



Standard Specification for “Fiberglass” (Glass-Fiber-Reinforced Thermosetting-Resin) Pressure Pipe¹

This standard is issued under the fixed designation D3517; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

This standard has been approved for use by agencies of the U.S. Department of Defense.

1. Scope*

1.1 This specification covers machine-made fiberglass pipe, 8 in. (200 mm) through 156 in. (4000 mm), intended for use in water conveyance systems which operate at internal gage pressures of 450 psi (3103 kPa) or less. Both glass-fiber-reinforced thermosetting-resin pipe (RTRP) and glass-fiber-reinforced polymer mortar pipe (RPMP) are fiberglass pipes. The standard is suited primarily for pipes to be installed in buried applications, although it may be used to the extent applicable for other installations such as, but not limited to, jacking, tunnel lining and slip-lining rehabilitation of existing pipelines.

NOTE 1—For the purposes of this standard, polymer does not include natural polymers.

1.2 The values stated in inch-pound units are to be regarded as the standard. The values given in parentheses are provided for information purposes only.

NOTE 2—There is no known ISO equivalent to this standard.

1.3 The following safety hazards caveat pertains only to the test methods portion, Section 8, of this specification: *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

2. Referenced Documents

2.1 ASTM Standards:²

[C33 Specification for Concrete Aggregates](#)

[D638 Test Method for Tensile Properties of Plastics](#)

[D695 Test Method for Compressive Properties of Rigid Plastics](#)

¹ This specification is under the jurisdiction of ASTM Committee D20 on Plastics and is the direct responsibility of Subcommittee D20.23 on Reinforced Plastic Piping Systems and Chemical Equipment.

Current edition approved March 1, 2014. Published March 2014. Originally approved in 1976. Last previous edition approved 2011 as D3517 – 11. DOI: 10.1520/D3517-14.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

[D790 Test Methods for Flexural Properties of Unreinforced and Reinforced Plastics and Electrical Insulating Materials](#)

[D883 Terminology Relating to Plastics](#)

[D1600 Terminology for Abbreviated Terms Relating to Plastics](#)

[D2290 Test Method for Apparent Hoop Tensile Strength of Plastic or Reinforced Plastic Pipe](#)

[D2412 Test Method for Determination of External Loading Characteristics of Plastic Pipe by Parallel-Plate Loading](#)

[D2584 Test Method for Ignition Loss of Cured Reinforced Resins](#)

[D2992 Practice for Obtaining Hydrostatic or Pressure Design Basis for “Fiberglass” \(Glass-Fiber-Reinforced Thermosetting-Resin\) Pipe and Fittings](#)

[D3567 Practice for Determining Dimensions of “Fiberglass” \(Glass-Fiber-Reinforced Thermosetting Resin\) Pipe and Fittings](#)

[D3892 Practice for Packaging/Packing of Plastics](#)

[D4161 Specification for “Fiberglass” \(Glass-Fiber-Reinforced Thermosetting-Resin\) Pipe Joints Using Flexible Elastomeric Seals](#)

[F412 Terminology Relating to Plastic Piping Systems](#)

[F477 Specification for Elastomeric Seals \(Gaskets\) for Joining Plastic Pipe](#)

2.2 ISO Standard:

[ISO 1172 Textile Glass Reinforced Plastics—Determination of Loss on Ignition³](#)

2.3 NSF Standard:

[Standard No. 61 Drinking Water System Components⁴](#)

3. Terminology

3.1 Definitions:

3.1.1 *General*—Definitions are in accordance with Terminology [D883](#) and Terminology [F412](#) and abbreviations are in accordance with Terminology [D1600](#), unless otherwise indicated.

³ Available from American National Standards Institute (ANSI), 25 W. 43rd St., 4th Floor, New York, NY 10036, <http://www.ansi.org>.

⁴ Available from NSF International, P.O. Box 130140, 789 N. Dixboro Rd., Ann Arbor, MI 48113-0140, <http://www.nsf.org>.

*A Summary of Changes section appears at the end of this standard

3.2 Definitions of Terms Specific to This Standard:

3.2.1 *fiberglass pipe*—a tubular product containing glass-fiber reinforcements embedded in or surrounded by cured thermosetting resin. The composite structure may contain aggregate, granular, or platelet fillers, thixotropic agents, pigments, or dyes. Thermoplastic or thermosetting liners or coatings may be included.

3.2.2 *flexible joint*—a joint that is capable of axial displacement or angular rotation, or both.

3.2.3 *liner*—a resin layer, with or without filler, or reinforcement, or both, forming the interior surface of the pipe.

3.2.4 *qualification test*—one or more tests used to prove the design of a product. Not a routine quality control test.

3.2.5 *reinforced polymer mortar pipe (RPMP)*—a fiberglass pipe with aggregate.

3.2.6 *reinforced thermosetting resin pipe (RTRP)*—a fiberglass pipe without aggregate.

3.2.7 *rigid joint*—a joint that is not capable of axial displacement or angular rotation.

3.2.8 *surface layer*—a resin layer, with or without filler, or reinforcements, or both, applied to the exterior surface of the pipe structural wall.

4. Classification

4.1 *General*—This specification covers fiberglass pressure pipe defined by raw materials in the structural wall (type) and liner, surface layer material (grade), operating pressure (class), and pipe stiffness. **Table 1** lists the types, liners, grades, classes, and stiffnesses that are covered.

NOTE 3—All possible combinations of types, liners, grades, classes, and stiffnesses may not be commercially available. Additional types, liners, grades, and stiffnesses may be added as they become commercially available. The purchaser should determine for himself or consult with the manufacturer for the proper class, type, liner, grade and stiffness of pipe to be used under the installation and operating conditions that will exist for the project in which the pipe is to be used.

4.2 *Designation Requirements*—The pipe materials designation code shall consist of the standard designation, ASTM D3517, followed by type, liner, and grade in Arabic numerals, class by the letter C and two or three Arabic numerals, and pipe stiffness by a capital letter. **Table 1** presents a summary of the designation requirements. Thus, a complete material code shall consist of ASTM D3517. . . three numerals, C . . . and two or three numerals, and a capital letter.

NOTE 4—Examples of the designation are as follows: (1) ASTM D3517-1-1-3-C50-A for glass-fiber reinforced aggregate and polyester resin mortar pipe with a reinforced thermoset liner and an unreinforced polyester resin and sand surface layer, for operation at 50 psi (345 kPa), and having a minimum pipe stiffness of 9 psi (62 kPa), (2) ASTM D3517-4-2-6-C200-C for glass-fiber reinforced epoxy resin pipe with a non-reinforced thermoset liner, no surface layer, for operation at 200 psi (1380 kPa), and having a minimum pipe stiffness of 36 psi (248 kPa).

NOTE 5—Although the “Form and Style for ASTM Standards” manual requires that the type classification be roman numerals, it is recognized that companies have stencil cutting equipment for this style of type, and it is therefore acceptable to mark the product type in arabic numbers.

5. Materials and Manufacture

5.1 *General*—The thermosetting resins, glass fiber reinforcements, fillers, and other materials, when combined as

a composite structure, shall produce piping products that meet the performance requirements of this specification.

5.2 *Wall Composition*—The basic structural wall composition shall consist of thermosetting resin, glass fiber reinforcement, and, if used, an aggregate filler.

5.2.1 *Resin*—A thermosetting polyester or epoxy resin, with or without filler.

5.2.2 *Reinforcement*—A commercial grade of glass fibers compatible with the resin used.

5.2.3 *Aggregate*—A siliceous sand conforming to the requirements of Specification C33, except that the requirements for gradation shall not apply.

NOTE 6—Fiberglass pipe intended for use in the transport of potable water should be evaluated and certified as safe for this purpose by a testing agency acceptable to the local health authority. The evaluation should be in accordance with requirements for chemical extraction, taste, and odor that are no less restrictive than those included in National Sanitation Foundation (NSF) Standard No. 61. The seal or mark of the laboratory making the evaluation should be included on the fiberglass pipe.

5.3 *Liner and Surface Layers*—Liner or surface layer, or both, when incorporated into or onto the pipe, shall meet the structural requirements of this specification.

5.4 *Joints*—The pipe shall have a joining system that shall provide for fluid tightness for the intended service condition. A particular type of joint may be restrained or unrestrained and flexible or rigid depending on the specific configuration and design conditions.

5.4.1 *Unrestrained*—Pipe joints capable of withstanding internal pressure but not longitudinal tensile loads.

5.4.1.1 *Coupling or Bell-and-Spigot Gasket Joints*, with a groove either on the spigot or in the bell to retain an elastomeric gasket that shall be the sole element of the joint to provide watertightness. For typical joint details see **Fig. 1**.

5.4.1.2 *Mechanical Coupling Joint*, with elastomeric seals.

5.4.1.3 *Butt Joint*, with laminated overlay.

5.4.1.4 *Flanged Joint*, both integral and loose ring.

5.4.2 *Restrained*—Pipe joints capable of withstanding internal pressure and longitudinal tensile loads..

5.4.2.1 Joints similar to those in **5.4.1.1** with supplemental restraining elements.

5.4.2.2 *Butt Joint*, with laminated overlay.

5.4.2.3 *Bell-and-Spigot*, with laminated overlay.

5.4.2.4 *Bell-and-Spigot*, adhesive-bonded joint: Three types of adhesive-bonded joints are permitted by this standard as follows:

(1) *Tapered bell-and-spigot*, an adhesive joint that is manufactured with a tapered socket for use in conjunction with a tapered spigot and a suitable adhesive.

(2) *Straight bell-and-spigot*, an adhesive joint that is manufactured with an untapered socket for use in conjunction with an untapered spigot and a suitable adhesive.

(3) *Tapered bell and straight spigot*, an adhesive joint that is manufactured with a tapered socket for use with an untapered spigot and a suitable adhesive.

5.4.2.5 *Flanged Joint*, both integral and loose ring

5.4.2.6 *Mechanical Coupling*, an elastomeric sealed coupling with a supplemental restraining elements.

5.4.2.7 *Threaded Joints*.



TABLE 1 General Designation Requirements for Fiberglass Pressure Pipe

| Designation Order | Property | Cell Limits (Note 1) | | | | | | | | |
|-------------------|-----------------------------|---|---|---|--|---------------|------|---------------|------|------|
| 1 | Type | 1 glass-fiber-reinforced thermosetting polyester (Note 2) resin mortar (RPMP polyester (Note 2)) | 2 glass-fiber-reinforced thermosetting polyester (RTRP polyester (Note 2)) | 3 glass-fiber-reinforced thermosetting epoxy resin mortar (RPMP epoxy) | 4 glass-fiber-reinforced thermosetting epoxy resin (RTRP epoxy) | | | | | |
| 2 | Liner | 1 reinforced thermoset liner | 2 non-reinforced thermoset liner | 3 thermoplastic liner | 4 no liner | | | | | |
| 3 | Grade | 1 polyester (Note 2) resin surface layer—reinforced | 2 polyester (Note 2) resin surface layer—non-reinforced | 3 polyester (Note 2) resin and sand surface layer nonreinforced | 4 epoxy resin surface layer—reinforced | | | | | |
| 4 | Class (Note 3) | C50 | C100 | C150 | C200 | C250 | C300 | C350 | C400 | C450 |
| 5 | Pipe Stiffness psi (kPa) | A 9 (62) | | B 18 (124) | | C 36 (248) | | D 72 (496) | | |

NOTE 1—The cell-type format provides the means of identification and specification of piping materials. This cell-type format, however, is subject to misapplication since unobtainable property combinations can be selected if the user is not familiar with non-commercially available products. The manufacturer should be consulted.

NOTE 2—For the purposes of this standard, polyester includes vinyl ester resins.

NOTE 3—Based on operating pressure in psig (numerals).




FIG. 1 Typical Joints

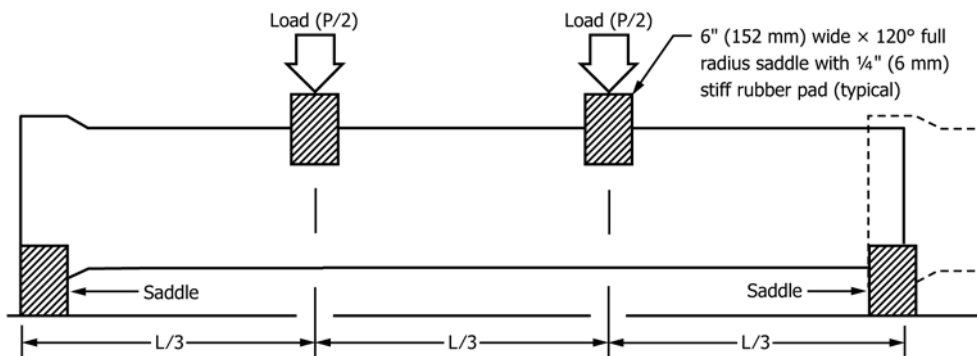


FIG. 2 Beam Strength—Test Setup

NOTE 7—Other types of joints may be added as they become commercially available.

NOTE 8—Restrained joints typically increase service loads on the pipe to greater than those experienced with unrestrained joints. The purchaser is cautioned to take into consideration all conditions that may be encountered in the anticipated service and to consult the manufacturer regarding the suitability of a particular type and class of pipe for service with restrained joint systems.

5.5 *Gaskets*—Elastomeric gaskets when used with this pipe shall conform to the requirements of Specification F477.

6. Requirements

6.1 Workmanship:

6.1.1 Each pipe shall be free from all defects including indentations, delaminations, bubbles, pinholes, cracks, pits, blisters, foreign inclusions, and resin-starved areas that due to their nature, degree, or extent, detrimentally affect the strength and serviceability of the pipe. The pipe shall be as uniform as commercially practicable in color, opacity, density, and other physical properties.

6.1.2 The inside surface of each pipe shall be free of bulges, dents, ridges, and other defects that result in a variation of inside diameter of more than $\frac{1}{8}$ in. (3.2 mm) from that obtained on adjacent unaffected portions of the surface. No glass fiber reinforcement shall penetrate the interior surface of the pipe wall.

6.1.3 Joint sealing surfaces shall be free of dents, gouges, and other surface irregularities that will affect the integrity of the joints.

6.2 Dimensions:

6.2.1 *Pipe Diameters*—Pipe shall be supplied in the nominal diameters shown in Table 2 or Table 3. The pipe diameter tolerances shall be as shown in Table 2 or Table 3, when measured in accordance with 8.1.1.

6.2.2 *Lengths*—Pipe shall be supplied in nominal lengths of 10, 20, 30, 40, and 60 ft. (3.05, 6.10, 9.15, 12.19, and 18.29 m). The actual laying length shall be the nominal length ± 2 in. (± 51 mm), when measured in accordance with 8.1.2. At least 90 % of the total footage of any one size and class, excluding

special order lengths, shall be furnished in the nominal lengths specified by the purchaser. Random lengths, if furnished, shall not vary from the nominal lengths by more than 5 ft (1.53 m) or 25 %, whichever is less.

6.2.3 *Wall Thickness*—The average wall thickness of the pipe shall not be less than the nominal wall thickness published in the manufacturer's literature current at the time of purchase, and the minimum wall thickness at any point shall not be less than 87.5 % of the nominal wall thickness when measured in accordance with 8.1.3.

6.2.4 *Squareness of Pipe Ends*—All points around each end of a pipe unit shall fall within $\pm \frac{1}{4}$ in. (± 6.4 mm) or ± 0.5 % of the nominal diameter of the pipe, whichever is greater, to a plane perpendicular to the longitudinal axis of the pipe, when measured in accordance with 8.1.4.

6.3 *Soundness*—Unless otherwise agreed upon between purchaser and supplier, test each length of pipe up to 96 in. (2400 mm) diameter hydrostatically without leakage or cracking, at the internal hydrostatic proof pressures specified for the applicable class in Table 4, when tested in accordance with 8.2. For sizes over 96 in. (2400 mm), the frequency of hydrostatic leak tests shall be as agreed upon by purchaser and supplier.

6.4 Hydrostatic Design Basis:

6.4.1 *Long-Term Hydrostatic Pressure*—The pressure classes shall be based on long-term hydrostatic pressure data obtained in accordance with 8.3 and categorized in accordance with Table 5. Pressure classes are based on extrapolated strengths at 50 years. For pipe subjected to longitudinal loads or circumferential bending, the effect of these conditions on the hydrostatic design pressure, classification of the pipe must be considered.

6.4.2 *Control Requirements*—Test pipe specimens periodically in accordance with Practice D2992.

NOTE 9—Hydrostatic design basis (HDB—extrapolated value at 50 years) determined in accordance with Procedure A of Practice D2992, may be substituted for the Procedure B evaluation required by 8.3. It is generally accepted that the Procedure A HDB value times 3 is equivalent to the Procedure B HDB value.

TABLE 2 Nominal Inside Diameters (ID) and Tolerances Inside Diameter Control Pipe

| Inch-Pound Units | | SI Units | | | |
|-------------------------------------|----------------|---|----------------------------|---------|---|
| Nominal Diameter ^A , in. | Tolerance, in. | Nominal Metric Diameter ^B , mm | ID Range ^B , mm | | Tolerance ^B on Declared ID, mm |
| | | | Minimum | Maximum | |
| 8 | ±0.25 | 200 | 196 | 204 | ±1.5 |
| 10 | ±0.25 | 250 | 246 | 255 | ±1.5 |
| 12 | ±0.25 | 300 | 296 | 306 | ±1.8 |
| 14 | ±0.25 | 400 | 396 | 408 | ±2.4 |
| 15 | ±0.25 | 500 | 496 | 510 | ±3.0 |
| 16 | ±0.25 | 600 | 595 | 612 | ±3.6 |
| 18 | ±0.25 | 700 | 695 | 714 | ±4.2 |
| 20 | ±0.25 | 800 | 795 | 816 | ±4.2 |
| 21 | ±0.25 | 900 | 895 | 918 | ±4.2 |
| 24 | ±0.25 | 1000 | 995 | 1020 | ±5.0 |
| 27 | ±0.27 | 1200 | 1195 | 1220 | ±5.0 |
| 30 | ±0.30 | 1400 | 1395 | 1420 | ±5.0 |
| 33 | ±0.33 | 1600 | 1595 | 1620 | ±5.0 |
| 36 | ±0.36 | 1800 | 1795 | 1820 | ±5.0 |
| 39 | ±0.39 | 2000 | 1995 | 2020 | ±5.0 |
| 42 | ±0.42 | (2200) | 2195 | 2220 | ±6.0 |
| 45 | ±0.45 | 2400 | 2395 | 2420 | ±6.0 |
| 48 | ±0.48 | (2600) | 2595 | 2620 | ±6.0 |
| 51 | ±0.51 | 2800 | 2795 | 2820 | ±6.0 |
| 54 | ±0.54 | (3000) | 2995 | 3020 | ±6.0 |
| 60 | ±0.60 | 3200 | 3195 | 3220 | ±7.0 |
| 66 | ±0.66 | (3400) | 3395 | 3420 | ±7.0 |
| 72 | ±0.72 | 3600 | 3595 | 3620 | ±7.0 |
| 78 | ±0.78 | (3800) | 3795 | 3820 | ±7.0 |
| 84 | ±0.84 | 4000 | 3995 | 4020 | ±7.0 |
| 90 | ±0.90 | ... | ... | ... | ... |
| 96 | ±0.96 | ... | ... | ... | ... |
| 102 | ±1.00 | ... | ... | ... | ... |
| 108 | ±1.00 | ... | ... | ... | ... |
| 114 | ±1.00 | ... | ... | ... | ... |
| 120 | ±1.00 | ... | ... | ... | ... |
| 132 | ±1.00 | ... | ... | ... | ... |
| 144 | ±1.00 | ... | ... | ... | ... |
| 156 | ±1.00 | ... | ... | ... | ... |

^A Inside diameters other than those shown shall be permitted by agreement between purchaser and supplier.

^B Values are taken from International Standards Organization documents. Parentheses indicate non-preferred diameters.

6.5 Stiffness—Each length of pipe shall have sufficient strength to exhibit the minimum pipe stiffness ($F/\Delta y$) specified in **Table 6**, when tested in accordance with **8.4**. At deflection level A per **Table 7**, there shall be no visible damage in the test specimen evidenced by surface cracks. At deflection level B per **Table 7**, there shall be no indication of structural damage as evidenced by interlaminar separation, separation of the liner or surface layer (if incorporated) from the structural wall, tensile failure of the glass fiber reinforcement, and fracture or buckling of the pipe wall.

NOTE 10—This is a visual observation (made with the unaided eye) for quality control purposes only and should not be considered a simulated service test. **Table 7** values are based on an in-use long-term deflection limit of 5 % and provide an appropriate uniform safety margin for all pipe stiffnesses. Since the pipe stiffness values ($F/\Delta y$) shown in **Table 6** vary, the percent deflection of the pipe under a given set of installation conditions will not be constant for all pipes. To avoid possible misapplication, take care to analyze all conditions which might affect performance of the installed pipe.

6.5.1 For other pipe stiffness levels, appropriate values for Level A and Level B deflections (**Table 7**) may be computed as follows:

$$\text{Level A at new PS} = \left(\frac{72}{\text{new PS}} \right)^{0.33} (9) \quad (1)$$

$$\text{Level B at new PS} = \text{new Level A} + 0.6$$

6.5.2 Since products may have use limits of other than 5 % long-term deflection, Level A and Level B deflections (**Table 7**) may be proportionally adjusted to maintain equivalent in-use safety margins. For example, a 4 % long-term limiting deflection would result in a 20 % reduction of Level A and Level B deflections, while a 6 % limiting deflection would result in a 20 % increase in Level A and Level B deflection values. However, minimum values for Level A and Level B deflections shall be equivalent to strains of 0.6 and 1.0 % respectively (as computed by Eq X1.4 in Appendix X1 of Specification D3262).

6.6 Hoop-Tensile Strength—All pipe manufactured under this specification shall meet or exceed the hoop-tensile strength shown for each size and class in **Table 8**, when tested in accordance with **8.5**.

TABLE 3 Nominal Outside Diameters (OD) and Tolerances

NOTE 1—The external diameter of the pipe at the spigots shall be within the tolerances given in the table, and the manufacturer shall declare his allowable maximum and minimum spigot diameters. Some pipes are manufactured such that the entire pipe meets the OD tolerances while other pipes meet the tolerances at the spigots, in which case, if such pipes are cut (shortened) the ends may need to be calibrated to meet the tolerances.

| Nominal Pipe Size, in. | Steel Pipe Equivalent (IPS) OD's, in. | Tolerance, in. | Cast Iron Pipe Equivalent OD's, in. | Tolerance, in. |
|---------------------------|---|-------------------|---|-------------------|
| 8 | 8.625 | +0.086 | 9.05 | |
| 10 | 10.750 | -0.040 | 11.10 | } ±0.06 |
| 12 | 12.750 | +0.108 | 13.20 | |
| 14 | 14.000 | -0.048 | 15.30 | |
| 16 | 16.000 | +0.128 | 17.40 | |
| 18 | ... | +0.140 | 19.50 | } +0.05 |
| 20 | ... | -0.062 | 21.60 | |
| 24 | ... | +0.160 | 25.80 | |
| 30 | ... | -0.070 | 32.00 | |
| 36 | ... | ... | 38.30 | } +0.08 |
| 42 | ... | ... | 44.50 | |
| 48 | ... | ... | 50.80 | |
| 54 | ... | ... | 57.56 | |
| 60 | ... | ... | 61.61 | } -0.06 |

| Metric Pipe Size, mm | Ductile Iron Pipe Equivalent, mm | Tolerance Upper, mm | Tolerance Lower, mm | International O.D., mm | Tolerance Upper, mm | Tolerance Lower, mm |
|-------------------------|-------------------------------------|------------------------|------------------------|---------------------------|------------------------|------------------------|
| 200 | 220.0 | +1.0 | 0.0 | ... | ... | ... |
| 250 | 271.8 | +1.0 | -0.2 | ... | ... | ... |
| 300 | 323.8 | +1.0 | -0.3 | 310 | +1.0 | -1.0 |
| 350 | 375.7 | +1.0 | -0.3 | 361 | +1.0 | -1.2 |
| 400 | 426.6 | +1.0 | -0.3 | 412 | +1.0 | -1.4 |
| 450 | 477.6 | +1.0 | -0.4 | 463 | +1.0 | -1.6 |
| 500 | 529.5 | +1.0 | -0.4 | 514 | +1.0 | -1.8 |
| 600 | 632.5 | +1.0 | -0.5 | 616 | +1.0 | -2.0 |
| 700 | | | | 718 | +1.0 | -2.2 |
| 800 | | | | 820 | +1.0 | -2.4 |
| 900 | | | | 924 | +1.0 | -2.6 |
| 1000 | | | | 1026 | +2.0 | -2.6 |
| 1200 | | | | 1229 | +2.0 | -2.6 |
| 1400 | | | | 1434 | +2.0 | -2.8 |
| 1600 | | | | 1638 | +2.0 | -2.8 |
| 1800 | | | | 1842 | +2.0 | -3.0 |
| 2000 | | | | 2046 | +2.0 | -3.0 |
| 2200 | | | | 2250 | +2.0 | -3.2 |
| 2400 | | | | 2453 | +2.0 | -3.4 |
| 2600 | | | | 2658 | +2.0 | -3.6 |
| 2800 | | | | 2861 | +2.0 | -3.8 |
| 3000 | | | | 3066 | +2.0 | -4.0 |
| 3200 | | | | 3270 | +2.0 | -4.2 |
| 3400 | | | | 3474 | +2.0 | -4.4 |
| 3600 | | | | 3678 | +2.0 | -4.6 |
| 3800 | | | | 3882 | +2.0 | -4.8 |
| 4000 | | | | 4086 | +2.0 | -5.0 |

6.6.1 *Alternative Requirements*—When agreed upon between the purchaser and the supplier, the minimum hoop-tensile strength shall be as determined in accordance with 8.5.1.

6.7 *Joint Tightness*—All joints shall meet the laboratory performance requirements, of Specification D4161. Unrestrained joints shall be tested with a fixed end closure condition and restrained joints shall be tested with a free end closure condition. Rigid joints shall be exempt from angular deflection

requirements of D4161. Rigid joints typically include butt joints with laminated overlay, bell-and-spigot joints with laminated overlay, flanged, bell-and-spigot adhesive bonded and threaded.

6.8 *Longitudinal Strength:*

6.8.1 *Beam Strength*—For pipe sizes up to 27 in. the pipe shall withstand, without failure, the beam loads specified in Table 9, when tested in accordance with 8.6.1. For pipe sizes larger than 27 in., and alternatively for smaller sizes, adequate

TABLE 4 Hydrostatic-Pressure Test

| Pressure Class | Hydrostatic Proof Pressure | |
|----------------|---|---|
| | Pipe Diameters up to and Including 54 in. | Pipe Diameters >54 in. up to and Including 96 in. |
| | (psi) psi (kPa) | (psi) psi (kPa) |
| C50 | 100 (689) | 75 (517) |
| C100 | 200 (1379) | 150 (1034) |
| C150 | 300 (2068) | 225 (1551) |
| C200 | 400 (2757) | 300 (2068) |
| C250 | 500 (3447) | 375 (2585) |
| C300 | 600 (4136) | 450 (3102) |
| C350 | 700 (4826) | 525 (3619) |
| C400 | 800 (5515) | 600 (4136) |
| C450 | 900 (6205) | 675 (4654) |

TABLE 5 Long-Term Hydrostatic Pressure Categories

| Class | Minimum Calculated Values of Long-Term Hydrostatic Pressure gage, psi (kPa) |
|-------|---|
| C50 | 90 (621) |
| C100 | 180 (1241) |
| C150 | 270 (1862) |
| C200 | 360 (2482) |
| C250 | 450 (3103) |
| C300 | 540 (3722) |
| C350 | 630 (4343) |
| C400 | 720 (4963) |
| C450 | 810 (5584) |

TABLE 6 Minimum Stiffness at 5 % Deflection

| Nominal Diameter, in. | Pipe Stiffness, psi (kPa) | | | |
|-----------------------|---------------------------|----------|----------|----------|
| | Designation | | | |
| | A | B | C | D |
| 8 | ... | ... | 36 (248) | 72 (496) |
| 10 | ... | 18 (124) | 36 (248) | 72 (496) |
| 12 and greater | 9 (62) | 18 (124) | 36 (248) | 72 (496) |

TABLE 7 Ring Deflection Without Damage or Structural Failure

| | Nominal Pipe Stiffness, psi | | | |
|---------|-----------------------------|------|------|------|
| | 9 | 18 | 36 | 72 |
| Level A | 18 % | 15 % | 12 % | 9 % |
| Level B | 30 % | 25 % | 20 % | 15 % |

beam strength is demonstrated by tension and compression tests conducted in accordance with 8.6.2 and 8.6.3, respectively, for pipe wall specimens oriented in the longitudinal direction, using the minimum tensile and compressive strength specified in Table 9.

6.8.2 *Longitudinal Tensile Strength*—All pipe manufactured under this specification shall have a minimum axial tensile elongation at failure of 0.25% and meet or exceed the longitudinal tensile strength shown for each size and class in Table 10, when tested in accordance with 8.6.2.

NOTE 11—The values listed in Table 10 are the minimum criteria for products made to this standard. The values may not be indicative of the axial strength of some products, or of the axial strength required by some installation conditions and joint configurations.

6.8.3 Conformance to the requirements of 6.8.1 shall satisfy the requirements of 6.8.2 for those pipe sizes and classes where

the minimum longitudinal tensile strength values of Table 9 are equal to the values of Table 10. Conformance to the requirements of 6.8.2 shall satisfy the longitudinal tensile strength requirements of 6.8.1.

7. Sampling

7.1 *Lot*—Unless otherwise agreed upon between the purchaser and the supplier, one lot shall consist of 100 lengths of each type, grade, and size of pipe produced.

7.2 *Production Tests*—Select one pipe at random from each lot and take one specimen from the pipe barrel to determine conformance of the material to the workmanship, dimensional, and stiffness, and strength requirements of 6.1, 6.2, 6.5, and 6.6, respectively. Unless otherwise agreed upon between purchaser and supplier, all pipes (up to 54-in. (1370-mm) diameter) shall meet the soundness requirements of 6.3.

7.3 *Qualification Tests*—Sampling for qualification tests (see section 3.2.4) is not required unless otherwise agreed upon between the purchaser and the supplier. Qualification tests, for which a certification and test report shall be furnished when requested by the purchaser include the following:

7.3.1 *Long-Term Hydrostatic Pressure Test.*

7.3.2 *Joint-Tightness Test (See 6.7).*

7.3.3 *Longitudinal-Strength Test, including:*

7.3.3.1 *Beam strength and*

7.3.3.2 *Longitudinal tensile strength.*

7.4 *Control Tests*—The following test is considered a control requirement and shall be performed as agreed upon between the purchaser and the supplier:

7.4.1 *Soundness Test*—102-in. (2600-mm) diameter pipe and larger.

7.4.2 Perform the sampling and testing for the control requirements for hydrostatic design basis at least once every two years.

7.5 For individual orders conduct only those additional tests and numbers of tests specifically agreed upon between the purchaser and the supplier.

8. Test Methods

8.1 *Dimensions:*

8.1.1 *Diameters:*

8.1.1.1 *Inside Diameter*—Take inside diameter measurements at a point approximately 6 in. (152 mm) from the end of the pipe section using a steel tape or an inside micrometer with graduations of 1/16 in. (1 mm) or less. Make two 90° opposing measurements at each point of measurement and average the readings.

8.1.1.2 *Outside Diameter*—Determine in accordance with Test Method D3567.

8.1.2 *Length*—Measure with a steel tape or gage having graduations of 1/16 in. (1 mm) or less. Lay the tape or gage on or inside the pipe and measure the overall laying length of the pipe.

8.1.3 *Wall Thickness*—Determine in accordance with Test Method D3567.

8.1.4 *Squareness of Pipe Ends*—Rotate the pipe on a mandrel or trunnions and measure the runout of the ends with a dial

TABLE 8 Minimum Hoop Tensile Strength of Pipe Wall

 NOTE 1—The values in this table are equal to $2PD$, where P is the pressure class in psi and D is the nominal diameter in inches.

| Inch-Pound Units | | | | | | | | | |
|------------------------|--------------------------------------|------------|------------|------------|------------|------------|------------|------------|------------|
| Nominal Diameter (in.) | Hoop Tensile Strength, lbf/in. Width | | | | | | | | |
| | Pressure Class | | | | | | | | |
| | C50 (psi) | C100 (psi) | C150 (psi) | C200 (psi) | C250 (psi) | C300 (psi) | C350 (psi) | C400 (psi) | C450 (psi) |
| 8 | 800 | 1600 | 2400 | 3200 | 4000 | 4800 | 5600 | 6400 | 7200 |
| 10 | 1000 | 2000 | 3000 | 4000 | 5000 | 6000 | 7000 | 8000 | 9000 |
| 12 | 1200 | 2400 | 3600 | 4800 | 6000 | 7200 | 8400 | 9600 | 10 800 |
| 14 | 1400 | 2800 | 4200 | 5600 | 7000 | 8400 | 9800 | 11 200 | 12 600 |
| 15 | 1500 | 3000 | 4500 | 6000 | 7500 | 9000 | 10 500 | 12 000 | 13 500 |
| 16 | 1600 | 3200 | 4800 | 6400 | 8000 | 9600 | 11 200 | 12 800 | 14 400 |
| 18 | 1800 | 3600 | 5400 | 7200 | 9000 | 10 800 | 12 600 | 14 400 | 16 200 |
| 20 | 2000 | 4000 | 6000 | 8000 | 10 000 | 12 000 | 14 000 | 16 000 | 18 000 |
| 21 | 2100 | 4200 | 6300 | 8400 | 10 500 | 12 600 | 14 700 | 16 800 | 18 900 |
| 24 | 2400 | 4800 | 7200 | 9600 | 12 000 | 14 400 | 16 800 | 19 200 | 21 600 |
| 27 | 2700 | 5400 | 8100 | 10 800 | 13 500 | 16 200 | 18 900 | 21 600 | 24 300 |
| 30 | 3000 | 6000 | 9000 | 12 000 | 15 000 | 18 000 | 21 000 | 24 000 | 27 000 |
| 33 | 3300 | 6600 | 9900 | 13 200 | 16 500 | 19 800 | 23 100 | 26 400 | 29 700 |
| 36 | 3600 | 7200 | 10 800 | 14 400 | 18 000 | 21 600 | 25 200 | 28 800 | 32 400 |
| 39 | 3900 | 7800 | 11 700 | 15 600 | 19 500 | 23 400 | 27 300 | 31 200 | 35 100 |
| 42 | 4200 | 8400 | 12 600 | 16 800 | 21 000 | 25 200 | 29 400 | 33 600 | 37 800 |
| 45 | 4500 | 9000 | 13 500 | 18 000 | 22 500 | 27 000 | 31 500 | 36 000 | 40 500 |
| 48 | 4800 | 9600 | 14 400 | 19 200 | 24 000 | 28 800 | 33 600 | 38 400 | 43 200 |
| 51 | 5100 | 10 200 | 15 300 | 20 400 | 25 500 | 30 600 | 35 700 | 40 800 | 45 900 |
| 54 | 5400 | 10 800 | 16 200 | 21 600 | 27 000 | 32 400 | 37 800 | 43 200 | 48 600 |
| 60 | 6000 | 12 000 | 18 000 | 24 000 | 30 000 | 36 000 | 42 000 | 48 000 | 54 000 |
| 66 | 6600 | 13 200 | 19 800 | 26 400 | 33 000 | 39 600 | 46 200 | 52 800 | 59 400 |
| 72 | 7200 | 14 400 | 21 600 | 28 800 | 36 000 | 43 200 | 50 400 | 57 600 | 64 800 |
| 78 | 7800 | 15 600 | 23 400 | 31 200 | 39 000 | 46 800 | 54 600 | 62 400 | 70 200 |
| 84 | 8400 | 16 800 | 25 200 | 33 600 | 42 000 | 50 400 | 58 800 | 67 200 | 75 600 |
| 90 | 9000 | 18 000 | 27 000 | 36 000 | 45 000 | 54 000 | 63 000 | 72 000 | 81 000 |
| 96 | 9600 | 19 200 | 28 800 | 38 400 | 48 000 | 57 600 | 67 200 | 76 800 | 86 400 |
| 102 | 10 200 | 20 400 | 30 600 | 40 800 | 51 000 | 61 200 | 71 400 | 81 600 | 91 800 |
| 108 | 10 800 | 21 600 | 32 400 | 43 200 | 54 000 | 64 800 | 75 600 | 86 400 | 97 200 |
| 114 | 11 400 | 22 800 | 34 200 | 45 600 | 57 000 | 68 400 | 79 800 | 91 200 | 10 2600 |
| 120 | 12 000 | 24 000 | 36 000 | 48 000 | 60 000 | 72 000 | 84 000 | 96 000 | 108 000 |
| 132 | 13 200 | 26 400 | 39 600 | 52 800 | 66 000 | 79 200 | 92 400 | 105 600 | 118 800 |
| 144 | 14 400 | 28 800 | 43 200 | 57 600 | 72 000 | 86 400 | 100 800 | 115 200 | 129 600 |
| 156 | 15 600 | 31 200 | 46 800 | 62 400 | 78 000 | 93 600 | 109 200 | 124 800 | 140 400 |

| SI Units | | | | | | | | | |
|----------------|----------------------------------|------------|------------|------------|------------|------------|------------|------------|------------|
| Pressure Class | Hoop Tensile Strength N/mm Width | | | | | | | | |
| | C50 (kPa) | C100 (kPa) | C150 (kPa) | C200 (kPa) | C250 (kPa) | C300 (kPa) | C350 (kPa) | C400 (kPa) | C450 (kPa) |
| 200 | 138 | 276 | 414 | 552 | 690 | 828 | 966 | 1104 | 1241 |
| 250 | 173 | 345 | 517 | 690 | 862 | 1035 | 1207 | 1380 | 1552 |
| 300 | 207 | 413 | 620 | 827 | 1034 | 1241 | 1448 | 1655 | 1862 |
| 350 | 242 | 482 | 724 | 965 | 1207 | 1448 | 1690 | 1931 | 2172 |
| 375 | 259 | 517 | 776 | 1034 | 1293 | 1552 | 1811 | 2069 | 2327 |
| 400 | 276 | 551 | 827 | 1103 | 1379 | 1655 | 1931 | 2207 | 2482 |
| 450 | 311 | 620 | 931 | 1241 | 1552 | 1862 | 2173 | 2483 | 2793 |
| 500 | 345 | 689 | 1034 | 1379 | 1724 | 2069 | 2414 | 2759 | 3103 |
| 550 | 380 | 758 | 1137 | 1517 | 1896 | 2276 | 2655 | 3035 | 3413 |
| 600 | 414 | 827 | 1241 | 1655 | 2069 | 2483 | 2897 | 3311 | 3724 |
| 700 | 483 | 965 | 1448 | 1931 | 2414 | 2897 | 3380 | 3863 | 4344 |
| 750 | 518 | 1034 | 1551 | 2069 | 2586 | 3104 | 3621 | 4139 | 4655 |
| 850 | 587 | 1171 | 1758 | 2344 | 2931 | 3517 | 4104 | 4690 | 5275 |
| 900 | 621 | 1240 | 1861 | 2482 | 3103 | 3724 | 4345 | 4966 | 5585 |
| 1000 | 690 | 1378 | 2068 | 2758 | 3448 | 4138 | 4828 | 5518 | 6206 |
| 1100 | 759 | 1516 | 2275 | 3034 | 3793 | 4552 | 5311 | 6070 | 6827 |
| 1150 | 794 | 1585 | 2378 | 3172 | 3965 | 4759 | 5552 | 6346 | 7137 |
| 1200 | 828 | 1654 | 2482 | 3310 | 4138 | 4966 | 5794 | 6622 | 7447 |
| 1300 | 897 | 1791 | 2688 | 3585 | 4482 | 5379 | 6276 | 7173 | 8068 |
| 1400 | 966 | 1929 | 2895 | 3861 | 4827 | 5793 | 6759 | 7725 | 8688 |
| 1500 | 1035 | 2067 | 3102 | 4137 | 5172 | 6207 | 7242 | 8277 | 9309 |
| 1700 | 1173 | 2343 | 3516 | 4689 | 5862 | 7035 | 8208 | 9381 | 10 550 |
| 1800 | 1242 | 2480 | 3722 | 4964 | 6206 | 7448 | 8690 | 9932 | 11 171 |
| 2000 | 1380 | 2756 | 4136 | 5516 | 6896 | 8276 | 9656 | 11 036 | 12 412 |
| 2200 | 1518 | 3032 | 4550 | 6068 | 7586 | 9104 | 10 622 | 12 140 | 13 653 |
| 2300 | 1587 | 3169 | 4756 | 6343 | 7930 | 9517 | 11 104 | 12 691 | 14 274 |
| 2400 | 1656 | 3307 | 4963 | 6619 | 8275 | 9931 | 11 587 | 13 243 | 14 894 |
| 2600 | 1794 | 3583 | 5377 | 7171 | 8965 | 10 759 | 12 553 | 14 347 | 16 136 |

| | | | | | | | | | |
|------|------|------|------|--------|--------|--------|--------|--------|--------|
| 2800 | 1932 | 3858 | 5790 | 7722 | 9654 | 11 586 | 13 518 | 15 450 | 17 377 |
| 2900 | 2001 | 3996 | 5997 | 7998 | 9999 | 12 000 | 14 001 | 16 002 | 17 997 |
| 3000 | 2070 | 4134 | 6204 | 8274 | 10 344 | 12 414 | 14 484 | 16 554 | 18 618 |
| 3400 | 2346 | 4685 | 7031 | 9377 | 11 723 | 14 069 | 16 415 | 18 761 | 21 100 |
| 3600 | 2484 | 4961 | 7445 | 9929 | 12 413 | 14 897 | 17 381 | 19 865 | 22 342 |
| 4000 | 2760 | 5512 | 8272 | 11 032 | 13 792 | 16 552 | 19 312 | 22 072 | 24 824 |

TABLE 9 Beam-Strength Test Loads

| Nominal Diameter, in. | Beam Load (<i>P</i>) | | Minimum Longitudinal Tensile Strength, per Unit of Circumference | | Minimum Longitudinal Compressive Strength, per Unit of Circumference | |
|-----------------------|------------------------|--------|--|--------|--|--------|
| | lbf | (kN) | lbf/in. | (kN/m) | lbf/in. | (kN/m) |
| 8 | 800 | (3.6) | 580 | (102) | 580 | (102) |
| 10 | 1200 | (5.3) | 580 | (102) | 580 | (102) |
| 12 | 1600 | (7.1) | 580 | (102) | 580 | (102) |
| 14 | 2200 | (9.8) | 580 | (102) | 580 | (102) |
| 15 | 2600 | (11.6) | 580 | (102) | 580 | (102) |
| 16 | 3000 | (13.3) | 580 | (102) | 580 | (102) |
| 18 | 4000 | (17.8) | 580 | (102) | 580 | (102) |
| 20 | 4400 | (19.6) | 580 | (102) | 580 | (102) |
| 21 | 5000 | (22.2) | 580 | (102) | 580 | (102) |
| 24 | 6400 | (28.5) | 580 | (102) | 580 | (102) |
| 27 | 8000 | (35.6) | 580 | (102) | 580 | (102) |
| 30 | ... | ... | 580 | (102) | 580 | (102) |
| 33 | ... | ... | 640 | (111) | 640 | (111) |
| 36 | ... | ... | 700 | (122) | 700 | (122) |
| 39 | ... | ... | 780 | (137) | 780 | (137) |
| 42 | ... | ... | 800 | (140) | 800 | (140) |
| 45 | ... | ... | 860 | (150) | 860 | (150) |
| 48 | ... | ... | 920 | (161) | 920 | (161) |
| 51 | ... | ... | 980 | (171) | 980 | (171) |
| 54 | ... | ... | 1040 | (182) | 1040 | (182) |
| 60 | ... | ... | 1140 | (200) | 1140 | (200) |
| 66 | ... | ... | 1260 | (220) | 1260 | (220) |
| 72 | ... | ... | 1360 | (238) | 1360 | (238) |
| 78 | ... | ... | 1480 | (260) | 1480 | (260) |
| 84 | ... | ... | 1600 | (280) | 1600 | (280) |
| 90 | ... | ... | 1720 | (301) | 1720 | (301) |
| 96 | ... | ... | 1840 | (322) | 1840 | (322) |
| 102 | ... | ... | 1940 | (340) | 1940 | (340) |
| 108 | ... | ... | 2060 | (360) | 2060 | (360) |
| 114 | ... | ... | 2180 | (382) | 2180 | (382) |
| 120 | ... | ... | 2280 | (400) | 2280 | (400) |
| 132 | ... | ... | 2520 | (440) | 2520 | (440) |
| 144 | ... | ... | 2740 | (480) | 2740 | (480) |
| 156 | ... | ... | 2964 | (519) | 2964 | (519) |

8.3 *Long-Term Hydrostatic Pressure*—Determine the long-term hydrostatic pressure at 50 years in accordance with Procedure B of Practice **D2992**, with the following exceptions permitted:

8.3.1 Test at ambient temperatures between 50 and 110°F (10 and 43.5°C) and report the temperature range experienced during the tests.

NOTE 12—Tests indicate no significant effects on long-term hydrostatic pressure within the ambient temperature range specified.

8.3.2 Determine the hydrostatic design basis for the glass fiber reinforcement in accordance with the method in **Annex A1**.

8.3.3 Calculate the long-term hydrostatic pressure and categorize by class in accordance with **Table 5**. **A1.6** explains how to calculate the long-term hydrostatic pressure.

8.4 *Stiffness*—Determine the pipe stiffness ($F/\Delta y$) at 5 % deflection for the specimen, using the apparatus and procedure of Test Method **D2412**, with the following exceptions permitted:

8.4.1 Measure the wall thickness to the nearest 0.01 in. (0.25 mm).

8.4.2 Load the specimen to 5 % deflection and record the load. Then load the specimen to deflection level A per **Table 7** and examine the specimen for visible damage evidenced by surface cracks. Then load the specimen to deflection level B per **Table 7** and examine for evidence of structural damage, as evidenced by interlaminar separation, separation of the liner or surface layer (if incorporated) from the structural wall, tensile failure of the glass fiber reinforcement, and fracture or buckling of the pipe wall. Calculate the pipe stiffness at 5 % deflection.

8.4.3 For production testing, test only one specimen to determine the pipe stiffness.

8.4.4 The maximum specimen length shall be 12 in. (305 mm), or the length necessary to include stiffening ribs, if they are used, whichever is greater.

NOTE 13—As an alternative to determining the pipe stiffness using the apparatus and procedure of Test Method **D2412** the supplier may submit to the purchaser for approval a test method and test evaluation on Test Method **D790**, accounting for the substitution of curved test specimens and measurement of stiffness at 5 % deflection.

8.5 *Hoop-Tensile Strength*—Determine the hoop-tensile strength by Test Method **D2290**, except that the sections on Apparatus and Test Specimens may be modified to suit the size of specimens to be tested, and the maximum load rate may not exceed 0.10 in/min. Alternatively, Test Method **D638** may be employed. Specimen width may be increased for pipe wall thicknesses greater than 0.55 in. (14 mm). Means may be provided to minimize the bending moment imposed during the test. Cut three specimens from the test sample. Record the load to fail each specimen and determine the specimen width as

indicator. The total indicated reading is equal to twice the distance from a plane perpendicular to the longitudinal axis of the pipe. Alternatively, when squareness of pipe ends is rigidly fixed by tooling, the tooling may be verified and reinspected at frequent enough intervals to ensure that the squareness of the pipe ends is maintained within tolerance.

8.2 *Soundness*—Determine soundness by a hydrostatic proof test procedure. Place the pipe in a hydrostatic pressure testing machine that seals the ends and exerts no end loads. Fill the pipe with water, expelling all air, and apply internal water pressure at a uniform rate not to exceed 50 psi (345 kPa)/s until the **Table 4** test pressure specified in accordance with **6.3** is reached. Maintain this pressure for a minimum of 30 s. The pipe shall show no visual signs of weeping, leakage, or fracture of the structural wall.

TABLE 10 Longitudinal Tensile Strength of Pipe Wall

| Inch-Pound Units | | | | | | | | | |
|------------------------|--|------------|------------|------------|------------|------------|------------|------------|------------|
| Nominal Diameter (in.) | Longitudinal Tensile Strength lbf/in. of Circumference | | | | | | | | |
| | Pressure Class | | | | | | | | |
| | C50 (psi) | C100 (psi) | C150 (psi) | C200 (psi) | C250 (psi) | C300 (psi) | C350 (psi) | C400 (psi) | C450 (psi) |
| 8 | 580 | 580 | 580 | 580 | 580 | 624 | 700 | 800 | 900 |
| 10 | 580 | 580 | 580 | 580 | 650 | 780 | 875 | 1000 | 1125 |
| 12 | 580 | 580 | 580 | 624 | 780 | 936 | 1050 | 1200 | 1350 |
| 14 | 580 | 580 | 609 | 728 | 910 | 1092 | 1225 | 1400 | 1575 |
| 15 | 580 | 580 | 653 | 780 | 975 | 1170 | 1313 | 1500 | 1688 |
| 16 | 580 | 580 | 696 | 832 | 1040 | 1248 | 1400 | 1600 | 1800 |
| 18 | 580 | 580 | 783 | 936 | 1170 | 1404 | 1575 | 1800 | 2025 |
| 20 | 580 | 580 | 870 | 1040 | 1300 | 1560 | 1750 | 2000 | 2250 |
| 21 | 580 | 609 | 914 | 1092 | 1365 | 1638 | 1838 | 2100 | 2363 |
| 24 | 580 | 696 | 1044 | 1248 | 1560 | 1800 | 2100 | 2400 | 2700 |
| 27 | 580 | 783 | 1175 | 1404 | 1688 | 2025 | 2363 | 2700 | 3038 |
| 30 | 580 | 870 | 1305 | 1560 | 1875 | 2250 | 2625 | 3000 | 3375 |
| 33 | 627 | 957 | 1436 | 1716 | 2063 | 2475 | 2888 | 3300 | 3713 |
| 36 | 684 | 1044 | 1566 | 1800 | 2250 | 2700 | 3150 | 3600 | 4050 |
| 39 | 741 | 1131 | 1697 | 1872 | 2340 | 2808 | 3276 | 3744 | 4212 |
| 42 | 798 | 1218 | 1827 | 2016 | 2520 | 3024 | 3528 | 4032 | 4536 |
| 45 | 855 | 1305 | 1958 | 2160 | 2700 | 3240 | 3780 | 4320 | 4860 |
| 48 | 912 | 1392 | 2088 | 2304 | 2880 | 3456 | 4032 | 4608 | 5184 |
| 51 | 969 | 1479 | 2219 | 2448 | 3060 | 3672 | 4284 | 4896 | 5508 |
| 54 | 1026 | 1566 | 2349 | 2592 | 3240 | 3726 | 4347 | 4968 | 5589 |
| 60 | 1140 | 1740 | 2520 | 2880 | 3600 | 4140 | 4830 | 5520 | 6210 |
| 66 | 1254 | 1914 | 2673 | 3036 | 3795 | 4554 | 5313 | 5808 | 6534 |
| 72 | 1368 | 2088 | 2916 | 3312 | 4140 | 4968 | 5796 | 6336 | 7128 |
| 78 | 1482 | 2106 | 3159 | 3432 | 4290 | 5148 | 6006 | 6864 | 7722 |
| 84 | 1596 | 2268 | 3402 | 3696 | 4620 | 5292 | 6174 | 7056 | 7938 |
| 90 | 1710 | 2430 | 3645 | 3960 | 4950 | 5670 | 6615 | 7380 | 8303 |
| 96 | 1824 | 2592 | 3888 | 4224 | 5280 | 6048 | 7056 | 7680 | 8640 |
| 102 | 1938 | 2754 | 4131 | 4488 | 5610 | 6426 | 7497 | 8160 | 9180 |
| 108 | 2052 | 2916 | 4374 | 4752 | 5940 | 6804 | 7938 | 8640 | 9720 |
| 114 | 2166 | 3078 | 4617 | 5016 | 6270 | 7182 | 8379 | 9120 | 10 260 |
| 120 | 2280 | 3240 | 4860 | 5280 | 6600 | 7560 | 8820 | 9600 | 10 800 |
| 132 | 2508 | 3564 | 5346 | 5808 | 7260 | 8316 | 9702 | 10 560 | 11 880 |
| 144 | 2736 | 3888 | 5832 | 6336 | 7920 | 9072 | 10 584 | 11 520 | 12 960 |
| 156 | 2964 | 4212 | 6318 | 6864 | 8580 | 9828 | 11 466 | 12 480 | 14 040 |

| SI Units | | | | | | | | | |
|-----------------------|---|-----------|------------|------------|------------|------------|------------|------------|------------|
| Pressure Class | Longitudinal Tensile Strength N/mm of Circumference | | | | | | | | |
| | C50 | C100 | C150 | C200 | C250 | C300 | C350 | C400 | C450 |
| Nominal Diameter (mm) | 345 (kPa) | 689 (kPa) | 1034 (kPa) | 1379 (kPa) | 1724 (kPa) | 2069 (kPa) | 2414 (kPa) | 2759 (kPa) | 3103 (kPa) |
| 200 | 102 | 102 | 102 | 102 | 102 | 109 | 123 | 140 | 158 |
| 250 | 102 | 102 | 102 | 102 | 114 | 137 | 153 | 175 | 197 |
| 300 | 102 | 102 | 102 | 109 | 137 | 164 | 184 | 210 | 236 |
| 350 | 102 | 102 | 107 | 127 | 159 | 191 | 215 | 245 | 276 |
| 375 | 102 | 102 | 114 | 137 | 171 | 205 | 230 | 263 | 296 |
| 400 | 102 | 102 | 122 | 146 | 182 | 219 | 245 | 280 | 315 |
| 450 | 102 | 102 | 137 | 164 | 205 | 246 | 276 | 315 | 355 |
| 500 | 102 | 102 | 152 | 182 | 228 | 273 | 306 | 350 | 394 |
| 550 | 102 | 107 | 160 | 191 | 239 | 287 | 322 | 368 | 414 |
| 600 | 102 | 122 | 183 | 219 | 273 | 315 | 368 | 420 | 473 |
| 700 | 102 | 137 | 206 | 246 | 296 | 355 | 414 | 473 | 532 |
| 750 | 102 | 152 | 229 | 273 | 328 | 394 | 460 | 525 | 591 |
| 850 | 110 | 168 | 251 | 301 | 361 | 433 | 506 | 578 | 650 |
| 900 | 120 | 183 | 274 | 315 | 394 | 473 | 552 | 630 | 709 |
| 1000 | 130 | 198 | 297 | 328 | 410 | 492 | 574 | 656 | 738 |
| 1100 | 140 | 213 | 320 | 353 | 441 | 530 | 618 | 706 | 794 |
| 1150 | 150 | 229 | 343 | 378 | 473 | 567 | 662 | 757 | 851 |
| 1200 | 160 | 244 | 366 | 403 | 504 | 605 | 706 | 807 | 908 |
| 1300 | 170 | 259 | 388 | 429 | 536 | 643 | 750 | 857 | 965 |
| 1400 | 180 | 274 | 411 | 454 | 567 | 652 | 761 | 870 | 979 |
| 1500 | 200 | 305 | 441 | 504 | 630 | 725 | 846 | 967 | 1087 |
| 1700 | 220 | 335 | 468 | 532 | 665 | 797 | 930 | 1017 | 1144 |
| 1800 | 240 | 366 | 511 | 580 | 725 | 870 | 1015 | 1110 | 1248 |
| 2000 | 260 | 369 | 553 | 601 | 751 | 902 | 1052 | 1202 | 1352 |
| 2200 | 279 | 397 | 596 | 647 | 809 | 927 | 1081 | 1236 | 1390 |
| 2300 | 299 | 426 | 638 | 693 | 867 | 993 | 1158 | 1292 | 1454 |
| 2400 | 319 | 454 | 681 | 740 | 925 | 1059 | 1236 | 1345 | 1513 |
| 2600 | 339 | 482 | 723 | 786 | 982 | 1125 | 1313 | 1429 | 1608 |
| 2800 | 359 | 511 | 766 | 832 | 1040 | 1192 | 1390 | 1513 | 1702 |
| 2900 | 379 | 539 | 809 | 878 | 1098 | 1258 | 1467 | 1597 | 1797 |

| | | | | | | | | | |
|------|-----|-----|------|------|------|------|------|------|------|
| 3000 | 399 | 567 | 851 | 925 | 1156 | 1324 | 1545 | 1681 | 1891 |
| 3400 | 439 | 624 | 936 | 1017 | 1271 | 1456 | 1699 | 1849 | 2080 |
| 3600 | 479 | 681 | 1021 | 1110 | 1387 | 1589 | 1853 | 2017 | 2270 |
| 4000 | 519 | 738 | 1106 | 1202 | 1503 | 1721 | 2008 | 2185 | 2459 |

close to the break as possible. Use the measured width and failure load to calculate the hoop-tensile strength.

8.5.1 Alternative Minimum Hoop-Tensile Strength Requirement—As an alternative, the minimum hoop-tensile strength values may be determined as follows:

$$F = (S_i/S_r)(Pr) \quad (2)$$

where:

- F = required minimum hoop tensile strength, lbf/in.,
- S_i = initial design hoop tensile stress, psi,
- S_r = hoop tensile stress at rated operating pressure, psi,
- P = rated operating pressure class, psi, and
- r = inside radius of pipe, in.

NOTE 14—A value of F less than $4 Pr$ results in a lower factor of safety on short term loading than required by the values in Table 8.

The value for S_i should be established by considering the variations in glass reinforcement strength and manufacturing methods, but in any case should not be less than the 95 % lower confidence value on stress at 0.1 h, as determined by the manufacturer’s testing carried out in accordance with 6.4. The value for S_r should be established from the manufacturer’s hydrostatic design basis.

8.6 Longitudinal Strength:

8.6.1 Beam Strength—Place a 20-ft (6.1-m) nominal length of pipe on saddles at each end. Hold the ends of the pipe round during the test. Apply beam load for the diameter of pipe shown in Table 9 simultaneously to the pipe through two saddles located at the third points of the pipe (see Fig. 2). The

loads shall be maintained for not less than 10 min with no evidence of failure. The testing apparatus shall be designed to minimize stress concentrations at the loading points.

8.6.2 Longitudinal Tensile Strength—Determine in accordance with Test Method D638, except the provision for maximum thickness shall not apply.

8.6.3 Longitudinal Compressive Strength—Determine in accordance with Test Method D695.

9. Packaging and Package Marking

9.1 Mark each length of pipe that meets or is part of a lot that meets the requirements of this specification at least once in letters not less than ½ in. (12 mm) in height and of bold-type style in a color and type that remains legible under normal handling and installation procedures. The marking shall include the nominal pipe size, manufacturer’s name or trademark, this ASTM specification number: D3517, type, liner, grade, class, and stiffness in accordance with the designation code in 4.2.

9.2 Prepare pipe for commercial shipment in such a way as to ensure acceptance by common or other carriers.

9.3 All packing, packaging, and marking provisions of Practice D3892 shall apply to this specification.

10. Keywords

10.1 fiberglass pipe; hydrostatic design basis; pressure pipe; RPMP; RTRP

ANNEX

(Mandatory Information)

A1. ALTERNATIVE HYDROSTATIC DESIGN METHOD

A1.1 The following symbols are used:

- S = tensile stress in the glass fiber reinforcement in the hoop orientation corrected for the helix angle, psi,
- P = internal pressure, psig,
- P_l = long-term hydrostatic pressure, psig,
- D = nominal inside pipe diameter, in.,
- t_h = actual cross-sectional area of glass-fiber reinforcement applied around the circumference of the pipe, in.²/in.,

- θ = plane angle between hoop-oriented reinforcement and longitudinal axis of the pipe (helix angle), and
- HDB = hydrostatic-design basis, psi.

A1.2 The hydrostatic design is based on the estimated tensile stress of the reinforcement in the wall of the pipe in the circumferential (hoop) orientation that will cause failure after 50 years of continuously applied pressure as described in Procedure B of Practice D2992. Strength requirements are calculated using the strength of hoop-oriented glass reinforcement only, corrected for the helix angle of the fibers.

A1.3 *Hoop-Stress Calculation* is derived from the ISO equation for hoop stress, as follows:

$$S = PD/2(t_h \sin\theta)$$

This stress is used as the ordinate (long-term strength) in calculating the regression line and lower confidence limit in accordance with Annexes A1 and A3 of Practice **D2992**.

NOTE A1.1—The calculated result for S may be multiplied by the factor 6.895 to convert from psi to kPa.

A1.4 *Hydrostatic-Design Basis*—The value of S is determined by extrapolation of the regression line to or 50 years in accordance with Practice **D2992**.

A1.5 *Hydrostatic-Design Basis Categories*—Convert the value of the HDB to internal hydrostatic pressure in psig as follows:

$$P_1 = 2(t_h \sin\theta)(\text{HDB})/D$$

The pipe is categorized in accordance with **Table A1.1**.

NOTE A1.2—The calculated result P_1 may be multiplied by the factor 6.895 to convert from psig to kPa.

A1.6 *Pressure Class Rating*—The classes shown in **Table A1.1** are based on the intended working pressure in psig for commonly encountered conditions of water service. The purchaser should determine the class of pipe most suitable to the installation and operating conditions that will exist on the project on which the pipe is to be used by multiplying the

TABLE A1.1 Long-Term Hydrostatic Pressure Categories

| Class | Minimum Calculated Values of Long-Term Hydrostatic Pressure gage, psi (kPa) |
|-------|---|
| C50 | 90 (621) |
| C100 | 180 (1241) |
| C150 | 270 (1862) |
| C200 | 360 (2482) |
| C250 | 450 (3103) |
| C300 | 540 (3722) |
| C350 | 630 (4343) |
| C400 | 720 (4963) |
| C450 | 810 (5584) |

values of P_1 from **Table A1.1** by a service (design) factor selected for the application on the basis of two general groups of conditions. The first group considers the manufacturing and testing variables, specifically normal variations in the material, manufacture, dimensions, good handling techniques, and in the evaluation procedures in this method. The second group considers the application or use, specifically installation, environment, temperature, hazard involved, life expectancy desired, and the degree of reliability selected.

NOTE A1.3—It is not the intent of this standard to give service (design) factors. The service (design) factor should be selected by the design engineer after evaluating fully the service conditions and the engineering properties of the specific plastic pipe material under consideration. Recommended service (design) factors will not be developed or issued by ASTM.

APPENDIXES

(Nonmandatory Information)

X1. INSTALLATION

X1.1 These specifications are material performance and purchase specifications only and do not include requirements for engineering design, pressure surges, bedding, backfill or the relationship between earth cover load, and the strength of the pipe. However, experience has shown that successful performance of this product depends upon the proper type of bedding

and backfill, pipe characteristics, and care in the field construction work. The purchaser of the fiberglass pressure pipe specified herein is cautioned that he must properly correlate the field requirements with the pipe requirements and provide adequate inspection at the job site.

X2. RECOMMENDED METHODS FOR DETERMINING GLASS CONTENT

X2.1 Determine glass content as follows:

X2.1.1 By ignition loss analysis in accordance with Test Method **D2584** or ISO 1172.

X2.1.2 As a process control, by weight of the glass fiber reinforcement applied by machine into the pipe structure.

SUMMARY OF CHANGES

Committee D20 has identified the location of selected changes to this standard since the last issue (D3517 – 11) that may impact the use of this standard. (March 1, 2014)

(1) Revised **Table 4, 6.3, and 7.4.1.**

ASTM International takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.

This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.

This standard is copyrighted by ASTM International, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website (www.astm.org). Permission rights to photocopy the standard may also be secured from the Copyright Clearance Center, 222 Rosewood Drive, Danvers, MA 01923, Tel: (978) 646-2600; <http://www.copyright.com/>