



# Standard Practice for Measuring the Uniformity of Furnace Exposure on Test Specimens<sup>1</sup>

This standard is issued under the fixed designation E2749; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon ( $\epsilon$ ) indicates an editorial change since the last revision or reapproval.

## 1. Scope

1.1 This standard provides general principles for measuring the uniformity of the furnace exposure on specimens tested in accordance with Test Methods [E119](#), [E814](#), [E1529](#), [E1725](#), [E1966](#) and [E2336](#).

1.2 This practice specifies the materials and the construction requirements for a standardized test specimen used to provide a mounting surface for the instrumentation that measures furnace exposure.

1.3 The instrumentation records temperatures, pressure differentials and oxygen content near the surface of the test specimen.

1.4 The values stated in SI units are to be regarded as the standard. The units given in parentheses are for information only.

1.5 *This standard is used to measure and describe the response of materials, products, or assemblies to heat and flame under controlled conditions, but does not by itself incorporate all factors required for fire hazard or fire risk assessment of the materials, products, or assemblies under actual fire conditions.*

1.6 *Fire testing is inherently hazardous. Adequate safeguards for personnel and property shall be employed in conducting these tests.*

1.7 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

<sup>1</sup> This practice is under the jurisdiction of ASTM Committee [E05](#) on Fire Standards and is the direct responsibility of Subcommittee [E05.11](#) on Fire Resistance.

Current edition approved June 1, 2015. Published July 2015. Originally approved in 2010. Last previous edition approved in 2015 as E2749-15. DOI:10.1520/E2749-15A.

## 2. Referenced Documents

### 2.1 *ASTM Standards:*<sup>2</sup>

- [C1396/C1396M](#) Specification for Gypsum Board
- [E119](#) Test Methods for Fire Tests of Building Construction and Materials
- [E176](#) Terminology of Fire Standards
- [E814](#) Test Method for Fire Tests of Penetration Firestop Systems
- [E1529](#) Test Methods for Determining Effects of Large Hydrocarbon Pool Fires on Structural Members and Assemblies
- [E1725](#) Test Methods for Fire Tests of Fire-Resistive Barrier Systems for Electrical System Components
- [E1966](#) Test Method for Fire-Resistive Joint Systems
- [E2336](#) Test Methods for Fire Resistive Grease Duct Enclosure Systems

### 2.2 *ISO Technical Report:*

- [ISO/TR 834-2](#) Fire resistance tests – Elements of building construction – Part 2: Guide on measuring uniformity of furnace exposure on test samples

## 3. Terminology

3.1 *Definitions*—For definitions of terms used in this practice, refer to Terminology [E176](#).

### 3.2 *Definitions of Terms Specific to This Standard:*

3.2.1 *effective area of the furnace opening*—furnace opening within the boundaries of the monitoring instrumentation.

## 4. Summary of Practice

4.1 This practice consists of preparing a standardized test specimen to represent test specimens described in Test Methods [E119](#), [E814](#), [E1529](#), [E1725](#), [E1966](#) and [E2336](#). The

<sup>2</sup> For referenced ASTM standards, visit the ASTM website, [www.astm.org](http://www.astm.org), or contact ASTM Customer Service at [service@astm.org](mailto:service@astm.org). For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

standardized test specimen provides a low cost, easily constructed supporting construction for the mounting of instrumentation that measures the exposure imposed by the furnace onto test specimens.

4.2 The standardized test specimen consists of two layers of 15.9 mm (5/8 in.) thick Type X gypsum board on the surface facing the furnace chamber attached to steel channels and a single layer of structural panels (plywood or oriented strand board) attached to the steel channels on the surface away from the furnace chamber. The gypsum board provides a fire-resistive surface for the mounting of the instrumentation. The structural panels provide stability for the steel support channels.

4.3 Instrumentation to measure the thermal impact due to exposure to the furnace upon the standardized test specimen is installed at various locations on the exposed surface of the standardized test specimen. Probes used to gather air samples within the furnace chamber are also installed.

4.4 The standardized test specimen is exposed to the time-temperature curve specified in referenced ASTM fire test standards for a time period of 45 min during which time data are recorded by the instrumentation mounted on the standardized test specimen.

4.5 The data provide a record of the conditions and uniformity of the furnace exposure upon standardized test specimens. The area bounded by the instrumentation installed on the standardized test specimen is designated as the effective area of the furnace opening.


## 5. Significance and Use

5.1 This practice describes a procedure to gather data intended to measure the uniformity of exposure conditions upon test specimens for the fire test methods described in Test Methods E119, E814, E1529, E1725, E1966 and E2336. The collected data from furnaces are intended to form a basis for performance requirements for the furnaces described in the referenced standards.

5.2 This practice does not include requirements for furnace performance.

5.3 In this procedure, the standardized test specimen is subjected to one or more specific sets of laboratory test conditions. If different test conditions are substituted or the end-use conditions are changed, it is not always possible by or from this procedure to predict changes in the fire-test-response characteristics measured. Therefore, the results are valid only for the fire-test-exposure conditions described in this procedure.

5.4 The attention of all persons connected with the conduct of this practice is drawn to the fact that fire testing is hazardous and that there is a possibility that harmful smoke and gases are developed during the test. There is also a possibility that mechanical and operational hazards develop during the construction of the test specimen and the disposal of the test residues. An assessment of all potential hazards and risks to health shall be made and safety precautions shall be identified and provided. Written safety instructions shall be issued.

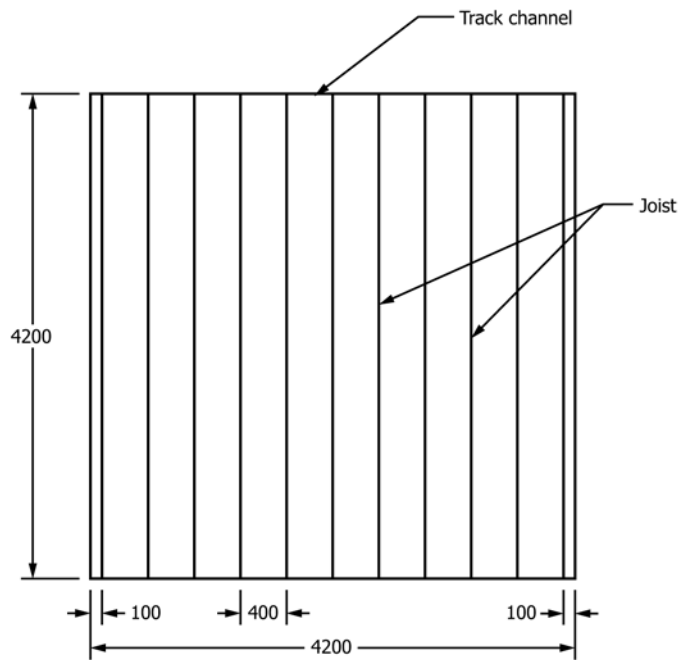

Dimensions in millimetres.

FIG. 1 Horizontal Standardized Test Specimen, Location of Joists and Track Channels

Appropriate training shall be provided to relevant personnel. Laboratory personnel shall ensure that they follow written safety instructions at all times.

## 6. Apparatus

6.1 The furnace(s) and restraining frame(s) used to conduct tests in accordance with Test Methods E119, E814, E1529, E1725, E1966 and E2336 shall be used.

### 6.2 Standardized Test Specimen:


6.2.1 *Materials*—The materials used to construct the standardized test specimen shall consist of the following: gypsum board, structural panels, cold-formed steel supports and fasteners.

6.2.1.1 The gypsum board shall be minimum 15.9 mm (5/8 in.) thick complying with the requirements of Type X as defined in Specification C1396/C1396M.

6.2.1.2 The structural panels shall be minimum 18 mm (nominal 3/4 in.) thick. Typical materials include plywood and oriented strand boards.

6.2.1.3 The cold-formed steel joists for horizontal specimens shall be fabricated from minimum 1.4 mm thick (0.055 in.) steel. The cold formed steel joists shall be “C” shaped having a minimum depth of 240 mm (9½ in.), a minimum flange width of 40 mm (1½ in.) and a minimum lip length of 12 mm (½ in.).

6.2.1.4 The cold-formed steel wall studs for vertical specimens shall be fabricated from minimum 0.9 mm thick (0.035 in.) steel. The cold-formed steel wall studs shall be “C” shaped having a minimum depth of 90 mm (3½ in.), a minimum flange width of 30 mm (1¼ in.) and a minimum folded back return flange legs of 5 mm (¼ in.).

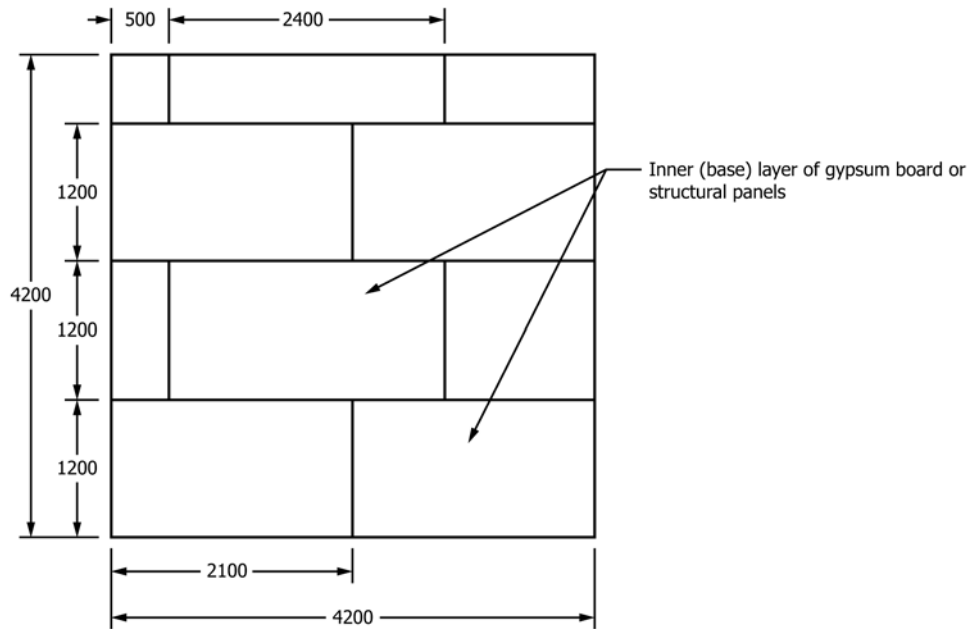

Dimensions in millimetres.

**FIG. 2 Horizontal Standardized Test Specimen, Location of Inner Layer of Gypsum Board and Structural Panels**

6.2.1.5 The cold-formed steel track channels for the horizontal and vertical specimens shall be “C” shaped having a depth compatible with the joists or wall studs being used.

6.2.1.6 Steel fasteners used to attach the gypsum board to the studs shall be designed for the attachment of gypsum board to steel supports. Typical screws have a thread diameter of 5 mm (1/4 in.) and a head diameter of 8 mm (3/8 in.). The steel fasteners used to attach the inner layer shall have a minimum length of 25 mm (1 in.). The steel fasteners used to attach the exposed layer shall have a minimum length of 40 mm (1 5/8 in.).

6.2.1.7 Fasteners used to attach the structural panels to the studs shall be designed for the attachment of the panels to steel supports.

6.2.2 *Construction Method*—Standardized horizontal test specimen.

6.2.2.1 The construction details with respect to the location of the joists, track channels, gypsum board and the structural panels are shown in Figs. 1-3. The construction details assume a furnace opening of 4.2 by 4.2 m (13 ft 9 3/8 in. by 13 ft 9 3/8 in.). Modifications to dimensions are necessary for other furnace openings.

6.2.2.2 The steel joists shall be spaced 300 to 450 mm (11 7/8 in. to 17 3/4 in.) on center. The joists are inserted into the track channels. The use of steel clip angles are permissible to facilitate the attachment of the joists to the track channels.

6.2.2.3 The inner layer of gypsum board shall be attached to the joists with the steel screws spaced a maximum of 200 mm (7 7/8 in.) on center along each joist. A distance of 10 to 15 mm (3/8 to 5/8 in.) shall be provided between the screws and the edges of the gypsum board.

NOTE 1—The inner layer, or base layer, of gypsum board is in contact with the joists.

6.2.2.4 The exposed layer of gypsum board shall be attached to the joists with steel screws spaced a maximum 200

mm (7 7/8 in.) on center along each joist and shall be spaced 100 mm (4 in.) from the screws used to attach the inner layer. A distance of 10 to 15 mm (3/8 to 5/8 in.) shall be provided between the screws and the edges of the gypsum board.

NOTE 2—The exposed layer, or outside layer, of gypsum board is in contact with the inner layer of gypsum board.

6.2.2.5 The structural panels shall be attached to the joists with steel screws spaced a maximum of 150 mm (5 7/8 in.) on center along each joist. A distance of 10 to 15 mm (3/8 to 5/8 in.) shall be provided between the screws and the edges of the structural panels. Holes are permissible in the structural panels to facilitate the installation of the instrumentation.

6.2.3 *Construction Method*—Vertical Standardized Test Specimen:


6.2.3.1 The construction details with respect to the location of the wall studs, track channels, gypsum board and the structural panels are shown in Figs. 4-6. The construction details assume a furnace opening of 3.1 by 3.1 m (10 ft. 2 in. by 10 ft. 2 in.). Modifications to dimensions are necessary for other furnace openings.

6.2.3.2 The wall studs shall be spaced 300 to 450 mm (11 7/8 to 17 3/4 in.) on center. The studs are inserted into track channels. The use of steel clip angles are permissible to facilitate the attachment of the studs to the track channels.

6.2.3.3 The inner layer of gypsum board shall be attached to the studs with the steel screws spaced a maximum of 200 mm (7 7/8 in.) on center along each stud. A distance of 10 to 15 mm (3/8 to 5/8 in.) shall be provided between the screws and the edges of the gypsum board.


NOTE 3—The inner layer, or base layer, of gypsum board is in contact with the studs.

6.2.3.4 The exposed layer of gypsum board shall be attached to the studs with steel screws spaced a maximum 200

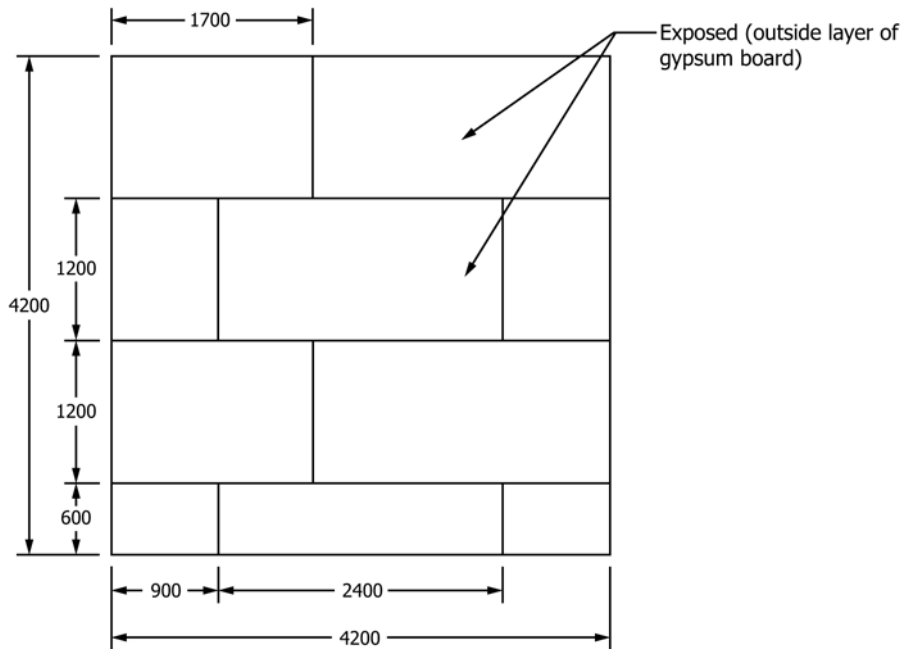

Dimensions in millimetres.

FIG. 3 Horizontal Standardized Test Specimen, Location of Outer Layer of Gypsum Board

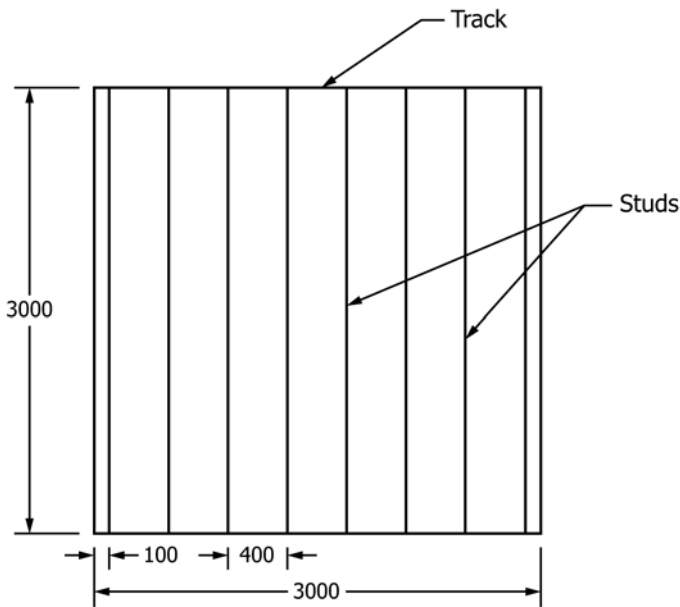

Dimensions in millimetres.

FIG. 4 Vertical Standardized Test Specimen, Location of Wall Studs and Track Channels

mm (7 $\frac{7}{8}$  in.) on center along each stud and shall be spaced 100 mm (4 in.) from the screws used to attach the inner layer. A distance of 10 to 15 mm ( $\frac{3}{8}$  to  $\frac{5}{8}$  in.) shall be provided between the screws and the edges of the gypsum board.

NOTE 4—The exposed layer, or outside layer, of gypsum board is in contact with the inner layer of gypsum board.

6.2.3.5 The structural panels shall be attached to the support channels with steel screws spaced a maximum of 150 mm (5 $\frac{7}{8}$  in.) on center along each support channel. A distance of 10 to

15 mm ( $\frac{3}{8}$  to  $\frac{5}{8}$  in.) shall be provided between the screws and the edges of the structural panels. Holes are permissible in the structural panels to facilitate the installation of the instrumentation.

6.3 Furnace Limitations—Furnaces with dedicated applications, such as testing of ceiling assemblies, typically have specific horizontal or vertical assemblies for this purpose and therefore do not include open restraining frames.

6.3.1 It is permissible to modify the standardized test specimen to account for these limitations.

6.4 Instrumentation—The instrumentation installed on the standardized test specimen shall include plate thermometers, a directional flame thermometer, bi-directional probes, Type K thermocouples and air sampling probes.


6.4.1 The plate thermometers (1)<sup>3</sup> shall be constructed as shown in Fig. 7.

6.4.1.1 The plate part of the plate thermometer shall be constructed from 150 ± 1 mm long by 100 ± 1 mm wide by 0.7 ± 0.1 mm thick nickel alloy plate strips folded to the design shown in Fig. 7.

6.4.1.2 A Type K ungrounded Inconel<sup>4</sup> sheathed thermocouple having a maximum diameter of 1 mm shall be fixed to the geometric center of the plate in the position shown in Fig. 7 by a steel strip made from the same material as the plate. The steel strip shall be welded or screwed to the plate. The strip shall be 18 ± 1 mm by 6 ± 1 mm when it is spot welded to the plate (Fig. 7) and 25 ± 1 mm by 6 ± 1 mm when it is to be screwed to the plate. The screw shall be a maximum 2 mm in diameter.


<sup>3</sup> The boldface numbers in parentheses refer to a list of references at the end of this standard.

<sup>4</sup> Inconel is a registered trademark of Special Metals Corporation.

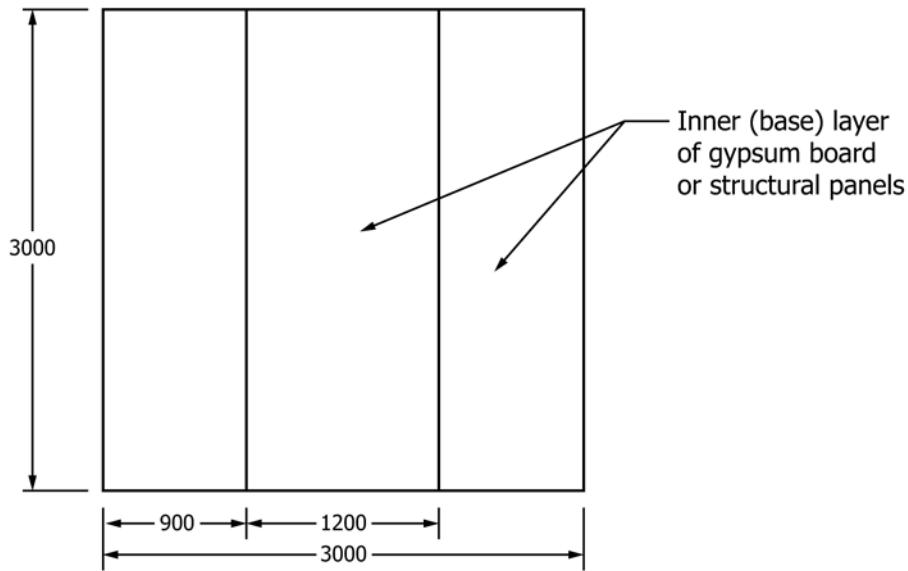

Dimensions in millimetres.

**FIG. 5 Vertical Standardized Test Specimen, Location of Inner Layer of Gypsum Board and Structural Panels**

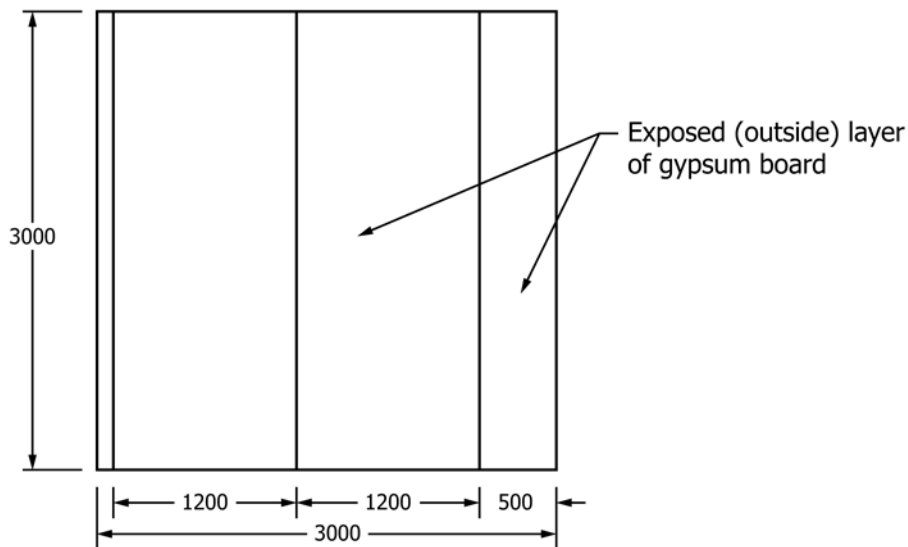

Dimensions in millimetres.

**FIG. 6 Vertical Standardized Test Specimen – Location of Outer Layer of Gypsum Board**

6.4.1.3 The assembly of the plate and thermocouple shall be fitted with a pad of inorganic insulation material  $97 \pm 1$  mm by  $97 \pm 1$  mm by  $10 \pm 1$  mm thick. The density of the insulation material shall be  $280 \pm 30$  kg/m<sup>3</sup>.

6.4.1.4 The plate thermometers shall be aged by immersing in a pre-heated oven at 1000°C for 1 h before their first use or exposed in a furnace following the time-temperature curve specified in Test Methods E119 for a minimum of 90 min.

6.4.2 The directional flame thermometers(2) shall be constructed as shown in Fig. 8.

6.4.2.1 The plate parts of the directional flame thermometers shall be constructed from 120 by 120 mm  $\pm 0.1$  by 3.0  $\pm 0.1$  mm thick Inconel plate.


6.4.2.2 A  $6.7 \pm 0.4$  mm diameter (Drill size H) hole shall be drilled near each corner of each plate.

6.4.2.3 The plates shall be oxidized by placing them in a furnace at  $1000 \pm 50$  °C for a minimum of 24 h.

6.4.2.4 By sanding, the oxide shall be removed from a area approximately 13 by 31 mm at the geometric center of each plate.


6.4.2.5 In the sanded area, a Type K ungrounded Inconel sheathed thermocouple having a maximum diameter of 1.6 mm shall be fixed to the geometric center of each plate using nickel or nichrome foil tightly fitted over the last 25 mm of the thermocouple and spot welded to the plate.

6.4.2.6 Place a 125 by 125 by 25 mm thick piece of 128 kg/m<sup>3</sup> ceramic fiber insulation between the plates. The plate surface with the thermocouples shall be in contact with the insulation as shown in Fig. 8.

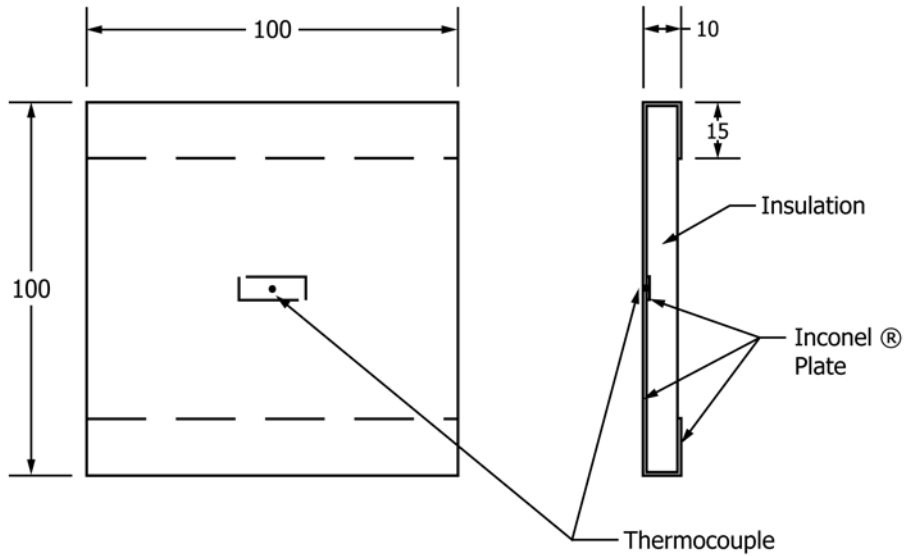

Dimensions in millimetres.

FIG. 7 Plate Thermometer

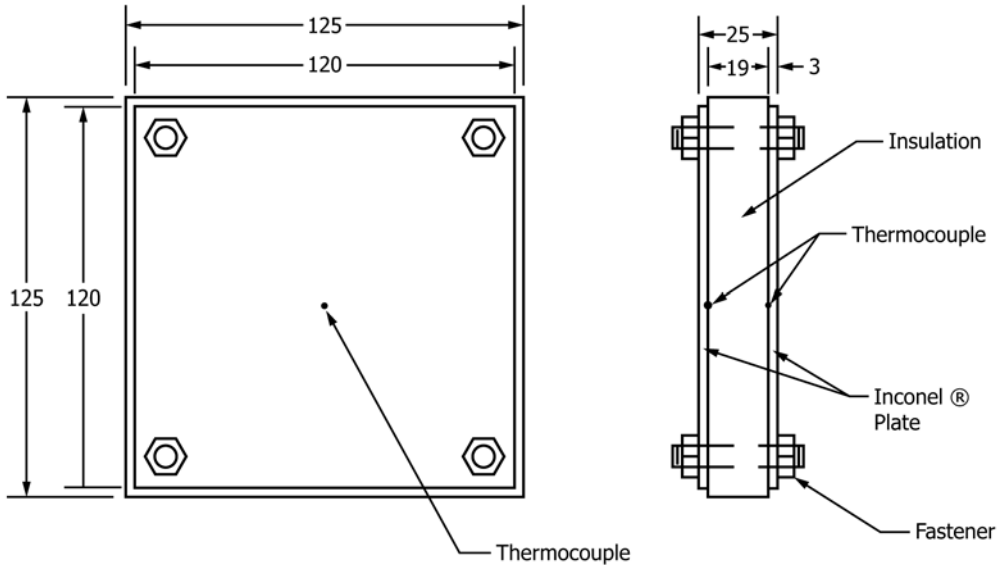

Dimensions in millimetres.

FIG. 8 Directional Flame Thermometer

NOTE 5—Cerablanket, manufactured by Thermal Ceramics, has been found to be a suitable insulation.

6.4.2.7 Using stainless steel tubular spacers with 304 stainless steel or Inconel® bolts, compress the insulation to a thickness of 19 mm.

6.4.3 The bi-directional probe(3) shall be constructed as shown in Fig. 9.

6.4.4 The Type K (Chromel–Alumel) Inconel sheathed thermocouple with an ungrounded tip shall have a maximum diameter of 1.5 mm.

6.4.5 The air sampling probes shall be a Tee-shaped probe or a tube probe and shall be manufactured from stainless steel or other suitable material.

6.4.6 The plate thermometers, directional flame thermometer, bi-directional low velocity probes and the probes to measure oxygen content are to be located as shown in Fig. 10.


6.4.6.1 Dimensions  $A_1$  and  $A_2$  are to be determined by the testing laboratory.

6.4.6.2 Dimensions  $B_1$  and  $B_2$  shall not be greater than 1700 mm (5 ft. 6 $\frac{7}{8}$  in.).

6.4.6.3 The effective area of the furnace opening (EA) shall be equal to:


$$EA = (W - 2A_1)(H - 2A_2)$$

where  $W$ ,  $H$ ,  $A_1$  and  $A_2$  are shown in Fig. 10.

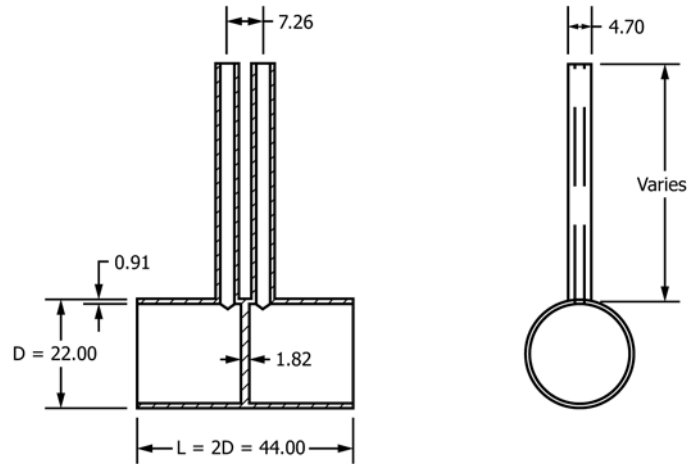

Dimensions in millimetres.

FIG. 9 Bi-directional Probe

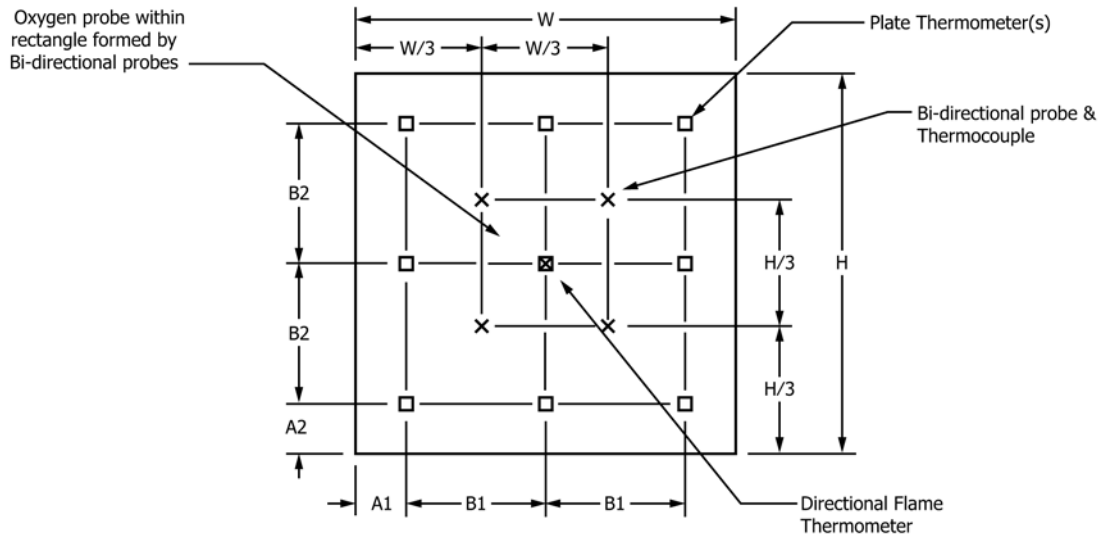

Dimensions in millimetres.

FIG. 10 Location of Instrumentation

6.4.6.4 For furnaces having an opening of 1700 by 1700 mm (5 ft. 6<sup>7</sup>/<sub>8</sub> in. by 5 ft. 6<sup>7</sup>/<sub>8</sub> in.) or less, a plate thermometer would be located at each corner of the effective area of the furnace opening and a directional flame thermometer would be located at the center of the effective area of the furnace opening.

6.4.6.5 The plate thermometers are to be positioned on the exposed surface of the gypsum board as shown in Fig. 11.

6.4.6.6 The bi-directional probes and 1.5 mm diameter Type K thermocouple are to be positioned of the exposed surface of the gypsum board as shown in Fig. 12. The orientation of adjacent probes shall be rotated 90 degrees. The distance between the probe and the thermocouple shall be 100 ± 50 mm (4 ± 2 in.).

6.4.6.7 The placement of the probe for obtaining air samples to be used to determine oxygen content in the furnace chamber shall be as shown in Fig. 13.

## 7. Procedure

7.1 The minimum time of furnace operation shall be 45 min.

7.2 The conditions within the furnace chamber shall be in compliance with the requirements of the referenced test method such as Test Methods E119, E814, E1529, E1725, E1966 or E2336.

7.3 All data shall be recorded at minimum 1-min intervals.


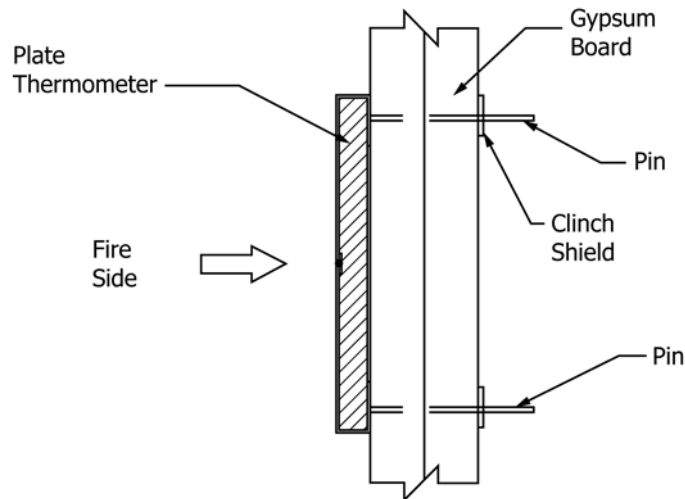


FIG. 11 Attachment of Plate Thermometer

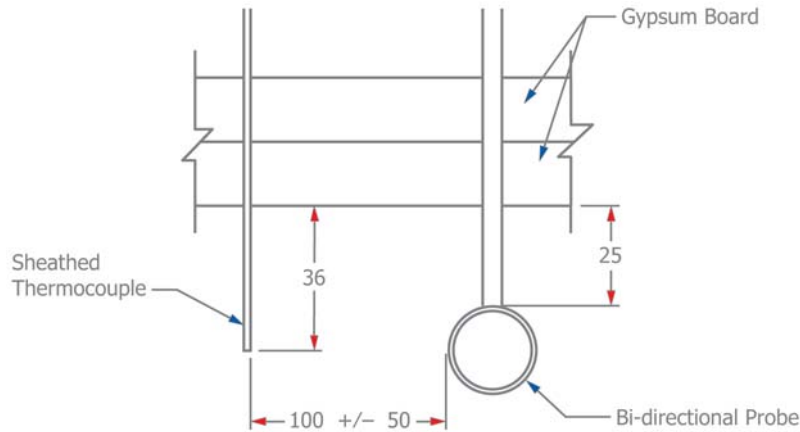

Dimensions in millimetres.

FIG. 12 Location of Bi-directional Probe and Thermocouple

## 8. Calculation or Interpretation of Results

8.1 The velocity shall be calculated from the equation:

$$V = 0.0698 \sqrt{(PT)}$$

where:

$V$  = gas velocity (m/s),

$P$  = pressure differential measured by bi-directional probe (Pa), and

$T$  = temperature measured by 1.5 mm diameter Type K thermocouple ( $^{\circ}$ K).

NOTE 6—See Ref (4), Equations 36 and 37 for information on the use of bi-directional probes.

## 9. Report

9.1 The test report shall include all important information relevant to the materials and method used to construct the standardized test specimen. The report shall also include the following:

- 9.1.1 The name and address of the testing laboratory,
- 9.1.2 The date when the procedure was conducted,

9.1.3 Details of the furnace such as: (1) the dimensions of the chamber, (2) the type, thickness and density of the lining, (3) the type and location of the burners and (4) the fuel,

9.1.4 The effective area of the furnace opening and location of instrumentation on the standardized test specimen,

9.1.5 Description and rationale for modifications to the standardized test specimen resulting from furnace limitations,

9.1.6 Details of instrumentation used to measure furnace temperature and furnace pressure,


9.1.7 The temperatures within the furnace chamber measured as specified in the procedure at minimum 1-min intervals,

9.1.8 The pressures within the furnace chamber measured at minimum 1-min intervals,

9.1.9 The average temperature recorded by the plate thermometers mounted on the standardized test specimen at minimum 1 min, intervals,

9.1.10 The temperatures recorded by the directional flame thermometer at minimum 1-min intervals,



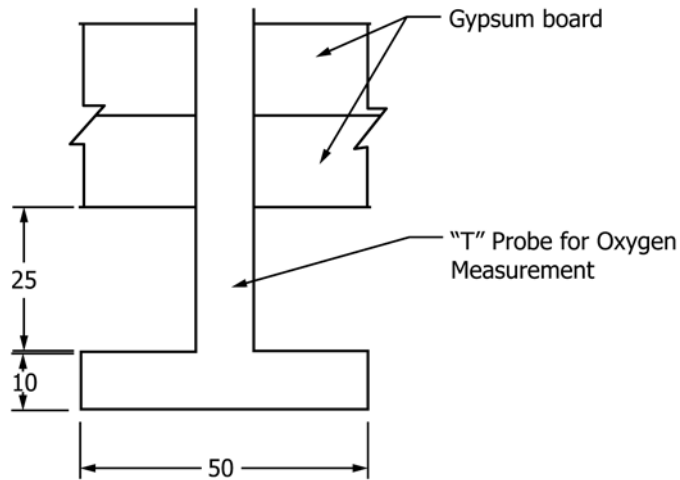

Dimensions in millimetres.

FIG. 13 Location of Probe for Oxygen Content Measurement

9.1.11 The difference between the maximum temperature and the minimum temperature recorded on the standardized test specimen by the plate thermometers at minimum 1-min intervals,

9.1.12 The orientation of the bi-directional probes,

9.1.13 The velocities calculated from the data obtained from the bi-directional low velocity probes and the adjacent thermocouples at minimum 1-min intervals, and

9.1.14 The oxygen content at minimum 1-min intervals.

## 10. Keywords

10.1 effective area of the furnace opening; fire resistance; fire test furnaces; furnace exposure conditions; oxygen content; uniformity of furnace exposure

## APPENDIX

### X1. COMMENTARY

X1.1 This fire-test-response method describes a procedure whereby the fire-exposure characteristics within furnaces used to conduct tests in accordance with Test Methods E119, E814, E1529, E1725, E1966 and E2336 can be measured and recorded for a standard test specimen constructed of readily available, inexpensive construction materials and instrumentation commonly found in a fire-test laboratory.

X1.2 Quantitative data on fire exposures (temperatures, heat fluxes, oxygen content, etc.) are needed as part of the process of developing performance-based standard methods and the development of fire protection engineering models. Recorded data includes temperatures measured by plate thermometers and a directional flame thermometer mounted on a standardized test specimen, velocities across the face of the specimen and the oxygen content within the furnace chamber. The plate thermometers are positioned on the specimen to define the effective area of the furnace opening. Additional plate thermometers and a directional flame thermometer are evenly

distributed within the effective area to document the temporal and geometric uniformity or variation, or both, of the heat flux imposed by the furnace upon the test specimen. Differential pressures and gas temperatures are recorded near the face of the specimen to calculate air velocities across the face of the specimen. The velocity calculation is intended to provide an indication of the air turbulence within the furnace. The oxygen content of the atmosphere within the furnace is to provide an indication of the propensity of combustible materials to ignite during a fire test.

X1.3 Reference to Test Method E1529 and ISO/TR 834-2, should be consulted for additional guidance on the performance and calibration of furnaces used to determine the fire resistance of building assemblies.

X1.4 Ref (5) provides data from preliminary tests conducted on a vertical furnace having a 1.4 by 1.7 m opening.

## REFERENCES

- (1) Wickström, U., *The Plate Thermometer – A Simple Instrument for Reaching Harmonized Fire Resistance Tests*, SP-Report 1989:03, Swedish National Testing and Research Institute, 1989.
- (2) Keltner, N.R., *Directional Flame Thermometers: A Tool for Measuring Thermal Exposure in Furnaces and Improving Control*, Proceedings of the Interflam 2007 Conference, CD version, University of London, September, 2007.
- (3) Mc Caffrey, B.J. and Heskestad, G., “A Robust Bi-directional Low-Velocity Probe for Flame and Fire Applications,” *Combustion and Flame*, Vol.26, No. 1, February 1976, pp. 125–127.
- (4) Bryant, R. A., Ohlemiller, T. J., Johnsson, E. L., Hamins, A., Grove, B. S., Guthrie, W. F., Maranghides, A., and Mulholland, G. W., “The NIST 3 Megawatt Quantitative Heat Release Rate Facility,” *NIST Special Publication 1007*, December 2003.
- (5) Berhinig, R., Guide on Measuring Uniformity of Furnace Exposure on Specimens Representing Test Samples Used to Determine Fire Resistance Ratings, *Journal of ASTM International*, Vol. 6, No. 6, Paper ID JAI 102301, ISSN: 1546-962X, June 2009.

*ASTM International takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.*

*This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.*

*This standard is copyrighted by ASTM International, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website (www.astm.org). Permission rights to photocopy the standard may also be secured from the Copyright Clearance Center, 222 Rosewood Drive, Danvers, MA 01923, Tel: (978) 646-2600; <http://www.copyright.com/>*