



# Standard Test Method for Laboratory Measurement of Impact Sound Transmission Through Floor-Ceiling Assemblies Using the Tapping Machine<sup>1</sup>

This standard is issued under the fixed designation E492; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ε) indicates an editorial change since the last revision or reapproval.

<sup>ε1</sup> NOTE—Editorially corrected 14.1 in April 2016.

## INTRODUCTION

This test method is one of several for evaluating the sound insulating properties of building elements. It is designed to measure the impact sound transmission performance of an isolated floor-ceiling assembly, in a controlled laboratory environment. Others in the set deal with field measurement of impact sound transmission through floor-ceiling assemblies (Test Method E1007), measurement of sound isolation in buildings (Test Method E336), the measurement of sound transmission through a common plenum between two rooms (Test Method E1414), and the laboratory measurement of airborne sound transmission loss of building partitions such as walls, floor-ceiling assemblies, doors, and other space-dividing elements (Test Method E90).

## 1. Scope

1.1 This test method covers the laboratory measurement of impact sound transmission of floor-ceiling assemblies using a standardized tapping machine. It is assumed that the test specimen constitutes the primary sound transmission path into a receiving room located directly below and that a good approximation to a diffuse sound field exists in this room.

1.2 Measurements may be conducted on floor-ceiling assemblies of all kinds, including those with floating-floor or suspended ceiling elements, or both, and floor-ceiling assemblies surfaced with any type of floor-surfacing or floor-covering materials.

1.3 This test method prescribes a uniform procedure for reporting laboratory test data, that is, the normalized one-third octave band sound pressure levels transmitted by the floor-ceiling assembly due to the tapping machine.

1.4 *Laboratory Accreditation*—The requirements for accrediting a laboratory for performing this test method are given in Annex A2.

1.5 The values stated in SI units are to be regarded as standard. No other units of measurement are included in this standard.

1.6 *This standard does not purport to address the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

## 2. Referenced Documents

### 2.1 ASTM Standards:<sup>2</sup>

- C423 Test Method for Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method
- C634 Terminology Relating to Building and Environmental Acoustics
- E90 Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions and Elements
- E336 Test Method for Measurement of Airborne Sound Attenuation between Rooms in Buildings
- E989 Classification for Determination of Impact Insulation Class (IIC)
- E1007 Test Method for Field Measurement of Tapping

<sup>1</sup> This test method is under the jurisdiction of ASTM Committee E33 on Building and Environmental Acoustics and is the direct responsibility of Subcommittee E33.03 on Sound Transmission.

Current edition approved April 1, 2016. Published April 2016. Originally approved in 1973. Last previous edition approved in 2009 as E492 – 09. DOI: 10.1520/E0492-09R16E01.

<sup>2</sup> For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

Machine Impact Sound Transmission Through Floor-Ceiling Assemblies and Associated Support Structures  
**E1414** Test Method for Airborne Sound Attenuation Between Rooms Sharing a Common Ceiling Plenum  
**E2235** Test Method for Determination of Decay Rates for Use in Sound Insulation Test Methods

2.2 *ANSI Standards:*<sup>3</sup>

**S1.10** Pressure Calibration of Laboratory Standard Pressure Microphones  
**S1.11** Specification for Octave-Band and Fractional-Octave-Band Analog and Digital Filters  
**S1.43** Specification for Integrating-Averaging Sound-Level Meters  
**S12.51** Acoustics—Determination of Sound Power Levels of Noise Sources Using Sound Pressure—Precision Methods for Reverberation Rooms

2.3 *ISO Standards:*<sup>3</sup>

**ISO 140/6** Acoustics—Measurement of Sound Insulation in Buildings and of Building Elements Part 6: Laboratory Measurements of Impact Sound Insulation of Floors  
**ISO 3741** Determination of Sound Power Levels of Noise Sources Using Sound Pressure—Precision Methods for Reverberation Rooms

2.4 *IEC Standards:*<sup>4</sup>

**IEC 60942** Electroacoustics—Sound Calibrators  
**IEC 61672** Electroacoustics—Sound Level Meters—Part 1: Specifications

### 3. Terminology

3.1 The following terms used in this test method have specific meanings that are defined in Terminology **C634**:

airborne sound  
average sound pressure level  
background noise  
decay rate  
decibel  
diffuse sound field  
impact insulation class  
one-third octave band  
receiving room  
reverberant sound field  
reverberation room  
sound absorption  
sound pressure level

3.2 *Definitions of Terms Specific to This Standard:*

3.2.1 *receiving room*—a reverberation room below the floor specimen under test in which the sound pressure levels due to the tapping machine are measured.

### 4. Summary of Test Method

4.1 A standard tapping machine is placed in operation on a floor specimen that is intended to represent a horizontal separation between two rooms, one directly above the other. The average spectrum of the sound pressure levels produced by

<sup>3</sup> Available from American National Standards Institute (ANSI), 25 W. 43rd St., 4th Floor, New York, NY 10036, <http://www.ansi.org>.

<sup>4</sup> Available from International Electrotechnical Commission (IEC), 3 rue de Varembe, Case postale 131, CH-1211, Geneva 20, Switzerland, <http://www.iec.ch>.

the tapping machine is measured in the receiving room below in one-third octave bands.

4.2 Since the spectrum depends on the absorption of the receiving room, the sound pressure levels are normalized to a reference absorption for purposes of comparing results obtained in different receiving rooms that differ in absorption.

### 5. Significance and Use

5.1 The spectrum of the noise in the room below the test specimen is determined by the following:

5.1.1 The size and the mechanical properties of the floor-ceiling assembly, such as its construction, surface, mounting or edge restraints, stiffness, or internal damping,

5.1.2 The acoustical response of the room below,

5.1.3 The placement of the object or device producing the impacts, and

5.1.4 The nature of the actual impact itself.

5.2 This test method is based on the use of a standardized tapping machine of the type specified in **8.1** placed in specific positions on the floor. This machine produces a continuous series of uniform impacts at a uniform rate on a test floor and generates in the receiving room broadband sound pressure levels that are sufficiently high to make measurements possible beneath most floor types even in the presence of background noise. The tapping machine itself, however, is not designed to simulate any one type of impact, such as produced by male or female footsteps.

5.3 Because of its portable design, the tapping machine does not simulate the weight of a human walker. Therefore, the structural sounds, i.e., creaks or booms of a floor assembly caused by such footstep excitation is not reflected in the single number impact rating derived from test results obtained by this test method. The degree of correlation between the results of tapping machine tests in the laboratory and the subjective acceptance of floors under typical conditions of domestic impact excitation is uncertain. The correlation will depend on both the type of floor construction and the nature of the impact excitation in the building.

5.4 In laboratories designed to satisfy the requirements of this test method, the intent is that only significant path for sound transmission between the rooms is through the test specimen. This is not generally the case in buildings where there are often many other paths for sounds—*flanking sound transmission*. Consequently sound ratings obtained using this test method do not relate directly to sound isolation in buildings; they represent an upper limit to what would be measured in a field test.

5.5 This test method is not intended for field tests. Field tests are performed according to Test Method **E1007**.

### 6. Test Rooms

6.1 The test facility shall be so constructed and arranged that the test specimen constitutes the only important transmission path for the tapping machine sound.

NOTE 1—Common methods for ensuring that this requirement is satisfied include mounting the specimen resiliently in the test opening,

mounting the specimen in a resiliently supported test frame, and supporting rooms resiliently. In general, all rigid connections between the specimen and the test rooms should be avoided.

6.2 The spatial variations of sound pressure level measured in the receiving room shall be such that the precision requirements in [Annex A1](#) are satisfied at all frequencies.

6.3 *Volume of Receiving Room*—The recommended minimum volume of the receiving room is 125 m<sup>3</sup>.

NOTE 2—See Test Method [E90](#) for recommendations for new construction.

6.4 *Room Absorption*—The sound absorption in the receiving room should be low to achieve the best possible *simulation* of the ideal diffuse field condition, and to minimize the region dominated by the direct field of the test specimen. In the frequency range that extends from  $f = 2000/V^{1/3}$  to 2000 Hz, the absorption in the receiving room (as furnished with diffusers) should be no greater than:

$$A = V^{2/3}/3 \quad (1)$$

where:

$V$  = the room volume, m<sup>3</sup>, and

$A$  = the sound absorption of the room, m<sup>2</sup>.

6.4.1 For frequencies below  $f = 2000/V^{1/3}$ , somewhat higher absorption may be desirable to accommodate requirements of other test methods (for example, ISO 3741); in any case, the absorption should be no greater than three times the value given by [Eq 1](#).

NOTE 3—For frequencies above 2000 Hz, atmospheric absorption may make it impossible to avoid a slightly higher value than that given in [Eq 1](#).

6.5 During the sound pressure level and sound absorption measurements in the receiving room the average temperature shall be in the range  $22 \pm 5^\circ\text{C}$  and the average relative humidity shall be at least 30 %.

6.6 During the sound pressure level and the corresponding sound absorption measurements, variations in temperature and humidity in the receiving room shall not exceed  $3^\circ\text{C}$  and 3 % relative humidity respectively. Temperature and humidity shall be measured and recorded as often as necessary to ensure compliance.

6.6.1 If a relative humidity of at least 30 % can not be maintained in the receiving room, users of the test method shall verify by calculation that changes in the  $10 \log A_1$  term (see [12.4](#)) due to changes in temperature and humidity do not exceed 0.5 dB.

NOTE 4—Procedures for calculating air absorption are described in Test Method [C423](#).

## 7. Test Specimens

7.1 The test specimen shall be prepared and described in the test report in accordance with [Annex A1](#) of Test Method [E90](#).

7.2 *Size and Mounting*—The test specimen shall have a minimum lateral dimension of 2.4 m. An area of at least 10 m<sup>2</sup> is recommended. The test specimen shall include all of the essential constructional elements and surfacing materials normally found in an actual installation. Some elements may have to be reduced in size to fit each laboratory's test opening. The

test specimen shall be sealed to prevent tapping machine operational sounds from entering the room below. The specimen shall be structurally isolated from the receiving room to avoid significant transmission of vibration from the specimen through the supporting structure to the room below.

7.3 Floor-surfacing materials, such as vinyl, carpets and pads, especially when installed with adhesive, significantly affect the response of the test specimen to impacts, both during test and in normal use. Consequently, such materials shall be deemed parts of the test specimen. The materials and the manner of installing them shall be fully described in the test report. The floor-surfacing material shall cover the whole test specimen, not merely the portion under the impact machine.

## 8. Tapping Machine

8.1 This test method is based on the use of a standardized tapping machine that conforms to the following specifications:

8.1.1 The tapping machine shall be motor-driven.

8.1.2 The tapping machine shall have five hammers equally spaced in a line. The distance between centerlines of neighboring hammers shall be  $100 \pm 3$  mm.

8.1.3 Each hammer shall have an effective mass of  $500 \pm 6$  g and shall fall freely from a height of  $40 \pm 3$  mm.

8.1.4 The falling direction of the hammers shall be perpendicular to the test surface to within  $\pm 0.5^\circ$ .

8.1.5 The part of the hammer carrying the impact surface shall be cylindrical with a diameter of  $30 \pm 0.2$  mm.

8.1.6 The impact surface shall be of hardened steel and shall be approximately spherical with a curvature radius of  $500 \pm 100$  mm.

NOTE 5—The mean curvature radius for each hammer face may be determined using a spherometer or other means.

8.1.7 The time between successive impacts shall be  $100 \pm 20$  ms.

8.1.8 Since friction in the hammer guidance system can reduce the velocity of the hammer at impact, the tapping machine shall be checked for friction between the hammers and the guidance system. Any friction found should be eliminated or reduced as much as possible.

8.1.9 Following adjustment of the hammer drop in accordance with the specifications, the tapping machine is ready for use on any floor structure, including those surfaced with soft or resilient materials.

NOTE 6—The above requirements are a subset of the ISO 140/6 requirements.

8.2 *Tapping Machine Positions*—The tapping machine positions and orientations described in the following must be used. [Fig. 1](#) illustrates one case.

8.2.1 *Position 1*—The middle hammer of the tapping machine shall be coincident with the midpoint of the floor area, that is, the point of intersection of floor diagonals. In framed construction, adjust this point to the centerline of the closest structural member or other support member, and arrange the tapping machine so that all hammers fall on the joist.

8.2.2 *Position 2*—Same as position 1, except rotate the tapping machine  $90^\circ$  about the axis of the middle hammer.

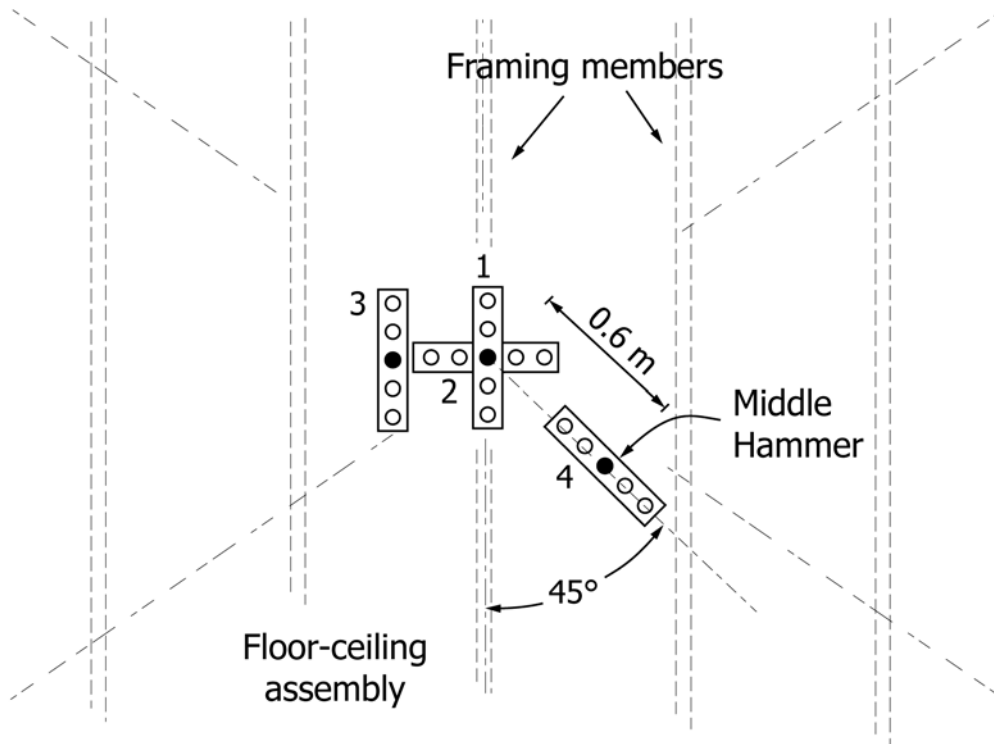


FIG. 1 Tapping Machine Positions on a Floor with Structural Members 610 mm o.c.

8.2.3 *Position 3*—Displace the tapping machine laterally from position 1, such that the long dimension of the machine is centered midway between and parallel to the central structural member. In the case of homogeneous concrete slab floors or solid deck construction without joists, the lateral displacement of the tapping machine shall be 0.6 m from that of position 1.

8.2.4 *Position 4*—Position the tapping machine so that all hammers fall on a 45° radial line extending from the middle hammer point of position 1. Locate the middle hammer 0.6 m from the midpoint of position 1.

## 9. Instrumentation Requirements

9.1 The measurement process must account for level fluctuations caused by spatial and temporal variations. Various systems of data collection and processing are possible, ranging from a single microphone moving continuously, a single microphone placed in sequence at several measurement positions, to several microphones making simultaneous measurements.

9.2 *Microphone Electrical Requirements*—Use microphones that are stable and substantially omnidirectional in the frequency range of measurement, with a known frequency response for a random incidence sound field. (A 13-mm random-incidence condenser microphone is recommended.) Specifically, microphones, amplifiers and electronic circuitry to process microphone signals must satisfy the requirements of ANSI S1.43 or IEC 61672 for class 1 sound level meters, except that A, B and C weighting networks are not required since one-third octave filters are used. Where multiple microphones are used, they shall be of the same model.

9.3 *Calibration*—Calibrate each microphone over the whole range of test frequencies as often as necessary to ensure the required accuracy (see ANSI S1.10). A record shall be kept of the calibration data and the dates of calibration (see A2.4.1).

9.4 The calibration of the entire measurement system shall be checked before each set of measurements using an acoustical calibrator that generates a known sound pressure level at the microphone diaphragm and at a known frequency. The Class of Calibrator shall be class 1 or better per ANSI S1.40 and/or IEC 60942. Data resulting from calibration shall be analyzed by the control chart method described in Part 3 of ASTM STP 15D. The analysis shall be according to the subsection entitled “Control—No Standard Given”. If changes are made to the microphones or measurement system that result in changes in calibration values, a new control chart should be started.

9.5 *Standard Test Frequencies*—Measurements shall be made in all one-third-octave bands with mid-band frequencies specified in ANSI S1.11 from 100 to 3150 Hz. Additional one-third octave band measurements should be made at 50, 63, and 80 Hz to accumulate research data.

9.6 *Bandwidth*—The overall frequency response of the filters used to analyze the microphone signals shall, for each test band, conform to the specifications in ANSI S1.11 for a one-third octave band filter set, class 1 or better.

## 10. Measurement of Sound Pressure Levels

10.1 Measurements of the average sound pressure levels shall be made in the receiving room directly below the floor



specimen using a procedure that satisfies the requirements in **Annex A1**. The measurements shall be in a series of frequency bands specified in **9.4** for each of the tapping machine positions designated in **8.2**.

**10.2 Background Noise Level**—Measurements of the background noise levels shall be made during each test to ensure that measurements of sound pressure level are not affected by extraneous airborne noise or electrical noise in the receiving system. These measurements shall be made at the same microphone positions using the same analyzer gain settings used to measure sound pressure levels generated by the tapping machine.

**10.2.1** If the background noise level is more than 10 dB below the combined level of signal plus background, then no correction is to be made.

**10.2.2** If the background noise level is between 10 and 5 dB below the combined level, then adjustments must be made for the background noise level as follows. If  $L_{sb}$  is the level of the signal and background combined, and  $L_b$  is the level due to background noise only, then the adjusted signal level,  $L_s$ , in the absence of background noise is the following:

$$L_s = 10 \log(10^{L_{sb}/10} - 10^{L_b/10}) \quad (2)$$

**10.2.3** At those frequencies where the background noise level is less than 5 dB below the combined level, subtract 2 dB from the combined level. In this case, the measurements can be used only to provide an estimate of the upper limit of the impact sound transmission. Identify such measurements in the test report.

## 11. Determination of Receiving Room Sound Absorption

**11.1** Measure the mean value of the receiving room absorption at each frequency in accordance with Test Method **E2235**. The determination of room absorption shall be made with the receiving room and the specimen in the same condition as for the measurement of the average sound pressure levels.

## 12. Calculations

**12.1 Averaging Sound Pressure Levels**—For each tapping machine position, a set of sound pressure levels corresponding to each microphone position in the receiving room will be obtained. The space-time average sound pressure level ( $\bar{L}_p$ ) for one tapping machine position is given by:

$$\bar{L}_p = 10 \log\left(\frac{1}{n} \sum_{i=1}^n 10^{L_i/10}\right) \quad (3)$$

where:

$n$  = number of microphone positions, and

$L_i$  = sound pressure level measured at a microphone position for one location of the tapping machine, dB re 20  $\mu$ Pa.

**12.2** The average one-third octave band sound pressure level ( $\bar{L}_0$ ) of the four average sound pressure levels measured for each tapping machine position is given by:

$$\bar{L}_0 = 10 \log\left(0.25 \sum_{p=1}^4 10^{\bar{L}_p/10}\right) \quad (4)$$

**12.3** The standard deviation of the means for four tapping machine positions is given by:

$$s_0 = \left[\frac{1}{3} \sum_{p=1}^4 (\bar{L}_p - \bar{L}_0)^2\right]^{1/2} \quad (5)$$

**12.4** The normalized sound pressure level,  $L_n$ , in each of the specified frequency bands shall be obtained from the following relationship:

$$L_n = \bar{L}_0 - 10 \log(A_0/A_1) \quad (6)$$

where:

$A_1$  = sound absorption of the receiving room ( $m^2$ ) measured in the same frequency band used for the measurement of  $\bar{L}_0$ , and

$A_0$  = reference absorption of 10  $m^2$ .

**12.5 Variation in Sound Pressure Level Due to Tapping Machine Position**—Many floor/ceiling assemblies are not homogeneous, thus there can be a variation in the average sound pressure levels measured for each tapping machine location. Since it is desirable to have some measure of the variability, the 95 % uncertainty limits for the normalized sound pressure levels shall be determined from:

$$\Delta L_n = 1.6[s_0^2 + s^2(f)/n]^{1/2} \quad (7)$$

where  $s(f)$  is determined according to Annex A3.

**NOTE 7**—Strictly, the uncertainty due to variation in room absorption should be included in this equation. In practice, however, this can be neglected.

## 13. Report

**13.1** The report shall include the following information:

**13.1.1** A statement, if true in every respect, that the tests were conducted in accordance with the provisions of this method.

**13.1.2** In conformance with **7.1**, a detailed description of the test specimen. The specimen area, total thickness, and the average weight per square meter shall be reported. A description furnished by the sponsor of the test may be included in the report provided that it is attributed to the sponsor. The curing period, if any, and the final condition of the sample (shrinkage, cracks, etc.) shall be reported.

**13.1.3** The dates of construction and testing.

**13.1.4** The minimum and maximum temperature and relative humidity in the receiving room.

**13.1.5** The volume of the receiving room.

**13.1.6** The normalized impact sound pressure levels ( $L_n$ ) to the nearest 1 dB, for the one-third octave frequency bands given in **9.5**. Results may be presented in graphical form.

**13.1.7** Identify data affected by flanking transmission or background noise.

**13.1.8** The calculated 95 % uncertainty limit ( $\Delta L_n$ ) of the impact noise test data at each frequency (see **Eq 7**).

**13.1.9** If a single number ratings are given, the impact insulation class (IIC) described in Classification **E989** shall be included.

## 14. Precision and Bias

**14.1 Precision**—Measurements at one laboratory give some information on repeatability standard deviation for the test method. A wood joist floor was installed and re-tested seven times over a period of ten days without disturbing the floor. The

**TABLE 1 Repeatability Standard Deviations**

Frequency, Hz	A	B	C
	wood joist re-test	wood joist re-build	150 mm concrete re- install
IIC	0.4	0.5	0.6
50	0.5	0.9	1.6
63	0.3	1.0	1.6
80	0.3	0.8	1.6
100	0.3	0.8	1.3
125	0.4	1.1	1.5
160	0.3	1.2	0.9
200	0.2	0.7	1.2
250	0.2	0.7	1.1
315	0.2	1.0	1.2
400	0.3	1.6	0.8
500	0.1	0.6	0.8
630	0.2	0.9	0.7
800	0.2	1.2	0.8
1000	0.3	1.4	0.6
1250	0.3	1.1	0.7
1600	0.3	0.9	0.8
2000	0.5	1.1	0.6
2500	0.5	1.2	0.6
3150	0.6	1.6	0.6

standard deviation of the sound pressure levels is given in column A of **Table 1**. Using different materials, eight nominally identical wood-joist floors were constructed and tested over a period of one year. The repeatability standard deviation in this case includes the effects of normal variations in materials but there were no changes in construction techniques (Column B of **Table 1**). A 150-mm concrete slab was installed in a test frame and tested fifteen times over a period of 11 years. The repeatability standard deviation for re-installation is given in column C of **Table 1**. Reproducibility data for this test method will become available when an inter-laboratory study is completed.

14.2 *Bias*—There is no bias in this method since the true value is defined by the test method.

## 15. Keywords

15.1 floor ceiling assemblies; impact sound transmission; tapping machine

## ANNEXES

### (Mandatory Information)

#### A1. QUALIFICATION OF ROOM SOUND FIELDS AND MICROPHONE SYSTEMS USED FOR SAMPLING

##### A1.1 *Scope*:

A1.1.1 This annex prescribes procedures for establishing a standard measurement protocol for obtaining the average sound pressure levels in the receiving room with confidence intervals small enough for the purposes of this test method.

A1.1.2 One principle underlying this test method is that the reverberant sound fields in the room show only small variations with position in the room. In practice, variations in the level of the reverberant sound field are still significant, especially in the lower frequency bands, and measurements of sound pressure level and sound decay rate must be made at several positions in the room to sample adequately the sound field.

A1.1.3 Two methods are commonly used for sampling sound fields in reverberation rooms: stationary microphones or moving microphones (usually mounted on a rotating boom). This annex deals with both types.

A1.2 *Microphone Positions*—For all microphone systems, microphones must be located according to the following restrictions:

A1.2.1 The shortest distance from any microphone position to any major extended surface shall be greater than 1 m. The same limit applies relative to any fixed diffuser surface (excluding edges) and relative to any possible position of a rotating or moving diffuser.

A1.2.2 Stationary microphone positions shall be at least 1.5 m apart.

NOTE A1.1—If estimates of the confidence interval of average sound pressure level are to be reliable, microphone positions should be sufficiently far apart to provide independent samples of the sound field. For fixed microphones, this requires that they be spaced at least half a wavelength apart.<sup>5</sup>

A1.2.3 In the receiving room, microphones shall be more than 1.5 m from the test specimen.

A1.2.4 No two microphone positions shall have the same height above the floor of the room. Heights shall be varied so as to sample as much of the room volume as possible.

A1.3 *Averaging Time*—The following requirements for averaging time always apply when measuring according to this test method.

A1.3.1 *Stationary Microphones*—For each microphone position, the averaging time shall be sufficient to yield an estimate of the time-averaged level to within  $\pm 0.5$  dB at each frequency. This requires longer averaging times at low frequencies than at high. For 95 % confidence limits of  $\pm e$  dB in a one-third octave band with mid-band frequency,  $f$ , the integration time,  $T$ , is given by:

<sup>5</sup> Lubman, D., "Precision of Reverberant Sound Power Measurements," *Journal of the Acoustical Society of America*, Vol 56, No. 2, 1974, pp. 523-533.

$$T = \frac{310}{fe^2} \quad (A1.1)$$

A1.3.1.1 Thus at 100 Hz, the minimum averaging time for confidence limits of  $\pm 0.5$  dB is 12.4 s. For more information, see *Noise and Vibration Control*.<sup>6</sup>

A1.3.2 If a moving or rotating diffuser is used, determine the average sound pressure level at each microphone position during an integral number of diffuser cycles. Alternatively, average over a time so long that contributions from fractions of a diffuser cycle are negligible.

A1.3.3 The plane of a moving microphone shall not be parallel to any room surface. The plane shall be tilted so as to sample as much of the room volume as possible.

A1.3.4 *Moving Microphones*—Using a moving microphone means that the time- and space-averaged sound pressure level is obtained automatically from the analyzer. The averaging time for a moving microphone shall be long enough that differences between repeat measurements are negligibly small. A typical averaging time around the traverse is 60 s but operators shall determine acceptable times by experiment.

A1.4 *Required Confidence Interval for Sound Pressure Level Measurements*—It is required that the 95 % uncertainty interval for sound pressure level determined for each tapping machine location be no greater than 3 dB for the one-third octave bands in the range from 100 to 400 Hz and no greater than 2.5 dB for the bands in the range from 500 to 3150 Hz.

**A1.5 Measurement Procedures and Calculations:**

A1.5.1 The following paragraphs describe the steps to be taken to collect the data and calculate the confidence intervals for the measurement of sound pressure level.

A1.5.2 Any specimen can be used for verifying that the required confidence intervals can be attained. However, sound pressure levels in the receiving room must be at least 10 dB above background noise in the room at all frequencies.

A1.5.3 In the reverberation room below select at least six microphone positions that satisfy the requirements of A1.2.

A1.5.4 For a single tapping machine position, measure the average sound pressure levels at each microphone position in the receiving room using a stationary microphone.

A1.5.5 For each frequency band,  $f$ , calculate the 95 % confidence interval for the mean sound pressure level in the room from the expression  $as(f)$  where:

$$s(f) = \sqrt{\frac{1}{n-1} \sum_{i=1}^n [L_i(f) - L_A(f)]^2} \quad (A1.2)$$

where:

- $L_i(f)$  = the time-averaged level taken at location  $i$ ,
- $n$  = the number of microphone positions,
- $s(f)$  = the standard deviation at frequency  $f$ ,
- $L_A(f)$  = the arithmetic mean of the set of sound pressure levels.

**TABLE A1.1 Factors for 95 % Confidence Limits for Averages**

Number of Measurements $n$	Factor $a$ for Confidence Limits <sup>A</sup> $X \pm as$
4	1.591
5	1.241
6	1.050
7	0.925
8	0.836
9	0.769
10	0.715
11	0.672
12	0.635
13	0.604
14	0.577
15	0.554

<sup>A</sup> Limits that may be expected to include the “true” average,  $X$ , 95 times in 100 in a series of measurements, each involving a single sample of observations.

The factor  $a$ , which depends on the number of measurements, is given in Table A1.1.

A1.5.6 If the confidence intervals calculated do not meet the criteria in A1.4, then the measurements must be repeated with a larger number of microphone positions until the criteria are met.

A1.5.7 If the confidence intervals calculated meet the criteria in A1.4, then the rooms qualify for measurements according to this test method with the set of microphone positions used.

A1.5.8 For routine testing, a microphone system can be selected as follows:

A1.5.8.1 *Fixed Microphone Positions*—From the array of microphone positions used to determine the confidence limits above, select a subset of locations that yield the same average result, within experimental error, and still meet the confidence requirements of A1.4. The minimum number of fixed microphone positions to be used for the measurement of sound pressure level in the room shall be four.

A1.5.8.2 *Moving Microphones*—Using the standard deviations calculated for the sound pressure levels in the receiving rooms, find the hypothetical minimum number of fixed microphone positions necessary for an acceptable confidence interval in the lowest frequency band. (This requires repeating the calculations for the confidence interval using the values of standard deviation found for the large array of microphones and trying different values of  $n$  and  $a$  from Table A1.1 until the confidence limits are satisfied.) If  $n_{min}$  is the minimum number of microphones required in the room and  $\lambda$  is the wavelength of sound at the lowest frequency of interest, then the minimum size of traverse for each room is calculated from the following:

*Rotating Microphones:*

$$r_{min} = \frac{n_{min}\lambda}{4\pi} \quad (A1.3)$$

where:

$r_{min}$  = minimum radius of the circular path traversed by the microphone.

*Linear Traverses:*

$$L_{min} = (n_{min} - 1)\lambda/2 \quad (A1.4)$$

<sup>6</sup> *Noise and Vibration Control*, Ed. by L. L. Beranek, McGraw-Hill, 1971, p. 115.

where:

$L_{min}$  = minimum length of straight line traverse.

The minimum radius of the circular path for a rotating microphone shall be 1.2 m.

A1.5.9 If the confidence intervals calculated do not meet the criteria in A1.4, then the number of microphone positions must be increased until the criteria are met.

A1.5.10 If the requirements of A1.2 do not allow enough measurement positions to be used in the room and thus reduce the confidence interval, then the rooms do not qualify for measurements according to this standard.

NOTE A1.2—Changes to diffuser arrangements or the addition of sound absorption may make the sound fields more uniform.

A1.5.11 The confidence intervals found by these procedures shall be re-measured whenever significant changes are made to measurement procedures, room geometry or diffusers. The data from which the estimates of confidence intervals were made must be kept on record as a detailed report.

NOTE A1.3—Laboratories are free to measure confidence intervals as frequently as they wish.

#### A1.6 Repeatability Tests:

A1.6.1 The laboratory must determine the repeatability limits for their test procedures as follows.

A1.6.2 Using any specimen, conduct at least six complete sets of measurements according to this test method without disturbing the specimen or the room.

A1.6.3 At each frequency, calculate the standard deviation of the normalized sound pressure levels,  $S_{L_o}$ .

A1.6.4 At each frequency, calculate  $2.8 S_{L_o}$ . This is the 95 % confidence limit for such repeat tests.

NOTE A1.4—This confidence limit does not relate to the values that would be obtained if the specimen were destroyed and a nominally identical specimen were constructed and tested. These limits do, however, give an estimate of the range in the data that might be seen if the test were repeated with no change to the specimen.

A1.6.5 The repeatability limits may be different for different floor types. It is useful to repeat this process for each of the floor types normally encountered by the laboratory.

A1.6.6 These repeatability tests need only be re-done when significant changes are made to the measurement procedures.

## A2. LABORATORY ACCREDITATION

### A2.1 Scope:

A2.1.1 This annex describes the information that must be supplied by a laboratory to an accrediting authority and the procedures required to demonstrate compliance with all the provisions of this standard method of test.

A2.1.2 Accrediting authorities are obviously free to add to the set of requirements here. This set comprises a minimum requirement in the opinion of ASTM committee E33.

A2.1.3 The information required from the laboratory needs to be interpreted by a knowledgeable accreditor. It is the responsibility of the accrediting agency to employ such individuals.

### A2.2 Referenced Documents:

A2.2.1 *ASTM Standards*: C634 Terminology Relating to Building and Environmental Acoustics

ASTM STP 15D Manual for the Presentation of Data and Control Chart Analysis

### A2.3 Laboratory Information :

A2.3.1 The laboratory shall provide drawings showing the test facilities in plan and elevation. All room linear dimensions and volumes shall be given on these drawings.

A2.3.2 The laboratory shall provide drawings showing the dimensions of the test specimen opening, the method for supporting specimens and how the opening connects to the rest of the test room.

A2.3.3 The laboratory shall provide the dimensions and total area (one-side) of any diffusing panels in the receiving room.

A2.3.4 The laboratory shall provide the number of loudspeakers, their type and disposition in the receiving room.

A2.3.5 The laboratory shall provide a description of any other procedures used to reduce spatial variations in the receiving room.

A2.3.6 The laboratory shall provide a description of the system used to ensure that the temperature and relative humidity in the receiving room are maintained within the specified limits.

A2.3.7 The laboratory shall provide a report of measurements made on the tapping machine to verify that it meets the requirements of this test method and any records of periodic check measurements made to ensure that the tapping machine remains within specification.

A2.3.8 The laboratory shall provide a copy of the report of measurements made following Annex A1 to qualify the receiving room.

### A2.4 Measurement and Calculation Procedures:

A2.4.1 The laboratory must identify the type of calibrator used to calibrate the measurement system before each test, the date it was last calibrated and a description of any procedures used to verify that its calibration has remained valid.



A2.4.2 The laboratory must describe the type of analyzer used to measure the sound pressure levels in the room. (Provide copies of the parts of the operator's manual that describe the filter response and the specifications.) Provide a description of any procedures followed to verify that the analyzer meets the specifications of the manufacturer and of this test method. Provide the date of the last calibration or check of the instrument.

A2.4.3 The laboratory shall provide the type of microphone(s) used in the receiving room.

A2.4.4 The laboratory must describe the procedure for determining the average sound pressure level in the receiving room: averaging time, the number of microphone positions and their locations or type of moving microphone (provide radius of a circular path or length of a linear traverse.)

A2.4.5 The laboratory must describe the procedure for determining the sound absorption in the receiving room.

A2.4.6 The laboratory must provide a detailed description of how the calculations required by the test method are carried out. If a customized program makes calculations during routine testing, evidence must be presented that the calculations are correct. This evidence might, for example, be a spreadsheet making the same calculations and giving the same answers as the customized software.

NOTE A2.1—To facilitate checking of calculations, it is useful to have custom software save all measured data and calculated values to files.

#### A2.5 Test Specimens:

A2.5.1 The laboratory must provide descriptions of procedures for aging test specimens.

A2.5.2 The laboratory must provide descriptions of procedures for installing the types of specimens typically tested in the laboratory: for example, joist floors, concrete slabs etc.

A2.6 Test Procedures—The laboratory must provide a copy of the work instructions followed by the technician running the test.

A2.6.1 *Quality Control*—The laboratory must describe the responsibilities of those members of the staff involved in the measurement and approval steps of routine testing.

A2.6.2 *Test Reports*—The accreditor will select several past tests run by the laboratory and ask to see the records of all physical measurements made on the test specimen and the materials comprising it, and the final test reports for these tests.

A2.6.3 The laboratory must provide a copy of the data obtained during repeatability testing (see A1.6).

#### A2.7 Reference Specimen:

A2.7.1 The laboratory shall choose a floor construction to be used as a reference test specimen to check the repeatability of the laboratory.

A2.7.2 The reference test specimen should be tested at least annually. It must be removed and re-installed between tests. It must have been installed and tested within the 12 months prior to any test using this test method.

A2.7.3 When a new reference specimen is introduced in a laboratory, a set of test records for that specimen needs to be established quickly for use by accreditors as well as the laboratory staff. Initially, the reference specimen should be tested at intervals of about 6 months until 5 sets of data have been obtained. Thereafter, annual testing will suffice. Laboratories are always free to check reference specimens more frequently.

A2.7.4 Data resulting from repeated tests made on the reference specimen shall be analyzed by the control chart method described in Part 3 of ASTM STP 15D. The analysis shall be according to the subsection entitled "Control—No Standard Given".

A2.7.5 All records of the tests and the statistical analysis of the results for the reference test specimen shall be made available to the accrediting authority.

*ASTM International takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.*

*This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.*

*This standard is copyrighted by ASTM International, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website (www.astm.org). Permission rights to photocopy the standard may also be secured from the Copyright Clearance Center, 222 Rosewood Drive, Danvers, MA 01923, Tel: (978) 646-2600; http://www.copyright.com/*