



# Standard Specification for Poly (Vinyl Chloride)(PVC) Closed Profile Gravity Pipe and Fittings Based on Controlled Inside Diameter <sup>1</sup>

This standard is issued under the fixed designation F1803; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon ( $\epsilon$ ) indicates an editorial change since the last revision or reapproval.

## 1. Scope\*

1.1 This specification covers requirements for poly(vinyl chloride) (PVC) closed profile sewer pipe and fittings with integral bell and elastomeric seal joints or plain end pipe with couplings in sizes (18 to 60 in.) based on a controlled inside diameter.

1.2 The values stated in inch-pound units are to be regarded as standard. The values given in parentheses are mathematical conversions to SI units that are provided for information only and are not considered standard.

1.3 The following safety hazard caveat pertains only to the test methods portion, Section 8, of this specification: *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

NOTE 1—Pipe and fittings produced to this specification should be installed in accordance with Practice D2321.

## 2. Referenced Documents

### 2.1 ASTM Standards:<sup>2</sup>

- D618 Practice for Conditioning Plastics for Testing
- D1600 Terminology for Abbreviated Terms Relating to Plastics
- D1784 Specification for Rigid Poly(Vinyl Chloride) (PVC) Compounds and Chlorinated Poly(Vinyl Chloride) (CPVC) Compounds
- D2122 Test Method for Determining Dimensions of Thermoplastic Pipe and Fittings
- D2152 Test Method for Adequacy of Fusion of Extruded

### Poly(Vinyl Chloride) (PVC) Pipe and Molded Fittings by Acetone Immersion

- D2321 Practice for Underground Installation of Thermoplastic Pipe for Sewers and Other Gravity-Flow Applications
- D2412 Test Method for Determination of External Loading Characteristics of Plastic Pipe by Parallel-Plate Loading
- D2444 Test Method for Determination of the Impact Resistance of Thermoplastic Pipe and Fittings by Means of a Tup (Falling Weight)
- D2855 Practice for Making Solvent-Cemented Joints with Poly(Vinyl Chloride) (PVC) Pipe and Fittings
- D3212 Specification for Joints for Drain and Sewer Plastic Pipes Using Flexible Elastomeric Seals
- F402 Practice for Safe Handling of Solvent Cements, Primers, and Cleaners Used for Joining Thermoplastic Pipe and Fittings
- F412 Terminology Relating to Plastic Piping Systems
- F477 Specification for Elastomeric Seals (Gaskets) for Joining Plastic Pipe
- F679 Specification for Poly(Vinyl Chloride) (PVC) Large-Diameter Plastic Gravity Sewer Pipe and Fittings

### 2.2 Federal Standard:<sup>3</sup>

- Fed. Std. No. 123 Marking for Shipment (Civil Agencies)

### 2.3 Military Standard:<sup>3</sup>

- MIL-STD-129 Marking for Shipment and Storage

## 3. Terminology

3.1 *Definitions*—Definitions are in accordance with Terminology F412, and abbreviations are in accordance with Terminology D1600, unless otherwise specified. The abbreviation for poly(vinyl chloride) is PVC.

### 3.2 *Definitions of Terms Specific to This Standard:*

3.2.1 *closed profile (CP) gravity sewer pipe, n*—a pipe product consisting of an essentially smooth waterway braced circumferentially or spirally with projections or ribs that are joined by an essentially smooth outer wall (see Fig. 1).

<sup>1</sup> This specification is under the jurisdiction of ASTM Committee F17 on Plastic Piping Systems and is the direct responsibility of Subcommittee F17.62 on Sewer. Current edition approved Nov. 15, 2015. Published December 2015. Originally approved in 1997. Last previous edition approved in 2006 as F1803 – 06 which was withdrawn in January 2015 and reinstated in November 2015. DOI: 10.1520/F1803-15.

<sup>2</sup> For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

<sup>3</sup> DLA Document Services Building 4/D 700 Robbins Avenue Philadelphia, PA 19111-5094 <http://quicksearch.dla.mil/>

\*A Summary of Changes section appears at the end of this standard

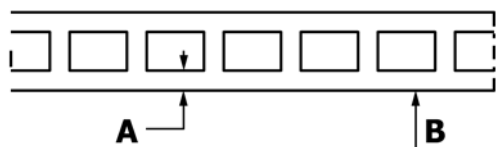


FIG. 1 Typical Closed Profile (CP) (A) Waterway minimum wall (B) Average inside diameter

#### 4. Significance and Use

4.1 The requirements of this specification are intended to provide pipe and fittings suitable for nonpressure drainage of sewage and surface water.

NOTE 2—Industrial waste disposal lines should be installed only with the specific approval of the governing code authority since chemicals not commonly found in drains and sewers and temperatures in excess of 140°F may be encountered.

#### 5. Material

5.1 *Basic Materials*—The pipe and fittings shall be made of PVC plastic having a minimum cell classification of 12454 or 12364 as defined in Specification D1784. Homopolymer PVC compounds must meet or exceed the requirements of the above listed minimum cell classification number.

5.2 *Rework Material*—Clean rework material generated from the manufacturer’s own pipe or fittings production may be used by the same manufacturer provided pipe or fittings produced meet all the requirements of this specification.

5.3 *Gaskets*—Elastomeric gaskets shall comply with the requirements described in Specification F477.

5.4 *Lubricant*—The lubricant used for assembly shall be suitable for use with PVC pipe and elastomeric seals for this application and have no detrimental effect on the gasket or on the pipe.

#### 6. Joining Systems

6.1 *Gasketed Joint*—The integral bell gasketed joint, coupling, or fitting joints shall be designed so that when assembled, the gasket (which is attached to either the bell or the spigot) will be compressed radially on the pipe spigot or in the bell to form a water-tight seal. The joints shall be designed

to comply with and show no sign of leakage when tested in accordance with 7.7 when assembled with pipe for which they are intended.

6.2 Couplings shall form a water-tight seal when assembled with plain end pipe and show no sign of leakage when tested in accordance with 7.7 when assembled with pipe for which they are intended.

NOTE 3—The outside diameters of products manufactured to this specification are not specified and therefore joint compatibility should be reviewed.

6.3 The joint shall be designed to avoid displacement of the gasket when assembled in accordance with the manufacturer’s recommendation.

6.4 The assembly of joints shall be in accordance with the manufacturer’s recommendations.

#### 7. Requirements

7.1 *Workmanship*—The pipe and fittings shall be essentially uniform in color, opacity, density, and other properties. The inside and outside surfaces shall be semimatte or glossy in appearance and free of chalking, sticky, or tacky material. The surfaces shall be free of excess bloom; that is, slight bloom is acceptable. The pipe walls shall be free of cracks, holes, blisters, voids, foreign inclusions, or other defects that are visible to the naked eye and that may affect the wall integrity. Bloom or chalking may develop in pipe exposed to direct rays of the sun (ultraviolet radiant energy) for extended periods and consequently these requirements do not apply to pipe after extended exposure to direct rays of the sun.

##### 7.2 Pipe Fitting Dimensions:

7.2.1 *Diameter*—The inside diameter of the pipe shall meet the requirements given in Table 1 when measured in accordance with 8.4.1.

7.2.2 *Wall Thickness*—The minimum wall thickness of the waterway of pipe and fittings fabricated from pipe sections shall meet the requirements given in Table 1 when measured in accordance with 8.4.2. The wall thickness of fittings fabricated from pipes meeting the requirements of Specification F679 are also satisfactory.

TABLE 1 Pipe Dimensions and Stiffness

Nominal Pipe Size, in.	Minimum Inside Diameter, <sup>A</sup> in. (mm)	Tolerance on Inside Diameter, in. (mm)	Minimum Pipe Stiffness Series 46, lbf/in. <sup>2</sup> (kPa)	Waterway Minimum Wall Series 46, in. (mm)
18	17.595 (446.91)	+0.110 (+2.79)	46 (320)	0.070 (1.78)
21	20.690 (525.53)	+0.120 (+3.05)	46 (320)	0.080 (2.03)
24	23.430 (595.12)	+0.140 (+3.56)	46 (320)	0.100 (3.54)
27	26.420 (671.01)	+0.160 (+4.06)	46 (320)	0.115 (2.92)
30	29.410 (747.01)	+0.180 (+4.57)	46 (320)	0.125 (3.18)
33	32.405 (823.09)	+0.190 (+4.83)	46 (320)	0.140 (3.56)
36	35.395 (899.03)	+0.210 (+5.33)	46 (320)	0.150 (3.81)
39	38.385 (974.98)	+0.230 (+5.84)	46 (320)	0.165 (4.19)
42	41.375 (1050.93)	+0.250 (+6.35)	46 (320)	0.180 (4.57)
45	44.370 (1127.00)	+0.260 (+6.60)	46 (320)	0.195 (4.95)
48	47.360 (1202.94)	+0.280 (+7.11)	46 (320)	0.210 (5.33)
54	53.350 (1355.09)	+0.300 (+7.62)	46 (320)	0.225 (5.72)
60	59.340 (1507.24)	+0.320 (+8.128)	46 (320)	0.240 (6.10)

<sup>A</sup> In-plant quality control manufacturing. Base inside diameter calculations should include out-of-roundness as a result of shipping and handling.

7.2.3 *Bell Wall Thickness*—In the case of belled pipe and fittings fabricated from pipe sections, the thickness of the wall in the bell shall be considered satisfactory if it was formed from pipe meeting the previous requirements. For reducing fittings or those with smaller inlets, the minimum wall thickness for each inlet shall be no less than the minimum wall thickness for that size pipe.

7.2.4 *Fittings:*

7.2.4.1 *Molded Fittings*—Molded fittings conforming to the requirements of Specification F679 may also be used with profile gravity sewer pipe provided an adapter (when required) is used to make the connection. The minimum wall thickness of the molded fittings and adapter shall coincide with the values listed in Table 1 of Specification F679. The thickness in the wall of the adapter bell shall be considered satisfactory if formed from pipe meeting the previous requirements.

7.2.4.2 *Fabricated Fittings*—Fabricated fittings shall be made from the pipe meeting the requirements of this specification, or Specification F679. Fabricated fittings with solvent cement components shall be made in accordance with Practice D2855 and taking cognizance of Practice F402. Unreinforced solvent cement mitred joints shall not be used. Fabricated joints shall be adequately lapped or fusion butt welded and, when needed, additionally reinforced.

7.3 *Pipe Flattening*—There shall be no evidence of splitting, cracking, breaking, or separation of ribs or seams when pipe is tested in accordance with 8.5.

7.4 *Pipe Impact Strength*—The impact strength shall not be less than the values shown in Table 2 when tested in accordance with 8.6.

NOTE 4—This requirement is intended only for use as a quality control test, not a simulated service test.

7.5 *Pipe Stiffness*—Pipe stiffness values for the pipe shall comply with Table 1 when tested in accordance with 8.7.

7.6 *Gaskets*—Gaskets shall meet the low head application requirements of Specification F477 and be molded into a circular form or extruded to the proper section and then spliced into circular form.

7.7 *Joint Tightness*—All joints shall show no signs of leakage when tested in accordance with Specification D3212 and Fig. 2. All surfaces of the joint upon which the gasket may bear shall be smooth and free of imperfections, ridges, fractures, or cracks that could adversely affect sealability.

7.8 *Acetone Immersion*—The pipe shall meet the requirements as defined in Test Method D2152 when tested in accordance with 8.8.

NOTE 5—This is intended only for use as a quality control test and not for use as a simulated service test.

7.9 *Air Test*—When pipe is made in such a manner that a seam or exposed channel is present, each length shall pass a 3.5-psi air test in accordance with 8.9.

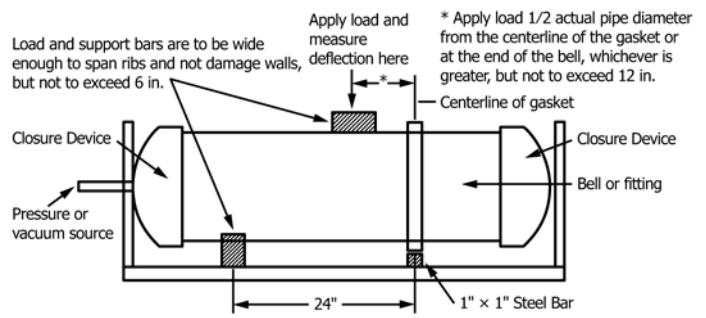


FIG. 2 Shear Deflection Test

7.10 *Exposed Channels*—Cut exposed channels of closed profile pipe shall be sealed with a material to provide an adequate seal to prevent infiltration and exfiltration and be resistant to sewer and drainage environments.

8. Test Methods

8.1 *Conditioning:*

8.1.1 *Referee Testing*—When conditioning is required for referee tests, condition the specimens in accordance with Procedure A of Practice D618 at  $73.4 \pm 3.6^\circ\text{F}$  ( $23 \pm 2^\circ\text{C}$ ) and  $50 \pm 10\%$  relative humidity for not less than 40 h prior to test. Conduct tests under the same conditions of temperature and humidity, unless otherwise specified.

8.1.2 *Quality Control Testing*—Condition specimens for a minimum of 4 h in air or 1 h in water at  $73.4 \pm 3^\circ\text{F}$  ( $23 \pm 2^\circ\text{C}$ ). Test the specimens at  $73.4 \pm 3^\circ\text{F}$  without regard to relative humidity.

8.2 *Test Conditions*—Conduct tests in the standard laboratory atmosphere of  $73.4 \pm 3.6^\circ\text{F}$  ( $23 \pm 2^\circ\text{C}$ ) and  $50 \pm 10\%$  relative humidity, unless otherwise specified in the test methods or in this specification. In cases of disagreement, the tolerances shall be  $\pm 1.8^\circ\text{F}$  ( $\pm 1^\circ\text{C}$ ) and  $\pm 2\%$  relative humidity.

8.3 *Sampling*—The selection of the samples of pipe shall be as agreed upon between the purchaser and the seller. In case of no prior agreement, any sample selected by the testing laboratory shall be deemed adequate.

8.4 *Dimensions:*

8.4.1 *Inside Diameter*—Determine the average inside diameter using an internal micrometer or telescoping gage accurate to  $\pm 0.001$  in. ( $\pm 0.02$  mm). Take sufficient readings, a minimum of four, to ensure that the maximum and minimum have been determined. Calculate the average diameter as the arithmetic mean of the diameters measured. As an alternative method, an inside-diameter-type circumferential tape may be used if proper care is taken to align it at right angles to the pipe axis. A tapered plug gage as described in Test Method D2122 may also be used.

8.4.2 *Wall Thickness*—Measure the wall thickness of the thinnest cross section of the waterway in the gaps between ribs in accordance with Test Method D2122. Make sufficient readings, a minimum of eight, to ensure that the minimum thickness is determined. (See Table 1).

TABLE 2 Minimum Impact Strength, 73°F (23°C)

Nominal Size, in.	Impact Strength, ft-lbf(J)
18 to 60	220(299)

8.5 *Flattening*—Flatten three specimens of pipe between parallel plates in a suitable press until the distance between the plates, expressed as % of the pipe diameter, by the greater of 40 % or of the value as determined by  $[3.43 (OD)/(OD - ID)]$ . The rate of loading shall be uniform and such that the compression is completed within 2 to 5 min. The specimen shall pass if no splitting, cracking, breaking, or separation of seams is observed under normal light with the unaided eye. The specimen shall be considered as failing this test if the load does not increase continuously (or smoothly) with increasing deflection to the point of maximum load. The maximum load point shall not be less than 30 % deflection.

8.5.1 Test specimens shall be 12 in. (305 mm) long.

8.6 *Impact Resistance*—Determine the impact resistance of the pipe in accordance with conditions and apparatus in Test Method **D2444**. Impact tests shall be conducted at two different locations. The two locations are (1) directly on the pipe midway between ribs, and (2) directly on the seam. (Where a seam cannot be struck directly, this orientation is omitted.) Failure of the test specimen shall be any crack, split, or shattering of the waterway. Separation of seams constitutes a failure.

8.6.1 Test six specimens, three at each orientation, each 12 in. (305 mm) long, using either 20-lb (9-kg) Tup B, or 30-lb (15-kg) Tup B and flat plate Holder B. All six specimens shall pass. If one fails, test another six specimens. Eleven passes out of twelve tested shall be acceptable.

8.7 *Pipe Stiffness*—Determine the pipe stiffness at 5 % deflection datum in accordance with Test Method **D2412**. The pipe stiffness of each specimen tested shall equal or exceed the minimum value listed in **Table 1**.

8.7.1 Three specimens are to be run per test. The length of the specimens are specified in **Table 3**. Circumferentially ribbed test specimens must be selected so that they are representative of the entire pipe.

NOTE 6—A representative stiffness specimen contains the proper ratio of ribs and flat area lengths to exhibit the entire pipe length. When properly selected, specimens cut consecutively from a pipe length and untrimmed will provide stiffness results that are approximately equal.

NOTE 7—The 5 % deflection criterion that was arbitrarily selected for testing convenience should not be considered as a limitation with respect to in-use deflection. The engineer is responsible for establishing the acceptable deflection limit.

8.8 *Acetone Immersion*—Conduct this test in accordance with Test Method **D2152**. The procedure is used for determining the degree of fusion of extruded PVC plastic pipe as indicated by reaction to immersion in anhydrous acetone. It is applicable only for distinguishing between unfused and properly fused PVC.

**TABLE 3 Specimen Size for Pipe Stiffness**

Pipe Configuration	Pipe Diameter, in.
	18 to 60
Circumferential	12, min
Helical	12 or one full wrap, whichever is larger

8.9 *Air Test*—Test each full length of pipe for air tightness at 3.5 psig (24.1 kPa) for the minimum dwell period specified in **Table 4**.

8.9.1 Seal pipe ends with a suitable restrained closure. If exposed channel seals exist, the restrained closures should be positioned such that the air test checks the seals. Pressurize the pipe with air at 3.5 psig (24.1 kPa) and cut off the air source. (Pipe may be pressurized above 3.5 psig and then the pressure reduced to this level before commencing the dwell period.) Commence timing the dwell period specified in **Table 4**. If the pressure falls below 3.375 psig (23.3 kPa) within the designated test period, reject the pipe. If not, accept the pipe.

## 9. Retest and Rejection

9.1 If the results of any test(s) do not meet the requirements of the specification, the test shall be conducted again only by agreement between the purchaser and seller. Under such agreement, minimum requirements shall not be lowered, changed, or modified, nor shall specification limits be changed. If upon retest failure occurs, the quantity of product represented by the test(s) does not meet the specification.

## 10. Marking

10.1 *Pipe Marking*—Each standard and random length of pipe in compliance with this specification shall be clearly marked by the producer in accordance with the following example at the interval of (5 ft) 1.5 m or less:

10.1.1 Manufacturer’s name, trade name, or trademark, and code.

10.1.2 Nominal pipe size in inches.

10.1.3 The PVC minimum cell classification as listed in **Table 1**, Specification **D1784**.

10.1.4 The legend “PS 46 PVC Sewer Pipe.”

10.1.5 This designation, ASTM F1803.

10.2 *Fittings Marking*—The fittings in compliance with this specification shall be clearly marked in accordance with the following example:

10.2.1 Manufacturer’s name or trademark and code.

10.2.2 Nominal size in inches.

10.2.3 The material designation “PVC.”

10.2.4 The designation, ASTM F1803.

NOTE 8—Manufacturer’s code to include day, month, year, shift, plant, and extruder of manufacturer.

**TABLE 4 Dwell Period for Air Test**

Nominal Pipe Diameter in.	Min Dwell Period, min:s
18	2:10
21	2:25
24	2:50
27	3:10
30	3:30
33	3:55
36	4:15
39	4:35
42	4:55
45	5:20
48	5:40
54	6:00
60	6:20

10.3 The markings shall be applied to the pipe in such a manner that they remain legible after installation and inspection has been completed.

### **11. Inspection**

11.1 *Notification*—If inspection is specified by the purchaser, the manufacturer shall notify the purchaser in advance of the date, time, and place of testing of the pipe in order that the purchaser may be represented at the test.

11.2 *Access*—The inspector shall have free access to those parts of the manufacturer’s plant that are involved in work performed under this specification. The manufacturer shall afford the inspector all reasonable facilities for determining whether the pipe meets the requirements of this specification.

### **12. Certification**

12.1 When agreed upon in writing by the purchaser and the seller, a certification shall be made on the basis of acceptance of the material. This shall consist of a copy of the manufac-

turer’s test report or a statement by the seller, accompanied by a copy of the test results, that the material has been sampled, tested, and inspected in accordance with the provisions of this specification. Each certification, so furnished, shall be signed by an authorized agent of the seller or manufacturer.

### **13. Quality Assurance**

13.1 When the product is marked with this ASTM designation (F1803), it affirms that the product was manufactured, inspected, sampled, and tested in accordance with this specification and has been found to meet the requirements of this specification.

### **14. Delivery**

14.1 All pipe and couplings and fittings shall, unless otherwise specified, be packaged for standard commercial shipment.

### **15. Keywords**

15.1 closed profile wall; PVC; sewer pipe

## **SUPPLEMENTARY REQUIREMENTS**

### **GOVERNMENT/MILITARY PROCUREMENT**

These requirements apply only to federal/military procurement, not domestic sales or transfers.

#### *S1. Responsibility for Inspection:*

Unless otherwise specified in the contract or purchase order, the producer is responsible for the performance of all inspection and test requirements specified herein. The producer may use his own or any other suitable facilities for the performance of all inspection and test requirements specified herein, unless the purchaser disapproves. The purchaser shall have the right to perform any of the inspections and tests set forward in this specification where such inspections are deemed necessary to ensure that material conforms to prescribed requirements.

NOTE S1.1—In U.S. federal contracts, the contractor is responsible for inspections.

#### *S2. Packaging and Marking for U.S. Government Procurement:*

S2.1 *Packaging*—Unless otherwise specified in the contract, the materials shall be packaged in accordance with the supplier’s standard practice in a manner ensuring arrival at destina-

tion in satisfactory condition and which will be acceptable to the carrier at the lowest rates. Containers and packaging shall comply with Uniform Freight Classification rules or National Motor Freight Classification rules.

S2.2 *Marking*—Marking for shipment shall be in accordance with Fed. Std. No. 123 for civil agencies and MIL-STD-129 for military agencies.

NOTE S2.1—The inclusion of U.S. Government procurement requirements should not be construed as an indication that the U.S. Government uses or endorses the product described in this specification.

**SUMMARY OF CHANGES**

Committee F17 has identified the location of selected changes to this standard since the last issue (F1803–06) that may impact the use of this standard.

(1) Revised relative humidity tolerances in **8.1.1** and **8.2**.

*ASTM International takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.*

*This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.*

*This standard is copyrighted by ASTM International, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or [service@astm.org](mailto:service@astm.org) (e-mail); or through the ASTM website ([www.astm.org](http://www.astm.org)). Permission rights to photocopy the standard may also be secured from the Copyright Clearance Center, 222 Rosewood Drive, Danvers, MA 01923, Tel: (978) 646-2600; <http://www.copyright.com/>*