



Standard Specification for Corrugated High Density Polyethylene (HDPE) Grease Interceptor Tanks¹

This standard is issued under the fixed designation F2649; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reappraisal. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reappraisal.

1. Scope*

1.1 This specification covers material, design, structural performance, and manufacturing practice requirements for monolithic or sectional corrugated polyethylene grease interceptor tanks with volumes equal to or greater than 333 gal (1,260 L).

1.2 The corrugated high density polyethylene (HDPE) grease interceptor tanks are placed between commercial food service (kitchen) drains and sanitary sewer interceptors to minimize the impact of commercial food service effluent containing grease, oils, soap scum and other typical commercial food service wastes on the sanitary sewer system. Typical sources of commercial kitchen effluent are scullery sinks, pot and pan sinks, dishwashers, soup kettles and floor drains where grease containing materials may exist.

1.3 The values stated in inch-pound units are to be regarded as standard. The values given in parentheses are mathematical conversions to SI units that are provided for information only and are not considered standard.

1.4 This specification covers pipe and fittings for horizontally laid corrugated HDPE grease interceptor tanks as illustrated in Fig. 1.

1.5 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

2. Referenced Documents

2.1 ASTM Standards:²

D543 Practices for Evaluating the Resistance of Plastics to Chemical Reagents

¹ This specification is under the jurisdiction of ASTM Committee F17 on Plastic Piping Systems and is the direct responsibility of Subcommittee F17.26 on Olefin Based Pipe.

Current edition approved Sept. 1, 2014. Published September 2014. Originally approved in 2008. Last previous edition approved in 2008 as F2649 – 08a. DOI: 10.1520/F2649-14.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

D1600 Terminology for Abbreviated Terms Relating to Plastics

D3212 Specification for Joints for Drain and Sewer Plastic Pipes Using Flexible Elastomeric Seals

F412 Terminology Relating to Plastic Piping Systems

F477 Specification for Elastomeric Seals (Gaskets) for Joining Plastic Pipe

F667 Specification for 3 through 24 in. Corrugated Polyethylene Pipe and Fittings

F714 Specification for Polyethylene (PE) Plastic Pipe (DR-PR) Based on Outside Diameter

F2306/F2306M Specification for 12 to 60 in. [300 to 1500 mm] Annular Corrugated Profile-Wall Polyethylene (PE) Pipe and Fittings for Gravity-Flow Storm Sewer and Subsurface Drainage Applications

2.2 IAPMO Document:³

Uniform Plumbing Code

IAPMO/ANSI Z1001 Prefabricated Gravity Grease Interceptors

2.3 American Society of Civil Engineers:⁴

ASCE No.60 Gravity Sanitary Sewer Design and Construction

2.4 Plastic Pipe Institute:⁵

PPI TR-4 PE3408

2.5 AASHTO Document:⁶

AASHTO LRFD Bridge Design Specifications

3. Terminology

3.1 For definitions of terms relating to plastics, see Terminology F412 and abbreviations are in accordance with Terminology D1600, unless otherwise specified.

3.2 Definitions of Terms Specific to This Standard:

³ Available from International Association of Plumbing and Mechanical Officials, 5001 E. Philadelphia St., Ontario, CA 91761, <http://www.iapmo.org>.

⁴ Available from American Society of Civil Engineers (ASCE), 1801 Alexander Bell Dr., Reston, VA 20191, <http://www.asce.org>.

⁵ Available from Plastics Pipe Institute (PPI), 105 Decker Court, Suite 825, Irving, TX 75062, <http://www.plasticpipe.org>.

⁶ Available from American Association of State Highway and Transportation Officials (AASHTO), 444 N. Capitol St., NW, Suite 249, Washington, DC 20001, <http://www.transportation.org>.

*A Summary of Changes section appears at the end of this standard

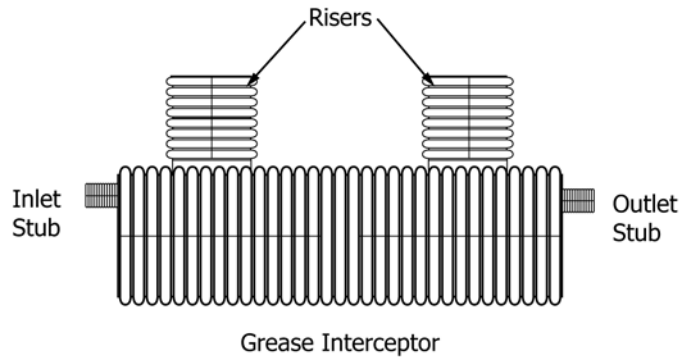


FIG. 1 Standard Corrugated HDPE Grease Interceptor

3.2.1 *access opening, n*—a hole in the top or crown of the tank used to gain access to the inside of the tank for the purpose of cleaning and removing grease, floating scum and sludge without a person actually having to enter the tank.

3.2.2 *baffle, n*—a partition across the width of the tank that extends partially between the top and bottom intended to deflect influent downward and increase the length of the flow path of the liquid as it travels through the tank.

3.2.3 *grease interceptor tank system, n*—a single tank or series of tanks in which wastes from a kitchen or food service industry containing no sanitary discharges is received and retained, and from which the liquid effluent, which is comparatively free from settleable and floating solids, is then discharged to a public sewer, septic system, or approved treatment system.

3.2.4 *inspection opening, n*—a hole in the top or crown of the tank used for the purpose of observing conditions inside the tank.

3.2.5 *joint, n*—a physical separation where two pieces of the tank or pipe-tank interface are in contact.

3.2.6 *monolithic corrugated high density polyethylene grease interceptor tank, n*—a single extruded piece of pipe with no internal joints other than end caps that serves as the principal tank structure.

3.2.7 *owner, n*—is by definition end user, customer, or purchaser.

3.2.8 *sectional corrugated high density polyethylene grease interceptor tank, n*—a group or two or more extruded pieces of pipe connected with joints that when combined serve as the principal tank structure.

4. Ordering Information

4.1 The owner shall include the following information in bidding documents and on the purchase order, as applicable to the units being ordered:

- 4.1.1 Reference to this specification, and date of issue,
- 4.1.2 Quantity or number of units ordered,
- 4.1.3 Capacity of tank in gal or L, based on owner's requirements,
- 4.1.4 Application conditions such as effluent and temperature of discharge,

4.1.5 Acceptance will be based on a review of the calculations or on proof tests,

4.1.6 Design requirements based on owner specified site conditions, such as depth of earth cover, live load applied at the surface, and ground water level, and

4.1.7 Testing for water leakage shall not be required at the job site unless specifically required by the owner at the time of ordering.

5. Materials and Manufacture

5.1 *Basic Materials*—Materials utilized for the fabrication of a corrugated polyethylene grease interceptor tank shall be evaluated for temperature extremes and effluent constituents in accordance with Practice D543.

5.1.1 *Tank and Risers*—The tank and risers shall be fabricated from pipe meeting the requirements of Specification F2306/F2306M.

5.1.2 *Inlet and Outlet Tees*—Inlet and outlet tees shall be fabricated from pipe meeting the requirements of Specification F2306/F2306M or F714.

5.1.3 *Vent pipes and internal tank piping*—Vent pipe and internal piping within the grease interceptor shall be fabricated from pipe and fittings meeting the requirements of Specification F2306/F2306M for dual wall pipe and Specification F667 for single wall pipe.

5.1.4 *Baffles and End Caps*—Baffles and end caps shall be fabricated from either flat plates meeting the requirements of PPI TR-4 PE3408 material.

5.1.5 *Welding Rod*—Welding rod shall be of medium or high density polyethylene, meeting the properties of the tank as required under Specification F2306/F2306M with the exception that the tensile strength at yield shall not be less than 5000 psi (3.5 M Kg/m²).

5.2 *Pipe Connections*—Pipe-to-tank connections shall employ flexible connectors conforming to the requirements of Specification F477. Materials for the connectors shall have demonstrated resistance to the effects of fats, oils, grease, and fluid temperatures specified under Section 4.

6. Structural Design Requirements

6.1 Structural design of grease interceptor tanks shall be by calculation.

6.1.1 Design by calculation shall be completed using the AASHTO LRFD Bridge Design Specifications, Section 12, “Buried Structures and Tunnel Liners.”

6.1.2 Tanks shall be designed so that they will not collapse or rupture when subjected to anticipated earth and hydrostatic pressures when the tanks are either full or empty. Design of end caps must consider the lateral load of both external water and earth loading including consideration of strength and deflection of the end cap, and how the load is transferred to and carried by the barrel of the tank.

6.1.3 After installation conditions are established, loads from AASHTO LRFD Bridge Design Specifications, Section 3, “Loads and Load Factors,” shall be used for design. Unless heavier live loads are expected, the minimum live load at the surface for design shall be an AASHTO H20 truck load.

6.2 *Openings*—The structural design shall take into consideration the number, placement, and size of all openings.

7. Physical Design Requirements

7.1 *Capacity*—Sizes are generally specified by local regulations and they shall supersede the following guidelines. When local regulations are not available, minimum grease interceptor capacity shall meet the performance requirements of IAPMO/ANSI Z1001 or ASCE No. 60 and be determined by use of one of the two sizing options below:

7.1.1 *Option 1*: The tank shall be sized in accordance with flow figures and factors listed in the Uniform Plumbing Code.

7.1.2 *Option 2*: The tank shall be sized by using the actual average daily-metered water use figures from the facility multiplied by a safety factor of 1.5.

7.2 *Compartments*:

7.2.1 Grease interceptor tank systems that utilize multiple compartments shall have the dividing walls welded to the tank body.

7.2.1.1 Welding of the dividing wall shall be done by continuous extrusion welding on both sides of the wall.

7.2.1.2 Welding rod shall be of medium or high density polyethylene meeting the properties for the tank as required under Specification **F2306/F2306M** with the exception that the tensile strength at yield shall not be less than 5000 psi (3.5 M Kg/m²).

7.2.2 Multiple units installed in series are acceptable.

7.2.3 Each compartment shall have a riser access for clean-out and maintenance.

7.3 *Influent and Effluent Pipes*:

7.3.1 The influent pipe shall be no less than 4 in. (100 mm) in diameter.

7.3.2 The difference between the invert of the influent pipe and the invert of the effluent pipe shall be a minimum of 2 in. (50 mm).

7.3.3 Inlet and outlet pipes shall be connected to the tank with a sealed flexible connector conforming to **F477** to accommodate tank movement.

7.4 *Outlet Devices*:

7.4.1 If tees or outlet filters are added, they shall be made of noncorrosive materials and be permanently connected with noncorrosive fasteners to either the inside of the tank or the outlet pipe.

7.4.2 Outlet filter device, if specified, shall be installed in accordance with manufacturer’s recommendations or requirements of regulating agencies, or both.

7.4.3 Specifications for tees and outlet filters shall be in accordance with normal, low-flow conditions. High-flow conditions, created when liquid is pumped from another tank, will require consideration for other dimensions. Design by a registered professional engineer is required for these cases.

7.5 *Openings in Tank Top*:

7.5.1 An access opening shall be located over the influent tee and the effluent tee. Where an opening has any dimension greater than 12 in. (300 mm) the cover shall weigh a minimum of 59 lb (27 kg.) or be provided with a lock system to prevent unauthorized entrance.

7.5.2 An access opening or inspection opening shall be provided to permit pumping of all compartments.

7.5.3 All openings, risers, and covers shall be sealed with resilient watertight seals meeting **F477**.

7.6 *End Plates*:

7.6.1 End plates shall be welded to the ends of the pipe sections to form the completed tank.

7.6.1.1 Welding of the end plates shall be done by continuous extrusion welding on both sides of the wall.

7.6.2 End caps shall be fabricated from flat plates meeting the requirements of PPI TR-4 PE3408 material.

8. Quality Control and Sampling

8.1 The manufacturer shall certify that the product meets three criteria: (1) water tightness, (2) physical dimensions, and (3) strength of grease interceptor tank.

8.2 Installation shall be in accordance with manufacturer’s instructions.

9. Performance Test Methods

9.1 Testing for leakage of the tank shall be performed using either vacuum testing or water-pressure testing. This testing is only to confirm the integrity of the welds and homogenous quality of the wall. Pressure testing of the joints and any similar connections shall be in accordance with **9.2**.

9.1.1 *Vacuum Testing*—Seal the empty tank and apply a vacuum to 100 mm (4 in.) of mercury. The tank is approved if the vacuum is held for 2 min.

9.1.2 *Water-Pressure Testing*—Seal the tank and fill with water. The tank is approved if water level is held for minimum of 15 minutes with no signs of leakage.

9.2 Testing of all bell and spigot joints shall be in accordance with Specification **D3212**.

10. Dimensions and Permissible Variations

10.1 *Dimensional Tolerances*—The length, width, height, or diameter measurements of the grease interceptor tank when measured on the inside surface shall not be less than 99 % of the design dimensions.

11. Repairs

11.1 Repairs of corrugated HDPE grease interceptor tanks, when required, shall be performed in accordance with the

manufacturer's recommendations in a manner ensuring that the repaired grease interceptor tank will conform to the requirements of this specification.

12. Rejection

12.1 Corrugated HDPE grease interceptor tanks or sections of grease interceptor tanks shall be subject to rejection because of failure to conform after repairs to any of the requirements contained in this specification.

13. Product Marking

13.1 Each grease interceptor tank shall be clearly marked within 2 ft (0.6 m) of the inlet to the tank by indentation or other approved means with (1) date manufactured, (2) name or trademark of the manufacturer, (3) tank capacity, (4) minimum and maximum amount of earth cover in ft (or m), inlet and

outlet clearly identified with this designation ASTM F2649, unless required otherwise by local codes.

13.2 When all the requirements of this specification are met, the product shall be so stamped.

14. Quality Assurance

14.1 When the product is marked with this designation, ASTM F2649, the manufacturer affirms that the product was manufactured, inspected, sampled, and tested in accordance with this specification and has been found to meet the requirements of this specification. When specified in the purchase order or contract, a report of the test results shall be furnished.

15. Keywords

15.1 corrugated HDPE pipe; grease interceptor tanks; liquid kitchen waste; wastewater pretreatment

SUMMARY OF CHANGES

Committee F17 has identified the location of selected changes to this standard since the last issue (F2649–08a) that may impact the use of this standard. (Approved September 1, 2014.)

(1) Section 3 was revised.

(2) 4.1.3 and 4.1.6 were revised.

(3) 5.1.4 was revised and 5.1.5 was added.

(4) 6.1.2 was revised.

(5) 7.5.2 and 7.6.2 were revised. 7.6.1.2 was deleted.

ASTM International takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.

This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.

This standard is copyrighted by ASTM International, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website (www.astm.org). Permission rights to photocopy the standard may also be secured from the Copyright Clearance Center, 222 Rosewood Drive, Danvers, MA 01923, Tel: (978) 646-2600; http://www.copyright.com/