



Standard Specification for 12 to 30 in. (300 to 750 mm) Annular Corrugated Profile-Wall Polyethylene (PE) Pipe and Fittings for Sanitary Sewer Applications¹

This standard is issued under the fixed designation F2762; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

^{ε1} NOTE—Units statement (1.4) was editorially revised in October 2013.

1. Scope

1.1 This specification covers requirements and test methods for annular, corrugated profile wall polyethylene pipe and fittings with an interior liner. The nominal inside diameters covered are 12 to 30 in. (300 to 750 mm).

1.2 The requirements of this specification are intended to provide pipe and fittings suitable for underground use for non-pressure sanitary sewer systems. Pipe and fittings produced in accordance with this specification shall be installed in compliance with Practice D2321.

1.3 This specification covers pipe and fittings with an interior liner using a corrugated exterior profile (Fig. 1).

1.4 *Units*—The values stated in inch-pound units are to be regarded as standard. The values given in parentheses are mathematical conversions to SI units that are provided for information only and are not considered standard.

1.5 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

2. Referenced Documents

2.1 *ASTM Standards*:²

- A666 Specification for Annealed or Cold-Worked Austenitic Stainless Steel Sheet, Strip, Plate, and Flat Bar
- D618 Practice for Conditioning Plastics for Testing
- D1600 Terminology for Abbreviated Terms Relating to Plastics

¹ This specification is under the jurisdiction of ASTM Committee F17 on Plastic Piping Systems and is the direct responsibility of Subcommittee F17.62 on Sewer. Current edition approved Jan. 1, 2011. Published January 2011. DOI: 10.1520/F2762-11.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

- D2122 Test Method for Determining Dimensions of Thermoplastic Pipe and Fittings
- D2321 Practice for Underground Installation of Thermoplastic Pipe for Sewers and Other Gravity-Flow Applications
- D2412 Test Method for Determination of External Loading Characteristics of Plastic Pipe by Parallel-Plate Loading
- D2444 Test Method for Determination of the Impact Resistance of Thermoplastic Pipe and Fittings by Means of a Tup (Falling Weight)
- D3212 Specification for Joints for Drain and Sewer Plastic Pipes Using Flexible Elastomeric Seals
- D3350 Specification for Polyethylene Plastics Pipe and Fittings Materials
- D4389 Specification for Finished Glass Fabrics Woven From Rovings
- F412 Terminology Relating to Plastic Piping Systems
- F477 Specification for Elastomeric Seals (Gaskets) for Joining Plastic Pipe
- F2136 Test Method for Notched, Constant Ligament-Stress (NCLS) Test to Determine Slow-Crack-Growth Resistance of HDPE Resins or HDPE Corrugated Pipe
- 2.2 *AASHTO Standard*:³
 - LRFD, Section 12 AASHTO LRFD Bridge Design Specifications Section 12 – Buried Structures and Tunnel Liners
 - 2.3 *Federal Standard*:⁴
 - Fed. Std. No. 123 Marking for Shipment (Civil Agencies)
 - 2.4 *Military Standard*:⁴
 - MIL-STD-129 Marking for Shipment and Storage

3. Terminology

3.1 *Definitions*—Definitions are in accordance with Terminology F412 and abbreviations are in accordance with Terminology D1600, unless otherwise specified. The abbreviation for polyethylene is PE.

³ Available from American Association of State Highway and Transportation Officials (AASHTO), 444 N. Capitol St., NW, Suite 249, Washington, DC 20001, http://www.transportation.org.

⁴ Available from Standardization Documents Order Desk, DODSSP, Bldg. 4, Section D, 700 Robbins Ave., Philadelphia, PA 19111-5098, http://dodssp.daps.dla.mil.

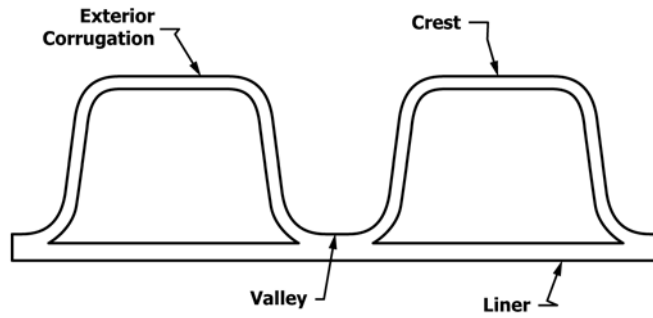


FIG. 1 Typical Annular Corrugated Pipe Profile

3.2 Definitions of Terms Specific to This Standard:

3.2.1 *profile wall, n*—In this case, the profile pipe wall construction provides an interior liner in the waterway and includes ribs, corrugations, or other shapes, which can be either solid or hollow, that helps brace the pipe against diametrical deformation.

4. Ordering Information

4.1 Orders for product made to this specification shall include the following information to adequately describe the desired product:

- 4.1.1 This ASTM designation and year of issue,
- 4.1.2 Diameters,
- 4.1.3 Total footage of each pipe diameter involved,
- 4.1.4 Pipe laying length,
- 4.1.5 Fitting type(s):
 - 4.1.5.1 Size and type of fittings, including mainline and branch diameters, and
 - 4.1.5.2 Number of fittings per diameter.

5. Materials and Manufacture

5.1 *Pipe and Fabricated Fittings*—The pipe and fabricated fittings shall be made of virgin PE compound meeting the requirements of Specification D3350 with a minimum cell classification of 435400C. The carbon black content in the pipe shall be equal to or greater than 2 wt % and shall not exceed 3 wt %. Compounds that have a higher cell classification in one or more properties shall be permitted provided all other product requirements are met.

5.2 *Rework*—Clean rework generated from the manufacturer’s own pipe and fittings production of this product shall be permitted to be used by the same manufacturer. Rework shall be the same cell classification as new PE compound with which it is blended and the pipe produced shall meet all the requirements of this specification.

6. Physical Properties

6.1 *Workmanship*—The pipe and fittings shall be homogeneous throughout and be as uniform as commercially practical in color, opacity, and density. The pipe walls shall be free of cracks, holes, blisters, voids, foreign inclusions, or other defects that are visible to the naked eye and that may affect the wall integrity. The ends shall be cut cleanly and squarely through valleys.

6.1.1 Visible defects, cracks, creases, splits, in pipe are not permissible.

6.2 Dimensions and Tolerance:

6.2.1 *Nominal Size*—The nominal size for the pipe and fittings shall be the inside diameter shown in Table 1.

6.2.2 *Minimum Inside Diameter*—The minimum manufacturer’s stated inside diameter shall be as shown in Table 1, when measured in accordance with 7.3.1.

NOTE 1—The outside diameters and the corrugation pitch of products manufactured to this specification are not specified; therefore, compatibility between pipe and fittings made to this specification from different manufacturers must be verified.

6.2.3 *Laying length*—The pipe shall be supplied in any laying length agreeable to both the owner and the manufacturer. Laying length shall not be less than 99 % of stated quantity when measured in accordance with 7.3.2.

6.2.4 *Liner Thickness*—The minimum liner thickness of the pipe shall meet the requirements given in Table 1 when measured in accordance with 7.3.3.

6.3 *Pipe Stiffness*—Minimum pipe stiffness at 5 % deflection shall meet the requirements given in Table 1 when tested in accordance with 7.4.

NOTE 2—The 5 % deflection criterion, which was selected for testing convenience, is not a limitation with respect to in-use deflection. The engineer is responsible for establishing the acceptable deflection limit.

TABLE 1 Pipe Stiffness and Pipe Dimensions

Nominal Diameter	Manufacturer’s Stated Inside Diameter and Tolerance		Minimum Pipe Stiffness at 5% Deflection		Minimum Liner Thickness
	Minimum, in. (mm)	Inside Diameter Tolerance, in. (mm)	lb/in./in. (kpa)	(in. (mm))	in. (mm)
12	12.00 (300)	±0.11 (±3)	46 (317)		0.043 (1.09)
15	14.95 (375)	±0.11 (±3)	46 (317)		0.052 (1.32)
18	17.94 (450)	±0.14 (±4)	46 (317)		0.060 (1.52)
21	20.88 (525)	±0.15 (±4)	46 (317)		0.062 (1.57)
24	24.00 (600)	±0.16 (±4)	46 (317)		0.064 (1.63)
27	26.89 (675)	±0.17 (±4)	46 (317)		0.073 (1.85)
30	29.92 (750)	±0.18 (±5)	46 (317)		0.086 (2.18)

6.4 *Pipe Flattening*—There shall be no evidence of splitting, cracking, breaking, separation of corrugation seams, separation of the valley and liner, or combinations thereof, when tested in accordance with 7.5.

6.5 *Pipe Impact Strength*—There shall be no evidence of splitting, cracking, breaking, separation of corrugation seams, separation of the valley and liner, or combinations thereof, on any specimen when tested in accordance with 7.6.

6.6 *Fittings and Joining Systems:*

6.6.1 Only fittings fabricated from pipe meeting this specification and supplied or recommended by the pipe manufacturer shall be used. Fabricated fittings shall be installed in accordance with the manufacturer's recommendations.

6.6.2 The joining system(s) shall be of a design that preserves alignment during construction and prevents separation at the joints.

6.6.3 Pipe and fittings shall have a watertight bell/spigot joint that complies with the laboratory tests defined and described in Specification D3212 and utilizes a gasket that complies with the requirements of Specification F477. All joints shall show no signs of leakage when tested in accordance with Specification D3212. Note that special provisions must be taken in order that joints made to field cut pipe meet the requirements of Specification D3212. Any component used in the joining material shall be resistant to effluents being carried in the pipe.

6.6.4 *Optional Bell Restraining Bands*—Bell restraining bands, when used, shall be made of corrosion resistant materials such as fiberglass (Specification D4389) or stainless steel (Specification A666).

6.6.5 *Joint Proof-of-Design*—To assess the effects of long-term properties of the pipe and gasket material under a joint assembly, a joint proof-of-design test shall be conducted on the pipe joints using the test method outlined in 7.8. Each joint proof of design pressure test shall be conducted by an independent third party, which provides written certification for each test. This test is a one-time validation test for the specific pipe diameter, profile geometry, gasket and joint configuration supplied by the manufacturer. This proof-of-design test shall be conducted on at least one pipe diameter within the prescribed diameter range and shall be conducted on each diameter that differs in joint design. If the joint design does not change within the prescribed range, the largest diameter shall be tested. If the diameter range includes more than 5 different pipe diameters, then two sizes shall be tested; the largest and smallest diameters.

6.7 *Slow Crack Growth Resistance Pipe*—For slow crack-growth resistance, the pipe shall be evaluated using the notched constant ligament stress (NCLS) test according to the procedure described in 7.7. The average failure time of the five test specimens shall exceed 30 h with no single test specimen's failure time less than 21 h. For smaller pipe sizes where the NCLS test cannot be conducted on the pipe due to size limitations on the longitudinal coupon, the NCLS test shall be conducted on molded plaques, and the average failure time of the five test specimens shall exceed 41 h.

6.8 *Structural Design:*

6.8.1 The manufacturer shall supply appropriate data necessary to satisfy the requirements of deflection, thrust, buckling, bending stress and long-term strain in accordance with the design criteria of the LRFD, Section 12. The design engineer shall verify that the data provided by the manufacturer satisfy the product requirements.

6.8.2 The minimum long-term (50-year) design values for modulus of elasticity and tensile strength for the PE compounds shall be 22,000 psi (152 MPa) and 900 psi (6.2 MPa), respectively.

6.8.3 The maximum allowable long-term (50-year) tensile strain limit for design shall be 5%.

7. Test Methods

7.1 *Conditioning:*

7.1.1 *Referee Testing*—When conditioning is required for referee tests, condition the specimens in accordance with Procedure A of Practice D618 at $73.4 \pm 3.6^\circ\text{F}$ ($23 \pm 2^\circ\text{C}$) for not less than 40 h prior to test. Conduct tests under the same conditions of temperature. The random selection of the sample or samples of the pipe and fittings shall be as agreed upon between the owner and the seller. In case of no prior agreement, any sample selected by the testing laboratory shall be permitted.

7.1.2 *Quality Control Testing*—Condition specimens for a minimum of 4 h prior to test in air or 1 h in water at $73.4 \pm 3.6^\circ\text{F}$ ($23 \pm 2^\circ\text{C}$) without regard to relative humidity.

7.2 *Test Conditions*—Conduct tests other than those for routine quality control purposes in the standard laboratory atmosphere of $73.4 \pm 3.6^\circ\text{F}$ ($23 \pm 2^\circ\text{C}$), in the referenced test method or in this specification.

7.3 *Dimensions:*

7.3.1 *Inside Diameter*—Measure the inside diameter in accordance with Test Method D2122.

7.3.2 *Laying length*—Measure pipe laying length in accordance with Test Method D2122. These measurements may be taken at ambient temperature.

7.3.3 *Minimum Inner-Liner Thickness*—Measure the thickness of the inner liner in accordance with Test Method D2122. Each specimen shall be cut perpendicular to the seam line of the pipe directly through a corrugation allowing a plain view of the inner wall 360° around the circumference in order to obtain a minimum of eight measurements in accordance with Test Method D2122.

7.4 *Pipe Stiffness*—Select three pipe specimens and test for pipe stiffness in accordance with Test Method D2412, except for the following conditions:

7.4.1 The test specimens shall be at least one diameter or 24 in. (609 mm) in length, whichever is less. However, the test specimen shall not be less than three full corrugations in length.

7.4.2 Each specimen shall be cut mid-valley to mid-valley (see Fig. 1) while still meeting or exceeding the minimum length requirement.

7.4.3 Determine the minimum inner wall thickness and locate the first specimen in the loading machine with the minimum inner wall thickness located at 9:00 or 3:00 when

viewing the specimen from the end. The specimen shall lie flat on the plate within 0.125 in. (3 mm). Use the first location as a reference point for rotation and testing the other two specimens. Rotate the other specimens 60° and 120°, respectively, from the original orientation. Test each specimen in only one position.

7.5 Flattening—Flatten the three test specimens from **7.4** between parallel plates until the pipe inside diameter is reduced by 40 %. The rate of loading shall be 0.5 in./min (12.5 mm/min), and may be increased after 5% deflection is obtained for pipe stiffness so the remainder of the test is completed within 2 to 5 minutes.

7.6 Impact Resistance—Test pipe specimens in accordance with Test Method **D2444** except six specimens shall be tested, or six impacts shall be made on one specimen. In the latter case, successive impacts shall be separated by $120 \pm 10^\circ$ for impacts made on one circle, or at least 12 in. (300 mm) longitudinally for impacts made on one element. Impact points shall be at least 6 in. (150 mm) from the end of the specimen. Impact strength shall not be less than 140 ft·lbf (190 J). Tests shall be conducted using either a 20 lb (9 kg) Tup B or 30 lb (15 kg) Tup B and a flat-plate specimen Holder B. Condition the specimens for 24 h at a temperature of $73.4F \pm 3.6F$ ($23 \pm 2^\circ C$), and conduct all tests within 60 s of removal from this atmosphere. The center of the falling tup shall strike on a corrugation crown for all impacts. In case of disagreement, impact six specimens once each at random orientations.

7.6.1 All the impact specimens shall be cut valley to valley. In sizes 12 to 18 in. (300 to 450 mm), the minimum length of the test specimens shall be the nominal diameter. In sizes 21 to 30 in. (525 to 750 mm), the minimum length shall be 18 in. (457 mm).

7.7 Slow-Crack Growth Resistance – PE Pipe—Pipe test specimens shall be taken from the extruded pipe in the pipe liner area or shall be molded into test specimens from the pipe. Test 5 pipe specimens using the same protocol for molded bars in Test Method **F2136** test, except for the following modifications:

7.7.1 The applied stress for the NCLS test shall be 600 psi (4138 kPa).

7.7.2 The test specimen is taken from the extruded pipe liner if the size allows. If not, then the extruded pipe is chopped and molded into a specimen.

7.8 Joint Proof-of-Design Pressure Test:

7.8.1 Prepare and test joints in accordance with **7.8.3**. Pipe shall have a watertight bell/spigot joint that complies with the laboratory tests defined and described in Test Method **D3212**.

7.8.2 Failure of any of the specimens shall constitute failure of the test.

7.8.3 Specimen Preparation:

7.8.3.1 Condition assembled test specimens a minimum of 2 h at the test temperature to be used prior to initiating the test procedure.

7.8.3.2 Test joints shall be assembled on the appropriate size pipe in accordance with the manufacturer's joining procedure. Lubricate and assemble the joint according to the manufacturer's instructions with the associated Specification **F477** gasket in place.

7.8.3.3 Testing shall be conducted at standard laboratory temperature of $73.4 + 3.6^\circ F$ ($23 + 2^\circ C$) unless otherwise specified.

7.8.3.4 Maintain assembled joint configuration for a minimum of 1000 h under ambient temperature conditions $75 + 5^\circ F$ ($24 + 3^\circ C$). Upon completion of this hold time, conduct a full Specification **D3212** test on the assembled joint. For entire 1000 h hold time, joint shall remain undisturbed and fully assembled. Joint may not be disassembled and reassembled at any point prior to completion of full Specification **D3212** testing.

7.8.3.5 Aside from stiffeners that are part of the joint design being tested, no stiffeners may be used in the specimen.

8. Inspection

8.1 Inspection of the product shall be as agreed upon between the owner and the manufacturer as part of the purchase contract. Unless otherwise specified in the contract or purchase agreement, the manufacturer is responsible for the performance of all inspection and test requirements specified herein.

8.2 Notification—If inspection is specified by the owner, the manufacturer shall notify the owner in advance of the date, time, and place of testing of the pipe or fittings, or both, so that the purchaser may be represented at the test.

8.3 Access—The inspector shall have free access to those parts of the manufacturer's plant that are involved in work performed under this specification. The manufacturer shall afford the inspector all reasonable facilities for determining whether the pipe or fittings, or both, meet the requirements of this specification.

9. Rejection and Retesting

9.1 If the results of any test(s) do not meet the requirements of this specification, the test(s) shall be conducted again in accordance with an agreement between the owner and the manufacturer. There shall be no agreement to lower the minimum requirement of the specification by such means as omitting tests that are a part of the specification, substituting or modifying a test method, or by changing the specification limits. In retesting, the product requirements of this specification shall be met, and the test methods designated in this specification shall be followed. If, upon retest, failure occurs, the quantity of product represented by the test(s) does not meet the requirements of this specification.

10. Certification

10.1 When specified in the purchase order or contract, a manufacturer's or independent laboratory's certification shall be furnished to the owner that the products shipped, as identified by the lot description of **11.1** and **11.2**, were manufactured, sampled, tested, and inspected at the time of manufacture in accordance with this specification and have

been found to meet the requirements. When specified in the purchase order or contract, a report of the test results shall be furnished. Where requested, certified actual inside diameter shall be provided.

11. Markings

11.1 *Pipe*—Each length of pipe in compliance with this specification shall be clearly marked with the following information: this designation ASTM F2762; the nominal size; the legend PE; the manufacturer's name, trade name or trademark; plant location; and date of manufacture. The marking shall be applied at the time of manufacture to the pipe in such a manner that it remains legible after installation and inspection. It shall be placed, at least, at each end of each length of pipe or spaced at intervals of not more than 10 ft (3.0 m).

11.2 *Fittings*—Each fitting in compliance with this specification shall be clearly marked with the following information:

this designation ASTM F2762; the nominal size; the legend PE; the manufacturer's name, trade name or trademark; plant location; and date of manufacture.

12. Packaging

12.1 All pipe and fittings shall, unless otherwise specified, be packaged for standard commercial shipment.

13. Quality Assurance

13.1 When the product is marked with this designation (ASTM F2762), the manufacturer affirms that the product was manufactured, inspected, sampled, and tested in accordance with this specification and has been found to meet the requirements of this specification.

14. Keywords

14.1 corrugated HDPE pipe; fittings; interior liner; PE; pipe; polyethylene; profile wall; sanitary sewer

SUPPLEMENTARY REQUIREMENTS

GOVERNMENT/MILITARY PROCUREMENT

These requirements apply only to federal/military procurement, not domestic sales or transfers.

S1. Responsibility for Inspection

S1.1 Unless otherwise specified in the contract or purchase order, the manufacturer is responsible for the performance of all inspection and test requirements specified herein. The manufacturer may use his own or any other suitable facilities for the performance of the inspection and test requirements specified herein, unless the owner disapproves. The owner shall have the right to perform any of the inspections and tests set forth in this specification, where such inspections are deemed necessary to ensure that material conforms to prescribed requirements.

NOTE S1—In U.S. federal contracts, the contractor is responsible for inspection.

S2. Packaging and Marking for U.S. Government Procurement

S2.1 *Packaging*—Unless otherwise specified in the contract, the materials shall be packaged in accordance with the manufacturer's standard practice in a manner ensuring arrival at destination in satisfactory condition and which will be acceptable to the carrier at lowest rates. Containers and packing shall comply with Uniform Freight Classification rules or National Motor Freight Classification rules.

S2.2 *Marking*—Marking for shipment shall be in accordance with Fed. Std. No. 123 for civil agencies and MIL-STD-129 for military agencies.

NOTE S2—The inclusion of U.S. government procurement requirements shall not be construed as an indication that the U.S. government uses or endorses the products described in this document.

APPENDIXES

(Nonmandatory Information)

X1. AUTHORITIES

X1.1 Since this product has a wide variety of uses in sanitary sewer systems, approval for its use rests with various agencies. The installer should contact the relevant authority to obtain local installation guidelines.

X1.2 The pipe manufacturer(s) should be able to provide proof of product acceptance by specific agencies, when appropriate.

X2. RECOMMENDED LIMIT FOR INSTALLED DEFLECTION

X2.1 Design engineers, public agencies, and others who have the responsibility to establish specifications for maximum allowable limits for deflection of installed polyethylene sewer pipe have requested direction relative to such a limit.

ASTM International takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.

This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.

This standard is copyrighted by ASTM International, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website (www.astm.org). Permission rights to photocopy the standard may also be secured from the Copyright Clearance Center, 222 Rosewood Drive, Danvers, MA 01923, Tel: (978) 646-2600; <http://www.copyright.com/>