



Standard Specification for Smooth-Wall Poly(Vinyl Chloride) (PVC) Conduit and Fittings for Underground Installation¹

This standard is issued under the fixed designation F512; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

1. Scope

1.1 This specification covers the requirements for single wall and coextruded cellular core smooth-wall poly(vinyl chloride) conduit and fittings for underground communication and electrical power wire and cables. Plastics which does not meet the material requirements specified in Section 5 is excluded from single layer and all coextruded layers.

1.2 The values given in parentheses are for information only.

1.3 The following safety hazards caveat pertains only to the test method portion, Section 8, of this specification: *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

1.4 *This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.*

2. Referenced Documents

2.1 ASTM Standards:²

- D618 Practice for Conditioning Plastics for Testing
- D1600 Terminology for Abbreviated Terms Relating to Plastics
- D1784 Specification for Rigid Poly(Vinyl Chloride) (PVC) Compounds and Chlorinated Poly(Vinyl Chloride) (CPVC) Compounds
- D2122 Test Method for Determining Dimensions of Ther-

moplastic Pipe and Fittings

- D2152 Test Method for Adequacy of Fusion of Extruded Poly(Vinyl Chloride) (PVC) Pipe and Molded Fittings by Acetone Immersion
- D2412 Test Method for Determination of External Loading Characteristics of Plastic Pipe by Parallel-Plate Loading
- D2444 Test Method for Determination of the Impact Resistance of Thermoplastic Pipe and Fittings by Means of a Tup (Falling Weight)
- D2466 Specification for Poly(Vinyl Chloride) (PVC) Plastic Pipe Fittings, Schedule 40
- D2564 Specification for Solvent Cements for Poly(Vinyl Chloride) (PVC) Plastic Piping Systems
- D2855 Practice for the Two-Step (Primer and Solvent Cement) Method of Joining Poly (Vinyl Chloride) (PVC) or Chlorinated Poly (Vinyl Chloride) (CPVC) Pipe and Piping Components with Tapered Sockets
- F412 Terminology Relating to Plastic Piping Systems

3. Terminology

3.1 Definitions are in accordance with Terminology F412 and abbreviations are in accordance with Terminology D1600, unless otherwise specified. The abbreviation for poly(vinyl chloride) is PVC.

3.2 Definitions of Terms Specific to This Standard:

3.2.1 *cellular plastic*—a plastic containing numerous cells, intentionally introduced, interconnecting or not, distributed throughout the mass.

3.2.2 *coextruded pipe*—pipe consisting of two or more concentric layers of material bonded together in processing by any combination of temperature, pressure, grafting, cross-linking or adhesion.

3.2.3 *coextrusion*—a process whereby two or more heated or unheated plastic material streams, forced through one or more shaping orifice(s), become one continuously formed piece.

3.2.4 *external recycled material*—industrial rework generated by a different company manufacturing to this specification. Composition is known by the industrial source of the material.

3.2.5 *post-consumer recycled material*—finished goods that have been purchased by the public, then returned to industry

¹ This specification is under the jurisdiction of ASTM Committee F17 on Plastic Piping Systems and is the direct responsibility of Subcommittee F17.25 on Vinyl Based Pipe.

Current edition approved April 1, 2017. Published April 2017. Originally approved in 1977. Last previous edition approved in 2012 as F512–12. DOI: 10.1520/F0512-12R17.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

and reprocessed into raw materials. Identity of finished goods is known by the reprocessing company.

3.2.6 *certificate of composition*—a certificate describing the certain properties of an external recycled material of a post consumer recycled material.

3.2.7 *composition disclosure*—a document describing the formulation of an external recycled material.

4. Classification

4.1 This specification covers five types of underground conduit. There are two having lesser pipe stiffness values, designed primarily for concrete encased burial (EB), and three with greater pipe stiffness values, designed primarily for direct burial (DB). The complete designations follow:

- Type EB-20 — Designed to be encased in concrete.
- Type EB-35 — Designed to be encased in concrete.
- Type DB-60 — Designed for direct burial without encasement in concrete.
- Type DB-100— Designed for direct burial without encasement in concrete.
- Type DB-120— Designed for direct burial without encasement in concrete.

4.2 This specification covers conduit with integral bells, or with either separate or attached couplings.

4.3 This specification covers molded and fabricated fittings intended for use with all types of conduit.

5. Materials

5.1 *Basic Materials*—The conduit shall be made of virgin homopolymer PVC compound having a cell classification of 12254, 12164³ (with a minimum tensile strength of 4000 psi (28 MPa)), or 12264 (with a minimum tensile modulus of 500 000 psi) as defined in Specification **D1784**. Molded fittings shall be made from PVC compound having a cell classification of 12234 or 13343 as defined in Specification **D1784**. Homopolymer PVC compounds must equal or exceed the requirements of the listed cell classification numbers.

5.2 *Rework Materials*—Rework material from the manufacturer’s own conduit or fittings production may be used by the same manufacturer, provided that the conduit or fittings produced meet all of the requirements of this specification. Rework material from the manufacture’s coextruded cellular core conduit shall be used in the core if it contains any residual

³ Supporting data have been filed at ASTM International Headquarters and may be obtained by requesting Research Report RR:F17-1002.

blowing agent. The pipe produced shall meet all of the requirements of this specification.

5.3 *Recycled PVC Materials*—Recycled PVC materials conforming to the cell classification of this specification may be used provided they are clean and free from foreign materials and provided that the conduit or fittings produced meet all requirements of this specification.

5.4 *Solvent Cement*—The solvent cement shall meet the requirements of Specification **D2564**.

6. Requirements

6.1 *Workmanship*—The conduit and fittings shall be homogeneous throughout, and free from visible cracks, holes, foreign inclusions, or other injurious defects. The conduit and fittings shall be as uniform as is commercially practical in color, opacity, density, and other physical properties.

6.2 Dimensions:

6.2.1 Dimensions shall be determined in accordance with Test Method **D2122**.

6.2.2 The dimensions and tolerances of the conduit shall be as specified in **Table 1**.

6.2.3 *Lengths*—Conduit shall be supplied in lengths of 20 or 25 ft, or as otherwise agreed upon between the purchaser and the seller. A length shall be considered to be the overall length of the conduit, including integral bell, or coupling if attached, unless otherwise specified. Tolerance on length shall be ± 1 in. (± 25 mm).

6.2.4 Integral Bell Dimensions:

6.2.4.1 Two systems of fit for integral bells are in common use. Unless otherwise specified, the manufacturer may employ either of them.

6.2.4.2 *Interference Fit System*—The dimensions and tolerances listed in Columns *A* and *B* of Table 1 in Specification **D2466** provide a satisfactory interference fit system between pipe and socket.

6.2.4.3 *Clearance Fit System*—The dimensions and tolerances listed in **Table 2** of this specification provide a satisfactory clearance fit system.

6.2.5 The wall thickness of integral bells and sweeps shall be considered satisfactory if formed from conduit which meets the minimum requirements of this specification.

6.2.6 Socket depths for integral bells shall conform to the requirements listed in **Table 2**.

TABLE 1 Conduit Dimensions and Tolerances, in.

Nominal Size	Average Outside Diameter	Tolerance on		Minimum Wall Thickness ^A									
		Average	Out-of-Round ^B	Minimum Modulus 400 000 psi					Minimum Modulus 500 000 psi				
				EB-20	EB-35	DB-60	DB-100	DB-120	EB-20	EB-35	DB-60	DB-100	DB-120
1	1.315	± 0.005	0.060	—	—	—	—	0.060	—	—	—	—	0.060
1½	1.900	± 0.006	0.060	—	—	0.060	—	0.065	—	—	—	—	0.060
2	2.375	± 0.006	0.060	—	0.060	0.065	—	0.083	0.060	—	0.060	—	0.077
3	3.500	± 0.008	0.060	0.067	0.082	0.100	0.121	0.127	0.061	0.076	0.092	0.112	0.118
3½	4.000	± 0.008	0.100	0.078	0.095	0.115	0.138	0.147	0.072	0.088	0.107	0.128	0.136
4	4.500	± 0.009	0.100	0.089	0.109	0.131	0.155	0.166	0.082	0.100	0.121	0.145	0.154
5	5.563	± 0.010	0.100	0.112	0.136	0.164	0.192	0.205	0.103	0.126	0.152	0.179	0.191
6	6.625	± 0.011	0.100	0.135	0.164	0.196	0.229	0.244	0.125	0.152	0.182	0.213	0.227

^A Tolerance on wall thickness is +12, -0 % or +0.030, -0.000 in. whichever is greater.

^B “Out-of-round” is defined as maximum diameter minus minimum diameter.

TABLE 2 Belled End Dimensions (Clearance Fit System), in.

Nominal Size	Average Entrance Diameter	Average Bottom Diameter	Tolerance on Diameters	Out-of-Round Tolerance ^A	Socket Depth	
					min	max
1	1.331	1.320	±0.005	0.060	1.000	1.750
1½	1.921	1.906	±0.006	0.060	1.375	2.125
2	2.400	2.381	±0.006	0.060	1.750	2.500
3	3.538	3.508	±0.008	0.060	2.875	3.625
3½	4.041	4.008	±0.008	0.100	3.125	3.875
4	4.544	4.509	±0.009	0.100	3.375	4.125
5	5.614	5.573	±0.010	0.100	4.000	4.750
6	6.687	6.636	±0.011	0.100	5.000	5.750

^A "Out-of-round" is defined as maximum diameter minus minimum diameter.

6.2.7 Integral belled ends shall be centered to provide a visible shoulder around the entire circumference.

6.2.8 The inside diameters of spigot ends shall be chamfered as shown in Fig. 1.

6.2.9 *Fittings and Sweep Dimensions:*

6.2.9.1 The dimensions and types of conduit fittings shall be as specified in Tables 3-17.

6.2.9.2 Conduit fittings shall be capable of passing a ball ¼ in. (6 mm) less in diameter than the nominal size of the conduit.

6.2.9.3 The dimensions of sweeps and bends shall be as specified in Table 17. Sweeps and bends shall be made from DB-60 or DB-120 conduit. Sweeps made from DB-60 conduit are intended for use with EB-20 and DB-60 conduit. Sweeps made from DB-120 conduit are intended for use with EB-35 and DB-120 conduit.

6.3 *Minimum Pipe Stiffness:*

6.3.1 The minimum pipe stiffness ($F/\Delta y$) values for conduit shall be in conformance with Table 18, when tested in accordance with 8.3. Three specimens shall be tested, all shall meet the requirements.

6.3.2 *Referee Test*—The minimum pipe stiffness ($F/\Delta y$) values shall be in accordance with Table 18 when tested in accordance with Test Method D2412 at 5 % deflection.

6.4 *Impact Strength*—The minimum drop weight impact strength values for conduit shall be as listed in Table 19, when tested in accordance with 8.1.

6.4.1 The impact test is a quality control test, to be performed at the time of manufacture.

6.5 *Joint Tightness (Referee Test)*—The joints shall not leak when tested in accordance with 8.2.

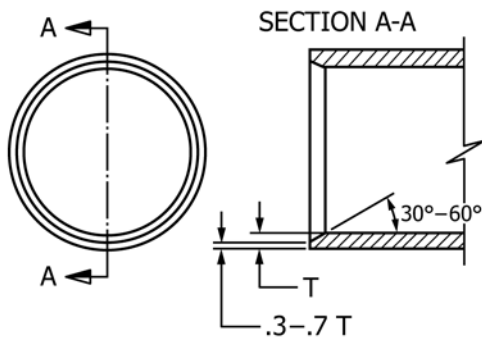



FIG. 1 Chamfer Detail

TABLE 3 Types of Conduit Fittings

1. Couplings
2. Domed caps
3. Flat caps
4. Fittings plugs
5. Tapered plugs
6. Bends (5, 22½, 30, 45, and 90°)
7. Sweeps (5, 22½, 30, 45, and 90°)
8. Angle Couplings (5°)
9. Fiber conduit adapters
10. Cement-asbestos conduit adapters
11. Water-tight expansion couplings
12. Spigot-ended reducers
13. Socket end-bells

TABLE 4 Fittings Socket Dimensions, in.

NOTE 1—Thermoformed fittings may employ the dimensions listed in Table 4, or the dimensions listed in Table 2 for integral bell ends.



Nominal Size	Dimension A Average Entrance Diameter	Dimension B Average Bottom Diameter	Tolerance on Diameters	Out-of-Round Tolerance	Dimension C Minimum Socket Depth
2	2.393	2.369	±0.006	0.012	1.125
3	3.515	3.492	±0.008	0.015	1.594
3½	4.015	3.992	±0.008	0.015	1.687
4	4.515	4.491	±0.009	0.015	1.750
5	5.593	5.553	±0.010	0.030	1.937
6	6.658	6.614	±0.011	0.030	2.125

6.6 *Extrusion Quality*—The conduit shall not flake or disintegrate when tested in accordance with Test Method D2152.


6.7 *Bond*—For pipe produced by the coextrusion process, that is, pipe containing two or more concentric layers, the bond between the layers shall be strong and uniform. It shall not be possible to separate any two layers with a probe or point of a knife blade so that the layers separate cleanly so the probe or knife blade moves freely between the layers. Nor shall separation of bond occur between layers during testing performed under the requirements of this specification.

7. Conditioning

7.1 *Referee Testing*—When conditioning is required for referee tests, condition the specimens in accordance with Procedure A in Methods D618 at 23 ± 2°C and 50 ± 5 % relative humidity for not less than 40 h prior to test. Conduct tests under the same conditions of temperature and humidity, unless otherwise specified.

7.2 *Quality Control:*

TABLE 5 Coupling Dimensions, in.




Nominal Size	M, max	SH, max	N, min
1	1 ¹³ / ₆₄	0.070	1 ¹ / ₁₆
1½	2 ⁹ / ₃₂	0.070	1 ¹ / ₁₆
2	2 ⁴⁷ / ₆₄	0.075	3 ³ / ₃₂
3	3 ³¹ / ₃₂	0.076	7 ¹ / ₆₄
3½	4 ¹ / ₂	0.087	7 ¹ / ₆₄
4	5 ¹ / ₃₂	0.097	7 ¹ / ₆₄
5	6 ¹ / ₄	0.118	9 ¹ / ₆₄
6	7 ¹ / ₂	0.140	9 ¹ / ₆₄

TABLE 7 Domed Cap Dimensions, in.




Nominal Size	W, max	M, max
2	2 ³ / ₃₂	2 ¹³ / ₁₆
3	3	4 ³ / ₃₂
3½	3 ¹ / ₈	4 ⁵ / ₈
4	3 ³¹ / ₆₄	5 ¹³ / ₆₄
5	4 ²⁷ / ₆₄	6 ¹ / ₄
6	5 ⁷ / ₃₂	7 ²⁵ / ₆₄

TABLE 6 5° Angle Couplings, in.

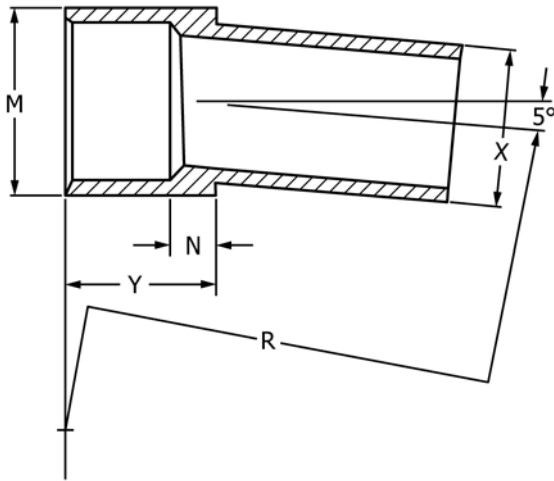


Nominal Size	M, max	N, min	X and Tolerance	Y, min	Bend R
2	2 ⁹ / ₁₆	1.50	2.375 ± 0.006	2.62	30
3	3 ²³ / ₃₂	1.55	3.500 ± 0.008	3.14	36
4	4 ⁵¹ / ₆₄	1.39	4.500 ± 0.009	3.14	36
5	5 ⁵⁹ / ₆₄	2.25	5.563 ± 0.010	4.19	48
6	7 ¹ / ₆₄	3.12	6.625 ± 0.011	5.24	60

TABLE 8 Flat Cap Dimensions, in.



Nominal Size	F, min	M, max
2	1 ⁹ / ₃₂	2 ³⁵ / ₆₄
3	1 ¹ / ₁₆	3 ⁴⁵ / ₆₄
3½	5 ¹ / ₆₄	4 ⁷ / ₃₂
4	3 ³ / ₃₂	4 ³ / ₄
5	3 ³ / ₃₂	5 ⁵³ / ₆₄
6	1 ¹ / ₈	6 ⁶¹ / ₆₄

TABLE 9 Fitting Plug Dimensions, in.



Nominal Size	M, max	F, min	X and Tolerance
2	2 ¹⁹ / ₃₂	2 ³ / ₆₄	2.375 ± 0.006
3	3 ²¹ / ₃₂	2 ³ / ₆₄	3.000 ± 0.008
3½	4 ⁹ / ₃₂	2 ³ / ₆₄	3.500 ± 0.008
4	4 ²⁵ / ₃₂	2 ³ / ₆₄	4.500 ± 0.009
5	5 ²⁷ / ₃₂	1 ³ / ₃₂	5.563 ± 0.010
6	Not Manufactured		

7.2.1 For quality control tests, condition specimens for a minimum of 3 h in air, or 1 h in liquid at 23 ± 2°C (70 to 77°F). Test the specimens at 23 ± 2°C without regard to relative humidity.


7.2.2 For the impact test, condition specimens for at least 30 min at 0 to 1.6°C (32 to 35°F).

8. Test Methods

8.1 Impact Resistance—Test and evaluate five specimens, each 6 ± 1/16 in. (150 ± 2 mm) long, in accordance with Test Method D2444, using a 20-lb Tup B, and the flat plate (Holder B). When testing is performed at temperatures above 0°C, no more than 15 s shall elapse from the time of removal of the specimen from the conditioning medium until completion of

that test. Specimens may be positioned with a random surface uppermost, but must be located so that the contact point is centered. All five specimens shall pass. If one specimen fails, test another five specimens: nine out of ten specimens passing shall be acceptable.


TABLE 10 Tapered Plug Dimensions, in.

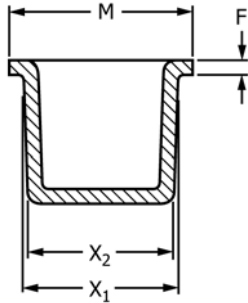

Nominal Size	M, max	X ₁ , min	X ₂ , max	F, min
2	3 ¹³ / ₆₄	2.500	1 ⁷ / ₈	7 ⁷ / ₆₄
3	3 ⁴⁵ / ₆₄	3.550	2 ⁷ / ₈	1 ¹ / ₈
3½	4 ⁷ / ₁₆	4.050	3 ³ / ₈	1 ¹ / ₆₄
4	5 ⁵ / ₁₆	4.550	3 ²⁷ / ₃₂	7 ⁷ / ₆₄
5	6 ⁹ / ₃₂	5.750	4 ⁷ / ₈	7 ⁷ / ₆₄
6	6 ⁷ / ₈	6.703	5 ⁷ / ₈	5 ⁶ / ₆₄

TABLE 11 Spigot Ended Reducer Dimensions, in.


NOTE 1—Both ends must be chamfered 0.03 in. (min) by 45°.

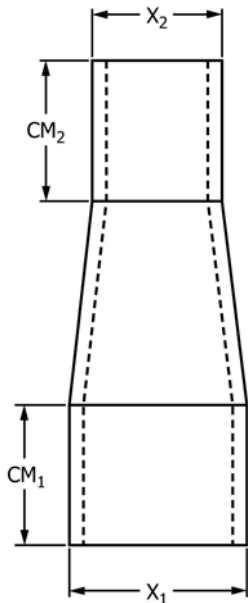

Nominal Size	CM ₁ , min	N, min	CM ₂ , min	X ₁ and Tolerance	X ₂ and Tolerance
3 by 2	3.250	2	2.125	3.500 ± 0.008	2.375 ± 0.006
3½ by 2	3.375	2	2.125	4.000 ± 0.008	2.375 ± 0.006
3½ by 3	3.375	2	3.250	4.000 ± 0.008	3.500 ± 0.008
4 by 3	3.375	2	3.250	4.500 ± 0.009	3.500 ± 0.008
4 by 3½	3.375	2	3.375	4.500 ± 0.009	4.000 ± 0.008
5 by 4	4.375	2	3.375	5.563 ± 0.010	4.500 ± 0.009
6 by 5	5.375	2	4.375	6.625 ± 0.011	5.563 ± 0.010


8.2 *Joint Tightness (Referee Test)*—Cement a section of conduit to a bell, using the manufacturer’s recommendations or, in their absence, the methods described in Practice D2855. Unless otherwise specified, allow the assembly to stand for at

TABLE 12 Fiber Conduit Adapter Dimensions, in.

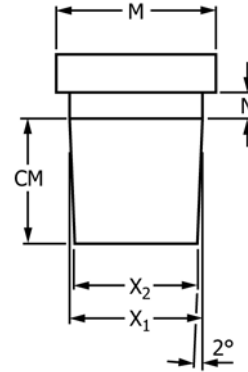

Nominal Size	M, max	N, min	Nominal CM	Nominal X ₁	Nominal X ₂
2	2 ³ / ₄	5 ⁵ / ₆₄	1 ⁷ / ₁₆	2.470	2 ²⁵ / ₆₄
3	4	9 ⁹ / ₆₄	1 ¹¹ / ₁₆	3.448	3 ¹¹ / ₃₂
4	5 ⁵ / ₄	1 ¹ / ₆₄	1 ¹⁵ / ₁₆	4.493	4 ³ / ₄

TABLE 13 Cement-Asbestos Adapter Dimensions, in.

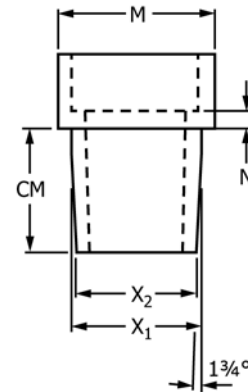

Nominal Size	M, max	N, min	Nominal CM	Nominal X ₁	Nominal X ₂
2	2 ³ / ₄	5 ⁵ / ₆₄	1 ³ / ₄	2.580	2
3	4	9 ⁹ / ₆₄	1 ³ / ₄	3.620	3
4	5 ¹ / ₃₂	1 ¹ / ₆₄	2	4.620	4

least 6 h. Then subject the assembly to an internal pressure of at least 25 psi (170 kPa), using water as the test medium. Maintain the pressure for at least 1 h. There shall be no leakage.

8.3 *Pipe Stiffness*—Determine the pipe stiffness ($F/\Delta y$) at 5 % deflection of inside diameter, as described in Test Method D2412. Test three specimens each 6 ± 1/16 in. (150 ± 2 mm) long. Place each specimen so that the minimum wall thickness is uppermost (adjacent to the top bearing plate). Measure the vertical inside diameter before compressing the specimen. Compress the specimen at the rate of 1/2 in. (13 mm)/min, and record the load at the point where the vertical inside diameter is equal to 95 % of the original inside diameter of the specimen.

TABLE 14 Water-Tight Expansion Coupling Dimensions, in.


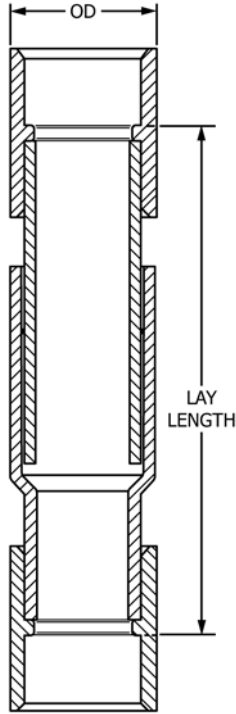



TABLE 16 Socket End Bell Dimensions, in.

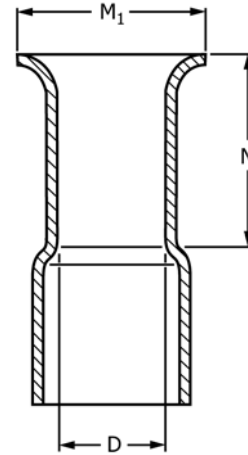

Nominal Size	M ₁ , max	N, min	D, min
2	4 ⁹ / ₃₂	2 ²⁵ / ₃₂	2.173
3	5 ⁹ / ₃₂	2 ⁹ / ₁₆	3.208
3½	4¾	3	3.668
4	5½	3	4.129
5	6½	4¼	5.195
6	7½	3¼	6.192

TABLE 17 Minimum Dimensions for Bends and Sweeps

NOTE 1—Sweeps longer than 10 ft may be supplied in two sections to facilitate shipping and storage.

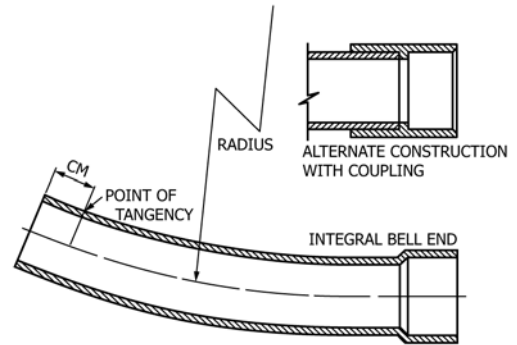

Radii, Degrees of Curvature, and Straight Tangent Lengths at Ends of Bends and Sweeps


Nominal Size	Radius, in.			Radius, ft	CM, min, in.
	5° Bend	22½ and 30° Bend	45 and 90° Bend	22½, 30, 45, and 90° Sweep	
2	48	18,24,36,48,60	18,24,36,48,60	12½	2¼
3	48	18,24,36,48,60	18,24,36,48,60	12½	3⅞
3½	48	18,24,36,48,60	18,24,36,48,60	12½	3⅞
4	48	18,24,36,48,60	18,24,36,48,60	12½	3⅞
5	48	48,60	36,48,60	12½	4½
6	48	48,60	48,60	12½	5½

9. Inspection

9.1 Inspection of the material shall be made as agreed upon between the purchaser and the seller as part of the purchase contract.

Nominal Size	Maximum Outside Diameter	Maximum Lay Length (open)	Minimum Lay Length (closed)
2	2 ⁵³ / ₆₄	19 ⁷ / ₈	11 ³ / ₁₆
3	4 ³ / ₃₂	24½	16¼
3½	4 ³⁹ / ₆₄	24 ⁵ / ₈	16½
4	5 ¹⁷ / ₃₂	24 ⁷ / ₈	16 ⁷ / ₈
5	6 ¹¹ / ₃₂	24½	18½
6	7 ¹⁵ / ₁₆	26½	20½

TABLE 15 Socket End Bell Dimensions, in.

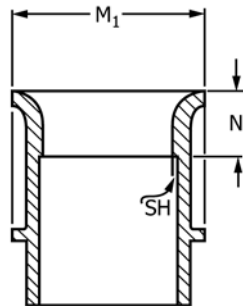

Nominal Size	M ₁ , max	SH, max	N, min
1	2¼	0.070	¾
1½	2½	0.070	¾
2	3 ⁷ / ₆₄	0.075	¾
3	4⅛	0.076	¾
3½	4 ⁵ / ₈	0.087	¾
4	5 ¹¹ / ₃₂	0.097	¾
5	6 ¹³ / ₃₂	0.118	¾
6	7 ¹³ / ₃₂	0.140	¾

**TABLE 18 Pipe Stiffness, lbf/(in.·in.)**

Conduit Series	Min Pipe Stiffness ($F/\Delta y$), All Sizes
EB-20	20
EB-35	35
DB-60	60
DB-100	100
DB-120	120

TABLE 19 Minimum Impact Resistance at 0°C (32°F), ft·lbf

Nominal Size	Conduit Series				
	EB-20	EB-35	DB-60	DB-100	DB-120
1	—	—	—	—	10
1½	—	—	10	—	15
2	20	20	20	25	25
3	20	30	40	45	50
3½	20	35	50	60	65
4	25	40	60	70	80
5	30	55	85	100	110
6	40	75	120	135	150

10. Retest and Rejection

10.1 If the results of any test(s) do not meet the requirements of this specification, the test(s) may be conducted again in accordance with an agreement between the purchaser and the seller. There shall be no agreement to lower the minimum requirement of the specification by such means as omitting tests that are a part of the specification, substituting or modifying a test method, or by changing the specification limits. In retesting, the product requirements of this specification shall be met, and the test methods designated in the specification shall be followed. If, upon retest, failure occurs, the quantity of product represented by the test(s) does not meet the requirements of this specification.

11. Certification

11.1 A manufacturer shall provide certification that the product was manufactured in accordance with the requirements of this specification signed by an authorized agent, provided that the user, purchaser, or specifying agency, or combination thereof, so request in the purchase order or contract. Furthermore, when agreed upon between the manufacturer and the user, purchaser, or specifying agency, or combination thereof, and preferably prior to the date of manufacture, the manufacturer shall provide test data and the date on which tests were conducted for a specific lot or shipment of product made under this specification.

12. Product Marking

12.1 Conduit shall be clearly marked with the manufacturer's name or trademark, PVC cell classification (that is: PVC

12254-A, PVC 12254-B, PVC 12164-B, PVC 12264-A, or PVC 12264-B), size, type of conduit (for example, DB-60), the minimum wall thickness, code or control number, and the designation "ASTM F512" for pipe produced by single extrusion or "ASTM F512 COEX" for pipe produced by coextrusion at intervals of 5 ft (1.5 m) or less. Any additional marking deemed necessary by the manufacturer is permitted.

12.2 Sweeps and bends shall be made from conduit that is marked in accordance with 11.1. In addition, the bend radius and the degrees shall be marked (for example, 18" R —30° for 18-in. radius 30° bend).

12.3 Fittings shall be marked with the manufacturer's name or trademark, the conduit size, the phrase "PVC," and this designation "ASTM F512." Where fitting size does not permit legible marking, the packaging shall carry the designated information.

12.4 The minimum letter size permitted on conduit, sweeps, and bends is ¼ in. (6 mm).

12.5 Upon agreement between the manufacturer and purchaser, or at the manufacturer's option, for sizes 2 through 6 in., the spigot end of each conduit length shall have a circumferential ring mark, or depth of entry mark, placed at a distance from the conduit end equal to ¼ in. (6 mm) more than the depth of the socket of the integral bell or attached coupling supplied on the conduit.

13. Packaging


13.1 Conduit sweeps and bends shall be packaged to protect them during shipment, handling, and subsequent storage.

13.2 Conduit shall be packaged in units not to exceed 5 ft in width, no less than 1 ft nor greater than 4 ft in height. Packaged units shall be capable of supporting no less than 10 ft in height of packaged units without damaging the packaged conduit. Packaged conduit units shall have provisions for fork lifting equipment.

13.3 Fittings and cement shall be packaged in suitable containers. Containers with volume greater than 30 ft³ shall have provisions for fork lifting equipment.

14. Quality Assurance

14.1 When the product is marked with this designation, F512, the manufacturer affirms that the product was manufactured, inspected, sampled, and tested in accordance with this specification and has been found to meet the requirements of this specification.

 **F512 – 12 (2017)**

ASTM International takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.

This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.

This standard is copyrighted by ASTM International, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website (www.astm.org). Permission rights to photocopy the standard may also be secured from the Copyright Clearance Center, 222 Rosewood Drive, Danvers, MA 01923, Tel: (978) 646-2600; <http://www.copyright.com/>