

Acoustics — Measurement of room acoustic parameters —

Part 2: Reverberation time in ordinary rooms

ICS 91.120.20

National foreword

This British Standard is the UK implementation of EN ISO 3382-2:2008. It is identical with ISO 3382-2:2008, incorporating corrigendum April 2009. It partially supersedes BS EN ISO 3382:2000, which will be withdrawn on publication of BS EN ISO 3382-1 and BS EN ISO 3382-3.

The UK participation in its preparation was entrusted by Technical Committee EH/1, Acoustics, to Subcommittee EH/1/6, Building acoustics.

A list of organizations represented on this subcommittee can be obtained on request to its secretary.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

Compliance with a British Standard cannot confer immunity from legal obligations.

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 31 October 2008

© BSI 2009

ISBN 978 0 580 67763 2

Amendments/corrigenda issued since publication

Date	Comments
31 August 2009	Implementation of ISO corrigendum April 2009. Figure A.2 changed

EUROPEAN STANDARD

EN ISO 3382-2

NORME EUROPÉENNE

EUROPÄISCHE NORM

June 2008

ICS 91.120.20

Supersedes EN ISO 3382:2000

English Version

Acoustics - Measurement of room acoustic parameters - Part 2: Reverberation time in ordinary rooms (ISO 3382-2:2008)

Acoustique - Mesurage des paramètres acoustiques des
salles - Partie 2: Durée de réverbération des salles
ordinaires (ISO 3382-2:2008)

Akustik - Messung von Parametern der Raumakustik - Teil
2: Nachhallzeit in gewöhnlichen Räumen (ISO 3382-
2:2008)

This European Standard was approved by CEN on 22 May 2008.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

Management Centre: rue de Stassart, 36 B-1050 Brussels

Foreword

This document (EN ISO 3382-2:2008) has been prepared by Technical Committee ISO/TC 43 "Acoustics" in collaboration with Technical Committee CEN/TC 126 "Acoustic properties of building elements and of buildings" the secretariat of which is held by AFNOR.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by December 2008, and conflicting national standards shall be withdrawn at the latest by December 2008.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN [and/or CENELEC] shall not be held responsible for identifying any or all such patent rights.

This document supersedes EN ISO 3382:2000.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and the United Kingdom.

Endorsement notice

The text of ISO 3382-2:2008 has been approved by CEN as a EN ISO 3382-2:2008 without any modification.

Contents

Page

Foreword.....	iv
Introduction	v
1 Scope	1
2 Normative references	1
3 Terms and definitions.....	1
4 Measurement conditions	2
4.1 General.....	2
4.2 Equipment	3
4.3 Measurement positions.....	4
5 Measurement procedures	5
5.1 General.....	5
5.2 Interrupted noise method	5
5.3 Integrated impulse response method.....	6
6 Evaluation of decay curves	7
7 Measurement uncertainty	7
7.1 Interrupted noise method	7
7.2 Integrated impulse response method.....	8
7.3 Lower limits for reliable results caused by filter and detector	8
8 Spatial averaging	8
9 Statement of results	9
9.1 Tables and curves.....	9
9.2 Test report	9
Annex A (informative) Measurement uncertainty	10
Annex B (informative) Evaluation of non-linear decay curves	14
Annex C (informative) Formulas for the least-squares fit method.....	16
Bibliography	17

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 2.

The main task of technical committees is to prepare International Standards. Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

ISO 3382-2 was prepared by Technical Committee ISO/TC 43, *Acoustics*, Subcommittee SC 2, *Building acoustics*.

ISO 3382-2, together with ISO 3382-1 and ISO 3382-3, cancel and replace ISO 3382:1997.

ISO 3382 consists of the following parts, under the general title *Acoustics — Measurement of room acoustic parameters*:

- *Part 1: Performance rooms*
- *Part 2: Reverberation time in ordinary rooms*

The following part is in preparation:

- *Part 3: Open plan spaces*

Introduction

This part of ISO 3382 specifies three levels of measurement accuracy: survey; engineering; and precision. The main difference concerns the number of measurement positions and thus the time required for the measurements. Annex A contains some additional information about the measurement uncertainty of the reverberation time. The introduction of the option of a survey measurement is intended to promote more frequent measurement of reverberation time in rooms where it is relevant. It is obvious that a very simple measurement is better than no measurement.

There are several reasons to measure reverberation time. First, the sound pressure level from noise sources, the intelligibility of speech, and the perception of privacy in a room are strongly dependent on reverberation time. Rooms may include domestic rooms, stairways, workshops, industrial plants, classrooms, offices, restaurants, exhibition centres, sports halls, and railway and airport terminals. Second, reverberation time is measured to determine the correction term for room absorption inherent in many acoustic measurements, such as sound insulation measurements according to ISO 140 (all parts) and sound power measurements according to ISO 3740.

In some countries, building codes specify the required reverberation times in classrooms and other categories of room. However, in the vast majority of rooms, it is left to the design team to specify and design for a reverberation time that is reasonable for the purpose of a room. This part of ISO 3382 is intended to contribute to the general understanding and acceptance of reverberation time for room quality and usability.

Two different evaluation ranges are defined in this part of ISO 3382, 20 dB and 30 dB. However, a preference has been given to the 20 dB evaluation range for several reasons:

- a) the subjective evaluation of reverberation is related to the early part of the decay;
- b) for the estimation of the steady-state sound level in a room from its reverberation time, it is appropriate to use the early part of the decay; and
- c) the signal-to-noise ratio is often a problem in field measurements, and it is often difficult or impossible to get a evaluation range of more than 20 dB. This requires a signal-to-noise level of at least 35 dB.

The traditional measuring technique is based on visual inspection of every single decay curve. With modern measuring equipment, the decay curves are normally not displayed and this may introduce a risk that abnormal decay curves are used for the determination of the reverberation time. For this reason, Annex B introduces two new measures that quantify the degree of non-linearity and the degree of curvature of the decay curve. These measures may be used to give warnings when the decay curve is not linear, and consequently the result should be marked as less reliable and not having a unique reverberation.

The use of rotating microphones during the measurement of decay curves has been considered by the working group, and this procedure is found to be without a clear physical meaning and thus it is only accepted for the interrupted noise method and only when the result is used for a correction term.

For other reverberation time measurements, ISO 3382-1 covers auditoria and performance spaces, and ISO 354 absorption coefficient measurements in a reverberation room. Neither ISO 3382-1 nor ISO 354 is suitable for measurements in rooms like those mentioned above. Thus, this part of ISO 3382 fills a gap among measurement standards for acoustic properties of buildings.

This part of ISO 3382 does not repeat the technical details of ISO 3382-1, but deals with the measurement of reverberation time, only, in any kind of room.

Acoustics — Measurement of room acoustic parameters —

Part 2: Reverberation time in ordinary rooms

1 Scope

This part of ISO 3382 specifies methods for the measurement of reverberation time in ordinary rooms. It describes the measurement procedure, the apparatus needed, the required number of measurement positions, and the method for evaluating the data and presenting the test report.

The measurement results can be used for correction of other acoustic measurements, e.g. sound pressure level from sound sources or measurements of sound insulation, and for comparison with requirements for reverberation time in rooms.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 3382-1:—¹⁾, *Acoustics — Measurement of room acoustic parameters — Part 1: Performance rooms*

ISO 18233, *Acoustics — Application of new measurement methods in building and room acoustics*

IEC 61260, *Electroacoustics — Octave-band and fractional-octave-band filters*

3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

3.1

decay curve

graphical representation of the decay of the sound pressure level in a room as a function of time after the sound source has stopped

[ISO 354:2003, 3.1]

NOTE It is possible to measure this decay either after the actual cut-off of a continuous sound source in the room or derived from the reverse-time integrated squared impulse response of the room, see Clause 5.

1) To be published. (Revision of ISO 3382:1997)

3.2 interrupted noise method
method of obtaining decay curves by direct recording of the decay of sound pressure level after exciting a room with broadband or band-limited noise

[ISO 354:2003, 3.3]

3.3 integrated impulse response method
method of obtaining decay curves by reverse-time integration of squared impulse responses

[ISO 354:2003, 3.4]

3.4 impulse response
temporal evolution of the sound pressure observed at a point in a room as a result of the emission of a Dirac impulse at another point in the room

[ISO 354:2003, 3.5]

NOTE It is impossible in practice to create and radiate true Dirac delta functions but short transient sounds (e.g. from gunshots) can offer close enough approximations for practical measurement. An alternative measurement technique, however, is to use a period of maximum-length sequence (MLS) type signal or other deterministic, flat-spectrum signal like a sine sweep and transform the measured response back to an impulse response.

3.5 reverberation time
 T
(room acoustic parameters) duration required for the space-averaged sound energy density in an enclosure to decrease by 60 dB after the source emission has stopped

NOTE 1 The reverberation time is expressed in seconds.

NOTE 2 T can be evaluated based on a smaller dynamic range than 60 dB and extrapolated to a decay time of 60 dB. It is then labelled accordingly. Thus, if T is derived from the time at which the decay curve first reaches 5 dB and 25 dB below the initial level, it is labelled T_{20} . If decay values of 5 dB to 35 dB below the initial level are used, it is labelled T_{30} .

3.6 large room volume
an enclosed space of volume greater than 300 m³

4 Measurement conditions

4.1 General

In many rooms, the number of people present can have a strong influence on the reverberation time. Reverberation time measurements should be made in a room containing no people. However, a room with up to two persons present may be allowed to represent its unoccupied state, unless otherwise specified. If the measurement result is used for correction of a measured sound pressure level, the number of persons present in the room should be the same for that measurement.

In large rooms, attenuation by air can contribute significantly to sound absorption at high frequencies. For precision measurements, the temperature and relative humidity of the air in the room shall normally be measured.

The contribution from air absorption is negligible if the reverberation time is shorter than 1,5 s at 2 kHz and shorter than 0,8 s at 4 kHz. In this case, it is not necessary to measure the temperature and relative humidity.

4.2 Equipment

4.2.1 Sound source

The source should be as omnidirectional as possible. For precision measurements, the directivity of the sound source shall fulfil the requirements of ISO 3382-1:—, A.3.1. For the survey and engineering measurements, there are no specific requirements for the directivity. It shall produce a sound pressure level sufficient to provide decay curves with the required minimum dynamic range without contamination by background noise.

4.2.2 Microphones and analysis equipment

Omnidirectional microphones shall be used to detect sound pressure and the output may be taken either

- directly to an amplifier, filter set and a system for displaying decay curves or analysis equipment for deriving the impulse responses; or
- to a signal recorder for later analysis.

4.2.2.1 Microphone and filters

The microphone should be as small as possible and preferably have a maximum diaphragm diameter of 14 mm. Microphones with diameters up to 27 mm are allowed, if they are of the pressure response type or of the free field response type but supplied with a random incidence corrector. The octave or one-third-octave filters shall conform to IEC 61260.

4.2.2.2 Apparatus for forming decay record of level

The apparatus for forming (and displaying and/or evaluating) the decay record shall use any of the following:

- a) exponential averaging, with continuous curve as output;
- b) exponential averaging, with successive discrete sample points from the continuous average as output;
- c) linear averaging, with successive discrete linear averages as output.

The averaging time, i.e. time constant of an exponential averaging device, shall be less than, but as close as possible to $T/30$. Similarly, the averaging time of a linear averaging device shall be less than $T/12$. Here T is the reverberation time being measured.

In apparatus where the decay record is formed as a succession of discrete points, the time interval between points on the record shall be less than 1,5 times the averaging time of the device.

In all cases where the decay record is to be evaluated visually, adjust the time scale of the display so that the slope of the record is as close as possible to 45° .

NOTE 1 The averaging time of an exponential averaging device is equal to $4,34 [= 10 \lg(e)]$ divided by the decay rate in decibels per second of the device.

NOTE 2 Commercial level recorders, in which sound pressure level is recorded graphically as a function of time, are usually equivalent to exponential averaging devices.

NOTE 3 When an exponential averaging device is used, there is little advantage in setting the averaging time very much less than $T/30$. When a linear averaging device is used there is no advantage in setting the interval between points at very much less than $T/12$. In some sequential measuring procedures, it is feasible to set the averaging time appropriately for each frequency band. In other procedures, this is not feasible, and an averaging time or interval chosen as above with reference to the shortest reverberation time in any band has to serve for measurements in all bands.

4.2.2.3 Overload

No overloading shall be allowed in any stage of the measuring apparatus. Where impulsive sound sources are used, peak-level indicating devices shall be used for checking against overloading.

4.3 Measurement positions

4.3.1 General

The minimum numbers of measurement positions to achieve an appropriate coverage in a room are given in Table 1. In rooms with a complicated geometry, more measurement positions should be used. A distribution of microphone-positions shall be chosen which anticipates the major influences likely to cause differences in reverberation time throughout the room.

Table 1 — Minimum numbers of positions and measurements

	Survey	Engineering ^a	Precision
Source-microphone combinations	2	6	12
Source-positions ^b	≥ 1	≥ 2	≥ 2
Microphone-positions ^c	≥ 2	≥ 2	≥ 3
No. decays in each position (interrupted noise method)	1	2	3

^a When the result is used for a correction term to other engineering-level measurements, only one source-position and three microphone-positions are required.

^b For the interrupted noise method uncorrelated sources may be used simultaneously.

^c For the interrupted noise method and when the result is used for a correction term a rotating microphone boom may be used instead of multiple microphone-positions.

For the interrupted noise method, the total number of decays is normally obtained by a number of repeated decays in each position. However, it is also allowed to take a new position for each decay, provided that the total number of decays is as prescribed.

Source-positions may be chosen as the normal position according to the use of the room. In small rooms such as domestic rooms or when no normal positions exist, one source-position should be in a corner of the room. Microphone-positions should preferably be at least half a wavelength apart, i.e. a minimum distance of around 2 m for the usual frequency range. The distance from any microphone-position to the nearest reflecting surface, including the floor, should preferably be at least a quarter of a wavelength, i.e. normally around 1 m. Symmetric positions should be avoided. In the special case of a moving microphone, the sweep radius shall be at least 0,7 m. The plane of the traverse shall not lie within 10° of any plane of the room (wall, floor, ceiling). The duration of a traverse period shall not be less than 15 s.

The microphone-positions shall not be too close together. Otherwise the number of independent positions is less than the actual number of measurement positions. The minimum numbers given in Table 1 are the numbers of independent positions.

No microphone-position shall be too close to any source-position in order to avoid too strong influence from the direct sound. The minimum distance, d_{\min} , in metres, can be calculated from Equation (1):

$$d_{\min} = 2 \sqrt{\frac{V}{c\hat{T}}} \quad (1)$$

where

V is the volume, in cubic metres;

c is the speed of sound, in metres per second;

\hat{T} is an estimate of the expected reverberation time, in seconds.

4.3.2 Survey method

The survey method is appropriate for the assessment of the amount of the room absorption for noise control purposes, and survey measurements of the airborne and impact sound insulation. It should be used for measurements in ISO 10052. Survey measurements are made in octave bands, only. The nominal accuracy is assumed to be better than 10 % for octave bands, see Annex A.

Make measurements of the reverberation time for at least one source-position. Find the average of results from at least two source-microphone combinations, see Table 1.

4.3.3 Engineering method

The engineering method is appropriate for verification of building performance for comparison with specifications of reverberation time or room absorption. It should be used for measurements in ISO 140 (all parts) with remarks to reverberation time measurements. The nominal accuracy is assumed to be better than 5 % in octave bands and better than 10 % in one-third-octave bands, see Annex A.

Make measurements of the reverberation time for at least two source-positions. At least six independent source-microphone combinations are required, see Table 1.

4.3.4 Precision method

The precision method is appropriate where high measurement accuracy is required. The nominal accuracy is assumed to be better than 2,5 % in octave bands and better than 5 % in one-third-octave bands, see Annex A.

Make measurements of the reverberation time for at least two source-positions. At least 12 independent source-microphone combinations are required, see Table 1.

5 Measurement procedures

5.1 General

Two methods of measuring the reverberation time are described in this part of ISO 3382: the interrupted noise method; and the integrated impulse response method. Both methods have the same expectation value. The frequency range depends on the purpose of the measurements. Where there is no requirement for specific frequency bands, the frequency range should cover at least 250 Hz to 2 000 Hz for the survey method. For the engineering and precision methods, the frequency range should cover at least 125 Hz to 4 000 Hz in octave bands, or 100 Hz to 5 000 Hz in one-third-octave bands.

5.2 Interrupted noise method

5.2.1 Excitation of the room

A loudspeaker source shall be used and the signal fed into the loudspeaker shall be derived from broadband random or pseudo-random electrical noise. When using a pseudo-random noise, it shall be randomly stopped, not using a repeated sequence. The source shall be able to produce a sound pressure level sufficient to ensure a decay curve starting at least 35 dB above the background noise in the corresponding frequency band. If T_{30} is to be measured, it is necessary to create a level at least 45 dB above the background level.

For measurements in octave bands, the bandwidth of the signal shall be greater than or equal to one octave; for measurements in one-third-octave bands, the bandwidth of the signal shall be greater than or equal to one-third octave. The spectrum shall be reasonably flat within the actual octave band to be measured. Alternatively, the broadband noise spectrum may be shaped to provide a pink spectrum of steady-state reverberant sound in the enclosure from 88 Hz to 5 657 Hz. Thus the frequency range covers the one-third-octave bands with mid-band frequencies from 100 Hz to 5 kHz or octave bands from 125 Hz to 4 kHz.

For the engineering and precision methods, the duration of excitation of the room needs to be sufficient for the sound field to have achieved a steady state before the source is switched off. Thus it is essential for the noise to be radiated for a minimum period of $T/2$ s. In large volumes, the duration of the excitation shall be at least a few seconds.

For the survey method, a short excitation or an impulse signal may be used as an alternative to the interrupted noise signal. However, in that case, the measuring accuracy is less than stated in 4.3.1.

5.2.2 Averaging of measurements

The number of microphone-positions used will be determined by the accuracy required. However, in view of the randomness inherent in the source signal, it is necessary to average over a number of measurements at each position in order to achieve an acceptable measurement uncertainty (see 7.1). The averaging can be made in two different ways, either

- find the individual reverberation times for all the decay curves and take the mean value; or
- make an ensemble average of the squared sound pressure decays and find the reverberation time of the resulting decay curve. The individual decays are superposed with their beginnings synchronised. The discrete squared sound pressure sample values are summed for each time interval increment of the decays and the sequence of these sums is used as a single overall ensemble decay from which T is then evaluated. The sound power emitted by the source shall be kept the same for all measurements. This is the preferred method.

5.3 Integrated impulse response method

5.3.1 General

The impulse response from a source-position to a receiver-position in a room is a well-defined quantity, which can be measured in a variety of ways (e.g. using pistol shots, spark gap impulses, noise bursts, chirps or MLSs as signals). It is not the aim of this part of ISO 3382 to exclude any other method that can yield the correct impulse response.

5.3.2 Excitation of the room

The impulse response can be measured directly using an impulse source such as a pistol shot or any other source that is not reverberant itself as long as its spectrum is broad enough to meet the requirements of 5.2.1. The impulse source shall be able to produce a peak sound pressure level sufficient to ensure a decay curve starting at least 35 dB above the background noise in the corresponding frequency band. If T_{30} is to be measured, it is necessary to create a level at least 45 dB above the background level.

Special sound signals may be used which yield the impulse response only after special processing of the recorded microphone signal, see ISO 18233. This can provide an improved signal-to-noise ratio. Sine sweeps or pseudo-random noise (e.g. MLSs) may be used if the requirements for the spectrum and directional characteristics of the source are fulfilled. Because of the improvement in signal-to-noise ratio, the dynamic requirements on the source can be considerably lower than those set in the previous paragraph. If time averaging is used, it is necessary to verify that the averaging process does not alter the measured impulse response. Using these measurement techniques, the frequency filtering is often inherent in the signal analysis, and it is sufficient that the excitation signal covers the frequency bands to be measured.

5.3.3 Integration of the impulse response

Generate the decay curve for each octave band or one-third-octave band by a backward integration of the squared, filtered impulse response. For further details see ISO 3382-1:—.

NOTE In the limit of an infinite number of measurements with interrupted noise, the ensemble averaged decay curve is identical to that of a single integrated squared impulse response.

6 Evaluation of decay curves

For the determination of T_{20} the evaluated range for the decay curves is from 5 dB to 25 dB below the steady-state level. For the integrated impulse response method, the steady-state level is the total level of the integrated impulse response. Within the evaluation range a least-squares fit line shall be computed for the curve or, in the case of decay curves plotted directly by level recorder, a straight line shall be fitted manually as closely as possible to the decay curve. The formula for the least-squares method is given in Annex C. Other algorithms that provide similar results may be used. The slope of the straight line gives the decay rate, d , in decibels per second, from which the reverberation time is calculated as $T_{20} = 60/d$. For the determination of T_{30} the evaluation range is from 5 dB to 35 dB.

If the technique used for determining the reverberation time is based on evaluating traces plotted by a level recorder, then a visual "best fit" line may be substituted for a computed regression line, but this will not be as reliable as a regression analysis.

In order to specify a reverberation time, the decay curves shall follow approximately a straight line. If the curves are non-linear this may indicate a mixture of modes with different reverberation times and thus the result may be unreliable. Two indicators of non-linear decay curves are proposed in Annex B.

The decay directly obtained after non-continuous excitation of a room (e.g. by recording a gunshot with a level recorder) is not recommended for accurate evaluation of the reverberation time. This method should only be used for survey purposes following the procedure for survey measurements.

7 Measurement uncertainty

7.1 Interrupted noise method

Due to the random nature of the excitation signal, the measurement uncertainty of the interrupted noise method strongly depends on the number of averages performed. Ensemble averaging and the averaging of individual reverberation times have the same dependencies on the number of averages. The standard deviation of the measurement result, $\sigma(T_{20})$ or $\sigma(T_{30})$, in seconds, can be estimated from Equations (2) and (3), respectively:

$$\sigma(T_{20}) = 0,88T_{20} \sqrt{\frac{1+(1,90/n)}{NB T_{20}}} \quad (2)$$

$$\sigma(T_{30}) = 0,55T_{30} \sqrt{\frac{1+(1,52/n)}{NB T_{30}}} \quad (3)$$

where

B is the bandwidth, in hertz;

n is the number of decays measured in each position;

N is the number of independent measurement positions (combinations of source- and receiver-positions);

T_{20} is the reverberation time, in seconds, based on a 20 dB evaluation range;

T_{30} is the reverberation time, in seconds, based on a 30 dB evaluation range.

Equations (2) and (3) are derived from References [1] and [2] and based on certain assumptions concerning the averaging device. Further information is given in Annex A.

For an octave filter, $B = 0,71 f_c$, and for one-third-octave filter, $B = 0,23 f_c$, where f_c is the mid-band frequency, in hertz, of the filter. Octave-band measurements give a better measurement accuracy than one-third-octave measurements with the same number of measurement positions.

7.2 Integrated impulse response method

The measurement uncertainty using the integrated impulse response method is of the same order of magnitude as that using an average of $n = 10$ measurements in each position with the interrupted noise method. No additional averaging is necessary to increase the statistical measurement accuracy for each position.

7.3 Lower limits for reliable results caused by filter and detector

In the case of very short reverberation times, the decay curve can be influenced by the filter and the detector. Using traditional forward analysis, the lower limit conditions for reliable results shall be:

$$BT > 16 \tag{4}$$

$$T > T_{\text{det}} \tag{5}$$

where

B is the filter bandwidth, in hertz;

T is the measured reverberation time, in seconds;

T_{det} is the reverberation time, in seconds, of the averaging detector.

NOTE Very short reverberation times can be analysed using the time-reversal technique described in ISO 3382-1:—. In that case the lower limit conditions for reliable results are $BT > 4$ and $T > T_{\text{det}}/4$.

8 Spatial averaging

The results measured for the range of source- and microphone-positions can be combined either for separate identified areas or for the room as a whole to give spatial average values. This spatial averaging shall be achieved by either of the following procedures.

- a) Arithmetic averaging of the reverberation times. The spatial average is given by taking the mean of the individual reverberation times for all the independent source- and microphone-positions. The standard deviation may be determined to provide a measure of accuracy and the spatial variance of the reverberation time.
- b) Ensemble averaging of the decay curves. The individual decays are superposed with their beginnings synchronised, see 5.2.2.

9 Statement of results

9.1 Tables and curves

The evaluated reverberation times for each frequency of measurement shall be stated in a table. The result may also be plotted in the form of a graph.

In the case of a graph, either straight lines connecting the points or a bar graph should be used. The abscissa shall present frequency on a logarithmic scale, while the ordinate shall use either a linear time scale with an origin of zero, or a logarithmic scale. The nominal mid-band frequencies for octave bands according to IEC 61260 should be marked on the frequency axis.

In the table and graph it shall be clearly stated whether T_{20} or T_{30} is used for the reverberation time.

9.2 Test report

The test report shall include at least the following information:

- a) a statement that the measurements were made in conformity with this part of ISO 3382;
 - b) all information necessary to uniquely identify the room tested;
 - c) sketch plan of the room, with an indication of the scale;
 - d) volume of the room;
- NOTE If the room is not completely enclosed, an explanation shall be given of how the stated volume is defined.
- e) condition of the room (furniture, number of persons present, etc.);
 - f) for the precision method only, the temperature and relative humidity in the room during the measurement;
 - g) type of sound source;
 - h) a description of the sound signal used;
 - i) degree of precision (survey, engineering or precision) including details of the source- and microphone-positions, preferably shown on a plan together with an indication of the heights of the positions;
 - j) description of measuring apparatus and the microphones;
 - k) method used for evaluation of the decay curves, either computed least-squares best fit or a visual best fit (Clause 6);
 - l) method used for averaging the result in each position (5.2.2);
 - m) method used for averaging the result over the positions (Clause 8);
 - n) table with the measuring results;
 - o) date of measurement and name of the measuring organisation.

Annex A (informative)

Measurement uncertainty

A.1 General

The measurement uncertainty of decay rate measurements has been studied in References [1] and [2].

The decay rate, d , in decibels per second, is related to the reverberation time T , in seconds, by $d = 60/T$. The measurements can be repeated in the same position.

The variance of the grand mean decay rate, $\text{var}(\bar{d})$, is given by Equation (A.1):

$$\text{var}(\bar{d}) = \frac{1}{N} \text{var}_s(d) + \frac{1}{Nn} \text{var}_e(d) \quad (\text{A.1})$$

where

- n is the number of decays measured in each position;
- N is the number of independent measurement positions;
- $\text{var}_e(d)$ is the ensemble variance in one position;
- $\text{var}_s(d)$ is the spatial variance.

The relative variance of the reverberation time is given by Equation (A.2):

$$\frac{\text{var}(\bar{T})}{\bar{T}^2} = \frac{\text{var}(\bar{d})}{\bar{d}^2} \quad (\text{A.2})$$

Thus, the estimated coefficient of variation of the mean reverberation time (also known as the standard uncertainty) is given by Equation (A.3):

$$\frac{\sigma(\bar{T})}{\bar{T}} = \sqrt{\frac{\text{var}(\bar{d})}{\bar{d}^2}} = \frac{1}{\sqrt{N}} \sqrt{\frac{\text{var}_s(d)}{d^2} + \frac{\text{var}_e(d)}{n d^2}} \quad (\text{A.3})$$

A.2 The interrupted noise method

In Reference [1], the ensemble variance and the spatial variance were derived for the case of measurements using the interrupted noise method. By inserting the results from Reference [1], Equations (2.55) and (2.56), into Equation (A.3), we obtain Equation (A.4):

$$\frac{\sigma(\bar{T})}{\bar{T}} = G \sqrt{\frac{1+(H/n)}{NBT}} \quad (\text{A.4})$$

where

$\sigma(\bar{T})$ is the standard deviation of the mean reverberation time, in seconds;

B is the bandwidth, in hertz;

G, H are constants that depend on the evaluation range;


T is the reverberation time, in seconds.

Constants G and H depend on the evaluation range D and a parameter $\gamma = T/T_{\text{det}}$, which is the ratio of measured reverberation time and the reverberation time inherent in the measuring apparatus. T_{det} is the reverberation time of the averaging detector. For some typical values of D and γ , the values of the constants G and H can be taken from Table A.1.

Equations (2) and (3) assume that $\gamma = 5$.

Table A.1 — Values of the constants G and H


Evaluation range, D dB	G %	H		
		$\gamma = 3$	$\gamma = 5$	$\gamma = 10$
10	175	2,67	3,32	3,87
20	88	1,72	1,90	2,04
30	55	1,42	1,52	1,59

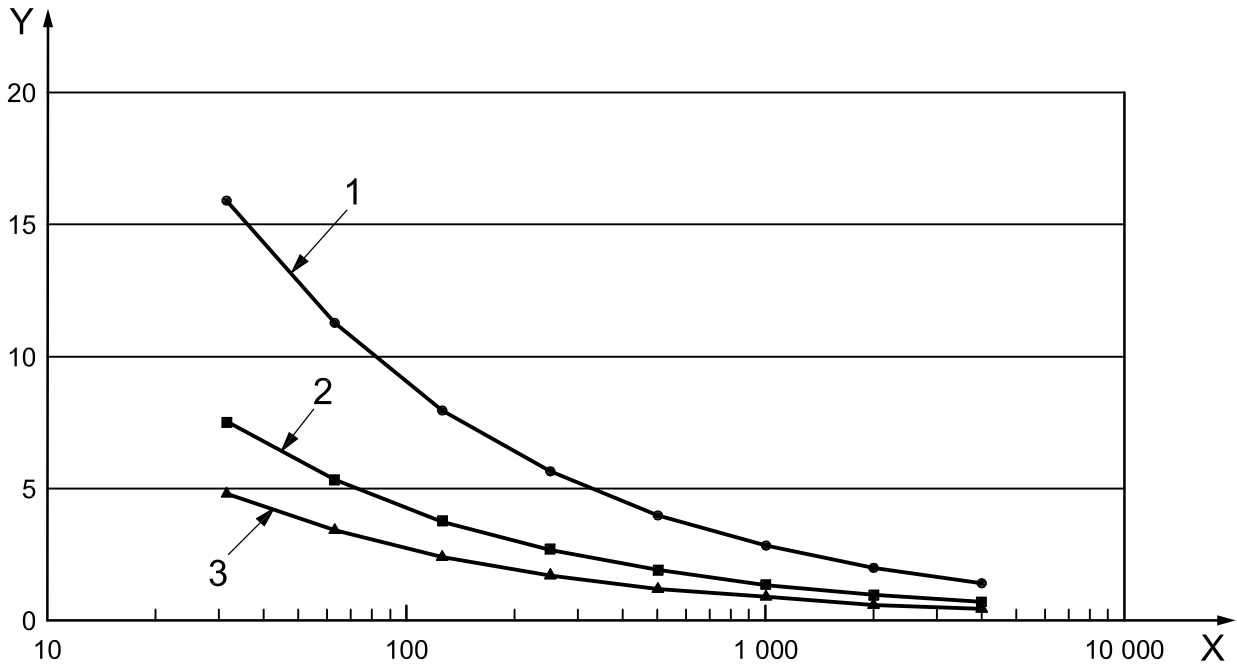

Key

- 1 survey method
 - 2 engineering method
 - 3 precision method
- X $f_c T_{20}$ is the centre frequency \times reverberation time
- Y $\sigma(\bar{T}_{20})/\bar{T}_{20}$ is the coefficient of variation of T_{20} , %

Figure A.1 — The coefficient of variation of T_{20} in octave bands as a function of centre frequency multiplied by reverberation time. The curves represent survey, engineering and precision methods

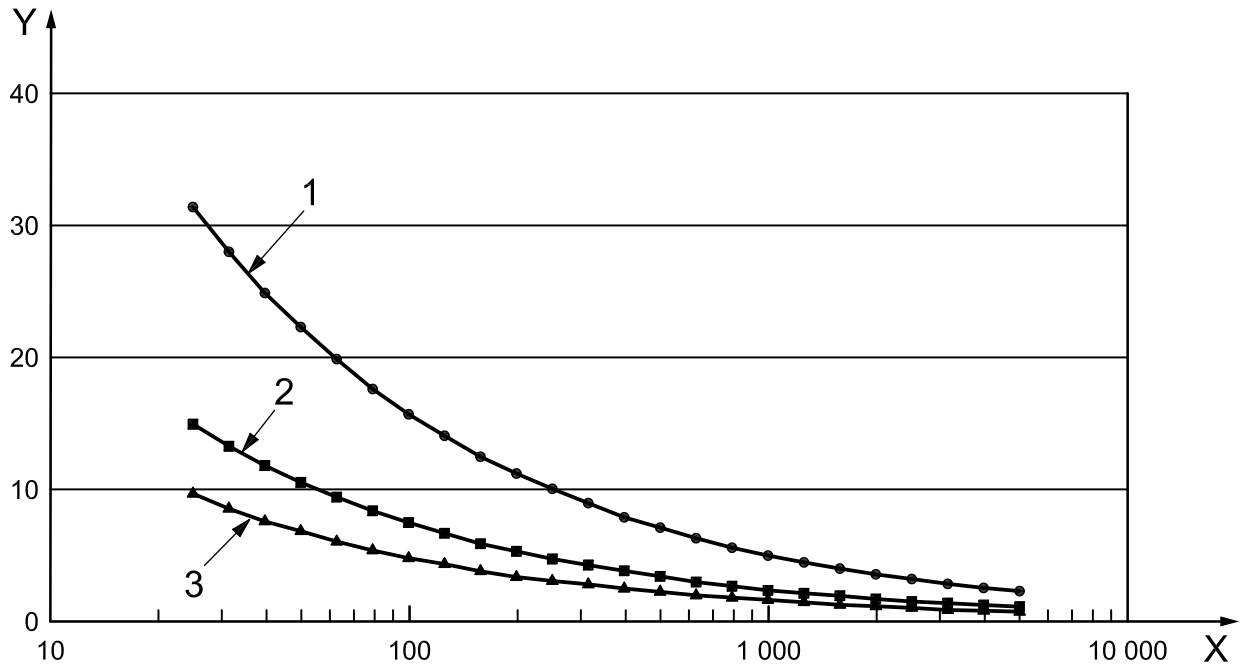**Key**

- 1 survey method
- 2 engineering method
- 3 precision method

X $f_c T_{20}$ is the centre frequency \times reverberation time

Y $\sigma(\bar{T}_{20})/\bar{T}_{20}$ is the coefficient of variation of T_{20} , %

Figure A.2 — The coefficient of variation of T_{20} in one-third-octave bands as a function of centre frequency multiplied by reverberation time. The curves represent survey, engineering and precision methods

A.3 The integrated impulse response method

For the integrated impulse response method, the ensemble variance is theoretically $\text{var}_e(d) = 0$. This corresponds to the averaging of an infinite number of excitations in the same position, if the interrupted noise method had been used (see Reference [2]). For the estimation of the standard deviation of a measurement result, Equation (A.4) may be used with a value of $n = 10$.

Annex B (informative)

Evaluation of non-linear decay curves

B.1 General

The measurement of reverberation time is based on the assumption that within the evaluation range, a straight line can approximate the slope of the decay curve. It can be useful to have some information about the extent to which this assumption is actually fulfilled. Two such indicators are proposed in this annex.

B.2 The degree of non-linearity

If the evaluation of the decay curve is made by a least-squares fit of a straight line, the following non-linearity parameter may be calculated. Let L_i be the level, in decibels, of sample number i , \hat{L}_i is the estimated value of sample number i from the linear regression, and the mean value of the samples, \bar{L} , is given by Equation (B.1):

$$\bar{L} = \frac{1}{n} \sum_{i=1}^n L_i \quad (\text{B.1})$$

The square of the correlation coefficient, r , is given by Equation (B.2):

$$r^2 = \frac{\sum_{i=1}^n (\hat{L}_i - \bar{L})^2}{\sum_{i=1}^n (L_i - \bar{L})^2} \quad (\text{B.2})$$

The square of the correlation coefficient can have any value between 0 and 1 and a perfectly straight decay curve corresponds to $r^2 = 1$. The non-linearity parameter, ξ , is introduced as the permillage deviation from perfect linearity

$$\xi = 1\,000(1 - r^2) \quad (\text{B.3})$$

Typical values of ξ are 0 ‰ to 5 ‰. Values higher than 10 ‰ indicate a decay curve which is far from being a straight line and the value of the reverberation time estimated from the decay curve may be suspicious. These values apply to ensemble-averaged curves and integrated impulse response curves; higher values may occur for individual decay curves.

B.3 The degree of curvature

The decay curve measured in a room will often be slightly non-linear. The initial part of the decay is typically a little steeper than the late part of the decay. The reason for this is that the decay represents a mixture of decaying modes with different decay rates. If the absorption is not evenly distributed on the surfaces of the room, the modes may have very different decay rates. Obviously, a non-linear decay curve means that the reverberation time evaluated from the measurement depends on which part of the decay curve is used. Consequently the result is less reliable than if the decay curve is linear.

The curvature parameter, C , is based on the two evaluation ranges of 20 dB and 30 dB and it is introduced as the percentage deviation from a perfectly straight line

$$C = 100 \times \left(\frac{T_{30}}{T_{20}} - 1 \right) \quad (\text{B.4})$$

Typical values of C are 0 % to 5 %. Values higher than 10 % indicate a decay curve which is far from being a straight line and the value of the reverberation time estimated from the decay curve may be suspicious. Negative values should not occur and they may indicate an error in the measurement.

Annex C (informative)

Formulas for the least-squares fit method

The reverberation time may be evaluated by using linear regression analysis and the least-squares fit procedure. This means that the decay curve is approximated by a straight line; \hat{L}_i , the level of the regression line of sample i , in decibels, is given by Equation (C.1):

$$\hat{L}_i = a + bt_i \text{ dB} \quad (\text{C.1})$$

where

a is the intercept of the straight line, in decibels;

b is the slope estimate, in decibels per second;

t_i is the time, in seconds, of sample i .

According to the least-squares fit procedure, the intercept and slope estimates shall be determined as follows:

$$a = \bar{L} - b\bar{t} \quad (\text{C.2})$$

$$b = \frac{\sum_{i=1}^n (t_i L_i) - n\bar{t}\bar{L}}{\sum_{i=1}^n (t_i^2) - n\bar{t}^2} \quad (\text{C.3})$$

where

$$\bar{L} = \frac{1}{n} \sum_{i=1}^n L_i \text{ dB} \quad (\text{C.4})$$

$$\bar{t} = \frac{1}{n} \sum_{i=1}^n t_i \quad (\text{C.5})$$

The estimate of the reverberation time, \hat{T} , in seconds, is given by

$$\hat{T} = -60/b \quad (\text{C.6})$$

Bibliography

- [1] DAVY, J.L., DUNN, I.P., DUBOUT, P. The variance of decay rates in reverberation rooms. *Acustica* 1979, **43**, pp. 12-25
- [2] DAVY, J.L. The variance of impulse decays. *Acustica* 1980, **44**, pp. 51-56
- [3] ISO 140 (all parts), *Acoustics — Measurement of sound insulation in buildings and of building elements*
- [4] ISO 354, *Acoustics — Measurement of sound absorption in a reverberation room*
- [5] ISO 3740, *Acoustics — Determination of sound power levels of noise sources — Guidelines for the use of basic standards*
- [6] ISO 10052, *Acoustics — Field measurements of airborne and impact sound insulation and of service equipment sound — Survey method*
- [7] ISO 80000-8, *Quantities and units — Part 8: Acoustics*

BSI - British Standards Institution

BSI is the independent national body responsible for preparing British Standards. It presents the UK view on standards in Europe and at the international level. It is incorporated by Royal Charter.

Revisions

British Standards are updated by amendment or revision. Users of British Standards should make sure that they possess the latest amendments or editions.

It is the constant aim of BSI to improve the quality of our products and services. We would be grateful if anyone finding an inaccuracy or ambiguity while using this British Standard would inform the Secretary of the technical committee responsible, the identity of which can be found on the inside front cover. Tel: +44 (0)20 8996 9000. Fax: +44 (0)20 8996 7400.

BSI offers members an individual updating service called PLUS which ensures that subscribers automatically receive the latest editions of standards.

Buying standards

Orders for all BSI, international and foreign standards publications should be addressed to Customer Services. Tel: +44 (0)20 8996 9001. Fax: +44 (0)20 8996 7001 Email: orders@bsigroup.com You may also buy directly using a debit/credit card from the BSI Shop on the Website <http://www.bsigroup.com/shop>

In response to orders for international standards, it is BSI policy to supply the BSI implementation of those that have been published as British Standards, unless otherwise requested.

Information on standards

BSI provides a wide range of information on national, European and international standards through its Library and its Technical Help to Exporters Service. Various BSI electronic information services are also available which give details on all its products and services. Contact Information Centre. Tel: +44 (0)20 8996 7111 Fax: +44 (0)20 8996 7048 Email: info@bsigroup.com

Subscribing members of BSI are kept up to date with standards developments and receive substantial discounts on the purchase price of standards. For details of these and other benefits contact Membership Administration. Tel: +44 (0)20 8996 7002 Fax: +44 (0)20 8996 7001 Email: membership@bsigroup.com

Information regarding online access to British Standards via British Standards Online can be found at <http://www.bsigroup.com/BSOL>

Further information about BSI is available on the BSI website at <http://www.bsigroup.com>

Copyright

Copyright subsists in all BSI publications. BSI also holds the copyright, in the UK, of the publications of the international standardization bodies. Except as permitted under the Copyright, Designs and Patents Act 1988 no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means – electronic, photocopying, recording or otherwise – without prior written permission from BSI.

This does not preclude the free use, in the course of implementing the standard, of necessary details such as symbols, and size, type or grade designations. If these details are to be used for any other purpose than implementation then the prior written permission of BSI must be obtained.

Details and advice can be obtained from the Copyright and Licensing Manager. Tel: +44 (0)20 8996 7070 Email: copyright@bsigroup.com