

Safety devices for protection against excessive pressure —

**Part 3: Safety valves and bursting disc
safety devices in combination
(ISO 4126-3:2006)**

ICS 13.240

National foreword

This British Standard is the UK implementation of EN ISO 4126-3:2006.

The UK participation in its preparation was entrusted to Technical Committee PVE/12, Safety devices.

A list of organizations represented on this committee can be obtained on request to its secretary.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

Compliance with a British Standard cannot confer immunity from legal obligations.

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 30 April 2009

© BSI 2009

ISBN 978 0 580 53523 9

Amendments/corrigenda issued since publication

Date	Comments

ICS 13.240

English Version

Safety devices for protection against excessive pressure - Part
3: Safety valves and bursting disc safety devices in combination
(ISO 4126-3:2006)

Dispositifs de sécurité pour protection contre les pressions
excessives - Partie 3: Dispositifs de sûreté combinant
soupapes de sûreté et disques de rupture (ISO 4126-
3:2006)

Sicherheitseinrichtungen gegen unzulässigen Überdruck -
Teil 3: Sicherheitsventile und Berstscheibeneinrichtungen
in Kombination (ISO 4126-3:2006)

This European Standard was approved by CEN on 27 February 2006.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Central Secretariat or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the Central Secretariat has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

Management Centre: rue de Stassart, 36 B-1050 Brussels

Foreword

This document (EN ISO 4126-3:2006) has been prepared by Technical Committee CEN/TC 69 "Industrial valves", the secretariat of which is held by AFNOR, in collaboration with Technical Committee ISO/TC 185 "Safety devices for protection against excessive pressure".

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by September 2006, and conflicting national standards shall be withdrawn at the latest by September 2006.

This document has been prepared under a mandate given to CEN by the European Commission and the European Free Trade Association, and supports essential requirements of EU Directive(s).

For relationship with EU Directive(s), see informative annex ZA, which is an integral part of this document.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom.

Contents

Page

Introduction	v
1 Scope	1
2 Normative references	1
3 Terms and definitions.....	2
4 Symbols	4
5 Design of combination	5
6 Installation of combination	5
7 Combination performance	6
8 Determination of combination discharge capacity factor, F_d , by testing.....	6
9 Derivation of combination discharge capacity factor, F_d	9
10 Alternative to testing for F_d	9
11 Certification of combination discharge capacity factor, F_d	10
12 Application and use of the certified combination discharge capacity factor, F_d	10
13 Marking and identification of combination devices	10
14 Certification	11
15 Preparation for storage and transport.....	11
Annex ZA (informative) Relationship between this International Standard and the Essential Requirements of EU Directive 97/23/EC (PED).....	12

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 2.

The main task of technical committees is to prepare International Standards. Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

ISO 4126-3 was prepared by the European Committee for Standardization (CEN) Technical Committee CEN/TC 69, *Industrial valves*, ISO/TC 185, *Safety devices for protection against excessive pressure*, in accordance with the Agreement on technical cooperation between ISO and CEN (Vienna Agreement).

This first edition of ISO 4126-3 cancels and replaces ISO 6718:1991, of which it constitutes a technical revision.

ISO 4126 consists of the following parts, under the general title *Safety devices for protection against excessive pressure*:

- *Part 1: Safety valves*
- *Part 2: Bursting disc safety devices*
- *Part 3: Safety valves and bursting disc safety devices in combination*
- *Part 4: Pilot-operated safety valves*
- *Part 5: Controlled safety pressure relief systems (CSPRS)*
- *Part 6: Application, selection and installation of bursting disc safety devices*
- *Part 7: Common data*
- *Part 9: Application and installation of safety devices excluding stand-alone bursting disc safety devices*

Part 7 contains data which is common to more than one of the parts of this standard to avoid unnecessary repetition.

Introduction

Bursting disc safety devices can be used in conjunction with safety valves in following cases:

- a) to protect the safety valve against corrosion, fouling or operating conditions which could affect the safety valve performance;
- b) to prevent leakage;
- c) to prevent total loss of contents from the protected equipment following the bursting of the bursting disc.

The term *combination* is used to describe the close-coupled (i.e. within 5 pipe diameters) assembly of a bursting disc safety device with a safety valve or CSPRS, as defined by this part of ISO 4126. In some cases, the bursting disc safety device and the safety valve or CSPRS are connected together to form the combination by a short length of pipe or a spool piece.

Safety devices for protection against excessive pressure —

Part 3:

Safety valves and bursting disc safety devices in combination

1 Scope

This part of ISO 4126 specifies the requirements for a product assembled from the in-series combination of safety valves or CSPRS (controlled safety pressure relief systems) according to ISO 4126-1, ISO 4126-4 and ISO 4126-5, and bursting disc safety devices according to ISO 4126-2 installed within no more than five pipe diameters from the valve inlet. It specifies the design, application and marking requirements for such products, which are used to protect pressure vessels, piping or other enclosures from excessive pressure, and which comprise the bursting disc safety device, a safety valve or CSPRS and, where applicable, a short length of connecting pipe or spool piece. In addition, it gives a method for establishing the combination discharge factor used in sizing combinations.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 4126-1:2004, *Safety devices for protection against excessive pressure — Part 1: Safety valves*

ISO 4126-2:2003, *Safety devices for protection against excessive pressure — Part 2: Bursting disc safety devices*

ISO 4126-4:2004, *Safety devices for protection against excessive pressure — Part 4: Pilot-operated safety valves*

ISO 4126-5:2004, *Safety devices for protection against excessive pressure — Part 5: Controlled safety pressure relief systems (CSPRS)*

ISO 4126-6:2003, *Safety devices for protection against excessive pressure — Part 6: Application, selection and installation of bursting disc safety devices*

EN 764-7:2002, *Pressure equipment — Part 7: Safety systems for unfired pressure equipment*

EN 13480-1:2002, *Metallic industrial piping — Part 1: General*

EN 13480-2:2002, *Metallic industrial piping — Part 2: Materials*

EN 13480-3:2002, *Metallic industrial piping — Part 3: Design and calculation*

EN 13480-4:2002, *Metallic industrial piping — Part 4: Fabrication and installation*

EN 13480-5:2002, *Metallic industrial piping — Part 5: Inspection and testing*

EN 13480-6:2002, *Metallic industrial piping — Part 6: Additional requirements for buried piping*

CEN/TR 13480-7:2002, *Metallic industrial piping — Part 7: Guidance on the use of conformity assessment procedures*


3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

3.1 combination

installation which comprises a bursting disc safety device installed within five pipe diameters (from outlet of bursting disc holder to inlet of valve) before the inlet of a safety valve or a CSPRS

See Figure 1.

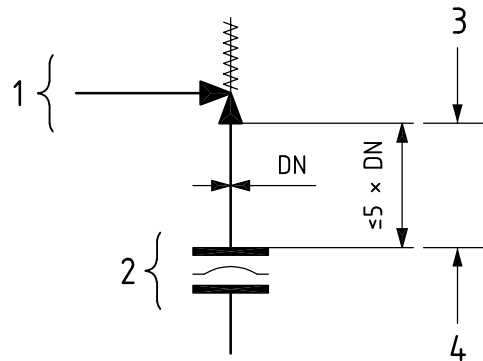

Key

- 1 safety valve or CSPRS
- 2 bursting disc safety device
- 3 safety valve or CSPRS inlet
- 4 bursting disc safety device outlet

NOTE Other bursting disc safety device configurations used in conjunction with safety valves or CSPRS are specified in ISO 4126-6.

Figure 1 — Diagram of combination showing relative distance

3.2 combination discharge capacity factor

F_d
factor used to determine the discharge capacity of a safety valve or CSPRS when the safety valve or CSPRS is used in combination with a bursting disc safety device installed upstream of the safety valve or CSPRS

3.3 flow resistance factor

K_r
factor which determines the resistance to flow in a pipe work system caused by the presence therein of a burst bursting disc, forming part of a bursting disc safety device, installed in the system

NOTE Its symbol, K_r , is a dimensionless factor expressed as the velocity head loss.

3.4 bursting disc safety device

non-reclosing pressure relief device actuated by differential pressure and designed to function by the bursting of the bursting disc(s)

NOTE It is the complete assembly of installed components including, where appropriate, the bursting disc holder.

3.5**bursting disc assembly**

complete assembly of the components installed in the bursting disc holder to perform the desired function

3.6**bursting disc**

pressure-containing and pressure-sensitive component of a bursting disc safety device

3.7**bursting disc holder**

part of a bursting disc safety device that retains the bursting disc assembly in position

3.8**specified bursting pressure**

bursting pressure quoted with a coincident temperature when defining the bursting disc requirements

NOTE It is used in conjunction with a **performance tolerance** (3.11).

3.9**specified maximum bursting pressure**

maximum bursting pressure quoted with the coincident temperature when defining the bursting disc requirements

NOTE It is used in conjunction with a **specified minimum bursting pressure** (3.10).

3.10**specified minimum bursting pressure**

minimum bursting pressure quoted with the coincident temperature when defining the bursting disc requirements

NOTE It is used in conjunction with a **specified maximum bursting pressure** (3.9).

3.11**performance tolerance**

range of pressure between the specified minimum bursting pressure and the specified maximum bursting pressure or the range of pressure in positive and negative percentages or quantities which is related to the specified bursting pressure

3.12**operating pressure**

pressure existing at normal operating conditions within the system being protected

3.13**relieving pressure**

maximum pressure under discharge conditions in the pressurized system

NOTE It may differ from the bursting pressure of the bursting disc.

3.14**bursting disc safety device discharge area**

minimum cross-sectional flow area of the bursting disc safety device, taking into consideration the possible reduction of the cross-section by, for example, back pressure supports, catching devices or parts of the bursting disc which remain after bursting

3.15**batch**

quantity of bursting discs or bursting disc safety devices made as a single group of the same type, size, materials and specified bursting pressure requirements, and where the bursting discs are manufactured from the same lot of material

3.16

bursting pressure

value of the differential pressure between the upstream side and the downstream side of the bursting disc when it bursts

3.17

bursting disc safety device discharge capacity

rate at which a bursting disc safety device can discharge fluid after bursting of the bursting disc

3.18

replacement period

time period beginning at the installation of a bursting disc assembly and ending with its replacement

3.19

pressure relief system

system intended for the safe relief of fluids from pressure equipment for prevention of excessive pressure

NOTE It can consist of equipment nozzle, inlet piping, pressure relief device(s) and discharge piping to atmosphere/collecting vessel/header.

3.20

discharge coefficient

α

coefficient which determines reduction of theoretical discharge capacity of a pressure relief system by the simplified approach which incorporates a burst bursting disc, forming part of a bursting disc safety device

NOTE For details of the simplified approach, see ISO 4126-6:2003, Annex C.

3.21

certified derated coefficient of discharge

K_{dr}

adjusted coefficient of discharge for the safety valve

NOTE See ISO 4126-1.

4 Symbols

A flow area of a safety valve (not curtain area), in square millimetres

F_d combination discharge capacity factor

K_d certified coefficient of discharge of the combination

K_{dr} certified derated coefficient of discharge for safety valve

K_r flow resistance factor

α discharge coefficient for bursting disc safety device

5 Design of combination

- 5.1** Bursting disc safety devices shall comply with ISO 4126-2 and meet the requirements of 6.2.
- 5.2** Safety valves shall comply with ISO 4126-1 or ISO 4126-4.
- 5.3** CSPRS shall comply with ISO 4126-5.
- 5.4** Where additional components are used to combine the bursting disc safety device and the safety valve or CSPRS into a combination (e.g. spool piece), these shall comply with EN 13480.
- 5.5** The space between the bursting disc safety device and the safety valve or CSPRS shall be provided with a connection to prevent or detect an unacceptable build up in pressure.

NOTE Bursting discs, being pressure-differential devices, require a higher pressure in the protected equipment to burst the bursting disc if pressure builds up in the space between the bursting disc and the safety valve or the CSPRS. This occurs when leakage develops through the bursting disc due to corrosion, due to back pressure in the discharge piping or other cause.

- 5.6** After bursting, the bursting disc petals shall not protrude into the valve inlet unless the influence of the petals on the capacity and performance of the safety valve or CSPRS have been assessed and proven to meet the requirements of Clause 7.
- 5.7** The design of the bursting disc safety device shall be such that on bursting, release of bursting disc material shall not impair the performance of the safety valve or the CSPRS.
- 5.8** The nominal pipe size of the bursting disc safety device shall be not less than the nominal size of the inlet of the safety valve or CSPRS.

6 Installation of combination

- 6.1** The combination shall be installed in accordance with ISO 4126-6.
- 6.2** The connection from the protected equipment to the safety valve inlet should be as short as practicable and designed so that the total pressure drop to the safety valve or CSPRS inlet, including the effect of the bursting disc safety device (based on ISO 4126-6:2003, Annex C) shall not exceed 3 % of the set pressure of the safety valve or the CSPRS.

NOTE The 3 % pressure drop is determined from the flow through the combination at maximum relieving pressure of the safety valve or the CSPRS.

- 6.3** The discharge of the combination shall be disposed of safely and be prevented from unintentional flowing into other equipment to create a hazard (for example, into equipment out of service or undergoing maintenance). The discharge pipe, between the outlet of the combination and the atmosphere or venting system, shall be adequately drained at all times. Provision shall be made to absorb the reaction forces expected during the discharge of material (see also ISO 4126-6:2003, 7.2.5). It can be difficult to provide drainage points in a closed disposal system, but in this case the routing of the pipe work should avoid any low points where liquids can accumulate.
- 6.4** The supplier of the combination shall provide assembly and installation instructions in addition to the instructions provided by the manufacturers of the bursting disc safety device and the safety valve or CSPRS, taking into consideration the results of a hazard analysis.

7 Combination performance

7.1 The pressure in the equipment to be protected shall never exceed the allowable limits, e.g. as specified in EN 764-7:2002, 6.1.2 and 6.1.4.

7.2 The maximum limit of bursting pressure of the bursting disc safety device shall not exceed 110 % of the safety valve or CSPRS set pressure or a gauge pressure of 0,1 bar ¹⁾, whichever is greater (see also EN 764-7:2002, 6.3.2.2). The minimum limit of the bursting disc safety device bursting pressure should be not less than 90 % of the safety valve or CSPRS set pressure.

7.3 When the combination is intended for liquid service, the bursting disc safety device and safety valve or CSPRS manufacturers shall be consulted.

NOTE Special attention needs to be given to the possibility of particular circumstances (e.g. thermal relief systems or hydraulic service) that can result in a flow of media insufficient to open the safety valve, when advice from the bursting disc safety device and safety valve or CSPRS manufacturers could be necessary.

7.4 The combination shall be characterized by a combination discharge capacity factor, F_d , determined according to Clause 8, 9 or 10 and to be applied in accordance with Clause 12.

8 Determination of combination discharge capacity factor, F_d , by testing

8.1 General

In order to determine the effect of the proximity of the burst bursting disc safety device on the coefficient of discharge of the safety valve, the manufacturer of the combination shall conduct tests to determine the combination discharge capacity factor, F_d .

Two different approaches to testing are permitted by this part of ISO 4126: the one-size method and the three-size method (see 8.4).

The one-size method can involve testing a specific combination intended for installation in a particular application. Alternatively, by selecting the largest flow area used in that size and type of safety valve and the lowest burst pressure of the bursting disc safety device design to be used in the combination, the one-size method can be used to provide a bounding and conservative value of F_d for a limited range of parameters (e.g. one size and type of safety valve but for a limited range of flow areas).

The three-size method is normally used where series manufacture of combinations takes place and the manufacturer of the combination wishes to derive a conservative value of F_d that can be used to cover the full product range.

8.2 Test requirements

8.2.1 For combinations to be used for compressible fluids, tests shall be carried out using dry saturated steam, superheated steam, air or compressible fluid of other known characteristics.

NOTE *Dry saturated steam* in this context refers to steam with a minimum dryness fraction of 98 % or a maximum degree of superheat of 10 °C. *Superheated steam* in this context refers to steam with a degree of superheat greater than 10 °C.

8.2.2 For combination devices to be used in liquid service, tests shall be carried out using water or liquid of known characteristics.

NOTE Methods to derive values of K_f for incompressible fluids are currently being developed and are to be included in future versions of the relevant parts of ISO 4126.

1) 1 bar = 0,1 MPa = 0,1 N/mm² = 10⁵ N/m².

8.2.3 The test equipment shall be designed and operated such that the actual test flowing capacity measurement shall be accurate to within $\pm 2\%$.

8.2.4 The safety valve or CSPRS tested shall have the largest flow area used in that size and type of valve, except where combination discharge capacity factor, F_d , is specified for smaller flow areas.

8.2.5 The bursting disc safety device shall be mounted on the inlet of the safety valve or CSPRS, taking into consideration the requirements of Clause 5, if applicable.

8.2.6 The tests shall use the lowest burst pressure of the bursting disc safety device design that is to be used in combination with the safety valve or CSPRS design.

8.2.7 The certification shall apply to the combination of the same design of safety valve or CSPRS and the same design of bursting disc safety device (internal flow path of holder) as those tested, irrespective of the external bursting disc holder geometry.

8.2.8 The test records shall include all observations, measurements, and instrument readings and calibration records necessary to attain the objectives of the tests. Original test records shall remain in the custody of the organization responsible for the test. Copies of all test records shall be furnished to each of the parties concerned with the tests. Corrections and corrected values shall be entered separately in the test record.

8.3 Test rig

Details for the test rig(s) and test conditions, including the proposed instrumentation and calibration procedures, shall be specified before testing commences.

8.4 Test method

The following two alternative methods of testing are permitted.

a) One-size combination

- 1) The combination discharge capacity factor determined by this method shall apply only to the size and type tested.
- 2) For each type or model of bursting disc safety device and safety valve or CSPRS, three bursting discs of the same specified bursting pressure shall be individually burst and flow tested in accordance with 8.5.

The test results so obtained may be used as applicable in the three-size method according to b).

b) Three-size combination

- 1) Three sequential sizes of combinations shall be tested.
- 2) For each of the three sizes of bursting disc safety device, three bursting discs of the same specified bursting pressure shall burst and be flow tested in accordance with 8.5. It is permissible to carry out the tests with one holder for each size of bursting disc.

8.5 Test procedure

8.5.1 The certified coefficient of discharge, K_d , of the safety valve or CSPRS used for the test shall be established without the bursting disc safety device, in accordance with ISO 4126-1, ISO 4126-4 or ISO 4126-5, at a relieving pressure no greater than 10 % above the valve set pressure or a gauge pressure of 0,1 bar, whichever is greater.

8.5.2 The bursting disc device shall then be installed at the inlet of the safety valve or the CSPRS and the bursting disc burst in accordance with 8.5.4 in order to operate the valve.

8.5.3 The appropriate safety precautions shall be observed when carrying out tests.

8.5.4 The combination shall be tested as follows.

- a) With the combination installed in the test rig, the pressure at the inlet shall be increased to 90 % of the expected minimum bursting pressure in a time not less than 5 s. Thereafter, the pressure at the inlet shall be increased at a rate that allows accurate recording of the pressure until the bursting disc bursts.
- b) The combination capacity test shall be performed at 10 % or a gauge pressure of 0,1 bar (whichever is greater) above the safety valve or CSPRS set pressure duplicating the individual safety valve or CSPRS capacity test. Maintain this pressure for a sufficient period of time to permit the rate of flow, temperature and pressure to reach stable conditions before recording the test data.
- c) Determine K_d from the test of the combination by determining the ratio of the actual flow to the theoretical flow.
- d) Repeat a), b) and c) for the remaining bursting disc safety devices of the same size.

8.6 Acceptance criteria of the tests

8.6.1 General

The results shall be approved and a combination discharge factor certified only if the following conditions are met.

8.6.2 Conditions applicable to the safety valve

The measured capacity of the tested safety valve shall be equal to or greater than the certified values of K_{dr} (see also ISO 4126-1:2004, Clause 7).

8.6.3 Conditions applicable to the bursting disc safety device

8.6.3.1 The bursting pressure of all bursting discs tested shall fall within the performance tolerance of the specified bursting pressure or within the maximum and minimum specified bursting pressure, whichever is marked on the bursting disc, and shall be in accordance with ISO 4126-2.

8.6.3.2 If any bursting disc does not burst in accordance with 8.6.3.1, the following conditions shall be satisfied.

- a) If the bursting pressure of only one of the bursting discs of any one batch is not in accordance with 8.6.3.1, two additional tests shall be performed using bursting discs from the same batch and the results from these two substituted for the rejected results.
- b) If more than one of the total of the bursting discs tested of any one batch, including any substitute test [see a)], bursts at a pressure not in accordance with 8.6.3.1, then that batch shall be rejected, and new tests of a different batch shall be conducted in accordance with 8.5.
- c) The results of the test of capacity shall fall within 10 % of the average capacity of the three tests. Failure to meet this requirement shall be cause to require retesting to determine the cause of the discrepancies.

8.6.4 Conditions applicable to combination

8.6.4.1 One-size combination

Determine the average K_d for the combination as specified in 8.5.4 c). None of the accepted values of K_d for the combination shall exceed $\pm 5\%$ of the arithmetic average.

8.6.4.2 Three-size combination

Determine the average K_d for each sequential size of combination as specified in 8.5 (three different-sized valves, each with three bursting discs, giving a total of 9 tests). All accepted values of K_d for each type and size of combination tested shall not exceed $\pm 5\%$ of the arithmetic average for that type and size. Similarly the average K_d value for the three sequential sizes of combination shall not exceed $\pm 5\%$ of the arithmetic average.

8.6.4.3 Other conditions

8.6.4.3.1 If, for any test, the K_d value of the combination falls outside $\pm 5\%$ of the arithmetic averages then all test results shall be rejected, except as provided for in 8.6.4.3.2 and 8.6.4.3.3

8.6.4.3.2 If the K_d of only one test under 8.6.4.2 exceeds $\pm 5\%$ of the arithmetic average, two additional tests of the same size shall be performed using bursting discs from the same batch. The K_d values obtained from these two tests shall be substituted for the rejected result and a new average K_d shall be calculated, provided the replacement bursting discs burst at a pressure in accordance with 8.6.4.2.

8.6.4.3.3 If any of the values of K_d obtained, excluding the rejected test result but including the substitute tests of 8.6.4.3.2, fall outside $\pm 5\%$ of the new arithmetic average, or if the bursting pressure of one of the substitute bursting discs is not in accordance with 8.6.4.2, then all results obtained from this batch of bursting discs shall be rejected.

9 Derivation of combination discharge capacity factor, F_d

9.1 The combination discharge capacity factor, F_d , is the ratio of the average of the coefficients of discharge determined by the combination tests to the coefficient of discharge determined on the valve(s) used in the test(s) (see 8.5).

NOTE The three-size combination test, see 8.4 b), requires the above procedure to be repeated for three sequential sizes of combinations.

9.2 Where values of F_d greater than one are found, a value of one shall be used. Where values of F_d of less than 0,97 are found, these combinations shall not be used unless special considerations are given for their use (absence of fouling, presence of damping devices, *in situ* testing, etc.).

10 Alternative to testing for F_d

As an alternative to testing to determine F_d according to Clause 8, the use of a default combination discharge capacity factor of 0,9 is permitted. The safety valve or CSPRS pressure loss calculation and the determination of the reaction force should be performed with the safety valve or CSPRS coefficient of discharge.

NOTE Calculation methods are currently under evaluation and considered for inclusion in a future edition of this part of ISO 4126.

11 Certification of combination discharge capacity factor, F_d

11.1 Test results shall be approved and a certified F_d given only if the requirements of Clause 8 are met.

11.2 The certified combination discharge capacity factor is the average of the accepted combination discharge factors. This value shall not be greater than one.

12 Application and use of the certified combination discharge capacity factor, F_d

12.1 The certified combination discharge capacity factor, F_d , shall be applied as a multiplier to the certified (discharge) capacity of the safety valve or CSPRS (see ISO 4126-1, ISO 4126-4 and ISO 4126-5).

12.2 The certified combination discharge capacity factor, F_d , shall be applied to the sizes of combination devices and the bursting pressures according to 8.5.1 and 8.5.2, as based upon the design, type or model of bursting disc safety device and safety valve or CSPRS tested in combination.

12.3 The F_d obtained from tests by the one size method is applicable to all combinations of the same design of bursting disc devices and safety valves or CSPRS in size equal to the tested combination, and for all bursting pressures greater than or equal to the set pressure of the combination.

12.4 The F_d obtained from tests by the three-size method is applicable to all sizes greater than, or equal to, the smallest size tested, and all minimum bursting pressures appropriate to the size of the combination and material of the bursting disc.

12.5 For subcritical flow conditions, only a certified F_d established by one-size method according to 8.4 a) shall be applied.

13 Marking and identification of combination devices

13.1 Bursting disc safety device

The marking of the bursting disc, bursting disc holder and ancillary components shall be in accordance with ISO 4126-2.

13.2 Safety valve

The marking of the safety valve body and the safety valve or the CSPRS identification plate shall be in accordance with ISO 4126-1, ISO 4126-4 or ISO 4126-5.

13.3 Combination

The combination shall be marked with the following:

- a) a unique reference number identifying the combination;
- b) the manufacturer's name and type reference;
- c) the number of this part of ISO 4126, i.e. "ISO 4126-3";
- d) the maximum allowable pressure limits for which the combination has been designed;
- e) the nominal size designation for the combination, as appropriate, for example, DN or NPS;
- f) the material designation of the combination;
- g) the year of manufacture of the combination.

14 Certification

The supplier of the combination shall provide a certificate for the combination including at least the following information:

- a) bursting disc safety device manufacturer's name and type reference;
- b) safety valve manufacturer's name and type reference;
- c) nominal size designation, as appropriate, for example DN or NPS;
- d) either specified maximum bursting pressure and specified minimum bursting pressure with coincident temperature, stating units, or specified bursting pressure and performance tolerance with coincident temperature, stating units;
- e) valve specified set pressure, stating units;
- f) combination discharge capacity factor, F_d , for the combination, and method of derivation;
- g) flow area of the safety valve or CSPRS in square millimetres (mm²);
- h) minimum value of the lift of the safety valve or the CSPRS in millimetres (mm) and corresponding overpressure expressed as a percentage of overpressure;
- i) safety valve or the CSPRS derated coefficient of discharge, indicating the reference fluid;
- j) number of this part of ISO 4126, i.e. "ISO 4126-3";
- k) date of supply;
- l) manufacturer's unique reference number for identifying the combination.

15 Preparation for storage and transport

The bursting disc safety device and safety valve shall be packed to prevent any damage and to ensure that their function is not impaired. Marking of packages shall be in accordance with the marking requirements of ISO 4126-1, ISO 4126-2, ISO 4126-4 or ISO 4126-5.

Annex ZA (informative)

Relationship between this International Standard and the Essential Requirements of EU Directive 97/23/EC (PED)

This European Standard has been prepared under a mandate given to CEN by the European Commission and the European Free Trade Association to provide one means of conforming to Essential Requirements of the New Approach Directive 97/23/EC, Pressure Equipment Directive (PED).

Once this standard is cited in the Official Journal of the European Communities under that Directive and has been implemented as a national standard in at least one Member State, compliance with the normative clauses of this standard given in Table ZA.1 confers, within the limits of the scope of this standard, a presumption of conformity with the corresponding Essential Requirements of that Directive and associated EFTA regulations.

**Table ZA.1 — Correspondence between this International Standard and Directive
97/23/EC (PED)**

Sub-clauses of this EN	Essential Requirements of Directive 97/23/EC (PED)	
	Essential Requirements	Annex I of PED
5, 6, 7, 8, 9, 11 and 12	Safety accessories	2.11.1 and 2.11.2
5, 9 and 12	General design	2.1
5	Design for adequate strength	2.2
5, 6 and 7	Safe operation	2.3
8.1, 8.4, 8.5 and 8.6	Performance testing	2.2.4
13	Marking and labelling	3.3

WARNING — Other requirements and other EU Directives may be applicable to the products falling within the scope of this standard.

British Standards Institution (BSI)

BSI is the independent national body responsible for preparing British Standards. It presents the UK view on standards in Europe and at the international level. It is incorporated by Royal Charter.

Revisions

British Standards are updated by amendment or revision. Users of British Standards should make sure that they possess the latest amendments or editions.

It is the constant aim of BSI to improve the quality of our products and services. We would be grateful if anyone finding an inaccuracy or ambiguity while using this British Standard would inform the Secretary of the technical committee responsible, the identity of which can be found on the inside front cover.
Tel: +44 (0)20 8996 9000 Fax: +44 (0)20 8996 7400

BSI offers members an individual updating service called PLUS which ensures that subscribers automatically receive the latest editions of standards.

Buying standards

Orders for all BSI, international and foreign standards publications should be addressed to Customer Services.

Tel: +44 (0)20 8996 9001 Fax: +44 (0)20 8996 7001

Email: orders@bsigroup.com

You may also buy directly using a debit/credit card from the BSI Shop on the Website <http://www.bsigroup.com/shop>.

In response to orders for international standards, it is BSI policy to supply the BSI implementation of those that have been published as British Standards, unless otherwise requested.

Information on standards

BSI provides a wide range of information on national, European and international standards through its Library and its Technical Help to Exporters Service. Various BSI electronic information services are also available which give details on all its products and services. Contact the Information Centre.

Tel: +44 (0)20 8996 7111 Fax: +44 (0)20 8996 7048

Email: info@bsigroup.com

Subscribing members of BSI are kept up to date with standards developments and receive substantial discounts on the purchase price of standards. For details of these and other benefits contact Membership Administration.

Tel: +44 (0)20 8996 7002 Fax: +44 (0)20 8996 7001

Email: membership@bsigroup.com

Information regarding online access to British Standards via British Standards Online can be found at <http://www.bsigroup.com/BSOL>.

Further information about BSI is available on the BSI website at <http://www.bsigroup.com>.

Copyright

Copyright subsists in all BSI publications. BSI also holds the copyright, in the UK, of the publications of the international standardization bodies. Except as permitted under the Copyright, Designs and Patents Act 1988 no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means – electronic, photocopying, recording or otherwise – without prior written permission from BSI.

This does not preclude the free use, in the course of implementing the standard, of necessary details such as symbols, and size, type or grade designations. If these details are to be used for any other purpose than implementation then the prior written permission of BSI must be obtained.

Details and advice can be obtained from the Copyright & Licensing Manager.

Tel: +44 (0)20 8996 7070 Email: copyright@bsigroup.com