

BS EN ISO 6806:2014



BSI Standards Publication

Rubber hoses and hose assemblies for use in oil burners — Specification

bsi.

...making excellence a habit.™

National foreword

This British Standard is the UK implementation of EN ISO 6806:2014. It supersedes BS EN ISO 6806:1996 which is withdrawn.

The UK participation in its preparation was entrusted to Technical Committee PRI/66, Rubber and plastics tubing, hoses and hose assemblies.

A list of organizations represented on this committee can be obtained on request to its secretary.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

© The British Standards Institution 2014. Published by BSI Standards Limited 2014

ISBN 978 0 580 82827 0

ICS 27.060.10; 83.140.40

Compliance with a British Standard cannot confer immunity from legal obligations.

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 30 September 2014.

Amendments issued since publication

Date	Text affected
------	---------------

English Version

Rubber hoses and hose assemblies for use in oil burners - Specification (ISO 6806:2014)

Tuyaux et flexibles en caoutchouc pour brûleurs -
Spécifications (ISO 6806:2014)

Gummischläuche und Schlauchleitungen für den Einsatz in
Ölbrennern - Anforderung (ISO 6806:2014)

This European Standard was approved by CEN on 7 June 2014.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

CEN-CENELEC Management Centre: Avenue Marnix 17, B-1000 Brussels

Foreword

This document (EN ISO 6806:2014) has been prepared by Technical Committee ISO/TC 45 "Rubber and rubber products" in collaboration with Technical Committee CEN/TC 218 "Rubber and plastics hoses and hose assemblies" the secretariat of which is held by BSI.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by March 2015, and conflicting national standards shall be withdrawn at the latest by March 2015.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN [and/or CENELEC] shall not be held responsible for identifying any or all such patent rights.

This document supersedes EN ISO 6806:1995.

According to the CEN-CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.

Endorsement notice

The text of ISO 6806:2014 has been approved by CEN as EN ISO 6806:2014 without any modification.

Contents

Page

Foreword	iv
1 Scope	1
2 Normative references	1
3 Construction	1
4 Dimensions and tolerances	2
4.1 Inside diameter.....	2
4.2 Bend radii.....	2
4.3 Thickness of lining and cover.....	2
5 Physical requirements for lining and cover	2
6 Physical requirements for hoses and hose assemblies	3
6.1 Hydrostatic tests.....	3
6.2 Oil swell.....	3
6.3 External pressure test.....	3
6.4 Low-temperature flexibility.....	4
6.5 Flammability.....	4
6.6 Ozone resistance (cover only).....	4
6.7 Impulse test.....	4
7 Frequency of testing	4
8 Type tests	4
9 Marking	4
Annex A (normative) Test frequency	5
Annex B (informative) Production tests	6
Annex C (normative) Determination of oil swell	7
Annex D (normative) Determination of resistance to external pressure	8
Annex E (normative) Determination of flammability	9
Annex F (normative) Pressure impulse test	11
Bibliography	12

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see www.iso.org/directives).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see www.iso.org/patents).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation on the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the WTO principles in the Technical Barriers to Trade (TBT) see the following URL: Foreword - Supplementary information

The committee responsible for this document is ISO/TC 45, *Rubber and rubber products*, Subcommittee SC 1, *Hoses (rubber and plastics)*.

This third edition cancels and replaces the second edition (ISO 6806:1992), of which it constitutes a minor revision.

The following changes (mainly editorial) were made as required to bring the standard up to date.

- [Clause 2](#) (Normative references) has been updated where necessary. Reference to ISO 4672 has been replaced by ISO 10619-2 and the new titles of ISO 1307, ISO 1436 and ISO 4671 have been quoted.
- Wherever necessary the terminology has been amended to conform to ISO 8330.
- New [Clause 7](#) (Frequency of testing) and [Clause 8](#) (Type tests) have been introduced; new [Annexes A](#) and [B](#) ([Tables A.1](#) and [B.1](#)) have been introduced to standardize the frequency of the tests already required in the previous edition (ISO 6806:1992).
- [Clause 9](#) (Marking) has been amended (maximum working pressure and date of publication of this International Standard to be marked on hose).
- No technical changes from requirements already specified in the second edition (ISO 6806:1992) have been made.

Rubber hoses and hose assemblies for use in oil burners — Specification

1 Scope

This International Standard specifies the minimum requirements for rubber hoses and hose assemblies for use in oil burners.

The following two types of hose assembly are specified.

- Type 1: Hose assemblies for flux and reflux, but not for insertion between the oil burner pump and the atomizing connection; maximum working pressure 1,0 MPa (10 bar); maximum oil temperature 100 °C.
- Type 2: Hose assemblies for insertion between the oil burner pump and the atomizing connection; working pressure 4,0 MPa (40 bar); maximum oil temperature 100 °C.

NOTE The hose assemblies specified in this International Standard are not intended to be used, without special assessment, for purposes other than oil burner installations.

2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 37, *Rubber, vulcanized or thermoplastic — Determination of tensile stress-strain properties*

ISO 48, *Rubber, vulcanized or thermoplastic — Determination of hardness (hardness between 10 IRHD and 100 IRHD)*

ISO 188, *Rubber, vulcanized or thermoplastic — Accelerated ageing and heat resistance tests*

ISO 1307, *Rubber and plastics hoses — Hose sizes, minimum and maximum inside diameters, and tolerances on cut-to-length hoses*

ISO 1402, *Rubber and plastics hoses and hose assemblies — Hydrostatic testing*

ISO 1436, *Rubber hoses and hose assemblies — Wire-braid-reinforced hydraulic types for oil-based or water-based fluids — Specification*

ISO 1817, *Rubber, vulcanized or thermoplastic — Determination of the effect of liquids*

ISO 4671, *Rubber and plastics hoses and hose assemblies — Methods of measurement of the dimensions of hoses and the lengths of hose assemblies*

ISO 7326, *Rubber and plastics hoses — Assessment of ozone resistance under static conditions*

ISO 10619-2:2011, *Rubber and plastics hoses and tubing — Measurement of flexibility and stiffness — Part 2: Bending tests at sub-ambient temperatures*

3 Construction

Hoses in accordance with this International Standard shall consist of either:

- a) an internally smooth rubber lining and an external corrosion-resistant metal braid; or

- b) an internally smooth rubber lining, a reinforcement consisting of one or more layers of textile or corrosion-resistant metal braid and a rubber outer cover.

The hoses shall be fitted with permanently attached couplings.

Both the couplings and the metal braid shall be provided with suitable corrosion protection. The metals used shall not have any deleterious effects on the rubber components.

4 Dimensions and tolerances

4.1 Inside diameter

The inside diameter of the hose shall be in accordance with the nominal dimensions and tolerances given in [Table 1](#), which is in accordance with ISO 1307.

Table 1 — Nominal size

Nominal size	Tolerance (mm)
5	±0,5
6,3 8 10 12,5 16 20	±0,75
25	±1,25

4.2 Bend radii

The hoses shall not be used at bend radii, measured at the inside of the bend, smaller than the minimum bend radii specified in [Table 2](#).

Table 2 — Minimum bend radii

Nominal size	Minimum bend radius (mm)
5	50
6,3	60
8	75
10	80
12,5	105
16	120
20	145
25	165

4.3 Thickness of lining and cover

When measured in accordance with ISO 4671, the minimum thickness of the lining and cover shall be not less than 1,7 mm and 1,3 mm, respectively.

5 Physical requirements for lining and cover

When tested in accordance with the methods of test indicated, the lining and cover shall comply with the requirements of [Table 3](#).

Table 3 — Physical requirements for lining and cover

Property	Requirement	Method of test
Tensile strength (lining and cover)	8,0 MPa	ISO 37
Elongation at break (lining and cover)	250 % min.	ISO 37
Accelerated ageing:		ISO 188
Change in tensile strength (lining and cover)	30 % max.	3 days at 100 °C ± 1 °C
Change in elongation at break (lining and cover)	35 % max.	3 days at 100 °C ± 1 °C
Oil resistance:		ISO 1817
Volume change:		$\begin{pmatrix} 72 & 0 \\ & -2 \end{pmatrix}$ h in No. 3 oil
— lining	- 5 % to + 15 %	at 70 °C ± 1 °C for type 1
— cover	- 5 % to + 60 %	at 125 °C ± 2 °C for type 2
Hardness change: ^a		
— lining	±10 IRHD	ISO 48

^a No initial hardness is specified, but a limit on hardness change after oil immersion is included to ensure that a lining with adequate oil resistance is employed.

6 Physical requirements for hoses and hose assemblies

6.1 Hydrostatic tests

6.1.1 Proof pressure test

When tested in accordance with the method specified in ISO 1402 to the proof test pressure specified in [Table 4](#), the hose assembly shall show no signs of leakage or distortion or movement of the couplings.

6.1.2 Burst pressure test

When tested in accordance with the method specified in ISO 1402, the hose assembly shall show no signs of leakage or failure before the minimum burst pressure specified in [Table 4](#) has been attained.

Table 4 — Hydrostatic pressure requirements

Parameter	Pressure requirements			
	Type 1		Type 2	
	MPa	bar	MPa	bar
Maximum design working pressure	1,0	10	4,0	40
Proof test pressure	2,0	20	8,0	80
Minimum burst pressure	4,0	40	16,0	160

6.2 Oil swell

When tested in accordance with the method specified in [Annex C](#), the reduction in the inside diameter of the hose shall not exceed 10 %.

6.3 External pressure test

When tested in accordance with the method specified in [Annex D](#), the reduction in the outside diameter of the hose shall not exceed 6 %.

6.4 Low-temperature flexibility

When tested in accordance with method B of ISO 10619-2:2011 at a temperature of $-40\text{ °C} \pm 2\text{ °C}$, the hose shall not crack and shall show no signs of leakage when subsequently proof pressure tested in accordance with [6.1](#).

6.5 Flammability

When tested in accordance with the method specified in [Annex E](#), the hose shall show no signs of leakage.

6.6 Ozone resistance (cover only)

When tested in accordance with ISO 7326, there shall be no signs of cracking.

6.7 Impulse test

When tested in accordance with the method specified in [Annex F](#), there shall be no leakage or damage after completion of 30 000 cycles.

7 Frequency of testing

The minimum frequency of testing shall conform to the schedule given in [Annex A](#).

Type tests are those tests carried out in order to verify that the hose meets all requirements of this International Standard.

Routine tests are those tests carried out on each length or finished hose.

Production tests are those tests carried out per batch (see schedule given in [Annex B](#), which is for guidance only).

8 Type tests

Type testing is carried out in order to confirm that all the materials, construction and test requirements of this International Standard have been met by the method of manufacture and hose design.

Type testing shall be repeated at least every five years or whenever a change in the method of manufacture or materials occurs.

Type testing shall be performed for all sizes, classes and types except those of same size and construction.

9 Marking

Hoses shall be marked with at least the following information, and the marking shall be repeated every 1,0 m or less:

- a) the manufacturer's mark or reference;
- b) the number and year of publication of this International Standard;
- c) the type number, e.g. type 2;
- d) the nominal size, e.g. 20;
- e) the maximum working pressure, in MPa and/or bars, including units, e.g. 4 MPa/40 bar;
- f) the quarter and year of manufacture, e.g. 2Q14.

EXAMPLE MANxxxx ISO 6806:2014 – type 2/20/4 MPa/40 bar/2Q14.

Annex A (normative)

Test frequency

[Table A.1](#) gives the frequency of testing for type tests and routine tests (see [Clauses 7](#) and [8](#) for description of these tests).

Table A.1 — Frequency of testing for type tests and routine tests

Property	Type tests	Routine tests
Compound tests		
Oil resistance test for cover	x	N/A
Oil resistance test for lining	x	N/A
Hose test		
Visual examination (inside and outside)	x	x
Measurement of inside diameter	x	x
Measurement of outside diameter	x	x
Measurement of outer cover thickness	x	N/A
Measurement of liner thickness	x	N/A
Proof pressure test	x	x
Burst test	x	N/A
Oil swell test	x	N/A
External pressure resistance test	x	N/A
Low temperature flexibility test	x	N/A
Flammability test	x	N/A
Ozone resistance test (cover only)	x	N/A
Impulse test	x	N/A
NOTE X = test carried out, N/A = not applicable.		

Annex B (informative)

Production tests

[Table B.1](#) give the suggested frequency for production tests (see [Clause 7](#)), to be carried out per batch or per 10 batches as indicated in this table.

A batch is defined as 3 000 m of hose.

Table B.1 — Recommended test frequency

Property	Production test	
	Per batch	Per 10 batches
Compound tests		
Oil resistance test for cover	N/A	N/A
Oil resistance test for lining	N/A	x
Hose test		
Visual examination (inside and outside)	x	x
Measurement of inside diameter	x	x
Measurement of outside diameter	x	x
Measurement of outer cover thickness	x	N/A
Measurement of liner thickness	x	x
Proof pressure test	x	x
Burst test	N/A	N/A
Oil swell test	N/A	x
External pressure resistance test	N/A	x
Low temperature flexibility test	N/A	x
Flammability test	N/A	x
Ozone resistance test (cover only)	N/A	x
Impulse test	N/A	x
NOTE X = test carried out, N/A = not applicable.		

Annex C (normative)

Determination of oil swell

Measure the internal diameter in accordance with ISO 4671 of a hose of length at least 500 mm. Fill the hose assembly with No. 3 oil as specified in ISO 1817 and condition it for 28 days at 100 °C with the ends sealed. At the end of this period, re-measure the internal diameter of the hose and express the result as a percentage change from the original.

Annex D (normative)

Determination of resistance to external pressure

Measure the free length, l , between the fittings of a hose assembly of length about 500 mm. Seal one end and attach the other end to a connector inside a pressure vessel. Connect the other end of the connector to a calibrated glass standpipe (see [Figure D.1](#)).

Close the pressure vessel, fill the hose assembly and standpipe with water, free from entrained air, and condition for 1 h at 70 °C. Apply a pressure of 0,06 MPa ± 0,005 MPa (0,6 bar ± 0,05 bar) within the pressure vessel and, after 5 min, read the change in the level of the meniscus, Δh , in the standpipe.

Calculate the reduction in the internal diameter of the hose assembly, expressed as a percentage, using the formula:

$$\frac{d_k^2 \times \Delta h}{d_s^2 \times l} \times 100$$

where

- d_k is the internal diameter, in millimetres, of the standpipe;
- d_s is the internal diameter, in millimetres, of the hose;
- Δh is the change in the level, in millimetres, of the meniscus;
- l is the free length, in millimetres, of the hose.

The internal diameter of the standpipe shall be selected so that the meniscus does not rise by more than 150 mm above the lowest point of the hose assembly.

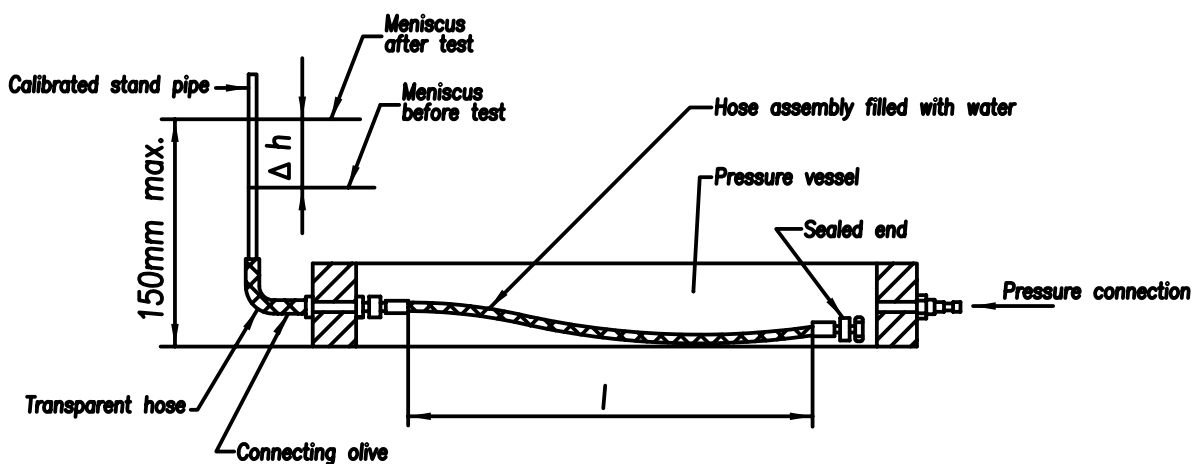


Figure D.1 — Apparatus for determination of resistance to external pressure

Annex E (normative)

Determination of flammability

Seal one end of a hose assembly of length about 1 000 mm. Fill the assembly to about 90 % of its volume with No. 3 oil as specified in ISO 1817 and connect the assembly to a water pressure standpipe. Bend the assembly as shown in [Figure E.1](#) and, using laboratory clamps, fix it in this position.

Apply internal water pressure to the assembly. The water pressure shall be 0,5 MPa (5 bar) for type 1 hose assemblies and 4,0 MPa (40 bar) for type 2 hose assemblies.

Expose the lowest bent portion of the hose assembly for 5 min to the flame of a Bunsen burner burning propane gas at a temperature of $675\text{ °C} \pm 75\text{ °C}$. The nominal inside diameter of the burner tube shall be 10 mm and the air inlet shall be closed. The pressure of the propane gas fed to the Bunsen burner shall be approximately 5 kPa (50 mbar). Use a burner tip of frustum shape to stabilize the flame.

WARNING — Attention is drawn to the potential fire hazard associated with hose failing to meet the requirements of this test. Adequate precautions shall be taken to restrict the spread of fire and to ensure the safety of personnel in the event of failure.

Dimensions in millimetres

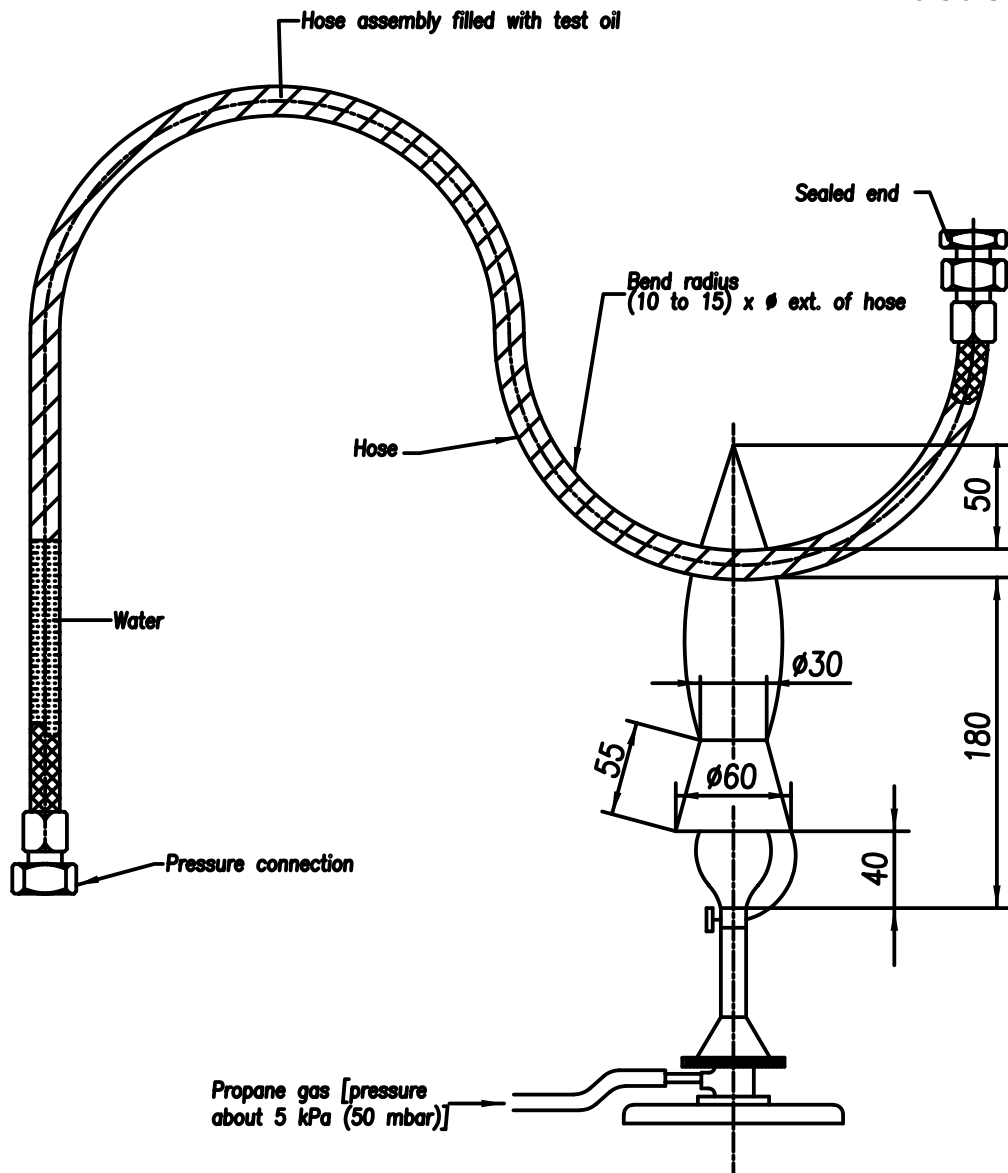


Figure E.1 — Arrangement for flammability test

Annex F (normative)

Pressure impulse test

Two hose assemblies having a length equal to 20 times the external diameter of the hose (minimum 250 mm) shall be tested. Subject each assembly to an internal pressure pulsating at a rate of $0,04 \text{ Hz} \pm 0,01 \text{ Hz}$. The pressure cycle shall be as shown in [Figure F.1](#). The test fluid shall be No. 3 oil as specified in ISO 1817 or that specified in ISO 1436. Each hose assembly shall be bent through 180° to a radius equal to eight times the external diameter of the hose and mounted in the test rig. The peak test pressure and the temperature of the test fluid shall be as specified in [Table F.1](#).

Table F.1 — Peak test pressure and fluid temperature

Test parameter	Type 1	Type 2
Peak test pressure, p	1,5 MPa (15 bar)	6,0 MPa (60 bar)
Temperature of test fluid	70 °C	125 °C

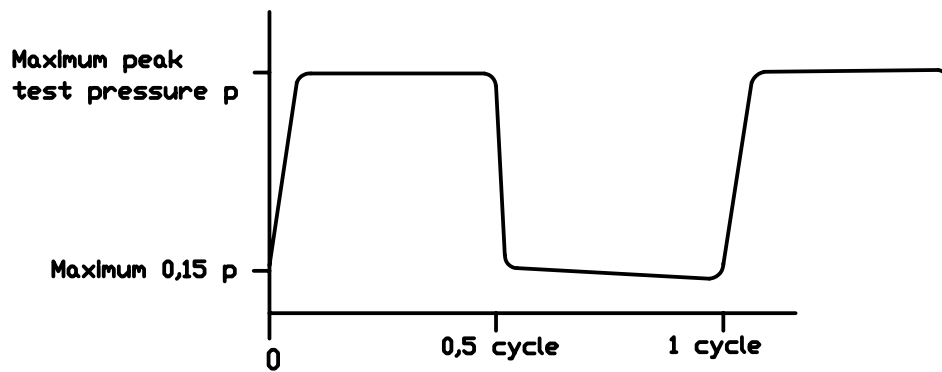


Figure F.1 — Pressure impulse cycle

Bibliography

- [1] ISO 8330, *Rubber and plastics hoses and hose assemblies — Vocabulary*

British Standards Institution (BSI)

BSI is the national body responsible for preparing British Standards and other standards-related publications, information and services.

BSI is incorporated by Royal Charter. British Standards and other standardization products are published by BSI Standards Limited.

About us

We bring together business, industry, government, consumers, innovators and others to shape their combined experience and expertise into standards-based solutions.

The knowledge embodied in our standards has been carefully assembled in a dependable format and refined through our open consultation process. Organizations of all sizes and across all sectors choose standards to help them achieve their goals.

Information on standards

We can provide you with the knowledge that your organization needs to succeed. Find out more about British Standards by visiting our website at bsigroup.com/standards or contacting our Customer Services team or Knowledge Centre.

Buying standards

You can buy and download PDF versions of BSI publications, including British and adopted European and international standards, through our website at bsigroup.com/shop, where hard copies can also be purchased.

If you need international and foreign standards from other Standards Development Organizations, hard copies can be ordered from our Customer Services team.

Subscriptions

Our range of subscription services are designed to make using standards easier for you. For further information on our subscription products go to bsigroup.com/subscriptions.

With **British Standards Online (BSOL)** you'll have instant access to over 55,000 British and adopted European and international standards from your desktop. It's available 24/7 and is refreshed daily so you'll always be up to date.

You can keep in touch with standards developments and receive substantial discounts on the purchase price of standards, both in single copy and subscription format, by becoming a **BSI Subscribing Member**.

PLUS is an updating service exclusive to BSI Subscribing Members. You will automatically receive the latest hard copy of your standards when they're revised or replaced.

To find out more about becoming a BSI Subscribing Member and the benefits of membership, please visit bsigroup.com/shop.

With a **Multi-User Network Licence (MUNL)** you are able to host standards publications on your intranet. Licences can cover as few or as many users as you wish. With updates supplied as soon as they're available, you can be sure your documentation is current. For further information, email bsmusales@bsigroup.com.

BSI Group Headquarters

389 Chiswick High Road London W4 4AL UK

Revisions

Our British Standards and other publications are updated by amendment or revision.

We continually improve the quality of our products and services to benefit your business. If you find an inaccuracy or ambiguity within a British Standard or other BSI publication please inform the Knowledge Centre.

Copyright

All the data, software and documentation set out in all British Standards and other BSI publications are the property of and copyrighted by BSI, or some person or entity that owns copyright in the information used (such as the international standardization bodies) and has formally licensed such information to BSI for commercial publication and use. Except as permitted under the Copyright, Designs and Patents Act 1988 no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means – electronic, photocopying, recording or otherwise – without prior written permission from BSI. Details and advice can be obtained from the Copyright & Licensing Department.

Useful Contacts:

Customer Services

Tel: +44 845 086 9001

Email (orders): orders@bsigroup.com

Email (enquiries): cservices@bsigroup.com

Subscriptions

Tel: +44 845 086 9001

Email: subscriptions@bsigroup.com

Knowledge Centre

Tel: +44 20 8996 7004

Email: knowledgecentre@bsigroup.com

Copyright & Licensing

Tel: +44 20 8996 7070

Email: copyright@bsigroup.com



...making excellence a habit.™