

# Ceramic tiles —

## Part 7: Determination of resistance to surface abrasion for glazed tiles

The European Standard EN ISO 10545-7:1998 has the status of a British Standard

ICS 91.100.25

This British Standard, having been prepared under the direction of the Sector Committee for Building and Civil Engineering, was published under the authority of the Standards Committee and comes into effect on 15 April 1999

© BSI 02-2000

ISBN 0 580 32225 4

**Amendments issued since publication**

Amd. No.	Date	Comments

---

# Contents

	Page
National foreword	ii
Foreword	2
Foreword	iii
Text of ISO 10545-7	1

---

# National foreword

This British Standard is the English language version of EN ISO 10545-7:1998. It is identical with ISO 10545-7:1996. It supersedes BS 6431-20:1984 which will be withdrawn when Parts 1 to 16 of BS EN ISO 10545 have all been published.

The UK participation in its preparation was entrusted to Technical Committee B/539, Ceramic tiles and other rigid tiling, which has the responsibility to:

- aid enquirers to understand the text;
- present to the responsible international/European committee any enquiries on the interpretation, or proposals for change, and keep the UK interests informed;
- monitor related international and European developments and promulgate them in the UK.

A list of organizations represented on this committee can be obtained on request to its secretary.

This part is referred to in the specification for ceramic tiles, ISO 13006, that includes requirements for all the tiles standardized in BS 6431-1 to BS 6431-9 inclusive.

The technical changes from the method described in BS 6431-20 are as follows.

The use of the dry abrasive load has been deleted. The number of revolutions to establish the classes of abrasion resistance has been changed to start at 100 for class 1 and end at > 12 000 for a new class 5. To achieve class 5, tiles also have to pass the test in BS EN ISO 10545-14 for stain resistance.

## Cross-references

The British Standards which implement international or European publications referred to in this document may be found in the BSI Standards Catalogue under the section entitled “International Standards Correspondence Index”, or by using the “Find” facility of the BSI Standards Electronic Catalogue.

## Textual errors

The textual errors set out below were discovered when the English language version of EN ISO 10545-7:1998 was adopted as the national standard. They have been reported to CEN and ISO.

clause 4, line 4, delete “stell” and substitute “steel”;

5.1, paragraph 1, line 8, delete “22,5” and substitute “25,5” and paragraph 2, delete “present” and substitute “preset”;

5.3, delete “(110 + 5)” and substitute “(110 ± 5)”;

6.6, line 3, delete “ckeck” and substitute “check”;

clause 7, paragraph 4, line 4, delete “sujected” and substitute “subjected” and paragraph 5, line 2, delete “restult” and substitute “result”;

Table 1, note 1, delete “Must” and substitute “Shall”.

A British Standard does not purport to include all the necessary provisions of a contract. Users of British Standards are responsible for their correct application.

**Compliance with a British Standard does not of itself confer immunity from legal obligations.**

## Summary of pages

This document comprises a front cover, an inside front cover, pages i and ii, the EN ISO title page, page 2, the ISO title page, pages ii to iv, pages 1 to 6, an inside back cover and a back cover.

This standard has been updated (see copyright date) and may have had amendments incorporated. This will be indicated in the amendment table on the inside front cover.

---

ICS 91.100.20

Descriptors: See ISO document

English version

## Ceramic tiles — Part 7: Determination of resistance to surface abrasion for glazed tiles

(ISO 10545-7:1996)

Carreaux et dalles céramiques —  
Partie 7: Détermination de la résistance à  
l'abrasion de surface pour les carreaux et  
dalles émaillés  
(ISO 10545-7:1996)

Keramische Fliesen und Platten —  
Teil 7: Bestimmung des Widerstandes gegen  
Oberflächenverschleiß — Glasierte Fliesen  
und Platten  
(ISO 10545-7:1996)

This European Standard was approved by CEN on 29 November 1998.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Central Secretariat or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the Central Secretariat has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and United Kingdom.

# CEN

European Committee for Standardization  
Comité Européen de Normalisation  
Europäisches Komitee für Normung

**Central Secretariat: rue de Stassart 36, B-1050 Brussels**

## Foreword

The text of the International Standard from Technical Committee ISO/TC 189 “Ceramic tile” of the International Organization for Standardization (ISO) has been taken over as an European Standard by Technical Committee CEN/TC 67 “Ceramic tiles”, the secretariat of which is held by UNI.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by June 1999, and conflicting national standards shall be withdrawn at the latest by June 1999.

Annex A of this standard is only informative.

EN ISO 10545 consists of the following parts, under the common title, “Ceramic tiles”:

- *Part 1: Sampling and basis for acceptance* (ISO 10545-1:1995);
- *Part 2: Determination of dimensions and surface quality* (ISO 10545-2:1995, including Technical Corrigendum 1:1997);
- *Part 3: Determination of water absorption, apparent porosity, apparent relative density and bulk density* (ISO 10545-3:1995, including Technical Corrigendum 1:1997);
- *Part 4: Determination of modulus of rupture and breaking strength* (ISO 10545-4:1995);
- *Part 5: Determination of impact resistance by measurement of coefficient of restitution* (ISO 10545-5:1996, including Technical Corrigendum 1:1996);
- *Part 6: Determination of resistance to deep abrasion for unglazed tiles* (ISO 10545-6:1995);
- *Part 7: Determination of resistance to surface abrasion for glazed tiles* (ISO 10545-7:1996);
- *Part 8: Determination of linear thermal expansion* (ISO 10545-8:1994);
- *Part 9: Determination of resistance to thermal shock* (ISO 10545-9:1994);
- *Part 10: Determination of moisture expansion* (ISO 10545-10:1995);
- *Part 11: Determination of crazing resistance for glazed tiles* (ISO 10545-11:1994);
- *Part 12: Determination of frost resistance* (ISO 10545-12:1995, including Technical Corrigendum 1:1997);
- *Part 13: Determination of chemical resistance* (ISO 10545-13:1995);
- *Part 14: Determination of resistance to stains* (ISO 10545-14:1995, including Technical Corrigendum 1:1997);
- *Part 15: Determination of lead and cadmium given off by glazed tiles* (ISO 10545-15:1995);

— *Part 16: Determination of small colour differences* (ISO/DIS 10545-16:1998);

— *Part 17: Determination of coefficient of friction* (ISO/DIS 10545-17:1998).

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and the United Kingdom.

## Endorsement notice

The text of the International Standard ISO 10545-7:1996 has been approved by CEN as a European Standard without any modification.

NOTE Normative references to International Standards are listed in Annex ZA (normative).

INTERNATIONAL  
STANDARD

**ISO**  
**10545-7**

First edition  
1996-12-15

---

---

**Ceramic tiles —**

**Part 7:**

Determination of resistance to surface  
abrasion for glazed tiles

*Carreaux et dalles céramiques —*

*Partie 7: Détermination de la résistance à l'abrasion de surface pour  
les carreaux et dalles émaillés*



Reference number  
ISO 10545-7:1996(E)

## Contents

	Page
Foreword	iii
1 Scope	1
2 Normative reference	1
3 Principle	1
4 Abrasive load	1
5 Apparatus	1
6 Test specimens	1
6.1 Types of test specimens	1
6.2 Number of test specimens	3
6.3 Preparation	3
7 Procedure	3
8 Classification of results	4
9 Test report	4
Annex A (informative) Calibration of the abrasion apparatus using float glass	5
A.1 Reference material	5
A.2 General	5
A.2.1 Chemical method	5
A.2.2 Ultraviolet (UV) method	5
A.2.3 Energy dispersive analysis (EDA) method	5
A.3 Procedure for calibration	5
A.3.1 General	5
A.3.2 Mass loss	5
A.3.3 Gloss change	5
Annex ZA (normative) Normative references to international publications with their relevant European publications	Inside back cover
Figure 1 — Abrasion apparatus	2
Figure 2 — Specimen holder	2
Figure 3 — Arrangement for visual assessment	3
Figure A.1 — Arrangement for the UV method	6
Table 1 — Classification of glazed ceramic tiles	4

**Descriptors:** Ceramics, floor coverings, tiles, tests, abrasion tests, determination, abrasion resistance.



## Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

International Standard ISO 10545-7 was prepared by Technical Committee ISO/TC 189, *Ceramic tile*.

ISO 10545 consists of the following parts, under the general title *Ceramic tiles*:

- *Part 1: Sampling and basis for acceptance;*
- *Part 2: Determination of dimensions and surface quality;*
- *Part 3: Determination of water absorption, apparent porosity, apparent relative density and bulk density;*
- *Part 4: Determination of modulus of rupture and breaking strength;*
- *Part 5: Determination of impact resistance by measurement of coefficient of restitution;*
- *Part 6: Determination of resistance to deep abrasion for unglazed tiles;*
- *Part 7: Determination of resistance to surface abrasion for glazed tiles;*
- *Part 8: Determination of linear thermal expansion;*
- *Part 9: Determination of resistance to thermal shock;*
- *Part 10: Determination of moisture expansion;*
- *Part 11: Determination of crazing resistance for glazed tiles;*
- *Part 12: Determination of frost resistance;*
- *Part 13: Determination of chemical resistance;*
- *Part 14: Determination of resistance to stains;*
- *Part 15: Determination of lead and cadmium given off by glazed tiles;*
- *Part 16: Determination of small colour differences;*
- *Part 17: Determination of coefficient of friction.*

Annex A of this part of ISO 10545 is for information only.



## 1 Scope

This part of ISO 10545 specifies a method for determining the resistance to surface abrasion of all glazed ceramic tiles used for floor covering.

## 2 Normative reference

The following standards contain provisions which, through reference in this text, constitute provisions of this part of ISO 10545. At the time of publication, the editions indicated were valid. All standards are subject to revision, and parties to agreements based on this part of ISO 10545 are encouraged to investigate the possibility of applying the most recent editions of the standards indicated below. Members of IEC and ISO maintain registers of currently valid International Standards.

ISO 8486-1:—, *Bonded abrasives — Grain size analysis — Designation and determination of grain size distribution — Part 1: Macrogrits F 4 to F 220<sup>1)</sup>*.

ISO 10545-14:1995, *Ceramic tiles — Part 14: Determination of resistance to stains*.

## 3 Principle

Determination of the abrasion resistance of the glaze of tiles by rotation of an abrasive load on the surface and assessment of the wear by means of visual comparison of abraded test specimens and non-abraded tiles.

## 4 Abrasive load

The total load on each test specimen shall consist of

- 70,0 g of steel balls of diameter 5 mm;
- 52,5 g of steel balls of diameter 3 mm;
- 43,75 g of steel balls of diameter 2 mm;
- 8,75 g of steel balls of diameter 1 mm;
- 3,0 g of white fused aluminium oxide of grain size F 80 according to ISO 8486;
- 20 ml of deionized or distilled water.

## 5 Apparatus

**5.1 Abrasion apparatus** (see Figure 1), consisting of a steel case with an inbuilt electrical drive connected to a horizontal supporting plate with positions for test specimens of dimensions at least 100 mm × 100 mm. The distance between the centre of the supporting plate and the centre of each position shall be 195 mm. There shall be equal distances between each adjacent position. The supporting plate shall rotate at 300 r/min with an eccentricity, *e*, of 22,5 mm so that every part of each test specimen describes a circular motion of diameter 45 mm. The test specimens are held down with the aid of metal holders which are provided with rubber seals (see Figure 2). The internal diameter of the holders is 83 mm, thus providing a test area of about 54 cm<sup>2</sup>. The thickness of the rubber is 9 mm and the height of the space under the holder is 22,5 mm.

The apparatus switches off automatically after completion of a present number of revolutions.

The supporting plate with holders and test specimens shall be covered during operation.

A suitable apparatus of another description may be used, provided it gives the same results as those obtained with the apparatus described below.

**5.2 Apparatus for visual assessment** (see Figure 3), consisting of a viewing box equipped with fluorescent lighting of colour temperature 6 000 K to 6 500 K placed vertically above the surface to be observed providing 300 lx illuminance. The dimensions of the box shall be 61 cm × 61 cm × 61 cm and the inner faces shall be painted a neutral gray. The light source is screened to avoid direct viewing.

**5.3 Drying oven**, capable of being operated at (110 + 5) °C.

**5.4 Balance** (if mass loss is required).



## 6 Test specimens

### 6.1 Types of test specimens

Test specimens shall be representative of the sample. Where tiles have different colours or decorative effects in parts of the surface, care should be taken to include all the distinctive parts.

The usual facial dimensions of test specimens are 100 mm × 100 mm. Test specimens with smaller facial dimensions shall be fastened close together on a suitable supporting material. Edge effects at the narrow joints shall be ignored.

<sup>1)</sup> To be published. (Revision of ISO 8486:1986)

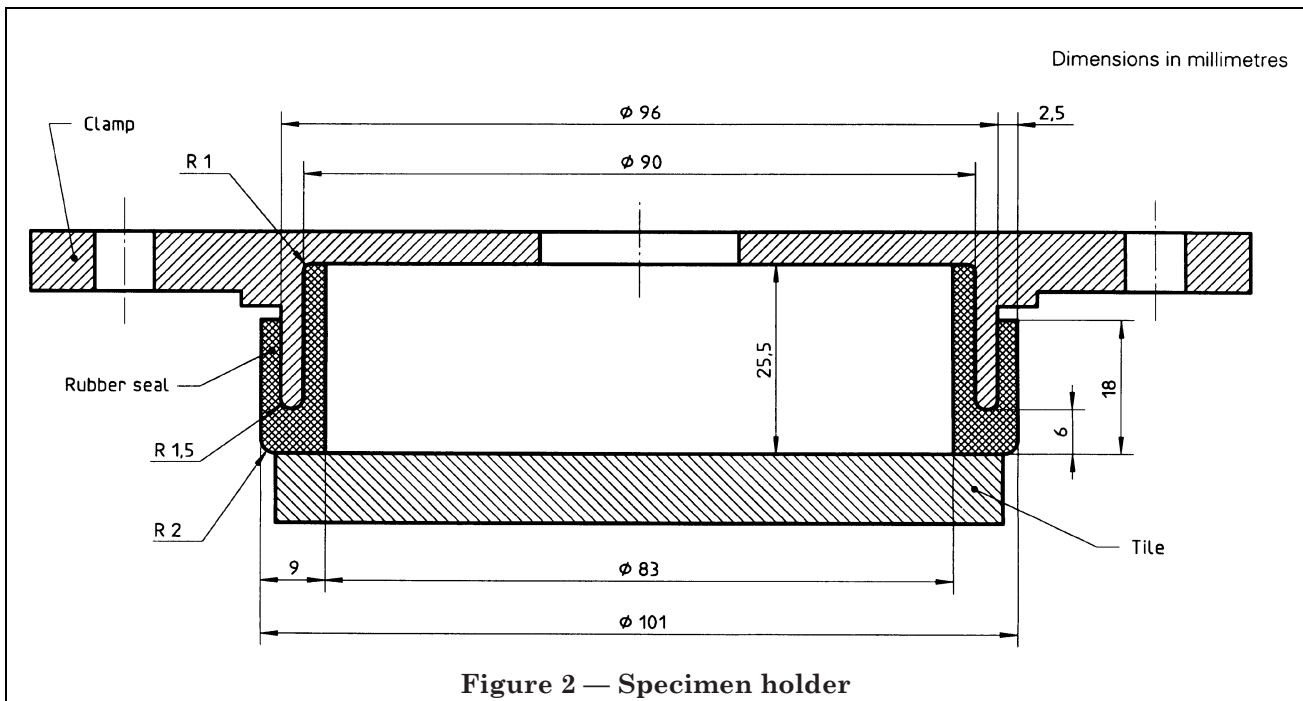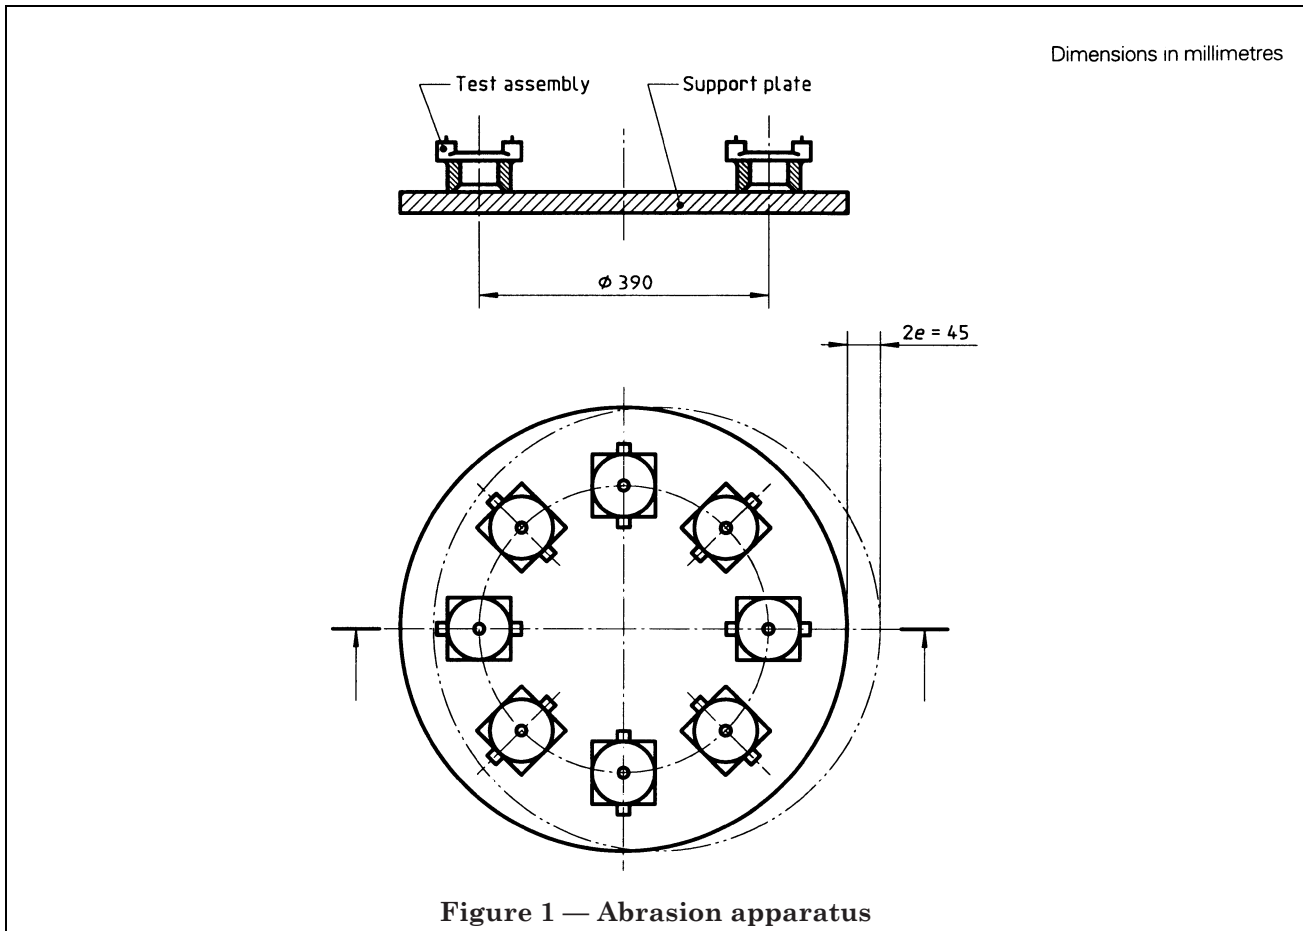

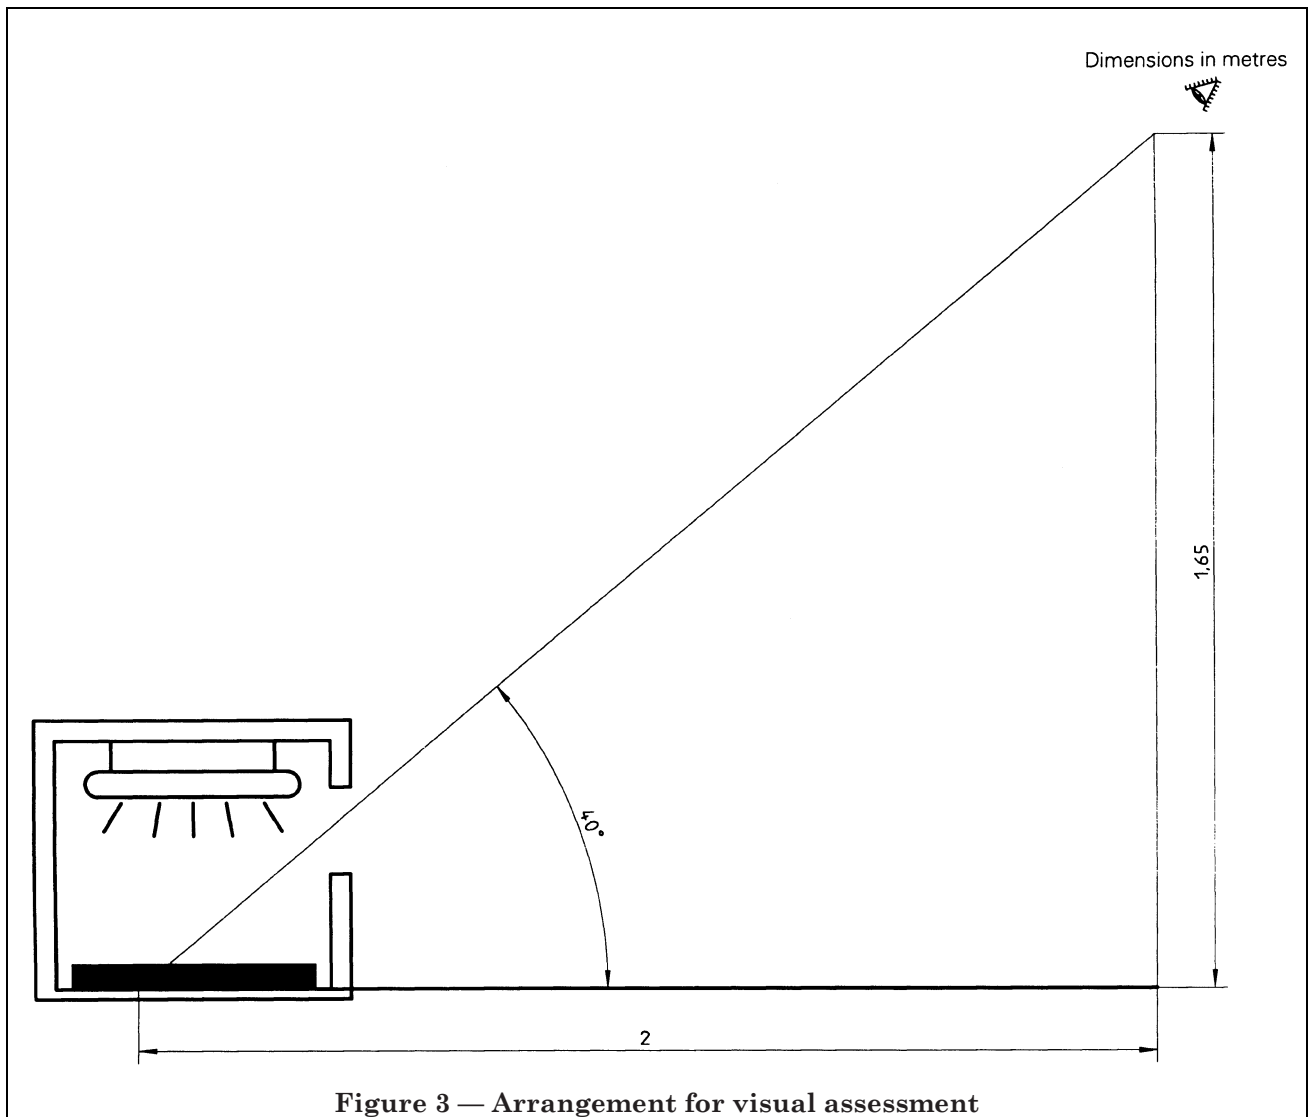


Figure 3 — Arrangement for visual assessment

### 6.2 Number of test specimens

Eleven test specimens are required. In addition, eight test specimens are required for the visual assessment.

The procedure requires one test specimen for each state of abrasion, and subsequently an additional three test specimens to check the result at the visual-failure point.

### 6.3 Preparation

The glazed surfaces of the test specimens shall be clean and dry.

## 7 Procedure

Calibration of the abrasion apparatus is only occasionally necessary or when there is a doubt regarding the validity of the results. One possible calibration method is described in Annex A.

Clamp a metal holder onto the glazed surface of each test specimen on the abrasion apparatus (5.1). Introduce the abrasive load (clause 4) into the holder through a hole in its upper surface. Then seal the hole to prevent loss from the abrasive load. The number of revolutions of the preset counter required for each abrasion stage of the test is 100, 150, 600, 750, 1 500, 2 100, 6 000, and 12 000. Remove one test specimen after each abrasion stage and continue the test until failure is observed.

After abrasion, rinse the test specimens under running water and dry in the oven (5.3) at  $(110 \pm 5)$  °C. If the test specimens are stained with iron oxide, completely remove the stain with 10 % (V/V) hydrochloric acid. Immediately rinse under running water and dry.

For the visual comparison, surround an abraded test specimen with unabraded tiles of exactly the same type in an apparatus for visual assessment under an illuminance of 300 lx. View with the naked eye (or with spectacles if usually worn) from a distance of 2 m and a height of 1,65 m in a darkened room. Note the number of revolutions at which any change in the area that has been subjected to abrasion can readily be distinguished. The consensus of at least three observers is required.

Check the result by retesting at the abrasion stage when failure is observed and at the next higher and lower abrasion stages. If the result is not the same, use the lower of the two abrasion stages to decide upon the classification.

Then test the abraded area of the tile which has passed the 12 000 revolutions stage for stain resistance in accordance with ISO 10545-14.

After use, clean the steel balls with water followed by methylated spirits and then thoroughly dry to prevent rusting. Before each test, screen the steel balls in the abrasive load into specified size categories (see clause 4) and replace any mass in each size category.

If there is an agreement to determine the mass lost from a surface during abrasion testing, obtain this by measuring the dry mass of three test specimens before the test and after 6 000 revolutions. Upon agreement, subsequently test abraded tiles which have passed the 1 500, 2 100 and 6 000 revolutions stages for stain resistance in accordance with ISO 10545-14 at the abrasion stage at which visual failure occurred. Other relevant properties may be determined by agreement during the execution of the test procedure, for instance change of colour or gloss. The additional information which is obtained by agreement shall not be used to classify tiles.

## 8 Classification of results

The test specimens shall be classified according to Table 1. In order to be classified as Class 5, the tile shall also pass the test specified in ISO 10545-14 for resistance to stains on the abraded area. However, the following modifications to ISO 10545-14 will apply:

- 1) only one abraded tile (> 12 000 revolutions) may be used, provided care is taken to ensure separation of the stains (for example cutting the abraded tile prior to testing the resistance to stains);
- 2) cleaning procedure D specified in ISO 10545-14 shall be used without first employing procedures A, B and C.

If there is no visual failure after 12 000 revolutions but if stains cannot be removed by any of the procedures (A, B, C or D) specified in ISO 10545-14, the tile shall be of Class 4.

**Table 1 — Classification of glazed ceramic tiles**

Abrasion stage; Failure visible at revolutions	Class
100	0
150	1
600	2
750, 1 500	3
2 100, 6 000, 12 000	4
> 12 000 <sup>a</sup>	5

<sup>a</sup> Must pass the test specified in ISO 10545-14 for resistance to stains.

## 9 Test report

The test report shall include the following information:

- a) reference to this part of ISO 10545;
- b) a description of the tiles, including means of preparing the test specimens;
- c) the classification according to clause 8;
- d) the abrasion stage at which visual failure occurred;
- e) by agreement, class of stain resistance for tiles of abrasion Class 4;
- f) mass loss, colour change, gloss change or other properties measured by agreement.

## Annex A (informative)

### Calibration of the abrasion apparatus using float glass

#### A.1 Reference material

The reference material shall be float glass with a minimum thickness of 6 mm.

Information about suitable reference materials may be obtained from national standards institutions.

#### A.2 General

As the calibration test is carried out on the float-bath side, this has first to be identified.

One of the following methods can be used.

##### A.2.1 Chemical method

###### A.2.1.1 Reagents

###### A.2.1.1.1 Etching solution

Thoroughly mix 10 volumes of concentrated hydrochloric acid, 8 volumes of concentrated hydrofluoric acid [40 % (V/V)] and 10 volumes of distilled water.

**A.2.1.1.2 Cacotheline solution**, 0,1 % (V/V) cacotheline in distilled water.

###### A.2.1.2 Procedure

Place 2 or 3 drops of the etching solution on the glass surface followed by 1 or 2 drops of the cacotheline solution.

In 5 s to 10 s, a purple colour will be seen on the float-bath side; otherwise, the solution will remain yellow.

##### A.2.2 Ultraviolet (UV) method

View the glass surface in a dark room when illuminated by ultraviolet light as shown in Figure A.1. The float-bath side exhibits a slight fluorescence.

**CAUTION — Ultraviolet light in the region 254 nm to 365 nm will damage the eyes and suitable protective UV-filter goggles must be worn.**

##### A.2.3 Energy dispersive analysis (EDA) method

Examine the glass surfaces by energy dispersive analysis. The float-bath side is identified by its tin content.

#### A.3 Procedure for calibration

##### A.3.1 General

The abrasion apparatus is calibrated by measuring either the loss in mass (see A.3.2), or the change in gloss (see A.3.3). Eight float glass specimens of size 100 mm × 100 mm are abraded on the float-bath side using the abrasive load (clause 4).

##### A.3.2 Mass loss

Dry the test specimens in the drying oven (5.3) maintained at  $(110 \pm 5)^\circ\text{C}$  and measure the mass of each. Abrade the specimens for 6 000 revolutions. Rinse and then dry the specimens again at  $(110 \pm 5)^\circ\text{C}$ . Determine the loss in mass of each specimen and calculate the mean loss. Measure the abraded area of each specimen.


The abrasion apparatus is satisfactory if the mean loss in mass is  $(0,032 \pm 0,002)$  mg per square millimetre of the abraded area.

##### A.3.3 Gloss change

Measure the  $60^\circ$  specular gloss on the float-bath side at the centre of each test specimen backed by a matt black surface, for example black velvet. Abrade the specimens for 1 000 revolutions. Rinse and then dry the specimens and remeasure the  $60^\circ$  specular gloss. Calculate the percentage loss in gloss for each specimen and the mean loss in gloss.

The abrasion apparatus is satisfactory if the mean loss in gloss at the centre of the abraded area is  $(50 \pm 5) \%$ .

NOTE If any difficulty is experienced in obtaining stable initial gloss values, the specimens may first be cleaned by immersion in water containing a trace of detergent for at least 1 h at  $(75 \pm 5)^\circ\text{C}$  followed by rinsing with warm water.

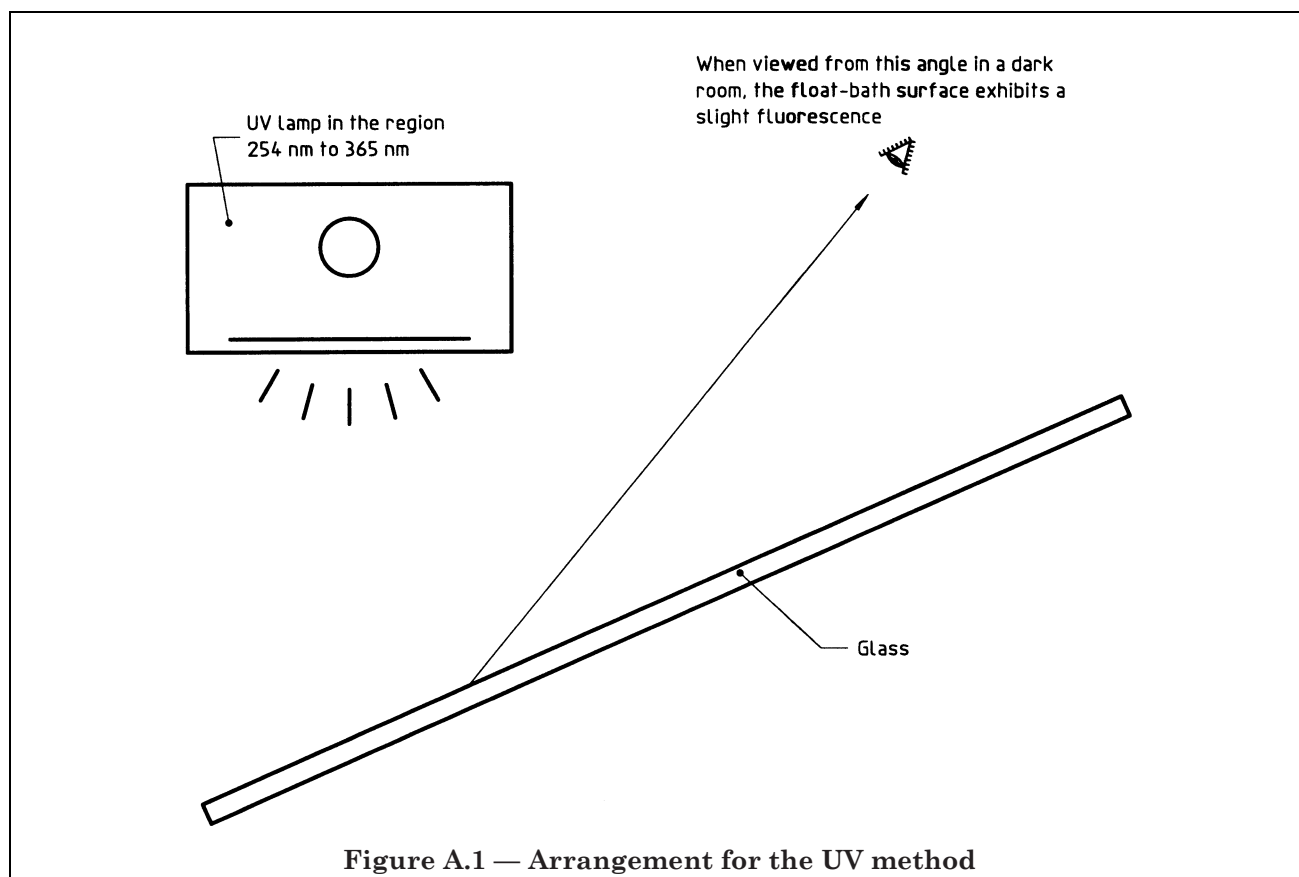



**Annex ZA (normative)****Normative references to international publications with their relevant European publications**

This European Standard incorporates by dated or undated reference, provisions from other publications. These normative references are cited at the appropriate places in the text and the publications are listed hereafter. For dated references, subsequent amendments to or revisions of any of these publications apply to this European Standard only when incorporated in it by amendment or revision. For undated references the latest edition of the publication referred to applies.

Publication	Year	Title	EN	Year
ISO 10545-14	1995	<i>Ceramic tiles — Part 14: Determination of resistance to stains</i> (including Technical Corrigendum 1:1997)	EN ISO 10545-14	1997

---

---

## BSI — British Standards Institution

BSI is the independent national body responsible for preparing British Standards. It presents the UK view on standards in Europe and at the international level. It is incorporated by Royal Charter.

### Revisions

British Standards are updated by amendment or revision. Users of British Standards should make sure that they possess the latest amendments or editions.

It is the constant aim of BSI to improve the quality of our products and services. We would be grateful if anyone finding an inaccuracy or ambiguity while using this British Standard would inform the Secretary of the technical committee responsible, the identity of which can be found on the inside front cover. Tel: 020 8996 9000. Fax: 020 8996 7400.

BSI offers members an individual updating service called PLUS which ensures that subscribers automatically receive the latest editions of standards.

### Buying standards

Orders for all BSI, international and foreign standards publications should be addressed to Customer Services. Tel: 020 8996 9001. Fax: 020 8996 7001.

In response to orders for international standards, it is BSI policy to supply the BSI implementation of those that have been published as British Standards, unless otherwise requested.

### Information on standards

BSI provides a wide range of information on national, European and international standards through its Library and its Technical Help to Exporters Service. Various BSI electronic information services are also available which give details on all its products and services. Contact the Information Centre. Tel: 020 8996 7111. Fax: 020 8996 7048.

Subscribing members of BSI are kept up to date with standards developments and receive substantial discounts on the purchase price of standards. For details of these and other benefits contact Membership Administration. Tel: 020 8996 7002. Fax: 020 8996 7001.

### Copyright

Copyright subsists in all BSI publications. BSI also holds the copyright, in the UK, of the publications of the international standardization bodies. Except as permitted under the Copyright, Designs and Patents Act 1988 no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means – electronic, photocopying, recording or otherwise – without prior written permission from BSI.

This does not preclude the free use, in the course of implementing the standard, of necessary details such as symbols, and size, type or grade designations. If these details are to be used for any other purpose than implementation then the prior written permission of BSI must be obtained.

If permission is granted, the terms may include royalty payments or a licensing agreement. Details and advice can be obtained from the Copyright Manager. Tel: 020 8996 7070.