

BS EN ISO 15876-2:2017



BSI Standards Publication

Plastics piping systems for hot and cold water installations — Polybutene (PB)

Part 2: Pipes (ISO 15876-2:2017)

National foreword

This British Standard is the UK implementation of EN ISO 15876-2:2017. It supersedes BS EN ISO 15876-2:2003 which is withdrawn.

The UK participation in its preparation was entrusted to Technical Committee PRI/88/2, Plastics piping for pressure applications.

A list of organizations represented on this committee can be obtained on request to its secretary.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

© The British Standards Institution 2017.
Published by BSI Standards Limited 2017

ISBN 978 0 580 90296 3

ICS 23.040.20; 91.140.60

Compliance with a British Standard cannot confer immunity from legal obligations.

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 28 February 2017.

Amendments/corrigenda issued since publication

Date	Text affected
------	---------------

EUROPEAN STANDARD

EN ISO 15876-2

NORME EUROPÉENNE

EUROPÄISCHE NORM

February 2017

ICS 23.040.20; 91.140.60

Supersedes EN ISO 15876-2:2003

English Version

Plastics piping systems for hot and cold water installations - Polybutene (PB) - Part 2: Pipes (ISO 15876-2:2017)

Systèmes de canalisations en plastique pour les
installations d'eau chaude et froide - Polybutène (PB) -
Partie 2: Tubes (ISO 15876-2:2017)

Kunststoff-Rohrleitungssysteme für die Warm- und
Kaltwasserinstallation - Polybuten (PB) - Teil 2: Rohre
(ISO 15876-2:2017)

This European Standard was approved by CEN on 24 December 2016.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

CEN-CENELEC Management Centre: Avenue Marnix 17, B-1000 Brussels

European foreword

This document (EN ISO 15876-2:2017) has been prepared by Technical Committee CEN/TC 155 “Plastics piping systems and ducting systems” the secretariat of which is held by NEN, in collaboration with Technical Committee ISO/TC 138 “Plastics pipes, fittings and valves for the transport of fluids”.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by August 2017, and conflicting national standards shall be withdrawn at the latest by August 2017.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN [and/or CENELEC] shall not be held responsible for identifying any or all such patent rights.

This document supersedes EN ISO 15876-2:2003.

According to the CEN-CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.

Endorsement notice

The text of ISO 15876-2:2017 has been approved by CEN as EN ISO 15876-2:2017 without any modification.

Contents

	Page
Foreword	iv
Introduction	v
1 Scope	1
2 Normative references	1
3 Terms and definitions, symbols and abbreviated terms	2
4 Pipe material	2
4.1 General.....	2
4.2 Evaluation of σ_{LPL} -curves.....	2
4.3 Influence on water intended for human consumption.....	5
5 General characteristics	6
5.1 Appearance.....	6
5.2 Opacity.....	6
6 Geometrical characteristics	6
6.1 General.....	6
6.2 Dimensions of pipes.....	7
6.2.1 Outside diameters.....	7
6.2.2 Wall thicknesses and their tolerances.....	7
7 Mechanical characteristics	10
8 Physical and chemical characteristics	10
9 Performance requirements	11
10 Marking	11
10.1 General requirements.....	11
10.2 Minimum required marking.....	12
Annex A (normative) Derivation of $S_{calc,max}$	13
Bibliography	16

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see www.iso.org/directives).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see www.iso.org/patents).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation on the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the World Trade Organization (WTO) principles in the Technical Barriers to Trade (TBT) see the following URL: www.iso.org/iso/foreword.html.

ISO 15876-2 was prepared by the European Committee Standardization (CEN) Technical Committee CEN/TC 155, *Plastics piping systems and ducting systems*, in collaboration with ISO Technical Committee ISO/TC 138, *Plastics pipes, fittings and valves for the transport of fluids*, Subcommittee SC 2, *Plastics pipes and fittings for water supplies*, in accordance with the Agreement on technical cooperation between ISO and CEN (Vienna Agreement).

This second edition cancels and replaces the first edition (ISO 15876-2:2003), which has been technically revised with the following changes:

- introduction of polybutene random copolymer (PB-R) and renaming existing polybutene (PB) into polybutene homopolymer (PB-H);
- revision of specifications for conditioning of samples.

It also incorporates the Amendment ISO 15876-2:2003/Amd 1:2007.

A list of all parts in the ISO 15876 series can be found on the ISO website.

Introduction

The System Standard ISO 15876, of which this document is Part 2, specifies the requirements for a piping system when made from polybutene (PB). The piping system is intended to be used for hot and cold water installations.

In respect of potential adverse effects on the quality of water intended for human consumption, caused by the product covered by ISO 15876 (all parts):

- ISO 15876 (all parts) provides no information as to whether the product may be used without restriction in any of the Member States of the EU or EFTA;
- it should be noted that, while awaiting the adoption of verifiable European criteria, existing national regulations concerning the use and/or the characteristics of this product remain in force.

Requirements and test methods for material and components, other than pipes, are specified in ISO 15876-1 and ISO 15876-3. Characteristics for fitness for purpose (mainly for joints) are covered in ISO 15876-5. ISO/TS 15876-7 gives guidance for the assessment of conformity.

This document specifies the characteristics of pipes.

At the date of publication of this standard, System Standards for piping systems of other plastics materials used for the same application include ISO 15874, ISO 15875, ISO 15876, ISO 15877, ISO 21003 and ISO 22391.

Plastics piping systems for hot and cold water installations — Polybutene (PB) —

Part 2: Pipes

1 Scope

This document specifies the characteristics of pipes for polybutene-1 (PB-1) piping systems intended to be used for hot and cold water installations within buildings for the conveyance of water whether or not intended for human consumption (domestic systems), and for heating systems, under design pressures and temperatures appropriate to the class of application (see ISO 15876-1).

The designation polybutene is used together with the abbreviation PB throughout this document.

This document covers a range of service conditions (application classes), design pressures and pipe dimension classes. For values of T_D , T_{max} and T_{mal} in excess of those in ISO 15876-1, this document does not apply.

NOTE 1 It is the responsibility of the purchaser or specifier to make the appropriate selections from these aspects, taking into account their particular requirements and any relevant national regulations and installation practices or codes.

It also specifies the test parameters for the test methods referred to in this document.

In conjunction with the other parts of ISO 15876, this document is applicable to PB pipes, their joints and to joints with components of PB, other plastics and non-plastics materials intended to be used for hot and cold water installations.

It is applicable to pipes with or without (a) barrier layer(s).

NOTE 2 In the case of plastics pipes provided with a thin barrier layer, e.g. to prevent or greatly diminish the diffusion of gases and the transmission of light into or through the pipe wall, the design stress requirements are totally met by the base polymer (PB).

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 1133-1, *Plastics — Determination of the melt mass-flow rate (MFR) and melt volume-flow rate (MVR) of thermoplastics — Part 1: Standard method*

ISO 1167-1, *Thermoplastics pipes, fittings and assemblies for the conveyance of fluids — Determination of the resistance to internal pressure — Part 1: General method*

ISO 1167-2, *Thermoplastics pipes, fittings and assemblies for the conveyance of fluids — Determination of the resistance to internal pressure — Part 2: Preparation of pipe test pieces*

ISO 2505, *Thermoplastics pipes — Longitudinal reversion — Test method and parameters*

ISO 3126, *Plastics piping systems — Plastics components — Determination of dimensions*

ISO 7686, *Plastics pipes and fittings — Determination of opacity*

ISO 9080, *Plastics piping and ducting systems — Determination of the long-term hydrostatic strength of thermoplastics materials in pipe form by extrapolation*

ISO 15876-1:2003, *Plastics piping systems for hot and cold water installations — Polybutene (PB) — Part 1: General*

ISO 15876-3, *Plastics piping systems for hot and cold water installations — Polybutene (PB) — Part 3: Fittings*

ISO 15876-5, *Plastics piping systems for hot and cold water installations — Polybutene (PB) — Part 5: Fitness for purpose of the system*

3 Terms and definitions, symbols and abbreviated terms

For the purposes of this document, the terms and definitions, symbols and abbreviated terms given in ISO 15876-1 apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <http://www.iso.org/obp>

4 Pipe material

4.1 General

The pipe material from which the pipe is made shall comply with ISO 15876-1.

After extrusion or moulding, PB undergoes a crystalline phase transition (usually called ageing) before it develops its final properties. The minimum required transition time depends on temperature and product characteristics. The same final material performance is obtained once completion of crystalline phase transition is achieved, irrespective of transition conditions. For quality control purposes, therefore, test specimens shall be taken immediately after processing and be conditioned in accordance with recommendations obtained from the compound supplier prior to testing.

The crystalline phase transition is dependent on time and temperature. For guidance a minimum time of five days for PB-H and one day for PB-R should be allowed at 23 °C, unless accelerated ageing is performed.

NOTE The crystalline phase transition can be considerably accelerated upon applying higher hydrostatic pressure of approx. 1 kbar to 2 kbar. Accelerated ageing at higher pressure can be accepted if test results can be proven reproducible and equal to those obtained at atmospheric pressure.

Because of the slow crystallization, transformation and shrinkage which takes places after PB-H and PB-R plastics are cooled from the melt, physical testing should be delayed after extrusion or moulding until this morphological transition is complete.

4.2 Evaluation of σ_{LPL} -curves

The pipe material shall be evaluated in accordance with ISO 9080 or equivalent where internal pressure tests are made in accordance with ISO 1167-1 and ISO 1167-2 to find the σ_{LPL} -values. The σ_{LPL} -value thus determined shall at least be as high as the corresponding values of the reference curves given in [Figure 1](#) or [Figure 2](#).

NOTE One equivalent way of evaluation is to calculate the σ_{LPL} -value for each temperature (e.g. 20 °C, 60 °C to 70 °C and 95 °C) individually.

The reference curves in [Figure 1](#) in the temperature range of 10 °C to 110 °C for PB-H and in [Figure 2](#) in the temperature range of 10 °C to 95 °C for PB-R are derived from the following formulae:

First branch (i.e. the left-hand portion of the lines as shown in [Figure 1](#) and [Figure 2](#))

for PB-H:

$$\log t = -430,866 - \frac{125\,010 \cdot \lg \sigma}{T} + \frac{173\,892,7}{T} + 290,0569 \cdot \log \sigma \quad (1)$$

for PB-R:

$$\log t = -367,8019 - \frac{104\,096,6 \cdot \lg \sigma}{T} + \frac{145\,940,231}{T} + 245,536 \cdot \log \sigma \quad (2)$$

Second branch (i. e. the right-hand portion of the lines as shown in [Figure 1](#))

for PB-H:


$$\log t = -129,895 - \frac{37\,262,7 \cdot \lg \sigma}{T} + \frac{52\,556,48}{T} + 88,56735 \cdot \log \sigma \quad (3)$$

To demonstrate conformance to the reference lines, pipe samples shall be tested at following temperatures and at various hoop stresses such that, at each of the temperatures given, at least three failure times fall in each of the following time intervals:

- temperatures 20 °C; 60 °C to 70 °C; 95 °C;
- time intervals 10 h to 100 h, 100 h to 1 000 h, 1 000 h to 8 760 h and above 8 760 h.

In tests lasting more than 8 760 h, once failure is reached at a stress and time at least on or above the reference line, any time after that may be considered as the failure time. Testing should be carried out in accordance with ISO 1167-1 and ISO 1167-2.


Conformance with the reference lines should be demonstrated by plotting the individual experimental results on the graph. At least 97,5 % of them should lie on or above the reference line.

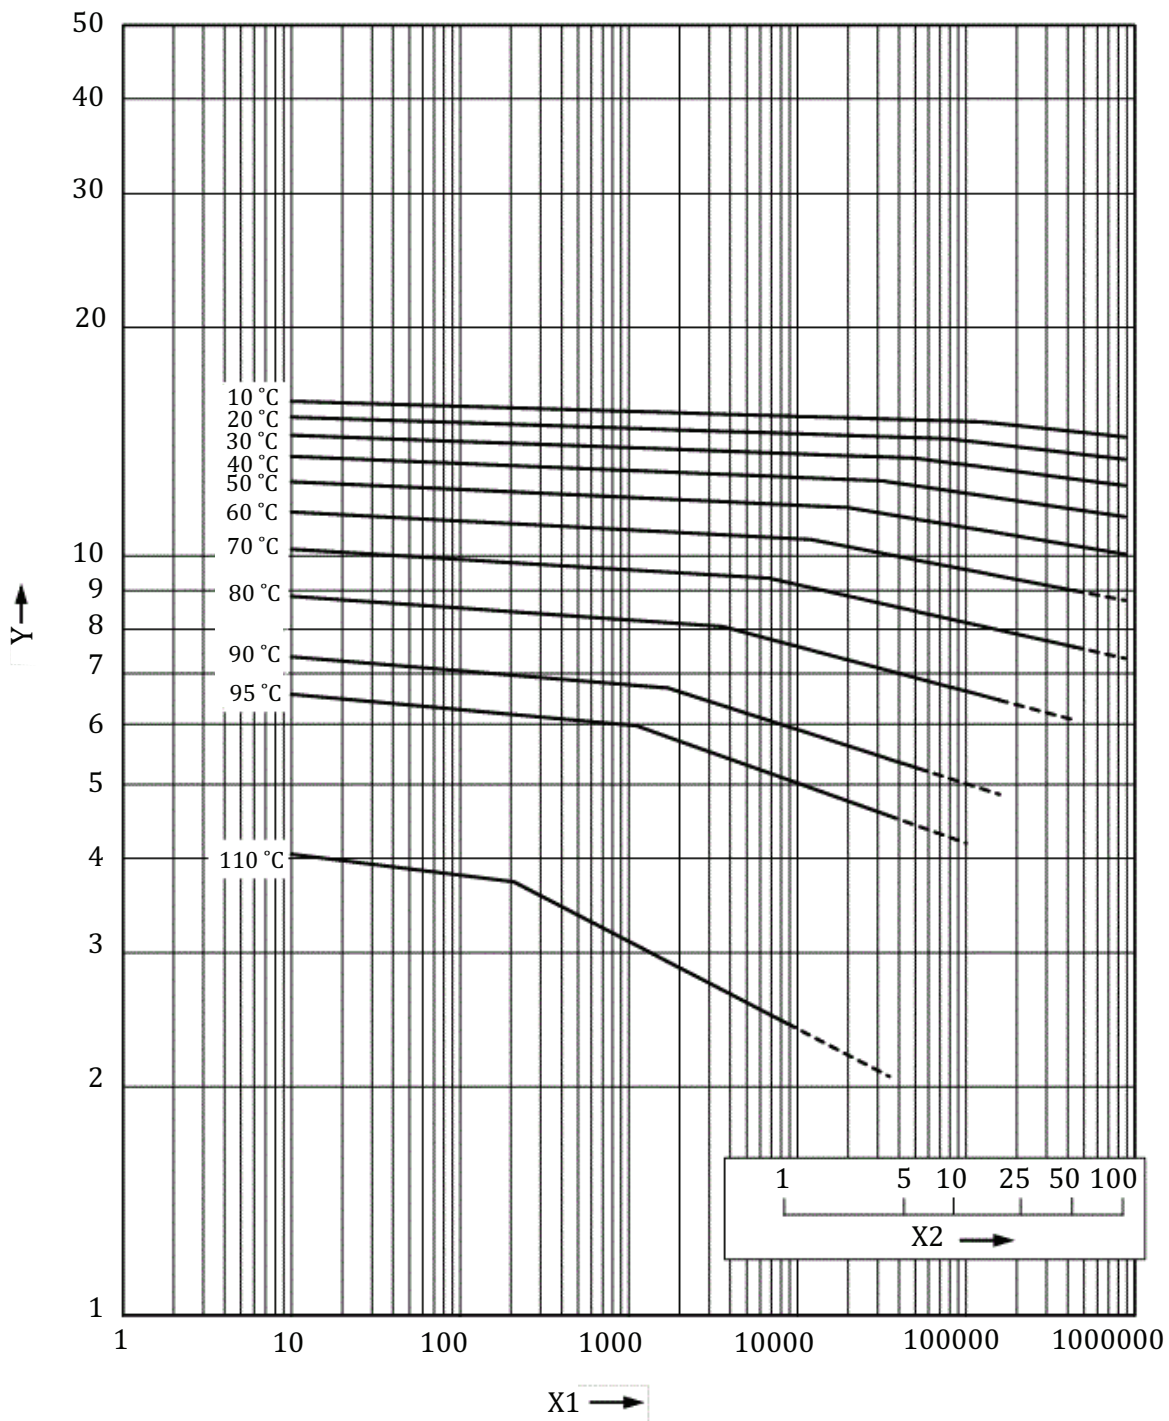

Key

- X1 time, t_1 , to fracture, in hours
- X2 time, t_2 , to fracture, in years
- Y hoop stress, σ , in megapascal

Figure 1 — Reference curves for expected strength of polybutene homopolymer (PB-H)

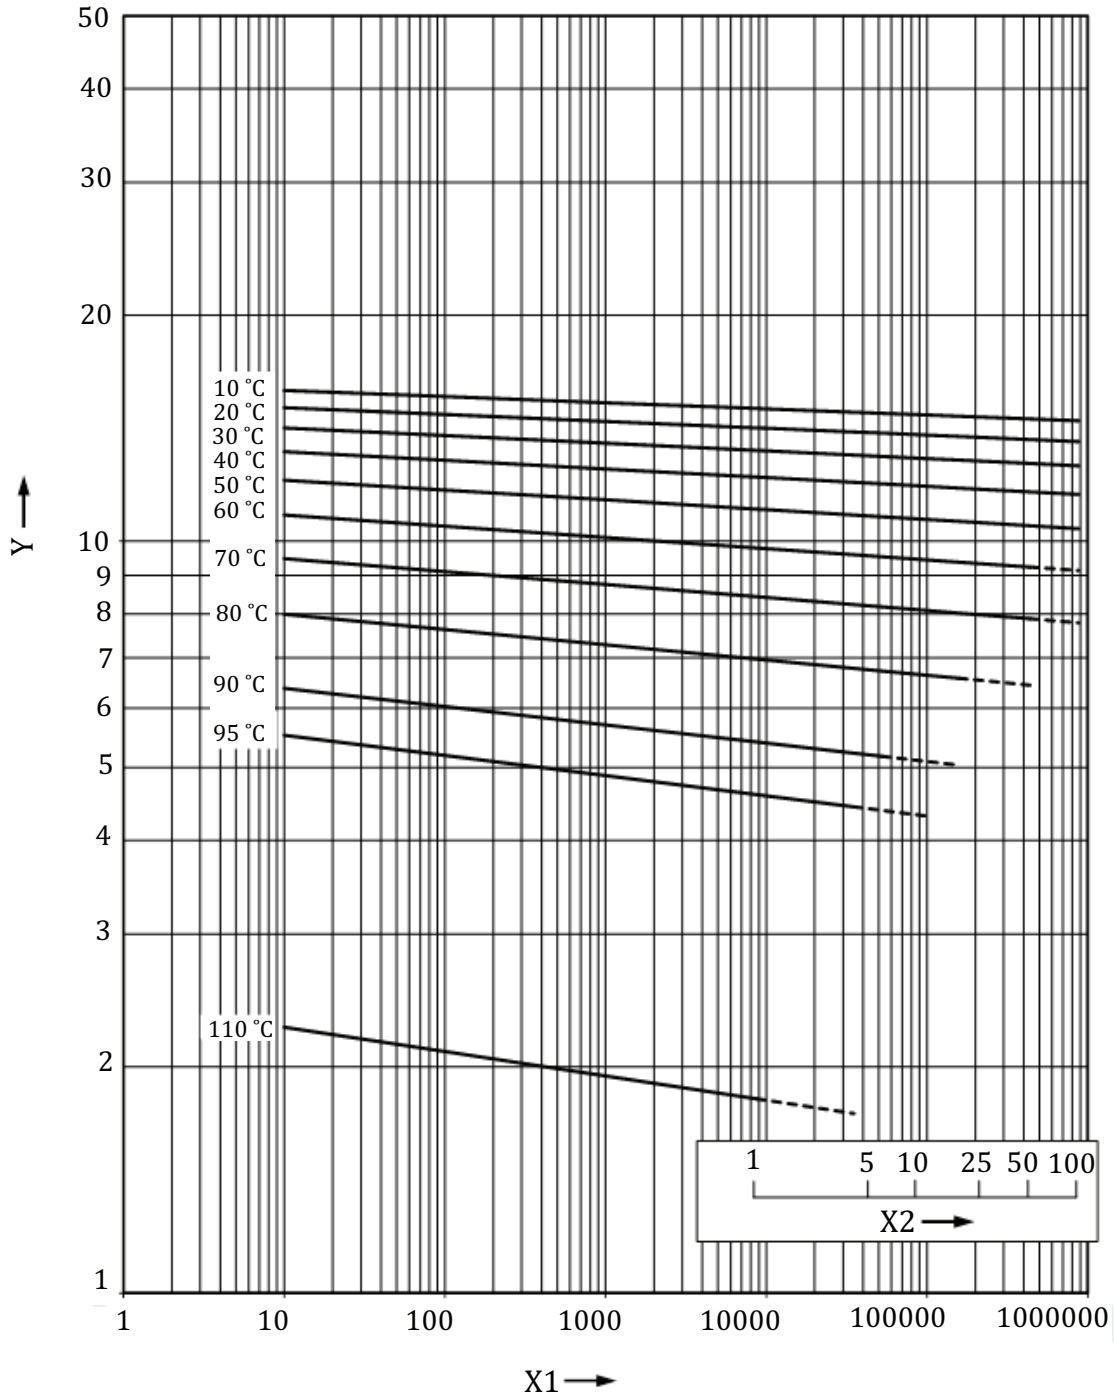

Key

- X1 time, t_1 , to fracture, in hours
- X2 time, t_2 , to fracture, in years
- Y hoop stress, σ , in megapascal

Figure 2 — Reference curves for expected strength of polybutene random copolymer (PB-R)

4.3 Influence on water intended for human consumption

The material shall conform to ISO 15876-1.

5 General characteristics

5.1 Appearance

When viewed without magnification, the internal and external surfaces of pipes shall be smooth, clean and free from scoring, cavities, and other surface defects to an extent that would prevent conformity to this document. The material shall not contain visible impurities. Slight variations in the appearance of the colour shall be permitted. The ends of the pipe shall be cut cleanly and square to the axis of the pipe.

5.2 Opacity

Polybutene pipes that are declared to be opaque shall not transmit more than 0,2 % of visible light, when tested in accordance with ISO 7686.

6 Geometrical characteristics

6.1 General

Dimensions shall be measured in accordance with ISO 3126.

The maximum calculated pipe value, $S_{\text{calc,max}}$, for the applicable class of service condition and design pressure, p_D , is given in [Table 1](#) and [Table 2](#) for PB-H and PB-R, respectively.

Table 1 — $S_{\text{calc,max}}$ -values for PB-H

Design pressure p_D bar	Application			
	Class 1	Class 2	Class 4	Class 5
	$S_{\text{calc,max}}$ -values ^a			
4	10,9 ^b	10,9 ^b	10,9 ^b	10,9 ^b
6	9,5	8,4	9,1	7,2
8	7,1	6,3	6,8	5,4
10	5,7	5,0	5,4	4,3
^a The values are rounded down to the first place of decimals. ^b The 20 °C, 10 bar, 50 years, cold water requirement, being higher, determines this value (see ISO 15876-1).				

Table 2 — $S_{\text{calc,max}}$ -values for PB-R

Design pressure p_D bar	Application			
	Class 1	Class 2	Class 4	Class 5
	$S_{\text{calc,max}}$ -values ^a			
4	10,9 ^b	10,9 ^b	10,8	10,3
6	8,6	8,5	7,2	6,8
8	6,4	6,4	5,4	5,1
10	5,1	5,0	4,3	4,1

^a The values are rounded down to the first place of decimals.
^b The 20 °C, 10 bar, 50 years, cold water requirement, being higher, determines this value (see ISO 15876-1).

NOTE The derivation of $S_{\text{calc,max}}$ is provided in [Annex A](#). The method described takes account of the properties of PB under the service conditions of different classes given in ISO 15876-1.

The values of outside diameter and/or wall thickness apply to the polybutene pipe and are exclusive of additional outside layers. For pipes with barrier layers, the values of outside diameter and wall thickness may apply to the finished product, including the barrier layer, provided that the thickness of the outside barrier layer, including any adhesive layer, is $\leq 0,4$ mm and the design calculation using the values of outside diameter and wall thickness of base pipe (PB) meet the $S_{\text{calc,max}}$ values according to [Table 1](#) or [Table 2](#).

The manufacturer shall state the dimensions and tolerances of the base pipe in his documentation when different from [Tables 3](#) to [7](#).

Pipes with non-circular cross section are permitted if they conform to the requirements of this document.

6.2 Dimensions of pipes

6.2.1 Outside diameters

For the applicable pipe dimension class, the mean outside diameter, d_{em} , of a pipe shall conform to [Table 3](#), [Table 4](#), [Table 5](#) or [Table 6](#), as applicable.

6.2.2 Wall thicknesses and their tolerances

For any particular class of service condition, design pressure and nominal size, the minimum wall thickness, e_{min} , shall be chosen in such a way that the corresponding S series or S_{calc} -value is equal to or less than the values of $S_{\text{calc,max}}$ given in [Table 1](#) or [Table 2](#), respectively.

For the applicable pipe dimension class, the wall thickness of the base pipe or finished pipe (see [6.1](#)), shall conform to [Table 3](#), [Table 4](#), [Table 5](#) or [Table 6](#), as applicable, in relation to the pipe series S and S_{calc} -values, respectively. However, pipes intended to be joined together by fusion shall have a minimum wall thickness of 1,9 mm.

The tolerance on the wall thickness, e , shall conform to [Table 7](#).

Table 3 — Pipe dimensions for dimension class A (sizes conform to ISO 4065 and are applicable for all classes of service conditions)

Dimensions in millimetres

Nominal size DN/OD	Nominal outside diameter d_n	Mean outside diameter $d_{em,min}$ $d_{em,max}$		Pipe series					
				S 10	S 8	S 6,3	S 5	S 4	S 3,2
				Wall thicknesses e_{min} and e_n					
12	12	12,0	12,3	1,3 ^a	1,3 ^a	1,3 ^a	1,3 ^a	1,4	1,7
16	16	16,0	16,3	1,3	1,3	1,3	1,5	1,8	2,2
20	20	20,0	20,3	1,3	1,3	1,5	1,9	2,3	2,8
25	25	25,0	25,3	1,3	1,5	1,9	2,3	2,8	3,5
32	32	32,0	32,3	1,6	1,9	2,4	2,9	3,6	4,4
40	40	40,0	40,4	1,9	2,4	3,0	3,7	4,5	5,5
50	50	50,0	50,5	2,4	3,0	3,7	4,6	5,6	6,9
63	63	63,0	63,6	3,0	3,8	4,7	5,8	7,1	8,6
75	75	75,0	75,7	3,6	4,5	5,6	6,8	8,4	10,3
90	90	90,0	90,9	4,3	5,4	6,7	8,2	10,1	12,3
110	110	110,0	111,0	5,3	6,6	8,1	10,0	12,3	15,1
125	125	125,0	126,2	6,0	7,4	9,2	11,4	14,0	17,1
140	140	140,0	141,3	6,7	8,3	10,3	12,7	15,7	19,2
160	160	160,0	161,5	7,7	9,5	11,8	14,6	17,9	21,9

^a non-preferred wall thickness of 1,1 mm is permitted for dimension $d_n = 12$.

Table 4 — Pipe dimensions for dimension class B1 (sizes based on copper pipe sizes and applicable for all classes of service conditions)

Dimensions in millimetres

Nominal size DN/OD	Nominal outside diameter d_n	Mean outside diameter $d_{em,min}$ $d_{em,max}$		Pipe series					
				S 10	S 8	S 6,3	S 5	S 4	S 3,2
				Wall thicknesses e_{min} and e_n					
10	10	9,9	10,2	1,3	1,3	1,3	1,3	1,3	1,4
12	12	11,9	12,2	1,3	1,3	1,3	1,3	1,3	1,6
15	15	14,9	15,2	1,3	1,3	1,3	1,3	1,7	2,0
18	18	17,9	18,2	1,3	1,3	1,3	1,6	2,0	2,4
22	22	21,9	22,2	1,3	1,3	1,6	2,0	2,4	3,0
28	28	27,9	28,2	1,3	1,6	2,0	2,5	3,1	3,8
35	35	34,9	35,4	1,7	2,0	2,6	3,2	3,9	4,8

Table 5 — Pipe dimensions for dimension class B2 (sizes based on copper pipe sizes and applicable for all classes of service conditions)

Dimensions in millimetres

Nominal size DN/OD	Nominal outside diameter d_n	Mean outside diameter		Wall thicknesses e_{min} and e_n	S_{calc}
		$d_{em,min}$	$d_{em,max}$		
14,7	14,7	14,63	14,74	1,6	4,1
21	21	20,98	21,09	2,05	4,6
27,4	27,4	27,33	27,44	2,6	4,8
34	34	34,08	34,19	3,15	4,9

Table 6 — Pipe dimensions for dimension class C (non-preferred pipe sizes used for example for heating systems)

Dimensions in millimetres

Nominal size DN/OD	Nominal outside diameter d_n	Mean outside diameter		Wall thicknesses e_{min} and e_n	S_{calc}
		$d_{em,min}$	$d_{em,max}$		
12	12	12,0	12,3	2,0	2,5
14	14	14,0	14,3	2,0	3,0
15	15	15,0	15,3	2,0	3,2
16	16	16,0	16,3	2,0	3,5
17	17	17,0	17,3	2,0	3,8
18	18	18,0	18,3	2,0	4,0
20	20	20,0	20,3	2,0	4,5

Table 7 — Tolerance on wall thicknesses

Dimensions in millimetres

Minimum wall thickness		Tolerance ^a x	Minimum wall thickness		Tolerance ^a x
e_{min}			e_{min}		
>	≤		>	≤	
1,0	2,0	0,3	11,0	12,0	1,3
2,0	3,0	0,4	12,0	13,0	1,4
3,0	4,0	0,5	13,0	14,0	1,5
4,0	5,0	0,6	14,0	15,0	1,6
5,0	6,0	0,7	15,0	16,0	1,7
6,0	7,0	0,8	16,0	17,0	1,8
7,0	8,0	0,9	17,0	18,0	1,9
8,0	9,0	1,0	18,0	19,0	2,0
9,0	10,0	1,1	19,0	20,0	2,1
10,0	11,0	1,2	20,0	21,0	2,2
			21,0	22,0	2,3

^a The tolerance is expressed in the form $\begin{matrix} +x \\ 0 \end{matrix}$ mm, where "x" is the value of the tolerance given. The level of the tolerances conforms to Grade V in ISO 11922-1.

7 Mechanical characteristics

When tested in accordance with the test methods as specified in [Table 8](#) using the indicated parameters, the pipe shall withstand the hydrostatic (hoop) stress without bursting. In the case of pipes with (a) barrier layer(s), the test shall be carried out on test pieces produced without the barrier layer(s).

Prior to the delivery, the pipes shall meet the mechanical characteristics.

Table 8 — Mechanical characteristics of pipes

Characteristic	Requirement	Test parameters for the individual tests				Test method		
		Hydrostatic (hoop) stress MPa	Test temp. °C	Test period h	Number of test pieces			
Resistance to internal pressure	No failure during the test period	PB-H	15,5	20	1 ^a	3	ISO 1167-1/ ISO 1167-2	
			15,2	20	22	3		
			6,5	95	22	3		
			6,2	95	165	3		
			6,0	95	1 000	3		
		PB-R	15,3	20	1 ^a	3		
			15,0	20	22	3		
			5,5	95	22	3		
			5,2	95	165	3		
			5,0	95	1 000	3		
		Test parameters for all tests						
		Sampling procedure			b			
		Type of end cap			Type a)			
		Orientation of test piece			Not specified			
		Type of test			Water-in-water			
^a In case of dispute, tests shall be done at 20 °C/22 h.								
^b The sampling procedure is not specified. For guidance, see ISO/TS 15876-7.								

8 Physical and chemical characteristics

When tested in accordance with the test methods as specified in [Table 9](#) using the indicated parameters, the pipe shall conform to the requirements given in this table.

Prior to the delivery, the pipes shall meet the physical and chemical characteristics.

Table 9 — Physical and chemical characteristics of pipes

Characteristic	Requirement	Test parameters		Test method
		Parameter	Value	
Longitudinal reversion	≤2 %	Temperature Duration of exposure for: $e_n \leq 8$ mm $8 \text{ mm} < e_n \leq 16$ mm Number of test pieces	110 °C 1 h 2 h 3	Method B of ISO 2505 (oven test)
Thermal stability by hydrostatic pressure testing	No bursting during the test period	Sampling procedure End cap Orientation Type of test Hydrostatic (hoop) stress PB-H PB-R Test temperature Test period Number of test pieces	a Type a) Free Water-in-air 2,4 Mpa 1,8 MPa ^b 110 °C 8 760 h 1	ISO 1167-1/ ISO 1167-2
Melt flow rate MFR/ MVR (pipe) ^c	30 % maximum difference compared to compound	Load Test temperature Number of test pieces	2,16 kg or 5 kg ^d 190 °C 3	ISO 1133-1
<p>^a The sampling procedure is free. For guidance, see ISO 15876-7.</p> <p>^b PB-R samples shall be conditioned at 95 °C/96 h prior to thermal stability testing.</p> <p>^c Samples for measuring MFR/MVR (melt mass-flow rate / melt volume-flow rate) of pellets and pipe shall be taken from the same compound and the same batch of material. It is not allowed to compare pipe or fittings prepared from a blend of batches with MFR/MVR measured on individual components.</p> <p>^d In case of dispute, 2,16 kg load shall be used.</p>				

9 Performance requirements

When pipes conforming to this document are jointed to each other or to components conforming to ISO 15876-3, the pipes and the joints shall conform to ISO 15876-5.

10 Marking

10.1 General requirements

Marking details shall be printed or formed directly on the pipe no less than once per metre in such a way that after storage, handling and installation (e.g. in accordance with CEN/TR 12108[1]), legibility is maintained.

NOTE The manufacturer is not responsible for marking being illegible, due to actions such as painting, scratching, covering of the components or by use of detergent, etc. on the components unless agreed or specified by the manufacturer.

Marking shall not initiate cracks or other types of defects which adversely influence the performance of the pipe.

If printing is used, the colouring of the printed information shall differ clearly from the basic colouring of the pipe.

The size of the marking shall be such that the marking is legible without magnification.

10.2 Minimum required marking

The minimum required marking of the pipe is specified in [Table 10](#).

Table 10 — Minimum required marking

Aspects	Marking or symbol
Number of this document	e.g. ISO 15876
Manufacturer's name and/or trade mark	Name or code
Nominal outside diameter and nominal wall thickness	e.g. 32 × 2,9
Pipe dimensions class	e.g. A
Material	PB-H or PB-R
Application class combined with design pressure	e.g. Class 2/10 bar
Opacity ^a	e.g. opaque
Manufacturer's information	b
^a If declared by the manufacturer. ^b For proving traceability, the following details shall be given: <ul style="list-style-type: none"> — the production period, year and month, in figures or in code; — a name or code for the production site if the manufacturer is producing at different sites. 	

Annex A (normative)

Derivation of $S_{\text{calc,max}}$

A.1 General

This Annex details the principles regarding the calculation of $S_{\text{calc,max}}$ -values and, hence, of minimum wall thicknesses, e_{min} , of pipes relative to the classes of service conditions (application classes) given in ISO 15876-1 and the applicable design pressure, p_D .

A.2 Design stress

The design stress, σ_D , for a particular class of service conditions (application class) is calculated from [Formula \(1\)](#) or [Formula \(2\)](#) and [Formula \(3\)](#) (see [4.2](#)) using Miner's rule in accordance with ISO 13760 and taking into account the applicable class requirements given in of ISO 15876-1:2003, Table 1 and the service coefficients given in [Table A.1](#).

Table A.1 — Overall service (design) coefficients

Temperature °C	Overall service (design) coefficient C	
	PB-H	PB-R
T_D	1,5	1,5
T_{max}	1,3	1,3
T_{mal}	1,0	1,0
T_{cold}	1,25	1,25

The resulting design stress, σ_D , has been calculated relative to each class and is given in [Table A.2](#).

Table A.2 — Design stress

Application class	Design stress ^a σ_D MPa	
	PB-H	PB-R
1	5,72	5,16
2	5,04	5,12
4	5,46	4,33
5	4,30	4,13
20 °C for 50 y	10,91	10,92

^a Values given are rounded down to the second place of decimals (i.e. the nearest 0,01 MPa).

A.3 Derivation of maximum value of S_{calc} ($S_{\text{calc,max}}$)

$S_{\text{calc,max}}$ is the smaller value of

either

$$\frac{\sigma_{DP}}{p_D} \quad (A.1)$$

where

σ_{DP} is the design stress in the pipe material taken from [Table A.2](#) in megapascals (MPa);

p_D is the design pressure of 4 bar or 6 bar or 8 bar or 10 bar, as applicable, expressed in megapascals (MPa).

or

$$\frac{\sigma_{cold}}{p_D} \quad (A.2)$$

where

σ_{cold} is the design stress at 20 °C relative to a service life of 50 years;

p_D is the design pressure of 10 bar, expressed in megapascals (MPa).

The values of $S_{calc,max}$ relative to each class of service condition (see ISO 15876-1) are given in [Table A.3](#) and [Table A.4](#).

Table A.3 — $S_{calc,max}$ values for PB-H

p_D bar	Application			
	Class 1	Class 2	Class 4	Class 5
	$S_{calc,max}$ -values ^a			
4	10,9 ^b	10,9 ^b	10,9 ^b	10,7
6	9,5	8,4	9,1	7,1
8	7,1	6,3	6,8	5,3
10	5,7	5,0	5,4	4,3

^a The values are rounded down to the first place of decimals.
^b The 20 °C, 10 bar, 50 years, cold water requirement, being higher, determines this value (see ISO 15876-1:2003, Clause 4; based on σ_{cold}/p_D).

Table A.4 — $S_{calc,max}$ values for PB-R

p_D bar	Application			
	Class 1	Class 2	Class 4	Class 5
	$S_{calc,max}$ -values ^a			
4	10,9 ^b	10,9 ^b	10,8	10,3
6	8,6	8,5	7,2	6,8
8	6,4	6,4	5,4	5,1
10	5,1	5,1	4,3	4,1

^a The values are rounded down to the first place of decimals.
^b The 20 °C, 10 bar, 50 years, cold water requirement, being higher, determines this value (see ISO 15876-1:2003, Clause 4; based on σ_{cold}/p_D).

A.4 Use of $S_{\text{calc,max}}$ to determine wall thickness

The S series and S_{calc} -values shall be chosen for each application class and design pressure from [Tables 3, 4, 5](#) or [6](#), as applicable, in such a way that S or S_{calc} is not greater than $S_{\text{calc,max}}$ in [Table A.3](#) or [Table A.4](#) (see also [6.2](#)).

Bibliography

- [1] ISO 4065, *Thermoplastics pipes — Universal wall thickness table*
- [2] ISO 11922-1, *Thermoplastics pipes for the conveyance of fluids — Dimensions and tolerances — Part 1: Metric series*
- [3] ISO 13760, *Plastics pipes for the conveyance of fluids under pressure — Miner's rule — Calculation method for cumulative damage*
- [4] ISO 15874 (all parts), *Plastics piping systems for hot and cold water installations — Polypropylene (PP)*
- [5] ISO 15875 (all parts), *Plastics piping systems for hot and cold water installations — Crosslinked polyethylene (PE-X)*
- [6] ISO 15876 (all parts), *Plastics piping systems for hot and cold water installations — Polybutylene (PB)*
- [7] ISO/TS 15876-7, *Plastics piping systems for hot and cold water installations — Polybutylene (PB) — Part 7: Guidance for the assessment of conformity*
- [8] ISO 15877 (all parts), *Plastics piping systems for hot and cold water installations — Chlorinated poly(vinyl chloride) (PVC-C)*
- [9] ISO 21003 (all parts), *Multilayer piping systems for hot and cold water installations inside buildings*
- [10] ISO 22391 (all parts), *Plastics piping systems for hot and cold water installations — Polyethylene of raised temperature resistance (PE-RT)*
- [11] CEN/TR 12108, *Plastics piping systems — Guidance for the installation inside buildings of pressure piping systems for hot and cold water intended for human consumption*

British Standards Institution (BSI)

BSI is the national body responsible for preparing British Standards and other standards-related publications, information and services.

BSI is incorporated by Royal Charter. British Standards and other standardization products are published by BSI Standards Limited.

About us

We bring together business, industry, government, consumers, innovators and others to shape their combined experience and expertise into standards-based solutions.

The knowledge embodied in our standards has been carefully assembled in a dependable format and refined through our open consultation process. Organizations of all sizes and across all sectors choose standards to help them achieve their goals.

Information on standards

We can provide you with the knowledge that your organization needs to succeed. Find out more about British Standards by visiting our website at bsigroup.com/standards or contacting our Customer Services team or Knowledge Centre.

Buying standards

You can buy and download PDF versions of BSI publications, including British and adopted European and international standards, through our website at bsigroup.com/shop, where hard copies can also be purchased.

If you need international and foreign standards from other Standards Development Organizations, hard copies can be ordered from our Customer Services team.

Copyright in BSI publications

All the content in BSI publications, including British Standards, is the property of and copyrighted by BSI or some person or entity that owns copyright in the information used (such as the international standardization bodies) and has formally licensed such information to BSI for commercial publication and use.

Save for the provisions below, you may not transfer, share or disseminate any portion of the standard to any other person. You may not adapt, distribute, commercially exploit, or publicly display the standard or any portion thereof in any manner whatsoever without BSI's prior written consent.

Storing and using standards

Standards purchased in soft copy format:

- A British Standard purchased in soft copy format is licensed to a sole named user for personal or internal company use only.
- The standard may be stored on more than 1 device provided that it is accessible by the sole named user only and that only 1 copy is accessed at any one time.
- A single paper copy may be printed for personal or internal company use only.

Standards purchased in hard copy format:

- A British Standard purchased in hard copy format is for personal or internal company use only.
- It may not be further reproduced – in any format – to create an additional copy. This includes scanning of the document.

If you need more than 1 copy of the document, or if you wish to share the document on an internal network, you can save money by choosing a subscription product (see 'Subscriptions').

Reproducing extracts

For permission to reproduce content from BSI publications contact the BSI Copyright & Licensing team.

Subscriptions

Our range of subscription services are designed to make using standards easier for you. For further information on our subscription products go to bsigroup.com/subscriptions.

With **British Standards Online (BSOL)** you'll have instant access to over 55,000 British and adopted European and international standards from your desktop. It's available 24/7 and is refreshed daily so you'll always be up to date.

You can keep in touch with standards developments and receive substantial discounts on the purchase price of standards, both in single copy and subscription format, by becoming a **BSI Subscribing Member**.

PLUS is an updating service exclusive to BSI Subscribing Members. You will automatically receive the latest hard copy of your standards when they're revised or replaced.

To find out more about becoming a BSI Subscribing Member and the benefits of membership, please visit bsigroup.com/shop.

With a **Multi-User Network Licence (MUNL)** you are able to host standards publications on your intranet. Licences can cover as few or as many users as you wish. With updates supplied as soon as they're available, you can be sure your documentation is current. For further information, email subscriptions@bsigroup.com.

Revisions

Our British Standards and other publications are updated by amendment or revision.

We continually improve the quality of our products and services to benefit your business. If you find an inaccuracy or ambiguity within a British Standard or other BSI publication please inform the Knowledge Centre.

Useful Contacts

Customer Services

Tel: +44 345 086 9001

Email (orders): orders@bsigroup.com

Email (enquiries): cservices@bsigroup.com

Subscriptions

Tel: +44 345 086 9001

Email: subscriptions@bsigroup.com

Knowledge Centre

Tel: +44 20 8996 7004

Email: knowledgecentre@bsigroup.com

Copyright & Licensing

Tel: +44 20 8996 7070

Email: copyright@bsigroup.com

BSI Group Headquarters

389 Chiswick High Road London W4 4AL UK