

BS EN 1745:2012



BSI Standards Publication

Masonry and masonry products — Methods for determining thermal properties

bsi.

...making excellence a habit.™

National foreword

This British Standard is the UK implementation of EN 1745:2012. It supersedes BS EN 1745:2002 which is withdrawn.

The UK participation in its preparation was entrusted to Technical Committee B/519, Masonry and associated testing.

A list of organizations represented on this committee can be obtained on request to its secretary.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

© The British Standards Institution 2012. Published by BSI Standards Limited 2012

ISBN 978 0 580 71789 5

ICS 91.080.30; 91.120.10

Compliance with a British Standard cannot confer immunity from legal obligations.

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 30 April 2012.

Amendments issued since publication

Date	Text affected
------	---------------

EUROPEAN STANDARD

EN 1745

NORME EUROPÉENNE

EUROPÄISCHE NORM

April 2012

ICS 91.080.30; 91.120.10

Supersedes EN 1745:2002

English Version

Masonry and masonry products - Methods for determining thermal properties

Maçonnerie et éléments de maçonnerie - Méthodes pour la détermination des propriétés thermiques

Mauerwerk und Mauerwerksprodukte - Verfahren zur Bestimmung von wärmeschutztechnischen Eigenschaften

This European Standard was approved by CEN on 9 March 2012.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

Management Centre: Avenue Marnix 17, B-1000 Brussels

Contents

Page

Foreword.....	4
Introduction	5
1 Scope.....	7
2 Normative references	7
3 Terms, definitions and symbols	7
3.1 Terms and definitions.....	7
3.2 Symbols	9
3.3 Subscripts.....	10
4 Procedures to determine $\lambda_{10,dry,unit}$ -values for solid masonry units and $\lambda_{10,dry,mor}$ -values for mortars	11
4.1 General.....	11
4.2 $\lambda_{10,dry,mat}$ -values for solid masonry units and mortars	11
4.2.1 Model S1. Determination of $\lambda_{10,dry,unit}$ -values from tabulated $\lambda_{10,dry,mat}$ /net dry density relation.....	11
4.2.2 Model S2. Determination of $\lambda_{10,dry,unit}$ -values based on $\lambda_{10,dry,mat}$ /net dry density curve.....	11
4.2.3 Model S3. Procedures to determine $\lambda_{10,dry,unit}$ -values from determining the thermal transmittance (U_{mas}) of masonry built from solid masonry units and mortar	13
4.3 Test methods and numbers of samples to be taken for the different models.....	14
5 Procedures to determine equivalent $\lambda_{10,dry,unit}$ -values for masonry units with formed voids and composite masonry units	14
5.1 General.....	14
5.2 Calculation methods.....	15
5.3 $\lambda_{10,dry,unit}$ -values of masonry units.....	15
5.3.1 Determination of $\lambda_{10,dry,unit}$ -values from tabulated $\lambda_{unit}/\lambda_{mat}$ relation.....	15
5.3.2 Determination of $\lambda_{10,dry,unit}$ -values based on calculation	16
5.3.3 Model P5. Determination of $\lambda_{10,dry,unit}$ -values from determining the thermal transmittance (U_{mas}) of masonry built from masonry units with formed voids or composite masonry units and mortar.....	16
5.4 Test methods and numbers of samples to be taken for the different models.....	19
6 Moisture conversion	19
7 Procedures to determine design thermal values ($R_{design,mas}$ or $\lambda_{design,mas}$) for masonry built from masonry units and mortar.....	20
7.1 General.....	20
7.2 $R_{design,mas}$ - or $\lambda_{design,mas}$ -values based on calculation.....	20
7.3 $R_{design,mas}$ - or $\lambda_{design,mas}$ -values of masonry built from masonry units with formed voids or composite masonry units and mortar based on tabulated values	21
7.3.1 Tabulated values	21
8. Determination of the thermal transmittance of masonry.....	23
9. Specific heat capacity.....	23
10. Rounding rules for λ -values for masonry.....	23
Annex A (normative) Tabulated $\lambda_{10,dry,mat}$ -values of materials used for masonry products.....	24
Annex B (informative) $R_{dry,mas}$ - or $\lambda_{10,dry,mas}$ -values of masonry built from a range of masonry units containing formed voids.....	35

Annex C (informative) Example of how to use the tables in Annex B	62
Annex D (normative) Requirements for appropriate calculation procedures	64
D.1 Capabilities of the program	64
D.2 Input data and results	64
D.3 Testing of the program accuracy	65
D.4 Reference cases	65
Annex E (informative) Evaluation of conformity	73
Annex F (informative) Alternative procedure for the moisture correction of units with formed voids	75
Bibliography	76

Foreword

This document (EN 1745:2012) has been prepared by Technical Committee CEN/TC 125 "Masonry", the secretariat of which is held by BSI.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by October 2012, and conflicting national standards shall be withdrawn at the latest by October 2012.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN [and/or CENELEC] shall not be held responsible for identifying any or all such patent rights.

This document supersedes EN 1745:2002.

This document has been prepared under a mandate given to CEN by the European Commission and the European Free Trade Association.

The following is a list of significant technical changes since the last edition:

- addition of Figure 1 to show the procedures and calculation possibilities;
- editorial improvement;
- extension of Annex B;
- adaption of Annex E;
- addition of Annex F;
- deletion of Annex ZA.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.

Introduction

This European Standard provides rules for the determination of dry and design thermal conductivity and thermal resistance values of masonry products and masonry.

It describes how dry thermal values are determined. It also describes the correction methods to derive design values from a dry value. The dry value is a characteristic of a masonry material, masonry unit or of masonry. On the basis of dry thermal conductivity values determination methods of design thermal values are given.

Three procedures (model S1 – S3) for the determination of dry thermal conductivity ($\lambda_{10,dry,unit}$) of solid masonry units are described and five procedures (model P1 – P5) for the determination of equivalent dry thermal conductivity ($\lambda_{10,dry,unit}$) of masonry units with formed voids and composite masonry units are described, see Figure 1.

For mortars according to EN 998-1 and EN 998-2, the models S1 – S2 can be used.

Additionally three procedures for the determination of thermal resistance are described. These procedures are:

- the use of tabulated R -values;
- the measurement of R -value;
- the numerical calculation of R -value.

The following major types of masonry units are covered by this European Standard:

- solid masonry units;
- masonry units with formed voids;
- composite masonry units.

In Figure 1, the different models and procedures are illustrated.

The design value of a product characteristic is the value determined for a specific application and for use in calculations.

Design thermal values are determined, according to the procedure given in this European Standard according to the intended application, environmental and climatic conditions, bearing in mind the purpose of this determination, such as:

- energy consumption;
- design of heating and cooling equipment;
- surface temperature determination;
- compliance with national building regulations;
- consideration of non-steady state thermal conditions in buildings.

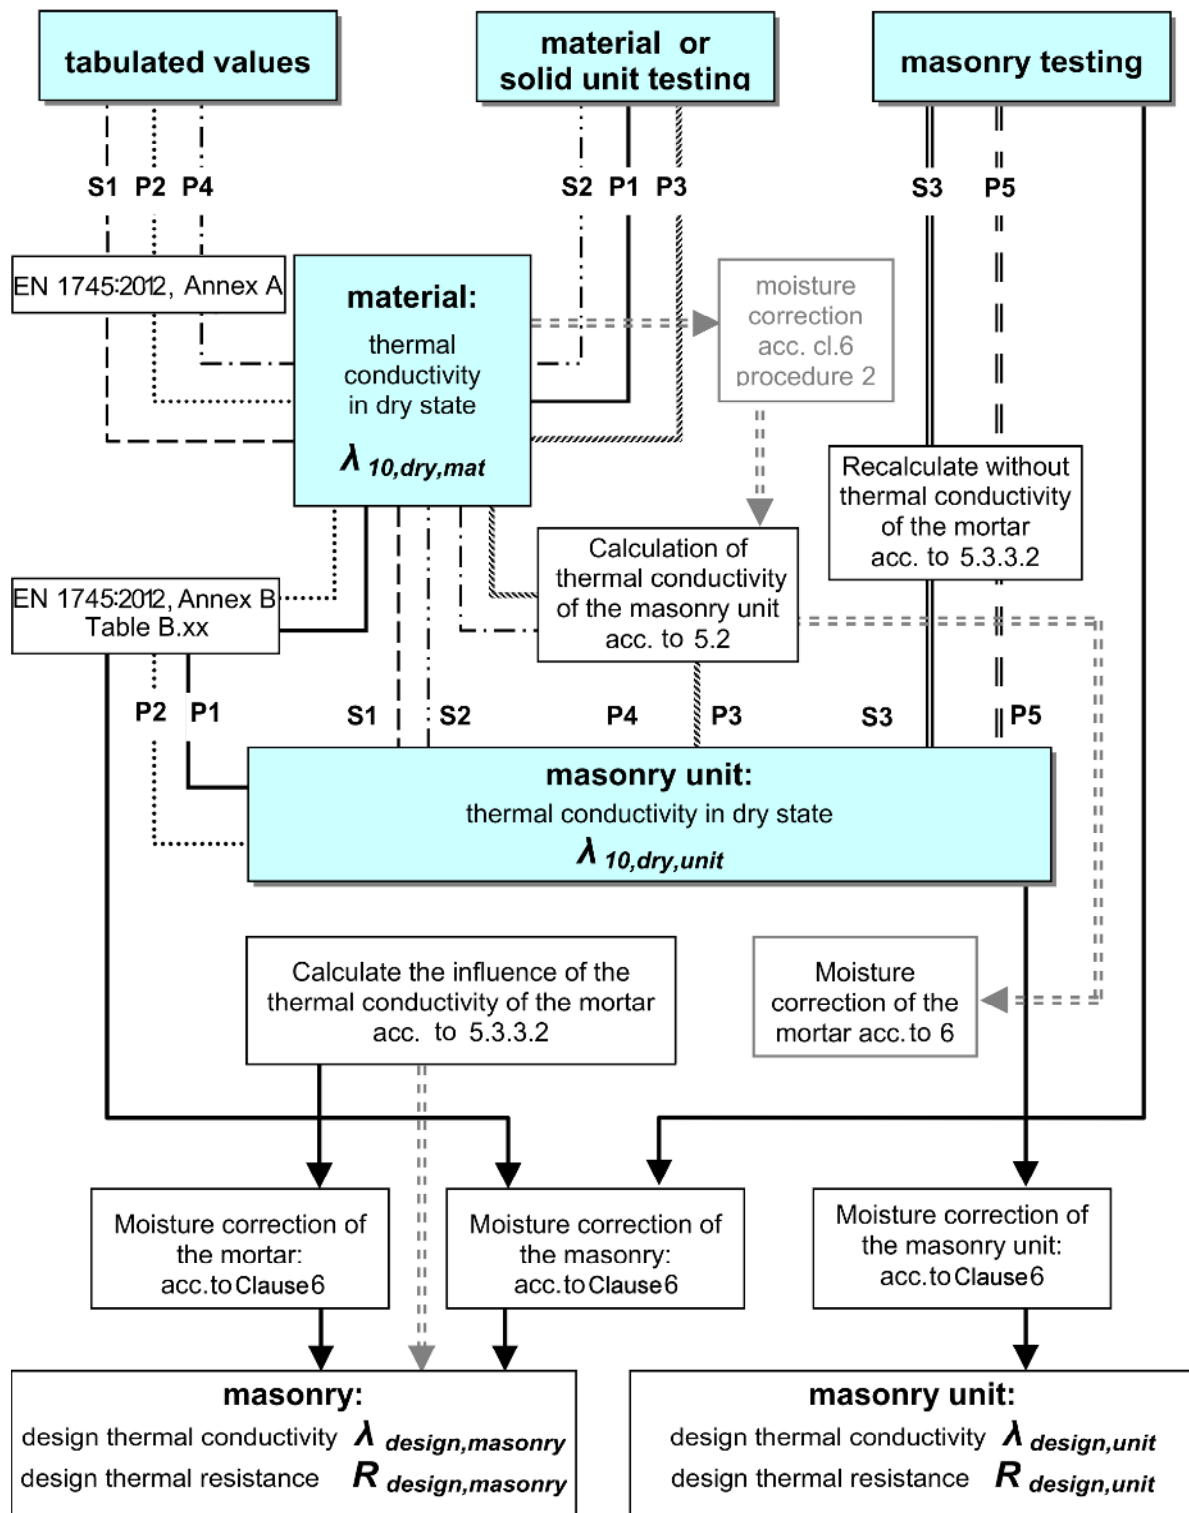


Figure 1 — Determination of thermal properties of masonry units and masonry

1 Scope

This European Standard specifies procedures for the determination of thermal properties of masonry and masonry products.

2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 772-4, *Methods of test for masonry units — Part 4: Determination of real and bulk density and of total and open porosity for natural stone masonry units*

EN 772-13, *Methods of test for masonry units — Part 13: Determination of net and gross dry density of masonry units (except for natural stone)*

EN 1015-10, *Methods of test for mortar for masonry — Part 10: Determination of dry bulk density of hardened mortar*

EN 1934, *Thermal performance of buildings — Determination of thermal resistance by hot box method using heat flow meter — Masonry*

EN 1936, *Natural stone test methods — Determination of real density and apparent density, and of total and open porosity*

EN 12664, *Thermal performances of building materials and products — Determination of thermal resistance by means of guarded hot plate and heat flow meter methods — Dry and moist products of medium and low thermal resistance*

EN ISO 6946:2007, *Building components and building elements — Thermal resistance and thermal transmittance — Calculation method (ISO 6946:2007)*

EN ISO 7345:1995, *Thermal insulation — Physical quantities and definitions (ISO 7345:1987)*

EN ISO 10211, *Thermal bridges in building construction — Heat flows and surface temperatures — Detailed calculations (ISO 10211)*

EN ISO 10456, *Building materials and products — Hydrothermal properties — Tabulated design values and procedures for determining declared and design thermal values (ISO 10456)*

3 Terms, definitions and symbols

For the purposes of this document, the following terms, definitions and symbols and those given in EN ISO 7345:1995 apply.

3.1 Terms and definitions

3.1.1

masonry

assemblage of masonry units laid in a specified pattern and joined together with masonry mortar

3.1.2

masonry product

masonry units, masonry mortars, rendering and plastering mortars

3.1.3

solid masonry unit

masonry unit containing no perforations except external indentations such as grip holes, grooves, etc.

3.1.4

masonry unit with formed voids

masonry unit with a system of intentionally formed voids

3.1.5

composite masonry unit

masonry unit incorporating one or more layers of additional material to enhance performance

3.1.6

thermal value

common term for either the thermal conductivity $[W/(m \cdot K)]$ or the thermal resistance $[m^2 \cdot K/W]$

3.1.7

dry state

state after drying under conditions stated in the relevant standards

3.1.8

dry thermal value

value of a thermal property of a building material or product in a dry state determined according to this European Standard as a basis for the calculation of design thermal values

Note 1 to entry: The dry thermal value can be expressed as thermal conductivity or thermal resistance.

3.1.9

design thermal value

value of a thermal property of a building material or product under specific external and internal conditions which can be considered as typical of the performance of that material or product when incorporated in a building component or building

3.1.10

masonry thermal conductivity

value which is derived by dividing the thickness of a given masonry element by its thermal resistance excluding surface resistance

3.1.11

reference conditions

set of conditions identifying a state of equilibrium selected as the base to which the thermal values of building materials and products are referred

3.1.12

equivalent thermal conductivity

value derived by dividing the width of a masonry unit with formed voids or a composite masonry unit or masonry by its thermal resistance excluding surface resistance

3.2 Symbols

The order of the indices for thermal values is temperature, condition and subject

Symbol	Quantity	Unit
$\lambda_{10,dry,mat}$	thermal conductivity at an average temperature of 10 °C in dry state for the material	W/(m·K)
$\lambda_{10,dry,mas}$	thermal conductivity at an average temperature of 10 °C in dry state for the masonry	W/(m·K)
$\lambda_{10,dry,mor}$	thermal conductivity at an average temperature of 10 °C in dry state for the mortar	W/(m·K)
$\lambda_{10,dry,unit}$	thermal conductivity at an average temperature of 10 °C in dry state for the unit. For solid units the $\lambda_{10,dry,unit}$ is the same as $\lambda_{10,dry,mat}$ and for units with formed voids and composite units the $\lambda_{10,dry,unit}$ is the equivalent thermal conductivity.	W/(m·K)
$\lambda_{design,mas}$	design thermal conductivity for the masonry	W/(m·K)
$\lambda_{design,mor}$	design thermal conductivity for the mortar	W/(m·K)
$\lambda_{design,unit}$	design thermal conductivity for the unit	W/(m·K)
λ_i	individual measured or calculated thermal conductivity	W/(m·K)
R_i	individual measured thermal resistance	m ² ·K/W
$R_{dry,mas}$	thermal resistance of masonry	m ² ·K/W
$R_{design,mas}$	design thermal resistance of masonry	m ² ·K/W
R_{si}, R_{se}	internal and external surface resistance	m ² ·K/W
$R_{t,mas}$	the true thermal resistance of the masonry	m ² ·K/W
a_{mor}	percentage area of mortar joint in the measured masonry	%
a_{unit}	percentage area of units in the measured masonry	%
d	thickness of the masonry	m
T	temperature	K
μ	water vapour diffusion coefficient	
c_p	specific heat capacity	J/(kg·K)
l	length of a masonry unit	mm
w	width of a masonry unit	mm
h_{unit}	height of a masonry unit	mm

h_{mor}	thickness of a mortar joint	mm
F_m	moisture conversion factor	
f_u	moisture conversion coefficient by mass	kg/kg
f_v	moisture conversion coefficient by volume	m ³ /m ³
u	moisture content mass by mass	kg/kg
ψ	moisture content volume by volume	m ³ /m ³
$U_{10,dry,mas}$	thermal transmittance of the masonry in dry state	W/(m ² ·K)
U_{mas}	thermal transmittance of the masonry	W/(m ² ·K)
U_{mor}	thermal transmittance of the mortar	W/(m ² ·K)
U_{unit}	thermal transmittance of the units	W/(m ² ·K)
P	fractile of population	%
$\rho_{g,dry}$	gross dry density	kg/m ³
$\rho_{n,dry}$	net dry density	kg/m ³
v	percentage of voids	%

3.3 Subscripts

10	average test temperature of 10 °C
dry	state after drying under conventional conditions as stated in the relevant standards
mas	masonry
mat	material
mor	mortar
$unit$	masonry unit

4 Procedures to determine $\lambda_{10,dry,unit}$ -values for solid masonry units and $\lambda_{10,dry,mor}$ -values for mortars

4.1 General

$\lambda_{10,dry,unit}$ -values for solid masonry units and $\lambda_{10,dry,mor}$ -values for mortars are identical to the $\lambda_{10,dry,mat}$ -values. The $\lambda_{10,dry,mat}$ -values of solid masonry units and of mortars can be determined from tests carried out on samples of the material or from tables or graphs which relate $\lambda_{10,dry,mat}$ to density or from determining the thermal transmittance (U_{mas}) of masonry built from masonry units and mortar. In all cases the $\lambda_{10,dry,mat}$ -value is to be representative of the material.

4.2 $\lambda_{10,dry,mat}$ -values for solid masonry units and mortars

4.2.1 Model S1. Determination of $\lambda_{10,dry,unit}$ -values from tabulated $\lambda_{10,dry,mat}$ /net dry density relation

Tabulated $\lambda_{10,dry,mat}$ -values for different materials used for masonry products are given in Annex A, differentiated by material and dry density. This annex also contains values for the water vapour diffusion coefficient, the specific heat capacity and the moisture conversion coefficient.

These tabulated values are valid for materials where there is factory production control of the net dry density but no directly measured λ -values. $\lambda_{10,dry,mat}$ -values are given as 50 % and 90 % fractiles (P).

4.2.2 Model S2. Determination of $\lambda_{10,dry,unit}$ -values based on $\lambda_{10,dry,mat}$ /net dry density curve

4.2.2.1 General

To determine a $\lambda_{10,dry,mat}$ -value from a $\lambda_{10,dry,mat}$ /net dry density relationship the following procedure shall be used:

4.2.2.2 Test specimens

Test specimens shall be in accordance with the requirements of EN 12664. Care should be taken that the test specimens are representative of the masonry product itself.

NOTE An appropriate way to ensure this is to cut specimens from masonry units.

4.2.2.3 Conditioning of specimens

Normally masonry materials are tested in a dry condition. It is also possible to carry out tests in a moist condition (e.g. conditioned to constant mass in an environment of (23 ± 2) °C and $50 \% \pm 5 \%$ relative humidity), in which case the measured value has to be converted to the dry state following one of the procedures given in Clause 6.

4.2.2.4 Test measurement

The reference test method is given in EN 12664. The test shall be carried out at a mean temperature of 10 °C.

Alternative test methods, which may require different test specimens and different conditioning methods, may be used, if the correlation between the reference test method and the alternative method can be given.

4.2.2.5 Establishing a product related $\lambda_{10,dry,mat}$ /net dry density-curve

Three items of information are necessary for this determination procedure:

- 1) the tabulated $\lambda_{10,dry,mat}$ /net dry density-correlation for the given material (see Annex A);
- 2) the product net dry density range, which can be derived either from the production history or from the net dry density tolerances which are given in the relevant product standards;
- 3) at least three individual test measurements of the net dry density and λ_i , on material which is representative for the current material produced. The measurements of net dry density and λ shall be carried out on the same specimens. The three tests have to be carried out on specimens from different production batches to represent the manufactured product net dry density range. These three measurements are used to determine the distance of the individual $\lambda_{10,dry,mat}$ /net dry density-curve, for a defined production, from the tabulated $\lambda_{10,dry,mat}$ /net dry density curve.

Determine the measured λ_i -value as prescribed in 4.2.2.1 to 4.2.2.3 and calculate the arithmetic mean value of the 3 λ_i -results.

Measure the net dry density of each of the three samples following the procedure prescribed in EN 772-4 or EN 772-13 or EN 1015-10 and calculate the arithmetic mean value of the 3 results.

Then use the following procedure.


Through the point A representing mean thermal conductivity and mean net dry density draw a λ /net dry density-curve parallel to the general $\lambda_{10,dry,mat}$ /net dry density-curve obtained from plotting the tabulated λ - and net dry density-values for the product (material) given in Annex A.

Derive the mean λ -value of the product from the average net dry density. Derive the upper and lower limit values as the values that represent 90 % and 10 % of the manufactured product under consideration density range with a confidence level of 90 % according to EN ISO 10456.

Use the product related $\lambda_{10,dry,mat}$ /net dry density-curve to determine the $\lambda_{10,dry,mat}$ -value related to the mean net dry density the manufacturer is confident to achieve.

Express the $\lambda_{10,dry,unit}$ -values for solid masonry units or the $\lambda_{10,dry,mor}$ -values for mortars as the mean $\lambda_{10,dry,mat}$ -value together with the difference between the limit and the mean value.

Figure 2 shows this process in the form of a graph.

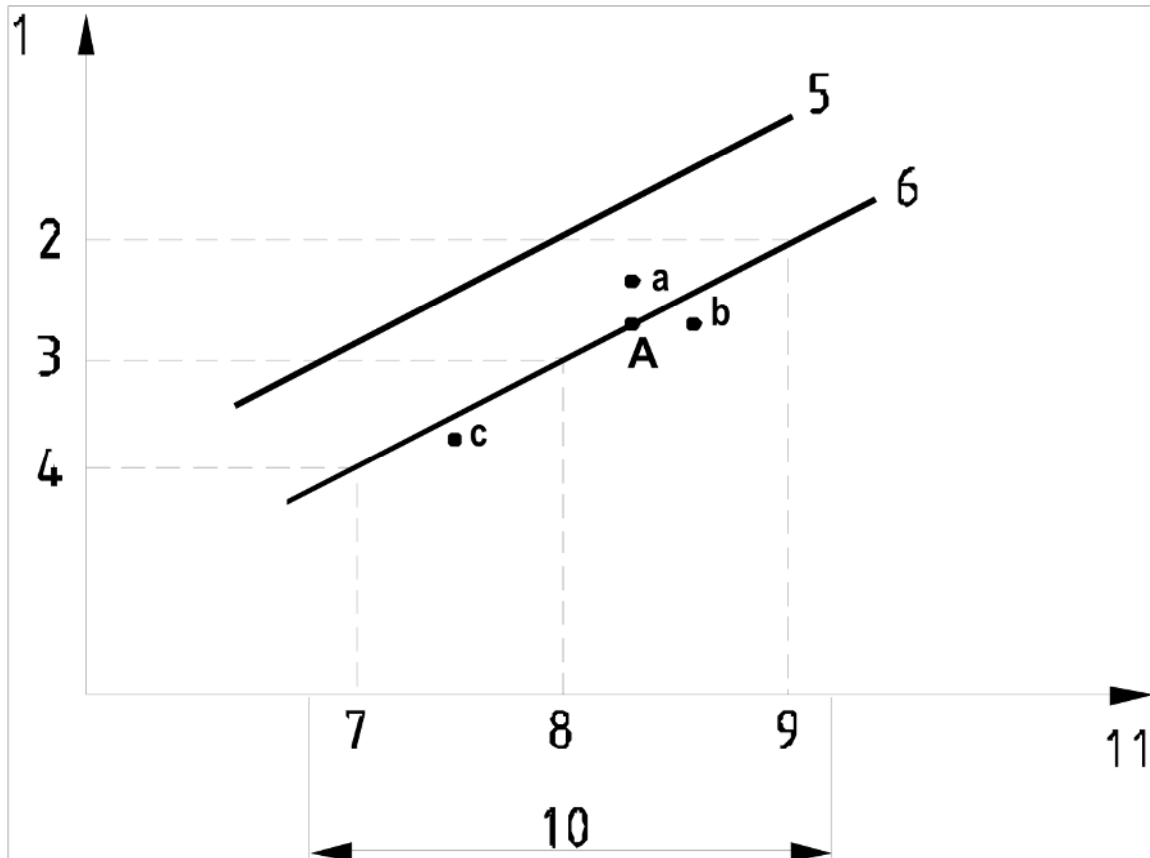

Key

- 1 $\lambda_{10, dry, mat}$ (W/m·K)
- 2 upper limit λ value
- 3 mean λ value
- 4 lower limit λ value
- 5 curve resulting from tabulated values (Annex A)
- 6 parallel curve drawn through point A (mean of the single values a, b, c)
- 7 10 % of production of the product under consideration
- 8 mean net dry density
- 9 90 % of production of the product under consideration
- 10 product density range
- 11 net dry density (kg/m³)

Figure 2 — Derivation of the material $\lambda_{10, dry, mat}$ -value

NOTE For factory production control purposes thermal conductivity may be controlled from the net dry density of the material, see Annex E.

4.2.3 Model S3. Procedures to determine $\lambda_{10, dry, unit}$ -values from determining the thermal transmittance (U_{mas}) of masonry built from solid masonry units and mortar

To determine a $\lambda_{10, dry, unit}$ -values from test measurements of the thermal transmittance of masonry built from masonry units and mortars, the procedure in 5.3.3 shall be used.

4.3 Test methods and numbers of samples to be taken for the different models

In the following table test methods and numbers of samples to be taken for the different models is given.

Table 1 — Test methods and minimum numbers of specimens within the test

Test methods	Minimum numbers of specimens
<i>Model S1:</i>	
Material density, EN 772-13 or EN 1936 (natural stone units)	6
<i>Model S2:</i>	
Material density, EN 772-13, EN 1015-10 or EN 1936 (natural stone units)	3
Thermal conductivity, EN 12664	3
<i>Model S3:</i>	
Gross dry density, EN 772-13, EN 1015-10 or EN 1936 (natural stone units)	3 × 6
Thermal transmittance, EN 1934	3

5 Procedures to determine equivalent $\lambda_{10,dry,unit}$ -values for masonry units with formed voids and composite masonry units

5.1 General

The thermal properties of masonry units with formed voids cannot fully be determined by the $\lambda_{10,dry,mat}$ -value of the material, there is also a high influence from the shape and the geometry of the voids in the unit. The thermal conductivity of the materials can be derived from tables or measurements.

The $\lambda_{10,dry,unit}$ -values of masonry units with formed voids can be determined:

- from tables;
- from calculations;
- from test measurements carried out on masonry samples.

The $\lambda_{10,dry,unit}$ -values of composite masonry units can be determined:

- from calculations;
- from measurements carried out on masonry samples.

5.2 Calculation methods

There are several different numerical methods in use (e.g. Finite Difference, Finite Element) for the calculation of the thermal properties of masonry units with formed voids or composite masonry units. The thermal conductivities of the materials and the configuration of the units are necessary input parameters for such calculations.

The requirements for appropriate calculation programs (accuracy, boundary conditions, etc.) are given in Annex D.

The method described in EN ISO 6946 may also be used.

5.3 $\lambda_{10,dry,unit}$ -values of masonry units

5.3.1 Determination of $\lambda_{10,dry,unit}$ -values from tabulated $\lambda_{unit}/\lambda_{mat}$ relation

5.3.1.1 General

$\lambda_{10,dry,unit}$ -values used for masonry units with different void patterns are given in Annex B. Annex C provides an example of how to use Annex B.

No tabulated values for composite masonry units are given in Annex B.

NOTE The types of units shown and the pattern of voids are intended as examples of units typically found on the market. They are not intended to cover every size and type of unit or void pattern produced.

5.3.1.2 Application of Annex B

Examples for $\lambda_{10,dry,unit}$ -values of masonry units with formed voids given in Annex B, are differentiated by:

- material;
- geometry of the units and geometry of formed voids;
- λ -value of the material of the masonry units;

Linear interpolation may be used for material conductivities between the values given in the tables in Annex B.

5.3.1.3 Model P1. The determination of the $\lambda_{10,dry,unit}$ -value using Annex B using measured thermal conductivity of the masonry unit material

To determine a $\lambda_{10,dry,unit}$ -value from using Annex B using measured thermal conductivity of the masonry unit material, the following procedure shall be used:

Select the table relevant for the actual units. Express the $\lambda_{10,dry,unit}$ -value as the value given in the relevant table for the $\lambda_{10,dry,mat}$ -value the manufacturer is confident to achieve. The $\lambda_{10,dry,mat}$ -value is a measured thermal conductivity of the masonry unit material as specified in 4.2.2.

5.3.1.4 Model P2. The determination of the $\lambda_{10,dry,unit}$ -value using Annex B using tabulated value from Annex A

To determine a $\lambda_{10,dry,unit}$ -value from using Annex B using tabulated value from Annex A, the following procedure shall be used:

Select the table relevant for the actual units. Express the $\lambda_{10,dry,unit}$ -value as the value given in the relevant table for the $\lambda_{10,dry,mat}$ -value the manufacturer is confident to achieve. The $\lambda_{10,dry,mat}$ -value is a tabulated value from Annex A.

5.3.2 Determination of $\lambda_{10,dry,unit}$ -values based on calculation

5.3.2.1 General

To determine a $\lambda_{10,dry,unit}$ -value for a masonry unit by calculation methods following 5.2, the following procedure shall be used:

Based on:

- the geometry of the units;
- the geometry of formed voids;
- the $\lambda_{10,dry,mat}$ -value;
- the orientation of the unit in use

a numerical model of the unit can be established and the thermal transmittance can be approximated.

This method is also suitable for composite masonry units, where the calculation is dealt with separately for each layer.

5.3.2.2 Model P 3. Determination of $\lambda_{10,dry,unit}$ -values using measured thermal conductivity of the masonry unit material

Express the $\lambda_{10,dry,unit}$ -value as the result of the calculation using the $\lambda_{10,dry,mat}$ -value the manufacturer is confident to achieve. The $\lambda_{10,dry,mat}$ -value is a measured thermal conductivity of the masonry unit material as specified in 4.2.2.

5.3.2.3 Model P 4. Determination of $\lambda_{10,dry,unit}$ -values using tabulated value from Annex A

Express the $\lambda_{10,dry,unit}$ -value as the result of the calculation using the $\lambda_{10,dry,mat}$ -value the manufacturer is confident to achieve. The $\lambda_{10,dry,mat}$ -value is tabulated values from Annex A.

5.3.3 Model P5. Determination of $\lambda_{10,dry,unit}$ -values from determining the thermal transmittance (U_{mas}) of masonry built from masonry units with formed voids or composite masonry units and mortar

5.3.3.1 General

To determine $\lambda_{10,dry,unit}$ -values from test measurements of the thermal transmittance of masonry built from masonry units and mortars, the following procedure shall be used.

5.3.3.2 Testing procedure

- Select test samples from 3 different production batches for the product under consideration. Determine their mean gross dry density.
- From each of these batches erect one wall.

- Measure the thermal transmittance on each of those walls following EN 1934. If the measured wall is not in a dry state, the measured value has to be converted to the dry state following the procedure given in Clause 6.

5.3.3.3 The determination of the $\lambda_{10,dry,unit}$ -value

- Calculate the $\lambda_{10,dry,mas}$ -value using the equation:
$$\lambda_{10,dry,mas} = \frac{d}{\frac{1}{U_{10,dry,mas}} - R_{si} - R_{se}}$$

where

$U_{10,dry,mas}$ is the thermal transmittance of the masonry in dry state, in W/m^2K ;

R_{si} , R_{se} are the internal and external surface resistance in $m^2 \cdot K/W$ according to EN ISO 6946;

d is the thickness of the masonry in m;

$\lambda_{10,dry,mas}$ is the thermal conductivity of the masonry in dry state in $W/(m \cdot K)$.

- Calculate the $\lambda_{10,dry,unit}$ -value using the equation:
$$\lambda_{10,dry,unit} = \frac{100 \times \lambda_{10,dry,mas} - a_{mor} \times \lambda_{10,dry,mor}}{a_{unit}}$$

where

a_{mor} is the percentage area of mortar joint in the measured masonry;

a_{unit} is the percentage area of units in the measured masonry;

$\lambda_{10,dry,mor}$ is the thermal conductivity of the actual mortar joint;

$\lambda_{10,dry,unit}$ is the thermal conductivity of the units.

The thermal conductivity of the mortar joints shall take into account mortar pockets and strip bedding and the use of insulating material between the strips.

If the units are intended to be used with unfilled vertical mortar joints the masonry tested shall also be with unfilled joints and the $\lambda_{10,dry,unit}$ -values for the units will take into account the effect of the unfilled joints calculated according to EN 6946.

Take the 3 individual calculated $\lambda_{10,dry,unit}$ -values and calculate the arithmetic mean value.

Measure the gross dry density of each of the three samples taken from each batch of masonry units and mortar following the procedure prescribed in EN 772-4 or EN 772-13 or EN 1015-10 and calculate the arithmetic mean value of the 3 results.

To the given $\lambda_{10,dry,mat}$ -values in the relevant table in Annex B find the corresponding net dry densities values in Annex A. From the corresponding net dry density values calculate the related gross dry density values using the following equation:

$$\rho_{g,dry} = \frac{100 - v}{100} \rho_{n,dry}$$

where

$\rho_{g,dry}$ is the gross dry density in kg/m^3 ;


$\rho_{n,dry}$ is the net dry density in kg/m^3 ;

v is the percentage of voids taken from the relevant table in Annex B.

Through the point A representing mean thermal conductivity and mean density draw a λ /gross dry density-curve parallel to the general $\lambda_{10,dry,unit}$ /gross dry density-curve obtained from plotting the tabulated $\lambda_{10,dry,unit}$ -values in Annex B and the corresponding calculated gross dry density-values for the product.

Use the product related $\lambda_{10,dry,unit}$ /gross dry density-curve to determine the $\lambda_{10,dry,unit}$ -value related to the mean gross dry density the manufacturer is confident to achieve.

Figure 3 shows this process in the form of a graph.

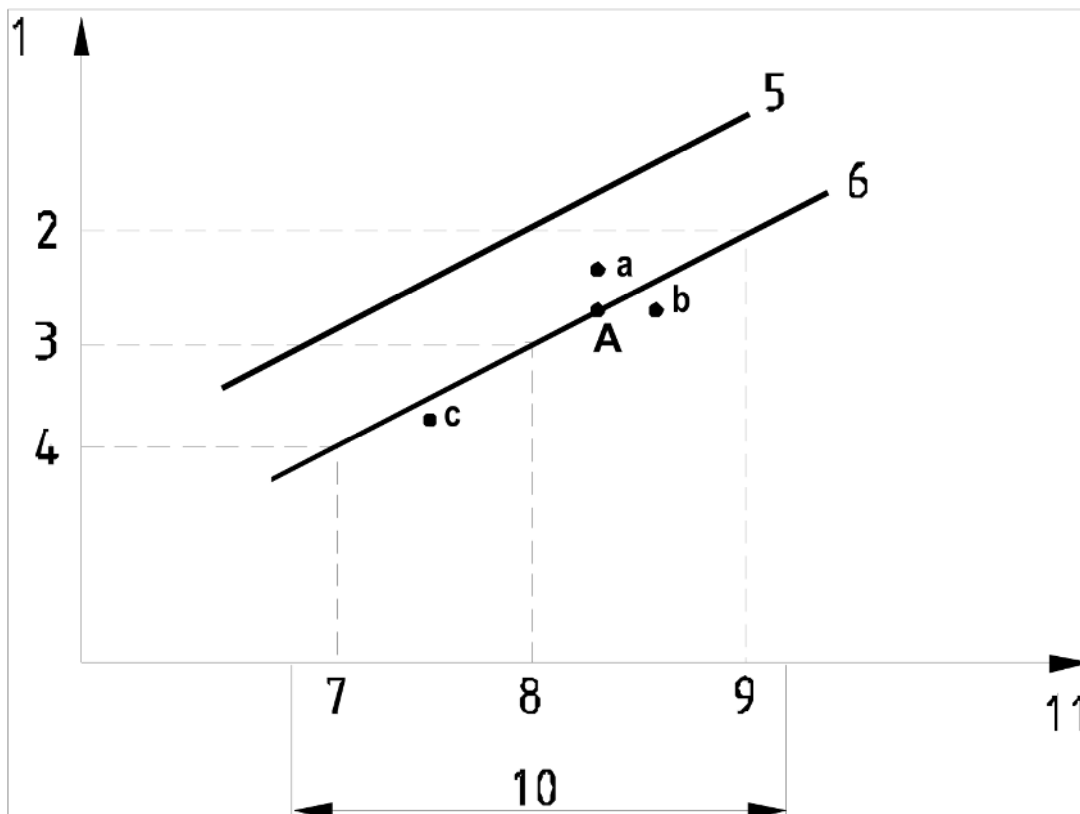

Key

- 1 $\lambda_{10,dry,unit}$ ($\text{W/m}\cdot\text{K}$)
- 2 upper limit λ value
- 3 mean λ value
- 4 lower limit λ value
- 5 curve resulting from tabulated values (combination of Annexes A and B)
- 6 parallel curve drawn through point A (mean of the single values a, b, c)
- 7 10 % of production of the product under consideration
- 8 mean gross dry density
- 9 90 % of production of the product under consideration
- 10 product density range
- 11 gross dry density (kg/m^3)

Figure 3 — Derivation of the $\lambda_{10,dry,unit}$ -value

NOTE For factory production control purposes thermal conductivity may be controlled from the gross dry density of the product, see Annex E.

5.4 Test methods and numbers of samples to be taken for the different models

In the following table test methods and numbers of samples to be taken for the different models is given.

Table 2 — Test methods and minimum numbers of specimens within the test

Test methods	Minimum numbers of specimens
<i>Model P1:</i>	
Material density, EN 772-13	6
Thermal conductivity, EN 12664	3
<i>Model P2:</i>	
Material density, EN 772-13	6
<i>Model P3:</i>	
Material density, EN 772-13	3
Thermal conductivity, EN 12664	3
<i>Model P4:</i>	
Material density, EN 772-13	6
<i>Model P5:</i>	
Gross dry density, EN 772-13 and EN 1015-10	3×6
Thermal transmittance, EN ISO 1934	3

6 Moisture conversion

Design thermal conductivity values/resistance values for masonry units or mortars may be determined using one of the following 3 procedures:

From the $\lambda_{10,dry}$ -value calculate the corresponding λ_{design} -value using the moisture conversion coefficient given in Annex A for each material and the design moisture content from the tables in EN ISO 10456 or the nationally given design moisture content for a specific material and application.

Alternatively, moisture conversion coefficients and moisture conversion factors can be derived from tests, carried out at several practical moisture contents.

Procedure 1 (for materials, mortar and solid masonry units):

$$\lambda_{design} = \lambda_{10,dry} \times F_m \quad \text{or alternatively} \quad R_{design} = \frac{R_{10,dry}}{F_m}$$

with

$$F_m = e^{f_u \times u_{design}} \quad \text{or alternatively} \quad F_m = e^{f_\psi \times \psi_{design}}$$

where

F_m	is the moisture conversion factor	[1];
f_u	is the moisture coefficient by mass	kg/kg;
u_{design}	is the design moisture content mass by mass	kg/kg;
f_ψ	is the moisture coefficient by volume	m ³ /m ³ ;
ψ_{design}	is the design moisture content volume by volume	m ³ /m ³ .

Procedure 2 (for masonry units with formed voids and composite masonry units):

Moisture conversion has to be carried out for the thermal conductivity of each constituent material according to procedure 1, followed by a calculation of the thermal conductivity of the unit according to 5.2.

For composite masonry units and partially filled units with formed voids the moisture conversion factors of each material have to be taken into account.

Procedure 3 (for masonry units with formed voids):

As an alternative to procedure 2 an approximate method taking into account the percentage of voids can be used. Details of this procedure can be found in informative Annex F.

7 Procedures to determine design thermal values ($R_{design,mas}$ or $\lambda_{design,mas}$) for masonry built from masonry units and mortar

7.1 General

Design thermal resistance or design thermal conductivity for masonry may be determined using one of following procedures.

The $R_{design,mas}$ -values or $\lambda_{design,mas}$ -values of masonry built from masonry units can be determined from calculations, from tables or from tests.

7.2 $R_{design,mas}$ - or $\lambda_{design,mas}$ -values based on calculation

7.2.1 $R_{design,mas}$ - or $\lambda_{design,mas}$ -values based on λ_{design} -values for the masonry units and the mortar

Determine the $R_{design,mas}$ - or $\lambda_{design,mas}$ -values according to the following procedure:

Calculate the $\lambda_{design,mas}$ -values using the equation:

$$\lambda_{design,mas} = a_{mor} \lambda_{design,mor} + a_{unit} \lambda_{design,unit}$$

where

- a_{mor} is the percentage area of mortar joint;
- a_{unit} is the percentage area of units;
- $\lambda_{design,mor}$ is the design equivalent thermal conductivity of the mortar joint;
- $\lambda_{design,unit}$ is the design thermal conductivity of the units.

Calculate the design thermal resistance $R_{design,mas}$ using the equation:

$$R_{design,mas} = \frac{d}{\lambda_{design,mas}}$$

where

d is the thickness of the masonry in m.

7.2.2 $R_{design,mas}$ - or $\lambda_{design,mas}$ -values using a numerical calculation method based on the design thermal conductivity of the materials used

There are several numerical methods in use (e.g. Finite Difference, Finite Element) for the calculation of the thermal properties of masonry units. The thermal conductivities of the materials as necessary input parameters for such calculations shall be the λ_{design} -value for the masonry product used.

The requirements for appropriate calculation programs (accuracy, boundary conditions, etc.) are given in Annex D.

The method described in EN ISO 6946 may also be used.

7.3 $R_{design,mas}$ - or $\lambda_{design,mas}$ -values of masonry built from masonry units with formed voids or composite masonry units and mortar based on tabulated values

7.3.1 Tabulated values

Equivalent $\lambda_{10,dry,mas}$ -values for masonry built with units having different void patterns are given in Annex B.

No tabulated values for composite masonry units are given in Annex B.

NOTE The types of units shown and the pattern of voids are intended as examples of units typically found on the market. They are not intended to cover every size and type of unit or void pattern produced.

7.3.2 Application of Annex B

Examples for material $\lambda_{10,dry,mat}$ -values for the determination of $R_{dry,mas}$ - or $\lambda_{10,dry,mas}$ -values of masonry built from masonry units with formed voids are given in Annex B, differentiated by:

- material;
- geometry of the units and geometry of formed voids;
- $\lambda_{10,dry,mat}$ -value of the material of the masonry units;
- $\lambda_{10,dry,mor}$ -value of the mortar.

The tabulated $R_{dry,mas}$ - or $\lambda_{10,dry,mas}$ -values should be taken as the basis for the calculation of any national design values, which are dependent on the climatic conditions and corrections for the application using Clause 6.

Linear interpolation may be used for material conductivities between the values given in the tables in Annex B.

7.3.3 Alternative application of Annex B

The tabulated values have been calculated assuming a specific height and length of the masonry units, a specific thickness of the horizontal mortar joints and no mortar in the vertical joints (the "basic dimensions" are given for each geometry class). For masonry built from units with a different height, a correction for the mortar joints may be taken into account as follows. The same procedure may be used to determine values for masonry with vertical mortar joints in those cases where no separate values are given. These methods are suitable for all available masonry units.

Calculate the U_{mas} -value of the masonry from the λ_{mas} -value of the masonry in the table using the equation:

$$U_{mas} = \frac{1}{R_{si} + \frac{d}{\lambda_{mas}} + R_{se}}$$

where

U_{mas} is the thermal transmittance of the masonry, in $W/(m^2 \cdot K)$;

R_{si} , R_{se} are the internal and external surface resistance in $m^2 \cdot K/W$ according to EN ISO 6946;

d is the thickness of the masonry in m;

λ_{mas} is the tabulated value of the thermal conductivity of the masonry in $W/(m \cdot K)$.

Calculate the thermal transmittance of the masonry units without mortar as follows:

$$U_{unit} = \frac{U_{mas} \times h - U_{mor} \times h_{mor}}{h_{unit}}$$

where

h_{unit} is the unit height which was the basis for the calculation of the tabulated value in mm;

h_{mor} is the height of the mortar joint which was basis for the calculation of the tabulated value in mm;

$h = h_{unit} + h_{mor}$ in mm;

U_{unit} is the thermal transmittance of the units without mortar influence in $W/(m^2 K)$;

U_{mor} is the thermal transmittance of the mortar joint in $W/(m^2 K)$ given by:

$$U_{mor} = \frac{1}{R_{si} + \frac{d}{\lambda_{mor}} + R_{se}}$$

λ_{mor} is the thermal conductivity of the mortar in W/(m·K).

Calculate the thermal transmittance of masonry built from units with another height, as follows:

$$U_{mas,act} = \frac{U_{unit} \times h_{unit,act} + U_{mor} \times h_{mor,act}}{h_{act}}$$

where

$U_{mas,act}$ is the thermal transmittance of masonry made from units with the height h_{unit} in W/m²·K;

$h_{unit,act}$ is the actual height of the unit in mm;

$h_{mor,act}$ is the actual height of the mortar joint in mm;

$h_{act} = h_{unit,act} + h_{mor,act}$ in mm.

A similar calculation may be applied for different length of masonry units and thickness of vertical mortar joints.

If there are no vertical mortar joints the differing lengths of the units may be ignored.

NOTE 1 The thermal transmittance of masonry made from masonry units with a length > 250 mm which have a tongue and groove system instead of vertical mortar joints will be lower than the tabulated value, which means that the tabulated value is on the safe side. For masonry units with shapes as shown in Figures B.23 to B.28, where the voids run continuously over the vertical joint, the length of the unit has no influence on the thermal transmittance.

NOTE 2 The heat flow direction is indicated in the drawings in Annex B by means of an arrow.

8. Determination of the thermal transmittance of masonry

Calculation of the thermal transmittance U shall be made according to EN ISO 6946.

9. Specific heat capacity

The thermal mass of the construction has a significant influence on the heating and cooling requirements of buildings. Values for the specific heat capacity c_p are therefore given in Annex A.

10. Rounding rules for λ -values for masonry

The value should be rounded according to EN ISO 10456.

Annex A (normative)

Tabulated $\lambda_{10,dry,mat}$ -values of materials used for masonry products

The water vapour diffusion coefficient μ is defined as the factor, which describes how many times higher the diffusion resistance of a material layer is, than the resistance of an air layer with the same thickness under the same conditions. To compare the diffusion resistance of two building elements, it is necessary to multiply the μ -factor by the thickness of the respective layer, which leads to a figure with the dimension m. The diffusion behaviour is different, whether it is diffusion into a building component (lower values) or out of the building component (drying period, higher value).

Table A.1 — Clay units (fired clay)

Density of the material (net dry density)	$\lambda_{10,dry,mat}$ [W/(m·K)]		Water vapour diffusion coefficient	Specific heat capacity c_p [J/(kg·K)]
	$P = 50 \% ^a$	$P = 90 \%$		
[kg/m ³]			μ	
1 000	0,20	0,27	5/10	1 000
1 100	0,23	0,30	5/10	1 000
1 200	0,26	0,33	5/10	1 000
1 300	0,30	0,36	5/10	1 000
1 400	0,34	0,40	5/10	1 000
1 500	0,37	0,43	5/10	1 000
1 600	0,41	0,47	5/10	1 000
1 700	0,45	0,51	5/10	1 000
1 800	0,49	0,55	5/10 ^b	1 000
1 900	0,53	0,60	5/10 ^b	1 000
2 000	0,58	0,64	5/10 ^b	1 000
2 100	0,62	0,69	5/10 ^b	1 000
2 200	0,67	0,74	5/10 ^b	1 000
2 300	0,72	0,79	5/10 ^b	1 000
2 400	0,77	0,84	5/10 ^b	1 000

$f_{\psi} = 10 \text{ (m}^3/\text{m}^3\text{)}$

^a Calculations in support of the Energy Performance of Buildings Directive are related to buildings and not to individual products. U -values used in such calculations are based on the mean thermal resistance of masonry elements. Therefore the recommended material λ value is the 50 % fractile.

^b For clay materials with a density between 1 800 kg/m³ and 2 400 kg/m³ used as facing materials the μ -value is 50/100 instead of 5/10.

Table A.2 — Calcium silicate units

Density of the material (net dry density) [kg/m ³]	$\lambda_{10,dry,mat}$ [W/(m·K)]		Water vapour diffusion coefficient μ	Specific heat capacity c_p [J/(kg·K)]
	$P = 50 \% ^a$	$P = 90 \%$		
900	0,22	0,29	5/10	1 000
1 000	0,24	0,30	5/10	1 000
1 100	0,26	0,32	5/10	1 000
1 200	0,30	0,36	5/10	1 000
1 300	0,34	0,41	5/10	1 000
1 400	0,40	0,46	5/10	1 000
1 500	0,47	0,53	5/25	1 000
1 600	0,55	0,61	5/25	1 000
1 700	0,64	0,70	5/25	1 000
1 800	0,75	0,81	5/25	1 000
1 900	0,86	0,92	5/25	1 000
2 000	0,98	1,05	5/25	1 000
2 100	1,14	1,20	5/25	1 000
2 200	1,31	1,37	5/25	1 000
2 300	1,49	1,56	5/25	1 000
2 400	1,68	1,76	5/25	1 000

$f_{\psi} = 10 \text{ (m}^3\text{/m}^3\text{)}$
^a Calculations in support of the Energy Performance of Buildings Directive are related to buildings and not to individual products. U -values used in such calculations are based on the mean thermal resistance of masonry elements. Therefore the recommended material λ value is the 50 % fractile.

Table A.3 — Dense aggregate concrete units and manufactured stone units

Density of the material (net dry density)	$\lambda_{10,dry,mat}$ [W/(m·K)]		Water vapour diffusion coefficient μ	Specific heat capacity c_p [J/(kg·K)]
	$P = 50 \% ^a$	$P = 90 \%$		
[kg/m ³]				
1 600	0,69	0,88	5/15	1 000
1 700	0,75	0,93	5/15	1 000
1 800	0,82	1,01	5/15	1 000
1 900	0,90	1,09	5/15	1 000
2 000	1,00	1,19	5/15	1 000
2 100	1,11	1,30	5/15	1 000
2 200	1,24	1,42	30/100	1 000
2 300	1,37	1,56	50/150	1 000
2 400	1,52	1,72	50/150	1 000

$f_{\psi} = 4 \text{ (m}^3/\text{m}^3)$

^a Calculations in support of the Energy Performance of Buildings Directive are related to buildings and not to individual products. U -values used in such calculations are based on the mean thermal resistance of masonry elements. Therefore the recommended material λ value is the 50 % fractile.

Table A.4 — Concrete units with no other aggregate than pumice

Density of the material (net dry density)	$\lambda_{10,dry,mat}$ [W/(m·K)]		Water vapour diffusion coefficient	Specific heat capacity c_p
	$P = 50 \% ^a$	$P = 90 \%$		
[kg/m ³]			μ	[J/(kg·K)]
500	0,11	0,14	5/15	1 000
600	0,13	0,16	5/15	1 000
700	0,16	0,18	5/15	1 000
800	0,19	0,21	5/15	1 000
900	0,22	0,24	5/15	1 000
1 000	0,26	0,28	5/15	1 000
1 100	0,30	0,32	5/15	1 000
1 200	0,34	0,36	5/15	1 000
1 300	0,38	0,41	5/15	1 000

$f_{\psi} = 4 \text{ (m}^3/\text{m}^3)$
^a Calculations in support of the Energy Performance of Buildings Directive are related to buildings and not to individual products. *U*-values used in such calculations are based on the mean thermal resistance of masonry elements. Therefore the recommended material λ value is the 50 % fractile.

Table A.5 — Concrete units with polystyrene aggregate

Density of the material (net dry density)	$\lambda_{10,dry,mat}$ [W/(m·K)]		Water vapour diffusion coefficient	Specific heat capacity c_p
	$P = 50 \% ^a$	$P = 90 \%$		
[kg/m ³]			μ	[J/(kg·K)]
500	0,13	0,16	5/15	1 000
600	0,14	0,19	5/15	1 000
700	0,17	0,22	5/15	1 000
800	0,18	0,25	5/15	1 000

$f_{\psi} = 5 \text{ (m}^3/\text{m}^3)$
^a Calculations in support of the Energy Performance of Buildings Directive are related to buildings and not to individual products. *U*-values used in such calculations are based on the mean thermal resistance of masonry elements. Therefore the recommended material λ value is the 50 % fractile.

Table A.6 — Concrete units with expanded clay aggregate

Density of the material (net dry density)	$\lambda_{10,dry,mat}$ [W/(m·K)]		Water vapour diffusion coefficient	Specific heat capacity c_p [J/(kg·K)]
	$P = 50 \% ^a$	$P = 90 \%$		
[kg/m ³]			μ	
400	0,10	0,12	5/15	1 000
500	0,12	0,15	5/15	1 000
600	0,16	0,18	5/15	1 000
700	0,19	0,21	5/15	1 000
800	0,22	0,25	5/15	1 000
900	0,26	0,28	5/15	1 000
1 000	0,30	0,32	5/15	1 000
1 100	0,34	0,36	5/15	1 000
1 200	0,39	0,41	5/15	1 000
1 300	0,43	0,46	5/15	1 000
1 400	0,48	0,51	5/15	1 000
1 500	0,53	0,56	5/15	1 000
1 600	0,60	0,63	5/15	1 000
1 700	0,67	0,70	5/15	1 000

$f_u = 4$ (kg/kg) if expanded clay is the predominant aggregate
 $f_u = 2,6$ (kg/kg) if expanded clay is the only aggregate
^a Calculations in support of the Energy Performance of Buildings Directive are related to buildings and not to individual products. U -values used in such calculations are based on the mean thermal resistance of masonry elements. Therefore the recommended material λ value is the 50 % fractile.

Table A.7 — Concrete units with more than 70 % expanded blast-furnace slag aggregate ^a

Density of the material (net dry density)	$\lambda_{10,dry,mat}$		Water vapour diffusion coefficient	Specific heat capacity c_p
	[W/(m·K)]			
[kg/m ³]	$P = 50 \%$ ^b	$P = 90 \%$	μ	[J/(kg·K)]
1 100	0,19	0,21	5/15	1 000
1 200	0,23	0,24	5/15	1 000
1 300	0,28	0,29	5/15	1 000
1 400	0,33	0,34	5/15	1 000
1 500	0,39	0,40	5/15	1 000
1 600	0,45	0,47	5/15	1 000
1 700	0,52	0,54	5/15	1 000

$f_u = 4$ (kg/kg)

^a A lightweight aggregate produced by the expansion of molten blast-furnace slag with water. Blast-furnace slag is a by-product of the extraction of iron haematite ores.

^b Calculations in support of the Energy Performance of Buildings Directive are related to buildings and not to individual products. U -values used in such calculations are based on the mean thermal resistance of masonry elements. Therefore the recommended material λ value is the 50 % fractile.

Table A.8 — Concrete units with the predominant aggregate derived from pyroprocessed colliery material

Density of the material (net dry density) [kg/m ³]	$\lambda_{10,dry,mat}$ [W/(m·K)]		Water vapour diffusion coefficient μ	Specific heat capacity c_p [J/(kg·K)]
	$P = 50 \% ^a$	$P = 90 \%$		
1 100	0,31	0,35	5/15	1 000
1 200	0,33	0,37	5/15	1 000
1 300	0,35	0,39	5/15	1 000
1 400	0,37	0,41	5/15	1 000
1 500	0,39	0,43	5/15	1 000

$f_u = 4$ (kg/kg)

^a Calculations in support of the Energy Performance of Buildings Directive are related to buildings and not to individual products. U -values used in such calculations are based on the mean thermal resistance of masonry elements. Therefore the recommended material λ value is the 50 % fractile

Table A.9 is to be used for concrete units with lightweight aggregates, where no history for λ exists (e.g. for new products). Therefore, no 50 % and 90 % fractiles (P) can be given, the given λ -values are to be understood as safe values for all different types of aggregates.

Table A.9 — Concrete units with other lightweight aggregates

Density of the material (net dry density) [kg/m ³]	$\lambda_{10,dry,mat}$ ^a [W/(m·K)]	Water vapour diffusion coefficient μ	Specific heat capacity c_p [J/(kg·K)]
500	0,24	5/15	1 000
600	0,27	5/15	1 000
700	0,30	5/15	1 000
800	0,33	5/15	1 000
900	0,37	5/15	1 000
1 000	0,41	5/15	1 000
1 100	0,46	5/15	1 000
1 200	0,52	5/15	1 000
1 300	0,58	5/15	1 000
1 400	0,66	5/15	1 000
1 500	0,74	5/15	1 000
1 600	0,83	5/15	1 000
1 800	1,08	5/15	1 000
2 000	1,33	5/15	1 000

$f_{\psi} = 4 \text{ (m}^3/\text{m}^3)$
^a Calculations in support of the Energy Performance of Buildings Directive are related to buildings and not to individual products. U -values used in such calculations are based on the mean thermal resistance of masonry elements. Therefore, the recommended material λ value is the 50 % fractile.

Table A.10 — Autoclaved aerated concrete units

Density of the material (net dry density)	$\lambda_{10,dry,mat}$		Water vapour diffusion coefficient	Specific heat capacity
	[W/(m·K)]			
[kg/m ³]	<i>P</i> = 50 % ^a	<i>P</i> = 90 %	μ	[J/(kg·K)]
300	0,072	0,085	5/10	1 000
400	0,096	0,11	5/10	1 000
500	0,12	0,13	5/10	1 000
600	0,15	0,16	5/10	1 000
700	0,17	0,18	5/10	1 000
800	0,19	0,21	5/10	1 000
900	0,22	0,24	5/10	1 000
1 000	0,24	0,26	5/10	1 000

$f_u = 4$ (kg/kg)

^a Calculations in support of the Energy Performance of Buildings Directive are related to buildings and not to individual products. *U*-values used in such calculations are based on the mean thermal resistance of masonry elements. Therefore the recommended material λ value is the 50 % fractile.

Table A.11 — Natural stone units ^a

Type of stone	Density of the material (net dry density) [kg/m ³]	$\lambda_{10,dry,mat}$ [W/(m·K)]	Water vapour diffusion coefficient μ		Specific heat capacity c_p [J/(kg·K)]
			dry	wet	
1. METAMORPHIC AND PLUTONIC ROCKS					
- Gneiss, porphyry	2 300 to 2 900	3,5	10 000	10 000	1 000
- Marble	2 600 to 2 800	3,5	10 000	10 000	1 000
- Granites	2 500 to 2 700	2,8	10 000	10 000	1 000
- Shale, slates	2 000 to 2 800	2,2	1 000	800	1 000
2. VOLCANIC ROCKS					
- Basalt	2 700 to 3 000	1,6	10 000	10 000	1 000
- Trachytes, andesites	2 000 to 2 700	1,1	20	15	1 000
- Vacuole lava	≤ 1 600	0,55	20	15	1 000
3. LIMESTONE					
- very hard stone	2 200 to 2 590	2,3	250	200	1 000
- hard rock	2 000 to 2 190	1,7	200	150	1 000
- compact stone	1 800 to 1 990	1,4	50	40	1 000
- soft stone	1 600 to 1 790	1,1	40	25	1 000
- very soft stone	≤ 1 590	0,85	30	20	1 000
4. SANDSTONE					
- Quartz sandstone	2 600 to 2 800	2,6	40	30	1 000
- Siliceous sandstone	2 200 to 2 590	2,3	40	30	1 000
- Calciferous sandstone	2 000 to 2 700	1,9	30	20	1 000
5. FLINT, MILLSTONE, PUMICE					
- Flint	2 600 to 2 800	2,6	10 000	10 000	1 000
- Millstone	1 900 to 2 500	1,8	50	40	1 000
- Millstone	1 300 to 1 900	0,9	30	20	1 000
- Natural pumice	≤ 400	0,12	8	6	1 000
^a For these materials the 50 % / 90 % approach is not applicable.					

Table A.12 — Mortar (masonry mortar and rendering mortar)

Density of the material (net dry density)	$\lambda_{10,dry,mat}$ [W/(m·K)]		Water vapour diffusion coefficient	Specific heat capacity c_p [J/(kg·K)]
	$P = 50 \% ^a$	$P = 90 \%$		
[kg/m ³]			μ	
200	0,074	0,081	5/20	1 000
300	0,086	0,094	5/20	1 000
400	0,10	0,11	5/20	1 000
500	0,12	0,13	5/20	1 000
600	0,14	0,15	5/20	1 000
700	0,16	0,17	5/20	1 000
800	0,18	0,20	5/20	1 000
900	0,21	0,23	5/20	1 000
1 000	0,25	0,27	5/20	1 000
1 200	0,33	0,36	5/20	1 000
1 400	0,45	0,49	5/20	1 000
1 600	0,61	0,66	15/35	1 000
1 800	0,82	0,89	15/35	1 000
2 000	1,11	1,21	15/35	1 000

$f_{\psi} = 4 \text{ (m}^3/\text{m}^3\text{)}$
^a Calculations in support of the Energy Performance of Buildings Directive are related to buildings and not to individual products. U -values used in such calculations are based on the mean thermal resistance of masonry elements. Therefore the recommended material λ value is the 50 % fractile.

Annex B (informative)

$R_{dry,mas}$ - or $\lambda_{10,dry,mas}$ -values of masonry built from a range of masonry units containing formed voids

NOTE The range of size and types of unit and void pattern is intended to be representative of units typically found on the market. It is not intended to be an exhaustive list covering all combinations of material, unit size, void configuration and size. The procedure according to 7.3.3 will need to be followed for configurations of units not covered by these tables.

The geometries are defined numerically by two figures:

- the number of rows of voids; and
- the number of voids in a row.

For example 3,7/1,6 means that this type of unit has 3,7 rows of voids per 100 mm thickness and 1,6 voids in a row per 100 mm length, which means 11 rows of voids in the case of a masonry thickness of 300 mm and 4 voids in a row in the case of a unit length of 250 mm. The transverse web portion is defined as the sum of the thicknesses of the transverse webs divided by the unit length expressed as a percentage and is given for each geometry as additional information.

Further information is given for each geometry about the dimensions, which were the basis for the numerical calculation.

The following tabulated values should be used as a basis for the determination of unit equivalent $\lambda_{10,dry,unit}$ -values or $R_{dry,mas}$ - or $\lambda_{10,dry,mas}$ -values of the masonry if neither an individual test measurement nor a calculation are available for a specific product.

The values in this annex were calculated using a three-dimensional Finite-Difference-Program.

The equivalent thermal conductivity of the air in the voids was determined according to EN ISO 6946:2007, B.2. The program used was checked through the examples shown in Annex D and fulfils all the requirements for appropriate calculation procedures.

The theoretical background for the selection of geometries was knowledge about the principal geometrical influences on the thermal resistance:

- number of rows of voids;
- thickness of the material webs between the voids (transverse web portion);
- voids staggered or "in line";
- shape of the voids.

(experience shows that the last two factors can be neglected-for the purpose of tabulated values).

The tabulated values in the following tables are generally given for masonry with only horizontal mortar joints.

In some cases, the tabulated values are split into two, one of which is valid without vertical mortar joints and the second is valid with vertical mortar joints. For those geometry classes, where no separate values are given use the calculation procedure in 7.3.3.

The thermal resistance of the mortar joints on which the calculation results are based can be derived in different ways. Full bed mortar joints may be provided using an insulating mortar or it is possible to reach the same resistance/equivalent conductivity by making twin strip mortar joints from a general purpose mortar, possible with a strip of insulating material in between.

The values are grouped according to the material of the masonry units, nevertheless, the calculation results are also valid for other materials, if the geometry and the thermal conductivity of the material is the same.

The resistance-values are tabulated as resistance per 100 mm, which means for example that for a masonry of 300 mm thickness the values have to be multiplied by 3. As additional information, the calculation results are also given as $\lambda_{10,dry,mas}$ -values of the masonry, which are calculated according to the following equation:

$$\lambda_{10,dry,mas} = \frac{0,1}{R_{dry,mas}}$$

The values for the percentage of voids given in the tables are related to the cross section of the units.

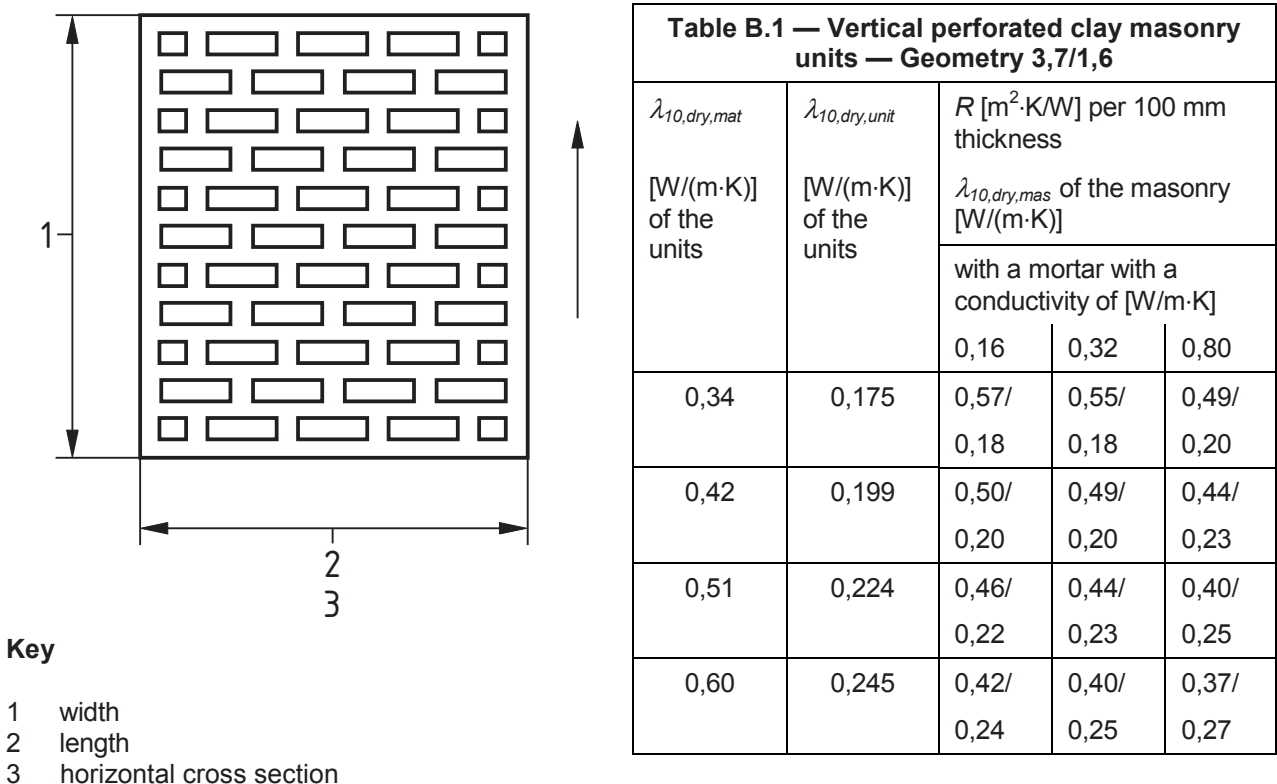


Figure B.1 — Vertical perforated clay masonry units — Geometry 3,7/1,6

(transverse web portion: 26,4 %; percentage of voids : 38,4 %)

basic dimensions: $l = 250$ mm, $w = 300$ mm, $h_{unit} = 238$ mm, $h_{mor} = 12$ mm

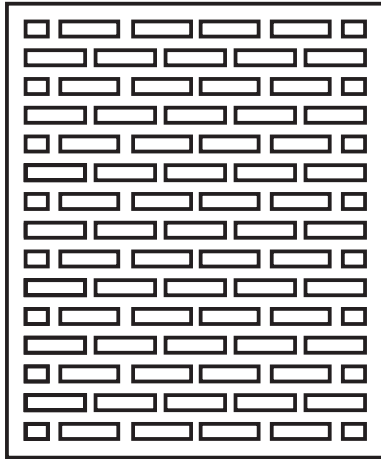


Figure B.2 — Vertically perforated clay masonry units — Geometry 5/2

Table B.2 — Vertically perforated clay masonry units — Geometry 5/2

$\lambda_{10,dry,mat}$ [W/(m·K)] of the units	$\lambda_{10,dry,unit}$ [W/(m·K)] of the units	R [m ² ·K/W] per 100 mm thickness/ $\lambda_{10,dry,mas}$ of the masonry [W/(m·K)]		
		with a mortar with a conductivity of [W/m·K]		
		0,16	0,32	0,80
0,34	0,161	0,62/ 0,16	0,59/ 0,17	0,53/ 0,19
0,42	0,182	0,58/ 0,18	0,53/ 0,19	0,48/ 0,21
0,51	0,203	0,50/ 0,20	0,48/ 0,21	0,43/ 0,23
0,60	0,224	0,45/ 0,22	0,44/ 0,23	0,40/ 0,25

(transverse web portion: 25,8 %; percentage of voids : 37,5 %)
basic dimensions: $l = 250$ mm, $w = 300$ mm, $h_{unit} = 238$ mm, $h_{mor} = 12$ mm

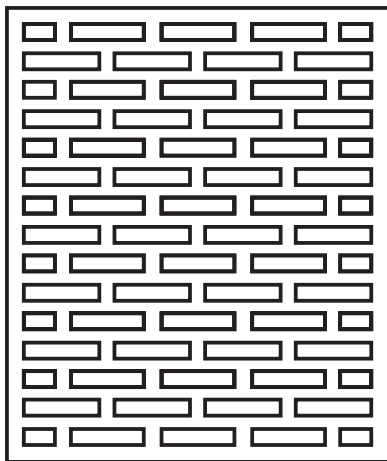


Figure B.3 — Vertically perforated clay masonry units — Geometry 5/1,6

Table B.3 — Vertically perforated clay masonry units — Geometry 5/1,6

$\lambda_{10,dry,mat}$ [W/(m·K)] of the units	$\lambda_{10,dry,unit}$ [W/(m·K)] of the units	R [m ² ·K/W] per 100 mm thickness/ $\lambda_{10,dry,mas}$ of the masonry [W/(m·K)]		
		with a mortar with a conductivity of [W/m·K]		
		0,16	0,32	0,80
0,34	0,150	0,65/ 0,15	0,62/ 0,16	0,55/ 0,18
0,42	0,171	0,58/ 0,17	0,56/ 0,18	0,50/ 0,20
0,51	0,192	0,53/ 0,19	0,51/ 0,20	0,46/ 0,22
0,60	0,203	0,49/ 0,20	0,47/ 0,21	0,43/ 0,23

(transverse web portion: 22,2 %; percentage of voids: 39,1 %)
basic dimensions: $l = 250$ mm, $w = 300$ mm, $h_{unit} = 238$ mm, $h_{mor} = 12$ mm

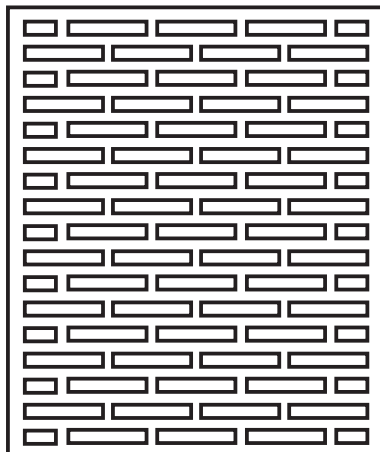


Figure B.4 — Vertically perforated clay masonry units — Geometry 5,7/1,6

Table B.4 — Vertically perforated clay masonry units — Geometry 5,7/1,6

$\lambda_{10,dry,mat}$ [W/(m·K)] of the units	$\lambda_{10,dry,unit}$ [W/(m·K)] of the units	R [m ² ·K/W] per 100 mm thickness/ $\lambda_{10,dry,mas}$ of the masonry [W/(m·K)]		
		with a mortar with a conductivity of [W/m·K]		
		0,16	0,32	0,80
0,34	0,140	0,70/ 0,14	0,66/ 0,15	0,59/ 0,17
0,42	0,161	0,63/ 0,16	0,60/ 0,17	0,54/ 0,19
0,51	0,175	0,57/ 0,18	0,55/ 0,18	0,49/ 0,20
0,60	0,192	0,53/ 0,19	0,51/ 0,20	0,46/ 0,22

(transverse web portion: 20,8 %; percentage of voids: 39,3 %)
basic dimensions: $l = 250$ mm, $w = 300$ mm, $h_{unit} = 238$ mm, $h_{mor} = 12$ mm

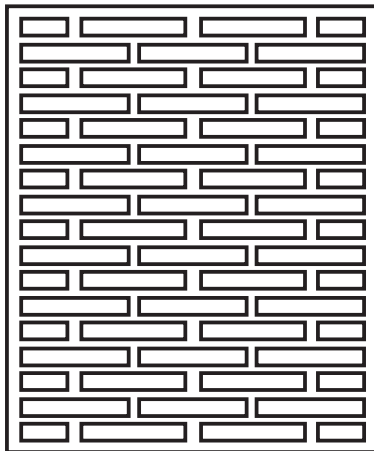


Figure B.5 — Vertically perforated clay masonry units — Geometry 5,7/1,2

Table B.5 — Vertically perforated clay masonry units — Geometry 5,7/1,2

$\lambda_{10,dry,mat}$ [W/(m·K)] of the units	$\lambda_{10,dry,unit}$ [W/(m·K)] of the units	R [m ² ·KW] per 100 mm thickness/ $\lambda_{10,dry,mas}$ of the masonry [W/(m·K)] with a mortar with a conductivity of [W/(m·K)]		
		0,16	0,32	0,80
0,34	0,129	0,75/ 0,13	0,71/ 0,14	0,63/ 0,16
0,42	0,140	0,69/ 0,14	0,65/ 0,15	0,58/ 0,17
0,51	0,157	0,64/ 0,16	0,61/ 0,16	0,54/ 0,19
0,60	0,171	0,59/ 0,17	0,57/ 0,18	0,51/ 0,20

(transverse web portion: 15,6 %; percentage of voids: 50,9 %)
basic dimensions: $l = 250$ mm, $w = 300$ mm, $h_{unit} = 238$ mm, $h_{mor} = 12$ mm

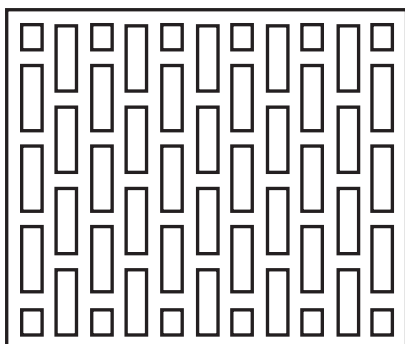


Figure B.6 — Vertically perforated clay masonry — Geometry 1,6/3,7

Table B.6 — Vertically perforated clay masonry — Geometry 1,6/3,7

$\lambda_{10,dry,mat}$ [W/(m·K)] of the units	$\lambda_{10,dry,unit}$ [W/(m·K)] of the units	R [m ² ·KW] per 100 mm thickness/ $\lambda_{10,dry,mas}$ of the masonry [W/(m·K)] with a mortar with a conductivity of [W/(m·K)]	
		0,32	0,80
0,34	0,296	0,33 0,30	0,31 0,32
0,42	0,342	0,29 0,34	0,27 0,37
0,51	0,392	0,26 0,39	0,24 0,41
0,60	0,441	0,23 0,44	0,22 0,46

(transverse web portion : 48,0 %; percentage of voids: 38,4 %)

basic dimensions: $l = 300$ mm, $w = 250$ mm, $h_{unit} = 238$ mm, $h_{mor} = 12$ mm

NOTE There are no values given for a combination of such a masonry unit with a mortar with a conductivity of 0,16 W/m·K, because such a combination would not be sensible.

Table B.7 — Vertically perforated clay masonry units — Geometry 2,8/4,1

$\lambda_{10,dry,mat}$ [W/(m·K)] of the units	$\lambda_{10,dry,unit}$ [W/(m·K)] of the units	R [m ² ·KW] per 100 mm thickness/ $\lambda_{10,dry,mas}$ of the masonry [W/(m·K)]			
		with a mortar with a conductivity of [W/(m·K)]			
		0,16	0,32	0,80	^a
0,25	0,221	0,48/	0,42/	0,32/	(0,30)/
		0,21	0,24	0,31	(0,33)
0,34	0,265	0,40/	0,36/	0,29/	(0,28)/
		0,25	0,28	0,34	(0,36)/
0,42	0,324	0,33/	0,31/	0,25/	(0,24)/
		0,30	0,33	0,39	(0,41)/
0,51	0,387	0,28/	0,26/	0,22/	(0,21)/
		0,35	0,38	0,45	(0,47)/
0,60	0,446	0,25/	0,23/	0,20/	(0,19)/
		0,40	0,43	0,50	(0,52)/

^a Values in brackets are where there is a vertical mortar joint.

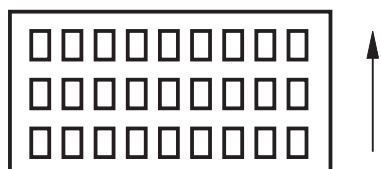


Figure B.7 — Vertically perforated clay masonry units — Geometry 2,8/4,1

(transverse web portion: 50,9 %; percentage of voids: 30 %)

basic dimensions: $l = 220$ mm, $w = 105$ mm, $h_{unit} = 65$ mm, $h_{mor} = 12$ mm

Table B.8 — Vertically perforated clay masonry units — Geometry 2,17/4,51

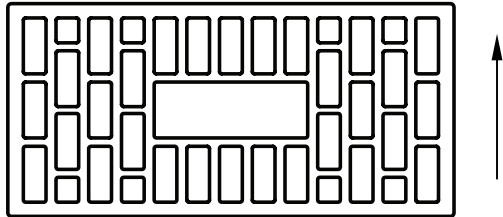


Figure B.8 — Vertically perforated clay masonry units — Geometry 2,17/4,51

$\lambda_{10,dry,mat}$ [W/(m·K)] of the units	$\lambda_{10,dry,unit}$ [W/(m·K)] of the units	R [m ² ·K/W] per 100 mm thickness/ $\lambda_{10,dry,mas}$ of the masonry [W/(m·K)]		
		with a mortar with a conductivity of [W/(m·K)] ^a		
		0,16	0,32	0,80
0,25	0,20	0,53	0,50	0,42
		0,19	0,20	0,24
0,34	0,21	0,50	0,48	0,40
		0,20	0,21	0,25
0,42	0,21	0,43	0,42	0,36
		0,23	0,24	0,28
0,51	0,24	0,38	0,37	0,32
		0,26	0,27	0,31
0,60	0,29	0,34	0,33	0,29
		0,29	0,30	0,34

^a All values are with vertical mortar joints.

(transverse web portion: 31 %; percentage of voids: 53 %)
basic dimensions: $l = 288$ mm, $w = 138$ mm, $h_{unit} = 138$ mm, $h_{mor} = 12$ mm

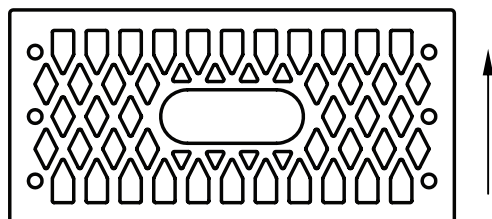


Table B.9 — Vertically perforated clay masonry units — Geometry 3,62/3,82

$\lambda_{10,dry,mat}$ [W/(m·K)] of the units	$\lambda_{10,dry,unit}$ [W/(m·K)] of the units	R [m ² ·K/W] per 100 mm thickness/ $\lambda_{10,dry,mas}$ of the masonry [W/(m·K)]		
		with a mortar with a conductivity of [W/(m·K)] ^a		
		0,16	0,32	0,80
0,25	0,20	0,50 0,20	0,48 0,21	0,42 0,24
0,34	0,22	0,45 0,22	0,43 0,23	0,38 0,26
0,42	0,27	0,37 0,27	0,36 0,28	0,32 0,31
0,51	0,30	0,34 0,29	0,33 0,30	0,29 0,34
0,60	0,37	0,28 0,36	0,27 0,37	0,24 0,41

^a All values are with vertical mortar joints.

**Figure B.9 — Vertically perforated
clay masonry units — Geometry
3,62/3,82**

(transverse web portion: 64 %; percentage of voids: 39 %)
basic dimensions: $l = 288$ mm, $w = 138$ mm, $h_{unit} = 138$ mm, $h_{mor} = 12$ mm

Table B.10 — Vertically perforated clay masonry units — Geometry 1,9/2,3


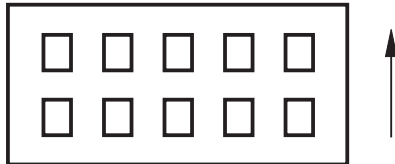


Figure B.10 — Vertically perforated clay masonry units — Geometry 1,9/2,3

$\lambda_{10,dry,mat}$ [W/(m·K)] of the units	$\lambda_{10,dry,unit}$ [W/(m·K)] of the units	R [m ² ·K/W] per 100 mm thickness/ $\lambda_{10,dry,mas}$ of the masonry [W/(m·K)]			
		with a mortar with a conductivity of [W/(m·K)]			
		0,16	0,32	0,80	^a
0,25	0,199	0,50/ 0,20	0,44/ 0,23	0,35/ 0,29	(0,32)/ (0,31)
0,34	0,280	0,38/ 0,26	0,34/ 0,29	0,27/ 0,37	(0,26)/ (0,39)
0,42	0,341	0,32/ 0,31	0,29/ 0,34	0,24/ 0,42	(0,23)/ (0,44)
0,51	0,414	0,27/ 0,37	0,25/ 0,40	0,21/ 0,48	(0,20)/ (0,50)
0,60	0,479	0,24/ 0,42	0,22/ 0,45	0,18/ 0,54	(0,18)/ (0,55)/

^a Values in brackets are where there is a vertical mortar joint.

(transverse web portion: 54,5 %; percentage of voids: 17,3 %)
basic dimensions: $l = 220$ mm, $w = 105$ mm, $h_{unit} = 55$ mm, $h_{mor} = 12$ mm

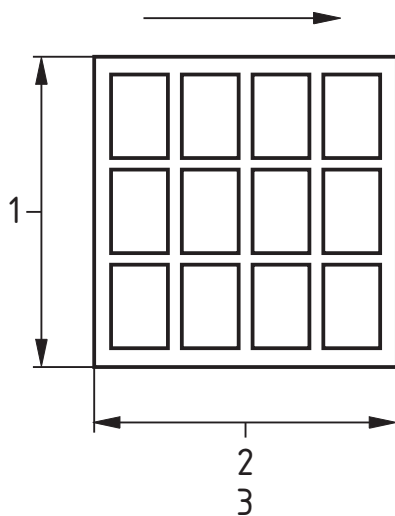

Key
1 height
2 width
3 vertical cross section

Figure B.11 — Horizontally perforated clay Masonry — Geometry units 2/1,5

Table B.11 — Horizontally perforated clay masonry — Geometry units 2/1,5

$\lambda_{10,dry,mat}$ [W/(m·K)] of the units	$\lambda_{10,dry,unit}$ [W/(m·K)] of the units	R [m ² ·K/W] per 100 mm thickness/ $\lambda_{10,dry,mas}$ of the masonry [W/(m·K)]			
		with a mortar with a conductivity of [W/(m·K)]			
		0,16	0,32	0,80	^a
0,34	0,222	0,45/ 0,22	0,44/ 0,23	0,39/ 0,25	(0,37)/ (0,27)
0,42	0,243	0,42/ 0,24	0,40/ 0,25	0,37/ 0,27	(0,35)/ (0,28)
0,51	0,257	0,40/ 0,25	0,38/ 0,26	0,34 0,29	(0,33)/ (0,30)
0,60	0,282	0,36/ 0,28	0,36/ 0,28	0,32/ 0,31	(0,31)/ (0,32)/

^a The values in brackets are for the case where there is a vertical mortar joint.

(transverse web portion: 16 %;
percentage of voids: 63,9 %)

basic dimensions: $l = 500$ mm, $w = 200$ mm, $h_{unit} = 200$ mm, $h_{mor} = 12$ mm

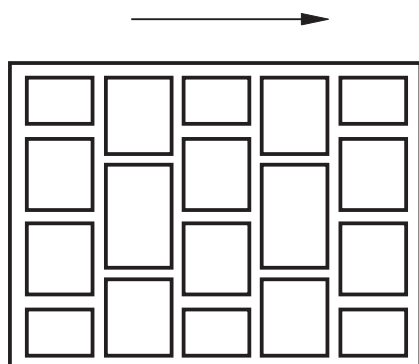


Figure B.12 — Horizontally perforated clay masonry units — Geometry 1,85/1,5

Table B.12 — Horizontally perforated clay masonry units — Geometry 1,85/1,5

$\lambda_{10,dry,mat}$ [W/(m·K)] of the units	$\lambda_{10,dry,unit}$ [W/(m·K)] of the units	R [m ² ·K/W] per 100 mm thickness/ $\lambda_{10,dry,mas}$ of the masonry [W/m·K] with a mortar with a conductivity of [W/m·K]			
		0,16	0,32	0,80	^a
0,34	0,160	0,44/ 0,22	0,43/ 0,23	0,40/ 0,25	(0,38)/ (0,26)
0,42	0,169	0,42/ 0,24	0,40/ 0,25	0,37/ 0,27	(0,36)/ (0,28)
0,51	0,183	0,38/ 0,26	0,37/ 0,27	0,34/ 0,29	(0,33)/ (0,30)
0,60	0,201	0,36/ 0,28	0,34/ 0,29	0,33/ 0,31	(0,31)/ (0,32)

^a The values in brackets are for the case where there is a vertical mortar joint.

(transverse web portion: 21,5 %; percentage of voids: 62,8 %)
basic dimensions: $l = 500$ mm, $w = 270$ mm, $h_{unit} = 200$ mm, $h_{mor} = 12$ mm

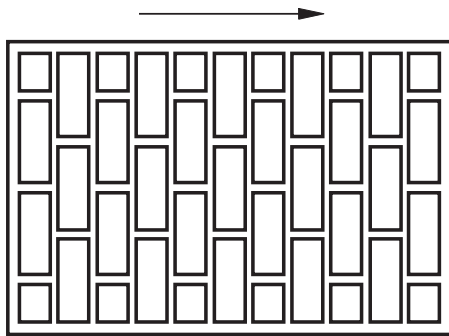


Figure B.13 — Horizontally perforated clay masonry units — Geometry 3,7/1,5

(transverse web portion: 18,5 %; percentage of voids: 61,8 %)
basic dimensions: $l = 500$ mm, $w = 300$ mm, $h_{unit} = 200$ mm, $h_{mor} = 12$ mm

Table B.13 — Horizontally perforated clay masonry units — Geometry 3,7/1,5

$\lambda_{10,dry,mat}$	$\lambda_{10,dry,unit}$	R [$m^2 \cdot K/W$] per 100 mm thickness/ $\lambda_{10,dry,mas}$ of the masonry [$W/(m \cdot K)$]			
		with a mortar with a conductivity of [$W/(m \cdot K)$]			
[$W/(m \cdot K)$] of the units	[$W/(m \cdot K)$] of the units	0,16	0,32	0,80	^a
0,34	0,169	0,59/ 0,17	0,55/ 0,18	0,50/ 0,20	(0,48)/ (0,21)
0,42	0,183	0,55/ 0,18	0,51/ 0,19	0,46/ 0,22	(0,43)/ (0,23)
0,51	0,201	0,50/ 0,20	0,48/ 0,21	0,43/ 0,23	(0,40)/ (0,25)
0,60	0,222	0,46/ 0,22	0,43/ 0,23	0,40/ 0,25	(0,38)/ (0,26)

^a The values in brackets are for the case where there is a vertical mortar joint.

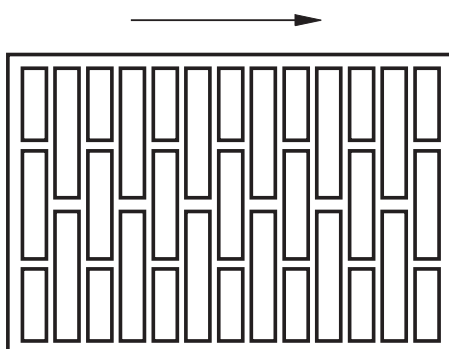


Figure B.14 — Horizontally perforated clay masonry units — Geometry 4,3/1

(transverse web portion: 15,4 %; percentage of voids: 56,3 %)
basic dimensions: $l = 500$ mm, $w = 300$ mm, $h_{unit} = 200$ mm, $h_{mor} = 12$ mm

Table B.14 — Horizontally perforated clay masonry units — Geometry 4,3/1

$\lambda_{10,dry,mat}$	$\lambda_{10,dry,unit}$	R [$m^2 \cdot K/W$] per 100 mm thickness/ $\lambda_{10,dry,mas}$ of the masonry [$W/(m \cdot K)$]			
		with a mortar with a conductivity of [$W/(m \cdot K)$]			
[$W/(m \cdot K)$] of the units	[$W/(m \cdot K)$] of the units	0,16	0,32	0,80	^a
0,34	0,151	0,64/ 0,15	0,61/ 0,16	0,53/ 0,19	(0,50)/ (0,20)
0,42	0,169	0,59/ 0,17	0,56/ 0,18	0,50/ 0,20	(0,48)/ (0,21)
0,51	0,186	0,53/ 0,19	0,53/ 0,19	0,46/ 0,22	(0,43)/ (0,23)
0,60	0,201	0,50/ 0,20	0,48/ 0,21	0,43/ 0,23	(0,41)/ (0,24)

^a The values in brackets are for the case where there is a vertical mortar joint.

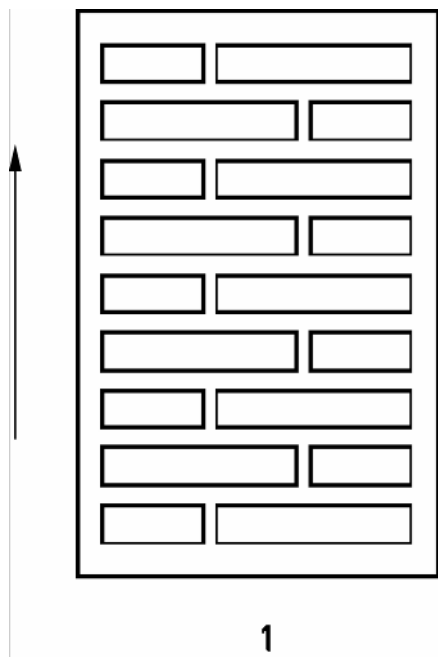


Table B.15 — Calcium silicate masonry units — Geometry 2,5/0,8

$\lambda_{10,dry,mat}$ [W/(m·K)] of the units	$\lambda_{10,dry,unit}$ [W/(m·K)] of the units	R [m ² ·K/W] per 100 mm thickness/ $\lambda_{10,dry,mas}$ of the masonry [W/(m·K)]			
		with a mortar with a conductivity of [W/(m·K)]			thin layer mortar
		0,16	0,32	0,80	
0,32	0,192	0,52/ 0,19	0,50/ 0,20	0,46/ 0,22	0,52/ 0,19
0,64	0,276	0,37/ 0,27	0,36/ 0,28	0,33/ 0,30	0,36/ 0,28

Key

1 horizontal cross section

Figure B.15 — Calcium silicate masonry units — Geometry 2,5/0,8

(transverse web portion: 20 %; percentage of voids: 46 %)
basic dimensions: $l = 240$ mm, $w = 365$ mm, $h_{unit} = 238$ mm, $h_{mor} = 12$ mm

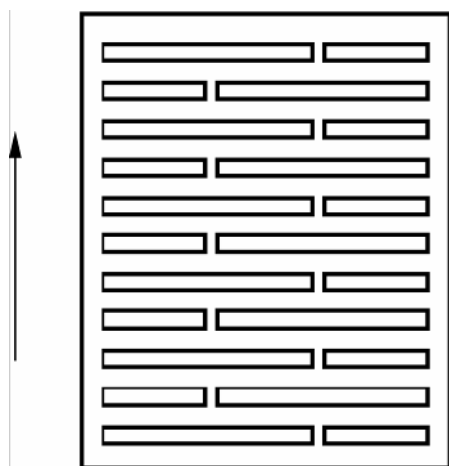


Table B.16 — Calcium silicate masonry units — Geometry 3,7/0,8

$\lambda_{10,dry,mat}$ [W/(m·K)] of the units	$\lambda_{10,dry,unit}$ [W/(m·K)] of the units	R [m ² ·K/W] per 100 mm thickness/ $\lambda_{10,dry,mas}$ of the masonry [W/(m·K)]			
		with a mortar with a conductivity of [W/(m·K)]			Thin layer mortar
		0,16	0,32	0,80	
0,32	0,178	0,57/ 0,18	0,54/ 0,19	0,49/ 0,20	0,57/ 0,18
0,64	0,259	0,40/ 0,25	0,38/ 0,26	0,35/ 0,29	0,39/ 0,26

Figure B.16 — Calcium silicate masonry units — Geometry 3,7/0,8

(transverse web portion: 16 %; percentage of voids: 30 %)
basic dimensions: $l = 247$ mm, $w = 365$ mm, $h_{unit} = 238$ mm, $h_{mor} = 12$ mm

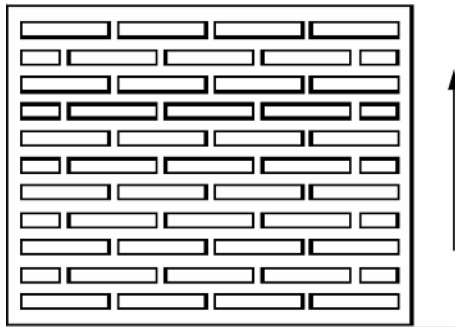


Figure B.17 — Calcium silicate masonry units — Geometry 3,7/1,1

Table B.17 — Calcium silicate masonry units — Geometry 3,7/1,1

$\lambda_{10,dry,mat}$	$\lambda_{10,dry,unit}$	R [m ² ·K/W] per 100 mm thickness/ $\lambda_{10,dry,mas}$ of the masonry [W/m·K]			
		with a mortar with a conductivity of [W/m·K]			thin layer mortar
[W/(m·K)] of the units	[W/(m·K)] of the units	0,16	0,32	0,80	
0,32	0,171	0,60/ 0,17	0,57/ 0,18	0,51/ 0,20	0,60/ 0,17
0,64	0,259	0,41/ 0,24	0,40/ 0,25	0,37/ 0,27	0,41/ 0,24

(transverse web portion: 19 %; percentage of voids: 34 %)
basic dimensions: $l = 373$ mm, $w = 300$ mm, $h_{unit} = 238$ mm, $h_{mor} = 12$ mm

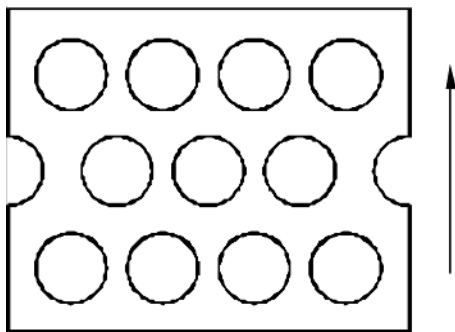


Figure B.18 — Calcium silicate masonry units — Geometry 1,3/1,3

Table B.18 — Calcium silicate masonry units — Geometry 1,3/1,3

$\lambda_{10,dry,mat}$	$\lambda_{10,dry,unit}$	R [m ² ·K/W] per 100 mm thickness/ $\lambda_{10,dry,mas}$ of the masonry [W/m·K]	
		with a mortar with a conductivity of [W/m·K]	thin layer mortar
[W/(m·K)] of the units	[W/(m·K)] of the units	0,80	
0,64	0,440	0,22/ 0,45	0,22/ 0,45
1,05	0,666	0,15/ 0,67	0,15/ 0,67

(transverse web portion: 39 %; percentage of voids: 28 %)
basic dimensions: $l = 300$ mm, $w = 240$ mm, $h_{unit} = 238$ mm, $h_{mor} = 12$ mm

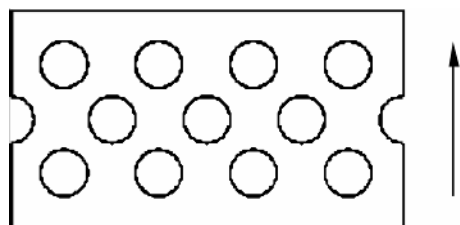


Figure B.19 — Calcium silicate masonry units — Geometry 1,7/1,3

(transverse web portion: 59 %; percentage of voids: 17 %)
basic dimensions: $l = 300$ mm, $w = 175$ mm, $h_{unit} = 238$ mm, $h_{mor} = 12$ mm

Table B.19 — Calcium silicate masonry units — Geometry 1,7/1,3

$\lambda_{10,dry,mat}$	$\lambda_{10,dry,unit}$	R [$m^2 \cdot K/W$] per 100 mm thickness/ $\lambda_{10,dry,mas}$ of the masonry [$W/(m \cdot K)$]	
		with a mortar with a conductivity of [$W/(m \cdot K)$]	
[$W/(m \cdot K)$] of the units	[$W/(m \cdot K)$] of the units	0,80	thin layer mortar
0,64	0,430	0,20/ 0,50	0,20/ 0,50
1,05	0,666	0,13/ 0,77	0,13/ 0,77

Table B.20 — Calcium silicate masonry units — Geometry 1,7/1,7

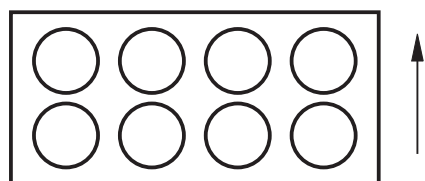


Figure B.20 — Calcium silicate masonry units — Geometry 1,7/1,7

(transverse web portion: 33 %; percentage of voids: 36 %)
basic dimensions: $l = 240$ mm, $w = 115$ mm, $h_{unit} = 238$ mm, $h_{mor} = 12$ mm

$\lambda_{10,dry,mat}$	$\lambda_{10,dry,unit}$	R [$m^2 \cdot K/W$] per 100 mm thickness/ $\lambda_{10,dry,mas}$ of the masonry [$W/(m \cdot K)$]	
		with a mortar with a conductivity of [$W/(m \cdot K)$]	
[$W/(m \cdot K)$] of the units	[$W/(m \cdot K)$] of the units	0,80	
0,64	0,411	0,23/ 0,43	
1,05	0,621	0,16/ 0,63	

Table B.21 — Calcium silicate masonry units — Geometry 2,1/1,3

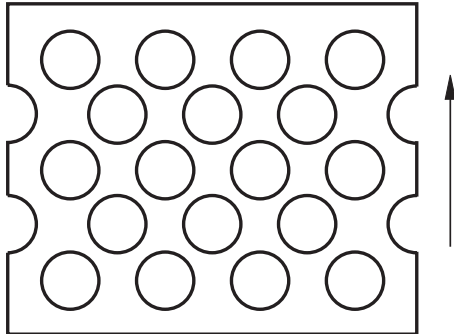


Figure B.21 — Calcium silicate masonry units — Geometry 2,1/1,3

(transverse web portion: 49 %; percentage of voids: 32 %)
basic dimensions: $l = 300$ mm, $w = 240$ mm, $h_{unit} = 238$ mm, $h_{mor} = 12$ mm

$\lambda_{10,dry,mat}$ [W/(m·K)] of the units	$\lambda_{10,dry,unit}$ [W/(m·K)] of the units	R [m ² ·K/W] per 100 mm thickness/ $\lambda_{10,dry,mas}$ of the masonry [W/m·K] with a mortar with a conductivity of [W/m·K]	
		0,80	thin layer mortar
0,64	0,405	0,23/ 0,43	0,25/ 0,40
1,05	0,625	0,16/ 0,63	0,16/ 0,63

Table B.22 — Calcium silicate masonry units — Geometry 2,1/1,7

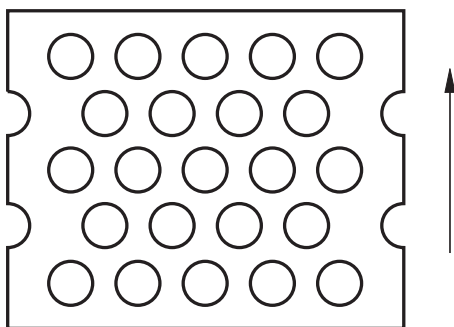


Figure B.22 — Calcium silicate masonry units — Geometry 2,1/1,7

(transverse web portion: 50 %; percentage of voids: 25 %)
basic dimensions: $l = 300$ mm, $w = 240$ mm, $h_{unit} = 238$ mm, $h_{mor} = 12$ mm

$\lambda_{10,dry,mat}$ [W/(m·K)] of the units	$\lambda_{10,dry,unit}$ [W/(m·K)] of the units	R [m ² ·K/W] per 100 mm thickness/ $\lambda_{10,dry,mas}$ of the masonry [W/(m·K)] with a mortar with a conductivity of [W/(m·K)]	
		0,80	thin layer mortar
0,64	0,430	0,22/ 0,45	0,23/ 0,43
1,05	0,666	0,15/ 0,67	0,15/ 0,67

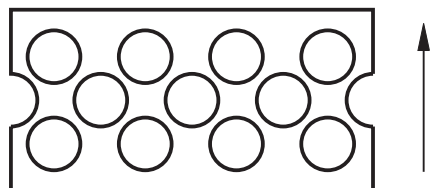


Figure B.23 — Calcium silicate masonry units — Geometry 2,6/1,7

(transverse web portion: 50 %; percentage of voids: 31 %)
basic dimensions: $l = 240$ mm, $w = 115$ mm, $h_{unit} = 113$ mm, $h_{mor} = 12$ mm

Table B.23 — Calcium silicate masonry units — Geometry 2,6/1,7

$\lambda_{10,dry,mat}$	$\lambda_{10,dry,unit}$	R [m ² ·K/W] per 100 mm thickness/ $\lambda_{10,dry,mas}$ of the masonry [W/m·K]
[W/(m·K)] of the units	[W/(m·K)] of the units	with a mortar with a conductivity of [W/m·K]
		0,80
0,64	0,391	0,23/ 0,43
1,05	0,612	0,16/ 0,63

Table B.24 — Calcium silicate masonry units — Geometry 2,6/2,1

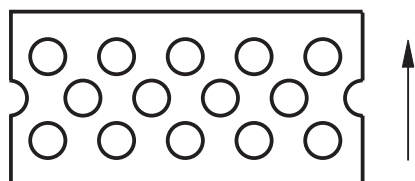


Figure B.24 — Calcium silicate masonry units — Geometry 2,6/2,1


(transverse web portion: 63 %; percentage of voids: 14 %)
basic dimensions: $l = 240$ mm, $w = 115$ mm, $h_{unit} = 113$ mm, $h_{mor} = 12$ mm

$\lambda_{10,dry,mat}$	$\lambda_{10,dry,unit}$	R [m ² ·K/W] per 100 mm thickness/ $\lambda_{10,dry,mas}$ of the masonry [W/m·K]
[W/(m·K)] of the units	[W/(m·K)] of the units	with a mortar with a conductivity of [W/m·K]
		0,80
0,64	0,501	0,19/ 0,53
1,05	0,833	0,12/ 0,83

NOTE Tables B.23 to B.28 inclusive were calculated without vertical mortar joints. Tables B.29 to B.33 inclusive were calculated with mortar pockets. Table B.34 is based on a continuous vertical mortar joint.

The values in Tables B.29 to B.33 inclusive are valid for more than one shape, the drawings shown are only examples for the geometries covered.

**Table B.25 — Lightweight concrete masonry units
— Geometry 1/1,2**

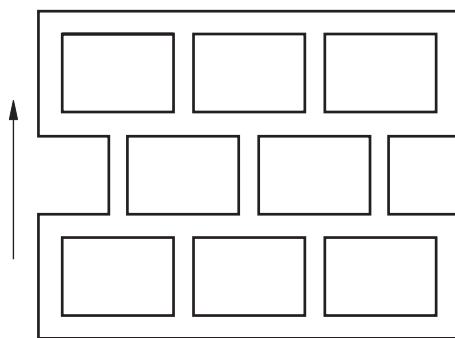

**Figure B.25 — Lightweight
concrete masonry units —
Geometry 1/1,2**

$\lambda_{10,dry,mat}$	$\lambda_{10,dry,unit}$	R [$m^2 \cdot K/W$] per 100 mm thickness/ $\lambda_{10,dry,mas}$ of the masonry [$W/(m \cdot K)$]		
		with a mortar with a conductivity of [$W/(m \cdot K)$]		
[$W/(m \cdot K)$] of the units	[$W/(m \cdot K)$] of the units	0,16	0,32	0,80 ^a
0,35	0,315	0,32/ 0,31	0,31/ 0,32	0,29/ 0,34
0,50	0,378	0,27/ 0,37	0,27/ 0,37	0,25/ 0,40
0,67	0,431	0,24/ 0,42	0,24/ 0,42	0,22/ 0,45
0,83	0,484	-	0,21/ 0,48	0,20/ 0,50
1,00	0,515	-	-	0,19/ 0,53
1,25	0,579	-	-	0,17/ 0,59
1,50	0,663	-	-	0,15/ 0,67

^a These values are valid, if there is no mortar in the vertical joint (which means that the rows of voids are not interrupted in the vertical joint).

(transverse web portion: 16 % to 21 %; percentage of voids: 58,9 %)
basic dimensions: $l = 380$ mm, $w = 300$ mm, $h_{unit} = 221$ mm, $h_{mor} = 12$ mm

**Table B.26 — Lightweight concrete masonry units
— Geometry 1,7/1,2**

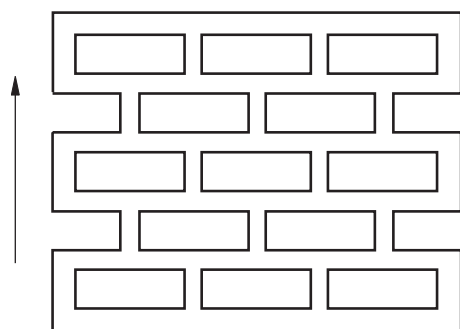



Figure B.26 — Lightweight concrete masonry units — Geometry 1,7/1,2

$\lambda_{10,dry,mat}$ [W/(m·K)] of the units	$\lambda_{10,dry,unit}$ [W/(m·K)] of the units	R [m ² ·K/W] per 100 mm thickness/ $\lambda_{10,dry,mas}$ of the masonry [W/(m·K)]		
		with a mortar with a conductivity of [W/(m·K)]		
		0,16	0,32	0,80 ^a
0,35	0,241	0,42/ 0,24	0,41/ 0,24	0,37/ 0,27
0,50	0,273	0,36/ 0,28	0,35/ 0,29	0,33/ 0,30
0,67	0,315	- -	0,31/ 0,32	0,29/ 0,34
0,83	0,357	- -	0,28/ 0,36	0,26/ 0,38
1,00	0,399	- -	- -	0,24/ 0,42
1,25	0,431	- -	- -	0,22/ 0,45
1,50	0,484	- -	- -	0,20/ 0,50

^a These values are valid, if there is no mortar in the vertical joint (which means that the rows of voids are not interrupted in the vertical joint).

(transverse web portion: 13 % to 19 %; percentage of voids: 54,4 %)
basic dimensions: $l = 380$ mm, $w = 300$ mm, $h_{unit} = 221$ mm, $h_{mor} = 12$ mm

**Table B.27 — Lightweight concrete masonry units
— Geometry 1,7/0,8**

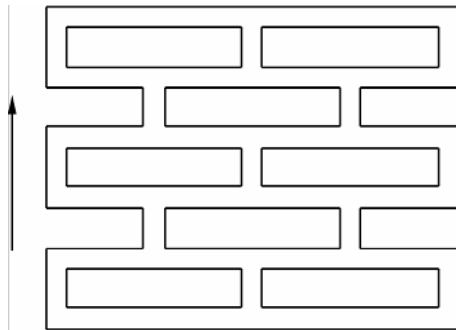

**Figure B.27 — Lightweight
concrete masonry units —
Geometry 1,7/0,8**

$\lambda_{10,dry,mat}$	$\lambda_{10,dry,unit}$	R [m ² ·K/W] per 100 mm thickness/ $\lambda_{10,dry,mas}$ of the masonry [W/(m·K)]	
[W/(m·K)] of the units	[W/(m·K)] of the units	with a mortar with a conductivity of [W/(m·K)]	
		0,32	0,80 ^a
0,35	0,231	0,41/ 0,24	0,38/ 0,26
0,50	0,273	0,35/ 0,29	0,33/ 0,30
0,67	0,315	0,31/ 0,32	0,29/ 0,34
0,83	0,347	0,29/ 0,34	0,27/ 0,37
1,00	0,378	- -	0,25/ 0,40/
1,25	0,431	- -	0,22/ 0,45
1,50	0,463	- -	0,21/ 0,48

^a These values are valid, if there is no mortar in the vertical joint (which means that the rows of voids are not interrupted in the vertical joint).

(transverse web portion: 11 % to 16 %, percentage of voids: 51,8 %)
basic dimensions: $l = 380$ mm, $w = 300$ mm, $h_{unit} = 221$ mm, $h_{mor} = 12$ mm

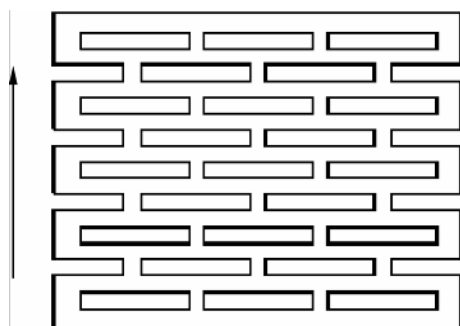


Figure B.28 — Lightweight concrete masonry units — Geometry 3/1,2

(transverse web portion: 11 % to 18 %; percentage of voids: 40,9 %)
basic dimensions: $l = 380$ mm, $w = 300$ mm, $h_{unit} = 221$ mm, $h_{mor} = 12$ mm

Table B.28 — Lightweight concrete masonry units — Geometry 3/1,2

$\lambda_{10,dry,mat}$	$\lambda_{10,dry,unit}$	R [$m^2 \cdot K/W$] per 100 mm thickness/ $\lambda_{10,dry,mas}$ of the masonry [$W/(m \cdot K)$]		
		with a mortar with a conductivity of [$W/(m \cdot K)$]		
[$W/(m \cdot K)$] of the units	[$W/(m \cdot K)$] of the units	0,16	0,32	0,80 ^a
0,17	0,125	0,77/ 0,13	0,73/ 0,14	0,64/ 0,16
0,35	0,178	0,55/ 0,18	0,53/ 0,19	0,48/ 0,21
0,50	0,210	0,47/ 0,21	0,45/ 0,22	0,41/ 0,24
0,67	0,241	-	0,40/ 0,25	0,37/ 0,27

^a These values are valid, if there is no mortar in the vertical joint (which means that the rows of voids are not interrupted in the vertical joint).

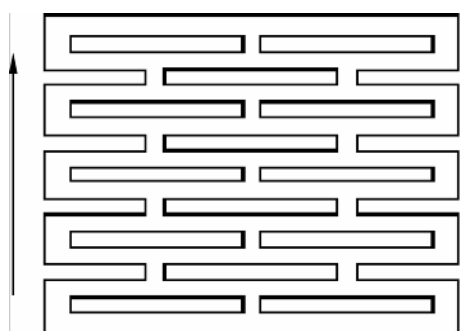


Figure B.29 — Lightweight concrete masonry unit — Geometry 3/0,8

Table B.29 — Lightweight concrete masonry unit — Geometry 3/0,8

$\lambda_{10,dry,mat}$	$\lambda_{10,dry,unit}$	R [$m^2 \cdot K/W$] per 100 mm thickness/ $\lambda_{10,dry,mas}$ of the masonry [$W/(m \cdot K)$]		
		with a mortar with a conductivity of [$W/(m \cdot K)$]		
[$W/(m \cdot K)$] of the units	[$W/(m \cdot K)$] of the units	0,16	0,32	0,80 ^a
0,17	0,125	0,78/ 0,13	0,73/ 0,14	0,64/ 0,16
0,35	0,167	0,57/ 0,18	0,54/ 0,19	0,49/ 0,20
0,50	0,199	0,49/ 0,20	0,47/ 0,21	0,43/ 0,23

^a These values are valid, if there is no mortar in the vertical joint (which means that the rows of voids are not interrupted in the vertical joint).

(transverse web portion: 7 % - 14 %; percentage of voids: 42,7 %)
basic dimensions: $l = 380$ mm, $w = 300$ mm, $h_{unit} = 221$ mm, $h_{mor} = 12$ mm

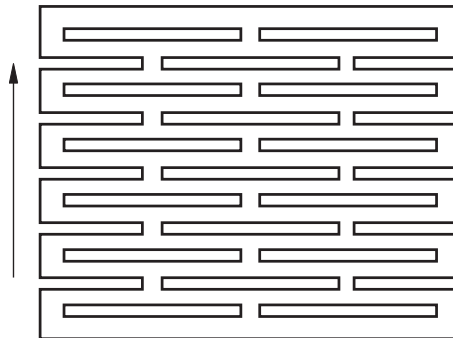


Figure B.30 — Lightweight concrete masonry units — Geometry 3,7/0,8

Table B.30 — Lightweight concrete masonry units — Geometry 3,7/0,8

$\lambda_{10,dry,mat}$ [W/(m·K)] of the units	$\lambda_{10,dry,unit}$ [W/(m·K)] of the units	R [m ² ·K/W] per 100 mm thickness/ $\lambda_{10,dry,mas}$ of the masonry [W/(m·K)]		
		with a mortar with a conductivity of [W/(m·K)]		
		0,16	0,32	0,80 ^a
0,17	0,125	0,79/ 0,13	0,74/ 0,14	0,64/ 0,16
0,35	0,167	0,57/ 0,18	0,55/ 0,18	0,49/ 0,20
0,50	0,199	0,49/ 0,20	0,47/ 0,21	0,43/ 0,23

^a These values are valid, if there is no mortar in the vertical joint (which means that the rows of voids are not interrupted in the vertical joint).

(transverse web portion: 7 % to 14 %; percentage of voids: 35,9 %)
basic dimensions: $l = 380$ mm, $w = 300$ mm, $h_{unit} = 221$ mm, $h_{mor} = 12$ mm

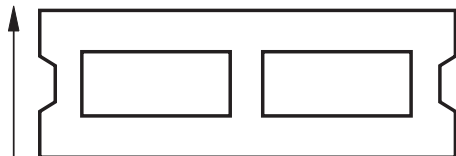


Figure B.31 — Lightweight concrete masonry units — Geometry 0,6/x

Table B.31 — Lightweight concrete masonry units — Geometry 0,6/x

$\lambda_{10,dry,mat}$ [W/(m·K)] of the units	$\lambda_{10,dry,unit}$ [W/(m·K)] of the units	R [m ² ·K/W] per 100 mm thickness/ $\lambda_{10,dry,mas}$ of the masonry [W/(m·K)]		
		with a mortar with a conductivity of [W/(m·K)]		
		0,16	0,32	0,80
0,10	0,151	0,75/ 0,13	0,71/ 0,14	0,65/ 0,15
0,17	0,231	0,51/ 0,20	0,49/ 0,20	0,45/ 0,22
0,25	0,309	0,38/ 0,26	0,37/ 0,27	0,34/ 0,29
0,40	0,408	0,28/ 0,36	0,27/ 0,37	0,29/ 0,40
0,55	0,523	0,23/ 0,43	0,22/ 0,45	0,21/ 0,48
0,75	0,631	-	-	0,17/ 0,59
1,00	0,746	-	-	0,14/ 0,71
1,25	0,847	-	-	0,12/ 0,83
1,50	0,940	-	-	0,11/ 0,91

(transverse web portion: 20,2 %; percentage of voids: 30 %)
basic dimensions: $l = 495$ mm, $w = 175$ mm, $h_{unit} = 238$ mm, $h_{mor} = 12$ mm

Table B.32 — Lightweight concrete masonry units — Geometry 0,8/x

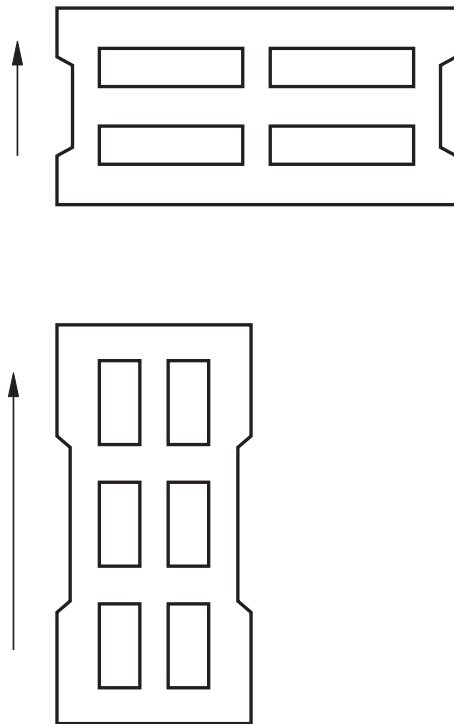


Figure B.32 — Lightweight concrete masonry units — Geometry 0,8/x

$\lambda_{10,dry,mat}$ [W/(m·K)] of the units	$\lambda_{10,dry,unit}$ [W/(m·K)] of the units	R [m ² ·K/W] per 100 mm thickness/ $\lambda_{10,dry,mas}$ of the masonry [W/(m·K)] with a mortar with a conductivity of [W/(m·K)]		
		0,16	0,32	0,80
0,10	0,215	0,74/ 0,14	0,68/ 0,15	0,59/ 0,17
0,17	0,314	0,52/ 0,19	0,48/ 0,21	0,42/ 0,24
0,25	0,410	0,40/ 0,25	0,38/ 0,26	0,34/ 0,29
0,40	0,562	0,29/ 0,34	0,28/ 0,36	0,25/ 0,40
0,55	0,698	0,23/ 0,43	0,22/ 0,45	0,20/ 0,50
0,75	0,865	-	-	0,16/ 0,63
1,00	1,062	-	-	0,13/ 0,77
1,25	1,252	-	-	0,11/ 0,91
1,50	1,437	-	-	0,10/ 1,00

(transverse web portion: 21,2 % to 40,8 %; percentage of voids: 30,8 % to 31,4 %)
basic dimensions: $l = 495$ mm, $w = 240$ mm, $h_{unit} = 238$ mm, $h_{mor} = 12$ mm

Table B.33 — Lightweight concrete masonry units — Geometry 1,0/x

$\lambda_{10,dry,mat}$	$\lambda_{10,dry,unit}$	R [m ² ·K/W] per 100 mm thickness/ $\lambda_{10,dry,mas}$ of the masonry [W/(m·K)]		
		with a mortar with a conductivity of [W/(m·K)]		
[W/(m·K)] of the units	[W/(m·K)] of the units	0,16	0,32	0,80
0,10	0,080	0,77/ 0,13	0,72/ 0,14	0,63/ 0,16
0,17	0,117	0,54/ 0,19	0,51/ 0,20	0,46/ 0,22
0,25	0,153	0,42/ 0,24	0,40/ 0,25	0,36/ 0,28
0,40	0,207	0,31/ 0,32	0,30/ 0,33	0,28/ 0,36
0,55	0,252	0,26/ 0,38	0,25/ 0,40	0,23/ 0,43
0,75	0,305	-	-	0,19/ 0,53
1,00	0,364	-	-	0,16/ 0,63
1,25	0,418	-	-	0,14/ 0,71
1,50	0,479	-	-	0,12/ 0,83

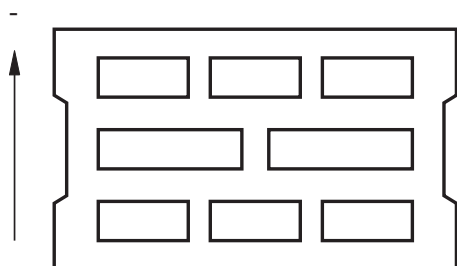


Figure B.33 — Lightweight concrete masonry units — Geometry 1,0/x

(transverse web portion: 25,9 %; percentage of voids: 35,4 %)
basic dimensions: $l = 495$ mm, $w = 300$ mm, $h_{unit} = 238$ mm, $h_{mor} = 12$ mm

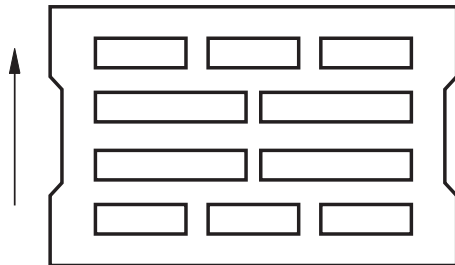


Figure B.34 — Lightweight concrete masonry units — Geometry 1,3/x

Table B.34 — Lightweight concrete masonry units — Geometry 1,3/x

$\lambda_{10,dry,mat}$	$\lambda_{10,dry,unit}$	R [m ² ·K/W] per 100 mm thickness/ $\lambda_{10,dry,mas}$ of the masonry [W/(m·K)]		
		with a mortar with a conductivity of [W/(m·K)]		
[W/(m·K)] of the units	[W/(m·K)] of the units	0,16	0,32	0,80
0,10	0,086	0,83/ 0,12	0,77/ 0,13	0,67/ 0,15
0,17	0,122	0,59/ 0,17	0,56/ 0,18	0,49/ 0,20
0,25	0,155	0,47/ 0,21	0,44/ 0,23	0,40/ 0,25
0,40	0,205	0,35/ 0,29	0,34/ 0,29	0,31/ 0,32
0,55	0,246	0,29/ 0,34	0,28/ 0,36	0,26/ 0,38
0,75	0,294	- -	- -	0,21/ 0,48
1,00	0,349	- -	- -	0,18/ 0,56
1,25	0,397	- -	- -	0,16/ 0,63
1,50	0,445	- -	- -	0,14/ 0,71

(transverse web portion: 21,2 % to 48 %; percentage of voids: 35,5 %)
basic dimensions: $l = 495$ mm, $w = 300$ mm, $h_{unit} = 238$ mm, $h_{mor} = 12$ mm

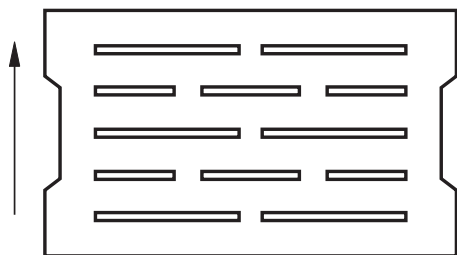


Figure B.35 — Lightweight concrete masonry units — Geometry 1,7/x

Table B.35 — Lightweight concrete masonry units — Geometry 1,7/x

$\lambda_{10,dry,mat}$ [W/(m·K)] of the units	$\lambda_{10,dry,unit}$ [W/(m·K)] of the units	R [m ² ·K/W] per 100 mm thickness/ $\lambda_{10,dry,mas}$ of the masonry [W/(m·K)] with a mortar with a conductivity of [W/(m·K)]		
		0,16	0,32	0,80
0,10	0,062	1,01/ 0,10	0,92/ 0,11	0,78/ 0,13
0,17	0,092	0,69/ 0,14	0,64/ 0,16	0,55/ 0,18
0,25	0,120	0,52/ 0,19	0,49/ 0,20	0,43/ 0,23
0,40	0,160	0,37/ 0,27	0,36/ 0,28	0,32/ 0,31
0,55	0,195	0,30/ 0,33	0,29/ 0,34	0,26/ 0,38

(transverse web portion: 20,6 %; percentage of voids: 11,8 %)
basic dimensions: $l = 495$ mm, $w = 300$ mm, $h_{unit} = 238$ mm, $h_{mor} = 12$ mm

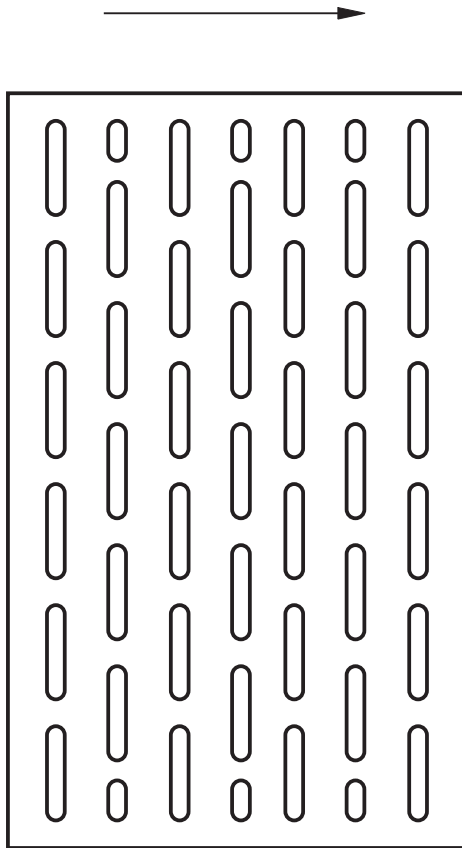


Table B.36 — Lightweight concrete masonry units — Geometry 3,0/x

$\lambda_{10,dry,mat}$ [W/(m·K)] of the units	$\lambda_{10,dry,unit}$ [W/(m·K)] of the units	R [m ² ·K/W] per 100 mm thickness/ $\lambda_{10,dry,mas}$ of the masonry [W/(m·K)] with a mortar with a conductivity of [W/(m·K)]		
		0,16	0,32	0,80
0,10	0,091	1,06/ 0,09	0,96/ 0,10	0,79/ 0,13
0,17	0,133	0,75/ 0,13	0,70/ 0,14	0,60/ 0,17
0,25	0,171	0,59/ 0,17	0,56/ 0,18	0,49/ 0,20
0,40	0,234	0,44/ 0,23	0,42/ 0,24	0,38/ 0,26


(transverse web portion: 24,2 %; percentage of
voids: 23,1 %)
basic dimensions: $l = 495$ mm, $w = 300$ mm, h_{unit}
 $= 238$ mm, $h_{mor} = 12$ mm

Figure B.36 — Lightweight concrete masonry units — Geometry 3,0/x

Annex C (informative)

Example of how to use the tables in Annex B

Dimensions in millimetres

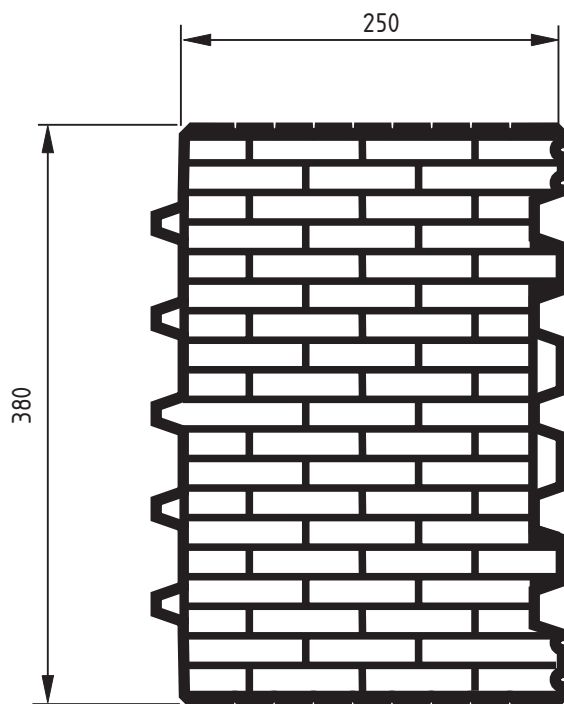

A vertical perforated clay unit with the dimensions $l \times w \times h_{unit} = 250 \text{ mm} \times 380 \text{ mm} \times 238 \text{ mm}$ has a dry mass of approximately 13,6 kg. The horizontal joint is made with a thermal insulating mortar with a thermal conductivity $\lambda_{10,dry,mat}$ of 0,16 W/m·K. The net dry density of the brick is approximately 1 500 kg/m³, which can be derived from the mass and the net volume of the unit (the net volume needs to be determined according to EN 772-3).

Figure C.1 — Example of a vertically perforated clay unit

The unit has 19 rows of holes, which means 5 rows of holes per 100 mm thickness, and either 3 or 4 holes per row, which means 1,2 or 1,6 holes per 100 mm length. There is no geometry class 5/1,2, therefore the relevant table is Table B.3 - Geometry 5/1,6. The values from this table are on the safe side, because of the number of voids per row and also because of the thickness of the webs. From Annex A the $\lambda_{10,dry,mat}$ -value for a clay unit material with a density of 1 500 kg/m³ can be taken as 0,43 W/m·K (if an individual test measurement for λ is available the measured value can be taken). From the first column in Table B.3 ($\lambda_{10,dry,mor} = 0,16 \text{ W/m·K}$) a resistance per 100 mm thickness of 0,58 m²·K/W and a $\lambda_{10,dry,mas}$ of 0,17 W/m·K is obtained. As the unit has a thickness of 38 cm, the R -value for the dry masonry is 0,58 × 3,8 = 2,204 m²·K/W. The unit has a tongue and groove system in the vertical joint, therefore no mortar correction is necessary (even if there was a vertical mortar joint, it could be neglected, because a thermal insulating mortar is used). No correction is necessary for deviating dimensions, because the length and height of the unit are identical with the "basic dimensions" of geometry in Table B.3).

To produce a design thermal value, the dry resistance has to be corrected according to moisture. The moisture correction coefficient is taken as 6 % per volume percent change of moisture as no individual measurement is available. Therefore, for a practical moisture content of 1 % by volume the dry resistance has to be multiplied by 0,94, which leads to a design resistance of $2,204 \times 0,94 = 2,072 \text{ m}^2\cdot\text{K}/\text{W}$; a practical moisture content of 1,5 % by volume leads to a design resistance of $2,204 \times 0,91 = 2,006 \text{ m}^2\cdot\text{K}/\text{W}$. The design U -value would then be in the first case $0,45 \text{ W}/(\text{m}^2\cdot\text{K})$ in the second case $0,46 \text{ W}/(\text{m}^2\cdot\text{K})$.

Annex D (normative)

Requirements for appropriate calculation procedures

D.1 Capabilities of the program

The user shall be supplied with the necessary information about the capability of the program to simulate the relevant characteristic properties of the physical component under considerations. Therefore, the following aspects of the heat flow model shall be defined:

- 2 or 3 dimensional;
- rectangular or non-rectangular shape;
- isotropic or non-isotropic conductivity. In this case:
 - general anisotropy;
 - partial anisotropy (with respect to the eigenvalues or eigenvectors of conductance);
- voids;
 - equivalent conductivity or resistance (convective and radiative part);
 - radiation exchange and equivalent conductivity (convective part);
 - radiation exchange and internal air flow model;
 - the thermal resistance of the voids has to be calculated according to EN ISO 6946;
- mass transfer (air-, moisture-transport from environment to environment);
- surface resistances to be taken from EN ISO 6946.

There is no specific preference related to the numerical methods incorporated; on the other hand, the user shall be informed about the advantages and restrictions of each method.

D.2 Input data and results

Input data shall be presented, to make it possible for a third party to do the same calculation.

The following calculation results shall at least be provided:

- minimum surface temperature of the test component on all sides;
- maximum surface temperature of the test component on all sides;
- 2D or 3D thermal coupling coefficient ($W/(m \cdot K)$ or W/K respectively);
- number and type of elements.

D.3 Testing of the program accuracy

The program shall be tested by calculating reference cases according to EN 10211.

D.4 Reference cases

D.4.1 Case 1: Calculation of thermal resistance R and thermal conductivity $\lambda_{10,dry,unit}$ of a masonry unit (vertically perforated unit).

Given:

Geometry of masonry unit: see Figure D.1

Material: $\lambda_{10,dry,mat} = 0,35 \text{ W/(m}\cdot\text{K)}$

Boundary conditions: $R_{si} = 0,13 \text{ m}^2\cdot\text{K/W}$

$R_{se} = 0,04 \text{ m}^2\cdot\text{K/W}$

Preparation of input data:

Thermal resistance of voids in the unit:

$d = 0,014 \text{ 2 m}; b_1 = 0,047 \text{ 5 m} : \lambda_{10,dry,unit} = 0,082 \text{ W/(m}\cdot\text{K)}$

$b_2 = 0,017 \text{ 7 m} : \lambda_{10,dry,unit} = 0,074 \text{ W/(m}\cdot\text{K)}$

Cut off planes:

Symmetry planes perpendicular to surface planes;

smallest distance of symmetry planes: $w = 125 \text{ mm}$.

Result of 2-DIM calculation:

thermal coupling coefficient: $L^{2D} = 0,070 \text{ 7 W/(m}\cdot\text{K)}$

DERIVATION OF THERMAL VALUES R , $\lambda_{10,dry,unit}$:

$$U = L/w = \frac{0,070 \text{ 7}}{0,125} = 0,565 \text{ 6 W/m}^2\text{K}$$

$$R_{mas} = \frac{1}{U} = 1,768 \text{ 0 m}^2\text{K/W}$$

$$R_t = R_{mas} - R_{si} - R_{se} = 1,598 \text{ m}^2 \text{ K/W}$$

$$\lambda_U = \frac{d}{R_t} = \frac{0,300 \text{ 2}}{1,598} = 0,188 \text{ W/mK}$$

NOTE Definitions and symbols are given in EN ISO 10211.

Dimensions in millimetres

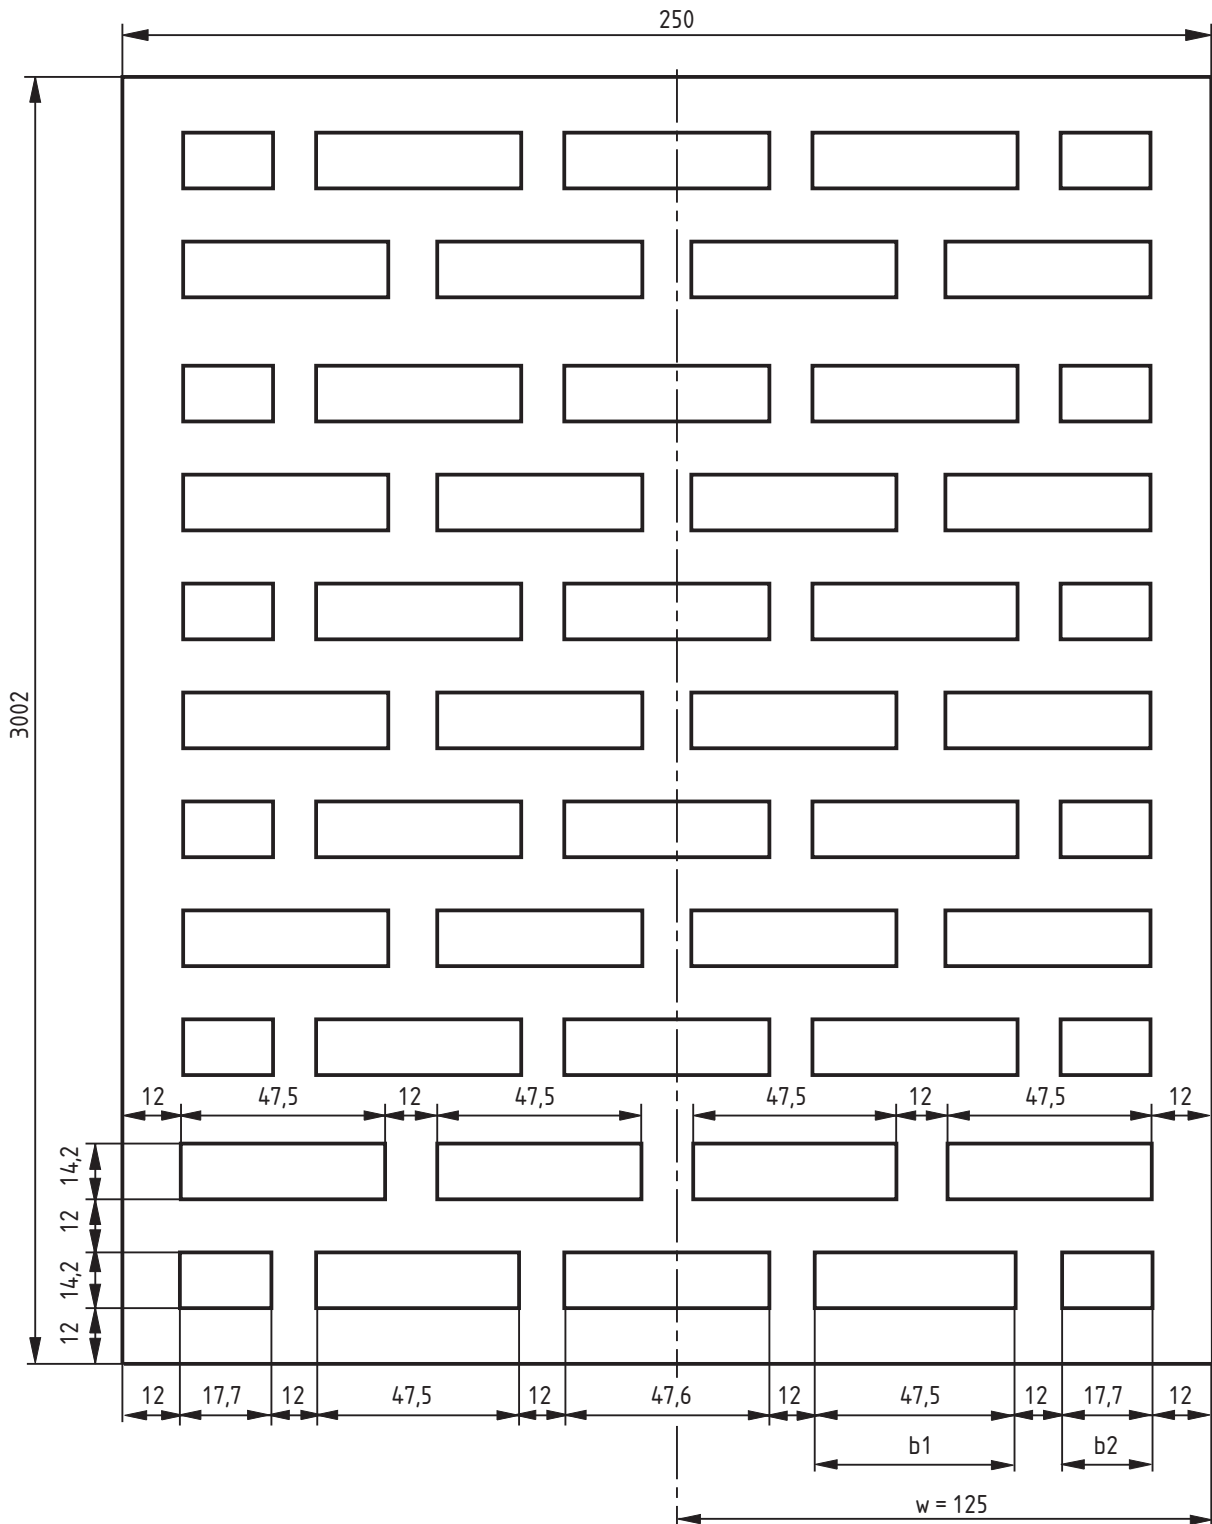


Figure D.1 — Geometry of a masonry unit, vertically perforated

D.4.2 Case 2: Calculation of thermal resistance $R_{dry,mas}$ of masonry consisting of vertically perforated masonry units and internal/ external plaster layers.

Given:

Geometry of the building component: see Figures D.1 and D.2

Material:	masonry units:	$\lambda = 0,35 \text{ W/(m}\cdot\text{K)}$;
	masonry mortar:	$\lambda = 0,20 \text{ W/(m}\cdot\text{K)}$;
	plaster - external:	$\lambda = 0,45 \text{ W/(m}\cdot\text{K)}$;
	- internal:	$\lambda = 0,10 \text{ W/(m}\cdot\text{K)}$;
	boundary conditions:	$R_{si} = 0,13 \text{ m}^2\cdot\text{K/W}$.

$$R_{se} = 0,04 \text{ m}^2\cdot\text{K/W}$$

Preparation of input data:

Thermal resistance of voids in the masonry unit:

$$d = 0,014 \text{ 2 m}; \quad b_1 = 0,047 \text{ 5 m} : \quad \lambda_{10,dry,unit} = 0,082 \text{ W/(m}\cdot\text{K)}$$

$$b_2 = 0,017 \text{ 7 m} : \quad \lambda_{10,dry,unit} = 0,074 \text{ W/(m}\cdot\text{K)}$$

Cut off planes:

$$\begin{array}{ll} \text{Vertical cut off planes are symmetry planes} & : \quad w = 125 \text{ mm;} \\ \text{horizontal cut off planes are symmetry planes} & : \quad h = 250 \text{ mm.} \end{array}$$

Result of 3-DIM calculation:

$$\text{thermal coupling coefficient} : L^{3D} = 0,015 \text{ 9 W/K}$$

Derivation of thermal value R of masonry:

$$U_{mas} = \frac{L}{A} = \frac{0,015 \text{ 9}}{0,125 \times 0,25} = 0,508 \text{ 8 W/m}^2\text{K}$$

$$R_{mas} = \frac{1}{U_{mas}} = 1,965 \text{ 4 m}^2\text{K/W}$$

$$R_{t,mas} = R_{mas} - R_{si} - R_{se} - \frac{d_i}{\lambda_i} = 1,539 \text{ 9 m}^2\text{K/W}$$

where

$R_{t,mas}$ is the true thermal resistance of the masonry.

NOTE The term $\frac{d_i}{\lambda_i}$ relates to the two plaster layers.

Symbols and definitions given in EN ISO 10211.

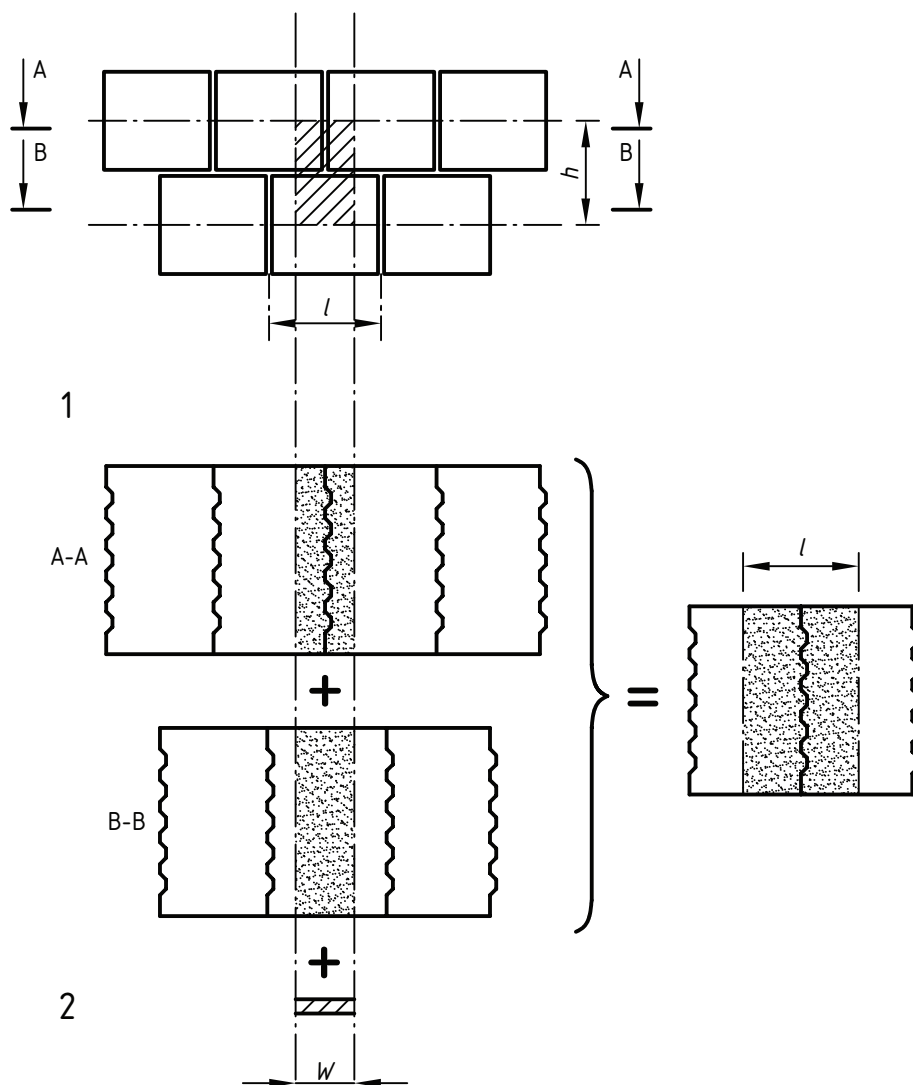


Figure D.2 — Geometry of masonry consisting of vertically perforated masonry units, bed joints with mortar layers, head joints without mortar but with interlocking system

D.4.3 CASE 3: Calculation of thermal resistance R_t of masonry consisting of masonry units, horizontal mortar layers, vertical mortar pockets and additional external insulation layer.

Given:

Geometry of the building component: see Figure D.3.

Material:	masonry units:	$\lambda = 0,65 \text{ W/(m}\cdot\text{K)}$;
	mortar (joints, pockets):	$\lambda = 1,00 \text{ W/(m}\cdot\text{K)}$;
	plaster - external:	$\lambda = 0,50 \text{ W/(m}\cdot\text{K)}$;
	- internal:	$\lambda = 0,40 \text{ W/(m}\cdot\text{K)}$;
	adhesive mortars:	$\lambda = 0,30 \text{ W/(m}\cdot\text{K)}$;
	insulation material:	$\lambda = 0,041 \text{ W/(m}\cdot\text{K)}$;
	boundary conditions:	$R_{si} = 0,13 \text{ m}^2\cdot\text{K/W}$;
		$R_{se} = 0,04 \text{ m}^2\cdot\text{K/W}$.

Preparation of input data:

Thermal resistance of voids in the masonry unit:

$$d = 0,036 \text{ mm}; b = 0,095 \text{ mm}; \lambda_{10,dry,unit} = 0,174 \text{ W/(m}\cdot\text{K)}$$

Cut off planes:

- Vertically- there exist symmetry planes at distance of 125 mm;
- horizontally - no symmetry planes exist due to asymmetry of the masonry unit.

For testing the influence of the selection of cut off planes disregarding symmetry, calculations were carried out for two masonry elements of different height:

Type	height	
	[mm]	
1	250	(1 layer)
2	500	(2 layers)

Result of 3-DIM calculation:

Type	L^{3D}
	[W/K]
1	0,013 14
2	0,026 28

Derivation of thermal values U , R :

Using:

$$U_{mas} = \frac{L^{3D}}{A}; \quad R_{mas} = \frac{1}{U_{mas}}$$

and

$$R_{t,mas} = R_{mas} - R_{si} - R_{se} - \frac{d_i}{\lambda_i}$$

where

$R_{t,mas}$ is the true thermal resistance of the masonry,

we get the thermal values listed in the following table:


Table D.1 — Results of case 3

Type	height [mm]	U_{mas} [W/(m ² ·K)]	R_t [m ² ·K/W]
1	250	0,420 5	0,668 2
2	500	0,420 5	0,668 2

NOTE The result shows, that in this special case the influence of the selection of cut off planes disregarding symmetry on the calculation result is so small, that it cannot be seen within the calculation accuracy.

Symbols and definitions are given in EN ISO 10211.

Dimensions in millimetres

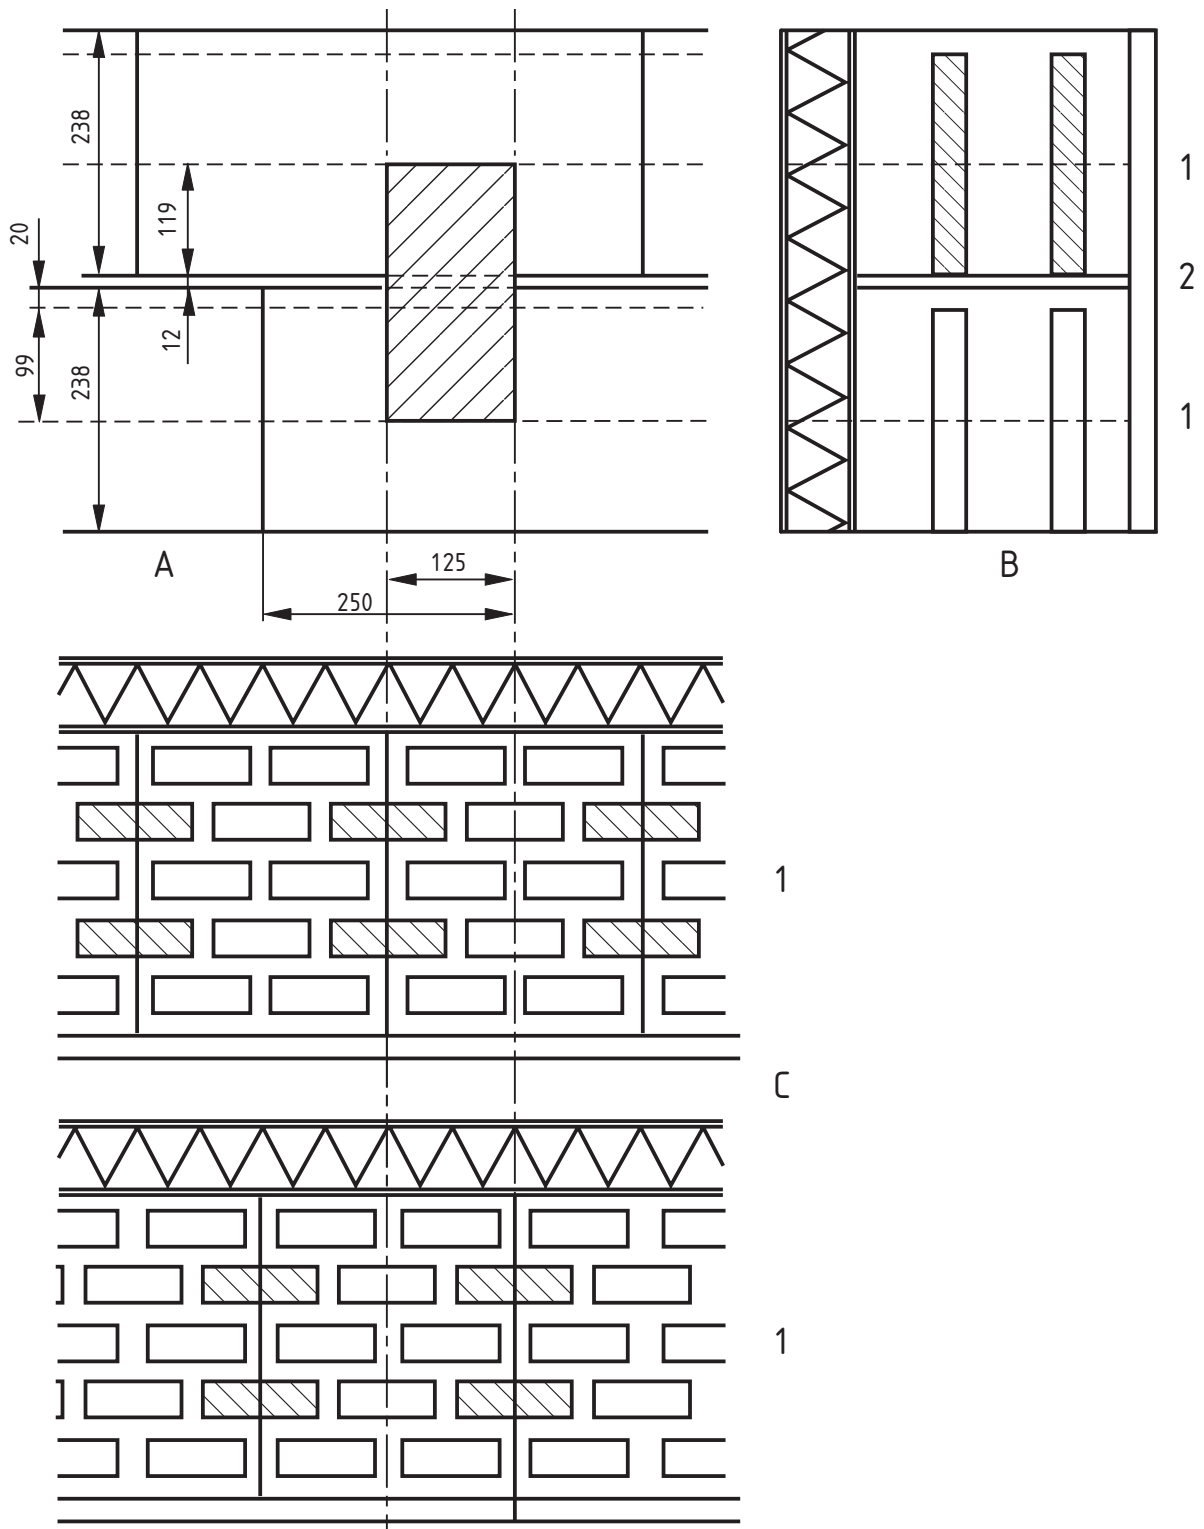

Key

- | | | | | | |
|---|------------------------|---|------------------|---|--------------------|
| A | view | B | vertical section | C | horizontal section |
| 1 | layer of masonry units | 2 | mortar | | |

Figure D.3 — Geometry of masonry consisting of masonry units, horizontal mortar layers and vertical mortar pockets and an external insulation layer

Dimensions in millimetres

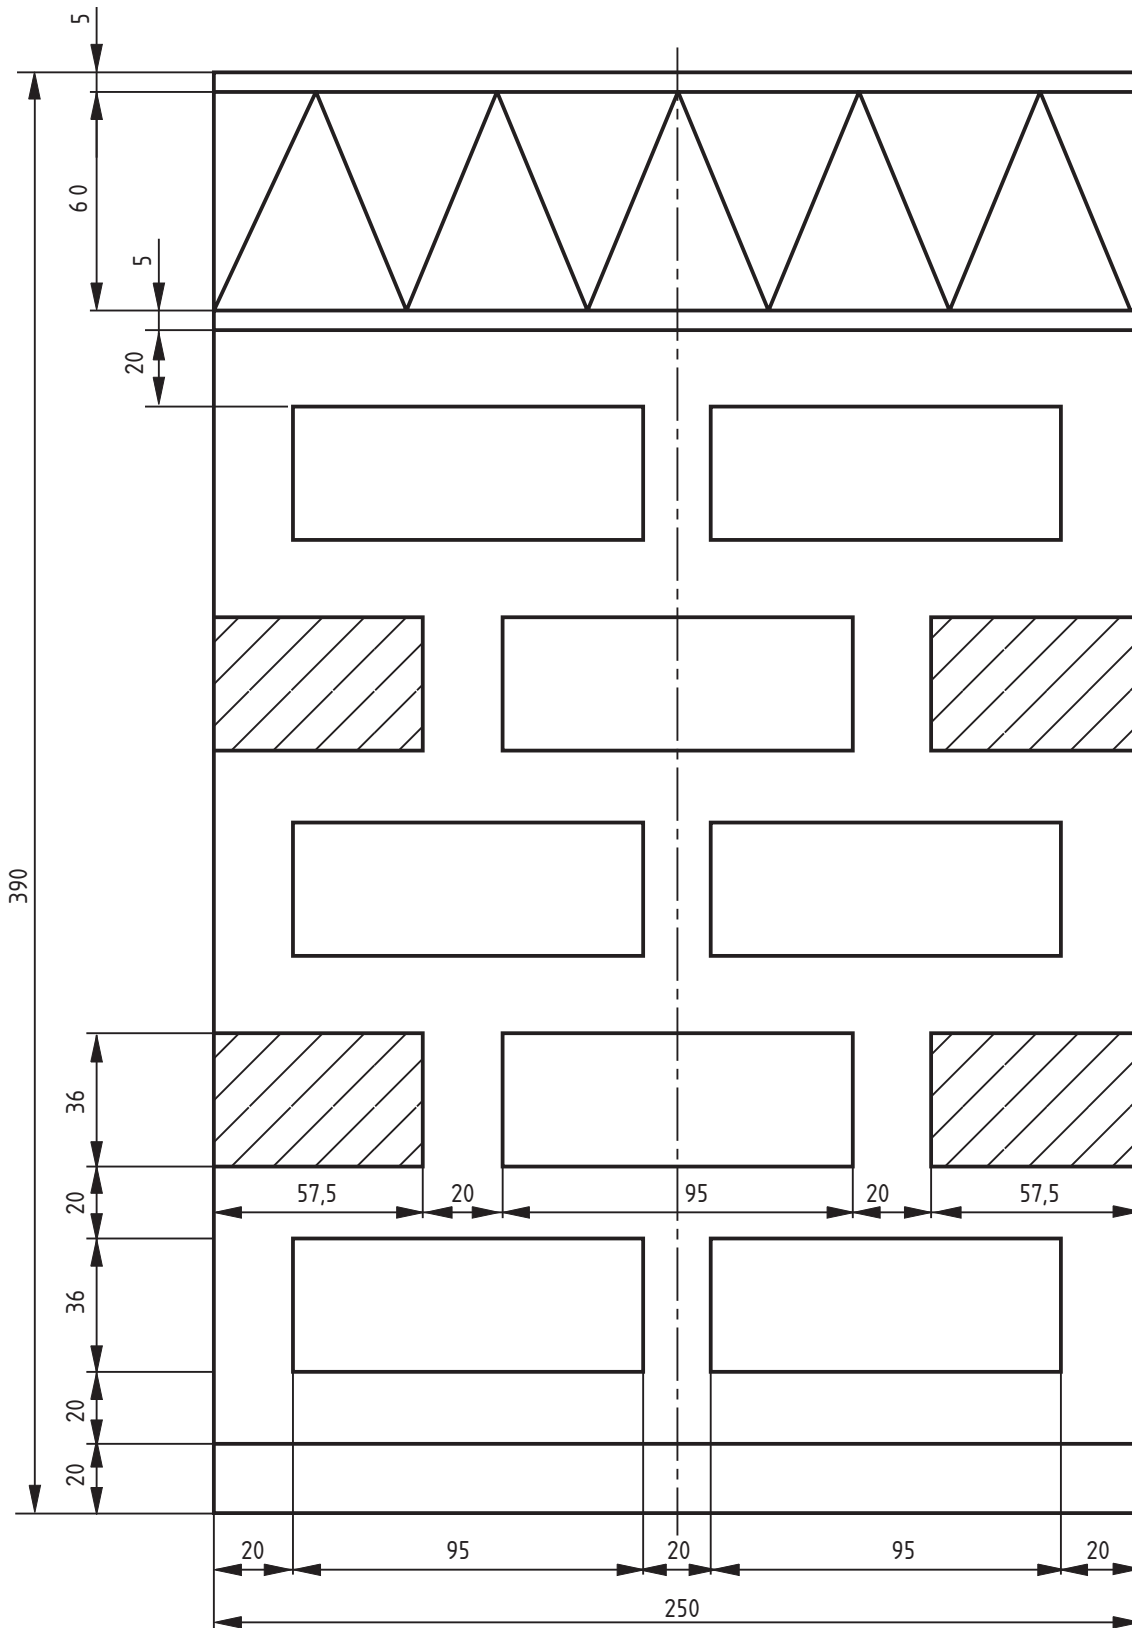


Figure D.4 — Geometry of cement bound unit

Annex E (informative)

Evaluation of conformity

Information about in what way the parameters used in the determination of the $\lambda_{10,dry,unit}$ or equivalent $\lambda_{10,dry,unit}$ -values will be part of the evaluation of conformity system is given in the following table:

Model	Initial type testing (ITT)	Factory production control (FPC)
S1	Net dry density	Net dry density
S2	Net dry density $\lambda_{10,dry,mat}$ / net dry density relationship ^a	Net dry density
S3	Net dry density Thermal transmittance of masonry	Net dry density
P1	Net dry density Configuration Thermal conductivity of the masonry unit material	Net dry density Configuration
P2	Net dry density Configuration	Net dry density Configuration
P3	Net dry density Configuration Thermal conductivity of the masonry unit material	Net dry density Configuration
P4	Net dry density Configuration	Net dry density Configuration
P5	Gross dry density Configuration $\lambda_{10,dry,unit}$ / gross dry density relationship ^b	Gross dry density Configuration
<p>^a If the net dry density of the unit under consideration deviate less than 2 times the declared tolerance from the net dry density forming the basis for the established relationship, then the $\lambda_{10,dry,mat}$ / net dry density relationship does not need to be repeated.</p> <p>^b If the pattern is the same and the gross dry density of the unit under consideration deviates by less than twice the declared tolerance from the gross dry density forming the basis for the established relationship, then the $\lambda_{10,dry,unit}$ / gross dry density relationship does not need to be repeated.</p>		

Table E.1 — Parameters for evaluation of conformity

As part of a FPC system the $\lambda_{10,dry,mat}$ -value for a batch of masonry unit may be determined based on direct testing of thermal conductivity. If so the following procedure should be used:

Establish a correlation between EN 12664 results and the alternative test method. The $\lambda_{10,dry,unit}$ -value may be based on the value obtained from the alternative test method after applying the established correlation correction.

NOTE Care should be taken that the test specimens are representative of the masonry product itself. An appropriate way to ensure this is to cut specimens from masonry units.

Annex F (informative)

Alternative procedure for the moisture correction of units with formed voids

The principle of this method is to correct the design moisture content according to the percentage of voids. It is a safe approximation and may be used as an alternative to procedure 2 in Clause 6.

From the moisture correction coefficient and the design moisture content, the following formulae can be used:

$$u_{corrected} = u_{design} \times (1 - v/100) \quad \text{or alternatively} \quad \psi_{corrected} = \psi_{design} \times (1 - v/100)$$

$$\lambda_{design} = \lambda_{10,dry} \times F_m \quad \text{or alternatively} \quad R_{design} = \frac{R_{10,dry}}{F_m}$$

with

$$F_m = e^{f_u \times u_{corrected}} \quad \text{or alternatively} \quad F_m = e^{f_\psi \times \psi_{corrected}}$$

with

$$\rho_{g,dry} / \rho_{n,dry} = \left(1 - \frac{v}{100} \right)$$

NOTE It is possible to use the term (gross dry density / net dry density) instead of (1 - v/100) in the corrected equation above.

where

f_ψ	is the moisture coefficient by volume	m ³ /m ³ ;
f_u	is the moisture coefficient by mass	kg/kg;
$\rho_{g,dry}$	is the gross dry density	kg/m ³ ;
ψ_{design}	is the design moisture content volume by volume	m ³ /m ³ ;
μ_{design}	is the design moisture content mass by mass	kg/kg;
$\rho_{n,dry}$	is the net dry density	kg/m ³ ;
v	is the voids ratio	%.

Bibliography

- [1] EN 771 (all parts), *Specification for masonry units*
- [2] EN 772-3, *Methods of test for masonry units — Part 3: Determination of net volume and percentage of voids of clay masonry units by hydrostatic weighing*
- [3] EN 772-16, *Methods of test for masonry units — Part 16: Determination of dimensions*
- [4] EN 998 (all parts), *Specification for mortar for masonry*

British Standards Institution (BSI)

BSI is the national body responsible for preparing British Standards and other standards-related publications, information and services.

BSI is incorporated by Royal Charter. British Standards and other standardization products are published by BSI Standards Limited.

About us

We bring together business, industry, government, consumers, innovators and others to shape their combined experience and expertise into standards-based solutions.

The knowledge embodied in our standards has been carefully assembled in a dependable format and refined through our open consultation process. Organizations of all sizes and across all sectors choose standards to help them achieve their goals.

Information on standards

We can provide you with the knowledge that your organization needs to succeed. Find out more about British Standards by visiting our website at bsigroup.com/standards or contacting our Customer Services team or Knowledge Centre.

Buying standards

You can buy and download PDF versions of BSI publications, including British and adopted European and international standards, through our website at bsigroup.com/shop, where hard copies can also be purchased.

If you need international and foreign standards from other Standards Development Organizations, hard copies can be ordered from our Customer Services team.

Subscriptions

Our range of subscription services are designed to make using standards easier for you. For further information on our subscription products go to bsigroup.com/subscriptions.

With **British Standards Online (BSOL)** you'll have instant access to over 55,000 British and adopted European and international standards from your desktop. It's available 24/7 and is refreshed daily so you'll always be up to date.

You can keep in touch with standards developments and receive substantial discounts on the purchase price of standards, both in single copy and subscription format, by becoming a **BSI Subscribing Member**.

PLUS is an updating service exclusive to BSI Subscribing Members. You will automatically receive the latest hard copy of your standards when they're revised or replaced.

To find out more about becoming a BSI Subscribing Member and the benefits of membership, please visit bsigroup.com/shop.

With a **Multi-User Network Licence (MUNL)** you are able to host standards publications on your intranet. Licences can cover as few or as many users as you wish. With updates supplied as soon as they're available, you can be sure your documentation is current. For further information, email bsmusales@bsigroup.com.

BSI Group Headquarters

389 Chiswick High Road London W4 4AL UK

Revisions

Our British Standards and other publications are updated by amendment or revision.

We continually improve the quality of our products and services to benefit your business. If you find an inaccuracy or ambiguity within a British Standard or other BSI publication please inform the Knowledge Centre.

Copyright

All the data, software and documentation set out in all British Standards and other BSI publications are the property of and copyrighted by BSI, or some person or entity that owns copyright in the information used (such as the international standardization bodies) and has formally licensed such information to BSI for commercial publication and use. Except as permitted under the Copyright, Designs and Patents Act 1988 no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means – electronic, photocopying, recording or otherwise – without prior written permission from BSI. Details and advice can be obtained from the Copyright & Licensing Department.

Useful Contacts:

Customer Services

Tel: +44 845 086 9001

Email (orders): orders@bsigroup.com

Email (enquiries): cservices@bsigroup.com

Subscriptions

Tel: +44 845 086 9001

Email: subscriptions@bsigroup.com

Knowledge Centre

Tel: +44 20 8996 7004

Email: knowledgecentre@bsigroup.com

Copyright & Licensing

Tel: +44 20 8996 7070

Email: copyright@bsigroup.com



...making excellence a habit.™