

Products and systems for the protection and repair of concrete structures — Test methods — Tests to measure the suitability of structural bonding agents for application to concrete surface

The European Standard EN 1799:1998 has the status of a
British Standard

ICS 83.180; 91.080.40

National foreword

This British Standard is the English language version of EN 1799:1998.

The UK participation in its preparation was entrusted by Technical Committee B/517, Concrete, to Subcommittee B/517/8, Repair and protection of concrete structures, which has the responsibility to:

- aid enquirers to understand the text;
- present to the responsible European committee any enquiries on the interpretation, or proposals for change, and keep the UK interests informed;
- monitor related international and European developments and promulgate them in the UK.

A list of organizations represented on this subcommittee can be obtained on request to its secretary.

Cross-references

The British Standards which implement international or European publications referred to in this document may be found in the BSI Standards Catalogue under the section entitled “International Standards Correspondence Index”, or by using the “Find” facility of the BSI Standards Electronic Catalogue.

A British Standard does not purport to include all the necessary provisions of a contract. Users of British Standards are responsible for their correct application.

Compliance with a British Standard does not of itself confer immunity from legal obligations.

Summary of pages

This document comprises a front cover, an inside front cover, the EN title page, pages 2 to 6, an inside back cover and a back cover.

Amendments issued since publication

Amd. No.	Date	Comments

This British Standard, having been prepared under the direction of the Sector Committee for Building and Civil Engineering, was published under the authority of the Standards Committee and comes into effect on 15 June 1999

© BSI 06-1999

ISBN 0 580 30945 2

ICS 83.180; 91.080.40

Descriptors: concrete structures, repairs, protection, areas, glue, tests, laboratory tests, determination, operating requirements

English version

Products and systems for the protection and repair of concrete structures — Test methods — Tests to measure the suitability of structural bonding agents for application to concrete surface

Produits et systèmes pour la protection et la réparation des structures en béton — Méthodes d'essais — Essais de détermination de l'aptitude à l'emploi des colles structurales à appliquer sur les surfaces en béton

Produkte und Systeme für den Schutz und die Instandsetzung von Betontragwerken — Prüfverfahren — Prüfungen der Eignung von Klebern für die Anwendung auf Betonoberflächen

This European Standard was approved by CEN on 29 November 1998.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Central Secretariat or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the Central Secretariat has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and United Kingdom.

CEN

European Committee for Standardization
Comité Européen de Normalisation
Europäisches Komitee für Normung

Central Secretariat: rue de Stassart 36, B-1050 Brussels

Foreword

This European Standard has been prepared by Technical Committee CEN/TC 104, Concrete (performance, production, placing and compliance criteria), the Secretariat of which is held by DIN.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by June 1999, and conflicting national standards shall be withdrawn at the latest by June 1999.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and the United Kingdom.

NOTE This European Standard should be read together with EN 1504-1.

Contents

	Page
Foreword	2
1 Scope	3
2 Normative references	3
3 Test methods	3
4 Equipment	3
4.1 Sag flow test	3
4.2 Squeezability test	3
5 Test procedure	3
5.1 Sag flow test	3
5.2 Squeezability test	3
6 Test report	4
6.1 Sag flow test	4
6.2 Squeezability test	4

1 Scope

This standard specifies methods of testing to measure the suitability of structural bonding agents for application to vertical and horizontal surfaces.

2 Normative references

This European Standard incorporates by dated or undated reference, provisions from other publications. These normative references are cited at the appropriate places in the text and the publications are listed hereafter. For dated references, subsequent amendments to or revisions of any of these publications apply to this European Standard only when incorporated in it by amendment or revision. For undated references the latest edition of the publication referred to applies.

EN 1504-1, *Products and systems for the protection and repair of concrete structures — Definitions, requirements, quality control and evaluation of conformity — Part 1: Definitions.*

prEN 12189, *Products and systems for the protection and repair of concrete structures — Test methods — Determination of open time.*

3 Test methods

This standard describes a method for the determination of the suitability of structural bonding agents applied using a spreader to a vertical or horizontal surface, referred to as the “sag flow test”.

This standard also describes a method for the determination of the suitability of injectable structural bonding agents for application between two surfaces, referred to as the “squeezability test”.

4 Equipment

4.1 Sag flow test

4.1.1 *Sag flow board*, in steel as depicted in Figure 1.

4.1.2 *Temperature-controlled conditioning cabinet*, adjustable to within 1 °C.

4.1.3 *Thermometer* measuring in degrees Celsius with 0,1 °C divisions.

4.1.4 *Straightedge*.

4.1.5 *Timer*.

4.1.6 *Mould release agent*.

4.2 Squeezability test

4.2.1 *Wax papers*, at least 400 mm square.

4.2.2 *Flat steel plate*, 6 mm thick and at least 400 mm square.

4.2.3 *Means of applying load of 150 N*.

4.2.4 *Timer*.

4.2.5 *Rule*, graduated in mm.

5 Test procedure

5.1 Sag flow test

5.1.1 Conditioning

Condition the resin and hardener components of the bonding agent and the sag flow board for at least 4 h at the test temperature of (21 ± 2) °C or an alternative test temperature as required.

5.1.2 Procedure

Clean the surface of the sag flow board.

Mix the components of the sample in accordance with the manufacturer's instructions.

With the sag flow board in the horizontal position, spread the sample into each of the required channels, beginning with the shallowest channel. Round the material slightly above the top of the guides for each channel. With a straightedge, strike off the excess flush with the top surface of the guides for each channel, and flush with the lower end of the guides (see Figure 2).

After all the required channels have been filled, allow the sag board to remain in a horizontal position for a further 30 s. Then, place the board gently into the vertical position, so that the board rests on the edge marked bottom (see Figure 1). Start the timer. The board shall remain in position throughout the test.

All the required channels should be filled within 10 min after the end of mixing. If the open time of the mixture, as measured by prEN 12189 is less than 15 min, the material should be tested in channels one at a time.

At the end of the test (30 min unless otherwise reported), measure in millimetres the distance from the lower end of the guides to the point of maximum flow for each thickness of interest. If the adhesive reaches the base of the sag flow board, the report should state that the sag was greater than 50 mm.

5.2 Squeezability test

5.2.1 Conditioning

Condition the resin and hardener components of the bonding agent as well as the plates for at least 4 h at the test temperature of (21 ± 2) °C or an alternative temperature as required.

5.2.2 Procedure

Mix the components of the sample in accordance with the manufacturer's instructions.

10 min after the completion of mixing, pour 300 cm³ of bonding agent onto a sheet of wax paper, placed on a hard level surface. The area occupied by the bonding agent should be as small as possible.

Place a second piece of wax paper over the poured out bonding agent. A flat plate is placed on top of this second wax paper and a load of 150 N is applied centrally and vertically. The flat plate should be maintained parallel with the level surface.

Maintain this load for 3 min, then remove the load and steel plate and measure the squeezed out diameter of the bonding agent. If the material squeezes out beyond the test area, the quantity of material should be reduced as appropriate.

6 Test report

6.1 Sag flow test

The report shall include the following information for each determination.

- 6.1.1 Type and identification of the product to be tested.
- 6.1.2 Temperature of the test environment.
- 6.1.3 Temperature of the components before mixing.
- 6.1.4 Volume of the sample mixed at one time.
- 6.1.5 Method of mixing.
- 6.1.6 Length of time of the test.
- 6.1.7 Mode of application.
- 6.1.8 Length of sag flow for each thickness at the end of the test.
- 6.1.9 Thickest section of bonding agent which develops zero sag flow within the time of the test.
- 6.1.10 Any deviation from this European Standard.

6.2 Squeezability test

The report shall include the following information for each determination.

- 6.2.1 Type and identification of the product to be tested.
- 6.2.2 Temperature of the test environment.
- 6.2.3 Temperature of the components before mixing.
- 6.2.4 Volume of the sample mixed at one time.
- 6.2.5 Method of mixing.
- 6.2.6 Length of time of the test.
- 6.2.7 Quantity of material poured for the test.
- 6.2.8 Diameter of the squeezed out bonding agent, in millimetres, at the end of the test.
- 6.2.9 Any deviation from this European Standard.

Dimensions in millimetres


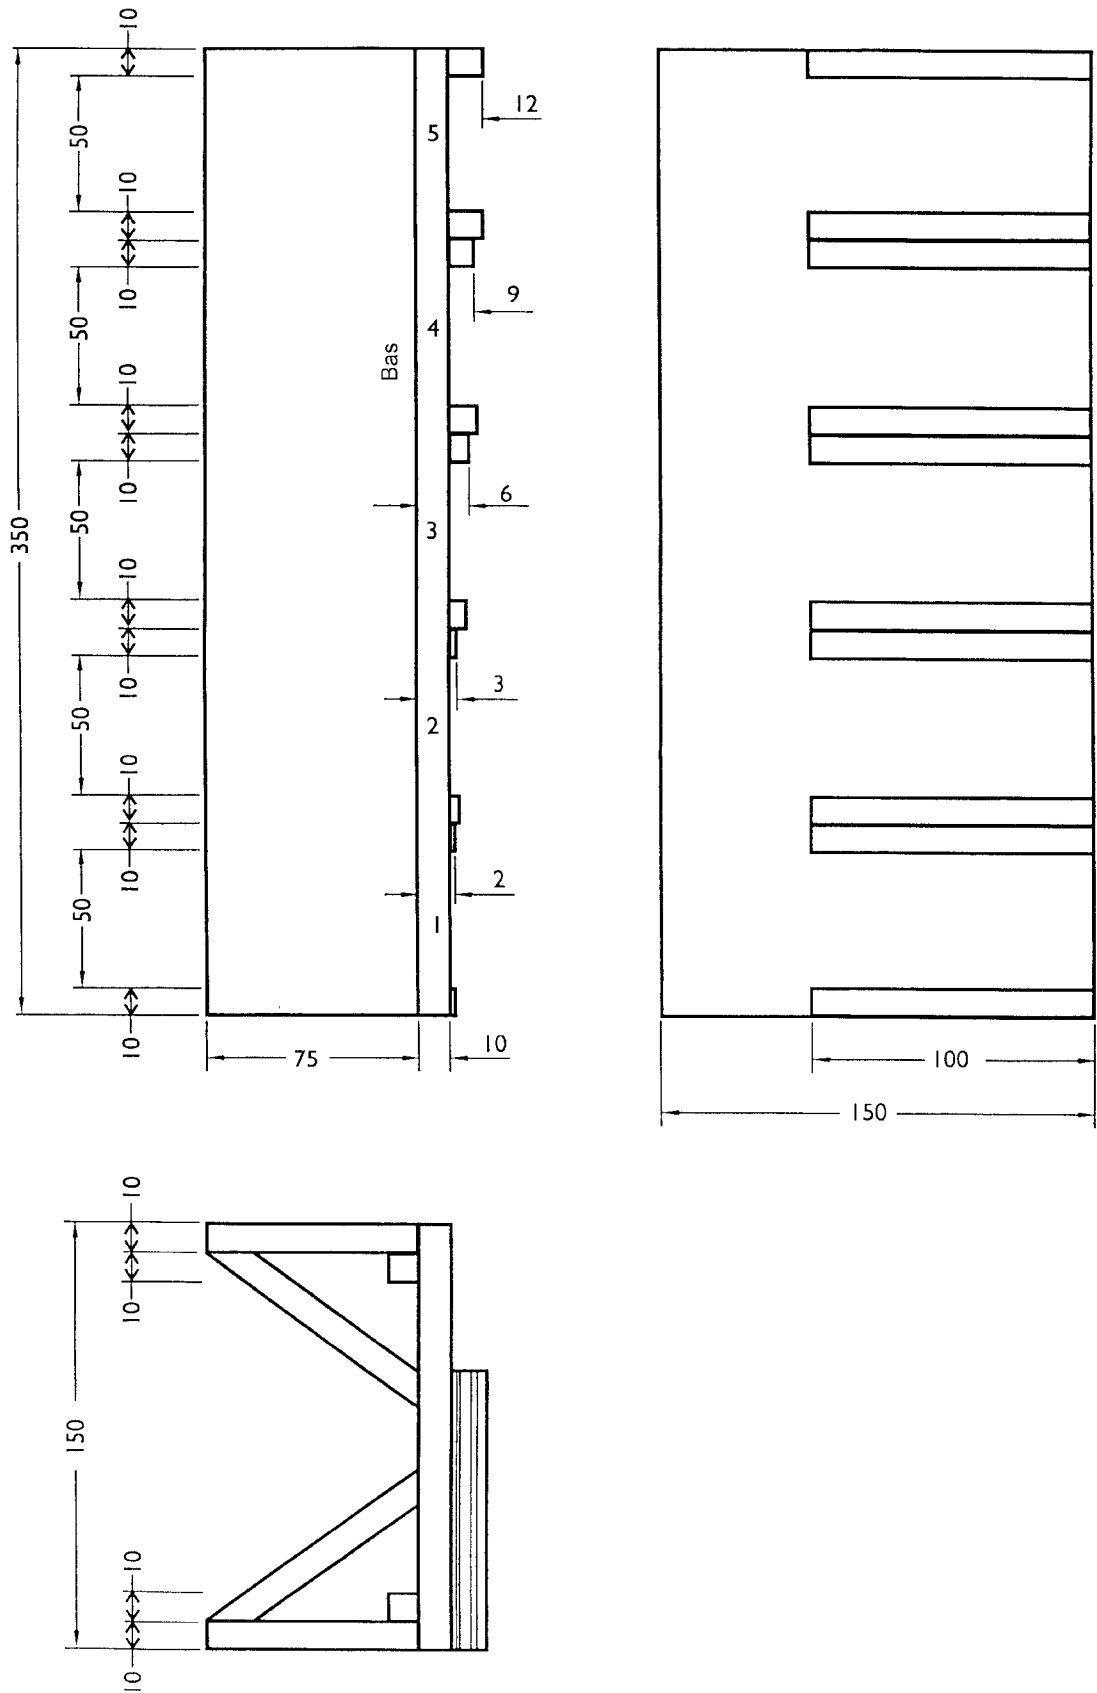


Figure 1 — Sag flow board

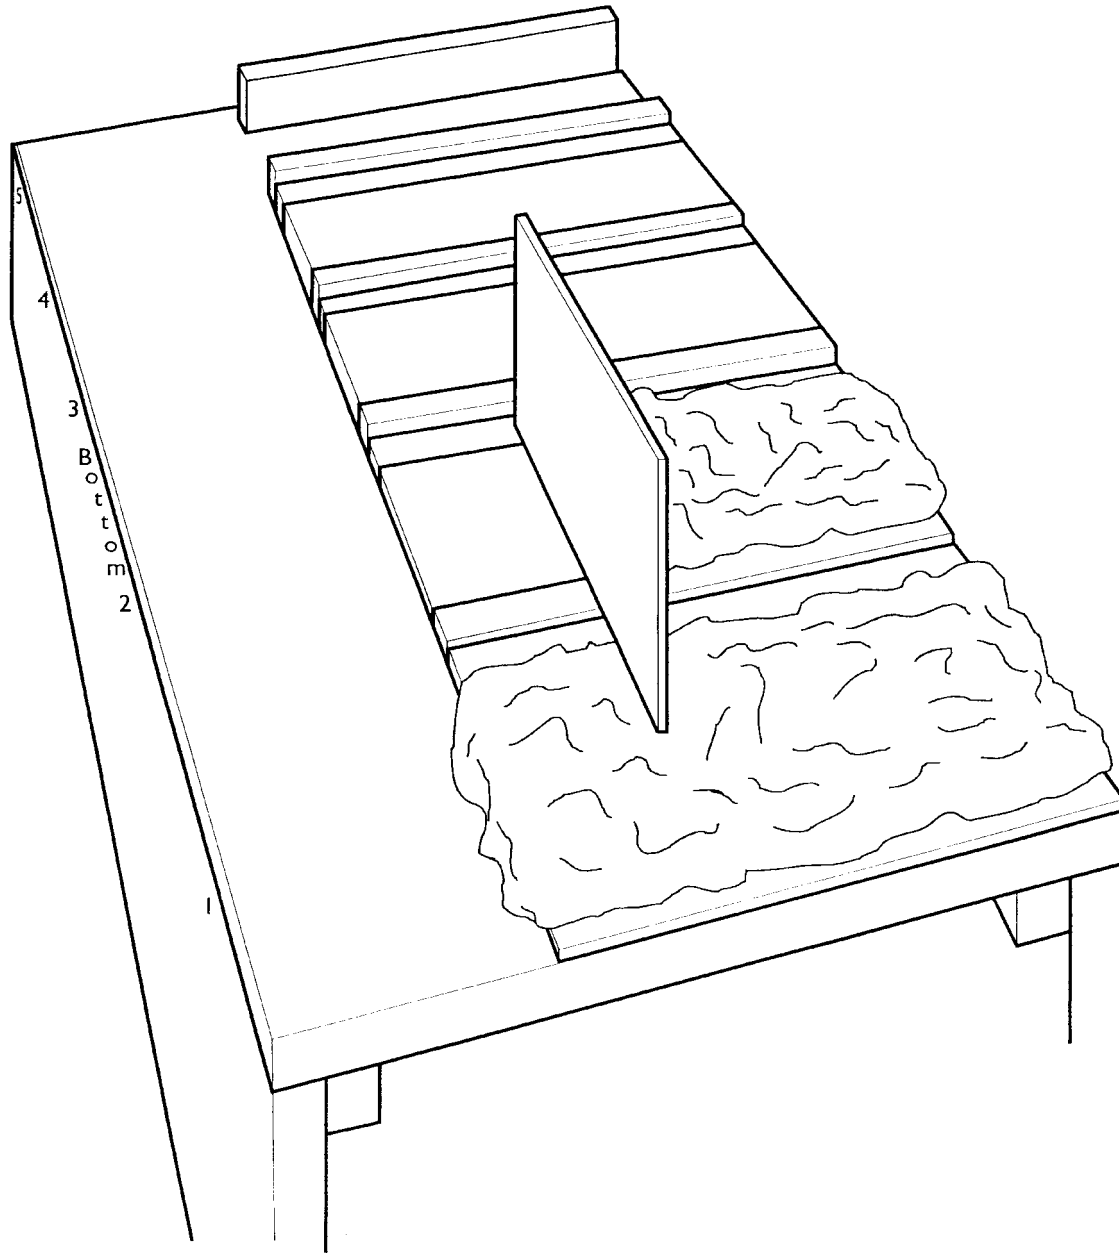

- Channel 5 remains empty
- Channels 3 and 4 have been completed
- Channel 2 Straight edge is being used to strike off excess paste in Channel 2 (towards top of board)
- Channel 1 is ready to be struck off

Figure 2 — Sag flow board in use

BSI — British Standards Institution

BSI is the independent national body responsible for preparing British Standards. It presents the UK view on standards in Europe and at the international level. It is incorporated by Royal Charter.

Revisions

British Standards are updated by amendment or revision. Users of British Standards should make sure that they possess the latest amendments or editions.

It is the constant aim of BSI to improve the quality of our products and services. We would be grateful if anyone finding an inaccuracy or ambiguity while using this British Standard would inform the Secretary of the technical committee responsible, the identity of which can be found on the inside front cover. Tel: 020 8996 9000. Fax: 020 8996 7400.

BSI offers members an individual updating service called PLUS which ensures that subscribers automatically receive the latest editions of standards.

Buying standards

Orders for all BSI, international and foreign standards publications should be addressed to Customer Services. Tel: 020 8996 9001. Fax: 020 8996 7001.

In response to orders for international standards, it is BSI policy to supply the BSI implementation of those that have been published as British Standards, unless otherwise requested.

Information on standards

BSI provides a wide range of information on national, European and international standards through its Library and its Technical Help to Exporters Service. Various BSI electronic information services are also available which give details on all its products and services. Contact the Information Centre. Tel: 020 8996 7111. Fax: 020 8996 7048.

Subscribing members of BSI are kept up to date with standards developments and receive substantial discounts on the purchase price of standards. For details of these and other benefits contact Membership Administration. Tel: 020 8996 7002. Fax: 020 8996 7001.

Copyright

Copyright subsists in all BSI publications. BSI also holds the copyright, in the UK, of the publications of the international standardization bodies. Except as permitted under the Copyright, Designs and Patents Act 1988 no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means – electronic, photocopying, recording or otherwise – without prior written permission from BSI.

This does not preclude the free use, in the course of implementing the standard, of necessary details such as symbols, and size, type or grade designations. If these details are to be used for any other purpose than implementation then the prior written permission of BSI must be obtained.

If permission is granted, the terms may include royalty payments or a licensing agreement. Details and advice can be obtained from the Copyright Manager. Tel: 020 8996 7070.