

Steel pipes for pipelines for combustible fluids — Technical delivery conditions

Part 2: Pipes of requirement class B

ICS 23.040.10

National foreword

This British Standard is the UK implementation of EN 10208-2:2009. It supersedes BS EN 10208-2:1997 which is withdrawn.

The UK participation in its preparation was entrusted to Technical Committee PSE/17/2, Transmission pipelines.

A list of organizations represented on this committee can be obtained on request to its secretary.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

Compliance with a British Standard cannot confer immunity from legal obligations.

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 30 April 2009.

© BSI 2009

ISBN 978 0 580 63200 6

Amendments/corrigenda issued since publication

Date	Comments

EUROPEAN STANDARD

EN 10208-2

NORME EUROPÉENNE

EUROPÄISCHE NORM

March 2009

ICS 23.040.10

Supersedes EN 10208-2:1996

English Version

**Steel pipes for pipelines for combustible fluids - Technical
delivery conditions - Part 2: Pipes of requirement class B**

Tubes en acier pour conduites de fluides combustibles -
Conditions techniques de livraison - Partie 2: Tubes de la
classe de prescription B

Stahlrohre für Rohrleitungen für brennbare Medien -
Technische Lieferbedingungen - Teil 2: Rohre der
Anforderungsklasse B

This European Standard was approved by CEN on 25 January 2009.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

Management Centre: Avenue Marnix 17, B-1000 Brussels

Contents	Page
Foreword.....	3
Introduction.....	4
1 Scope	5
2 Normative references	5
3 Terms and definitions	7
4 Symbols and abbreviations	8
5 Classification and designation.....	8
5.1 Classification.....	8
5.2 Designation	8
6 Information to be supplied by the purchaser	9
6.1 Mandatory information	9
6.2 Options	9
6.3 Example of ordering	11
7 Manufacturing	11
7.1 General.....	11
7.2 Steelmaking.....	12
7.3 Pipe manufacture.....	12
7.4 Heat treatment condition	12
7.5 Sizing	13
7.6 Strip end welds	14
7.7 Jointers	14
7.8 General requirements for non-destructive testing.....	14
8 Requirements	14
8.1 General.....	14
8.2 Chemical composition	14
8.3 Mechanical properties.....	16
8.4 Weldability	21
8.5 Appearance and soundness.....	21
8.6 Dimensions, masses and tolerances.....	22
9 Inspection	29
9.1 Types of inspection and inspection documents	29
9.2 Summary of inspection and testing.....	29
9.3 Selection and preparation of samples and test pieces.....	30
9.4 Test methods.....	38
9.5 Retests, sorting and reprocessing.....	42
10 Marking of the pipes	42
10.1 General marking.....	42
10.2 Special marking	43
11 Coating for temporary protection	43
Annex A (normative) Manufacturing procedure qualification.....	44
Annex B (normative) Treatment of imperfections and defects disclosed by visual examination	46
Annex C (normative) Non-destructive testing	47
Bibliography.....	54

Foreword

This document (EN 10208-2:2009) has been prepared by Technical Committee ECISS/TC 29 “Steel tubes and fittings for steels tubes”, the secretariat of which is held by UNI.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by September 2009, and conflicting national standards shall be withdrawn at the latest by September 2009.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN [and/or CENELEC] shall not be held responsible for identifying any or all such patent rights.

This document supersedes EN 10208-2:1996

This European Standard consists of the following parts, under the general title *Steel pipes for pipelines for combustible fluids — Technical delivery conditions*:

Part 1: Pipes of requirement class A

Part 2: Pipes of requirement class B

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and the United Kingdom.

Introduction

It was the intention, when preparing this document, to avoid specifying the quality of line pipe to be used for a particular application. However, it was recognized that there are several quality levels commonly used, and it was decided to reflect these in the standard by the differentiation between two quality levels.

Firstly, the need was recognized to provide a basic quality level. This is designated requirement class A and considered in EN 10208-1.

Secondly, many purchasers impose requirements additional to the basic standard, for instance concerning toughness and non-destructive inspection. This approach is common, for example, for transmission pipelines. Such enhanced requirements are addressed in requirement class B and considered in EN 10208-2.

For offshore applications and other applications outside the scope of EN 10208-1 and EN 10208-2, other standards may be applicable, e.g. ISO 3183 [1].

The Charpy impact energy requirements in this document have been derived from established data, in accordance with EPRG recommendations [2], and are intended to prevent the occurrence of long running shear fracture in pipelines transporting clean, dry natural gas. It is the responsibility of the designer to decide whether these energy requirements suffice for the intended application. For example, rich gas or two-phase fluids may require additional testing to be carried out.

For pipes of requirement class B, a weld efficiency factor of 1,0 can be used in design calculations, due to the conditions specified for the manufacture of the pipes and for the testing of the tubes.

The selection of the requirement class depends on many factors: the properties of the fluid to be conveyed, the service conditions, design code and any statutory requirements should all be taken into consideration. Therefore this document gives no detailed guidelines. It is the ultimate responsibility of the user to select the appropriate requirement class for the intended application.

NOTE This document combines a wide range of product types, dimensions and technical restrictions in accordance with the functional requirements for gas supply systems referred to in EN 1594 [3].

1 Scope

This European Standard specifies the technical delivery conditions for seamless and welded steel pipes for the on land transport of combustible fluids primarily in gas supply systems but excluding pipeline applications in the petroleum and natural gas industries. It includes more stringent quality and testing requirements than those in EN 10208-1.

NOTE 1 Steel pipes for pipeline transportation systems within the petroleum and natural gas industries are covered by ISO 3183 [1]. This standard specifies products with the same (and additional) strength levels and partly similar (but not identical) requirements as EN 10208-1 and EN 10208-2 and is with two additional annexes specifying deviating or additional requirements also published as API Spec 5L [4].

NOTE 2 This European Standard does not apply to cast steel pipe.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 473, *Non-destructive testing — Qualification and certification of NDT personnel — General principles*

EN 910, *Destructive tests on welds in metallic materials — Bend tests*

EN 1011-1, *Welding — Recommendations for welding of metallic materials — Part 1: General guidance for arc welding*

EN 1011-2, *Welding — Recommendations for welding of metallic materials — Part 2: Arc welding of ferritic steels*

EN 10002-1, *Metallic materials — Tensile testing — Part 1: Method of test at ambient temperature*

EN 10020:2000, *Definition and classification of grades of steel*

EN 10021, *General technical delivery conditions for steel products*

EN 10027-1, *Designation systems for steels — Part 1: Steel names*

EN 10027-2, *Designation systems for steels — Part 2: Numerical system*

EN 10045-1, *Metallic materials — Charpy impact test — Part 1: Test method*

EN 10052:1993, *Vocabulary of heat treatment terms for ferrous products*

EN 10079:2007, *Definition of steel products*

EN 10168, *Steel products — Inspection documents — List of information and description*

EN 10204, *Metallic products — Types of inspection documents*

EN 10220, *Seamless and welded steel tubes — Dimensions and masses per unit length*

EN 10246-3, *Non-destructive testing of steel tubes — Part 3: Automatic eddy current testing of seamless and welded (except submerged arc welded) steel tubes for the detection of imperfections*

BS EN 10208-2:2009
EN 10208-2:2009 (E)

EN 10246-5, *Non-destructive testing of steel tubes — Part 5: Automatic full peripheral magnetic transducer/flux leakage testing of seamless and welded (except submerged arc welded) ferromagnetic steel tubes for the detection of longitudinal imperfections*

EN 10246-7, *Non-destructive testing of steel tubes — Part 7: Automatic full peripheral ultrasonic testing of seamless and welded (except submerged arc welded) steel tubes for the detection of longitudinal imperfections*

EN 10246-8, *Non-destructive testing of steel tubes — Part 8: Automatic ultrasonic testing of the weld seam of electric welded steel tubes for the detection of longitudinal imperfections*

EN 10246-9, *Non-destructive testing of steel tubes — Part 9: Automatic ultrasonic testing of the weld seam of submerged arc welded steel tubes for the detection of longitudinal and/or transverse imperfections*

EN 10246-10, *Non-destructive testing of steel tubes — Part 10: Radiographic testing of the weld seam of automatic fusion arc welded steel tubes for the detection of imperfections*

EN 10246-14, *Non-destructive testing of steel tubes — Part 14: Automatic ultrasonic testing of seamless and welded (except submerged arc-welded) steel tubes for the detection of laminar imperfections*

EN 10246-15, *Non-destructive testing of steel tubes — Part 15: Automatic ultrasonic testing of strip/plate used in the manufacture of welded steel tubes for the detection of laminar imperfections*

EN 10246-16, *Non-destructive testing of steel tubes — Part 16: Automatic ultrasonic testing of the area adjacent to the weld seam of welded steel tubes for the detection of laminar imperfections*

EN 10246-17, *Non-destructive testing of steel tubes — Part 17: Ultrasonic testing of tube ends of seamless and welded steel tubes for the detection of laminar imperfections*

EN 10256, *Non-destructive testing of steel tubes – Qualification and competence of level 1 and 2 non-destructive testing personnel*

EN 10266:2003, *Steel tubes, fittings and structural hollow sections — Symbols and definitions of terms for use in product standards*

EN 10274, *Metallic materials — Drop weight tear test*

EN ISO 377, *Steel and steel products — Location and preparation of samples and test pieces for mechanical testing (ISO 377:1997)*

EN ISO 2566-1, *Steel — Conversion of elongation values — Part 1: Carbon and low alloy steels (ISO 2566-1:1984)*

EN ISO 6506-1, *Metallic materials — Brinell hardness test — Part 1: Test method (ISO 6506-1:2005)*

EN ISO 6508-1, *Metallic materials — Rockwell hardness test — Part 1: Test method (scales A, B, C, D, E, F, G, H, K, N, T) (ISO 6508-1:2005)*

EN ISO 8492, *Metallic materials — Tube — Flattening test (ISO 8492:1998)*

EN ISO 14284, *Steel and iron — Sampling and preparation of samples for the determination of the chemical composition (ISO 14284:1996)*

ISO 19232-1, *Non-destructive testing — Image quality of radiographs — Part 1: Image quality indicators (wire type) — Determination of image quality value*

CEN/TR 10261, *Iron and steel — Review of available methods of chemical analysis*

3 Terms and definitions

For the purposes of this document the following terms and definitions apply in addition to or deviating from those given in EN 10020:2000, EN 10052:1993, EN 10079:2007 and EN 10266:2003.

3.1

normalizing forming

[deviating from EN 10052:1993]

forming process in which the final deformation is carried out in a certain temperature range leading to a material condition equivalent to that obtained after normalizing so that the specified values of the mechanical properties are retained even after normalizing

NOTE The abbreviated form of this delivery condition is N.

3.2

thermomechanical forming

[as in EN 10052:1992, but supplemented]

forming process in which the final deformation is carried out in a certain temperature range leading to a material condition with certain properties which cannot be achieved or repeated by heat treatment alone

NOTE 1 Subsequent heating above 580 °C may lower the strength values.

NOTE 2 The abbreviated form of this delivery condition is M (included, where applicable, in the steel name).

NOTE 3 Thermomechanical forming leading to the delivery condition M may include processes of increased cooling rates without or with tempering including self-tempering but excluding definitively direct quenching and quenching and tempering.

NOTE 4 As a consequence of lower carbon content and carbon equivalent values, material in the delivery condition M has improved weldability properties.

3.3

quenching and tempering

heat treatment comprising of quench hardening followed by tempering, where quench hardening implies austenitization followed by cooling, under conditions such that austenite transforms more or less completely into martensite and possibly into bainite

NOTE 1 By tempering to specific temperatures ($< A_{c1}$) one or more times or holding at these temperatures, followed by cooling at an appropriate rate, the properties are brought to the required level.

NOTE 2 The abbreviated form of this delivery condition is Q (in this document, included in the steel name).

3.4

cold forming

(in this context) the process by which a flat product is formed into a pipe without heating of the plate or strip

3.5

cold finishing

cold working operation (normally cold drawing) with a permanent strain greater than the maximum strain of 1,5 % which differentiates it from sizing operations specified in 7.5

3.6

pipe body

for seamless pipe, the entire pipe; for welded pipes, the entire pipe excluding weld(s) and heat affected zone (HAZ)

3.7

imperfection

irregularity in the wall or on the pipe surfaces detectable by methods described in this document

BS EN 10208-2:2009
EN 10208-2:2009 (E)

NOTE Imperfections with a size and/or population density complying with the acceptance criteria specified in this document are considered to have no practical implication on the intended use of the product.

**3.8
defect**

imperfection of a size and/or population density not complying with the acceptance criteria specified in this document

NOTE Defects are considered to adversely affect or limit the intended use of the product.

**3.9
jointer**

two lengths of pipe coupled or welded together by the manufacturer

**3.10
by agreement/agreed**

[as in EN 10266]

agreement between manufacturer and purchaser at the time of enquiry and order

4 Symbols and abbreviations

For symbols and abbreviations, see EN 10266:2003.

NOTE 1 EN 10266 includes definitions of types of pipe and their abbreviations.

NOTE 2 Symbols from EN 10266:2003 most frequently used in this document are:

D specified outside diameter;

D_{\min} (specified) minimum outside diameter;

T specified wall thickness;

T_{\min} (specified) minimum wall thickness.

5 Classification and designation

5.1 Classification

The steel grades specified in this document are non-alloy quality or non-alloy or alloy special steels. Their classification in accordance with EN 10020 is indicated in Table 1.

5.2 Designation

The specified steel grades are designated with steel names in accordance with EN 10027-1. The corresponding steel numbers have been allocated in accordance with EN 10027-2.

Table 1 — Classification and designation of the steel grades

Delivery condition	Classification in accordance with EN 10020	Steel name	Steel number
Normalized or normalizing formed	non-alloy quality steel	L245NB	1.0457
		L290NB	1.0484
		L360NB	1.0582
Quenched and tempered	alloy special steel	L415NB	1.8972
	non-alloy quality steel	L360QB	1.8948
		L415QB	1.8947
		L450QB	1.8952
		L485QB	1.8955
		L555QB	1.8957
		Thermomechanically rolled	non-alloy quality steel
L290MB	1.0429		
L360MB	1.0578		
alloy special steel	L415MB		1.8973
	L450MB		1.8975
	L485MB		1.8977
	L555MB		1.8978

6 Information to be supplied by the purchaser

6.1 Mandatory information

The purchaser shall state in his enquiry and order the following minimum information:

- a) quantity ordered (e.g. total tonnage or total length of pipe);
- b) type of pipe (see Table 2, column 1);
- c) product form (i.e. pipe);
- d) pipe outside diameter and wall thickness in millimetres (see 8.6.1.2);
- e) random length group or, if a fixed length is required, the length in millimetres (see 8.6.3.3 and Table 11);
- f) number of this European Standard (EN 10208-2);
- g) steel name or number (see Table 1);
- h) which impact energy requirements, Table 6 or Table 7, shall apply;
- i) type of inspection document required (see 9.1.1).

6.2 Options

A number of options are specified in this document and these are listed below. If the purchaser does not indicate a wish to implement any of these options at the time of enquiry and order, the pipe shall be supplied in accordance with the basic specification (see 6.1).

a) Mandatory agreement – options which shall be agreed when applicable

- 1) chemical composition of pipe with wall thickness $T > 25$ mm (see Table 3, footnote b);
- 2) mechanical properties of pipe with wall thickness $T > 25$ mm (see Table 5, footnote a);
- 3) impact and DWT test requirements for outside diameter $D > 1\,430$ mm and/or wall thickness > 25 mm (see Tables 6 and 7, footnote b);
- 4) diameter tolerances for seamless pipe with wall thickness $T > 25$ mm (see Table 9, footnote b);
- 5) diameter and out-of-roundness tolerances for pipe with outside diameter $D > 1\,430$ mm (see Table 9, columns 2 and 3);
- 6) party to issue the inspection document 3.2 (see 9.1.1).

b) Unless otherwise agreed – left to the discretion of the manufacturer

- 1) method of verification of dimensional and geometrical requirements (see 9.4.10.4);
- 2) timing of NDT of seamless and HFW pipe (see C.2.2);
- 3) radiographic inspection for the detection of longitudinal imperfections (see C.5.4 a);

c) Optional agreement – options which may be agreed

- 1) approval of the quality system and/or verification of the manufacturing procedure (see 7.1 and Annex A);
- 2) steelmaking process (see 7.2.1);
- 3) manufacture of SAWL pipe with two seams (see 7.3);
- 4) acceptance of strip end welds in SAWH/COWH pipe (see 7.6.1);
- 5) Mo content (see Table 3, footnote g);
- 6) lower CEV (see Table 3, footnote d);
- 7) DWT test (see Tables 6 and 7, footnote d);
- 8) weldability data or weld tests (see 8.4.2);
- 9) application of the diameter tolerance to the inside diameter (see Table 9, footnote c);
- 10) application of the diameter tolerance to the outside diameter (see Table 9, footnote d);
- 11) special bevel configuration (see 8.6.4.2);
- 12) offset of strip end welds (see Table 13, footnote a);
- 13) impact test for the heat affected zone (see 9.2.2);
- 14) test piece direction (see Table 18, footnote b);
- 15) use of circular test pieces (see 9.3.2.2, second paragraph);
- 16) use of flattened and heat treated test coupons (see 9.3.2.2, last paragraph);

- 17) impact test and DWT test temperatures other than 0 °C (see 9.4.3.1 and 9.4.4);
- 18) substitution of the macrographic examination of the weld by alternative test methods (see 9.4.7.1);
- 19) hardness test during production for seam heat treated HFW pipe (see 9.4.7.2);
- 20) hydrostatic test pressures greater than 250 bar or 500 bar and up to 100 % of specified minimum yield strength respectively (see 9.4.8.1);
- 21) use of special devices for measuring the pipe diameter (see 9.4.10.1);
- 22) use of (cold) die stamping (see 10.1.3);
- 23) special marking (see 10.2);
- 24) coating and lining (see Clause 11);
- 25) acceptance level U2/C or F2, respectively for NDT of seamless pipe (see C.3.1, C.3.2);
- 26) use of the flux leakage test (for seamless and HFW pipe) and of the eddy current test (for HFW pipe) (see C.3.2 and C.4.1.2);
- 27) acceptance level U2/C (U2) for NDT of HFW pipe (see C.4.1.1);
- 28) acceptance level F2 for NDT of HFW pipe (see C.4.1.2 a);
- 29) verification of quality requirement for laminar imperfections (see C.2.4; C.4.2 and C.4.3; C.5.2 and C.5.3);
- 30) use of fixed depth notches for equipment calibration (see C.5.1.1 d);
- 31) use of hole penetrometer instead of ISO wire penetrometer (see C.5.5.1 a);
- 32) use of fluoroscopic inspection (C.5.5.1 b).

6.3 Example of ordering

Orders shall be preferably presented as given in the example.

EXAMPLE 10 000 m longitudinally submerged arc welded pipe with an outside diameter of 610 mm, a wall thickness of 12,5 mm in a length according to random length group r2 (see Table 12), made of steel grade L415MB, impact properties in accordance with Table 7, with drop weight tear (DWT) tests and inspection certificate 3.2 in accordance with EN 10204:

10 000 m SAWL pipe – 610 x 12,5 x r2 – EN 10208-2 – L415MB – impact properties of Table 7,
with DWT test, inspection certificate EN 10204:3.2

7 Manufacturing

7.1 General

The pipe manufacturer and the stockist, where products are supplied through a stockist, shall operate a quality system. An approval of the quality system may be agreed.

In special cases, the verification of the manufacturing procedure either by available data or in accordance with Annex A may also be agreed.

7.2 Steelmaking

7.2.1 The steels shall be made using the basic oxygen process or the electric furnace process.

Other equivalent steelmaking processes may be used by agreement.

7.2.2 The steels shall be fully killed and be made according to fine grain practice.

7.3 Pipe manufacture

Acceptable types of pipe are listed together with acceptable manufacturing routes in Table 2. The type of pipe and the type of heat treatment as given in the steel name shall be specified by the purchaser.

SAWH pipes shall be manufactured using strip with a width not less than 0,8 or more than 3,0 times the pipe outside diameter.

SAWL pipe may be manufactured with two seams by agreement.

7.4 Heat treatment condition

The pipes shall be delivered in one of the forming and heat treatment conditions given in Table 2.

Table 2 — Type of piping and manufacturing route (starting material, pipe forming and heat treatment conditions)

Type of pipe	Starting material	Pipe forming ^a	Heat treatment condition	Symbol for the heat treatment
Seamless (S)	Ingot or billet	Hot rolling	Normalized or normalizing formed	N
			Quenched and tempered	Q
		Hot rolling and cold finishing	Normalized	N
			Quenched and tempered	Q
High frequency welded (HFW)	Normalizing rolled strip	Cold forming	Normalized weld area	N
	Thermomechanically rolled strip		Heat treated weld area	M
	Hot rolled or normalizing rolled strip		Normalized (entire pipe)	N
		Cold forming and hot stretch reducing under controlled temperature resulting in a normalized condition	–	N
Submerged arc-welded (SAW) – longitudinal seam (SAWL) – helical seam (SAWH),	Normalized or normalizing rolled plate or strip	Cold forming	–	N
	Thermomechanically rolled plate or strip			M
Combination welded (COW) – longitudinal seam COWL) – helical seam ¹ (COWH)	As rolled plate or strip	Normalizing forming	–	N
	Normalized or normalizing rolled plate or strip			

^a See 3.4 and 3.5.

7.5 Sizing

The pipes may be sized to their final dimensions by expanding or reducing. This shall not produce excessive permanent strain. Where no further heat treatment or only a heat treatment of the weld area is carried out, the sizing ratio s_r achieved by this cold working shall not exceed 0,015. It shall be calculated according to the formula:

$$s_r = \frac{|D_a - D_b|}{D} \quad (1)$$

where

D_a is the outside diameter after sizing;

BS EN 10208-2:2009
EN 10208-2:2009 (E)

D_b is the outside diameter before sizing;

D is the specified outside diameter.

7.6 Strip end welds

7.6.1 For helical seam welded pipe, the strip end weld may be retained in the pipe, by agreement. Where accepted, the strip end weld shall be located at least 200 mm from the pipe end.

7.6.2 For welded pipe with a longitudinal seam, strip end welds are not permitted in the pipe.

7.7 Jointers

The delivery of jointers is not permitted.

7.8 General requirements for non-destructive testing

All NDT activities shall be carried out by qualified and competent level 1, 2 and/or 3 personnel authorized to operate by the employer.

The qualification shall be in accordance with EN 10256 or, at least, an equivalent to it. It is recommended that the level 3 personnel be certified in accordance to EN 473 or, at least an equivalent to it.

The operating authorization issued by the employer shall be in accordance with a written procedure. NDT operations shall be authorized by a level 3 NDT individual approved by the employer.

NOTE The definition of level 1, 2 and 3 can be found in appropriate standards, e.g. EN 473 and EN 10256.

8 Requirements

8.1 General

The requirements specified in this document apply on condition that the relevant specifications for test piece selection, test piece preparation and test methods given in 9.3 and 9.4 are complied with.

NOTE Table 17 gives a survey on the tables and clauses containing requirements and specifications for testing.

8.2 Chemical composition

8.2.1 Cast analysis

The cast analysis reported by the steel producer shall apply and comply with the requirements of Table 3.

Table 3 — Chemical composition (cast analysis)^a for wall thicknesses ≤ 25 mm^b

Steel grade		Maximum content, % by mass									
Steel name	Steel number	C ^c	Si	Mn ^c	P	S	V	Nb	Ti	Others	CEV ^d max.
Steels for seamless and welded pipes											
L245NB	1.0457	0,16	0,40	1,10	0,025	0,020	–	–	–	e	0,42
L290NB	1.0484	0,17	0,40	1,20	0,025	0,020	0,05	0,05	0,04	e	0,42
L360NB	1.0582	0,20	0,45	1,60	0,025	0,020	0,10	0,05	0,04	e, f	0,45
L415NB	1.8972	0,21	0,45	1,60	0,025	0,020	0,15	0,05	0,04	e, f, g	as agreed
Steels for seamless pipes											
L360QB	1.8948	0,16	0,45	1,40	0,025	0,020	0,05	0,05	0,04	e	0,42
L415QB	1.8947	0,16	0,45	1,60	0,025	0,020	0,08	0,05	0,04	e, f, g	0,43
L450QB	1.8952	0,16	0,45	1,60	0,025	0,020	0,09	0,05	0,06	e, f, g	0,45
L485QB	1.8955	0,16	0,45	1,70	0,025	0,020	0,10	0,05	0,06	e, f, g	0,45
L555QB	1.8957	0,16	0,45	1,80	0,025	0,020	0,10	0,06	0,06	f, h	as agreed
Steels for welded pipes											
L245MB	1.0418	0,16	0,45	1,50	0,025	0,020	0,04	0,04	–	e	0,40
L290MB	1.0429	0,16	0,45	1,50	0,025	0,020	0,04	0,04	–	e	0,40
L360MB	1.0578	0,16	0,45	1,60	0,025	0,020	0,05	0,05	0,04	e	0,41
L415MB	1.8973	0,16	0,45	1,60	0,025	0,020	0,08	0,05	0,06	e, f, g	0,42
L450MB	1.8975	0,16	0,45	1,60	0,025	0,020	0,10	0,05	0,06	e, f, g	0,43
L485MB	1.8977	0,16	0,45	1,70	0,025	0,020	0,10	0,06	0,06	e, f, g	0,43
L555MB	1.8978	0,16	0,45	1,80	0,025	0,020	0,10	0,06	0,06	e, f, g	as agreed
<p>a Elements not mentioned in this table shall not be added intentionally without purchaser's approval except for elements which may be added for deoxidation and finishing of the heat (see footnote e).</p> <p>b Chemical composition for larger wall thicknesses up to 40 mm is to be agreed.</p> <p>c For each reduction of 0,01 % below the max. carbon content an increase of 0,05 % manganese above the specified maximum value is permitted with a max. increase of 0,2 %.</p> <p>d $CEV = C + \frac{Mn}{6} + \frac{Cr + Mo + V}{5} + \frac{Ni + Cu}{15}$; the CEV is only specified for the product analysis. For grades with values higher than 0,43 a max. CEV of 0,43 may be agreed.</p> <p>e $0,015 \leq Al_{tot} < 0,060$; $N \leq 0,012$; $\frac{Al}{N} \geq \frac{2}{1}$; $Cu \leq 0,25$; $Ni \leq 0,30$; $Cr \leq 0,30$; $Mo \leq 0,10$.</p> <p>f The sum of V, Nb, Ti shall not exceed 0,15 %.</p> <p>g For these steel grades, a molybdenum content up to 0,35 % may be agreed.</p> <p>h Al, N, Al/N and Cu see footnote e; $Ni \leq 0,60$; $Cr \leq 0,50$; $Mo \leq 0,35$.</p>											

8.2.2 Product analysis

The product analysis shall not deviate from the limiting values for the cast analysis as specified in Table 3 by more than the values given in Table 4.

Table 4 — Permissible deviations of the product analysis from the specified limits on cast analysis given in Table 3

Element	Limiting value for the cast analysis according to Table 3 % by mass	Permissible deviation of the product analysis % by mass
C	≤ 0,21	+ 0,02
Si	≤ 0,45	+ 0,05
Mn	≤ 1,80	+ 0,10
P	≤ 0,025	+ 0,005
S	≤ 0,020	+ 0,005
V	≤ 0,15	+ 0,01
Nb	≤ 0,06	+ 0,01
Ti	≤ 0,06	+ 0,01
V + Nb + Ti	≤ 0,15	+ 0,02
Cr	≤ 0,50	+ 0,05
Ni	≤ 0,60	+ 0,05
Mo	≤ 0,35	+ 0,03
Cu	≤ 0,25	+ 0,05
Al	≤ 0,015 < 0,060	± 0,005
N	≤ 0,012	+ 0,002

8.3 Mechanical properties

The pipe shall, as applicable (see Table 17, column 2), comply with the requirements given in Table 5 and Tables 6 or 7. The purchaser shall state, at the time of enquiry and order, which impact energy requirements, depending on the safety factor to be used, shall apply.

NOTE 1 In case of hot forming and/or subsequent field heat treatment of pipes delivered in the quenched and tempered or thermomechanically rolled condition, an adverse change of mechanical properties can occur (see for example 3.2). Where appropriate, the purchaser should contact the manufacturer for more detailed information.

NOTE 2 The impact requirements in Tables 6 and 7 have been determined using among other parameters a safety factor. The safety factors 1,4 and 1,6 have been chosen as typical examples in the range of commonly used safety factors.

Table 5 — Requirements for the result of tensile and bend test for wall thickness $T \leq 25$ mm^a and for the hydrostatic test

Steel grade		Pipe body ^b (seamless and welded pipes)				Weld seam (SAW and COW pipe)	Entire pipe
		Yield strength $R_{10,5}$ MPa	Tensile strength R_m MPa min.	$R_{10,5}/R_m$ ^c max.	Elongation ^d A % min.	Diameter of the mandrel for bend test ^e (see 9.4.5)	Hydrostatic test (see 9.4.8)
Steel name	Steel number						
L245NB	1.0457	245 to 440	415	0,80	22	3 T	Each length of pipe shall withstand the test without showing leakage or visible deformation
L245MB	1.0418			0,85			
L290NB	1.0484	290 to 440	415	0,85	21	3 T	
L290MB	1.0429			0,85			
L360NB	1.0582	360 to 510	460	0,85	20	4 T	
L360QB	1.8948			0,88			
L360MB	1.0578			0,85			
L415NB	1.8972	415 to 565	520	0,85	18	5 T	
L415QB	1.8947			0,88			
L415MB	1.8973			0,85			
L450QB	1.8952	450 to 570	535	0,90	18	6 T	
L450MB	1.8975			0,87			
L485QB	1.8955	485 to 605	570	0,90	18	6 T	
L485MB	1.8977			0,90			
L555QB	1.8957	555 to 675	625	0,90	18	6 T	
L555MB	1.8978			0,90			

^a Mechanical properties of pipes with greater wall thicknesses up to 40 mm are to be agreed.

^b The same R_m values apply for the weld seam of HFW, SAW and COW pipe.

^c The values for the yield strength ratio apply to the product "pipe". They cannot be required for the starting material.

^d These values apply to transverse specimens taken from the pipe body. When longitudinal specimens are tested (see Table 18), the values of elongation shall be 2 units higher.

^e T = specified wall thickness of the pipe.

EN 10208-2:2009 (E)

Table 6 — Requirements for the results of the impact test for a safety factor of 1,6^a and for the drop weight tear (DWT) test at 0 °C

Steel grade		Impact test									DWT test ^d		
		Minimum impact energy, <i>KV</i> , in J for outside diameters $D \leq 1\,430$ mm and wall thicknesses $T \leq 25$ mm ^b											Minimum shear fracture area in %
		Pipe body (pipe outside diameter D in mm)									Weld seam	Pipe body	
											$D \leq 1\,430$		$500 < D \leq 1\,430$
Steel name	Steel number	≤ 510	> 510 ≤ 610	> 610 ≤ 720	> 720 ≤ 820	> 820 ≤ 920	> 920 $\leq 1\,020$	$> 1\,020$ $\leq 1\,120$	$> 1\,120$ $\leq 1\,220$	$> 1\,220$ $\leq 1\,430$	transverse to the seam		
		transverse to the pipe axis (longitudinal to the pipe axis in angular brackets) ^c											
L245NB	1.0457	40 (30) [60 (45)]									40 (30)		not applicable
L245MB	1.0418										42 (32)		
L290NB	1.0484										42 (32)		
L290MB	1.0429												
L360NB	1.0582										42 (32)		
L360QB	1.8948												
L360MB	1.0578										42 (32)		
L415NB	1.8972												
L415QB	1.8947												
L415MB	1.8973												
L450QB	1.8952	40 (30)			42 (32)	43 (32)	47 (35)	40 (30)		85 ^e			
L450MB	1.8975	40 (30)		42 (32)	43 (32)	47 (35)							
L485QB	1.8955	40 (30) [60 (45)]	41 (31) [62 (47)]	45 (34) [68 (51)]	48 (36)	51 (38)	53 (40)				56 (42)	58 (44)	63 (47)
L485MB	1.8977												
L555QB	1.8957	48 (36) [72 (54)]	55 (41) [83 (62)]	61 (46) [92 (69)]	66 (50)	72 (54)	77 (58)				82 (62)	87 (65)	96 (72)
L555MB	1.8978												

^a See Note 2 in 8.3.

^b The values apply for standard test pieces. For sub-size test pieces, see 9.4.3.2. The specified values without brackets are the transverse minimum average values for three tests; the specified transverse minimum individual values (75 % of the average values) are indicated in round brackets. The impact requirements do not apply for the heat affected zone (HAZ).
For outside diameters $D > 1\,430$ mm and/or wall thickness $T > 25$ mm values shall be agreed.

The test pieces shall be taken transverse to the pipe axis as long as minimum sub-size test pieces with a width $w \geq 5$ mm are still obtainable without flattening.

^d To be carried out by agreement of for pipes with an outside diameter $D > 500$ mm, a wall thickness $T > 8$ mm and a specified yield strength > 360 MPa.

^e Average value of two tests.

Table 7 — Requirements for the results of the impact test for a safety factor of 1,4^a and for the drop weight tear (DWT) test at 0 °C

Steel grade		Impact test										DWT test ^d	
		Minimum impact energy, KV, in J for outside diameters $D \leq 1\,430$ mm and wall thicknesses $T \leq 25$ mm ^b										Minimum shear fracture area in %	
Steel name	Steel number	Pipe body (pipe outside diameter D in mm)									Weld seam	Pipe body	
		transverse to the pipe axis (longitudinal to the pipe axis in angular brackets) ^c									D in mm		
		≤ 510	> 510 ≤ 610	> 610 ≤ 720	> 720 ≤ 820	> 820 ≤ 920	> 920 $\leq 1\,020$	$> 1\,020$ $\leq 1\,120$	$> 1\,120$ $\leq 1\,220$	$> 1\,220$ $\leq 1\,430$	$D \leq 1\,430$ transverse to the seam	$500 < D \leq 1\,430$	
L245NB	1.0457	40 (30) [60 (45)]									40 (30)	not applicable	
L245MB	1.0418												
L290NB	1.0484												
L290MB	1.0429												
L360NB	1.0582												
L360QB	1.8948												
L360MB	1.0578												
L415NB	1.8972	40 (30)									40 (30)	85 ^e	
L415QB	1.8947												
L415MB	1.8973	40 (30) [60 (45)]									40 (30)	85 ^e	
L450QB	1.8952												
L450MB	1.8975	40 (30) [60 (45)]		41 (31) [62 (47)]	43 (32)	46 (35)	48 (36)	51 (38)	53 (40)	57 (43)	40 (30)	85 ^e	
L485QB	1.8955	46 (35) [69 (52)]	50 (38) [75 (56)]	55 (41) [83 (62)]	58 (44)	62 (47)	65 (49)	68 (51)	71 (53)	77 (58)			
L485MB	1.8977												
L555QB	1.8957												
L555MB	1.8978	61 (46) [92 (69)]	68 (51) [102 (77)]	76 (57) [114 (86)]	83 (62)	90 (68)	96 (72)	102 (77)	108 (81)	120 (90)	40 (30)	85 ^e	

EN 10208-2:2009 (E)

- a See Note 2 in 8.3.
- b The values apply for standard test pieces. For sub-size test pieces, see 9.4.3.2. The specified values without brackets are the transverse minimum average values for three tests; the specified transverse minimum individual values (75 % of the average values) are indicated in round brackets. The impact requirements do not apply for the heat affected zone (HAZ). For outside diameters $D > 1\,430$ mm and/or wall thickness $T > 25$ mm values shall be agreed.
- c The test pieces shall be taken transverse to the pipe axis as long as minimum sub-size test pieces with a width $w \geq 5$ mm are still obtainable without flattening.
- d To be carried out by agreement of for pipes with an outside diameter $D > 500$ mm, a wall thickness $T > 8$ mm and a specified yield strength > 360 MPa.
- e Average value of two tests.

8.4 Weldability

8.4.1 In view of the processes for the manufacture of pipes and of pipelines, the requirements for the chemical composition of the steels and in particular the limiting values for the carbon equivalent CEV (see Table 3) have been selected to insure that the steels delivered in accordance with this document are weldable.

However, account should be taken of the fact that the behaviour of the steel during and after welding is dependent not only on the steel, but also on the welding consumables used and on the conditions of preparing for and carrying out the welding.

8.4.2 If so agreed, the manufacturer shall supply for the type of steel concerned weldability data or perform weld tests. In the case of weld tests, the details for carrying out the tests and the acceptance criteria are also to be agreed.

8.5 Appearance and soundness

8.5.1 The pipes shall be free from defects in the finished condition.

8.5.2 The internal and external surface finish of the pipes shall be typical of the manufacturing process and the heat treatment employed. The surface condition shall be such that any surface imperfections requiring dressing can be identified.

8.5.3 Surface imperfections disclosed by visual inspection shall be investigated, classified and treated as follows:

- a) imperfections with a depth equal to or less than 12,5 % of the specified wall thickness, and which do not encroach on the specified minimum wall thickness, shall be classified as acceptable imperfections and treated in accordance with B.1;
- b) imperfections with a depth greater than 12,5 % of the specified wall thickness, but which do not encroach on the specified minimum wall thickness, shall be classified as defects and shall either be dressed-out by grinding in accordance with B.2 or treated in accordance with B.3 as appropriate;
- c) imperfections which encroach the specified minimum wall thickness shall be classified as defects and treated in accordance with B.3.

8.5.4 Geometric deviations for the normal cylindrical contour of the pipe which occur as a result of the pipe forming process or manufacturing operations (e.g. dents, flat spots, peaks) shall not exceed the following values:

- a) 3 mm (flat spots, peaks and cold formed dents with sharp bottom gouges);
- b) 6 mm (other dents).

These limits refer to the gap between the extreme point of the deviation and the prolongation of the normal contour of the pipe.

For the measurement of flat spots and peaks see 9.4.10.3. For dents, the length in any direction shall not exceed one half of the pipe outside diameter.

8.5.5 For undercuts disclosed by visual inspection of SAW and COW pipes, the acceptance criteria given in C.5.5.2 d) to C.5.5.2 f) apply.

8.5.6 Surface imperfections may be removed, but only by grinding or machining. The tube thickness in the dressed area shall not be less than the specified minimum wall thickness. All dressed areas shall blend smoothly into the contour of the tube.

BS EN 10208-2:2009
EN 10208-2:2009 (E)

8.5.7 Any hard spot exceeding 50 mm in any direction shall have a hardness value less than 35 HRC (327 HB) (see 9.4.9).

8.5.8 The acceptance criteria for imperfections detected by non-destructive testing, as required by 9.4.12, are specified in Annex C.

8.6 Dimensions, masses and tolerances

8.6.1 Dimensions

8.6.1.1 The pipes shall be delivered to the dimensions specified in the enquiry and order, within the tolerances given in 8.6.3 to 8.6.6.

8.6.1.2 Where appropriate, the preferred outside diameters D and wall thicknesses T given in Table 8 and selected from those in EN 10220 should be ordered.

8.6.1.3 For the length of pipes, see 8.6.3.3; and for the execution of the pipe ends, see 8.6.4.

8.6.2 Masses

The mass per unit length may be calculated by the formula

$$M = (D - T) \times T \times 0,0246615 \text{ kg/m} \quad (2)$$

where

M is the mass per unit length,

D is the specified outside diameter in mm,

T is the specified wall thickness in mm.

The formula is based on density equal to 7,85 kg/dm³.

Table 8 — Preferred outside diameters and wall thickness
(indicated by the shadowed field)

Dimensions in mm

Outside diameter <i>D</i>	Wall thickness <i>T</i>																											
	2,3	2,6	2,9	3,2	3,6	4	4,5	5	5,6	6,3	7,1	8	8,8	10	11	12,5	14,2	16	17,5	20	22,2	25	28	30	32	36	40	
33,7																												
42,4																												
48,3																												
60,3																												
88,9																												
114,3																												
168,3																												
219,1																												
273																												
323,9																												
355,6																												
406,4																												
457																												
508																												
559																												
610																												
660																												
711																												
762																												
813																												
864																												
914																												
1 016																												
1 067																												
1 118																												
1 168																												
1 219																												
1 321																												
1 422																												
1 524																												
1 626																												

8.6.3 Tolerances on the pipe

8.6.3.1 Diameter and out-of-roundness

The outside diameters and the out-of-roundness of the pipes as defined in 9.4.10.2 shall be within the tolerance limits given in Table 9.

Table 9 — Tolerance on diameter and out-of-roundness

Outside diameter D mm	Diameter tolerance ^a				Out-of-roundness ^a	
	Pipe except the end		Pipe end ^b		Pipe except the end	Pipe end ^{b,e}
	Seamless pipe	Welded pipe	Seamless pipe	Welded pipe		
$D \leq 60$	$\pm 0,5$ mm or $\pm 0,75 \% D$ (whichever is the greater)	$\pm 0,5$ mm or $\pm 0,75 \% D$ (whichever is the greater), but max. ± 3 mm	$\pm 0,5$ mm or $\pm 0,5 \% D$ ^c (whichever is the greater), but max. $\pm 1,6$ mm		(included in the diameter tolerance)	
$60 < D \leq 610$					2,0 %	1,5 %
$610 < D \leq 1\,430$	$\pm 1 \% D$	$\pm 0,5 \% D$ but max. ± 4 mm	$\pm 2,0$ mm ^d	$\pm 1,6$ mm ^d	1,5 % (but max. 15 mm) for $\frac{D}{T} \leq 75$;	1,0 % for $\frac{D}{T} \leq 75$; 1,5 % for $\frac{D}{T} > 75$
$D > 1\,430$	as agreed		as agreed ^d		2,0 % for $\frac{D}{T} > 75$	as agreed ^d

^a The pipe end shall be considered to include a length of 100 mm at the pipe extremities.

^b For seamless pipe, the values apply for wall thicknesses $T \leq 25$ mm; for greater thicknesses by agreement.

^c Subject to agreement, the tolerance may be applied to the inside diameter for outside diameters $D > 210$ mm.

^d Unless otherwise agreed, the diameter tolerance applies to the inside diameter.

^e When the diameter tolerance is applied to the inside diameter, the inside diameter shall also be the basis for the out-of-roundness requirements.

8.6.3.2 Wall thickness

The wall thickness shall be within the tolerances given in Table 10.

Table 10 — Tolerances on wall thickness

Wall thickness T mm	Permissible tolerance
Seamless pipe ^a	
$T \leq 4$	+ 0,6 mm / - 0,5 mm
$4 < T < 25$	+ 15 % / - 12,5 %
$T \geq 25$	+ 3,75 mm / - 3,0 mm or $\pm 10 \%$ (whichever is the greater)
Welded pipe	
$T \leq 10$	+ 1,0 mm / - 0,5 mm
$10 < T < 20$	+ 10 % / - 5 %
$T \geq 20$	+ 2,0 mm / - 1,0 mm
^a For outside diameters $D \geq 355,6$ mm, it is permitted to exceed the upper wall thickness locally by further 5 % of the specified wall thickness. However, the mass tolerance in 8.6.6 applies.	

8.6.3.3 Length

8.6.3.3.1 Depending on the order, the pipes are to be delivered in random lengths or in fixed lengths.

8.6.3.3.2 Random lengths shall be delivered in accordance with the requirements of the specified length groups (see Table 11).

8.6.3.3.3 Fixed lengths shall be delivered with a tolerance of ± 500 mm.

Table 11 — Requirements for random length groups

Dimensions in metres

Length group	Length range for 90 % of order item ^a	Minimum average length of order item	Shortest length of order item
r1	6 to 11	8	4
r2	9 to 14	11	6
r3	10 to 16	13	7
r4	11 to 18	15	8
^a The upper limit applies as an absolute maximum value for the length of each individual pipe.			

8.6.3.4 Straightness


The total deviation from a straight line shall be $\leq 0,2$ % of the whole pipe length. Any local deviation in straightness shall be < 4 mm/m.

8.6.4 Finish of pipe ends

8.6.4.1 All pipe ends shall be cut square and be free from harmful burrs.

The out-of-squareness (see Figure 1) shall not exceed:

- a) 1 mm for outside diameters $D \leq 220$ mm;
- b) $0,005 D$, but max. 1,6 mm, for outside diameters $D > 220$ mm.

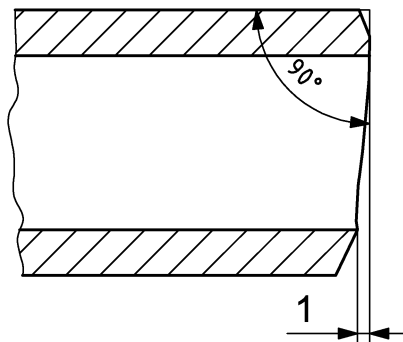**Key**

1 out-of-squareness

Figure 1 — Out-of-squareness

8.6.4.2 The end faces of pipes with a wall thickness greater than 3,2 mm shall be bevelled for welding. The angle of the bevel measured from a line drawn perpendicular to the axis of the pipe shall be 30° with a tolerance of ${}^{+5}_0^\circ$. The width of the root face of the bevel shall be 1,6 mm with a tolerance of $\pm 0,8$ mm.

Other bevel preparations may be agreed.

Where internal machining or grinding is carried out, the angle of the internal taper, measured from the longitudinal axis, shall be not greater than:


- a) as given in Table 12 (for seamless pipe);
- b) 7° (for welded pipe, outside diameter $D > 114,3$ mm).

Table 12 — Maximum angle of internal taper for seamless pipe

Specified wall thickness T mm	Maximum angle of taper degrees
$T < 10,5$	7
$10,5 \leq T < 14$	9,5
$14 \leq T < 17$	11
$T \geq 17$	14

8.6.5 Tolerances of the weld seam**8.6.5.1 Radial offset of plate or strip edges**


8.6.5.1.1 In the case of HFW pipe, the radial offset of strip edges at the joint shall not cause the remaining wall thickness at the weld to be less than the specified minimum wall thickness (see Figure 2a).

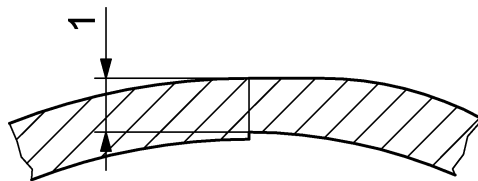

Key

1 remaining wall thickness at the weld

a) Radial offset of strip edges (HFW pipe)

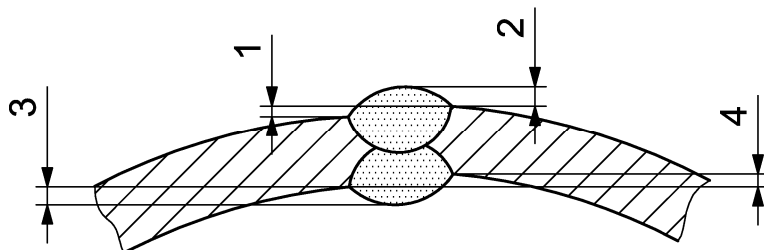


Key

1, 4 outside/inside radial offset

2, 3 outside/inside height of the weld bead

b) Radial offset and height of the weld beads of plate/strip edges (SAW and COW pipe)

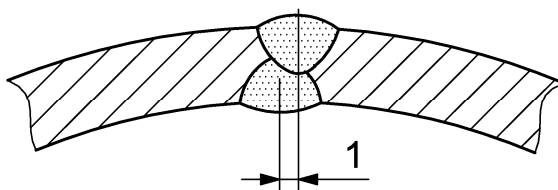

Key

1 misalignment

c) Misalignment of the weld beads (SAW and COW pipe)

Figure 2 — Possible dimensional deviations of the weld seam

8.6.5.1.2 In the case of SAW and COW pipes, the maximum radial offset (see Figure 2b) of the strip/plate edges shall be as given in Table 13.

Table 13 — Maximum permissible offset of SAW and COW pipes

Dimensions in mm

Specified wall thickness T	Maximum permissible radial offset ^a
$T \leq 10$	1,0
$10 < T \leq 20$	0,1 T
$T > 20$	2,0

^a For strip and welds other requirements may be agreed.

8.6.5.2 Height of the flash or weld bead/weld reinforcement

8.6.5.2.1 The outside flash of HFW pipe shall be trimmed to an essentially flush condition. The inside flash shall not extend above the contour of the pipe by more than $0,3 \text{ mm} + 0,05 T$. When trimming, the wall thickness shall not be reduced below the minimum specified.

The depth of groove resulting from trimming the internal flash of HFW pipe shall not undercut the contour of the pipe by more than that given in Table 14.

Table 14 — Maximum permissible depth of groove of HFW pipe

Dimensions in mm

Specified wall thickness T	Maximum permissible depth of groove
$T \leq 4,0$	$0,1 T$
$4,0 < T \leq 8$	0,4
$T > 8$	$0,05 T$

8.6.5.2.2 The inside weld bead of SAW and COW pipe (see Figure 2b) shall be ground flush with a tolerance of ${}^{+0,5}_0$ mm for a distance of 100 mm from each pipe end.

The height of the weld bead of the remainder of the pipe shall not exceed the applicable value given in Table 15.

Table 15 — Maximum permissible weld bead of SAW and COW pipes

Dimensions in mm

Specified wall thickness T	Maximum height of the weld bead	
	inside	outside
$T \leq 15$	3	3
$T > 15$	3	4

8.6.5.2.3 The weld bead shall blend in smoothly with the parent metal and shall for SAW and COW pipe not come below the contour of the pipe, except that dressing out of undercuts is permitted (see C.5.5.2 d).

8.6.5.3 Misalignment of the weld beads

Any misalignment of the weld beads of SAW and COW pipes (see Figure 2c) shall not exceed the values given in Table 16.

Table 16 — Maximum permissible misalignment of the weld beads of SAW and COW pipe

Dimensions in mm

Specified wall thickness T	Maximum permissible misalignment of the weld beads
$T \leq 10$	3
$T > 10$	4

8.6.6 Mass tolerance

The mass of any individual pipe shall not deviate from the nominal mass determined in accordance with 8.6.2 by more than + 10 % or – 3,5 %.

9 Inspection

9.1 Types of inspection and inspection documents

9.1.1 The compliance with the requirements of the order shall be checked for products in accordance with this document by specific inspection.

The purchaser shall specify the required type of inspection document (3.1 or 3.2) in accordance with EN 10204.

If an inspection certificate 3.2 is specified, the purchaser shall notify the manufacturer of the name and address of the organization or person who is to carry out the inspection and produce the inspection document. It shall also be agreed which party shall issue the certificate.

9.1.2 The inspection document shall include, in accordance with EN 10168, the following codes and information:

- A commercial transactions and parties involved;
- B description of products to which the inspection certificate applies;
- C01 to C02 location of sample, direction of the test piece and, if applicable, testing temperature;
- C10 to C29 tensile test;
- C40 to C43 impact test and, if applicable, DWT test;
- C50 to C69 bend or flattening test;
- C71 to C92 cast analysis and product analysis;
- D01 marking and dimensional checking and verification of the surface appearance;
- D02 to D99 non-destructive testing and hydrostatic test;
- Z validation.

9.2 Summary of inspection and testing

9.2.1 The tests to be carried out on the various types of pipe are given in Table 17, columns 2, 3 and 4. The frequency of testing is given in Table 17, column 5.

9.2.2 In addition to the tests specified in Table 17, impact tests on the heat affected zone of welded pipes may, where appropriate (see for example A.0), be agreed. In such cases the details of the requirements and the testing conditions shall also be agreed.

9.3 Selection and preparation of samples and test pieces

9.3.1 Samples and test pieces for the product analysis

The samples and test pieces shall be taken and prepared in accordance with EN ISO 14284. At the discretion of the pipe manufacturer they shall be taken either from plate/strip or pipe.

9.3.2 Samples and test pieces for the mechanical tests

9.3.2.1 General

The samples and test pieces for the specified tests shall be taken and the corresponding test pieces prepared in accordance with the general conditions of EN ISO 377, as far as applicable.

Samples for the various types of test shall be taken from pipe ends in accordance with Figures 3 and 4 and Table 18 taking into account the supplementary details specified in 9.3.2.2 to 9.3.2.6.

Table 17 — Survey of tests and requirements

1	2				3	4	5		6	7	8	
	The specifications in columns 3 to 8 apply for ^a				Type of test or requirement	Test status ^b	Frequency of testing		Sampling conditions see	Test method see	Requirements see	
	Seamless pipe	HFW pipe	SAW, COW pipe									
			longitudinal seam	helical seam								
a1	x	x	x	x	Cast analysis	m	1 analysis/cast		Left to the discretion of the manufacturer.		Table 3	
a2	x	x	x	x	Product analysis	m	1 analysis/cast		9.3.1	9.4.1	Table 4	
b1	x	x	x	x	Tensile test – on the pipe body	m	Except for strip end weld testing the test units shall consist only of pipes of – the same cast – the same heat treatment condition – the same dimension and a) in the case of outside diameters $D < 508$ mm not more than 100 pipes b) otherwise not more than 50 pipes.	Test pieces per sample 1	9.3.2.2 and Table 18	9.4.2	Table 5	
b2		x	x	x	– on the weld seam ($D \geq 210$ mm)	m						1
b3				x	– on the strip end weld seam ($D \geq 210$ mm)	m						1
c1	x	x	x	x	Charpy V-notch impact test (for $T \geq 5$ mm) – on the pipe body	m		3	9.3.2.3, Table 18 and Figure 5	9.4.3	Table 6 and Table 7	
c2		x	x	x	– on the weld seam ^c	m	3					
c3				x	– on the strip end weld seam ^c	m	3					
d	x	x	x	x	Drop weight tear test on the pipe body ^d	o	For strip end welds the test unit shall consist of not more than 50 pipes containing strip end welds per order item.		9.3.2.4 and Table 18	9.4.4		
e1			x	x	Bend test – on the weld seam	m	One sample tube shall be taken per test unit.		9.3.2.5 and Table 18	9.4.5	9.4.5.2, Table 5 and Figure 6	
e2				x	– on the strip end weld seam	m	2					
f		x			Flattening test	m	4 tests per coil; plus 2 tests in the case of a weld stop.		9.3.2.6 and Figure 4	9.4.6	9.4.6.2 and Figure 4	

EN 10208-2:2009 (E)

Table 17 (continued)

1	2				3	4	5	6	7	8
	The specifications in columns 3 to 8 apply for ^a				Type of test or requirement	Test status ^b	Frequency of testing	Sampling conditions see	Test method see	Requirements see
	Seamless pipe	HFW pipe	SAW, COW pipe							
			Longitudinal seam	Helical seam						
g1			x	x	Macro- and metallographic examination – Macrography	m	Once per shift or when pipe size is changed.	9.3.3	9.4.7.1	8.6.5.3
g2		x			– Metallography	m	Once per shift or when size or steel grade of the pipe is changed.		9.4.7.2	9.4.7.2
h1		x	x	x	Hardness test	m	In cold formed pipe any hard spot exceeding 50 mm in any direction shall be tested.	–	9.4.9	8.5.7
h2		x				o	To be carried out by agreement for seam heat treated HFW pipes.	–	–	e
i	x	x	x	x	Hydrostatic testing	m	Each pipe shall be tested.	–	9.4.8	9.4.8 and Table 5
j	x	x	x	x	Visual examination	m	Each pipe shall be examined.		9.4.9	8.5
k1	x	x	x	x	Dimensional testing – outside or inside diameter and out-of-roundness of pipe ends	m	Dimensions of each pipe shall be verified.	–	9.4.10.1, 9.4.10.2	8.6.3.1 and Table 9
k2	x	x	x	x	– wall thickness of pipe ends				9.4.10.4	8.6.3.2 and Table 10
k3	x	x	x	x	– other dimensional characteristics excluding the seam	m	At random testing.	9.4.10.3, 9.4.10.4	8.6.3.3, 8.6.3.4, 8.6.4	
k4		x	x	x	– weld seam	m	The details are left to the discretion of the inspector.		8.6.5	
l	x	x	x	x	Weighing	m	Each pipe or lot shall be weighed.	9.4.11	8.6.6	
m	x	x	x	x	Non-destructive testing	See Table C.1				

^a HFW High frequency welded; SAW Submerged arc welded; COW Combination welded.

^b m mandatory; o optional.

^c As far as test pieces transverse to the weld seam with a width of ≥ 5 mm are obtainable without straightening.

^d To be carried out by agreement for pipes with an outside diameter $D > 500$ mm, a wall thickness $T > 8$ mm and a minimum yield strength greater than 360 MPa.

^e The hardness values shall be agreed.


Table 18 — Number, direction and location of the test pieces to be taken per sample for the mechanical tests

Type of pipe ^a	Test	Test pieces to be taken from	Outside diameter <i>D</i> in mm			For further information see	
			< 210	≥ 210 < 500	≥ 500		
			Number, direction and location of the test pieces (see explanation of the symbols in Figure 3)				
Seamless (see Figure 3a)	Tensile	pipe body	1L	1L ^b	1L ^b	9.3.2.2	
	Charpy V-notch	pipe body	3T	3T	3T	9.3.2.3	
	Drop weight tear ^c	pipe body	–	–	2T	9.3.2.4	
Longitudinal seam (see Figure 3b)	HFW, SAW and COW	Tensile	pipe body	1L90	1T90	1T90	9.3.2.2
		Charpy V-notch	pipe body	3T90	3T90	3T90	9.3.2.3
		Drop weight tear ^c	pipe body	–	–	2T90	9.3.2.4
	SAW, COW	Tensile	seam ^d	–	1W	1W	9.3.2.2
		Charpy V-notch	seam ^d	3W	3W	3W	9.3.2.3
		Bend	seam ^d	2W	2W	2W	9.3.2.5
		HFW	Flattening	See Figure 4			9.3.2.6
Helical seam (see Figure 3c)	SAW, COW	Tensile	pipe body	1L, <i>a/4</i>	1T, <i>a/4</i>	1T, <i>a/4</i>	9.3.2.2
		Charpy V-notch	pipe body	3T, <i>a/4</i>	3T, <i>a/4</i>	3T, <i>a/4</i>	9.3.2.3
		Drop weight tear ^c	pipe body	–	–	2T, <i>a/4</i>	9.3.2.4
		Tensile	seam	–	1W	1W	9.3.2.2
		Charpy V-notch	seam	3W	3W	3W	9.3.2.3
		Bend	seam	2W	2W	2W	9.3.2.5
		Tensile	strip end weld	–	1WS	1WS	9.3.2.2
		Charpy V-notch	strip end weld	3WS	3WS	3WS	9.3.2.3
		Bend	strip end weld	2WS	2WS	2WS	9.3.2.5

^a HFW High frequency welded; SAW Submerged arc welded; COW Combination welded.
^b By agreement 1T instead of 1L.
^c See Table 6 and 7, footnote d.
^d If, by agreement (see 7.3), pipes with two seams are delivered, both seams are to be subjected to the tests.


BS EN 10208-2:2009

EN 10208-2:2009 (E)

**Key**


- 1 L — longitudinal sample
- 2 T — transverse sample

a) Seamless pipe

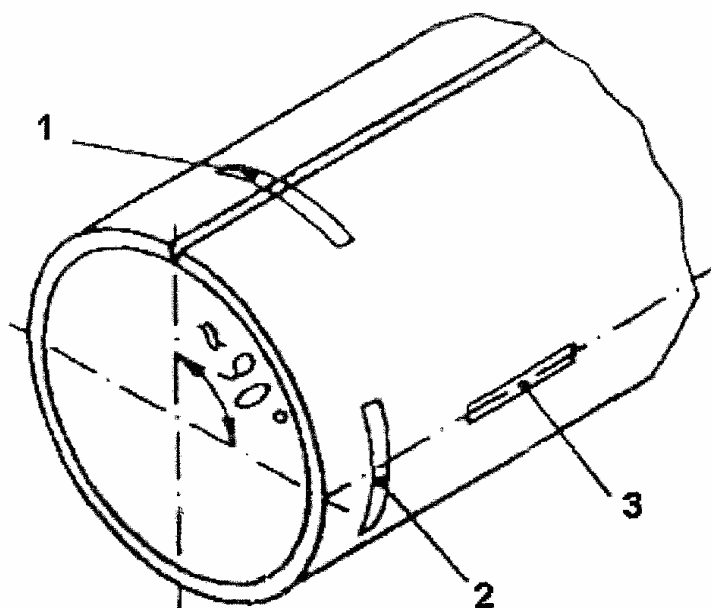**Key**

- 1 W — transverse sample, centred on the weld
- 2 T90 — transverse sample, centred $\approx 90^\circ$ from the longitudinal weld
- 3 L90 — longitudinal sample, centred $\approx 90^\circ$ from the longitudinal weld


b) HFW, SAWL and COWL pipe

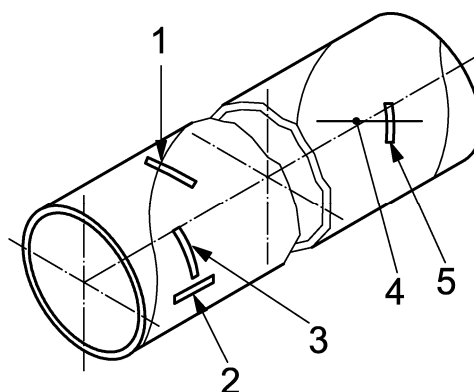**Key**

- 1 W — transverse sample, centred on the helical seam weld
- 2 L — longitudinal sample, centred at least $a/4$ in the longitudinal direction from the helical seam weld
- 3 T — transverse sample, centred at least $a/4$ in the longitudinal direction from the helical seam weld
- 4 strip/plate end weld, with length a
- 5 WS — transverse sample, centred at least $a/4$ from the junctions of the helical seam weld and the strip/plate end weld

c) SAWH and COWH pipe

Figure 3 — Sample position and explanation of the symbols applied in Table 18 for specifying the test piece direction and position

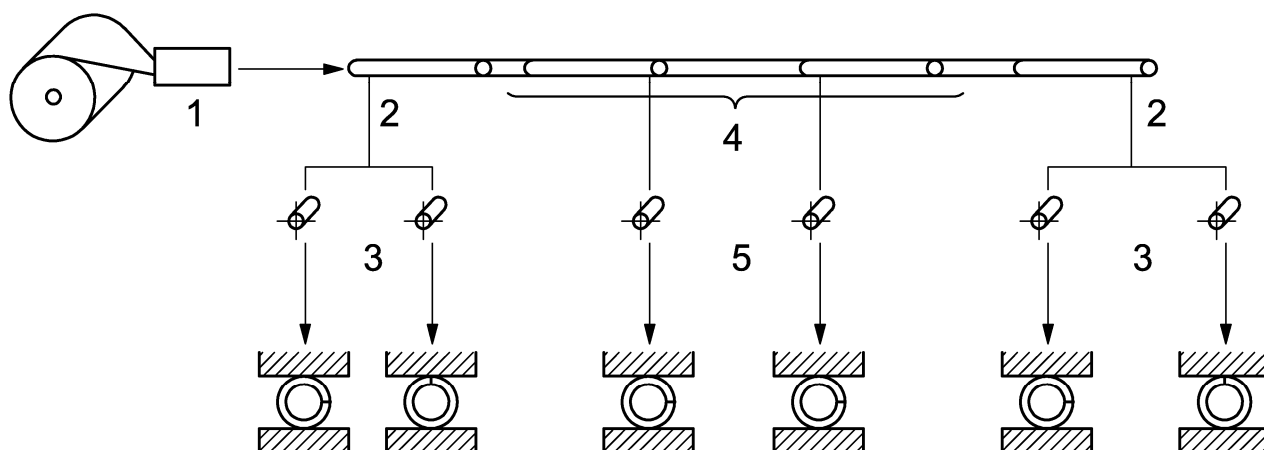**Key**

- | | |
|------------|--|
| 1 welding | 3 two test pieces from each coil end |
| 2 coil end | 4 weld stop |
| | 5 two test pieces, one from each side of the weld stop |

Figure 4 — Flattening test – sampling and testing (schematically)

(see further details in 9.4.6.1)

9.3.2.2 Tensile test pieces

Rectangular test pieces representing the full wall thickness of the pipe shall be taken in accordance with EN 10002-1 and Figure 3. Transverse test pieces shall be flattened.

Circular test pieces machined from an unflattened sample may be used by agreement.

EN 10208-2:2009 (E)

At the manufacturer's discretion, for testing the pipe body of pipes with outside diameter $D \leq 210$ mm, a full pipe test piece may be used.

Weld beads shall be ground flush, local imperfections may be removed, but mill scale should not be removed from the test pieces.

If the pipes are to be heat treated, test coupons may, by agreement, be taken and flattened before the heat treatment. The flattened test coupon shall then undergo the same heat treatment as the pipe.

9.3.2.3 Charpy V-notch impact test pieces

The test pieces shall be prepared in accordance with EN 10045-1 (see also Figure 5a) without flattening. The axis of the notch shall be perpendicular to the pipe surface. In case of test pieces taken on the weld, the axis of the notch shall be placed in the middle of the weld.

The orientation and size of the test piece shall be as follows:

- a) The greatest possible transverse width between 10 mm and 5 mm (see Figure 5b) shall be machined. The minimum outside diameter D_{\min} of the pipe necessary to obtain transverse test pieces is given by

$$D_{\min} = (T - 5) + [756,25 / (T - 5)] \quad (3)$$


where T is the specified wall thickness.

- b) If the smallest permitted transverse test piece is not obtainable, the greatest possible longitudinal width between 10 mm and 5 mm shall be used.


9.3.2.4 Test pieces for the drop weight tear (DWT) test

The test pieces shall be taken and prepared in accordance with EN 10274.

Dimensions in mm

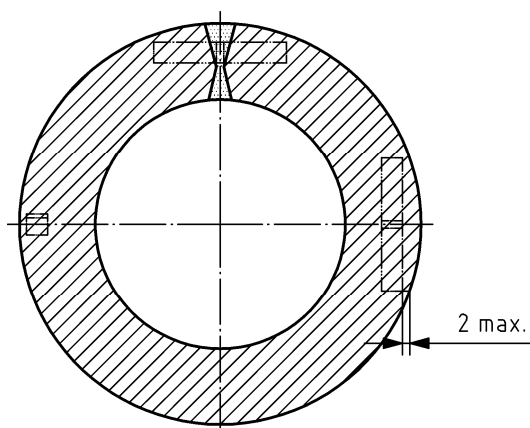

- a) Positions of test pieces (longitudinal, transverse, transverse to the weld)



- b) Width of the test piece w (including sub-size test pieces [$5 \text{ mm} \leq w < 10 \text{ mm}$] in mm)


Figure 5 — Position and width of impact test pieces

9.3.2.5 Test pieces for the bend test

The test pieces shall be taken in accordance with EN 910 and Figure 6. For pipes with a wall thickness $D > 20 \text{ mm}$ the test pieces may be machined to provide a rectangular cross section having a thickness of 19 mm. Full wall thickness D curved section test pieces are mandatory for pipe with wall thickness $\leq 20 \text{ mm}$.

The weld reinforcement shall be removed from both faces.

Dimensions in mm

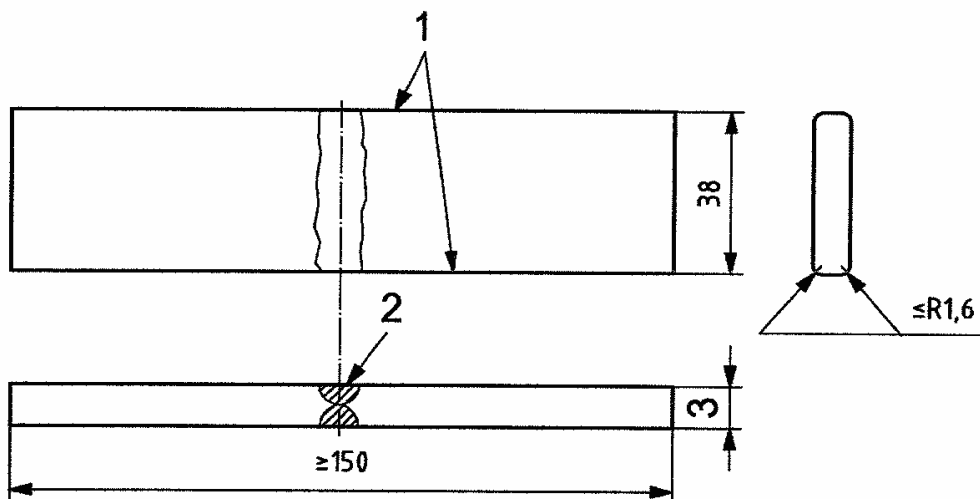

Key

- 1 long edges machined or oxygen cut, or both
- 2 weld
- 3 wall thickness

Figure 6 — Test piece for the bend test

9.3.2.6 Test pieces for the flattening test

The test pieces shall be taken in accordance with EN ISO 8492.

Minor surface imperfections may be removed by grinding.

9.3.2.7 Samples for macrographic and metallographic tests

The samples including the weld cross-section shall be taken and prepared in accordance with EN ISO 377, as far as applicable.

9.4 Test methods

9.4.1 Chemical analysis (product analysis)

The elements specified in Table 3 shall be determined.

Unless otherwise agreed at the time of enquiry and order, the choice of a suitable physical or chemical analytical method for the product analysis shall be at the discretion of the manufacturer. In cases of dispute, the analysis shall be carried out by a laboratory approved by both parties. In this case, the analysis method to be used shall be agreed taking into account the relevant existing European Standards. The list of available European Standards is given in CEN/TR 10261.

9.4.2 Tensile test

9.4.2.1 The tensile test shall be carried out in accordance with EN 10002-1.

The tensile strength R_m , the yield strength for 0,5 % total elongation $R_{t0,5}$ and the percentage elongation after fracture A shall be determined on the pipe body.

The percentage elongation after fracture shall be reported with reference to a gauge length of $5,65 \sqrt{S_0}$ where S_0 is the initial cross section of the gauge length. If other gauge lengths are used, the elongation referred to a gauge length of $5,65 \sqrt{S_0}$ shall be determined in accordance with EN ISO 2566-1.

NOTE The $R_{t0,5}$ value is considered to be approximately equivalent to the R_{eH} or $R_{p0,2}$ value within the normal scatter band of test results.

9.4.2.2 In the tensile test transverse to the weld, only the tensile strength R_m shall be determined.

9.4.3 Impact test

9.4.3.1 The impact test shall be carried out at 0 °C in accordance with EN 10045-1.

NOTE As long as existing national design codes specify testing temperatures for the impact and DWT test different from those specified in this document, the necessary deviations may be agreed. However, the requirements of this document are based on the principle that the impact and DWT tests are performed at the same temperature.

9.4.3.2 Where test pieces with a width < 10 mm are used, in accordance with 9.3.2.3, the measured impact energy KV_p and the test piece cross section S_p in mm² measured under the notch shall be reported. For comparison with the requirements in Table 6 and 7, the measured energy shall be converted to the impact energy KV in J using the formula:

$$KV = \frac{8 \times 10 \times KV_p}{S_p} \quad (4)$$

9.4.4 Drop weight tear (DWT) test

The DWT test shall be carried out in accordance with EN 10274. The test temperature shall be 0 °C. (However, see the Note to 9.4.3.1).

9.4.5 Bend test

9.4.5.1 The bend test shall be carried out in accordance with EN 910. The mandrel dimension shall be as indicated in Table 5 for the appropriate steel grade. Both test pieces shall be bent through approximately 180°, one with the root of the weld, the other with the face of the weld, directly under the mandrel.

9.4.5.2 The specimens shall not:

- a) fracture completely; nor
- b) reveal any crack or rupture in the weld metal greater than 3 mm in length regardless of depth; nor
- c) reveal any crack or rupture in the parent metal, the heat affected zone or the fusion line longer than 3 mm and deeper than 12,5 % of the specified wall thickness. Cracks that occur at the edges of the specimen and that are less than 6 mm in length shall not be cause for rejection in b) or c) regardless of depth.

If a fracture or crack in a test piece is caused by imperfections, the test piece may be discarded and a new test piece substituted.

9.4.6 Flattening test

9.4.6.1 The flattening test shall be carried out in accordance with EN ISO 8492. As indicated in Figure 4, one of the two test pieces taken from both end-of-coil locations shall be tested with the weld at the 12 o'clock position whilst the remaining two test pieces shall be tested at the 3 o'clock position.

Test pieces taken from crop ends in the case of a weld stop shall be tested at 3 o'clock position only.

9.4.6.2 The flattening test shall be carried out in three steps with following acceptance criteria:

- a) flatten to 2/3 of the original outside diameter; no weld opening shall occur;
- b) flatten to 1/3 of the original outside diameter; no crack or break shall occur other than in the weld;
- c) flatten until opposite walls of the pipe meet.

The presence of laminar imperfections or burnt metal shall not become apparent during the entire test.

9.4.7 Macrographic and metallographic examination

9.4.7.1 For SAW and COW pipes, the alignment of internal and external seams (see Figure 2c) shall be verified by macrographic examination.

Alternative methods, such as ultrasonic inspection, may be used by agreement. The ability of such equipment to detect misalignment shall be demonstrated. Where alternative methods are used, macrographic inspection shall be carried out at the beginning of the production of each pipe size (diameter and/or wall thickness).

9.4.7.2 For HFW pipe with seam heat treatment, it shall be verified by metallographic examination that the entire heat affected zone has been heat treated over the full wall thickness. In addition, a hardness test may be agreed.

9.4.8 Hydrostatic test

9.4.8.1 Except for the provisions of 9.4.8.3, the hydrostatic test pressure shall be calculated in accordance with 9.4.8.2 so that, referred to the specified minimum wall thickness of the pipe, a hoop stress of 95 % of the specified minimum yield strength for the appropriate steel grade (see Table 5) is reached. Unless otherwise agreed, the hydrostatic test pressure shall in no case be greater than:

- a) 500 bar for outside diameter $D \leq 406,4$ mm;
- b) 250 bar for outside diameter $D > 406,4$ mm.

NOTE A higher hoop stress up to 100 % of the specified minimum yield strength can be agreed. However, plastic deformations may occur in such cases.

9.4.8.2 The method of calculation for determining the hydrostatic test pressure necessary to reach a hoop stress of 95 % of the specified minimum yield strength depends on the equipment.

Consequently the manufacturer shall state which of the following methods (A or B) has been used.

Method A: In cases where the seal is made on the outside or inside diameter of the pipe the following formula shall apply:

$$p = \frac{20 \times S \times T_{\min}}{D} \quad (5)$$

where

p is the hydrostatic test pressure in bar;

D is the specified outside diameter in mm;

S is the stress in MPa, equal to 95 % of the minimum yield strength specified for the steel grade concerned (see also the note in 9.4.8.1).

T_{\min} is the specified minimum wall thickness in mm.

Method B: In the case of sealing against the end face of the pipe by means of a ram, a compressive longitudinal stress is produced. To take this into account, the following formula shall apply:

$$p_1 = \frac{10 S - \frac{p_R \times A_R}{A_p}}{\frac{D}{2T_{\min}} - \frac{A_1}{A_p}} \quad (6)$$

where

p_1 is the hydrostatic test pressure in bar;

A_1 is the internal cross-sectional area of pipe in mm²;

A_p is the cross-sectional area of pipe wall in mm²;

A_R is the cross-sectional area of ram in mm²;

D is the specified outside diameter in mm;

p_R is the internal pressure on end sealing ram in bar;

S is the stress in MPa equal to 95 % of the specified minimum yield strength for the steel grade concerned (see also the note in 9.4.8.1);

T_{\min} is the specified minimum wall thickness in mm.

9.4.8.3 The test pressure shall be held for not less than 10 seconds, and the pressure versus time shall be recorded in the case of pipes with diameters D equal to or greater than 114,3 mm. This record shall be available for examination by the inspection representative.

9.4.9 Visual examination

Each pipe shall be visually examined over the entire external surface.

The internal surface shall be visually examined:

- a) from each end for pipe outside diameters D less than 610 mm;
- b) over the entire internal surface for pipe outside diameters D equal to or greater than 610 mm.

The examination shall be carried out under sufficient lighting conditions by trained personnel with satisfactory visual acuity to verify the conformity of the pipes with the requirements of 8.5.

NOTE The light level should be of the order of 300 Lux.

The surface of cold formed welded pipe shall be examined to detect geometric deviations in the contour of the pipe. When this examination fails to disclose mechanical damage as the cause of the irregular surface, but indicates that the irregular surface may be attributed to a hard spot, the dimensions of the area and, if necessary (see 8.5.7), the hardness in this area shall be determined in accordance with EN ISO 6506-1 or EN ISO 6508-1. The choice of the test method is left to the discretion of the manufacturer. If dimensions and hardness exceed the acceptance criteria given in 8.5.7, the hard spot shall be removed.

9.4.10 Dimensional testing

9.4.10.1 The diameter of pipes shall be measured. At the discretion of the manufacturer, a circumferential tape or a caliper gauge may be used. By agreement, other approved measuring devices may be used.

9.4.10.2 The out-of-roundness O in percent shall be calculated by the formula

$$O = \frac{D_{\max} - D_{\min}}{D} 100 \quad (7)$$

where

D_{\max} is the greatest outside (or inside) diameter;

D_{\min} is the smallest outside (or inside) diameter;

D is the specified outside diameter (or inside diameter calculated from the specified outside diameter and wall thickness).

EN 10208-2:2009 (E)

To calculate the out-of-roundness of the pipe body, the greatest and smallest outside or inside diameter depending on the requirements of Table 9 shall be measured in the same cross-sectional plane. The determination of out-of-roundness of pipe ends shall be based on corresponding measurements of the inside or outside diameters depending on the manufacturing process.

9.4.10.3 The greatest deviation of flat spots or peaks from the normal contour of the pipe shall be measured:

- a) in the case of longitudinally welded pipe with a template located transverse to the pipe axis,
- b) in the case of helically welded pipe with a template parallel to the pipe axis.

The templates shall have a length of a quarter of the specified outside diameter but max. 200 mm.

9.4.10.4 For the verification of other dimensional and geometrical requirements specified in 8.6, suitable methods shall be used. The methods to be used are left to the discretion of the manufacturer, unless otherwise agreed.

9.4.11 Weighing

Each length of pipe with outside diameter D equal to or greater than 141,3 mm shall be weighed separately. Lengths of pipe with outside diameters D smaller than 141,3 mm shall be weighed either individually or in convenient lots, at the discretion of the manufacturer.

9.4.12 Non-destructive testing

For non-destructive testing, see Annex C.

9.5 Retests, sorting and reprocessing

For retests, sorting and reprocessing the requirements of EN 10021 apply.

10 Marking of the pipes**10.1 General marking**

10.1.1 Pipe marking shall include the following minimum information:

- a) the name or mark of the manufacturer of the pipe (X);
- b) the number of this part of this European Standard;
- c) the steel name;
- d) the type of pipe (S or W);
- e) the mark of the inspection representative (Y);
- f) an identification number which permits the correlation of the product or delivery unit with the related inspection document (Z).

EXAMPLE X EN 10208-2 L360MB S Y Z

10.1.2 Unless die stamping is agreed (see 10.1.3), the mandatory markings which shall be applied indelibly shall be as follows:

- a) For pipe with outside diameter $D \leq 48,3$ mm:
marked on a tag fixed to the bundle or painted on the straps or banding clips used to tie the bundle. Alternatively, at the discretion of the manufacturer, each pipe may be paint stencilled on one end.
- b) For seamless pipe in all other sizes and welded pipe with outside diameter $D < 406,4$ mm:
paint stencilled on the outside surface starting at a point between 450 mm and 750 mm from one end of the pipe.
- c) For welded pipe with outside diameter $D \geq 406,4$ mm outside diameter:
paint stencilled on the inside surface starting at a point no less than 150 mm from one end of the pipe.

10.1.3 Die stamping may be used by agreement within 150 mm of the pipe end and at least 25 mm from the weld.

Cold die stamping (at temperatures lower than 100 °C) of plate/strip or pipe not subsequently heat treated is only permitted if especially agreed and shall, in this case, be done with rounded or blunt dies.

10.1.4 If a protective coating is applied, marking shall be legible after coating.

10.2 Special marking

Any requirements for additional marking or for special locations or methods of marking are subject to agreement.

11 Coating for temporary protection

Unless otherwise ordered, the pipe shall be delivered with an external coating to protect it from rusting in transit.

If unprotected pipe or special coating and/or lining is required, this shall be agreed upon at the time of enquiry and order.

Annex A (normative)

Manufacturing procedure qualification

A.0 Introductory note

In special cases (e.g. first supply or new grades), the purchaser may, when ordering large quantities, ask for data demonstrating that the properties specified in this document can be achieved through the proposed manufacturing route. Where acceptable data from previous production is not available, e.g. in the case of new grades or new processing routes, the purchaser and manufacturer may agree qualification in accordance with A.1 and/or A.2.

A.1 Characteristics of the manufacturing procedure

Before production commences, the manufacturer shall supply the purchaser with information on the main characteristics of the manufacturing procedure. This specification shall include the following:

a) for all pipe:

- 1) steelmaker,
- 2) steel making and casting techniques,
- 3) target chemistry,
- 4) hydrostatic test procedure,
- 5) non-destructive testing procedures;

b) for welded pipe:

- 1) plate or strip manufacturing method including heat treatment method,
- 2) non-destructive testing procedures for the plate or strip,
- 3) pipe forming procedures, including preparation of edges, control of alignment and shape,
- 4) specification of the seam welding including repair welding procedure to be used together with previous qualification records for this procedure. This shall include sufficient information of the following kind:

c) for HFW pipe:

- 1) mechanical test results from seam heat treated pipes made from thermomechanically rolled strip (including hardness tests on the heat affected zone),

- 2) metallography, and
- d) for SAW and COW pipe:
 - 1) mechanical test results (including hardness test results on the heat affected zone),
 - 2) deposited weld metal analysis,
 - 3) pipe heat treatment procedure where applicable including in-line heat treatment of the weld seam;
- e) for seamless pipe:
 - 1) pipe forming process,
 - 2) pipe heat treatment procedure.

A.2 Manufacturing procedure qualification tests

For the qualification of the manufacturing procedure, the tests specified in Clause 9 shall be carried out at the beginning of the production. The frequency of testing is to be agreed. The purchaser may ask for characteristic data on other properties (e.g. weldability) of the product.

Annex B (normative)

Treatment of imperfections and defects disclosed by visual examination

B.1 Treatment of surface imperfections (see 8.5.3 a)

At the manufacturer's discretion, such imperfections not classified as defects are permitted to remain in the pipe without repair. Cosmetic grinding, however, is permitted.

B.2 Treatment of dressable surface defects (see 8.5.3 b)

All dressable surface defects shall be dressed-out by grinding. Grinding shall be carried out in such a way that the dressed area blends in smoothly with the contour of the pipe. Complete removal of defects shall be verified by local visual inspection, aided where necessary by suitable NDT methods. After grinding the remaining wall thickness in the dressed area shall be checked for compliance with 8.6.3.2.

B.3 Treatment of non-dressable surface defects (see 8.5.3 c)

Pipe containing non-dressable surface defects shall be given one of the following dispositions:

- a) weld defects in SAW and COW pipes in the non-cold expanded condition shall be repaired by welding in accordance with B.4;
- b) the section of the pipe containing the surface defect shall be cut off, within the limits of the requirement on minimum pipe length;
- c) the entire pipe length shall be rejected.

B.4 Repair of defects by welding

Repair by welding is only permitted for the weld of SAW and COW pipes. In the case of cold expanded SAW and COW pipes, repair subsequent to the cold expansion operation is not permitted. The total length of repaired zones on each pipe weld is limited to 5 % of the total weld length. Weld defects separated by less than 100 mm shall be repaired as a continuous single weld repair. Each single repair shall be carried out with a minimum of two layers/passes over a minimum length of 50 mm.

The weld repair work shall be performed using an approved and qualified procedure which, in the case of normalized or quenched and tempered steels, may be based on the recommendations given in EN 1011-1 and EN 1011-2.

After weld repair, the total area of the repair shall be ultrasonically inspected in accordance with C.5.1.1 or radiographically inspected in accordance with C.5.5.

In addition after repair, each repaired pipe length shall be hydrostatically tested in accordance with 9.4.8.

Annex C

(normative)

Non-destructive testing

C.1 Scope

This annex specifies non-destructive testing (NDT) requirements and acceptance levels. A survey on the tests is given in Table C.1.

Table C.1 — Survey of non-destructive tests

1	2	3	4	5
No.	NDT operation	Test status ^a	Types of test and requirements, acceptance level	Reference
Submerged arc welded and combination welded (SAW and COW) pipe				
1	Residual magnetism at the pipe ends	m	Hall effect gauss meter or equivalent; 30 Gauss/Oersteds max., random testing	C.2.3
2	Laminar imperfections at the pipe ends	o	Ultrasonic test EN 10246-17, acceptance limit: 6 mm max. circumferentially	C.2.4
Seamless pipe				
3	Longitudinal imperfections (including the pipe ends, where applicable, see C.2.5)	m	Ultrasonic test EN 10246-7, acceptance level U3/C or, by agreement, U2/C	C.3.1
			or (by agreement for $T < 10$ mm) Flux leakage test EN 10246-5, acceptance level F3 or, by agreement, F2	C.3.2
High frequency welded pipe				
4	Longitudinal imperfections in the weld (including the pipe ends, where applicable, see C.2.5)	m	Ultrasonic test EN 10246-7 or EN 10246-8, acceptance level U3/C or, by agreement U2/C	C.4.1.1
			or (by agreement for $T < 10$ mm) Flux leakage test EN 10246-5, acceptance level F3 or, by agreement, F2	C.4.1.2a
			(by agreement for $D < 250$ mm; $T < 6$ mm; $\frac{T}{D} < 0,18$) Eddy current test EN 10246-3, acceptance level E2	C.4.1.2b
5	Laminar imperfections in the pipe body	o	Ultrasonic test EN 10246-15, acceptance level U2 or EN 10246-14, acceptance level U2	C.4.2
6	Laminar imperfections on strip edges/area adjacent to weld seam	o	Ultrasonic test EN 10246-15 or EN 10246-16, acceptance level U2	C.4.3
Submerged arc welded / Combination welded pipe				
7	Longitudinal/transverse imperfections in the weld	m	Ultrasonic test EN 10246-9, acceptance level U2/U2H or "two lambda" calibration method (also for the strip end weld of helically welded pipe)	C.5.1
			Radiographic inspection EN 10246-10, image quality class R1, acceptance limits as per C.5.5, for T-joints of helically welded pipe	C.5.1.2
8	Laminar imperfections in the pipe body	o	Ultrasonic test EN 10246-15, acceptance level U2	C.5.2
9	Laminar imperfections on strip or plate edges/area adjacent to weld seam	o	Ultrasonic test EN 10246-15 or EN 10246-16, acceptance level U2	C.5.3
10	NDT of the weld seam at pipe ends (untested ends) / repaired areas	m	Ultrasonic test EN 10246-9 to requirements of C.5.1.1 on longitudinal imperfections, acceptance level U2/U2H	C.5.4, C.5.5
			or (unless otherwise agreed) Radiographic inspection EN 10246-10, image quality class R1 (see C.5.5) on longitudinal imperfections	
			and Ultrasonic test EN 10246-9 or radiographic test EN 10246-10 on transverse imperfections, acceptance limits as per C.5.4	
^a m mandatory, o optional test for mandatory requirement				

C.2 General NDT requirements and acceptance criteria

C.2.1 NDT personnel

For NDT personnel, see 7.8.

C.2.2 Timing of NDT operations

Unless otherwise agreed, NDT of the weld seam of HFW pipe with outside diameter $D < 200$ mm and full body NDT of seamless pipe shall be carried out, at the discretion of the manufacturer, before or after the hydrostatic test. NDT of the weld seam of SAW and COW pipe, and HFW with $D \geq 200$ mm, shall be carried out after the hydrostatic test.

The sequence of all other specified NDT operations shall be at the discretion of the manufacturer, as appropriate.

C.2.3 Residual magnetism at the pipe ends

The residual magnetism at the ends of each pipe, in the direction parallel to the pipe axis, shall not exceed 30 G (3mT), see note below. Measurements for checking compliance with this requirement, prior to pipe despatch, shall be made at random within the manufacturer's plant on the end face/bevel of the pipe using a calibrated Hall effect gauss meter or equivalent equipment.

NOTE This measurement may also be taken in Oersteds, where 30 G = 30 Oe (in air), due to equivalence between flux density and field strength in this case.

C.2.4 Laminar imperfections at the pipe ends

Laminar imperfections ≥ 6 mm in the circumferential direction are not permitted within 25 mm of each end of the pipe.

The verification of compliance with this requirement shall only be carried out by agreement. In such a case an ultrasonic test in accordance with EN 10246-17 shall be used.

C.2.5 Untested pipe ends

It is emphasized that in many of the automatic NDT operations specified in this document, there may be a short length at both pipe ends which cannot be tested. In such cases, either

- a) the untested ends shall be cropped off; or
- b) in the case of seamless or HFW pipe, the untested ends shall be subjected to a manual/semi-automatic test using the same technique, test sensitivity, test parameters, etc. as specified in the relevant clause of this document, where for manual testing, the scanning speed shall not exceed 150 mm/s; or
- c) in the case of SAW and COW pipe, the provisions of C.5.4 shall apply.

C.2.6 Suspect pipe

In all cases, pipes giving rise to indications producing a trigger/alarm condition as a result of the specified NDT operation(s) shall be deemed suspect.

EN 10208-2:2009 (E)

Suspect pipe shall be dealt with in accordance with the clause 'Acceptance' as given in the relevant European Standard for NDT of pipe, except where otherwise stated in this document. Repair by welding is only permitted on the weld of non-cold-expanded SAW and COW pipe, provided that the provisions of B.4 are fulfilled.

Where dressing is carried out, it shall be verified by any appropriate NDT method that the imperfections have been completely removed.

Any manual NDT applied to local suspect areas (dressed or not) shall use the same test sensitivity, test parameters and acceptance level (reference notch depth) as used during the test which originally deemed the pipe suspect. For manual ultrasonic testing, the scanning speed shall not exceed 150 mm/s.

C.3 NDT of seamless pipe

C.3.1 Seamless pipe shall be ultrasonically inspected for the detection of longitudinal imperfections in accordance with EN 10246-7 to acceptance level U3/C or, by agreement, U2/C.

C.3.2 Alternatively, by agreement, seamless pipe, with a specified wall thickness less than 10 mm, shall be inspected using the flux leakage method in accordance with EN 10246-5 to acceptance level F3 or, by agreement, F2.

C.4 NDT of HFW pipe**C.4.1 Non-destructive testing of the weld seam**

C.4.1.1 The full length of the weld seam of high frequency welded pipes shall be ultrasonically inspected for the detection of longitudinal imperfections, at the discretion of the manufacturer, in accordance with EN 10246-7 or EN 10246-8 to acceptance level U3/C or U3 respectively. By agreement, acceptance level U2/C or U2 respectively may be used.

C.4.1.2 Alternatively, by agreement, the full length of the weld seam shall be inspected using one of the following methods.

a) For pipes with a specified wall thickness $T < 10$ mm:

the flux leakage method in accordance with EN 10246-5 to acceptance level F3 or, by agreement, F2.

b) For pipes with an outside diameter $D < 250$ mm, and a wall thickness $T < 6$ mm and a ratio $T/D < 0,18$:

the eddy current method (concentric or segment coil technique) in accordance with EN 10246-3 to acceptance level E2H.

C.4.2 Laminar imperfections in the pipe body

Individual laminations or a lamination population density exceeding the acceptance limit U2 in EN 10246-15 or U2 in EN 10246-14 respectively, are not permitted within the pipe body.

The verification of compliance with this requirement shall only be carried out by agreement. In such a case, an ultrasonic test conducted in the pipe mill, at the discretion of the manufacturer either in the flat form prior to welding in accordance with EN 10246-15 to acceptance limit U2 or in the as-welded pipe form in accordance with EN 10246-14 to acceptance level U2, shall be used.

C.4.3 Laminar imperfections on the strip edges/areas adjacent to the weld seam

Individual laminations or a lamination population density exceeding the U2 acceptance limits in EN 10246-15 and EN 10246-16 respectively, are not permitted within a 15 mm wide zone along both longitudinal strip edges/areas adjacent to the weld seam.

The verification of compliance with this requirement by means of an ultrasonic test conducted in the pipe mill, at the discretion of the manufacturer either prior to welding of the strip edges in accordance with EN 10246-15 to acceptance limit U2 or after welding on the area adjacent to the weld seam in accordance with EN 10246-16 to acceptance limit U2 shall only be carried out by agreement.

C.5 NDT of SAW and COW pipe

C.5.1 Ultrasonic testing for longitudinal and transverse imperfections in the weld seam

C.5.1.1 The full length of the weld seam of SAW and COW pipe shall be ultrasonically inspected for the detection of longitudinal and transverse imperfections in accordance with EN 10246-9 to acceptance level U2/U2H, with the modifications given in a) to e) below.

- a) The maximum notch depth shall be 2,0 mm.
- b) The use of internal and external longitudinal notches located on the centre of the weld seam for equipment calibration purposes is not permitted.
- c) As an alternative to the use of the reference hole for equipment calibration for the detection of transverse imperfections, it is permitted to use acceptance level U2 internal and external notches, lying at right-angles to and centred over the weld seam. In this case, both internal and external weld reinforcements shall be ground flush to match the parent pipe contour in the immediate area and on both sides of the reference notches. The notches shall be sufficiently separated from each other in the longitudinal direction and from any remaining reinforcement, to give clearly identifiable separate ultrasonic signal responses. The full signal amplitude from each of these notches shall be used to set the trigger/alarm level of the equipment.
- d) As an alternative to the use of acceptance level U2 notches for equipment calibration, it is permitted, by agreement, to use a fixed depth internal and external notch and increase the test sensitivity by electronic means (i.e. increase in dB). In this case (known as the "two lambda" method), the depth of the notches shall be twice the wavelength at the ultrasonic frequency in use, given by:

$$\text{Wavelength} = \frac{\text{Ultrasonic velocity}(tr)}{\text{Ultrasonic frequency}}$$

(for example: at 4 MHz test frequency, wavelength = 0,8 mm, i.e. notch depth = 1,6 mm)

The required increase in test sensitivity shall be based on pipe thickness and the manufacturer shall demonstrate to the satisfaction of the purchaser that the test sensitivity achieved is essentially equivalent to that when using acceptance level U2 notches.

- e) The manufacturer may use one of the methods described in C.5.4 to re-test suspect areas.

C.5.1.2 For helically welded pipe, the full length of the strip end weld shall be subjected to an ultrasonic test using the same ultrasonic test sensitivity and the same ultrasonic parameters as used on the primary helical weld seam in accordance with C.5.1.1.

EN 10208-2:2009 (E)

In addition, the T-joints where the extremities of the strip end weld meet the primary weld seam, shall be subjected to radiographic inspection in accordance with C.5.5 and the acceptance limits given there.

C.5.2 Laminar imperfections in the pipe body

Individual laminations or a lamination population density exceeding the U2 acceptance limits given in EN 10246-15 are not permitted within the pipe body.

The verification of compliance with this requirement shall only be carried out by agreement. In such a case, an ultrasonic test conducted in either the plate mill or the pipe mill and in the latter case, at the discretion of the manufacturer, in either the flat form or the pipe form, in accordance with EN 10246-15 to acceptance level U2 shall be used.

C.5.3 Laminar imperfections on the strip or plate edges/area adjacent to the weld seam

Individual lamination or a lamination population density exceeding the U2 acceptance limits given in EN 10246-15 and EN 10246-16 are not permitted within a 15 mm wide zone along both longitudinal strip or plate edges/areas adjacent to the weld seam, and, in the case of helically welded pipe, the transverse strip edges/areas adjacent to the butt weld.

The verification of compliance with this requirement shall only be carried out by agreement. In such a case, an ultrasonic test conducted, at the discretion of the manufacturer, either in the plate mill or the pipe mill prior to welding of the strip/plate edges in accordance with EN 10246-15 to acceptance limit U2 or in the pipe mill after welding on the areas adjacent to the weld seam in accordance with EN 10246-16 to acceptance limit U2, shall be used.

C.5.4 NDT of the weld seam at the pipe ends/repaired areas

The length of the weld seam at the pipe ends which cannot be inspected by the automatic ultrasonic equipment and repaired areas of the weld seam (see B.4), shall be subjected to the following:

- a) for the detection of longitudinal imperfections, a manual or semi-automatic ultrasonic test using the same test parameters and test sensitivity as specified in C.5.1.1 or, unless otherwise agreed, radiographic inspection in accordance with C.5.5;
- b) for the detection of transverse imperfections, at the discretion of the manufacturer, a manual or semi-automatic ultrasonic test using the same test parameters and test sensitivity as specified in C.5.1.1 or radiographic inspection in accordance with C.5.5.

When manual ultrasonic testing is carried out, the scanning speed shall not exceed 150 mm/s.

C.5.5 Radiographic inspection of the weld seam

C.5.5.1 Where applicable, radiographic inspection of the weld seam shall be conducted in accordance with EN 10246-10 to image quality class R1, with the conditions given in a) to c) below.

- a) The sensitivity requirements, given in Table C.2 established on the base material shall be verified by use of the ISO Wire Penetrameter according to ISO 19232-1 or, if so agreed, by use of an equivalent hole penetrameter.
- b) Only X-ray radiation, using fine-grain, high-contrast direct film with lead screen, shall be used. By agreement, fluoroscopic methods are permitted, but only when the manufacturer can demonstrate equivalence to the X-ray film technique.

- c) The density of the radiograph shall not be less than 2,0 and shall be chosen so that the density through the thickest portion of the weld seam is not less than 1,5 and that maximum contrast for the type of film used is achieved.

Table C.2 — Sensitivity requirements for the radiographic inspection, image quality class R1, in accordance with EN 10246-10

Dimensions in mm

Wall thickness		Visibility required	
above	up to	of the hole with a diameter	of the wire with a diameter
4,5	10	0,40	0,16
10	16	0,50	0,20
16	25	0,63	0,25
25	32	0,80	0,32
32	40	1,00	0,40

C.5.5.2 The acceptance limits for radiographic inspection of the weld seam shall be as given in a) to f) below.

- a) Cracks, incomplete penetration and lack of fusion are not acceptable.
- b) Individual circular slag inclusions and gas pockets up to 3,0 mm or $T/3$ in diameter (T = specified wall thickness), whichever is the smaller, are acceptable.

The sum of the diameters of all such permitted individual imperfections in any 150 mm or $12 T$ of weld length, whichever is the smaller, shall not exceed 6,0 mm or $0,5 T$ whichever is the smaller, where the separation between individual inclusions is less than $4 T$.

- c) Individual elongated slag inclusions up to 12,0 mm or $1 T$ in length, whichever is the smaller, or up to 1,6 mm in width are acceptable. The maximum accumulated length of such permitted individual imperfections in any 150 mm or $12 T$ of weld length, whichever is the smaller, shall not exceed 12,0 mm, where the separation between individual inclusions is less than $4 T$.
- d) Individual undercuts of any length having a maximum depth of 0,4 mm are acceptable.

Individual undercuts of a maximum length of $T/2$ having a maximum depth of 0,8 mm and not exceeding 10 % of the specified wall thickness are acceptable provided that there are not more than two such undercuts in any 300 mm of the weld length, and all such undercuts are dressed out.

- e) Any undercuts exceeding the above limits shall be repaired (see B.4) or the suspect area shall be cropped off or the pipe shall be rejected.
- f) Any undercuts on the inside and outside weld of any length and depth which are coincident in the longitudinal direction on the same side of the weld are not acceptable.

Bibliography

- [1] ISO 3183, *Petroleum and natural gas industries — Steel pipe for pipeline transportation systems*
- [2] Demofonti, G.; Jones, D. G.; Pistone, G.; Re, G.; Vogt, G.: *EPRG recommendation for crack arrest toughness for high strength line pipe steels*. Presentation of the European Pipeline Research Group to the 8th Symposium on Line Pipe Research; Houston, Texas (1993-09-26/29); 13 pages, 7 figures, 3 tables
[To be ordered from: American Gas Association, Order and Billing Department, 1515 Wilson Boulevard, Arlington, Virginia, 22209 USA]
- [3] EN 1594, *Gas supply systems — Pipelines for maximum operating pressure over 16 bar — Functional requirements*
- [4] API Spec 5L, *Specification for line pipe*, 44th edition, October 1, 2007

BSI - British Standards Institution

BSI is the independent national body responsible for preparing British Standards. It presents the UK view on standards in Europe and at the international level. It is incorporated by Royal Charter.

Revisions

British Standards are updated by amendment or revision. Users of British Standards should make sure that they possess the latest amendments or editions.

It is the constant aim of BSI to improve the quality of our products and services. We would be grateful if anyone finding an inaccuracy or ambiguity while using this British Standard would inform the Secretary of the technical committee responsible, the identity of which can be found on the inside front cover. Tel: +44 (0)20 8996 9000. Fax: +44 (0)20 8996 7400.

BSI offers members an individual updating service called PLUS which ensures that subscribers automatically receive the latest editions of standards.

Buying standards

Orders for all BSI, international and foreign standards publications should be addressed to Customer Services. Tel: +44 (0)20 8996 9001. Fax: +44 (0)20 8996 7001 Email: orders@bsigroup.com You may also buy directly using a debit/credit card from the BSI Shop on the Website <http://www.bsigroup.com/shop>

In response to orders for international standards, it is BSI policy to supply the BSI implementation of those that have been published as British Standards, unless otherwise requested.

Information on standards

BSI provides a wide range of information on national, European and international standards through its Library and its Technical Help to Exporters Service. Various BSI electronic information services are also available which give details on all its products and services. Contact Information Centre. Tel: +44 (0)20 8996 7111 Fax: +44 (0)20 8996 7048 Email: info@bsigroup.com

Subscribing members of BSI are kept up to date with standards developments and receive substantial discounts on the purchase price of standards. For details of these and other benefits contact Membership Administration. Tel: +44 (0)20 8996 7002 Fax: +44 (0)20 8996 7001 Email: membership@bsigroup.com

Information regarding online access to British Standards via British Standards Online can be found at <http://www.bsigroup.com/BSOL>

Further information about BSI is available on the BSI website at <http://www.bsigroup.com>.

Copyright

Copyright subsists in all BSI publications. BSI also holds the copyright, in the UK, of the publications of the international standardization bodies. Except as permitted under the Copyright, Designs and Patents Act 1988 no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means – electronic, photocopying, recording or otherwise – without prior written permission from BSI.

This does not preclude the free use, in the course of implementing the standard, of necessary details such as symbols, and size, type or grade designations. If these details are to be used for any other purpose than implementation then the prior written permission of BSI must be obtained.

Details and advice can be obtained from the Copyright and Licensing Manager. Tel: +44 (0)20 8996 7070 Email: copyright@bsigroup.com