

BS EN 12201-4:2012



BSI Standards Publication

# Plastics piping systems for water supply, and for drainage and sewerage under pressure — Polyethylene (PE)

Part 4: Valves

**bsi.**

...making excellence a habit.™

**National foreword**

This British Standard is the UK implementation of EN 12201-4:2012. It supersedes BS EN 12201-4:2001 and BS EN 13244-4:2002 which are withdrawn.

The UK participation in its preparation was entrusted to Technical Committee PRI/88/2, Plastics piping for pressure applications.

A list of organizations represented on this committee can be obtained on request to its secretary.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

© The British Standards Institution 2012. Published by BSI Standards Limited 2012

ISBN 978 0 580 70905 0

ICS 23.060.01; 91.140.60

**Compliance with a British Standard cannot confer immunity from legal obligations.**

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 30 June 2012.

**Amendments issued since publication**

Date	Text affected
------	---------------

---

English Version

## Plastics piping systems for water supply, and for drainage and sewerage under pressure - Polyethylene (PE) - Part 4: Valves

Systèmes de canalisations en plastique pour l'alimentation en eau et pour les branchements et les collecteurs d'assainissement avec pression - Polyéthylène (PE) - Partie 4: Robinets

Kunststoff-Rohrleitungssysteme für die Wasserversorgung und für Entwässerungs- und Abwasserdruckleitungen - Polyethylen (PE) - Teil 4: Armaturen

This European Standard was approved by CEN on 16 December 2011.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION  
COMITÉ EUROPÉEN DE NORMALISATION  
EUROPÄISCHES KOMITEE FÜR NORMUNG

Management Centre: Avenue Marnix 17, B-1000 Brussels

<b>Contents</b>	<b>Page</b>
Foreword.....	3
Introduction .....	4
1 Scope.....	5
2 Normative references .....	6
3 Terms and definitions, symbols and abbreviations .....	6
4 Material.....	8
4.1 Compound .....	8
4.2 Material for non-polyethylene parts .....	8
5 General characteristics .....	9
5.1 Appearance of the valve.....	9
5.2 Colour.....	9
5.3 Design .....	9
5.4 Effect on water quality.....	10
6 Geometric characteristics .....	10
6.1 General.....	10
6.2 Measurement of dimensions .....	10
6.3 Dimensions of spigot ends for valves .....	10
6.4 Dimensions of valves with electrofusion sockets.....	10
6.5 Dimensions of the operating device .....	10
7 Mechanical characteristics for assembled valves.....	11
7.1 General.....	11
7.2 Requirements .....	11
8 Physical characteristics .....	15
8.1 Conditioning.....	15
8.2 Requirements .....	15
9 Performance requirements .....	16
10 Marking.....	16
10.1 General.....	16
10.2 Minimum required marking of valves .....	17
10.3 Additional Marking.....	17
11 Delivery Conditions .....	17
Annex A (normative) Determination of the leaktightness of seat and packing .....	18
A.1 General.....	18
A.2 Test method.....	18
Bibliography .....	19

## Foreword

This document (EN 12201-4:2012) has been prepared by Technical Committee CEN/TC 155 "Plastics piping systems and ducting systems", the secretariat of which is held by NEN.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by August 2012, and conflicting national standards shall be withdrawn at the latest by August 2012.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN [and/or CENELEC] shall not be held responsible for identifying any or all such patent rights.

This document supersedes EN 12201-4:2001, EN 13244-4:2002.

System Standards are based on the results of the work being undertaken in ISO/TC 138 "Plastics pipes, fittings and valves for the transport of fluids", which is a Technical Committee of the International Organization for Standardization (ISO).

EN 12201 consists of the following Parts, under the general title *Plastics piping systems for water supply and for drainage and sewerage under pressure — Polyethylene (PE)*:

- *Part 1: General*
- *Part 2: Pipes*
- *Part 3: Fittings*
- *Part 4: Valves for water supply systems (this standard)*
- *Part 5: Fitness for purpose of the system*
- *Part 7: Guidance for the assessment of conformity (CEN/TS).*

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.

## Introduction

This European Standard, known as the System Standard, specifies the requirements for a piping system and its components when made from polyethylene (PE). The piping system is intended to be used for water supply intended for human consumption, including the conveyance of raw water prior to treatment, drainage and sewerage under pressure, vacuum sewer systems, and water for other purposes.

In respect of potential adverse effects on the quality of water intended for human consumption, caused by the product covered by EN 12201:

- a) this European Standard provides no information as to whether the products may be used without restriction in any of the Member States of the EU or EFTA;
- b) products intended for use in water supply systems must comply, when existing, with national regulations and testing arrangements that ensure fitness for contact with drinking water.

NOTE On April 2006, EC Commission set up a revised mandate (M/136) asking CEN to propose harmonised product standards and support standards for test methods which could be used for assessing the fitness for contact with drinking water. In parallel, EC Commission has launched processes for a regulation of construction products (CPR) to be substituted to CP directive (89/106/EC) and for the revision of drinking water directive (98/83/EC). If relevant, when the outputs of these processes will be known, European Product Standards will be amended by the addition of an Annex Z under Mandate M/136 which will contain formal references to the applicable requirements. Until such amendments, the current national regulations remain applicable.

Requirements and test methods for material and components, other than valves, are specified in EN 12201-1:2011, EN 12201-2 and EN 12201-3:2011.

Characteristics for fitness of purpose are covered in EN 12201-5. CEN/TS 12201-7 [1] gives guidance for the assessment of conformity.

This Part of EN 12201 covers the characteristics of valves.

## 1 Scope

This Part of EN 12201 specifies the characteristics of valves or valve bodies made from polyethylene (PE 100 and PE 80) for buried and above ground applications, intended for the conveyance of water for human consumption, raw water prior to treatment, drainage and sewerage under pressure, vacuum sewer systems, and water for other purposes.

NOTE 1 For valves or valve bodies intended for drainage and sewerage under pressure, additional specifications/tests may be necessary according to the requirements of the purchaser, especially for the chemical resistance of the components in contact with the fluids and functioning characteristics.

NOTE 2 For PE components intended for the conveyance of water for human consumption and raw water prior to treatment attention is drawn to 5.4. Components manufactured for water for other purposes may not be suitable for water supply for human consumption.

It also specifies the test parameters for the test methods referred to in this European Standard.

NOTE 3 Valves made from material other than polyethylene (PE) designed for the supply of water intended for human consumption to a relevant standard(s) can be used in PE piping systems conforming to EN 12201 when they have relevant PE connection for butt fusion or electrofusion ends (see EN 12201-3:2011).

In conjunction with Parts 1, 2, 3 and 5 of EN 12201 it is applicable to PE valves, their joints and to joints with components of PE and other materials intended to be used under the following conditions:

- a) allowable operating pressure, PFA, up to 25 bar <sup>1)</sup>
- b) an operating temperature of 20 °C as a reference temperature;
- c) buried in the ground;
- d) sea outfalls;
- e) laid in water;
- f) above ground, including pipes suspended below bridges.

NOTE 4 For applications operating at constant temperature greater than 20 °C and up to 40 °C, see EN 12201-1:2011, Annex A.

EN 12201 covers a range of allowable operating pressures and gives requirements concerning colours and additives.

NOTE 5 It is the responsibility of the purchaser or specifier to make the appropriate selections from these aspects, taking into account their particular requirements and any relevant national guidance or regulations and installation practices or codes.

This Part of EN 12201 covers valves for pipes with a nominal outside diameter  $d_n \leq 315$  mm.

---

1) 1 bar = 0,1 MPa =  $10^5$  Pa; 1 MPa = 1 N/mm<sup>2</sup>.

## 2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 681-1, *Elastomeric seals — Materials requirements for pipe joint seals used in water and drainage applications — Part 1: Vulcanized rubber*

EN 736-1:1995, *Valves — Terminology — Part 1: Definition of types of valves*

EN 736-2:1997, *Valves — Terminology — Part 2: Definition of components of valves*

EN 1680, *Plastics piping systems — Valves for polyethylene (PE) piping systems — Test method for leaktightness under and after bending applied to the operating mechanisms*

EN 1705, *Plastics piping systems — Thermoplastics valves — Test method for the integrity of a valve after an external blow*

EN 12100, *Plastic piping systems — Polyethylene (PE) valves — Test method for resistance to bending between supports*

EN 12201-1:2011, *Plastics piping systems for water supply, and for drainage and sewerage under pressure — Polyethylene (PE) — Part 1: General*

EN 12201-2, *Plastics piping systems for water supply, and for drainage and sewerage under pressure — Polyethylene (PE) — Part 2: Pipes*

EN 12201-3:2011, *Plastics piping systems for water supply, and for drainage and sewerage under pressure — Polyethylene (PE) — Part 3: Fittings*

EN 12201-5, *Plastics piping systems for water supply, and for drainage and sewerage under pressure — Polyethylene (PE) — Part 5: Fitness for purpose of the system*

EN 28233, *Thermoplastic valves — Torque — Test method (ISO 8233)*

EN ISO 1133, *Plastics — Determination of the melt mass-flow rate (MFR) and the melt volume-flow rate (MVR) of thermoplastics (ISO 1133)*

EN ISO 1167-1, *Thermoplastics pipes, fittings and assemblies for the conveyance of fluids — Determination of the resistance to internal pressure — Part 1: General method (ISO 1167-1)*

EN ISO 1167-4, *Thermoplastics pipes, fittings and assemblies for the conveyance of fluids — Determination of the resistance to internal pressure — Part 4: Preparation of assemblies (ISO 1167-4)*

EN ISO 3126, *Plastics piping systems — Plastics components — Determination of dimensions (ISO 3126)*

ISO 10933, *Polyethylene (PE) valves for gas distribution systems*

ISO 11357-6, *Plastics — Differential scanning calorimetry (DSC) — Part 6: Determination of oxidation induction time (isothermal OIT) and oxidation induction temperature (dynamic OIT)*

## 3 Terms and definitions, symbols and abbreviations

For the purposes of this document, the terms and definitions, symbols and abbreviations given in EN 12201-1:2011, EN 736-1:1995, EN 736-2:1997 and the following apply.



### 3.1

#### **external leaktightness**

leaktightness of the body enveloping the space containing the water, with respect to the atmosphere

### 3.2

#### **internal leaktightness**

leaktightness between the inlet and the outlet of the valve, with the valve in the closed position

### 3.3

#### **leaktightness test**

test for both of the following characteristics:

- a) the internal leaktightness of the valve's closing seat when closed and pressurised from either side;
- b) the external leaktightness of the valve when half open

### 3.4

#### **initiating torque**

torque required to initiate movement of the obturator

### 3.5

#### **running torque**

torque required to achieve full opening or closing of the valve at maximum allowable operating pressure

### 3.6

#### **leakage**

seepage of water from the valve body, or any component of the valve

### 3.7

#### **valve body**

main part of a valve which contains the obturating device (closing element, the seat, the packing seals and the operating stop), as applicable and provides the terminal ends for connection to the PE pipe/fittings

### 3.8

#### **operating device**

part of a valve for connection with the operating key which allows the opening and closing of the valve

### 3.9 Terms relating to design

#### 3.9.1

##### **full bore valve**

valve with a flow section equal to or greater than 80 % of the section corresponding to the nominal inside diameter of the body end port

[EN 736-3:2008[6]]

#### 3.9.2

##### **clearway valve**

valve designed to have an unobstructed flow way, which allows for the passage of a theoretical sphere with a diameter that is not less than the nominal inside diameter of the body end port

[EN 736-3:2008[6]]

#### 3.9.3

##### **reduced bore valve**

valve with a flow section equal to or greater than 36 % of the section corresponding to the nominal inside diameter of the body end port and which does not correspond to the full bore valve

[EN 736-3:2008[6]]

## 4 Material

### 4.1 Compound

The compound from which the body of the valve, with spigot end or electrofusion socket is made, shall be PE 80 and PE 100 only, and shall conform to EN 12201-1:2011. The PE components of the valve shall only be made from virgin material conforming to EN 12201-1:2011.

### 4.2 Material for non-polyethylene parts

#### 4.2.1 General

All components shall conform to the relevant European Standard(s). Alternative standards may be utilised in cases where suitable European Standard(s) do not exist provided a fitness for purpose of the components can be demonstrated.

The materials and the constituent elements used in making the valves (including elastomers, greases and any metal parts as may be used) shall be as resistant to the external and internal environment as the other elements of the piping system. They also shall have a life expectancy under the following conditions at least equal to that of the PE pipes conforming to EN 12201 2:2011 with which they are intended to be used:

- a) during storage;
- b) under the effect of the water conveyed therein;
- c) with respect to the service environment and operating conditions.

The requirements for the level of material performance for non-polyethylene parts shall be at least as stringent as that of the PE compound for the piping system.

Other materials used in valves in contact with the PE pipe shall not adversely affect the pipe performance or initiate stress cracking.

NOTE Metal valve bodies for PE piping systems up to 25 bars should conform to the relevant standard of CEN/TC 69 "Industrial valves".

#### 4.2.2 Metal parts

All metal parts susceptible to corrosion shall be adequately protected, providing this is necessary for the durability and function of the system.

When dissimilar metallic materials are used which may be in contact with moisture, steps shall be taken to avoid the possibility of galvanic corrosion.

#### 4.2.3 Elastomers

Elastomeric seals shall conform to EN 681-1.

#### 4.2.4 Other materials

Greases or lubricants shall not exude on to fusion areas and shall not affect the long-term performance of the PE valve or valve body nor have any adverse effect on the quality of the water.

Other materials conforming to 4.2.1 may be used provided that it is proven that the valves conform to this European Standard.

#### **4.2.5 Assembly**

Valves shall be assembled according to manufacturer's procedures and any component used in the assembly shall not prevent conformity of the valve to this European Standard.

### **5 General characteristics**

#### **5.1 Appearance of the valve**

When viewed without magnification, the internal and external surfaces of valves shall be smooth, clean and free from scoring, cavities and other surface defects to an extent that would prevent conformity to this European Standard.

No component of the valve shall show any signs of damage, scratches, pitting, bubbles, blisters, inclusions or cracks to an extent that would prevent conformity of the valve to this European Standard.

#### **5.2 Colour**

The PE body shall be black or blue.

Blue valve bodies are not permitted for applications other than the conveyance of water for human consumption.

NOTE For above ground installations, all blue components should be protected from direct UV light.

#### **5.3 Design**

##### **5.3.1 General**

The design of the valve shall be such that, when assembling the valve onto the pipe or other components, the electrical coils and/or seals or any ancillary parts are not displaced.

PE valves bodies and their PE spigot end or electrofusion socket shall have a pressure rating of at least that of the pipe to which they are assembled. PE spigot ends or electrofusion sockets shall have sufficient fusion compatibility (see EN 12201-5) to the pipe to which it is fused to meet the requirements of this European Standard.

##### **5.3.2 Valve body**

The valve body of the valve shall be such that it cannot be dismantled.

##### **5.3.3 Operating device**

The operating device shall be integral with or connected to the stem in such a way that disconnection is impossible without special equipment.

The valve shall close by turning the operating device clockwise. For a quarter-turn valve, the position of the obturator shall be clearly indicated on the top side of the operating device.

Stops shall be provided at the fully open and closed positions.

### 5.3.4 Seals

The seals shall be so mounted as to be resistant to normally occurring mechanical loads. Creep and cold flow effects shall be taken into account. Any mechanism that puts a loading on the seals shall be permanently locked. The pressure in the pipeline shall not be used as the sole means of seal activation.

### 5.4 Effect on water quality

For valves intended for the conveyance of water for human consumption, attention is drawn to the requirements of national regulations (see introduction).

## 6 Geometric characteristics

### 6.1 General

Each valve shall be characterised by its dimensions and associated end connections.

Technical data given by the manufacturer shall include the following information:

- a) dimensional characteristics, by working drawings;
- b) instructions for assembly.

NOTE In order to prevent stress concentrations, any changes in the wall thickness of the valve body should be gradual.

### 6.2 Measurement of dimensions

Dimensions shall be measured in accordance with EN ISO 3126 at  $(23 \pm 2)$  °C, after being conditioned for at least 4 h. The measurement shall not be made less than 24 h after manufacture.

NOTE Indirect measurement at the stage of production is allowed at shorter time periods providing evidence is shown of correlation.

### 6.3 Dimensions of spigot ends for valves

The dimensions of spigots shall conform to EN 12201-3:2011, Table 3, up to and including  $d_n$  315 mm.

### 6.4 Dimensions of valves with electrofusion sockets

The dimensions of electrofusion sockets shall conform to EN 12201-3:2011, Table 1, up to and including  $d_n$  315 mm.

### 6.5 Dimensions of the operating device

For a quarter-turn valve, the dimension of the operating device shall be designed so it can be operated with a  $(50^{+0,5}_0)$  mm square socket,  $(40 \pm 2)$  mm depth.

NOTE For a non-quarter-turn operated valve, the attention is drawn on the requirements specified in EN ISO 5210 [2].

## 7 Mechanical characteristics for assembled valves

### 7.1 General

All tests shall be carried out on valves assembled with pipe(s) conforming to EN 12201-2:2011, where the pipe shall be of the same pressure rating as the valve. Assembly of the valve and pipe(s) shall be in accordance with the technical instructions and the extreme installation conditions of utilisation described in EN 12201-5.

NOTE The properties of an assembled valve depend on the properties of the pipes and the valve and on the conditions of their installation (e.g. geometry, temperature, type and method of conditioning, assembling and fusion procedures).

The technical description by the manufacturer shall include at least the following information:

- a) service conditions (e.g. valve temperature limits);
- b) assembly instructions;
- c) for valves with electrofusion sockets, the fusion instructions (power requirements or fusion parameters with limits).

### 7.2 Requirements

Unless otherwise specified by the applicable test method, test pieces shall be conditioned at  $(23 \pm 2) ^\circ\text{C}$  before testing in accordance with Table 1.

When tested in accordance with the test methods specified and using the test parameters given in Table 1, the valves shall conform to the requirements given in Table 1.

NOTE Attention is drawn to the requirements specified in EN 1074-1[3] and EN 1074-2[4].

Table 1 — Mechanical characteristics

Characteristic	Requirements	Test parameters		Test method
		Parameters	Value	
Hydrostatic strength (20 °C, 100 h)	No failure during the test period of any test piece	Conditioning time <sup>a</sup> Number of test pieces <sup>b</sup> Type of test Circumferential (hoop) stress: PE 80 PE 100 Test period Test temperature	Shall conform to EN ISO 1167-1 3 Water-in-water 10,0 MPa 12,0 MPa 100 h 20 °C	EN ISO 1167-1 and EN ISO 1167-4
Hydrostatic strength (80 °C, 165 h)	No failure during the test period of any test piece <sup>c</sup>	Conditioning time <sup>a</sup> Number of test pieces <sup>b</sup> Type of test Circumferential (hoop) stress: PE 80 PE 100 Test period Test temperature	Shall conform to EN ISO 1167-1 3 Water-in-water 4,5 MPa 5,4 MPa 165 h 80 °C	EN ISO 1167-1 and EN ISO 1167-4
Hydrostatic strength (80 °C, 1000 h)	No failure during the test period of any test piece	Conditioning time <sup>a</sup> Number of test pieces <sup>b</sup> Type of test Circumferential (hoop) stress: PE 80 PE 100 Test period Test temperature	Shall conform to EN ISO 1167-1 3 Water-in-water 4,0 MPa 5,0 MPa 1 000 h 80 °C	EN ISO 1167-1 and EN ISO 1167-4
Leaktightness of seat and packing	No leakage during the test period	Test temperature Test fluid Number of test pieces <sup>b</sup> Test pressure Duration of the test	23 °C Air or nitrogen 1 25 mbar 1 h	Annex A
Leaktightness of seat and packing	No leakage during the test period	Test temperature Test fluid Number of test pieces <sup>b</sup> Test pressure Duration of the test	23 °C Water, air or nitrogen 1 Water: 1,5 PN Air or nitrogen: 1,1 PN 30 s	Annex A
<b>SAFETY PRECAUTIONS — Safety precautions need to be taken when testing with air or nitrogen up to 1,5 PN. For testing with air or nitrogen a pressure of a maximum of 6 bar should be used. For higher pressures, testing with water should be considered, and the test conditions shall be agreed between the manufacturer and end user.</b>				
Operating torque <sup>d</sup>	Torque range: - For $d_n \leq 63$ mm 5 Nm < M ≤ 35 Nm - For 63 mm < $d_n \leq 125$ mm 10 Nm < M ≤ 70 Nm - For 125 mm < $d_n \leq 315$ mm 10 Nm < M ≤ 150 Nm	Test temperature Number of test pieces <sup>b</sup>	0 °C and 40 °C 1	EN 28233
				(continued)

**Table 1— Mechanical characteristics (continued)**

Characteristic	Requirements	Test parameters		Test method
		Parameters	Value	
Stop resistance	No failure at stops	Test temperature Number of test pieces <sup>b</sup> Torque	0 °C and 40 °C 1 2 times the value of the maximum measured operating torque measured with minimum 150 N.m during 15 s	EN 28233
Actuation mechanism resistance	Maximum value: 1,5 times the value of the maximum measured operating torque (see this table)	Test pressure Test temperature Number of test pieces <sup>b</sup>	6 bar 23 °C 1	EN 28233
Resistance to bending between supports	No leakage and maximum value for operating torque (see examination of operating torque)	Load applied for: 63 mm < $d_n$ ≤ 125 mm 125 mm < $d_n$ ≤ 315 mm Number of test pieces <sup>b</sup>	3,0 kN 6,0 kN 1	EN 12100
Leaktightness under tensile load	No leakage and maximum value for operating torque (see examination of operating torque)	Test pressure Test temperature Number of test pieces <sup>b</sup>	25 mbar 23 °C Shall conform to ISO 10933	ISO 10933
Leaktightness under and after bending applied to the operating mechanism	No leakage	Number of test pieces <sup>b</sup>	1	EN 1680
Impact loading resistance	No leakage and maximum value for operating torque (see examination of operating torque)	Position of test piece Drop height Mass of the striker Type of the striker  Test temperature Number of test pieces <sup>b</sup>	Vertical, see Figure 1 2 m 2,5 kg d90 in accordance with EN 744:1995 -20 °C 1	EN 1705
Multiple tests <sup>f</sup>				
1) Resistance to long-term internal pressure loading	The test piece shall fulfil the requirements of the following characteristics:	Conditioning time <sup>a</sup>  Type of test Number of test pieces <sup>b</sup> Test pressure for: PE 80 PE 100 Test period Test temperature	Shall conform to EN ISO 1167-1 Water-in-water 1  1,25 PN 1,25 PN 1 000 h 20 °C	EN ISO 1167-1 and EN ISO 1167-4
2) Leaktightness of seat and packing	No leakage during the test period	Test temperature Test fluid Number of test pieces <sup>b</sup> Test pressure Duration of the test	23 °C Air or nitrogen 1 25 mbar 1 h	Annex A
3) Leaktightness of seat and packing	No leakage during the test period	Test temperature Test fluid Number of test pieces <sup>b</sup> Test pressure  Duration of the test	23 °C Water, air or nitrogen 1 Water: 1,5 PN Air or nitrogen: 1,1 PN 30 s	Annex A
<b>SAFETY PRECAUTIONS — Safety precautions need to be taken when testing with air or nitrogen up to 1,5 PN. For testing with air or nitrogen a pressure of a maximum of 6 bar should be used. For higher pressures, testing with water should be considered, and the test conditions shall be agreed between the manufacturer and end user.</b>				

(continued)

**Table 1— Mechanical characteristics (concluded)**

Characteristic	Requirements	Test parameters		Test method
		Parameters	Value	
4) Operating torque <sup>d</sup>	Torque range: - For $d_n \leq 63$ mm $5 \text{ Nm} < M \leq 35 \text{ Nm}$ - For $63 \text{ mm} < d_n \leq 125$ mm $10 \text{ Nm} < M \leq 70 \text{ Nm}$ - For $125 \text{ mm} < d_n \leq 315$ mm $10 \text{ Nm} < M \leq 150 \text{ Nm}$	Test temperature Number of test pieces	0 °C and 40 °C 1	EN 28233
5) Impact loading resistance	No leakage and maximum value for operating torque (see examination of operating torque)	Position of test piece Drop height Mass of the striker Type of the striker  Test temperature Number of test pieces <sup>b</sup>	Vertical, see Figure 1 <sup>e</sup> 2 m 2,5 kg d90 in accordance with EN 744:1995 -20 °C 1	EN 1705

<sup>a</sup> The valves shall not be pressurized within 24 h after fusion.

<sup>b</sup> The numbers of test pieces given indicate the numbers required to establish a value for the characteristic described in the table. The numbers of test pieces required for factory production control and process control should be listed in the manufacturer's quality plan. For guidance see CEN/TS 12201-7[1].

<sup>c</sup> Only brittle failures shall be taken into account. If a ductile failure occurs before 165 h, the test may be repeated at a lower stress. The stress and the associated minimum test period shall be selected from Table 2 or from a line based on the stress/time points given in Table 2.

<sup>d</sup> The initiating torque and the running torque shall be within the torque range given in this table.


<sup>e</sup> The pipe and valve assembly are held on a flat horizontal surface to allow the striker to fall vertically onto the operating cap as shown in Figure 1

<sup>f</sup> As soon as possible after the completion of the internal pressure test the other three tests shall be carried out on the valve in the order stated.

**Table 2 — Circumferential (hoop) stress at 80 °C and associated minimum test period**

PE 80		PE 100	
Stress MPa	Minimum test period h	Stress MPa	Minimum test period h
4,5	165	5,4	165
4,4	233	5,3	256
4,3	331	5,2	399
4,2	474	5,1	629
4,1	685	5,0	1 000
4,0	1 000	—	—



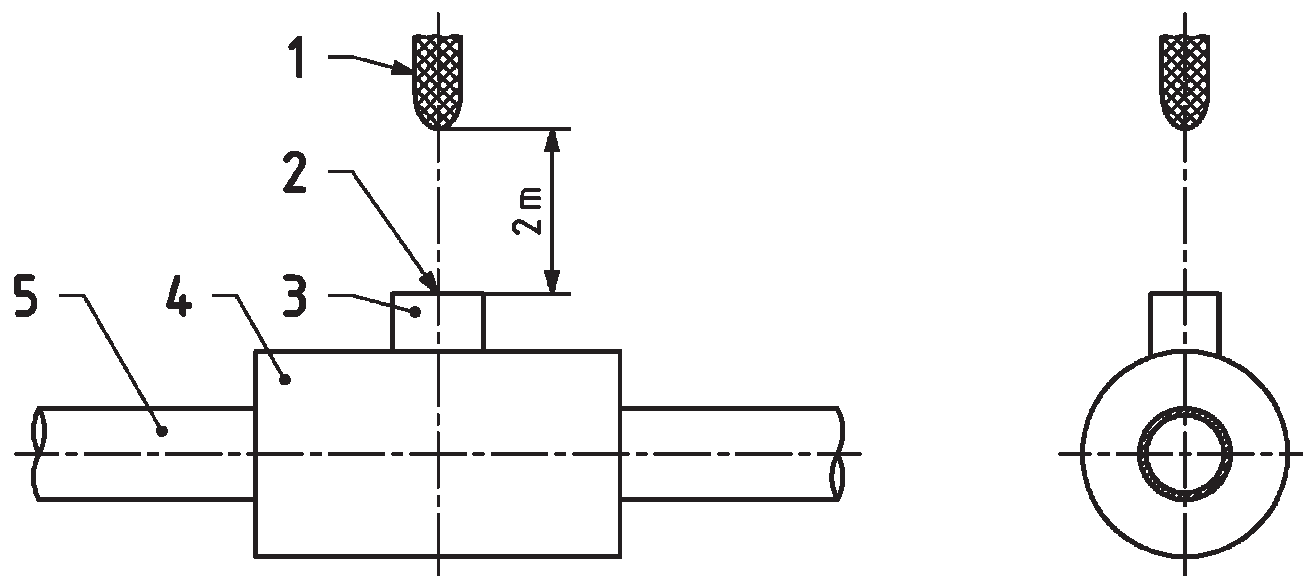

**Key**

- 1 striker
- 2 impact point
- 3 operating cap
- 4 valve body
- 5 valve outlet

**Figure 1 — Position of the test piece for the impact loading test**

## 8 Physical characteristics

### 8.1 Conditioning

Unless otherwise specified by the applicable test method, the test pieces shall be conditioned at  $(23 \pm 2) ^\circ\text{C}$  before testing in accordance with Table 3.

### 8.2 Requirements

When tested in accordance with the test methods specified and using the test parameters given in Table 3, the valves shall conform to the requirements given in Table 3.

**Table 3 — Physical characteristics**

Characteristic	Requirements	Test parameters		Test method
		Parameter	Value	
Oxidation induction time (thermal stability)	≥ 20 min	Test temperature Number of test pieces <sup>a</sup> Test environment Specimen weight	200 °C <sup>b</sup> 3 Oxygen (15 ± 2) mg	ISO 11357-6
Melt mass-flow rate (MFR)	After processing maximum deviation of ± 20 % of the value measured on the batch used to manufacture the valve	Loading mass Test temperature Time Number of test pieces <sup>a</sup>	5 kg 190 °C 10 min Shall conform to EN ISO 1133	EN ISO 1133
Effect on water quality <sup>c</sup>	National regulations apply			

<sup>a</sup> The number of test pieces given indicate the numbers required to establish a value for the characteristic described in the table. The number of test pieces required for factory production control and process control should be listed in the manufacturer's quality plan, for guidance see CEN/TS 12201-7 [1].

<sup>b</sup> Test may be carried out at 210 °C or 220 °C providing there is clear correlation to the results at 200 °C; in case of dispute the reference temperature shall be 200 °C.

<sup>c</sup> Test methods, parameters and requirements for all properties are under preparation. Until these European Standards are published National Regulations apply (see introduction).

## 9 Performance requirements

When valves conforming to this European Standard are assembled to each other or to other components conforming to other Parts of this European Standard, the joints shall conform to the requirements of EN 12201-5.

## 10 Marking

### 10.1 General

**10.1.1** Unless otherwise stated in Table 4, the marking elements shall be printed or formed directly on the fitting in such a way that after storage, weathering, handling and installation legibility is maintained during the use of the valve.

NOTE The manufacturer is not responsible for marking being illegible, due to actions caused during installation and use such as painting, scratching, covering of the components or using detergents etc. on the components unless agreed or specified by the manufacturer.

**10.1.2** Marking shall not initiate cracks or other types of defects which adversely influence the performance of the fitting.

**10.1.3** If printing is used, the colour of the printed information shall differ from the basic colour of the product.

**10.1.4** The marking shall be such that it is legible without magnification.

**10.1.5** There shall be no marking over the minimum spigot length of the valve.

## 10.2 Minimum required marking of valves

The minimum required marking shall conform to Table 4.

**Table 4 — Minimum required marking for valves**

Aspects required	Mark or symbol
Number of the System Standard <sup>a</sup>	EN 12201
Manufacturer's name and/or trademark	Name or symbol
Nominal outside diameter(s) of pipe, $d_n$	e.g. 110
Material and designation	e.g. PE 100
Design application series	e.g. SDR 11
Pressure rating bars <sup>a</sup>	e.g. PN 16
Manufacturer's information <sup>b</sup>	
Intended use <sup>a c</sup>	W
Flow direction (only for unidirectional valve)	Arrow
<sup>a</sup> This information may be printed on a label associated with the valve or on an individual bag. <sup>b</sup> For providing traceability, the following details shall be given: - the production period, year, month and/or week, in figures or in code; - a name or code for the production site if the manufacturer is producing in different sites. <sup>c</sup> Information on abbreviations can be found in CEN/TR 15438 [5] and/or in national rules.	

## 10.3 Additional Marking

Valves conforming to this European Standard, which are third party certified by a certification body, may be marked accordingly.

## 11 Delivery Conditions

The valves shall be packaged in bulk or individually protected where necessary in order to prevent deterioration and contamination. Whenever possible, they shall be placed in individual bags, in cardboard boxes or cartons.

NOTE 1 It is recommended to protect the spigot end by external caps.

The cartons and/or individual bags shall bear at least one label with the manufacturer's name, type and dimensions of the part, number of units in the box, and any special storage conditions and storage time limits.

NOTE 2 Valves should be stored in their original packing, until ready for use.

## Annex A (normative)

### Determination of the leaktightness of seat and packing

#### A.1 General

This Annex specifies the test method to verify the leaktightness of the seat and packing of a valve/valve bodies made from PE.

#### A.2 Test method

The valve shall be freed of air when testing with a liquid.

Test equipment shall not subject the valve to externally applied stresses which may affect the results of the tests.

The valves shall be tested by closing the obturator in the normal manner.

The method of internal leakage testing shall result in the application of the full differential test pressure specified in Table 1 across the seat or seats in the direction for which they are designed. Tests for typical types of valves shall be as specified in Table A.1.

Any unidirectional flow valve shall be tested in the specified flow direction only. Bidirectional valve shall be tested in both flow directions.

The duration of test shall conform to the specified values specified in Table 1.

**Table A.1 — Obturator tightness test methods**

Type of valves	Test method
Gate valves Ball valves Plug valves	The bonnet cavity shall be filled with the test fluid. Pressure shall be applied successively to each side of the closed valve and the valve shall be subsequently checked for leakage.  Valves with independent double seating (such as two-piece obturator or double-seated valves) may be tested by applying pressure between the seats, and each side of the closed valve checked for leakage.
Butterfly valves Diaphragm valves	Pressure shall be applied in the most adverse direction; valves with symmetrical seating may be tested in either direction.
Check valves	Pressure shall be applied in the direction tending to close the obturator and the opposite side shall be checked for leakage.

## Bibliography

- [1] CEN/TS 12201-7, *Plastics piping systems for water supply — Polyethylene (PE) - Part 7: Guidance for the assessment of conformity*
- [2] EN ISO 5210, *Industrial valves — Multi-turn valve actuator attachments (ISO 5210)*
- [3] EN 1074-1, *Valves for water supply — Fitness for purpose requirements and appropriate verification tests — Part 1: General requirements*
- [4] EN 1074-2, *Valves for water supply — Fitness for purpose requirements and appropriate verification tests — Part 2: Isolating valves*
- [5] CEN/TR 15438, *Plastics piping systems — Guidance for coding of products and their intended uses*
- [6] EN 736-3:2008, *Valves — Terminology — Part 3: Definition of terms*





# British Standards Institution (BSI)

BSI is the national body responsible for preparing British Standards and other standards-related publications, information and services.

BSI is incorporated by Royal Charter. British Standards and other standardization products are published by BSI Standards Limited.

## About us

We bring together business, industry, government, consumers, innovators and others to shape their combined experience and expertise into standards-based solutions.

The knowledge embodied in our standards has been carefully assembled in a dependable format and refined through our open consultation process. Organizations of all sizes and across all sectors choose standards to help them achieve their goals.

## Information on standards

We can provide you with the knowledge that your organization needs to succeed. Find out more about British Standards by visiting our website at [bsigroup.com/standards](http://bsigroup.com/standards) or contacting our Customer Services team or Knowledge Centre.

## Buying standards

You can buy and download PDF versions of BSI publications, including British and adopted European and international standards, through our website at [bsigroup.com/shop](http://bsigroup.com/shop), where hard copies can also be purchased.

If you need international and foreign standards from other Standards Development Organizations, hard copies can be ordered from our Customer Services team.

## Subscriptions

Our range of subscription services are designed to make using standards easier for you. For further information on our subscription products go to [bsigroup.com/subscriptions](http://bsigroup.com/subscriptions).

With **British Standards Online (BSOL)** you'll have instant access to over 55,000 British and adopted European and international standards from your desktop. It's available 24/7 and is refreshed daily so you'll always be up to date.

You can keep in touch with standards developments and receive substantial discounts on the purchase price of standards, both in single copy and subscription format, by becoming a **BSI Subscribing Member**.

**PLUS** is an updating service exclusive to BSI Subscribing Members. You will automatically receive the latest hard copy of your standards when they're revised or replaced.

To find out more about becoming a BSI Subscribing Member and the benefits of membership, please visit [bsigroup.com/shop](http://bsigroup.com/shop).

With a **Multi-User Network Licence (MUNL)** you are able to host standards publications on your intranet. Licences can cover as few or as many users as you wish. With updates supplied as soon as they're available, you can be sure your documentation is current. For further information, email [bsmusales@bsigroup.com](mailto:bsmusales@bsigroup.com).

## BSI Group Headquarters

389 Chiswick High Road London W4 4AL UK

## Revisions

Our British Standards and other publications are updated by amendment or revision.

We continually improve the quality of our products and services to benefit your business. If you find an inaccuracy or ambiguity within a British Standard or other BSI publication please inform the Knowledge Centre.

## Copyright

All the data, software and documentation set out in all British Standards and other BSI publications are the property of and copyrighted by BSI, or some person or entity that owns copyright in the information used (such as the international standardization bodies) and has formally licensed such information to BSI for commercial publication and use. Except as permitted under the Copyright, Designs and Patents Act 1988 no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means – electronic, photocopying, recording or otherwise – without prior written permission from BSI. Details and advice can be obtained from the Copyright & Licensing Department.

## Useful Contacts:

### Customer Services

**Tel:** +44 845 086 9001

**Email (orders):** [orders@bsigroup.com](mailto:orders@bsigroup.com)

**Email (enquiries):** [cservices@bsigroup.com](mailto:cservices@bsigroup.com)

### Subscriptions

**Tel:** +44 845 086 9001

**Email:** [subscriptions@bsigroup.com](mailto:subscriptions@bsigroup.com)

### Knowledge Centre

**Tel:** +44 20 8996 7004

**Email:** [knowledgecentre@bsigroup.com](mailto:knowledgecentre@bsigroup.com)

### Copyright & Licensing

**Tel:** +44 20 8996 7070

**Email:** [copyright@bsigroup.com](mailto:copyright@bsigroup.com)



...making excellence a habit.™