

# **Thermal performance of windows, doors and shutters — Determination of thermal transmittance by hot box method —**

## **Part 2: Frames**

The European Standard EN 12412-2:2003 has the status of a British Standard

ICS 91.060.50

## National foreword

This British Standard is the official English language version of EN 12412-2:2003.

The UK participation in its preparation was entrusted by Technical Committee B/540, Energy performance of materials, components and buildings, to Subcommittee B/540/1, European Standards for thermal insulation, which has the responsibility to:

- aid enquirers to understand the text;
- present to the responsible international/European committee any enquiries on the interpretation, or proposals for change, and keep the UK interests informed;
- monitor related international and European developments and promulgate them in the UK.

A list of organizations represented on this subcommittee can be obtained on request to its secretary.

### Cross-references

The British Standards which implement international or European publications referred to in this document may be found in the *BSI Catalogue* under the section entitled "International Standards Correspondence Index", or by using the "Search" facility of the *BSI Electronic Catalogue* or of British Standards Online.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

**Compliance with a British Standard does not of itself confer immunity from legal obligations.**

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 20 August 2003

### Summary of pages

This document comprises a front cover, an inside front cover, the EN title page, pages 2 to 42, an inside back cover and a back cover.

The BSI copyright notice displayed in this document indicates when the document was last issued.

### Amendments issued since publication

Amd. No.	Date	Comments

EUROPEAN STANDARD  
NORME EUROPÉENNE  
EUROPÄISCHE NORM

**EN 12412-2**

July 2003

ICS 91.060.50

English version

**Thermal performance of windows, doors and shutters -  
Determination of thermal transmittance by hot box method - Part  
2: Frames**

Performance thermique des fenêtres, portes et fermetures -  
Détermination du coefficient de transmission thermique par  
la méthode de la boîte chaude - Partie 2: Encadrements

Wärmetechnisches Verhalten von Fenstern, Türen und  
Abschlüssen - Bestimmung des  
Wärmedurchgangskoeffizienten mittels des  
Heizkastenverfahrens - Teil 2: Rahmen

This European Standard was approved by CEN on 2 May 2003.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Luxembourg, Malta, Netherlands, Norway, Portugal, Slovakia, Spain, Sweden, Switzerland and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION  
COMITÉ EUROPÉEN DE NORMALISATION  
EUROPÄISCHES KOMITEE FÜR NORMUNG

**Management Centre: rue de Stassart, 36 B-1050 Brussels**

## Contents

<b>Foreword .....</b>	<b>3</b>
<b>Introduction.....</b>	<b>4</b>
<b>1 Scope.....</b>	<b>4</b>
<b>2 Normative references.....</b>	<b>4</b>
<b>3 Terms, definitions, symbols, units and subscripts .....</b>	<b>5</b>
<b>4 Principle .....</b>	<b>6</b>
<b>5 Requirements for test specimen and apparatus.....</b>	<b>6</b>
<b>5.1 General .....</b>	<b>6</b>
<b>5.2 Surround panels .....</b>	<b>6</b>
<b>5.3 Specimen requirements and location .....</b>	<b>6</b>
<b>5.3.1 Complete frames for windows and doors.....</b>	<b>6</b>
<b>5.3.2 Frame and sash, transom or mullion profile sections.....</b>	<b>9</b>
<b>5.4 Calibration panels .....</b>	<b>11</b>
<b>5.5 Temperature measurement and baffle positions .....</b>	<b>11</b>
<b>6 Test procedure.....</b>	<b>13</b>
<b>6.1 General .....</b>	<b>13</b>
<b>6.2 Calibration measurements .....</b>	<b>13</b>
<b>6.2.1 General .....</b>	<b>13</b>
<b>6.2.2 Total surface resistance .....</b>	<b>14</b>
<b>6.2.3 Surface resistances and surface coefficients of heat transfer.....</b>	<b>15</b>
<b>6.2.4 Surround panel and edge effects .....</b>	<b>16</b>
<b>6.3 Measurement procedure for test specimens.....</b>	<b>17</b>
<b>7 Test report.....</b>	<b>19</b>
<b>Annex A (normative) Determination of environmental temperature .....</b>	<b>21</b>
<b>A.1 General .....</b>	<b>21</b>
<b>A.2 Environmental temperature.....</b>	<b>22</b>
<b>A.3 Mean radiant temperature .....</b>	<b>22</b>
<b>A.4 Convective surface heat transfer coefficient .....</b>	<b>23</b>
<b>Annex B (normative) Linear thermal transmittance of the edge zone .....</b>	<b>25</b>
<b>Annex C (informative) Example of calibration test and measurement of frame specimen.....</b>	<b>32</b>
<b>C.1 Calibration test with panel size 1,23 m  1,48 m .....</b>	<b>32</b>
<b>C.2 Frame specimen measurement.....</b>	<b>38</b>

## Foreword

This document EN 12412-2:2003 has been prepared by Technical Committee CEN /TC 89, "Thermal performance of buildings and building components" the secretariat of which is held by SIS.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by January 2004, and conflicting national standards shall be withdrawn at the latest by January 2004.

This standard is one of a series of standards on calculation and measurement methods for the design and evaluation of the thermal performance of buildings and building components.

Annexes A and B are normative. Annex C is informative.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Luxembourg, Malta, Netherlands, Norway, Portugal, Slovakia, Spain, Sweden, Switzerland and the United Kingdom.

## Introduction

The method given in this European Standard provides data on frames that can be used in calculations of the overall thermal performance of windows and doors according to EN ISO 10077-1, *Thermal performance of windows, doors and shutters – Calculation of thermal transmittance – Part 1: Simplified method (ISO 10077-1)*.

### 1 Scope

This European Standard specifies a method, based on EN ISO 8990 and EN ISO 12567-1, to measure the thermal transmittance of frame and sash components of windows and doors, including mullions and transoms.

The thermal bridging effect of window or door components (handles, hinges, closing devices, etc.) is included.

The test procedure is designed to take into account the whole developed area of the frame or sash surface, but excludes the influence of the thermal bridge introduced through the spacer in sealed glazing units.

Edge effects occurring outside of the perimeter of the specimen are excluded. Furthermore, energy transfer due to solar radiation is not taken into account, and air leakage is excluded.

The measurements are performed under defined conditions to facilitate the comparison of measured values.

Information on the design of the calibration transfer standard is given in EN ISO 12567-1.

### 2 Normative references

This European Standard incorporates by dated or undated reference, provisions from other publications. These normative references are cited at the appropriate places in the text, and the publications are listed hereafter. For dated references, subsequent amendments to or revisions of any of these publications apply to this European Standard only when incorporated in it by amendment or revision. For undated references the latest edition of the publication referred to applies (including amendments).

EN 1946-4, *Thermal performance of building products and components – Specific criteria for the assessment of laboratories measuring heat transfer properties – Part 4: Measurements by hot box methods*.

prEN 12519:1996<sup>1</sup>, *Windows and doors – Terminology*.

EN 12664, *Thermal performance of building materials and products – Determination of thermal resistance by means of guarded hot plate and heat flow meter methods – Dry and moist products of medium and low thermal resistance*.

EN ISO 7345:1995, *Thermal insulation – Physical quantities and definitions (ISO 7345:1987)*.

EN ISO 8990:1996, *Thermal insulation – Determination of steady-state thermal transmission properties – Calibrated and guarded hot box (ISO 8990:1994)*.

EN ISO 9288:1996, *Thermal insulation – Heat transfer by radiation – Physical quantities and definitions (ISO 9288:1989)*.

EN ISO 12567-1:2000, *Thermal performance of windows and doors – Determination of thermal transmittance by hot box method - Part 1: Complete windows and doors (ISO 12567-1:2000)*.

### 3 Terms, definitions, symbols, units and subscripts

#### 3.1 Terms and definitions

For the purposes of this European Standard, the terms and definitions given in prEN 12519:1996, EN ISO 7345:1995, EN ISO 8990:1996 and EN ISO 9288:1996 apply.

#### 3.2 Symbols and units

<b>Symbol</b>	<b>Quantity</b>	<b>Unit</b>
<i>A</i>	area	$\text{m}^2$
<i>d</i>	thickness or depth	$\text{m}$
<i>F</i>	fraction	
<i>f</i>	view factor	
<i>H</i>	height	$\text{m}$
<i>h</i>	surface coefficient of heat transfer	$\text{W}/(\text{m}^2 \text{K})$
<i>L</i>	perimeter length	$\text{m}$
<i>l</i>	length	$\text{m}$
<i>q</i>	density of heat flow rate	$\text{W}/\text{m}^2$
<i>R</i>	thermal resistance	$\text{m}^2 \text{K}/\text{W}$
<i>T</i>	thermodynamic temperature	$\text{K}$
<i>T</i> ,	temperature difference	$\text{K}$
<i>U</i>	thermal transmittance	$\text{W}/(\text{m}^2 \text{K})$
<i>v</i>	air velocity	$\text{m}/\text{s}$
<i>w</i>	width	$\text{m}$
	radiation factor	
	hemispherical emissivity	
	Celsius temperature	$^\circ\text{C}$
	thermal conductance	$\text{W}/(\text{m}^2 \text{K})$
	thermal conductivity	$\text{W}/(\text{mK})$
	Stefan-Boltzmann constant	$\text{W}/(\text{m}^2 \text{K}^4)$
	heat flow rate	$\text{W}$
	linear thermal transmittance	$\text{W}/(\text{mK})$

#### 3.3 Subscripts

<i>b</i>	baffle
<i>c</i>	convection (air)
<i>ca</i>	calibration
<i>e</i>	external, usually cold side
<i>ed</i>	edge zone
<i>f</i>	frame
<i>fi</i>	infill with known thermal properties

hb	hot box
i	internal, usually warm side
in	input
m	measured
me	average/mean
n	environmental (ambient)
ne	environmental (ambient external)
ni	environmental (ambient internal)
p	reveal of surround panel
r	radiation (mean)
s	surface
sp	specimen
sur	surround panel
t	total

## 4 Principle

The thermal transmittance of a frame is determined directly by measurement under standardised conditions using the calibrated or guarded hot box method according to EN ISO 8990 and EN ISO 12567-1. The requirements of EN ISO 8990 shall be complied with in addition to those given in this standard. The method may be applied to complete window or door frames (see 5.3.1) or to profile sections including mullions, transoms etc. (see 5.3.2).

The surround panel is used to keep the specimen in a given position. It is constructed with outer dimensions of appropriate size for the apparatus, having an aperture to accommodate the specimen (see Figures 1 to 5).

The principal heat flows through the surround panel and the calibration panel (or test specimen) are shown in Figure 8. The boundary edge heat flow due to the location of the calibration panel in the surround panel is determined separately as a linear thermal transmittance,  $\lambda_{boundary}$ .

The procedure in this standard includes a correction for the boundary edge heat flow, so that standardized and reproducible thermal transmittance properties are obtained.

The magnitude of the boundary edge heat flow as a function of geometry, calibration panel thickness and thermal conductivity is determined by tabulated values given EN ISO 12567-1:2000, annex B.

## 5 Requirements for test specimen and apparatus

### 5.1 General

The test apparatus shall conform to the requirements specified in EN 1946-4, EN ISO 8990 and EN ISO 12567-1.

### 5.2 Surround panels

For details see EN ISO 12567-1:2000, 5.2.

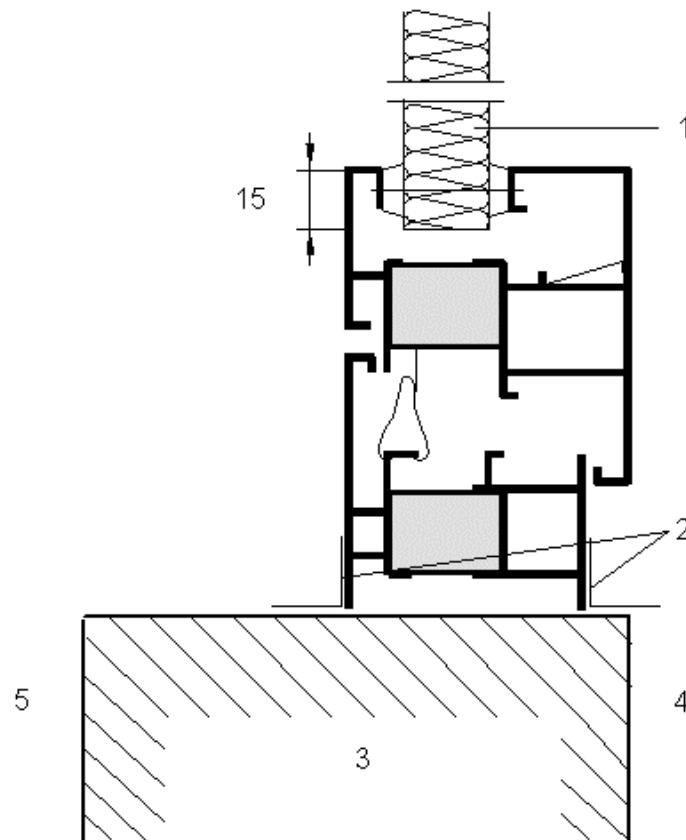
### 5.3 Specimen requirements and location

#### 5.3.1 Complete frames for windows and doors

Specimen sizes should be representative (typical) of those found in practice. For standardised tests on window frames the overall sizes recommended are 1230 mm (width) by 1480 mm (height). Further requirements are laid down in EN ISO 12567-1:2000, 5.3.

To ensure consistency of measurement, the specimen shall be located as follows. The specimen with panel shall fill the surround panel aperture, which shall be located centrally. The internal frame face shall be as close to the face of the surround panel as possible, but no part shall project beyond the surround panel faces on either the cold or warm sides (see Figures 1, 2 and 3).

Dimensions in millimetres

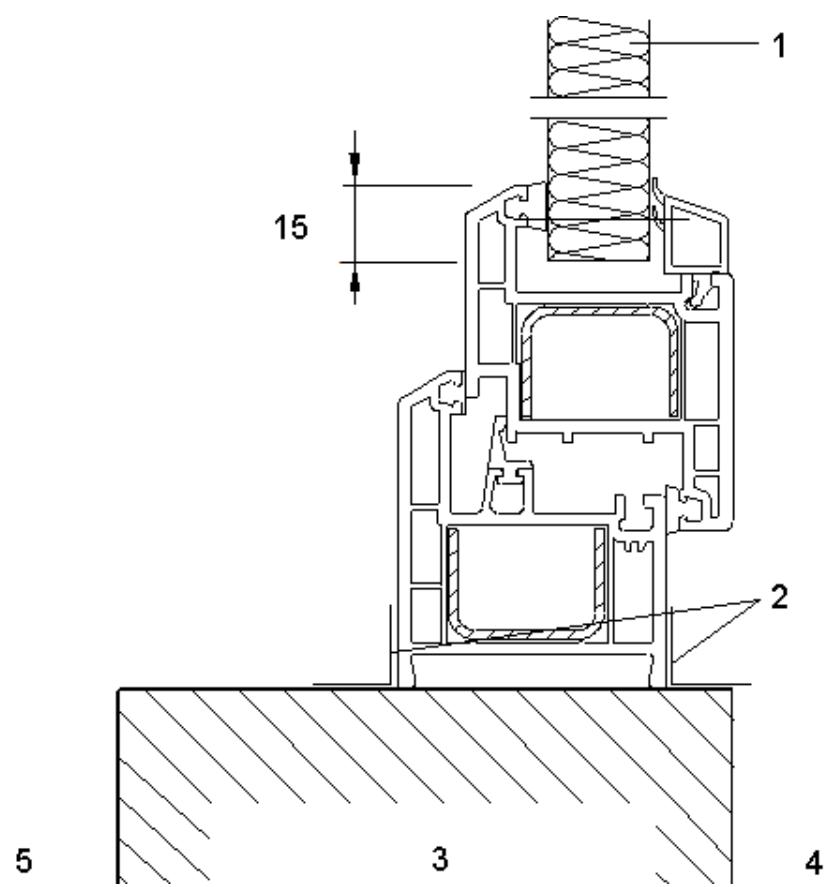


#### Key

- 1 Infill element of insulating material
- 2 Adhesive tape
- 3 Aperture
- 4 Warm side
- 5 Cold side

**Figure 1 — Mounting of specimen in the aperture Metal frame**

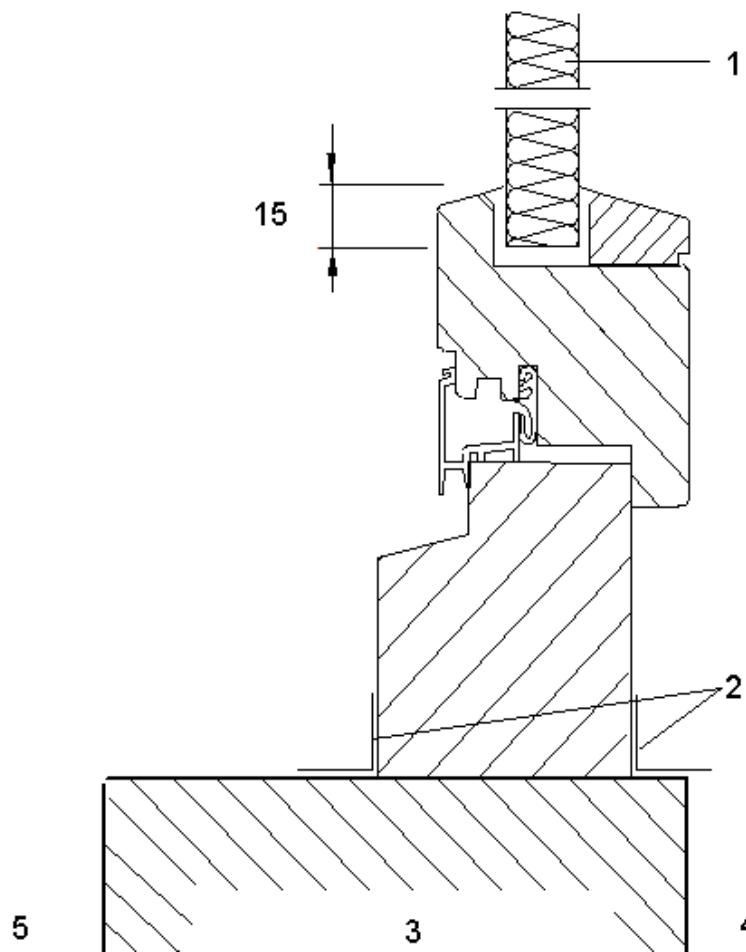
Dimensions in millimetres

**Key**

- 1 Infill element of insulating material
- 2 Adhesive tape
- 3 Aperture
- 4 Warm side
- 5 Cold side

**Figure 2 — Mounting of specimen in the aperture PVC frame**

Dimensions in millimetres

**Key**

- 1 Infill element of insulating material
- 2 Adhesive tape
- 3 Aperture
- 4 Warm side
- 5 Cold side

**Figure 3 — Mounting of the specimen in the aperture Wood frame**

The aperture should be at least 200 mm from the inside surfaces of the cold and hot boxes to avoid or limit edge heat flow corrections, and to allow room for the guarded hot box (where applicable).

Any glazing or opaque infill panels in windows and doors shall be replaced by insulating panels (see Figures 1, 2 and 3). Thermocouples to measure the surface temperature on the infill insulation shall be placed as shown in Figure 6.

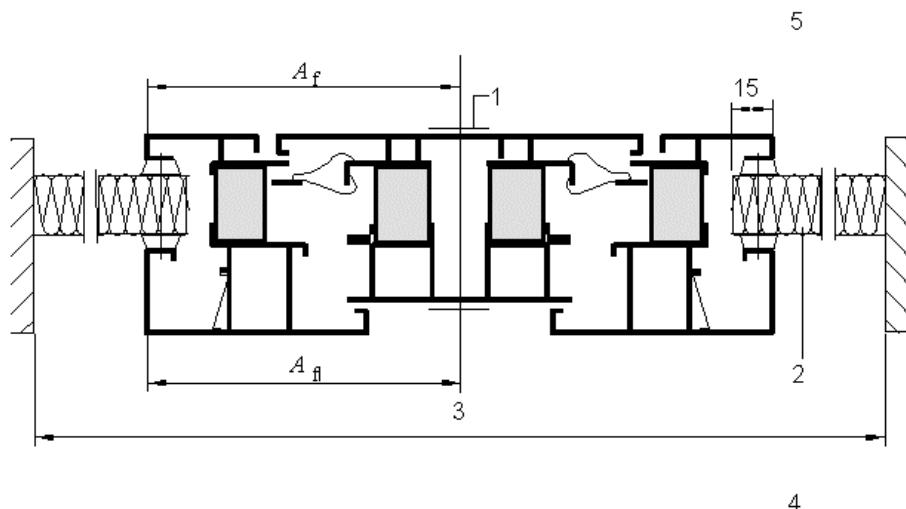
All surround panel thermocouples should be located centrally (see Figure 6).

For further information see EN ISO 12567-1.

### **5.3.2 Frame and sash, transom or mullion profile sections**

The frame, mullion or transom of a window or door system shall be installed vertically in the surround panel aperture. The internal specimen face shall be as close to the face of the surround panel as possible, but no part shall project beyond the surround panel faces on either the cold or warm sides (see Figure 4).

Dimensions in millimetres

**Key**

- 1 Adhesive tape
- 2 Infill element of insulating material
- 3 Projected area  $A_t$  of the frame and infill insulation
- 4 Warm side
- 5 Cold side

**Figure 4 — Combination of sashes and frames**

The frame area,  $A_f$ , is the larger of the two projected areas seen from both sides.

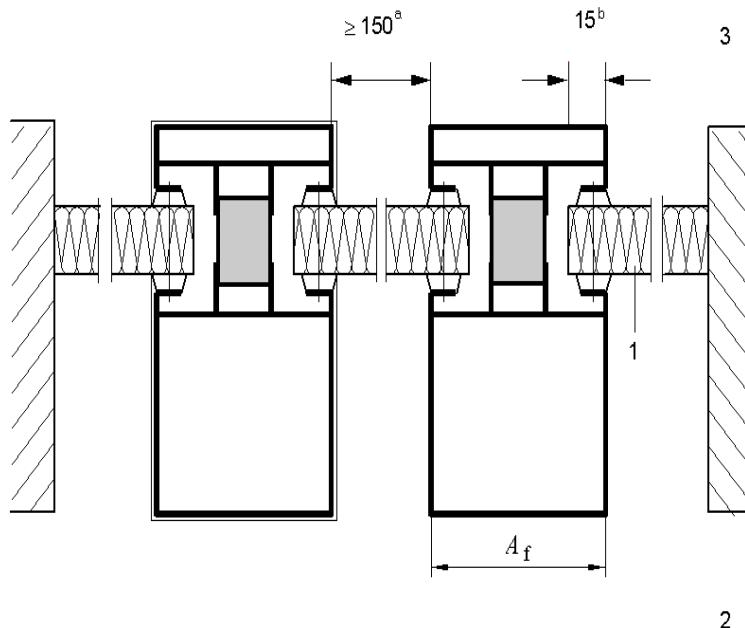
The length of the profile sections should be 1480 mm.

If the specimens usually form part of a combination of several frame profiles, e.g. sash and frame, the complete units shall be tested, inclusive of any hinges, seals, etc.

The sash and frame profile sections shall be connected with at least two hinges. Additionally, the profile sections shall be fixed without causing thermal bridging.

If the frame area forms less than 30 % of the aperture area of the hot box, two or more frames shall be installed so that the total frame area is at least 30 % of the aperture area, with a recommended distance between profile sections of 150 mm (see Figure 5).

Dimensions in millimetres



### Key

- 1 Infill insulation
- 2 Warm side
- 3 Cold side
- a Recommended dimension
- b The extent of penetration of the infill insulation may be smaller than 15 mm only if the design does not allow 15 mm; in that case the actual penetration depth shall be stated in the test report

**Figure 5 — Installation of more than one frame section in the aperture**

The connection of frame and insulating panels, and the joining of frames, are shown in Figures 4 and 5.

The surface of specimens shall be treated as for the normal application of the product.

The area remaining between the aperture of the hot box and the specimen shall be filled with an infill insulation with known thermal conductivity. The thermal conductivity should not be higher than 0,035 W/(mK).

The thermal conductivity of the infill insulation shall be obtained by measurement according to EN 12664 (guarded hot plate apparatus) or by using materials with certified properties from an accredited source.

Thermocouples to measure the surface temperature shall be centrally located as shown in Figure 7.

For further information see EN ISO 12567-1.

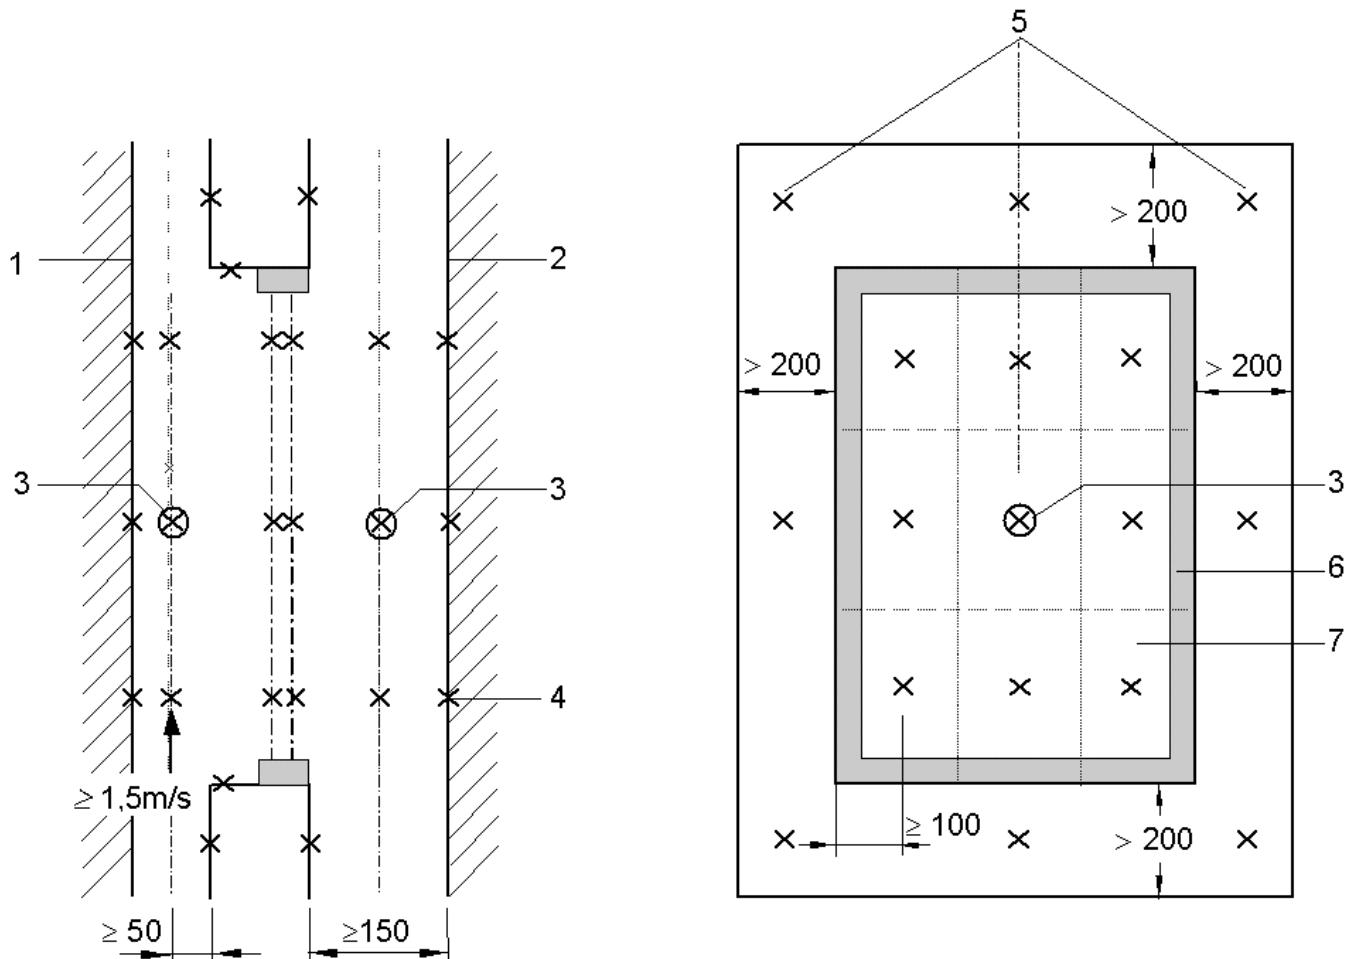
### 5.4 Calibration panels

The calibration panel shall be mounted as shown in Figure 8. For further details see 5.5 and EN ISO 12567-1:2000, 5.4.

### 5.5 Temperature measurement and baffle positions

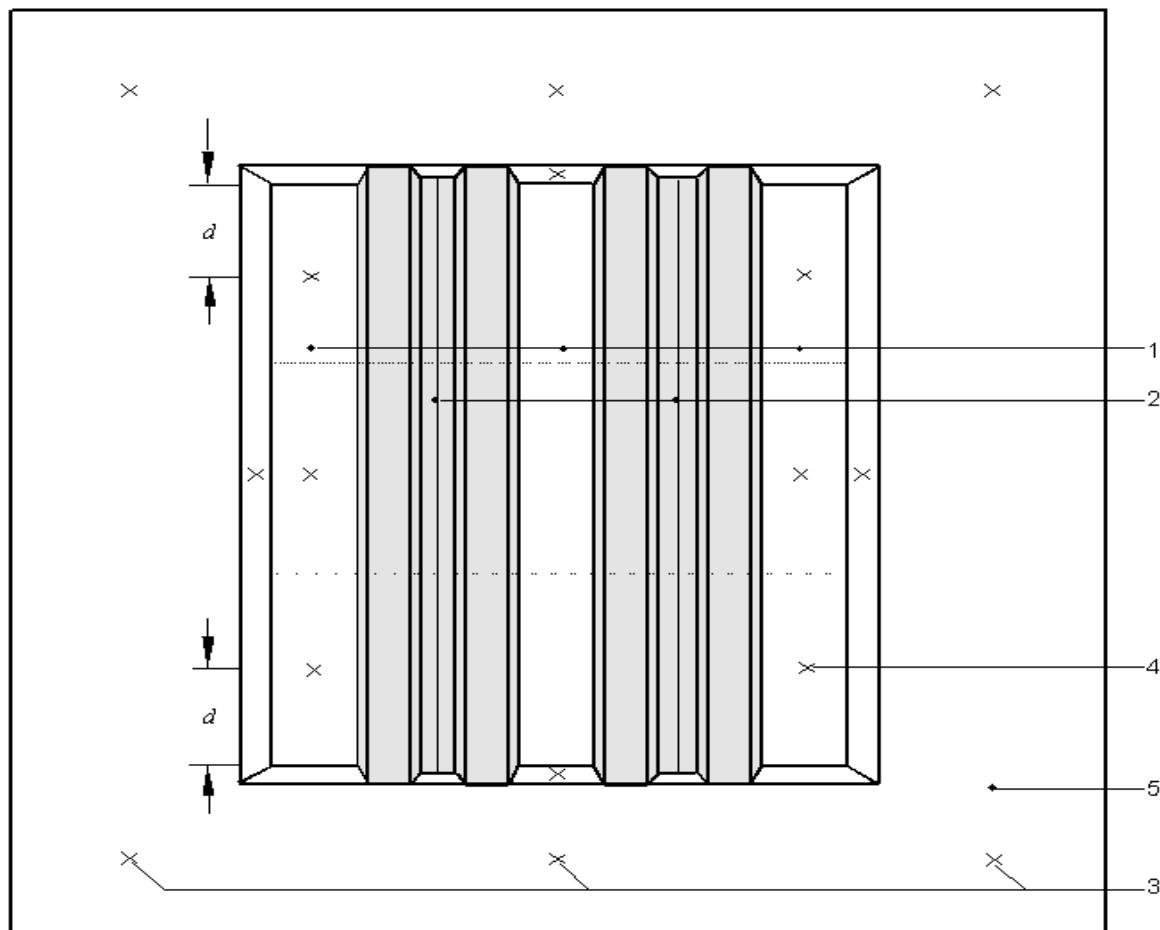
For details see EN ISO 12567-1:2000, 5.6.

Dimensions in millimetres

**Key**

- 1 Cold side baffle
- 2 Warm side baffle
- 3 Air speed sensor
- 4 Temperature sensors ( )
- 5 Surround panel thermocouples
- 6 Test specimen
- 7 Infill insulation

**Figure 6 — Location of temperature and air speed sensors for measurements on complete frames for windows and doors**



### Key

- 1 Infill insulation
- 2 Test specimen
- 3 Temperature sensors ( )
- 4 Temperature sensors ( )
- 5 Surround panel

NOTE Dimension  $d$  is half of 1/3 of the height of the infill insulation

**Figure 7 — Location of temperature sensors for measurements on profile sections**

## 6 Test procedure

### 6.1 General

Except as provided herein, the test procedure shall conform with EN ISO 12567-1:2000, 6.2 and 6.3. An example of the required calculations is given in annex C.

### 6.2 Calibration measurements

#### 6.2.1 General

Calibration measurements are required to ensure that suitable test conditions are set up and that the surround panel heat flow and surface heat transfer coefficients can be fully accounted for.

The calibration measurements shall be carried out at a minimum of six densities of heat flow rate, which cover the required range of specimen testing.

The calibration measurements should be carried out at three different mean air temperatures  $t_{c,me}$  (where  $t_{c,me}$  is  $(t_{c,i} + t_{c,e})/2$ ) in steps of  $\pm 5$  K by varying the cold side air temperature, retaining constant conditions of air movement on the cold side and constant air temperature and natural convection on the warm side. By this procedure surface resistances and coefficients of heat transfer can be determined as a function of the total density of heat flow rate through the calibration panel.

**NOTE** It is considered that for non-homogeneous test specimens like window frames or door frames, the mean heat transfer conditions over the measured area will be comparable to those of the given calibration panel.

## 6.2.2 Total surface resistance

### 6.2.2.1 Measurement

The calibration panels should be as specified in EN ISO 12567-1:2000, C.1 and the calibration measurements shall be carried out as specified in EN ISO 12567-1:2000, 6.2 (see also Figure 8).

The first calibration test shall be made with the thin panel ( $d_{ca} = 20$  mm) at a mean temperature of approximately  $10^\circ\text{C}$  and a temperature difference,  $\Delta\theta_c$ , between warm and cold sides, of  $(20 \pm 2)$  K (see annex A for determination of the environmental temperatures, EN ISO 8990:1996 and EN ISO 12567-1:2000, annex A).

The air velocity on the cold side shall be adjusted for the first calibration test by throttling or by fan speed adjustment to give a total surface thermal resistance (warm and cold side)  $R_{s,t} = 0,17 \pm 0,01 \text{ m}^2\text{K/W}$ . Thereafter the fan speed settings and/or the throttling devices shall remain constant for all subsequent calibration measurements. The set-up used for the calibration procedure shall be used for all tests with specimens of frames.

### 6.2.2.2 Calculation

Calculate the total surface thermal resistance of the warm and cold side,  $R_{s,t}$ , expressed in  $\text{m}^2\text{K/W}$ , using Equation (1):

$$R_{s,t} = \frac{\Delta\theta_{n,ca} - \Delta\theta_{s,ca}}{q_{ca}} \quad (1)$$

where

$\Delta\theta_{n,ca}$  is the difference between the environmental temperatures on each side of the calibration panel, in K, calculated in accordance with annex A;

$\Delta\theta_{s,ca}$  is the surface temperature difference of the calibration panel, in K;

$q_{ca}$  is the density of heat flow rate of the calibration panel determined from the known thermal resistance,  $R_{ca}$ , of the calibration panel (at the mean temperature,  $t_{me,ca}$ ) and the surface temperature difference,  $\Delta\theta_{s,ca}$ , calculated by Equation (2).

$$q_{ca} = \frac{\Delta\theta_{s,ca}}{R_{ca}} \quad (2)$$

where  $R_{ca}$  is the thermal resistance of the calibration panel at the mean temperature of the panel, calculated by Equation (3):

$$R_{ca} = \hat{a} \frac{d_j}{j} \quad (3)$$

The total surface resistance,  $R_{s,t}$ , shall be plotted as a function of the density of heat flow rate,  $q_{ca}$  through the calibration panel. These characteristics are used to determine the total surface resistance for all subsequent measurements on test specimens.

## 6.2.3 Surface resistances and surface coefficients of heat transfer

### 6.2.3.1 General

Surface coefficients of heat transfer (convective and radiative parts) are needed in order to determine the environmental temperatures (according to the procedures given in annex A, EN ISO 8990 and EN ISO 12567-1:2000, annex A). Surface temperature measurements on the calibration panel at different densities of heat flow rate allows the determination of the surface coefficients of heat transfer. The surface resistances are calculated using Equations (4) and (5).

$$R_{si,t} = \frac{\Delta_{ni,ca} - \Delta_{si,ca}}{q_{ca}} \quad (4)$$

$$R_{se,t} = \frac{\Delta\theta_{ne,ca} - \Delta\theta_{se,ca}}{q_{ca}} \quad (5)$$

where

$q_{ca}$  is the density of heat flow rate through the calibration panel, in  $\text{W/m}^2$ ;

$_{ni,ca}$  is the environmental temperature of the warm side, in  $^\circ\text{C}$ ;

$_{si,ca}$  is the warm side surface temperature of the calibration panel, in  $^\circ\text{C}$ ;

$_{se,ca}$  is the cold side surface temperature of the calibration panel, in  $^\circ\text{C}$ ;

$_{ne,ca}$  is the environmental temperature of the cold side, in  $^\circ\text{C}$ .

### 6.2.3.2 Convective fraction

Evaluate the radiative and convective parts of the surface coefficients of heat transfer from the calibration data for the warm and cold side, according to the procedure given in annex A and EN ISO 12567-1:2000, annex A, and determine the convective fraction  $F_c$  using Equation (6):

$$F_c = \frac{h_c}{h_c + h_r} \quad (6)$$

where

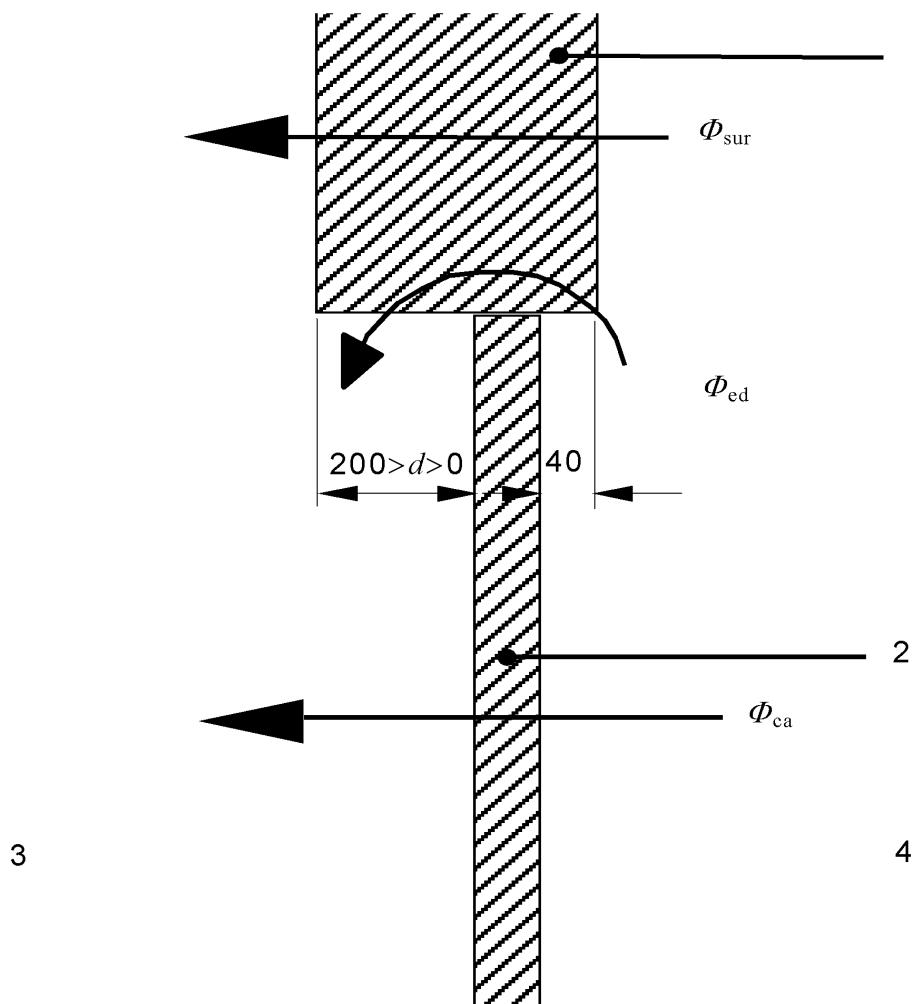
$h_c$  is the convective coefficient of heat transfer, in  $\text{W}/(\text{m}^2\text{K})$ ;

$h_r$  is the radiative coefficient of heat transfer, in  $\text{W}/(\text{m}^2\text{K})$ .

The variation of the convective fraction,  $F_c$  shall be plotted for both sides as a function of  $q_{ca}$  (density of heat flow rate through the calibration panel). It will be used by interpolation for the determination of the environmental temperatures of all subsequent measurements of test specimens using Equation (7):

$$n = F_c \cdot c + (1 - F_c) \cdot r \quad (7)$$

Dimensions in millimetres

**Key**

- 1 Surround panel
- 2 Calibration panel
- 3 Cold side
- 4 Warm side

**Figure 8 — Surround panel and boundary effects****6.2.4 Surround panel and edge effects**

The major difference compared to the procedures given in EN ISO 12567-1 is that a correction for a change in the total surface resistance is not made and so a graph of the density of heat flow rate against the total surface resistance does not need to be drawn.

From the data set of the thicker calibration panel ( $d_{ca} = 60$  mm), calculate and plot the thermal resistance of the surround panel,  $R_{sur}$ , as a function of its mean temperature. From the heat flows shown in Figure 8, the Equations (8), (9) and (10) are derived:

$$R_{sur} = \frac{A_{sur} \Delta_{s,sur}}{\text{in} \quad ca \quad ed} \quad (8)$$

where

$A_{\text{sur}}$  is the projected area of the surround panel, in  $\text{m}^2$ ;

$s_{\text{sur}}$  is the difference between the average surface temperatures of the surround panel, in K;

$_{\text{in}}$  is the heat input to the metering box appropriately corrected for heat flow through the metering box walls and the flanking losses, in W, (see EN ISO 8990);

$_{\text{ca}}$  is the heat flow rate through the calibration panel, in W, given by:

$$_{\text{ca}} = A_{\text{ca}} q_{\text{ca}} \quad (9)$$

where

$A_{\text{ca}}$  is the projected area of the calibration panel, in  $\text{m}^2$ ;

$q_{\text{ca}}$  is the density of heat flow rate of the calibration panel, in  $\text{W}/\text{m}^2$ ;

$_{\text{ed}}$  is the heat flow rate through the edge zone between calibration panel and surround panel, in W, given by:

$$_{\text{ed}} = L_{\text{ed}} \cdot _{\text{ed}} \cdot c \quad (10)$$

where

$L_{\text{ed}}$  is the perimeter length between surround panel and specimen, in m;

$_{\text{ed}}$  is the linear thermal transmittance of the edge zone between surround panel and specimen, in  $\text{W}/(\text{m}\cdot\text{K})$ ; values of  $_{\text{ed}}$  shall be taken from Table B.2 for measurements on complete frames described in 5.3.1 and Table B.3 for measurements on frame profiles described in 5.3.2;

$c$  is the difference between the warm and the cold side air temperatures, in K.

This calibration procedure allows the results from a given size of calibration panel to be applied to a different size of test specimen without repeating the whole calibration measurement process.

NOTE 1 The calculation of environmental temperatures is described in EN ISO 12567-1:2000, annex A.

NOTE 2 If the internal and external projected areas are different, the larger of the two is used.

NOTE 3 A worked example is given in annex C.

### 6.3 Measurement procedure for test specimens

The measurement of the test specimens shall be made under the same conditions as those used in the corresponding calibrations described in EN ISO 12567-1:2000, 6.2.1, at a mean temperature of approximately 10°C.

The density of heat flow rate  $q_t$ , expressed in  $\text{W}/\text{m}^2$ , through the infill insulation and frame during the measurement shall be calculated using Equation (11):

$$q_t = \frac{_{\text{in}}}{A_t} \cdot \frac{s_{\text{sur}}}{A_{\text{sur}}} \cdot \frac{_{\text{ed}}}{A_{\text{ed}}} \quad (11)$$

where

$A_t$  is the projected area of the frame and the infill area, in  $\text{m}^2$ ;

$_{\text{in}}$  is the heat input to the metering box appropriately corrected for heat flow through the metering box walls and the flanking losses, in W; (see EN ISO 8990:1996, 2.9.3.3);

$\phi_{\text{ed}}$  is the edge zone heat flow rate according to Equation (10), in W; the actual value for  $\phi_{\text{ed}}$  shall be taken from Tables B.2 or B.3;

$\phi_{\text{sur}}$  is the heat flow rate through the surround panel, in W, given by:

$$\Phi_{\text{sur}} = \frac{A_{\text{sur}} \Delta_{s,\text{sur}}}{R_{\text{sur}}} \quad (12)$$

where

$\Delta_n$  is the difference between the environmental temperatures on each side of the system under test, in K;

$A_{\text{sur}}$  is the projected area of the surround panel, in  $\text{m}^2$ ;

$R_{\text{sur}}$  is the thermal resistance of the surround panel, in  $\text{m}^2 \text{K/W}$ , determined by calibration (see example in annex C, Figure C.1).

The measured overall thermal transmittance  $U_{m,t}$ , expressed in  $\text{W}/(\text{m}^2 \text{K})$ , of the infill insulation and frame shall be calculated by Equation (13):

$$U_{m,t} = \frac{q_t}{\Delta\theta_n} \quad (13)$$

where

$q_t$  is the density of heat flow rate in the measurement of the infill insulation and frame, in  $\text{W}/\text{m}^2$ .

The overall thermal transmittance of the frame,  $U_f$ , is given by:

$$U_f = \frac{U_{m,t} A_t \Delta\theta_n}{A_f \Delta\theta_n} \quad (14)$$

where

$U_{m,t}$  is the measured thermal transmittance of the infill insulation and the frame, in  $\text{W}/(\text{m}^2 \text{K})$ ;

$A_f$  is the frame area; the frame area is the larger of the two projected areas seen from both sides, in  $\text{m}^2$ ;

$A_{fi}$  is the remaining area of the calibrated infill insulation in the plane of measurement ( $A_{fi} = A - A_f$ ), in  $\text{m}^2$ , (see Figure 9);

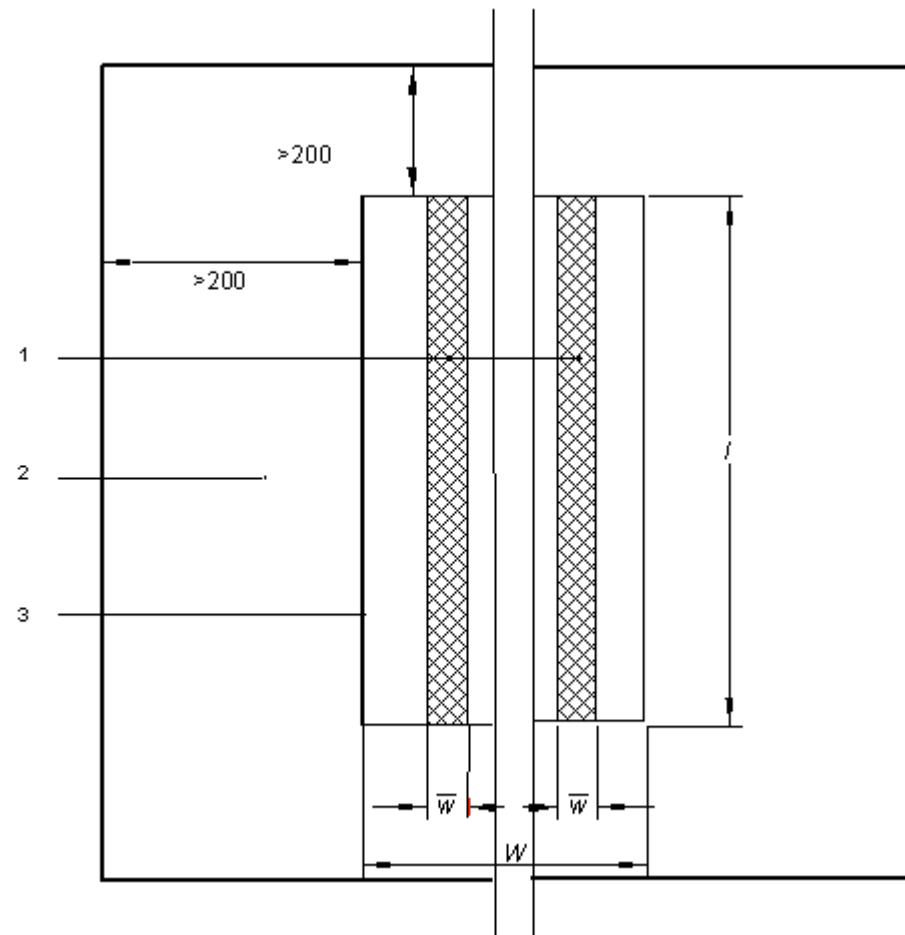
$A_t$  is the projected area of the metering area, in  $\text{m}^2$ ;

$\Delta_n$  is the difference between the environmental temperatures on each side of the system under test, in K;

$\lambda_{fi}$  is the thermal conductance of the infill insulation, in  $\text{W}/(\text{m}^2 \text{K})$ ;

$\Delta_{s,fi}$  is the difference of the temperatures between the surfaces of the infill element, in K.

Dimensions in millimetres

**Key**

- 1 Test specimen
- 2 Surround panel
- 3 Aperture

**Figure 9 — Aperture**

The area of the aperture is

$$A = w l \quad (15)$$

The area of infill is

$$A_{fi} = (wl) \sum_i (\bar{w}_i l_i) \quad (16)$$

The projected area of the frame is

$$A_f = \sum_i (\bar{w}_i l_i) \quad (17)$$

**7 Test report**

The test report shall contain:

- a) details of apparatus as required by EN ISO 8990 and EN ISO 12567-1;
- b) identification of specimen (height, width, thickness);
- c) sketch showing the structure of the specimen (including frame composition and geometry, sashes, thermal break etc.);

d) summary details of the range of calibrations appropriate to the test;

e) test conditions and result:

$\frac{3}{4}$  mean environmental temperature on hot side  $t_{ni}$ ;

$\frac{3}{4}$  mean environmental temperature on cold side  $t_{ne}$ ;

$\frac{3}{4}$  air speed  $v_e$ , on cold side;

$\frac{3}{4}$  the measured thermal transmittance  $U_f$ , as obtained from the test.

Thermal transmittances shall be expressed in W/(m<sup>2</sup>·K) rounded to two significant figures.

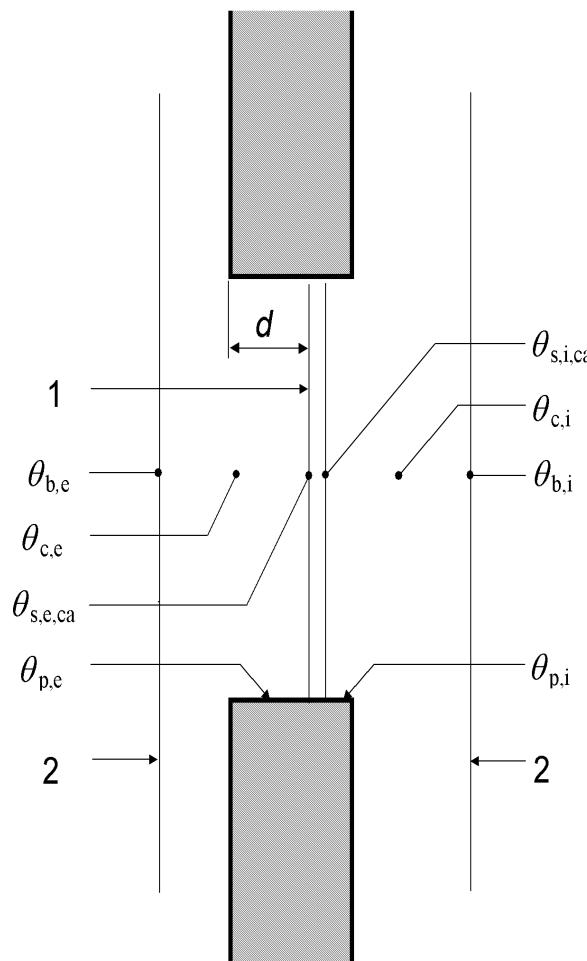
## Annex A (normative)

### Determination of environmental temperature

#### A.1 General

The procedure in EN ISO 12567-1:2000, annex A shall be applied, with the following modifications given in this annex.

In this annex the notations shown in Figure A.1 are used.



#### Key

- |                 |  |
|-----------------|--|
| 1               | Calibration panel or test specimen   |
| 2               | Baffle   |
| <sub>s,ca</sub> | Average surface temperature of the calibration panel, in °C                                |
| <sub>p</sub>    | Average surface temperature of the reveal of the surround panel (top, side, bottom), in °C |
| <sub>b</sub>    | Average surface temperature of the baffle, in °C   |
| <sub>c</sub>    | Average air temperature, in °C   |

**Figure A.1 — Notation used for the environmental temperature**

## A.2 Environmental temperature

The environmental temperature  $\theta_n$  is the weighting of the radiant temperature  $\theta_r$  and the air temperature  $\theta_c$ . Calculate the environmental temperature  $\theta_n$  in °C on both sides using Equation (A.1):

$$\theta_n = \frac{h_c \theta_c + h_r \theta_r}{h_c + h_r} \quad (\text{A.1})$$

where

- $h$  is the surface heat transfer coefficients, in  $\text{W}/(\text{m}^2 \times \text{K})$ ;
- $c$  is an index referring to mean air temperature;
- $r$  is an index referring to mean radiant temperature.

The convective fraction,  $F_c$  as explained in 6.2.3.2 shall be calculated from the calibration measurements as a function of the density of the heat flow rate  $q_{ca}$  (see example given in Figure C.3).

## A.3 Mean radiant temperature

The mean radiant temperature,  $\theta_r$  in °C, of the surfaces "seen" by the surface of the test specimen (calibration panel or window) shall be calculated using one of the following equations:

¾ if the depth  $d$  of the surround panel reveal is 50 mm, then Equation (A.2) is used:

$$\theta_r = \theta_b \quad (\text{A.2})$$

¾ if  $|b - p| < 5 \text{ K}$  then Equation (A.3) is used:

$$\theta_r = \frac{\alpha_{cb} \theta_b + \alpha_{cp} \theta_p}{\alpha_{cb} + \alpha_{cp}} \quad (\text{A.3})$$

¾ otherwise Equation (A.4) is used:

$$\theta_r = \frac{\alpha_{cb} h_{cb} \theta_b + \alpha_{cp} h_{cp} \theta_p}{\alpha_{cb} h_{cb} + \alpha_{cp} h_{cp}} \quad (\text{A.4})$$

The radiant heat transfer coefficient  $h_r$  in  $\text{W}/(\text{m}^2 \times \text{K})$ , is calculated using Equation (A.5):

$$h_r = \alpha_{cb} h_{cb} + \alpha_{cp} h_{cp} \quad (\text{A.5})$$

where  $h_{cb}$ ,  $h_{cp}$  are the black body radiant heat transfer coefficients calculated using Equations (A.6) and (A.7):

$$h_{cb} = (T_c^2 + T_b^2)(T_c + T_b) \quad (\text{A.6})$$

$$h_{cp} = (T_c^2 + T_p^2)(T_c + T_p) \quad (\text{A.7})$$

where

is the Stefan-Boltzmann constant,  $\sigma = 5,67 \times 10^{-8} \text{ W}/(\text{m}^2 \times \text{K}^4)$ ;

$\alpha_{cb}$ ,  $\alpha_{cp}$  are radiation factors from the baffle to the calibration panel and the surround panel reveals to the calibration panel calculated using Equations (A.8) and (A.9).

The values of  $h_{cb}$  and  $h_{cp}$  are calculated from the data set of the calibration panel and can be used for all specimens with the appropriate cold side temperature.

The radiation factors,  $f_{cb}$  and  $f_{cp}$ , are calculated ignoring second reflections, using Equations (A.8) and (A.9):

$$f_{cb} = \epsilon_c - \epsilon_b [f_{cb} + (1 - \epsilon_p) f_{cp} f_{pb}] \quad (\text{A.8})$$

$$f_{cp} = \epsilon_c - \epsilon_p [f_{cp} + (1 - \epsilon_b) f_{cb} f_{bp} + (1 - \epsilon_b) f_{cb} f_{pp}] \quad (\text{A.9})$$

where

$f$  is the view factor between two surfaces;

$\epsilon$  is the hemispherical emissivity.

The following subscripts indicate the direction of radiant heat exchange:

$cb$  from calibration panel to baffle;

$cp$  from calibration panel to surround panel reveal;

$pb$  from surround panel reveal to baffle;

$bp$  from baffle to surround panel reveal;

$pp$  from surround panel reveal to surround panel reveal.

View factors depending on the depth of surround panel reveal ' $d$ ' for the standardised test aperture are given in the Tables A.1 and A.2.

#### A.4 Convective surface heat transfer coefficient

The convective surface heat transfer coefficient,  $h_c$ , shall be calculated for the warm and cold side using Equation (A.10):

$$h_c = \frac{q_{ca} - h_r |\theta_r - \theta_{ca}|}{|\theta_c - \theta_{ca}|} \quad (\text{A.10})$$

where  $q_{ca}$  is the density of heat flow rate through the calibration panel, in  $\text{W/m}^2$ .

**Table A.1 — View factors for 1230 mm 1480 mm aperture**

	Reveal depth $d$ in mm				
	0	50	100	150	200
$f_{cb}$	1,0	0,930	0,867	0,809	0,756
$f_{pp}$	0,0	0,059	0,103	0,142	0,177
$f_{cp}=f_{bp}$ <sup>a</sup>	0,0	0,070	0,133	0,191	0,244
$f_{pb}$ <sup>b</sup>	0,5	0,471	0,449	0,429	0,412

<sup>a</sup>  $f_{cp}=f_{bp}=1-f_{cb}$  (A.11)

<sup>b</sup>  $f_{pb} = \frac{(1-f_{pp})}{2}$  (A.12)

**Table A.2 — View factors for 1200 1200 mm aperture**

	Reveal depth $d$ in mm				
	0	50	100	150	200
$f_{cb}$	1,0	0,922	0,853	0,790	0,733
$f_{pp}$	0,0	0,068	0,117	0,160	0,198
$f_{cp}=f_{bp}$ <sup>a</sup>	0,0	0,078	0,147	0,210	0,267
$f_{pb}$ <sup>b</sup>	0,5	0,466	0,442	0,420	0,401

<sup>a</sup>  $f_{cp}=f_{bp}=1-f_{cb}$  (A.11)

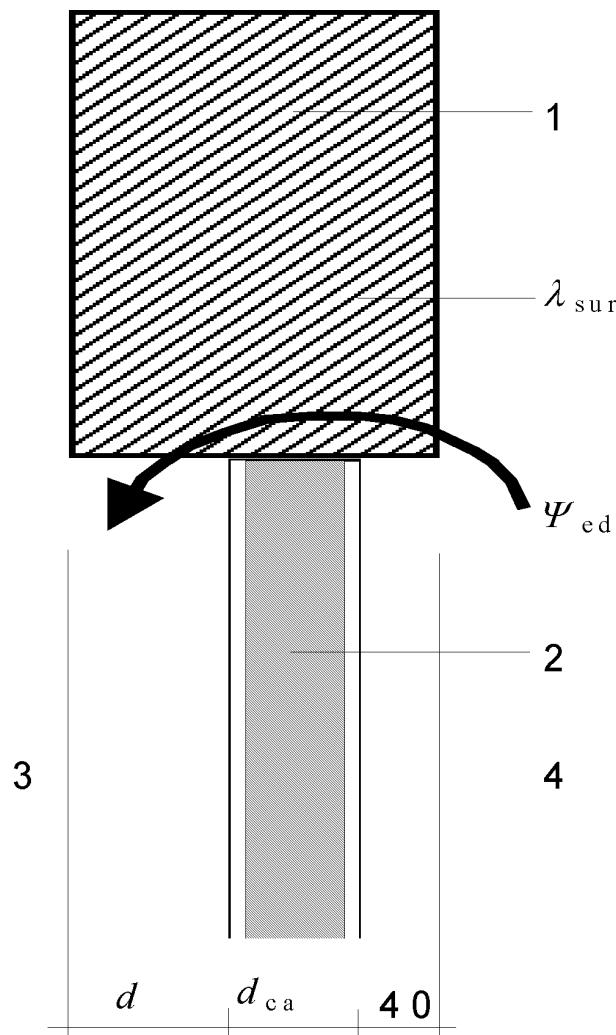
<sup>b</sup>  $f_{pb} = \frac{(1-f_{pp})}{2}$  (A.12)

For other geometries a detailed radiation heat exchange calculation procedure shall be used.

## Annex B (normative)

### Linear thermal transmittance of the edge zone

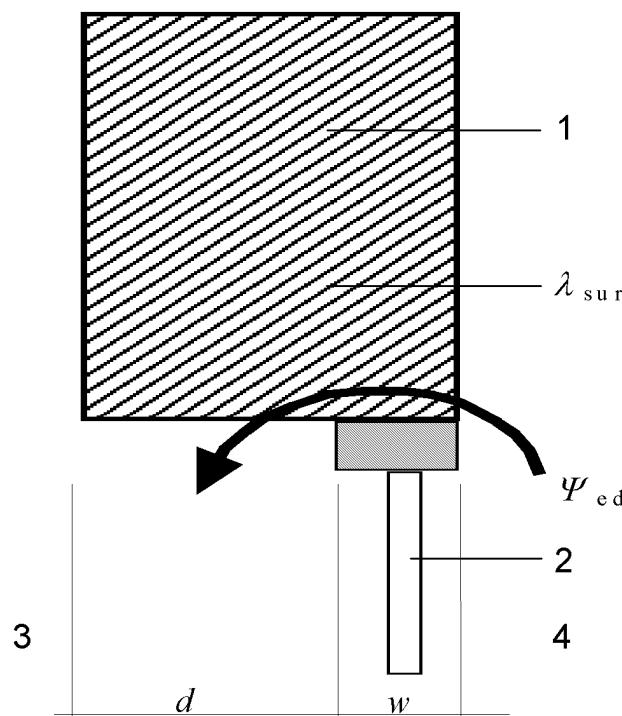
Dimensions in millimetres



#### Key

- 1 Surround panel
- 2 Calibration panel
- 3 Cold side
- 4 Warm side

**Figure B.1 — Glazed calibration panel with thickness  $d_{ca}$**

**Key**

- 1 Surround panel
- 2 Specimen
- 3 Cold side
- 4 Warm side

**Figure B.2 — Test specimen with frame width  $w$** **Table B.1 — Linear thermal transmittance for glazed calibration panel**

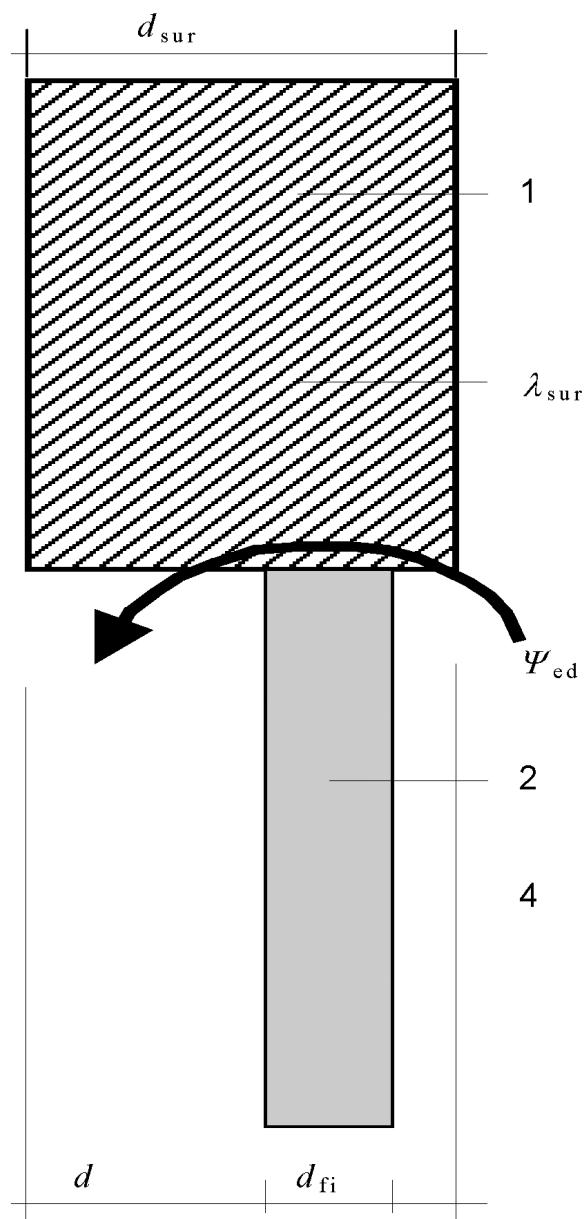
$d$	$\text{ed}$ for $d_{\text{ca}} = 20 \text{ mm}$ W/(m·K)			$\text{ed}$ for $d_{\text{ca}} = 60 \text{ mm}$ W/(m·K)			$\text{ed}$ for $d_{\text{ca}} = 100 \text{ mm}$ W/(m·K)		
	sur W/(m·K)	sur W/(m·K)	sur W/(m·K)	sur W/(m·K)	sur W/(m·K)	sur W/(m·K)	sur W/(m·K)	sur W/(m·K)	sur W/(m·K)
mm	0,030	0,035	0,040	0,030	0,035	0,040	0,030	0,035	0,040
0	0,0109	0,0125	0,0140	0,0044	0,0050	0,0057	0,0023	0,0027	0,0031
20	0,0085	0,0098	0,0110	0,0041	0,0048	0,0054	0,0024	0,0028	0,0032
40	0,0099	0,0113	0,0127	0,0050	0,0058	0,0065	0,0030	0,0035	0,0040
60	0,0118	0,0135	0,0152	0,0063	0,0072	0,0082	0,0039	0,0046	0,0052
80	0,0138	0,0159	0,0178	0,0077	0,0088	0,0100	0,0050	0,0057	0,0065
100	0,0157	0,0181	0,0204	0,0090	0,0104	0,0118	0,0060	0,0070	0,0079
120	0,0176	0,0202	0,0228	0,0104	0,0120	0,0136	0,0071	0,0082	0,0093
140	0,0193	0,0222	0,0250	0,0117	0,0135	0,0153	0,0081	0,0094	0,0107
160	0,0209	0,0240	0,0271	0,0130	0,0150	0,0170	0,0091	0,0106	0,0120
180	0,0223	0,0257	0,0287	0,0142	0,0164	0,0185	0,0101	0,0117	0,0133
200	0,0237	0,0273	0,0308	0,0153	0,0177	0,0200	0,0111	0,0128	0,0145

NOTE - values for intermediate  $d_{\text{ca}}$  and  $d$  values are obtained by linear interpolation.

Table B.2 — Linear thermal transmittance for test specimen

		ed W/(mK)					ed W/(mK)		
w mm	d mm	sur W/(mK)	sur W/(mK)	sur W/(mK)	w mm	d mm	sur W/(mK)	sur W/(mK)	sur W/(mK)
		0,030	0,035	0,040			0,030	0,035	0,040
40	60	0,0112	0,0126	0,0139	100	40	0,0029	0,0033	0,0036
	80	0,0142	0,0160	0,0177		80	0,0063	0,0071	0,0079
	120	0,0189	0,0214	0,0238		120	0,0093	0,0106	0,0118
	160	0,0230	0,0262	0,0292		160	0,0120	0,0138	0,0155
	200	0,0263	0,0299	0,0335		200	0,0144	0,0166	0,0186
50	50	0,0079	0,0088	0,0097	110	40	0,0026	0,0029	0,0032
	80	0,0119	0,0135	0,0150		80	0,0057	0,0064	0,0072
	120	0,0163	0,0185	0,0206		120	0,0085	0,0097	0,0109
	160	0,0201	0,0229	0,0256		160	0,0111	0,0127	0,0143
	200	0,0232	0,0265	0,0297		200	0,0134	0,0153	0,0173
60	40	0,0053	0,0059	0,0065	120	40	0,0023	0,0026	0,0028
	80	0,0103	0,0116	0,0129		80	0,0051	0,0058	0,0065
	120	0,0144	0,0164	0,0183		120	0,0078	0,0089	0,0100
	160	0,0178	0,0204	0,0228		160	0,0102	0,0117	0,0132
	200	0,0208	0,0238	0,0267		200	0,0124	0,0143	0,0161
70	30	0,0033	0,0036	0,0039	130	40	0,0021	0,0023	0,0026
	60	0,0068	0,0076	0,0084		80	0,0047	0,0053	0,0060
	120	0,0126	0,0144	0,0161		120	0,0072	0,0082	0,0092
	160	0,0160	0,0183	0,0205		160	0,0095	0,0109	0,0123
	200	0,0188	0,0215	0,0241		200	0,0116	0,0133	0,0150
80	20	0,0018	0,0020	0,0021	140	40	0,0019	0,0021	0,0023
	40	0,0038	0,0043	0,0047		80	0,0043	0,0049	0,0055
	80	0,0079	0,0089	0,0099		120	0,0067	0,0076	0,0086
	160	0,0113	0,0129	0,0185		160	0,0089	0,0102	0,0114
	200	0,0171	0,0196	0,0220		200	0,0108	0,0125	0,0140
90	10	0,0008	0,0009	0,0009	150	40	0,0017	0,0019	0,0021
	30	0,0024	0,0027	0,0029		80	0,0040	0,0045	0,0050
	60	0,0052	0,0059	0,0065		120	0,0062	0,0071	0,0079
	120	0,0102	0,0116	0,0130		160	0,0083	0,0095	0,0107
	200	0,0157	0,0180	0,0202		200	0,0102	0,0117	0,0132

NOTE: - values for intermediate  $w_{\text{sur}}$  can be obtained by linear interpolation.  
If  $w > 150 \text{ mm}$ , then  $w_{\text{ed}}$  is very small and can be neglected ( $w_{\text{ed}} = 0$ ).

**Key**

- 1 Surround panel
- 2 Infill insulation with thickness  $d_{\text{fi}}$
- 3 Cold side
- 4 Warm side

**Figure B.3 — Linear thermal transmittance of the edge zone**

**Table B.3 — Linear thermal transmittance for the infill insulation with conductivity values  $d_{fi}$  between 0,030 W/(m•K) to 0,035 W/(m•K)**

		ed for $d_{fi} = 20\text{mm}$ W/(m•K)			ed for $d_{fi} = 30\text{mm}$ W/(m•K)			ed for $d_{fi} = 40\text{mm}$ W/(m•K)				
$d$	$d_{sur}$	sur W/(m•K)	sur W/(m•K)	sur W/(m•K)	$d$	sur W/(m•K)	sur W/(m•K)	sur W/(m•K)	$d$	sur W/(m•K)	sur W/(m•K)	sur W/(m•K)
mm	mm	0,030	0,035	0,040	mm	0,030	0,035	0,040	mm	0,030	0,035	0,040
0	100	0,0185	0,0211	0,0235	0	0,0131	0,0150	0,0165	0	0,0092	0,0105	0,0118
		0,0106	0,0122	0,0137	20	0,0073	0,0083	0,0091	20	0,0049	0,0056	0,0063
		0,0090	0,0103	0,0115	40	0,0065	0,0075	0,0081	40	0,0050	0,0057	0,0065
		0,0111	0,0126	0,0142	60	0,0097	0,0111	0,0121	60	0,0096	0,0108	0,0121
		0,0193	0,0218	0,0242	70	0,0137	0,0155	0,0170				
0	120	0,0216	0,0246	0,0275	0	0,0161	0,0184	0,0203	0	0,0120	0,0138	0,0155
		0,0133	0,0152	0,0171	20	0,0097	0,0111	0,0123	20	0,0071	0,0081	0,0092
		0,0107	0,0123	0,0138	40	0,0079	0,0090	0,0099	40	0,0059	0,0067	0,0076
		0,0109	0,0125	0,0140	60	0,0087	0,0099	0,0109	60	0,0073	0,0084	0,0095
		0,0138	0,0158	0,0178	80	0,0125	0,0143	0,0158	80	0,0137	0,0142	0,0158
		0,0225	0,0255	0,0283	90	0,0167	0,0190	0,0210				
0	140	0,0242	0,0277	0,0309	0	0,0187	0,0213	0,0237	0	0,0145	0,0167	0,0187
		0,0157	0,0180	0,0202	20	0,0120	0,0138	0,0152	20	0,0092	0,0106	0,0119
		0,0126	0,0145	0,0162	40	0,0095	0,0110	0,0121	40	0,0073	0,0084	0,0095
		0,0118	0,0135	0,0152	60	0,0092	0,0106	0,0116	60	0,0074	0,0085	0,0096
		0,0129	0,0148	0,0166	80	0,0107	0,0123	0,0136	80	0,0095	0,0109	0,0123
		0,0163	0,0187	0,0210	100	0,0151	0,0173	0,0191	100	0,0151	0,0171	0,0192
		0,0252	0,0286	0,0319	110	0,0194	0,0221	0,0244				
0	160	0,0265	0,0303	0,0340	0	0,0209	0,0240	0,0267	0	0,0168	0,0192	0,0216
		0,0179	0,0205	0,0230	20	0,0141	0,0162	0,0179	20	0,0112	0,0129	0,0145
		0,0145	0,0165	0,0186	40	0,0113	0,0129	0,0143	40	0,0089	0,0102	0,0115
		0,0131	0,0150	0,0168	60	0,0103	0,0118	0,0130	60	0,0082	0,0094	0,0107
		0,0132	0,0151	0,0170	80	0,0107	0,0123	0,0136	80	0,0090	0,0104	0,0117
		0,0148	0,0170	0,0191	100	0,0127	0,0146	0,0162	100	0,0116	0,0133	0,0150
		0,0185	0,0213	0,0239	120	0,0173	0,0199	0,0221	120	0,0173	0,0198	0,0222
		0,0276	0,0314	0,0350	130	0,0217	0,0248	0,0275				
0	180	0,0286	0,0327	0,0367	0	0,0230	0,0264	0,0293	0	0,0188	0,0216	0,0243
		0,0198	0,0227	0,0256	20	0,0160	0,0184	0,0205	20	0,0130	0,0150	0,0169
		0,0162	0,0186	0,0209	40	0,0129	0,0149	0,0165	40	0,0104	0,0120	0,0135
		0,0145	0,0166	0,0187	60	0,0115	0,0132	0,0146	60	0,0093	0,0107	0,0121
		0,0140	0,0161	0,0180	80	0,0113	0,0130	0,0144	80	0,0094	0,0108	0,0122
		0,0147	0,0168	0,0189	100	0,0123	0,0141	0,0156	100	0,0106	0,0123	0,0138
		0,0166	0,0191	0,0215	120	0,0146	0,0168	0,0187	120	0,0135	0,0155	0,0175
		0,0206	0,0236	0,0266	140	0,0194	0,0223	0,0248	140	0,0194	0,0222	0,0249
		0,0297	0,0339	0,0378	150	0,0238	0,0272	0,0303				
		0	0,0305	0,0349	0,0391	0	0,0249	0,0285	0,0317	0	0,0206	0,0237
0	200	0,0216	0,0248	0,0279	20	0,0178	0,0204	0,0227	20	0,0147	0,0170	0,0191
		0,8750	0,0205	0,0230	40	0,0145	0,0167	0,0185	40	0,0119	0,0137	0,0155
		0,0159	0,0182	0,0204	60	0,0128	0,0147	0,0163	60	0,0105	0,0121	0,0136
		0,0153	0,0172	0,0193	80	0,0122	0,0140	0,0155	80	0,0101	0,0093	0,0131
		0,0151	0,0173	0,0194	100	0,0125	0,0144	0,0159	100	0,0106	0,0123	0,0138
		0,0161	0,0185	0,0208	120	0,0138	0,0159	0,0176	120	0,0122	0,0141	0,0159
		0,0183	0,0210	0,0237	140	0,0163	0,0188	0,0209	140	0,0152	0,0175	0,0198
		0,0224	0,0257	0,0290	160	0,0213	0,0244	0,0272	160	0,0213	0,0243	0,0273
		0,0316	0,0361	0,0403	170	0,0257	0,0294	0,0330				

(continued)

**Table B.3 (continued)**

0	220	0,0322	0,0369	0,0414	0	0,0266	0,0305	0,0340	0	0,0223	0,0256	0,0288
20		0,0233	0,0267	0,0301	20	0,0194	0,0223	0,0249	20	0,0163	0,0188	0,0212
40		0,0194	0,0223	0,0250	40	0,0160	0,0184	0,0205	40	0,0134	0,0154	0,0174
60		0,0172	0,0197	0,0222	60	0,0141	0,0162	0,0180	60	0,0117	0,0135	0,0152
80		0,0161	0,0185	0,0207	80	0,0132	0,0152	0,0168	80	0,0110	0,0127	0,0143
100		0,0158	0,0181	0,0203	100	0,0131	0,0150	0,0166	100	0,0111	0,0127	0,0144
120		0,0162	0,0186	0,0209	120	0,0137	0,0158	0,0175	120	0,0119	0,0137	0,0155
140		0,0175	0,0201	0,0226	140	0,0141	0,0175	0,0195	140	0,0137	0,0158	0,0178
160		0,0199	0,0229	0,0257	160	0,0179	0,0207	0,0230	160	0,0169	0,0194	0,0219
180		0,0241	0,0277	0,0312	180	0,0230	0,0264	0,0294	180	0,0230	0,0263	0,0296
200		0,0334	0,0381	0,0425	190	0,0275	0,0314	0,0350				
0	240	0,0338	0,0387	0,0434	0	0,0281	0,0323	0,0360	0	0,0238	0,0274	0,0309
20		0,0248	0,0285	0,0321	20	0,0209	0,0241	0,0268	20	0,0178	0,0205	0,0232
40		0,0208	0,0239	0,0269	40	0,0174	0,0200	0,0223	40	0,0147	0,0170	0,0191
60		0,0185	0,0213	0,0239	60	0,0154	0,0177	0,0196	60	0,0129	0,0149	0,0168
80		0,0172	0,0197	0,0222	80	0,0142	0,0164	0,0181	80	0,0120	0,0138	0,0156
100		0,0166	0,0191	0,0214	100	0,0138	0,0159	0,0176	100	0,0117	0,0135	0,0152
120		0,0167	0,0191	0,0215	120	0,0140	0,0161	0,0179	120	0,0121	0,0139	0,0157
140		0,0174	0,0199	0,0225	140	0,0149	0,0171	0,0190	140	0,0131	0,0151	0,0171
160		0,0188	0,0217	0,0244	160	0,0166	0,0183	0,0213	160	0,0151	0,0174	0,0196
180		0,0213	0,0245	0,0277	180	0,0194	0,0224	0,0250	180	0,0183	0,0211	0,0239
200	260	0,0256	0,0295	0,0332	200	0,0245	0,0282	0,0315	200	0,0245	0,0281	0,0316
220		0,0350	0,0399	0,0447	210	0,0290	0,0332	0,0371				
0		0,0352	0,0404	0,0453	0	0,0295	0,0339	0,0379	0	0,0253	0,0290	0,0327
20		0,0262	0,0301	0,0339	20	0,0223	0,0257	0,0287	20	0,0192	0,0221	0,0250
40	260	0,0221	0,0255	0,0287	40	0,0187	0,0215	0,0240	40	0,0160	0,0185	0,0209
60		0,0197	0,0227	0,0255	60	0,0166	0,0191	0,0212	60	0,0141	0,0162	0,0183
80		0,0183	0,0210	0,0236	80	0,0153	0,0176	0,0195	80	0,0130	0,0149	0,0169
100		0,0175	0,0201	0,0226	100	0,0146	0,0168	0,0187	100	0,0125	0,0143	0,0162
120		0,0173	0,0198	0,0223	120	0,0145	0,0167	0,0186	120	0,0125	0,0144	0,0163
140		0,0176	0,0202	0,0227	140	0,0150	0,0173	0,0192	140	0,0131	0,0151	0,0171
160		0,0185	0,0213	0,0239	160	0,0161	0,0185	0,0206	160	0,0143	0,0165	0,0187
180		0,0201	0,0231	0,0261	180	0,0179	0,0206	0,0230	180	0,0164	0,0189	0,0214
200		0,0227	0,0261	0,0295	200	0,0208	0,0240	0,0268	200	0,0197	0,0227	0,0257
220		0,0271	0,0311	0,0351	220	0,0259	0,0299	0,0334	220	0,0261	0,0299	0,0336
240		0,0364	0,0416	0,0467	230	0,0305	0,0349	0,0390				

(continued)

**Table B.3 (continued)**

0	280	0,0366	0,0419	0,0471	0	0,0309	0,0355	0,0397	0	0,0266	0,0306	0,0345
20		0,0275	0,0316	0,0357	20	0,0236	0,0271	0,0304	20	0,0205	0,0236	0,0267
40		0,0234	0,0269	0,0303	40	0,0199	0,0230	0,0257	40	0,0172	0,0199	0,0225
60		0,0209	0,0240	0,0271	60	0,0177	0,0204	0,0227	60	0,0152	0,0175	0,0201
80		0,0193	0,0222	0,0250	80	0,0163	0,0188	0,0209	80	0,0140	0,0161	0,0182
100		0,0184	0,0211	0,0238	100	0,0155	0,0178	0,0198	100	0,0133	0,0153	0,0173
120		0,0180	0,0207	0,0233	120	0,0152	0,0175	0,0194	120	0,0131	0,0151	0,0170
140		0,0180	0,0207	0,0233	140	0,0153	0,0177	0,0196	140	0,0134	0,0154	0,0174
160		0,0185	0,0213	0,0240	160	0,0160	0,0184	0,0205	160	0,0141	0,0163	0,0184
180		0,0196	0,0225	0,0254	180	0,0172	0,0198	0,0221	180	0,0155	0,0179	0,0202
200		0,0213	0,0245	0,0277	200	0,0191	0,0220	0,0246	200	0,0176	0,0203	0,0230
220		0,0240	0,0276	0,0311	220	0,0221	0,0255	0,0285	220	0,0210	0,0243	0,0274
240		0,0284	0,0327	0,0369	240	0,0273	0,0314	0,0351	240	0,0273	0,0314	0,0353
260		0,0378	0,0432	0,0485	250	0,0318	0,0365	0,0410				
0	300	0,0378	0,0433	0,0487	0	0,0321	0,0369	0,0413	0	0,0278	0,0320	0,0361
20		0,0287	0,0331	0,0373	20	0,0248	0,0285	0,0319	20	0,0217	0,0250	0,0282
40		0,0246	0,0283	0,0319	40	0,0211	0,0243	0,0272	40	0,0184	0,0212	0,0239
60		0,0221	0,0253	0,0285	60	0,0188	0,0217	0,0241	60	0,0163	0,0188	0,0212
80		0,0204	0,0234	0,0263	80	0,0173	0,0199	0,0222	80	0,0149	0,0172	0,0194
100		0,0193	0,0222	0,0250	100	0,0164	0,0188	0,0209	100	0,0141	0,0163	0,0184
120		0,0187	0,0215	0,0242	120	0,0159	0,0183	0,0203	120	0,0137	0,0158	0,0179
140		0,0186	0,0213	0,0240	140	0,0158	0,0182	0,0203	140	0,0138	0,0159	0,0179
160		0,0188	0,0216	0,0243	160	0,0162	0,0385	0,0207	160	0,0142	0,0164	0,0185
180		0,0195	0,0224	0,0252	180	0,0170	0,0195	0,0217	180	0,0151	0,0174	0,0197
200		0,0207	0,0237	0,0268	200	0,0183	0,0210	0,0235	200	0,0166	0,0191	0,0216
220		0,0225	0,0258	0,0291	220	0,0203	0,0233	0,0261	220	0,0188	0,0217	0,0245
240		0,0252	0,0290	0,0327	240	0,0233	0,0269	0,0275	240	0,0223	0,0257	0,0290
260		0,0296	0,0341	0,0385	260	0,0285	0,0329	0,0368	260	0,0286	0,0328	0,0369
280		0,0390	0,0447	0,0501	270	0,0331	0,0378	0,0425				

NOTE - values for intermediate  $\rho_{\text{sur}}$  can be obtained by linear interpolation.

## Annex C

(informative)

### **Example of calibration test and measurement of frame specimen**

#### **C.1 Calibration test with panel size 1,23 m 1,48 m**

Two calibration panels with total thermal resistance approximately  $0,3 \text{ m}^2\text{K/W}$  and  $1,4 \text{ m}^2\text{K/W}$  and total thickness 17 mm and 56 mm respectively are used. The panels are built with core material of expanded polystyrene and covered on both sides with 4 mm float glass according to EN ISO 12567-1:2000, annex C and have dimensions 1,23 m 1,48 m. The calibration panel has been installed in a surround panel made of polystyrene with a thickness of 220 mm.

The basic data for the polystyrene core and surround panel material have been measured in a hot plate apparatus according to ISO 8302, *Thermal insulation – Determination of steady-state thermal resistance and related properties – Guarded hot plate apparatus*. The measured data are:

$$\text{Panel 1 } (d = 17 \text{ mm}) \quad R_{ca} = 0,30009 - 0,00052245 \text{ me}$$

$$\text{Panel 2 } (d = 56 \text{ mm}) \quad R_{ca} = 1,490001 - 0,0081521 \text{ me}$$

$$\text{Surround panel } (d = 220 \text{ mm}) \quad R_{sur} = 0,0301625 + 0,0000525 \text{ me}$$

Where  $\text{me}$  is the mean temperature in  $^\circ\text{C}$ .

The calibration panel data are given in Table C.1.

**Table C.1 — Calibration panel**

Measured values			Panel 1			Panel 2		
$d_{ca}$	overall thickness	m	0,017			0,056		
$A_{ca}$	area of panel	$\text{m}^2$	1,82			1,82		
$A_{sur}$	area of surround panel	$\text{m}^2$	2,61			2,61		
$A_{t,hb}$	hot box metering area	$\text{m}^2$	4,43			4,43		
$L$	perimeter length	m	5,42			5,42		
Test number			2	1 <sup>a</sup>	3	4	5	6
Cold temperatures								
$\theta_{ce}$	air	$^\circ\text{C}$	- 3,92	0,96	9,94	- 7,28	2,01	7,86
$\theta_{se,b}$	baffle	$^\circ\text{C}$	- 3,67	1,05	9,97	- 7,24	2,04	7,85
$\theta_{se,ca}$	calibration panel	$^\circ\text{C}$	- 1,24	3,09	11,21	- 6,29	2,79	8,39
$\theta_{se,p}$	reveal panel	$^\circ\text{C}$	- 3,56	1,03	9,84	- 7,22	2,02	7,82
$\theta_{se,sur}$	surround panel	$^\circ\text{C}$	- 3,81	0,94	9,85	- 7,41	1,95	7,74
Warm temperatures								
$\theta_{ci}$	air	$^\circ\text{C}$	22,42	22,40	22,68	23,15	23,20	23,23
$\theta_{si,b}$	baffle	$^\circ\text{C}$	24,54	24,15	23,72	23,94	23,75	23,69
$\theta_{si,ca}$	calibration panel	$^\circ\text{C}$	16,30	17,31	19,46	20,68	21,45	21,90
$\theta_{si,p}$	reveal panel	$^\circ\text{C}$	20,49	20,54	21,60	21,77	21,82	22,17
$\theta_{si,sur}$	surround panel	$^\circ\text{C}$	20,72	21,03	21,71	22,03	22,40	22,43
$\Phi_{in}$	input power	W	120,11	97,34	57,45	46,55	32,95	24,17
$v_i$	air flow warm side, down	m/s	< 0,2	< 0,2	< 0,2	< 0,2	< 0,2	< 0,2
$v_e$	air flow cold side, down	m/s	~1,5	~1,5	~1,5	~1,5	~1,5	~1,5

<sup>a</sup> That test is used to fix the fan setting on the cold side.

Table C.2 — Linear thermal transmittance and view factors of the calibration panel

Values resulting from mounting instructions		Remarks	Panel 1	Panel 2
Total thickness of the calibration panel	mm		17	56
Total thickness of the surround panel	mm		220	220
Surround panel reveal depth – warm side	mm		40	40
Surround panel reveal depth – cold side	mm		163	~124
<sub>ed</sub> for $\lambda = 0,030 \text{ W}/(\text{m}\cdot\text{K})$	$\text{W}/(\text{m}\cdot\text{K})$	Table B.1	0,0211	0,0107
Warm side	view factors	$f_{\text{cbi}}$	Table A.2	0,944
		$f_{\text{ppi}}$	Table A.2	0,047
		$f_{\text{cp}}_i$	Equation (A.11)	0,056
		$f_{\text{bp}}_i$	Equation (A.11)	0,056
		$f_{\text{pb}}_i$	Equation (A.12)	0,476
	radiant factors	<sub>c</sub> bi	Equation (A.8)	0,750
		<sub>c</sub> pi	Equation (A.9)	0,049
Cold side	view factors	$f_{\text{cbe}}$	Table A.2	0,801
		$f_{\text{ppe}}$	Table A.2	0,147
		$f_{\text{cpe}}$	Equation (A.11)	0,199
		$f_{\text{bpe}}$	Equation (A.11)	0,199
	radiant factors	$f_{\text{pbe}}$	Equation (A.12)	0,426
		<sub>c</sub> be	Equation (A.8)	0,642
		<sub>c</sub> pe	Equation (A.9)	0,174
NOTE The radiant factors have been calculated with the following emissivities: $\epsilon_a = 0,84$ ; $\epsilon_p = 0,92$ , $\epsilon_b = 0,95$ .				

**Table C.3 — Calculation of surround panel thermal resistance  $R_{\text{sur}}$** 

<b>Data element</b>		<b>Remarks</b>	<b>Panel 2</b>		
$\Delta\theta_c$	K		30,43	21,19	15,37
$\Delta\theta_{s,\text{sur}}$	K		29,44	20,45	14,69
$\theta_{\text{me,sur}}$	°C		7,31	12,18	15,09
in	W		46,55	32,95	24,17
ca	W	Equation (9)	34,31	24,41	18,00
ed	W	Equation (10)	1,76	1,23	0,89
in - ca - ed	W		10,48	7,31	5,28
$R_{\text{sur}}$	$\text{m}^2 \cdot \text{K/W}$	Equation (8)	7,33	7,30	7,26
<b>Optional check with data of hot plate measurement</b>					
$\theta_{\text{me,sur}}$	°C		7,31	12,18	15,09
$\lambda_{\text{sur}}$	$\text{W}/(\text{m} \cdot \text{K})$	linear regression	0,0305	0,0308	0,0310
$R_{\text{sur}}$	$\text{m}^2 \cdot \text{K/W}$	$d/\lambda_{\text{sur}}$	7,21	7,14	7,10
$\Delta R_{\text{sur}}/R_{\text{sur}}$	%	relative difference	-1,8	-2,2	-2,2

**Table C.4 — Calculation of surface resistance and convective fraction  $F_c$** 

Data element		Remarks	Panel 1			Panel 2		
$\theta_{me,ca}$	°C		7,53	10,20	15,33	7,20	12,12	15,15
$\Delta\theta_{s,ca}$	K		17,54	14,22	8,25	26,97	18,66	13,51
$R_{ca}$	$m^2 \cdot K/W$	Equation (3)	0,296	0,295	0,292	1,431	1,392	1,366
$q_{ca}$	$W/m^2$	Equation (2)	59,26	48,20	28,25	18,85	13,41	9,89
$h_{cb,i}$	$W/(m^2 \cdot K)$	Equation (A.6)	5,739	5,757	5,807	5,850	5,867	5,879
$h_{cb,e}$	$W/(m^2 \cdot K)$	Equation (A.6)	4,499	4,728	5,181	4,287	4,746	5,047
$h_{cp,i}$	$W/(m^2 \cdot K)$	Equation (A.7)	5,621	5,651	5,745	5,785	5,810	5,834
$h_{cp,e}$	$W/(m^2 \cdot K)$	Equation (A.7)	4,502	4,728	5,177	4,288	4,745	5,046
$h_{r,i}$	$W/(m^2 \cdot K)$	Equation (A.5)	4,589	4,604	4,646	4,680	4,694	4,704
$h_{r,e}$	$W/(m^2 \cdot K)$	Equation (A.5)	3,628	3,813	4,177	3,450	3,819	4,061
$\theta_{r,i}$	°C	Equation (A.3)	- 24,54	24,15	23,72	23,94	23,75	23,69
$\theta_{r,e}$	°C	Equation (A.2)	- 3,65	1,05	9,95	-7,24	2,03	7,84
$h_{c,i}$	$W/(m^2 \cdot K)$	Equation (A.10)	3,17	2,91	2,21	1,69	1,45	0,91
$h_{c,e}$	$W/(m^2 \cdot K)$	Equation (A.10)	18,05	18,02	17,10	16,28	13,32	14,05
$F_{c,i}$	-	Equation (6)	0,408	0,387	0,322	0,265	0,236	0,161
$F_{c,e}$	-	Equation (6)	0,833	0,825	0,804	0,825	0,777	0,776
$\theta_{ni,ca}$	°C	Equation (7)	23,67	23,47	23,38	23,94	23,62	23,62
$\theta_{ne,ca}$	°C	Equation (7)	- 3,88	0,97	9,94	-7,27	2,01	7,85
$\Delta\theta_{n,ca}$	K		27,55	22,50	13,44	31,21	21,61	15,17
$R_{si}$	$m^2 \cdot K/W$	Equation (4)	0,129	0,133	0,146	0,157	0,163	0,178
$R_{se}$	$m^2 \cdot K/W$	Equation (5)	0,046	0,046	0,047	0,051	0,058	0,055
$R_{s,t}$	$m^2 \cdot K/W$	Equation (1)	0,175	0,179	0,193	0,208	0,221	0,234

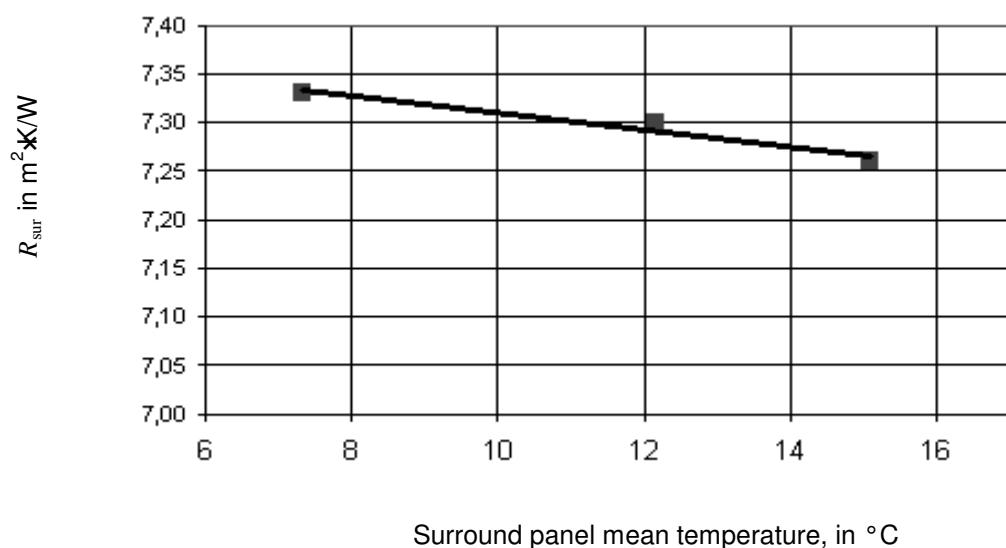
The results from the calibration measurements are plotted in Figures C.1, C.2 and C.3. The following regression curves have been derived by least-square fits from the data set:

$$\text{thermal resistance of the surround panel: } R_{sur} = 7,3970 - 0,0087 \theta_{me,sur}$$

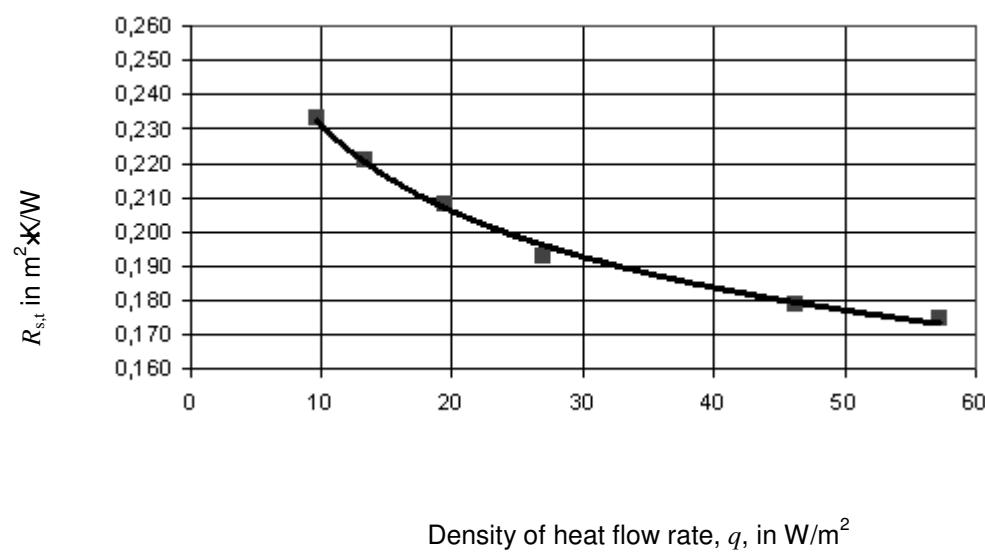
$$\text{convective fraction: } F_{c,i} = 0,1626 + 0,0047 q_{sp}$$

$$F_{c,e} = 0,7738 + 0,0011 q_{sp}$$

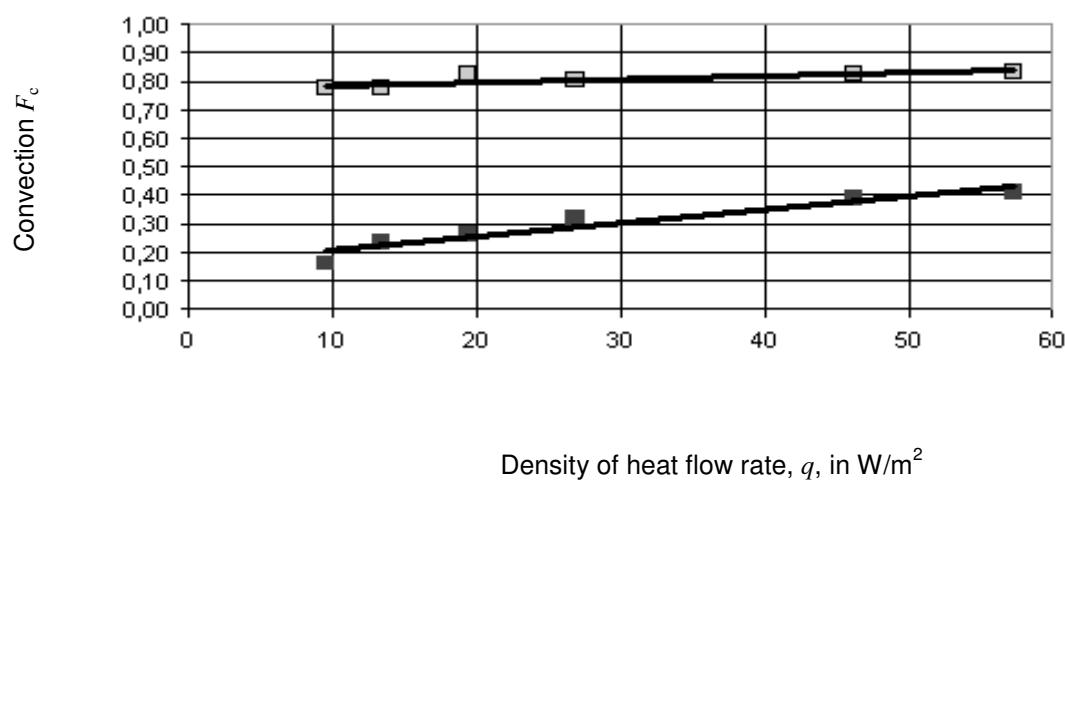
$$\text{Total surface resistance } R_{s,t} = 0,3378 q_{sp}^{-0,16}$$



**Figure C.1 — Thermal resistance of the surround panel**



**Figure C.2 — Total surface resistance**

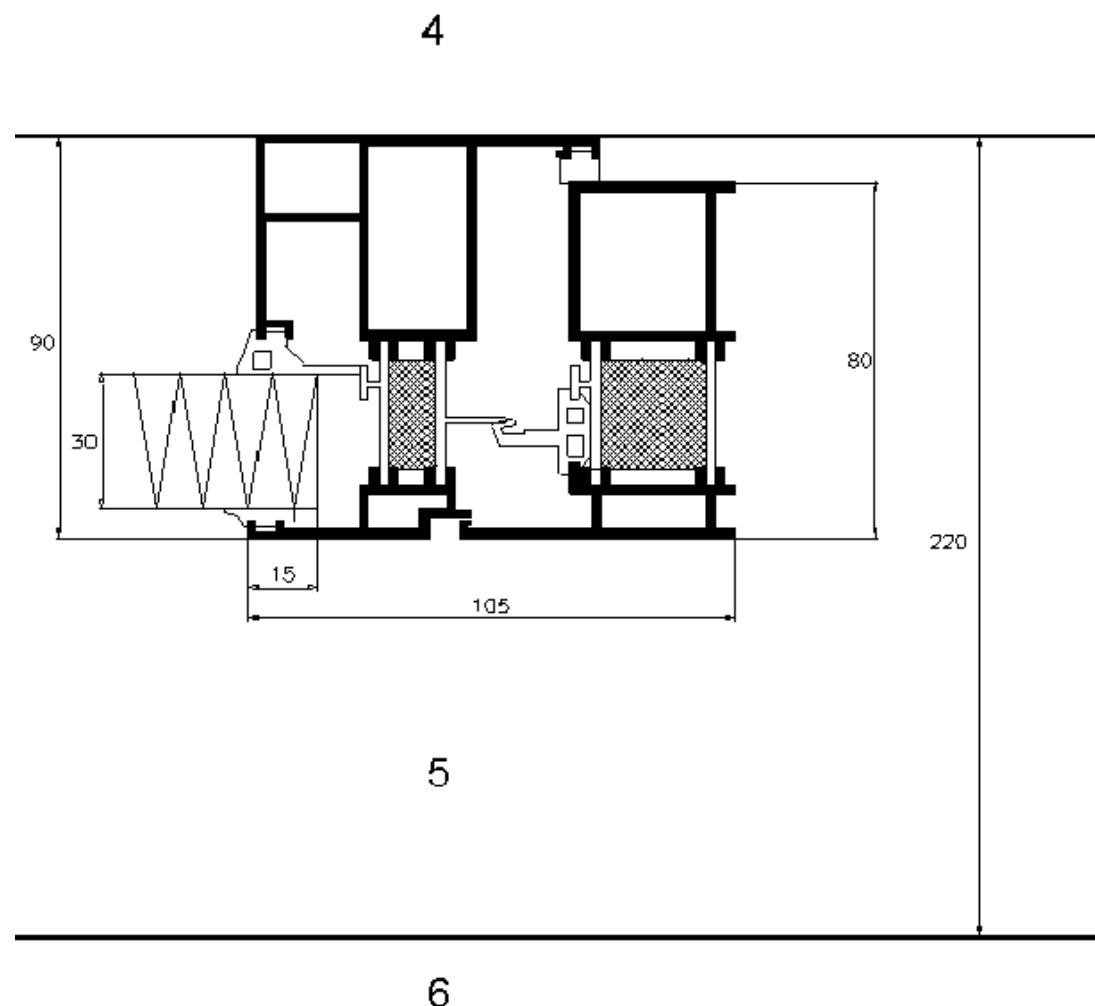
**Figure C.3 — Convective fractions cold side and warm side**

## C.2 Frame specimen measurement

### Description of the specimen

Tested object:	thermally broken metal profile	
Thermal break:	polyamide glass fibre reinforced	
Number of identical test specimens:	4	
Height of each test specimen:	1480 mm	
Width of each specimen:	on the warm side	104 mm
	on the cold side	105 mm
Total thickness of each specimen:	90 mm	
Projected frame area	$0,6216 \text{ m}^2$	
Developed frame area:	on the warm side:	$0,9886 \text{ m}^2$
	on the cold side:	$0,6808 \text{ m}^2$
Seals:	2 lip seals of EPDM	

Dimensions in millimetres

**Key**

- 1 Insulating material
- 2 Thermal break
- 3 Filling panel,  $\lambda = 0,0302 \text{ W}/(\text{m}\cdot\text{K})$
- 4 Warm side
- 5 Surround panel
- 6 Cold side

**Figure C.4 — Cross section of the specimen**

## Results of test specimen measurements

The quantities used for the determination of the *U*-value are listed below:

Areas: area of hot box aperture	$A_{t, hb} = 2,08 \text{ m} \quad 2,13 \text{ m}$	=	$4,43 \text{ m}^2$
area of calibration panel aperture	$A_{ca} = 1,23 \text{ m} \quad 1,48 \text{ m}$	=	$1,82 \text{ m}^2$
in this case, $A_{ca}$ corresponds to $A_t$			
projected frame area	$A_f = 4 \quad 1,48 \text{ m} \quad 0,105 \text{ m}$	=	$0,6216 \text{ m}^2$
infill insulation area	$A_{fi} = A - A_f$	=	$1,198 \text{ m}^2$
perimeter length	$L_{ed} =$		$5,42 \text{ m}$

Hemispherical emissivities:

baffle	$\epsilon_b = 0,89$
sample	$\epsilon_{sp} = 0,89$
calibration panel	$\epsilon_{ca} = 0,89$
surround panel	$\epsilon_{sur} = 0,89$

Infill insulation data:

$$\text{thickness} \quad d_{fi} = 30,0 \text{ mm}$$

## Sequence of calculations to determine the *U*-value (see Tables C.5 to C.7):

$q_t$	= 26,73 W/m <sup>2</sup>	from measurement	
$F_{c,i}(q_{ca})$	= 0,288	linear regression of calibration panel data	(see Figure C.3)
$F_{c,e}(q_{ca})$	= 0,803	linear regression of calibration panel data	(see Figure C.3)
$c_{,i}$	= 22,46 °C	$r_{,i} = b_{,i} = 23,10 \text{ }^\circ\text{C}$	
$c_{,e}$	= 1,08 °C	$r_{,e} = b_{,e} = 1,03 \text{ }^\circ\text{C}$	
$n_i$	= $F_{c,i} \times c_{,i} + (1 - F_{c,i}) r_{,i}$		
	= 0,288 · 22,46 + (1 - 0,288) · 23,10	= 22,92 °C	(7)
$n_e$	= $F_{c,e} \times c_{,e} + (1 - F_{c,e}) r_{,e}$		
	= 0,803 · 1,08 + (1 - 0,803) · 1,03	= 1,07 °C	(7)

$$R_{s,t}(q_t) = 0,200 \text{ m}^2 \text{K/W}$$

$$R_{sur} = \frac{A_{sur} \Delta_{s,sur}}{\text{in} \quad \text{ca} \quad \text{ed}} = \frac{2,61 \quad 20,09}{97,34 \quad 87,74 \quad 2,42} = 7,30 \text{ m}^2 \text{K/W} \quad (8)$$

$$ca \quad = A_{ca} q_{ca} = 1,82 \cdot 48,20 = 87,74 \text{ W} \quad (9)$$

### Measurement procedure for specimen

$$\text{ed} = L_{\text{ed}} \quad \text{ed} \quad \text{c} \quad = 5,42 \quad 0,0140 \quad 21,38 = 1,62 \quad (10)$$

$$q_t = \frac{\Phi_{\text{in}} \quad \Phi_{\text{sur}} \quad \Phi_{\text{ed}}}{A_t} = \frac{57,57 \quad 7,29 \quad 1,62}{1,23 \quad 1,48} = 26,73 \text{ W/m}^2 \quad (11)$$

$$\text{sur} = \frac{A_{\text{sur}} \Delta_{\text{s,sur}}}{R_{\text{sur}}} = \frac{2,61 \quad 20,39}{7,30} = 7,29 \text{ W} \quad (12)$$

$$U_{\text{m,t}} = \frac{q_t}{\Delta_n} = \frac{26,73}{21,85} = 1,22 \text{ W/m}^2\text{K} \quad (13)$$

$$U_f = \frac{U_{\text{m,t}} A_t \Delta\theta_n}{A_f \Delta\theta_n} = \frac{1,22 \quad 1,82 \quad 21,85 \quad 1,01 \quad 15,82 \quad 1,198}{0,6216 \quad 21,85} = 2,16 \text{ W/(m}^2\text{K)} \quad (14)$$

**Table C.5 — Frame data**

Data element	Value
w Frame width	in m 0,105
d <sub>sur</sub> Surround panel thickness	in m 0,220
A <sub>sp</sub> Area of frame	in m <sup>2</sup> 0,6216
A <sub>sur</sub> Area of surround panel	in m <sup>2</sup> 2,61
L Perimeter length	in m 5,42

**Table C.6 — Frame measurement results**

Data element	Value
Cold temperatures - measured	
ce (air)	in °C 1,08
se,b (baffle)	in °C 1,03
se,sur (surround panel)	in °C 1,27
Warm temperatures - measured	
ci (air)	in °C 22,46
si,b (baffle)	in °C 23,10
si,sur (surround panel)	in °C 21,66
i <sub>in</sub> (input power in hot box)	in W 57,57
v <sub>i</sub> (air flow warm, down)	in m/s < 0,2
v <sub>e</sub> (air flow cold, up)	in m/s ~1,5

**Table C.7 — Calculation of the thermal transmittance of the frame**

<b>Data element</b>		<b>Value</b>	<b>Remarks</b>
$m_{e,sur}$ (mean temp. of surround panel)	in °C	11,77	
$R_{sur}$ (surround panel resistance)	in $\text{m}^2\text{K/W}$	7,30	Figure C.1 / regression and Equation 8
$\lambda_{sur}$ (conductivity of surround panel)	in $\text{W}/(\text{m}\text{K})$	0,030	
$\epsilon_{ed}$ for infill insulation 30 mm	in $\text{W}/(\text{m}\text{K})$	0,0140	Table B.3
$\Delta_{s,sur}$ (temp. difference of surround panel)	in K	20,39	
$\Delta_c$ (air temp. difference)	in K	21,38	
$P_{in}$ (input power in hot box)	in W	57,57	
$P_{sur}$ (surround panel heat flow)	in W	7,29	Equation (12)
$P_{ed}$ (edge zone heat flow)	in W	1,62	Equation (10)
$q_t$ (heat flow rate through infill insulation and frame)	in $\text{W}/\text{m}^2$	26,73	Equation (11)
$U_{m,t}$ (measured thermal transmittance of the infill insulation and frame)	in $\text{W}/(\text{m}^2\text{K})$	1,22	Equation (13)
$F_{ci}$ (convective fraction - warm)		0,288	Figure C.3 / regression
$F_{ce}$ (convective fraction - cold)		0,803	Figure C.3 / regression
$R_{s,t}$ (total surface resistance)	in $\text{m}^2\text{K/W}$	0,200	Figure C.2 / regression
$\theta_{ri}$ (radiant temp.- warm)	in °C	23,10	Equation (A.2) to (A.4)
$\theta_{re}$ (radiant temp.- cold)	in °C	1,03	Equation (A.2) to (A.4)
$\theta_{ni}$ (environmental temp.- hot)	in °C	22,92	Equation (7)
$\theta_{ne}$ (environmental temp. - cold)	in °C	1,07	Equation (7)
$\Delta_n$ (environmental temp. difference)	in K	21,85	
$U_f$ (measured)	in $\text{W}/(\text{m}^2\text{K})$	2,16	Equation (14)
$U_f$ (uncertainty of the measurement)	in $\text{W}/(\text{m}^2\text{K})$	0,05	



## **BSI — British Standards Institution**

BSI is the independent national body responsible for preparing British Standards. It presents the UK view on standards in Europe and at the international level. It is incorporated by Royal Charter.

### **Rewards**

British Standards are updated by amendment or revision. Users of British Standards should make sure that they possess the latest amendments or editions.

It is the constant aim of BSI to improve the quality of our products and services. We would be grateful if anyone finding an inaccuracy or ambiguity while using this British Standard would inform the Secretary of the technical committee responsible, the identity of which can be found on the inside front cover.  
Tel: +44 (0)20 8996 9000. Fax: +44 (0)20 8996 7400.

BSI offers members an individual updating service called PLUS which ensures that subscribers automatically receive the latest editions of standards.

### **Buying standards**

Orders for all BSI, international and foreign standards publications should be addressed to Customer Services. Tel: +44 (0)20 8996 9001.  
Fax: +44 (0)20 8996 7001. Email: [orders@bsi-global.com](mailto:orders@bsi-global.com). Standards are also available from the BSI website at <http://www.bsi-global.com>.

In response to orders for international standards, it is BSI policy to supply the BSI implementation of those that have been published as British Standards, unless otherwise requested.

### **Information on standards**

BSI provides a wide range of information on national, European and international standards through its Library and its Technical Help to Exporters Service. Various BSI electronic information services are also available which give details on all its products and services. Contact the Information Centre.  
Tel: +44 (0)20 8996 7111. Fax: +44 (0)20 8996 7048. Email: [info@bsi-global.com](mailto:info@bsi-global.com).

Subscribing members of BSI are kept up to date with standards developments and receive substantial discounts on the purchase price of standards. For details of these and other benefits contact Membership Administration.  
Tel: +44 (0)20 8996 7002. Fax: +44 (0)20 8996 7001.  
Email: [membership@bsi-global.com](mailto:membership@bsi-global.com).

Information regarding online access to British Standards via British Standards Online can be found at <http://www.bsi-global.com/bsonline>.

Further information about BSI is available on the BSI website at <http://www.bsi-global.com>.

### **Copyright**

Copyright subsists in all BSI publications. BSI also holds the copyright, in the UK, of the publications of the international standardization bodies. Except as permitted under the Copyright, Designs and Patents Act 1988 no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means – electronic, photocopying, recording or otherwise – without prior written permission from BSI.

This does not preclude the free use, in the course of implementing the standard, of necessary details such as symbols, and size, type or grade designations. If these details are to be used for any other purpose than implementation then the prior written permission of BSI must be obtained.

Details and advice can be obtained from the Copyright & Licensing Manager.  
Tel: +44 (0)20 8996 7070. Fax: +44 (0)20 8996 7553.  
Email: [copyright@bsi-global.com](mailto:copyright@bsi-global.com).