

BS EN 12464-2:2014



BSI Standards Publication

# Light and lighting — Lighting of work places

Part 2: Outdoor work places

**bsi.**

...making excellence a habit.™

**National foreword**

This British Standard is the UK implementation of EN 12464-2:2014. It supersedes BS EN 12464-2:2007 which is withdrawn.

The UK participation in its preparation was entrusted to Technical Committee EL/1, Light and lighting applications.

A list of organizations represented on this committee can be obtained on request to its secretary.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

© The British Standards Institution 2014.  
Published by BSI Standards Limited 2014

ISBN 978 0 580 82655 9  
ICS 91.160.20

**Compliance with a British Standard cannot confer immunity from legal obligations.**

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 31 January 2014.

**Amendments/corrigenda issued since publication**

Date	Text affected
------	---------------

---

English Version

## Light and lighting - Lighting of work places - Part 2: Outdoor work places

Lumière et éclairage - Éclairage des lieux de travail - Partie  
2: Lieux de travail extérieurs

Licht und Beleuchtung - Beleuchtung von Arbeitsstätten -  
Teil 2: Arbeitsplätze im Freien

This European Standard was approved by CEN on 7 December 2013.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION  
COMITÉ EUROPÉEN DE NORMALISATION  
EUROPÄISCHES KOMITEE FÜR NORMUNG

**CEN-CENELEC Management Centre: Avenue Marnix 17, B-1000 Brussels**

## Contents

Page

Foreword.....	3
Introduction .....	4
1 Scope .....	5
2 Normative references .....	5
3 Terms and definitions .....	5
4 Lighting design criteria .....	5
4.1 Luminous environment .....	5
4.2 Luminance distribution .....	6
4.3 Illuminance .....	6
4.3.1 General.....	6
4.3.2 Illuminance on the task area.....	6
4.3.3 Illuminance of surroundings .....	7
4.3.4 Illuminance grid .....	8
4.3.5 Uniformity and diversity.....	8
4.4 Glare .....	9
4.4.1 General.....	9
4.4.2 Glare rating.....	9
4.4.3 Veiling reflections and reflected glare.....	10
4.5 Obtrusive light.....	10
4.6 Directional lighting .....	11
4.6.1 General.....	11
4.6.2 Modelling .....	11
4.6.3 Directional lighting of visual tasks .....	11
4.7 Colour aspects .....	11
4.7.1 General.....	11
4.7.2 Colour appearance .....	12
4.7.3 Colour rendering.....	12
4.8 Flicker and stroboscopic effects.....	12
4.9 Maintenance factor ( <i>MF</i> ) .....	12
4.10 Energy considerations .....	13
4.11 Sustainability.....	13
5 Schedule of lighting requirements.....	13
5.1 General.....	13
5.2 Composition of the Tables 5.1 to 5.15 below .....	14
5.3 The schedule of areas, tasks and activities .....	14
5.4 Lighting requirements for areas, tasks and activities .....	15
6 Verification procedures.....	21
6.1 General.....	21
6.2 Illuminance .....	21
6.3 Glare Rating.....	21
6.4 Colour Rendering Index and colour appearance .....	21
6.5 Obtrusive light.....	21
6.6 Maintenance schedule .....	21
Annex A (informative) A–deviations .....	22
Bibliography .....	23
Index of areas, tasks and activities.....	24

## Foreword

This document (EN 12464-2:2014) has been prepared by Technical Committee CEN/TC 169 "Light and lighting", the secretariat of which is held by DIN.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by July 2014, and conflicting national standards shall be withdrawn at the latest by July 2014.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN [and/or CENELEC] shall not be held responsible for identifying any or all such patent rights.

This document supersedes EN 12464-2:2007.

Significant changes between this document and EN 12464-2:2007 are:

- a) the terms and definitions were deleted to avoid duplication with EN 12665;
- b) symbols were aligned with EN 12665;
- c) Figure 1 was corrected;
- d) 4.4.2 "Glare rating", the reflectance has a default value of  $\rho = 0,15$ ;
- e) 4.7.3 "colour rendering", aligned with EN 12464-1;
- f) 4.10 "energy considerations", aligned with EN 12464-1 and extended;
- g) subclause 5.1, insertion of requirements regarding routine cleaning of work spaces;
- h) Table 5.1 "General requirements for areas and for cleaning at outdoor work places", title changed and new activity added;
- i) Table 5.12 "Railways and tramways", updated and extended;
- j) Clause 6 "Verification procedures", revised and harmonized with EN 12464-1.

EN 12464, *Light and lighting - Lighting of work places* consists of the following parts:

- *Part 1: Indoor work places*
- *Part 2: Outdoor work places*

According to the CEN-CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.

## **Introduction**

To enable people to perform outdoor visual tasks efficiently and accurately, especially during the night, adequate and appropriate lighting should be provided.

The degree of visibility and comfort required in a wide range of outdoor work places is governed by the type and duration of activity.

This standard specifies requirements for lighting of tasks in most outdoor work places and their associated areas in terms of quantity and quality of illumination. In addition recommendations are given for good lighting practice.

It is important that all clauses of the standard are followed although the specific requirements are tabulated in the schedule of lighting requirements (see Clause 5).

## 1 Scope

This European Standard specifies lighting requirements for outdoor work places, which meet the needs for visual comfort and performance. All usual visual tasks are considered. This European Standard is not applicable for emergency lighting; see EN 1838 and EN 13032-3.

This European Standard does not specify lighting requirements with respect to the safety and health of workers at work and has not been prepared in the field of application of Article 153 of the EC treaty, although the lighting requirements, as specified in this standard, usually fulfil safety needs. Lighting requirements with respect to the safety and health of workers at work may be contained in Directives based on Article 153 of the EC treaty, in national legislation of member states implementing these directives or in other national legislation of member states.

This European Standard neither provides specific solutions, nor restricts the designer's freedom from exploring new techniques nor restricts the use of innovative equipment.

## 2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 12665:2011, *Light and lighting - Basic terms and criteria for specifying lighting requirements*

EN 13201-2, *Road lighting - Part 2: Performance requirements*

EN 13201-3, *Road lighting - Part 3: Calculation of performance*

ISO 3864-1, *Graphical symbols - Safety colours and safety signs - Part 1: Design principles for safety signs and safety markings*

## 3 Terms and definitions

For the purposes of this document, the terms and definitions given in EN 12665:2011 apply.

## 4 Lighting design criteria

### 4.1 Luminous environment

For good lighting practice it is essential that, in addition to the required illuminance, other qualitative and quantitative needs are satisfied.

Lighting requirements are determined by the satisfaction of three basic human needs:

- visual comfort, where the workers have a feeling of well-being; in an indirect way also contributing to a high productivity level,
- visual performance, where the workers are able to perform their visual tasks, even under difficult circumstances and during longer periods,
- safety.

Main parameters determining the luminous environment are:

- luminance distribution,

- illuminance,
- glare,
- directionality of light,
- colour rendering and colour appearance of the light,
- flicker.

Values for illuminance and its uniformity, discomfort glare and colour rendering index are given in Clause 5; other parameters are described in Clause 4.

**NOTE** Intentionally improved and designed luminous environment, glare-free illumination, good colour rendering, high contrast markings and optical and tactile guiding systems can improve visibility and sense of direction and locality. See CIE 196:2011.

In addition to the lighting, there are other visual ergonomic parameters which influence visual performance, such as:

- the intrinsic task properties (size, shape, position, colour and reflectance properties of detail and background),
- ophthalmic capacity of the person (visual acuity, depth perception, colour perception),

Attention to these factors can enhance visual performance without the need for higher illuminance.

## **4.2 Luminance distribution**

The luminance distribution in the visual field controls the adaptation level of the eyes, which affects task visibility.

A well balanced luminance distribution is needed to increase:

- visual acuity (sharpness of vision),
- contrast sensitivity (discrimination of small relative luminance differences),
- efficiency of the ocular functions (such as accommodation, convergence, pupillary contraction, eye movements).

The luminance distribution in the visual field also affects visual comfort. Sudden changes in luminance should be avoided.

## **4.3 Illuminance**

### **4.3.1 General**

The illuminance and its distribution on the task area and the surrounding area have a great impact on how quickly, safely and comfortably a person perceives and carries out the visual task.

All values of illuminances specified in this standard are maintained illuminances and will provide for visual comfort, visual performance and safety needs.

All illuminance average and uniformity values are dependent upon the grid definition (see 4.3.4).

### **4.3.2 Illuminance on the task area**

The values given in Clause 5 are maintained illuminances over the task area on the reference surface, which may be horizontal, vertical or inclined. The average illuminance for each task shall not fall below the value given in Clause 5, regardless of the age and condition of the installation.



The values are valid for normal visual conditions and take into account the following factors:

- psycho-physiological aspects such as visual comfort and well-being,
- requirements for visual tasks,
- visual ergonomics,
- practical experience,
- safety,
- economy.

The value of illuminance may be adjusted by at least one step in the scale of illuminances (see below), if the visual conditions differ from the normal assumptions.

A factor of approximately 1,5 represents the smallest significant difference in subjective effect of illuminance. The recommended scale of illuminance (in lx) is:

5 – 10 – 15 – 20 – 30 – 50 – 75 – 100 – 150 – 200 – 300 – 500 – 750 – 1 000 – 1 500 – 2 000

The required maintained illuminance should be increased, when:

- visual work is critical,
- visual task or worker is moving,
- errors are costly to rectify,
- accuracy or higher productivity is of great importance,
- the visual capacity of the worker is below normal,
- task details are of unusually small size or low contrast,
- the task is undertaken for an unusually long time.

The required maintained illuminance may be decreased when:

- task details are of an unusually large size or high contrast,
- the task is undertaken for an unusually short time or on only rare occasions.

#### **4.3.3 Illuminance of surroundings**

The illuminance of surrounding areas shall be related to the illuminance of the task area and should provide a well-balanced luminance distribution in the visual field.

Large spatial variations in illuminances around the task area may lead to visual stress and discomfort.

The illuminance of the surrounding areas may be lower than the task illuminance but shall be not less than the values given in Table 1.

The surrounding area should be a band with a width of at least 2 m around the task area within the visual field.

**Table 1 — Relationship of illuminances of surrounding areas to task area**

Task illuminance lx	Illuminance of surrounding areas lx
≥ 500	100
300	75
200	50
150	30
$50 \leq \bar{E}_m \leq 100$	20
< 50	no specification

In addition to the task illuminance the lighting shall provide adequate adaptation luminance in accordance with 4.2.

#### 4.3.4 Illuminance grid

A grid system shall be created for the task and surrounding areas to indicate the points at which the illuminance values are calculated and verified.

Grids approximating a square are preferred, the ratio of length to width of a grid cell shall be kept between 0,5 and 2 (see also EN 12193). The maximum grid size shall be:

$$p = 0,2 \times 5^{\log_{10} d} \quad (1)$$

where

$d$  is the longer dimension of the area, in m, if the ratio of the longer to the shorter side is less than 2, otherwise  $d$  is the shorter dimension of the area; and

$p$  is the maximum grid cell size in m.

The value of  $p$  should be that  $p \leq 10$  m.

NOTE Formula (1) (coming from CIE x005:1992) has been derived under the assumption that  $p$  is proportional to  $\log_{10} d$ , where:

$$p = 0,2 \text{ m for } d = 1 \text{ m};$$

$$p = 1 \text{ m for } d = 10 \text{ m};$$

$$p = 5 \text{ m for } d = 100 \text{ m}.$$

#### 4.3.5 Uniformity and diversity

The task area shall be illuminated as uniformly as possible. The illuminance uniformity of the task area shall be not less than the values given in Clause 5. The uniformity of the surroundings shall not be less than 0,10.

In some cases, e.g. railways, illuminance diversity is also an important quality criterion.

## 4.4 Glare

### 4.4.1 General

Glare is the sensation produced by bright areas within the field of vision and may be experienced either as discomfort glare or disability glare. Glare caused by reflections in specular surfaces is usually known as veiling reflections or reflected glare.

It is important to limit the glare to the users to avoid errors, fatigue and accidents.

NOTE Special care is needed to avoid glare when the direction of view is above horizontal.

### 4.4.2 Glare rating


The glare directly from the luminaires of an outdoor lighting installation shall be determined using the CIE Glare Rating ( $R_G$ ) method, based on the formula:

$$R_G = 27 + 24 \log_{10} \left( \frac{L_{vl}}{L_{ve}^{0,9}} \right) \quad (2)$$

where

$L_{vl}$  is the total veiling luminance in  $\text{cd}\cdot\text{m}^{-2}$  caused by the lighting installation and is the sum of the veiling luminances produced by each individual luminaire ( $L_{vl} = L_{v1} + L_{v2} + \dots + L_{vn}$ ). The veiling luminance of the individual luminaires is calculated as  $L_v = 10 \cdot (E_{eye} \cdot \Theta^2)$ , in which  $E_{eye}$  is the illuminance at the observer's eye in a plane perpendicular to the line of sight ( $2^\circ$  below horizontal, see Figure 1) and  $\Theta$  is the angle between the observer's line of sight and the direction of the light incident from the individual luminaire;

$L_{ve}$  is the equivalent veiling luminance of the environment in  $\text{cd}\cdot\text{m}^{-2}$ . From the assumption that the reflection of the environment is totally diffuse, the equivalent veiling reflection from the environment may be calculated as  $L_{ve} = 0,035 \cdot \rho \cdot E_{hav} \cdot \pi^{-1}$ , in which  $\rho$  represents the average reflectance and  $E_{hav}$  the average horizontal illuminance of the area. If the value of reflectance is not known,  $\rho$  should be taken as 0,15.

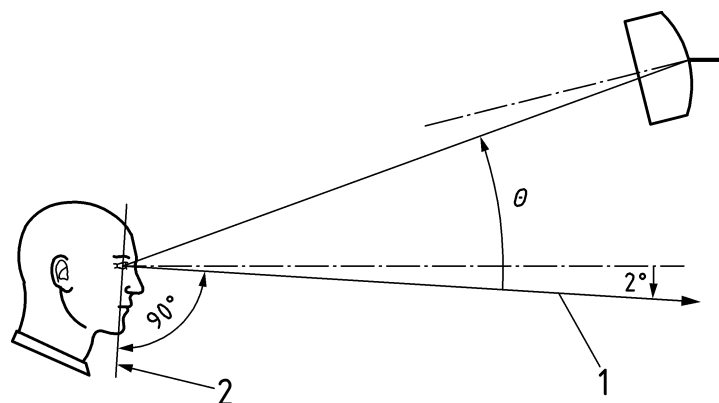

#### Key

- 1 line of sight
- 2 plane of  $E_{eye}$

**Figure 1 — The angle between the observer's line of sight and the direction of the light incident from the individual luminaire**

$R_G$  should be computed at grid positions as defined in 4.3.4, at  $45^\circ$  intervals radially about the grid points with  $0^\circ$  direction parallel to the long side of the task area.

All assumptions made in the determination of  $R_G$  shall be stated in the scheme documentation. The  $R_G$  value of the lighting installation shall not exceed the  $R_{GL}$ -value given in Clause 5.

#### 4.4.3 Veiling reflections and reflected glare

High brightness reflections in the visual task may alter task visibility, usually detrimentally. Veiling reflections and reflected glare may be prevented or reduced by the following measures:

- appropriate arrangement of luminaires and work places,
- surface finish (e.g. matte surfaces),
- luminance restriction of luminaires,
- increased luminous area of the luminaire.

#### 4.5 Obtrusive light

To safeguard and enhance the night time environment it is necessary to control obtrusive light (also known as light pollution), which can present physiological and ecological problems to surroundings and people.

The limits of obtrusive light for exterior lighting installations, to minimize problems for people, flora and fauna, are given in Table 2 and for road users in Table 3.

**Table 2 — Maximum obtrusive light permitted for exterior lighting installations**

Environmental zone	Light on properties		Luminaire intensity		Upward light ratio	Luminance	
	$E_v$ lx		$I$ cd			$R_{UL}$ %	$L_b$ cd·m <sup>-2</sup>
	Pre-curfew <sup>a</sup>	Post-curfew	Pre-curfew	Post-curfew	Building facade		Signs
E1	2	0	2 500	0	0	0	50
E2	5	1	7 500	500	5	5	400
E3	10	2	10 000	1 000	15	10	800
E4	25	5	25 000	2 500	25	25	1 000

where

E1 represents intrinsically dark areas, such as national parks or protected sites;

E2 represents low district brightness areas, such as industrial or residential rural areas;

E3 represents medium district brightness areas, such as industrial or residential suburbs;

E4 represents high district brightness areas, such as town centres and commercial areas;

$E_v$  is the maximum value of vertical illuminance on properties in lx;

$I$  is the light intensity of each source in the potentially obtrusive direction in cd;

$R_{UL}$  is the proportion of the flux of the luminaire(s) that is emitted above the horizontal, when the luminaire(s) is (are) mounted in its (their) installed position and attitude, and given in %;

$L_b$  is the maximum average luminance of the facade of a building in cd·m<sup>-2</sup>;

$L_s$  is the maximum average luminance of signs in cd·m<sup>-2</sup>.

<sup>a</sup> In case no curfew regulations are available, the higher values shall not be exceeded and the lower values should be taken as preferable limits.

For users of transport systems for the relevant viewing positions in the path of travel the threshold increment shall not exceed 15 % based on the actual adaptation level. If the adaptation level is not known and no road lighting is provided, an adaptation luminance of 0,1 cd/m<sup>2</sup> shall be applied.

**Table 3 — Maximum values of threshold increment from non-road lighting installations**

Light technical parameter	Road lighting classes <sup>a, b</sup>			
	No road lighting	ME5	ME4 / ME3	ME2 / ME1 <sup>f</sup>
Threshold increment ( <i>TI</i> ) <sup>c, d, e</sup>	15 % based on adaptation luminance of 0,1 cd·m <sup>-2</sup>	15 % based on adaptation luminance of 1 cd·m <sup>-2</sup>	15 % based on adaptation luminance of 2 cd·m <sup>-2</sup>	15 % based on adaptation luminance of 5 cd·m <sup>-2</sup>
NOTE During the life of this standard, the designations are likely to change from ME, CE, S to M, C, P.				
<p><sup>a</sup> Road lighting classes as given in EN 13201-2.</p> <p><sup>b</sup> If CE-class or S-class has to be applied, adaptation level of luminance should be used according to CEN/TR 13201-1:2004, Table 3 or equivalent national standards.</p> <p><sup>c</sup> <i>TI</i> calculation as given in EN 13201-3.</p> <p><sup>d</sup> Limits apply where users of transport systems are subject to a reduction in the ability to see essential information. Values given are for relevant positions and for viewing directions in the path of travel.</p> <p><sup>e</sup> Table 5.2 in CIE 150:2003 gives corresponding values for the veiling luminance <math>L_v</math>.</p> <p><sup>f</sup> The adaptation luminance values are taken from CIE 150:2003, Table 2.4.</p>				

## 4.6 Directional lighting

### 4.6.1 General

Directional lighting may be used to highlight objects, reveal texture and improve the appearance of people. This is described by the term “modelling”. Directional lighting of a visual task may also affect its visibility.

### 4.6.2 Modelling

Modelling is the balance between diffuse and directional light. It is a valid criterion of lighting quality in virtually all applications. The people and objects should be lit so that form and texture are revealed clearly and pleasingly. This occurs when the light comes predominantly from one direction; the shadows so essential to good modelling are then formed without confusion.

The lighting should not be too directional or it will produce harsh shadows.

### 4.6.3 Directional lighting of visual tasks

Lighting from a specific direction may reveal details within a visual task, increasing their visibility and making the task easier to perform. Veiling reflections and reflected glare should be avoided, see 4.4.3.

## 4.7 Colour aspects

### 4.7.1 General

The colour qualities of a near-white lamp are characterized by two attributes:

- the colour appearance of the lamp itself;
- its colour rendering capabilities, which affect the colour appearance of objects and persons illuminated by the lamp.

These two attributes shall be considered separately.

#### 4.7.2 Colour appearance

The “colour appearance” of a lamp refers to the apparent colour (chromaticity) of the light emitted. It is quantified by its correlated colour temperature ( $T_{cp}$ ).

Colour appearance may also be described as in Table 4.

**Table 4 — Lamp colour appearance groups**

Colour appearance	Correlated colour temperature $T_{cp}$ K
Warm	below 3 300
Intermediate	3 300 to 5 300
Cool	above 5 300

The choice of colour appearance is a matter of psychology, aesthetics and of what is considered to be natural.

#### 4.7.3 Colour rendering

Good colour rendering improves visual performance and the feeling of comfort and well-being. Colours in the environment and of objects shall be rendered correctly and, where reasonably practicable, human skin shall be rendered naturally. The latter may allow some compromise at outdoor workplaces.

To provide an objective indication of the colour rendering properties of a light source the general colour rendering index  $R_a$  is used. The maximum value of  $R_a$  is 100.

The minimum value of colour rendering index for distinct types of outdoor areas, tasks or activities are given in Tables 5.1 to 5.15.

Safety colours according to ISO 3864-1 shall always be recognizable as such.

Colour rendering properties of light from a light source may be reduced by optics, glazing and coloured surfaces.

For accurate rendition of colours of objects and human skin the appropriate individual special colour rendering index ( $R_i$ ) should be considered.

### 4.8 Flicker and stroboscopic effects

Flicker causes distraction and may give rise to physiological effects such as headaches.

Stroboscopic effects can lead to dangerous situations by changing the perceived motion of rotating or reciprocating machinery.

Lighting systems should be designed to avoid flicker and stroboscopic effects.

NOTE This can usually be achieved by technical measures adjusted to the chosen lamp type (e.g. operating discharge lamps at high frequencies).

### 4.9 Maintenance factor (MF)

The lighting scheme should be designed with a maintenance factor calculated for the selected lighting equipment, space environment and specified maintenance schedule, as defined in CIE 154:2003.

The recommended illuminance for each task is given as maintained illuminance. The maintenance factor depends on the maintenance characteristics of the lamp and control gear, the luminaire, the environment and the maintenance programme.

The designer shall:

- state the maintenance factor and list all assumptions made in the derivation of the value;
- specify lighting equipment suitable for the application environment;
- prepare a comprehensive maintenance schedule to include frequency of lamp replacement, luminaire cleaning intervals and cleaning method.

#### **4.10 Energy considerations**

The lighting solution should be designed to meet the lighting requirement of a particular task or area in an energy efficient manner. It is also important not to compromise the visual effectiveness of a lighting installation simply to reduce energy consumption.

The lighting conditions and light levels recommended in this European Standard are minimum average values and these shall be maintained at all required times.

Energy savings can be made by harvesting daylight when available, controlling the electric lights in response to workers presence and improving the maintenance characteristics of the lighting installation. These require the consideration and integration of appropriate lighting controls with the lighting system solution.

The amount of daylight available during the day depends on time and climate conditions. However, in many places during the day daylight can provide the lighting needs and it is free and uses no energy. Including automatic or manual switching or dimming controls with the lighting system will give much opportunity for energy savings and will ensure satisfactory integration of electric lighting with daylight.

The absence of people can be detected by suitable absence/presence detection circuits and can form an integral part of the lighting system. This control can save energy by reducing the use of the electric lights when the area is unoccupied or not in use. However, caution should be applied when using light sources requiring long run-up or restrike time.

#### **4.11 Sustainability**

Consideration should be given to the sustainability of the lighting installation. The choice of a specific design solution should achieve a reasonable balance between the various environmental aspects (Environmental Life-Cycle thinking: aimed to reduce the environmental impacts of products across the whole of their life cycle, including transport, installation, maintenance, possibilities for re-use, recycling and recovery of materials) and between environmental aspects and other relevant considerations, such as safety and health, technical requirements for functionality, quality, and performance, and economic aspects.

## **5 Schedule of lighting requirements**

### **5.1 General**

The lighting requirements for various areas, tasks and activities are given in the Tables of 5.4 (see also EN 12193).

Adequate lighting conditions shall be provided for all work spaces where and when routine cleaning of the space is carried out. The whole space shall be considered as the cleaning service task area and the relevant requirements are given in Table 5.1.

Use lighting control to achieve adequate flexibility for the variety of tasks performed.

## 5.2 Composition of the Tables 5.1 to 5.15 below

- **Column 1** lists the reference number for each area, task or activity.
- **Column 2** lists those areas, tasks or activities for which specific requirements are given. If the particular area, task or activity is not listed, the values given for a similar, comparable situation should be adopted.
- **Column 3** gives the maintained illuminance  $\overline{E}_m$  on the reference surface (see 4.3) for the area, task or activity given in column 2.
- **Column 4** gives the minimum illuminance uniformity  $U_o$  on the reference surface (see 4.3) for the area, task or activity given in column 2.
- **Column 5** gives the Glare Rating limits ( $R_{GL}$ ) where these are applicable to the situations listed in column 2 (see 4.4)
- **Column 6** gives the minimum colour rendering indices ( $R_a$ ) (see 4.7.3) for the situation listed in column 2.
- **Column 7**, contains advice and footnotes for exceptions and special applications for the situations listed in column 2.

## 5.3 The schedule of areas, tasks and activities

Table 5.1	General requirements for areas and for cleaning at outdoor work places
Table 5.2	Airports
Table 5.3	Building sites
Table 5.4	Canals, locks and harbours
Table 5.5	Farms
Table 5.6	Fuel filling stations
Table 5.7	Industrial sites and storage areas
Table 5.8	Off shore gas and oil structures
Table 5.9	Parking areas
Table 5.10	Oil and other chemical industries
Table 5.11	Power, electricity, gas and heat plants
Table 5.12	Railways and tramways
Table 5.13	Saw mills
Table 5.14	Shipyards and docks
Table 5.15	Water and sewage plants



## 5.4 Lighting requirements for areas, tasks and activities

Table 5.1 — General requirements for areas and for cleaning at outdoor work places

Ref. no.	Type of area, task or activity	$\bar{E}_m$ lx	$U_o$ —	$R_{GL}$ —	$R_a$ —	Specific requirements
5.1.1	Walkways exclusively for pedestrians	5	0,25	50	20	
5.1.2	Traffic areas for slowly moving vehicles (max. 10 km/h), e.g. bicycles, trucks and excavators	10	0,40	50	20	
5.1.3	Regular vehicle traffic (max. 40 km/h)	20	0,40	45	20	At shipyards and in docks, $R_{GL}$ may be 50
5.1.4	Pedestrian passages, vehicle turning, loading and unloading points	50	0,40	50	20	
5.1.5	Cleaning and servicing	50	0,25	50	20	All relevant surfaces

Table 5.2 — Airports

Ref. no.	Type of area, task or activity	$\bar{E}_m$ lx	$U_o$ —	$R_{GL}$ —	$R_a$ —	Specific requirements
General						1. Direct light in the direction of the control tower and landing aircraft shall be avoided. 2. Direct light emitted above horizontal from floodlights should be restricted to the minimum.
5.2.1	Hangar apron	20	0,10	55	20	
5.2.2	Terminal apron	20	0,25	50	20	
5.2.3	Loading areas	20	0,25	50	40	For reading labels: $\bar{E}_m = 50$ lx
5.2.4	Fuel depot	50	0,25	50	40	
5.2.5	Aircraft maintenance stands	200	0,50	45	60	

NOTE For aircraft stand, see ICAO, Annex 14.

Table 5.3 — Building sites

Ref. no.	Type of area, task or activity	$\bar{E}_m$ lx	$U_o$ —	$R_{GL}$ —	$R_a$ —	Specific requirements
5.3.1	Clearance, excavation and loading	20	0,25	55	20	
5.3.2	Construction areas, drain pipes mounting, transport, auxiliary and storage tasks	50	0,40	50	20	
5.3.3	Framework element mounting, light reinforcement work, wooden mould and framework mounting, electric piping and cabling	100	0,40	45	40	
5.3.4	Element jointing, demanding electrical, machine and pipe mountings	200	0,50	45	40	

**Table 5.4 — Canals, locks and harbours**

Ref. no.	Type of area, task or activity	$\bar{E}_m$ lx	$U_o$ —	$R_{GL}$ —	$R_a$ —	Specific requirements
5.4.1	Waiting quays at canals and locks	10	0,25	50	20	
5.4.2	Gangways and passages exclusively for pedestrians	10	0,25	50	20	
5.4.3	Lock control and ballasting areas	20	0,25	55	20	
5.4.4	Cargo handling, loading and unloading	30	0,25	55	20	For reading labels: $\bar{E}_m = 50$ lx
5.4.5	Passenger areas in passenger harbours	50	0,40	50	20	
5.4.6	Coupling of hoses, pipes and ropes	50	0,40	50	20	
5.4.7	Dangerous part of walkways and driveways	50	0,40	45	20	

**Table 5.5 — Farms**

Ref. no.	Type of area, task or activity	$\bar{E}_m$ lx	$U_o$ —	$R_{GL}$ —	$R_a$ —	Specific requirements
5.5.1	Farm yard	20	0,10	55	20	
5.5.2	Equipment shed (open)	50	0,20	55	20	
5.5.3	Animals sorting pen	50	0,20	50	40	

**Table 5.6 — Fuel filling stations**

Ref. no.	Type of area, task or activity	$\bar{E}_m$ lx	$U_o$ —	$R_{GL}$ —	$R_a$ —	Specific requirements
5.6.1	Vehicle parking and storage areas	5	0,25	50	20	
5.6.2	Entry and exit driveways: dark environment	20	0,40	45	20	
5.6.3	Entry and exit driveways: light environment	50	0,40	45	20	
5.6.4	Air pressure and water checking points and other service areas	150	0,40	45	20	
5.6.5	Meter reading area	150	0,40	45	20	

**Table 5.7 — Industrial sites and storage areas**

Ref. no.	Type of area, task or activity	$\bar{E}_m$ lx	$U_o$ —	$R_{GL}$ —	$R_a$ —	Specific requirements
5.7.1	Short-term handling of large units and raw materials, loading and unloading of solid bulk goods	20	0,25	55	20	
5.7.2	Continuous handling of large units and raw materials, loading and unloading of freight, lifting and descending location for cranes, open loading platforms	50	0,40	50	20	
5.7.3	Reading of addresses, covered loading platforms, use of tools, ordinary reinforcement and casting tasks in concrete plants	100	0,50	45	20	
5.7.4	Demanding electrical, machine and piping installations, inspection	200	0,50	45	60	Use local lighting

**Table 5.8 — Off-shore gas and oil structures**

Ref. no.	Type of area, task or activity	$\bar{E}_m$ lx	$U_o$ —	$R_{GL}$ —	$R_a$ —	Specific requirements
5.8.1	Sea surface below the rig	30	0,25	50	20	
5.8.2	Ladders, stairs, walkways	100	0,25	45	20	On treads
5.8.3	Boat landing areas / transport areas	100	0,25	50	20	
5.8.4	Helideck	100	0,40	45	20	1. Direct light in the direction of the control tower and landing aircraft shall be avoided. 2. Direct light emitted above horizontal from floodlights should be restricted to the minimum.
5.8.5	Derrick	100	0,50	45	40	
5.8.6	Treatment areas	100	0,50	45	40	
5.8.7	Pipe rack area / deck	150	0,50	45	40	
5.8.8	Test station, shale shaker, wellhead	200	0,50	45	40	
5.8.9	Pumping areas	200	0,50	45	20	
5.8.10	Life boat areas	200	0,40	50	20	
5.8.11	Drill floor and monkey board	300	0,50	40	40	Special attention to string entry is needed
5.8.12	Mud room, sampling	300	0,50	40	40	
5.8.13	Crude oil pumps	300	0,50	45	40	
5.8.14	Plant areas	300	0,50	40	40	
5.8.15	Rotary table	500	0,50	40	40	

**Table 5.9 — Parking areas**

Ref. no.	Type of area, task or activity	$\bar{E}_m$ lx	$U_o$ —	$R_{GL}$ —	$R_a$ —	Specific requirements
5.9.1	Light traffic, e.g. parking areas of shops, terraced and apartment houses; cycle parks	5	0,25	55	20	
5.9.2	Medium traffic, e.g. parking areas of department stores, office buildings, plants, sports and multipurpose building complexes	10	0,25	50	20	
5.9.3	Heavy traffic, e.g. parking areas of major shopping centres, major sports and multipurpose building complexes	20	0,25	50	20	

**Table 5.10 — Oil and other chemical industries**

Ref. no.	Type of area, task or activity	$\bar{E}_m$ lx	$U_o$ —	$R_{GL}$ —	$R_a$ —	Specific requirements
5.10.1	Handling of servicing tools, utilization of manually regulated valves, starting and stopping motors, lighting of burners	20	0,25	55	20	
5.10.2	Filling and emptying of container trucks and wagons with risk free substances, inspection of leakage, piping and packing	50	0,40	50	20	
5.10.3	Filling and emptying of container trucks and wagons with dangerous substances, replacements of pump packing, general service work, reading of instruments	100	0,40	45	40	
5.10.4	Fuel loading and unloading sites	100	0,40	45	20	
5.10.5	Repair of machines and electric devices	200	0,50	45	60	Use local lighting

**Table 5.11 — Power, electricity, gas and heat plants**

Ref. no.	Type of area, task or activity	$\bar{E}_m$ lx	$U_o$ —	$R_{GL}$ —	$R_a$ —	Specific requirements
5.11.1	Pedestrian movements within electrically safe areas	5	0,25	50	20	
5.11.2	Handling of servicing tools, coal	20	0,25	55	20	
5.11.3	Overall inspection	50	0,40	50	20	
5.11.4	General servicing work and reading of instruments	100	0,40	45	40	
5.11.5	Repair of electric devices	200	0,50	45	60	Use local lighting

Table 5.12 — Railways and tramways

Ref. no.	Type of area, task or activity	$\bar{E}_m$ lx	$U_o$ —	$R_{GL}$ —	$R_a$ —	Specific requirements
General	Railway areas including light railways, tramways, monorails, miniature rails, metro, etc.					Avoid glare for vehicle drivers.
5.12.1	Open platforms, very small number of passengers, e.g. train stops	5	0,20	55	20	1. Special attention to the edge of the platform 2. $U_d \geq 1/10$
5.12.2	Tracks in passenger station areas, including stabling	10	0,25	50	20	$U_d \geq 1/8$
5.12.3	Railway yards: flat marshalling, retarder and classification yards	10	0,40	50	20	$U_d \geq 1/5$
5.12.4	Hump areas	10	0,40	45	20	$U_d \geq 1/5$
5.12.5	Freight track, short duration operations	10	0,25	50	20	$U_d \geq 1/8$
5.12.6	Open platforms, small number of passengers, e.g. rural and local trains,	10	0,25	50	20	1. Special attention to the edge of the platform 2. $U_d \geq 1/8$
5.12.7	Walkways in railway areas, open footbridges	10	0,25	50	20	
5.12.8	Level crossings	20	0,40	45	20	
5.12.9	Open platforms, medium number of passengers, e.g. suburban or regional trains or inter-city services	20	0,30	45	20	1. Special attention to the edge of the platform 2. $U_d \geq 1/6$
5.12.10	Freight track, continuous operation	20	0,40	50	20	$U_d \geq 1/5$
5.12.11	Open platforms in freight areas	20	0,40	50	20	$U_d \geq 1/5$
5.12.12	Servicing trains and locomotives	20	0,40	50	40	$U_d \geq 1/5$
5.12.13	Railway yards handling areas	30	0,40	50	20	$U_d \geq 1/5$
5.12.14	Coupling area	30	0,40	45	20	$U_d \geq 1/5$
5.12.15	Stairs, small number of passengers	50	0,40	45	40	
5.12.16	Open platforms, large number of passengers, e.g. inter-city services	50	0,40	45	20	1. Special attention to the edge of the platform 2. $U_d \geq 1/5$
5.12.17	Covered platforms, small number of passengers, e.g. suburban or regional trains or inter-city services	50	0,40	45	40	1. Special attention to the edge of the platform 2. $U_d \geq 1/5$
5.12.18	Covered platforms in freight areas, short duration operations	50	0,40	45	20	$U_d \geq 1/5$
5.12.19	Covered platforms, large number of passengers, e.g. inter-city services	100	0,50	45	40	1. Special attention to the edge of the platform 2. $U_d \geq 1/3$
5.12.20	Stairs, large number of passengers	100	0,50	45	40	
5.12.21	Covered platforms in freight areas, continuous operation	100	0,50	45	40	$U_d \geq 1/5$
5.12.22	Inspection pit	100	0,50	40	40	Use low-glare local lighting

**Table 5.13 — Saw mills**

Ref. no.	Type of area, task or activity	$\bar{E}_m$ lx	$U_o$ —	$R_{GL}$ —	$R_a$ —	Specific requirements
5.13.1	Timber handling on land and in water, sawdust and chip conveyors	20	0,25	55	20	
5.13.2	Sorting of timber on land or in water, timber unloading points and sawn timber loading points, mechanical lifting to timber conveyor, stacking	50	0,40	50	20	
5.13.3	Reading of addresses and markings of sawn timber	100	0,40	45	40	
5.13.4	Grading and packaging	200	0,50	45	40	
5.13.5	Feeding into stripping and chopping machines	300	0,50	45	40	

**Table 5.14 — Shipyards and docks**

Ref. no.	Type of area, task or activity	$\bar{E}_m$ lx	$U_o$ —	$R_{GL}$ —	$R_a$ —	Specific requirements
5.14.1	General lighting of shipyard area, storage areas for prefabricated goods.	20	0,25	55	40	
5.14.2	Short-term handling of large units	20	0,25	55	20	
5.14.3	Scraping, cleaning and painting of ship hull	50	0,25	50	20	
5.14.4	Painting and welding	100	0,40	45	60	
5.14.5	Mounting of electrical and mechanical components	200	0,50	45	60	

**Table 5.15 — Water and sewage plants**

Ref. no.	Type of area, task or activity	$\bar{E}_m$ lx	$U_o$ —	$R_{GL}$ —	$R_a$ —	Specific requirements
5.15.1	Handling of service tools, utilization of manually operated valves, starting and stopping of motors, piping packing and raking plants	50	0,40	45	20	
5.15.2	Handling of chemicals, inspection of leakage, changing of pumps, general servicing work, reading of instruments	100	0,40	45	40	
5.15.3	Repair of motors and electric devices	200	0,50	45	60	

## 6 Verification procedures

### 6.1 General

Specified design criteria which are listed in this European Standard shall be verified by the following procedures.

In lighting design, calculations and measurements, certain assumptions, including degree of accuracy have been made. These shall be declared.

The installation and the environment shall be checked against the design assumptions.

### 6.2 Illuminance

When verifying conformity to the illuminance requirements the measurement points shall coincide with any design points or grids used according to requirements in 4.3.4. Verification shall be made to the criteria of the relevant surfaces.

For subsequent measurements, always the same measurement points shall be used.

Verification of illuminances that relate to specific tasks shall be measured in the plane of the task.

When verifying illuminance, account should be taken of the calibration of the light metres used, the conformity of the lamps and luminaires to the published photometric data and of the design assumptions made compared with the real values.

The average illuminance and uniformity shall be not less than the values specified.

### 6.3 Glare Rating

Verification of the glare criteria shall be made by inspection of the design data and parameters provided for the scheme. All assumptions shall be declared.

### 6.4 Colour Rendering Index and colour appearance

Authenticated colour rendering index  $R_a$  and correlated colour temperatures  $T_{cp}$  data shall be provided for the lamps used in the scheme by the manufacturer of the lamps. The lamps shall be checked for conformity with the design specification.

### 6.5 Obtrusive light

The relevant calculated values of upward light ratio  $R_{UL}$ , vertical illuminance  $E_v$ , luminaire intensity  $I$ , and the maximum average luminance façade  $L_b$  and signs  $L_s$  for the designed scheme shall be declared by the designer and checked for conformity with the design specification.

The verification of the vertical illuminance  $E_v$  and luminances  $L_b$  and  $L_s$  can be made by measurement taking into account all design assumptions.

### 6.6 Maintenance schedule

The maintenance schedule shall be provided and shall be based on the results from the calculations under item 4.9.

## Annex A (informative)

### A–deviations

A-deviation: National deviation due to regulations, the alteration of which is for the time being outside the competence of the CEN/CENELEC member.

This European Standard does not fall under any Directive of the EU. In the relevant CEN/CENELEC countries these A- deviations are valid instead of the provisions of the European Standard until they have been removed.

<u>Clause</u>	<u>Deviation</u>
4.5	<b>Germany</b>  “Hinweise zur Messung, Beurteilung und Minderung von Lichtimmissionen”, Beschluss des Bund-/Länderausschusses für Immissionsschutz instead of environmental zones the “Baunutzungsverordnung” has to be observed, the values for light on properties are different, there is a special method for glare evaluation instead of limiting the luminaire intensities.
4.3.4	<b>Slovakia</b>  In accordance with the Slovak regulations <sup>1)</sup> by common measurement (within the accuracy class 2) of general illuminance of an area or its functionally restricted part the relative distance of control points must not be more than the height of luminaires above the reference plane. By rough measurement (within the accuracy class 3) the distance can be increased by a one third, by accurate measurement (within the accuracy class 1) the distance shall be estimated according to Clause 4.4 of the EN 12464-1.  Illuminance measurements of walls and ceiling surfaces should be executed merely in well-grounded cases.
5.4	<b>Hungary</b>  In accordance with the Hungarian special regulation of the Ministry for National Economy of Hungary the 103/2003. (XII.27.) GKM decree, The National Railway Regulation has to be applied instead of Table 5.12.

---

1) Special regulation of the Ministry of Health Service of the Slovak Republic modifying the procedure of measurement and evaluation of lighting, (Bulletin MZ SR, 2013, upcoming).



## Bibliography

- [1] EN 1838, *Lighting applications - Emergency lighting*
- [2] EN 12193, *Light and lighting - Sports lighting*
- [3] EN 12464-1, *Light and lighting - Lighting of work places - Part 1: Indoor work places*
- [4] EN 13032-1, *Light and lighting - Measurement and presentation of photometric data of lamps and luminaires - Part 1 : Measurement and file format*
- [5] EN 13032-3, *Light and lighting - Measurement and presentation of photometric data of lamps and luminaires - Part 3: Presentation of data for emergency lighting of work places*
- [6] CEN/TR 13201-1:2004, *Road lighting - Part 1: Selection of lighting classes*
- [7] IEC 60050-845/CIE 17.4, *International Electrotechnical Vocabulary - Chapter 845: Lighting*
- [8] CIE 112:1994, *Glare evaluation system for use within outdoor and area lighting*
- [9] CIE 115:2010, *Lighting of roads for motor and pedestrian traffic*
- [10] CIE 126:1997, *Guidelines for minimizing sky glow*
- [11] CIE 129:1998, *Guide for lighting exterior work areas*
- [12] CIE 140:2000, *Road lighting calculations*
- [13] CIE 150:2003, *Guide on the limitation of the effects of obtrusive light from outdoor lighting installations*
- [14] CIE 154:2003, *Maintenance of outdoor lighting systems*
- [15] CIE 196:2011, *CIE Guide to increasing accessibility in light and lighting*
- [16] ICAO, *Annex 14 - Aerodromes. Volume I - Aerodrome Design and Operations*. Available from ICAO, Customer Services Unit, 999 University Street, Montréal, Quebec, Canada H3C 5H7.

## Index of areas, tasks and activities

Air pressure checking points (fuel filling stations)	5.6.4
Aircraft maintenance stands (airports)	5.2.5
Airports	5.2
Animals sorting pen (farms)	5.5.3
Auxiliary tasks (building sites)	5.3.2
Ballasting areas (canals, locks and harbours)	5.4.3
Boat landing areas (off-shore gas and oil structures)	5.8.3
Building sites	5.3
Bulk goods, solid (industrial sites and storage areas)	5.7.1
Burners, lighting of (oil and other chemical industries)	5.10.1
Cabling, electric (building sites)	5.3.3
Canals	5.4
Cargo handling (canals, locks and harbours)	5.4.4
Casting tasks in concrete plants, ordinary (industrial sites and storage areas)	5.7.3
Changing of pumps (water and sewage plants)	5.15.2
Chemicals, handling of (water and sewage plants)	5.15.2
Chemical industries	5.10
Chip conveyors (saw mills)	5.13.1
Chopping machines (saw mills)	5.13.5
Classification yards (railway areas)	5.12.3
Cleaning (general requirements)	5.1.5
Cleaning of ship hull (shipyards and docks)	5.14.3
Clearance (building sites)	5.3.1
Coal, handling of (power plants, etc.)	5.11.2
Construction areas (building sites)	5.3.2
Container trucks, emptying of dangerous substances (oil and other chemical industries)	5.10.3
Container trucks, emptying of risk free substances (oil and other chemical industries)	5.10.2
Container trucks, filling with dangerous substances (oil and other chemical industries)	5.10.3
Container trucks, filling with risk free substances (oil and other chemical industries)	5.10.2
Container wagons, emptying of dangerous substances (oil and other chemical industries)	5.10.3
Container wagons, emptying of risk free substances (oil and other chemical industries)	5.10.2
Container wagons, filling with dangerous substances (oil and other chemical industries)	5.10.3
Container wagons, filling with risk free substances (oil and other chemical industries)	5.10.2
Coupling area (railway areas)	5.12.14
Coupling of hoses, pipes and ropes (canals, locks and harbours)	5.4.6
Covered platforms in freight areas, continuous operation (railway areas)	5.12.21
Covered platforms in freight areas, short duration operations (railway areas)	5.12.18
Covered platforms, large number of passengers (railway areas)	5.12.19

Covered platforms, small number of passengers (railway areas)	5.12.17
Cranes, lifting and descending location (industrial sites and storage areas)	5.7.2
Crude oil pumps (off-shore gas and oil structures)	5.8.13
Derrick (off-shore gas and oil structures)	5.8.5
Descending location for cranes (industrial sites and storage areas)	5.7.2
Docks	5.14
Drain pipes mounting (building sites)	5.3.2
Drill floor (off-shore gas and oil structures)	5.8.11
Driveways, dangerous parts (canals, locks and harbours)	5.4.7
Driveways, entry and exit, dark environment (fuel filling stations)	5.6.2
Driveways, entry and exit light environment (fuel filling stations)	5.6.3
Electric cabling (building sites)	5.3.3
Electric devices, repair of (oil and other chemical industries)	5.10.5
Electric devices, repair of (power plants, etc.)	5.11.5
Electric devices, repair of (water and sewage plants)	5.15.3
Electric piping (building sites)	5.3.3
Electrical installations, demanding (industrial sites and storage areas)	5.7.4
Electrical mountings, demanding (building sites)	5.3.4
Electricity plants	5.11
Element jointing (building sites)	5.3.4
Entry driveways, dark environment (fuel filling stations)	5.6.2
Entry driveways, light environment (fuel filling stations)	5.6.3
Equipment shed, open (farms)	5.5.2
Excavation (building sites)	5.3.1
Exit driveways, dark environment (fuel filling stations)	5.6.2
Exit driveways, light environment (fuel filling stations)	5.6.3
Farm yard (farms)	5.5.1
Farms	5.5
Feeding into chopping machines (saw mills)	5.13.5
Feeding into stripping machines (saw mills)	5.13.5
Flat marshalling yards (railway areas)	5.12.2
Footbridges, open (railway areas)	5.12.7
Framework element mounting (building sites)	5.3.3
Framework mounting (building sites)	5.3.3
Freight platforms, open (railway areas)	5.12.11
Freight track, continuous operation (railway areas)	5.12.10
Freight track, short duration operations (railway areas)	5.12.5
Fuel depot (airports)	5.2.4
Fuel filling stations	5.6

Fuel loading and unloading sites (oil and other chemical industries)	5.10.4
Gangways exclusively for pedestrians (canals, locks and harbours)	5.4.2
Gas plants	5.11
General requirements for areas and for cleaning at outdoor work places	5.1
Grading (saw mills)	5.13.4
Handling areas, railway yards (railway areas)	5.12.13
Handling of chemicals (water and sewage plants)	5.15.2
Handling of large units, continuous (industrial sites and storage areas)	5.7.2
Handling of large units, short-term (industrial sites and storage areas)	5.7.1
Handling of large units, short-term (shipyards and docks)	5.14.2
Handling of raw materials, continuous (industrial sites and storage areas)	5.7.2
Handling of raw materials, short-term (industrial sites and storage areas)	5.7.1
Handling of service tools (water and sewage plants)	5.15.1
Handling of timber on land and in water (saw mills)	5.13.1
Hangar apron (airports)	5.2.1
Harbours	5.4
Heat plants	5.11
Heavy traffic (parking areas)	5.9.3
Helideck (off-shore gas and oil structures)	5.8.4
Hoses, coupling of (canals, locks and harbours)	5.4.6
Hump areas (railway areas)	5.12.4
Industrial sites	5.7
Industrial storage areas	5.7
Inspection (industrial sites and storage areas)	5.7.4
Inspection of leakage (oil and other chemical industries)	5.10.2
Inspection of leakage (water and sewage plants)	5.15.2
Inspection, overall (power plants, etc.)	5.11.3
Inspection pit (railway areas)	5.12.22
Instruments, reading of (oil and other chemical industries)	5.10.3
Instruments, reading of (power plants, etc.)	5.11.4
Instruments, reading of (water and sewage plants)	5.15.2
Ladders (off-shore gas and oil structures)	5.8.2
Large units, continuous handling of (industrial sites and storage areas)	5.7.2
Large units, short-term handling (industrial sites and storage areas)	5.7.1
Large units, short-term handling (shipyards and docks)	5.14.2
Leakage, inspection of (water and sewage plants)	5.15.2
Level crossings (railway areas)	5.12.8
Life boat areas (off-shore gas and oil structures)	5.8.10
Lifting location for cranes (industrial sites and storage areas)	5.7.2

Lifting to timber conveyor, mechanical (saw mills)	5.13.2
Light traffic (parking areas)	5.9.1
Loading (building sites)	5.3.1
Loading (canals, locks and harbours)	5.4.4
Loading areas (airports)	5.2.3
Loading of freight (industrial sites and storage areas)	5.7.2
Loading of solid bulk goods (industrial sites and storage areas)	5.7.1
Loading platforms, covered (industrial sites and storage areas)	5.7.3
Loading platforms, open (industrial sites and storage areas)	5.7.2
Loading points (general requirements)	5.1.4
Loading points, saw timber (saw mills)	5.13.2
Lock control areas (canals, locks and harbours)	5.4.3
Locks	5.4
Machine installations, demanding (industrial sites and storage areas)	5.7.4
Machine mountings, demanding (building sites)	5.3.4
Medium traffic (parking areas)	5.9.2
Meter reading area (fuel filling stations)	5.6.5
Monkey board (off-shore gas and oil structures)	5.8.11
Motors, starting and stopping (oil and other chemical industries)	5.10.1
Motors, starting and stopping (water and sewage plants)	5.15.1
Mould mounting (building sites)	5.3.3
Mounting of electrical components (shipyards and docks)	5.14.5
Mounting of mechanical components (shipyards and docks)	5.14.5
Mud room (off-shore gas and oil structures)	5.8.12
Mud sampling (off-shore gas and oil structures)	5.8.12
Off-shore gas and oil structures	5.8
Oil industries	5.10
Open platforms in freight areas (railway areas)	5.12.11
Open platforms, large number of passengers (railway areas)	5.12.16
Open platforms, medium number of passengers (railway areas)	5.12.9
Open platforms, small number of passengers (railway areas)	5.12.6
Open platforms, very small number of passengers (railway areas)	5.12.1
Packaging (saw mills)	5.13.4
Packing (oil and other chemical industries)	5.10.2
Painting (shipyards and docks)	5.14.4
Painting of ship hull (shipyards and docks)	5.14.3
Parking areas	5.9
Passages exclusively for pedestrians (canals, locks and harbours)	5.4.2
Passenger areas in passenger harbours (canals, locks and harbours)	5.4.5
Passenger station areas, tracks in (railway areas)	5.12.2

Pedestrian movements within electrically safe areas (power plants, etc.)	5.11.1
Pedestrian passages (general requirements)	5.1.4
Pipe mountings, demanding (building sites)	5.3.4
Pipe rack area / deck (off-shore gas and oil structures)	5.8.7
Pipes, coupling of (canals, locks and harbours)	5.4.6
Piping (oil and other chemical industries)	5.10.2
Piping, electric (building sites)	5.3.3
Piping installations, demanding (industrial sites and storage areas)	5.7.4
Piping packing and raking plants (water and sewage plants)	5.15.1
Plant areas (off-shore gas and oil structures)	5.8.14
Platforms in freight areas, continuous operation, covered (railway areas)	5.12.21
Platforms in freight areas, open (railway areas)	5.12.11
Platforms in freight areas, short duration operations, covered (railway areas)	5.12.18
Platforms, large number of passengers, covered (railway areas)	5.12.19
Platforms, large number of passengers, open (railway areas)	5.12.16
Platforms, medium number of passengers, open (railway areas)	5.12.9
Platforms, small number of passengers, covered (railway areas)	5.12.17
Platforms, small number of passengers, open (railway areas)	5.12.6
Platforms, very small number of passengers, open (railway areas)	5.12.1
Power plants	5.11
Pump packing, replacements of (oil and other chemical industries)	5.10.3
Pumping areas (off-shore gas and oil structures)	5.8.9
Pumps, changing of (water and sewage plants)	5.15.2
Quays at canals and locks, waiting (canals, locks and harbours)	5.4.1
Railway yards handling areas (railway areas)	5.12.13
Railway areas	5.12
Raw materials, continuous handling of (industrial sites and storage areas)	5.7.2
Raw materials, short-term handling (industrial sites and storage areas)	5.7.1
Reading of addresses (industrial sites and storage areas)	5.7.3
Reading of addresses and markings on sawn timber (saw mills)	5.13.3
Reading of instruments (oil and other chemical industries)	5.10.3
Reading of instruments (power plants, etc.)	5.11.4
Reading of instruments (water and sewage plants)	5.15.2
Reinforcement tasks in concrete plants, ordinary (industrial sites and storage areas)	5.7.3
Reinforcement work, light (building sites)	5.3.3
Repair of electric devices (oil and other chemical industries)	5.10.5
Repair of electric devices (power plants, etc.)	5.11.5
Repair of electric devices (water and sewage plants)	5.15.3
Repair of machines (oil and other chemical industries)	5.10.5
Repair of motors (water and sewage plants)	5.15.3

Retarder yards (railway areas)	5.12.3
Ropes, coupling of (canals, locks and harbours)	5.4.6
Rotary table (off-shore gas and oil structures)	5.8.15
Saw mills	5.13
Sawdust conveyors (saw mills)	5.13.1
Sawn timber loading points (saw mills)	5.13.2
Scraping of ship hull (shipyards and docks)	5.14.3
Sea surface below the rig (off-shore gas and oil structures)	5.8.1
Service areas (fuel filling stations)	5.6.4
Service work, general (oil and other chemical industries)	5.10.3
Service work, general (power plants, etc.)	5.11.4
Service work, general (water and sewage plants)	5.15.2
Servicing (general requirements)	5.1.5
Servicing tools, handling of (oil and other chemical industries)	5.10.1
Servicing tools, handling of (power plants, etc.)	5.11.2
Servicing tools, handling of (water and sewage plants)	5.15.1
Servicing trains and locomotives (railway areas)	5.12.12
Servicing work, general (power plants, etc.)	5.11.4
Servicing work, general (water and sewage plants)	5.15.2
Sewage plants	5.15
Shale shaker (off-shore gas and oil structures)	5.8.8
Shipyards area, general lighting (shipyards and docks)	5.14.1
Shipyards	5.14
Sites, industrial	5.7
Solid bulk goods, loading and unloading (industrial sites and storage areas)	5.7.1
Sorting of timber in water and on land (saw mills)	5.13.2
Stacking (saw mills)	5.13.2
Stabling (railway areas)	5.12.2
Stairs (off-shore gas and oil structures)	5.8.2
Stairs, large number of passengers (railway areas)	5.12.20
Stairs, small number of passengers (railway areas)	5.12.15
Storage areas (fuel filling stations)	5.6.1
Storage areas for prefabricated goods (shipyards and docks)	5.14.1
Storage areas, industrial	5.7
Storage tasks (building sites)	5.3.2
Stripping machines (saw mills)	5.13.5
Terminal apron (airports)	5.2.2
Test station (off-shore gas and oil structures)	5.8.8
Timber conveyor (saw mills)	5.13.2
Timber handling on land or in water (saw mills)	5.13.1

Timber sorting on land or in water (saw mills)	5.13.2
Timber unloading points (saw mills)	5.13.2
Tools, use of (industrial sites and storage areas)	5.7.3
Tracks in passenger station areas (railway areas)	5.12.2
Traffic areas for slowly moving vehicles, max. 10 km/h (general requirements)	5.1.2
Tramway areas	5.12
Traffic, heavy (parking areas)	5.9.3
Traffic, light (parking areas)	5.9.1
Traffic, medium (parking areas)	5.9.2
Traffic, vehicle regular (general requirements)	5.1.3
Transport (building sites)	5.3.2
Transport areas (off-shore gas and oil structures)	5.8.3
Treatment areas (off-shore gas and oil structures)	5.8.6
Unloading (canals, locks and harbours)	5.4.4
Unloading of freight (industrial sites and storage areas)	5.7.2
Unloading of solid bulk goods (industrial sites and storage areas)	5.7.1
Unloading points, timber (saw mills)	5.13.2
Unloading points (general requirements)	5.1.4
Valves, utilization of manually regulated (oil and other chemical industries)	5.10.1
Valves, utilization of manually regulated (water and sewage plants)	5.15.1
Vehicle loading points (general requirements)	5.1.4
Vehicle parking area (fuel filling stations)	5.6.1
Vehicle traffic, regular (general requirements)	5.1.3
Vehicle turning points (general requirements)	5.1.4
Vehicle unloading points (general requirements)	5.1.4
Waiting quays (canals, locks and harbours)	5.4.1
Walkways (off-shore gas and oil structures)	5.8.2
Walkways exclusively for pedestrians (general requirements)	5.1.1
Walkways, dangerous parts (canals, locks and harbours)	5.4.7
Walkways, (railway areas)	5.12.7
Walkways exclusively for pedestrians (general requirements)	5.1.1
Water checking points (fuel filling stations)	5.6.4
Water plants	5.15
Welding (shipyards and docks)	5.14.4
Wellhead (off-shore gas and oil structures)	5.8.8
Wooden mould mounting (building sites)	5.3.3





# British Standards Institution (BSI)

BSI is the national body responsible for preparing British Standards and other standards-related publications, information and services.

BSI is incorporated by Royal Charter. British Standards and other standardization products are published by BSI Standards Limited.

## About us

We bring together business, industry, government, consumers, innovators and others to shape their combined experience and expertise into standards-based solutions.

The knowledge embodied in our standards has been carefully assembled in a dependable format and refined through our open consultation process. Organizations of all sizes and across all sectors choose standards to help them achieve their goals.

## Information on standards

We can provide you with the knowledge that your organization needs to succeed. Find out more about British Standards by visiting our website at [bsigroup.com/standards](http://bsigroup.com/standards) or contacting our Customer Services team or Knowledge Centre.

## Buying standards

You can buy and download PDF versions of BSI publications, including British and adopted European and international standards, through our website at [bsigroup.com/shop](http://bsigroup.com/shop), where hard copies can also be purchased.

If you need international and foreign standards from other Standards Development Organizations, hard copies can be ordered from our Customer Services team.

## Subscriptions

Our range of subscription services are designed to make using standards easier for you. For further information on our subscription products go to [bsigroup.com/subscriptions](http://bsigroup.com/subscriptions).

With **British Standards Online (BSOL)** you'll have instant access to over 55,000 British and adopted European and international standards from your desktop. It's available 24/7 and is refreshed daily so you'll always be up to date.

You can keep in touch with standards developments and receive substantial discounts on the purchase price of standards, both in single copy and subscription format, by becoming a **BSI Subscribing Member**.

**PLUS** is an updating service exclusive to BSI Subscribing Members. You will automatically receive the latest hard copy of your standards when they're revised or replaced.

To find out more about becoming a BSI Subscribing Member and the benefits of membership, please visit [bsigroup.com/shop](http://bsigroup.com/shop).

With a **Multi-User Network Licence (MUNL)** you are able to host standards publications on your intranet. Licences can cover as few or as many users as you wish. With updates supplied as soon as they're available, you can be sure your documentation is current. For further information, email [bsmusales@bsigroup.com](mailto:bsmusales@bsigroup.com).

## BSI Group Headquarters

389 Chiswick High Road London W4 4AL UK

## Revisions

Our British Standards and other publications are updated by amendment or revision.

We continually improve the quality of our products and services to benefit your business. If you find an inaccuracy or ambiguity within a British Standard or other BSI publication please inform the Knowledge Centre.

## Copyright

All the data, software and documentation set out in all British Standards and other BSI publications are the property of and copyrighted by BSI, or some person or entity that owns copyright in the information used (such as the international standardization bodies) and has formally licensed such information to BSI for commercial publication and use. Except as permitted under the Copyright, Designs and Patents Act 1988 no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means – electronic, photocopying, recording or otherwise – without prior written permission from BSI. Details and advice can be obtained from the Copyright & Licensing Department.

## Useful Contacts:

### Customer Services

**Tel:** +44 845 086 9001

**Email (orders):** [orders@bsigroup.com](mailto:orders@bsigroup.com)

**Email (enquiries):** [cservices@bsigroup.com](mailto:cservices@bsigroup.com)

### Subscriptions

**Tel:** +44 845 086 9001

**Email:** [subscriptions@bsigroup.com](mailto:subscriptions@bsigroup.com)

### Knowledge Centre

**Tel:** +44 20 8996 7004

**Email:** [knowledgecentre@bsigroup.com](mailto:knowledgecentre@bsigroup.com)

### Copyright & Licensing

**Tel:** +44 20 8996 7070

**Email:** [copyright@bsigroup.com](mailto:copyright@bsigroup.com)



...making excellence a habit.™