

Bituminous mixtures — Test methods for hot mix asphalt —

**Part 28: Preparation of samples for
determining binder content, water
content and grading**

The European Standard EN 12697-28:2000 has the status of a
British Standard

ICS 93.080.20

National foreword

This British Standard is the official English language version of EN 12697-28:2000.

The UK participation in its preparation was entrusted by Technical Committee B/510, Road materials, to Subcommittee B/510/1, Coated macadam and hot mix asphalt, which has the responsibility to:

- aid enquirers to understand the text;
- present to the responsible European committee any enquiries on the interpretation, or proposals for change, and keep the UK interests informed;
- monitor related international and European developments and promulgate them in the UK.

A list of organizations represented on this subcommittee can be obtained on request to its secretary.

Cross-references

The British Standards which implement international or European publications referred to in this document may be found in the BSI Standards Catalogue under the section entitled “International Standards Correspondence Index”, or by using the “Find” facility of the BSI Standards Electronic Catalogue.

A British Standard does not purport to include all the necessary provisions of a contract. Users of British Standards are responsible for their correct application.

Compliance with a British Standard does not of itself confer immunity from legal obligations.

Summary of pages

This document comprises a front cover, an inside front cover, the EN title page, pages 2 to 13 and a back cover.

The BSI copyright notice displayed in this document indicates when the document was last issued.

This British Standard, having been prepared under the direction of the Sector Committee for Building and Civil Engineering, was published under the authority of the Standards Committee and comes into effect on 15 February 2001

© BSI 02-2001

Amendments issued since publication

Amd. No.	Date	Comments

ISBN 0 580 36415 1

ICS 93.080.20

English version

Bituminous mixtures — Test methods for hot mix asphalt —
Part 28: Preparation of samples for determining binder content,
water content and grading

Mélanges bitumineux — Essais pour enrobés à chaud —
Partie 28: Préparation des échantillons pour la
détermination de la teneur en liant, de la teneur en eau et
de la granularité

Asphalt — Prüfverfahren für Heiasphalt —
Teil 28: Vorbereitung von Proben zur Bestimmung des
Bindemittelgehaltes, des Wassergehaltes und zur
Korngrenbestimmung

This European Standard was approved by CEN on 24 November 2000.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

Management Centre: rue de Stassart, 36 B-1050 Brussels

Contents

Page

Foreword.....	3
1 Scope	5
2 Normative references	5
3 Terms and definitions	5
4 Apparatus	6
5 Preparation of laboratory samples of bituminous mixtures	6

Foreword

This European Standard has been prepared by Technical Committee CEN/TC 227, Road Materials, the Secretariat of which is held by DIN.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by June 2001, and conflicting national standards shall be withdrawn at the latest by August 2005.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and the United Kingdom

This European Standard is one of a series of standards as listed below:

EN 12697-1, *Bituminous mixtures — Test methods for hot mix asphalt — Part 1: Soluble binder content*

prEN 12697-2:1998, *Bituminous mixtures — Test methods for hot mix asphalt — Part 2: Particle size distribution*

EN 12697-3, *Bituminous mixtures — Test methods for hot mix asphalt — Part 3: Binder recovery: Rotary evaporator*

EN 12697-4, *Bituminous mixtures — Test methods for hot mix asphalt — Part 4: Binder recovery: Fractionating column*

prEN 12697-5:1996, *Bituminous mixtures — Test methods for hot mix asphalt — Part 5: Determination of the maximum density*

prEN 12697-6:1996, *Bituminous mixtures — Test methods for hot mix asphalt — Part 6: Determination of bulk density of bituminous specimen by hydro-static method*

prEN 12697-7:1996, *Bituminous mixtures — Test methods for hot mix asphalt — Part 7: Determination of bulk density of bituminous specimens by gamma rays*

prEN 12697-8:1996, *Bituminous mixtures — Test methods for hot mix asphalt — Part 8: Determination of the air voids content of bituminous materials*

prEN 12697-9:1997, *Bituminous mixtures — Test methods for hot mix asphalt — Part 9: Determination of the reference density, gyrator compactor*

prEN 12697-10:1996, *Bituminous mixtures — Test methods for hot mix asphalt — Part 10: Compactibility*

prEN 12697-11:1999, *Bituminous mixtures — Test methods for hot mix asphalt — Part 11: Determination of the affinity between aggregate and bitumen*

prEN 12697-12:1999, *Bituminous mixtures — Test methods for hot mix asphalt — Part 12: Determination of the water sensitivity of bituminous specimens*

EN 12697-13, *Bituminous mixtures — Test methods for hot mix asphalt — Part 13: Temperature measurement*

EN 12697-14, *Bituminous mixtures — Test methods for hot mix asphalt — Part 14: Water content*

prEN 12697-15:1997, *Bituminous mixtures — Test methods for hot mix asphalt — Part 15: Determination of the segregation sensitivity of bituminous mixtures*

prEN 12697-16:2000, *Bituminous mixtures — Test methods for hot mix asphalt — Part 16: Abrasion by studded tyres*

prEN 12697-17, *Bituminous mixtures — Test methods for hot mix asphalt — Part 17: Particle loss of specimen*

prEN 12697-18:1997, *Bituminous mixtures — Test methods for hot mix asphalt — Part 18: Binder drainage from porous asphalt*

prEN 12697-19:2000, *Bituminous mixtures — Test methods for hot mix asphalt — Part 19: Permeability of specimen*

prEN 12697-20:1999, *Bituminous mixtures — Test methods for hot mix asphalt — Part 20: Indentation using cube or Marshall specimens*

prEN 12697-21:1999, *Bituminous mixtures — Test methods for hot mix asphalt — Part 21: Indentation using plate specimens*

prEN 12697-22:1999, *Bituminous mixtures — Test methods for hot mix asphalt — Part 22: Wheel tracking*

prEN 12697-23:1999, *Bituminous mixtures — Test methods for hot mix asphalt — Part 23: Determination of the indirect tensile strength of bituminous specimens*

prEN 12697-24:1999, *Bituminous mixtures — Test methods for hot mix asphalt — Part 24: Resistance to fatigue*

prEN 12697-25, *Bituminous mixtures — Test methods for hot mix asphalt — Part 25: Dynamic creep test*

prEN 12697-26:1999, *Bituminous mixtures — Test methods for hot mix asphalt — Part 26: Stiffness*

EN 12697-27, *Bituminous mixtures — Test methods for hot mix asphalt — Part 27: Sampling*

EN 12697-28, *Bituminous mixtures — Test methods for hot mix asphalt — Part 28: Preparation of samples for determining binder content, water content and grading*

prEN 12697-29:1996, *Bituminous mixtures — Test methods for hot mix asphalt — Part 29: Determination of the dimensions of bituminous specimen*

prEN 12697-30:2000, *Bituminous mixtures — Test methods for hot mix asphalt — Part 30: Specimen preparation, impact compactor*

prEN 12697-31:2000, *Bituminous mixtures — Test methods for hot mix asphalt — Part 31: Specimen preparation, gyratory compactor*

prEN 12697-32:1997, *Bituminous mixtures — Test methods for hot mix asphalt — Part 32: Laboratory compaction of bituminous mixtures by a vibratory compactor*

prEN 12697-33:1999, *Bituminous mixtures — Test methods for hot mix asphalt — Part 33: Specimen preparation, slab compactor*

prEN 12697-34:1999, *Bituminous mixtures — Test methods for hot mix asphalt — Part 34: Marshall test*

prEN 12697-35, *Bituminous mixtures — Test methods for hot mix asphalt — Part 35: Laboratory mixing*

prEN 12697-36:1996, *Bituminous mixtures — Test methods for hot mix asphalt — Part 36: Method for the determination of the thickness of a bituminous pavement*

prEN 12697-37:1999, *Bituminous mixtures — Test methods for hot mix asphalt — Part 37: Hot sand test for the adhesivity of binder on precoated chippings for HRA*

prEN 12697-38, *Common equipment and calibration*

The applicability of this European Standard is described in the product standards for bituminous mixtures.

No existing European Standard is superseded.

1 Scope

This European Standard describes test methods for preparing test portions for the determination of the binder, water content and grading of samples of bituminous mixtures, when the sample submitted to the laboratory has a mass greater than or equal to four times the test portion.

2 Normative references

This European Standard incorporates by dated or undated reference, provisions from other publications. These normative references are cited at the appropriate places in the text and the publications are listed hereafter. For dated references, subsequent amendments to or revisions of any of these publications apply to this European Standard only when incorporated in it by amendment or revision. For undated references the latest edition of the publication referred to applies (including amendments).

EN 58, *Sampling bituminous binders*.

EN 932-1, *Tests for general properties of aggregates — Part 1: Methods for sampling*.

prEN 12697-36:1996, *Bituminous mixtures — Test methods for hot mix asphalt — Part 36: Method for the determination of the thickness of a bituminous pavement*.

3 Terms and definitions

For the purposes of this European Standard, the terms and definitions given in EN 58 and the following apply.

3.1

representative sample

bulk sample consisting of a specified number of increments purposely taken to represent a specific quantity or area of material

NOTE A representative sample is assumed to have the same composition as the material sampled, within the limits of precision associated with the method of sampling.

3.2

laboratory sample

sample despatched to the laboratory

NOTE It may be the whole or part of the bulk or representative sample and should be of sufficient quantity for all tests required.

3.3

test portion

part of the laboratory sample to be used for a specific test procedure to produce a single test result

3.4

test specimen

part of the test portion on which a single test is carried out

NOTE A number of tests may be necessary to produce a test result.

3.5

test result

result obtained by applying the test procedure to a test portion

NOTE When the test procedure is required to be carried out on more than one test specimen, the test result will be calculated as the mean result of a number of determinations.

4 Apparatus

4.1 Balance

4.2 Ruler

4.3 Circular saw, capable of cutting stone

4.4 Oven, conventional or microwave

4.5 Stopwatch

4.6 Metal tray (optional)

4.7 Sample splitter in accordance with EN 932-1 (such as that shown in Figure 1), optional

4.8 Shovel

4.9 Container

5 Preparation of laboratory samples of bituminous mixtures

5.1 Preliminary inspection and storage

5.1.1

On receipt of the laboratory sample inspect it and record its condition.

5.1.2

If a slab or a core cut from compacted material is to be stored prior to examination or separation of courses, take care so as to minimize deformation or deterioration of the material. Store slabs on a clean, hard, flat surface, preferably out of direct sunlight, with the final rolled surface at the bottom.

NOTE Cores of well compacted materials made with high viscosity binders will normally keep well standing vertically upside down on a clean bench in a cool room, but cores cut from less stable materials may require refrigeration especially for porous asphalt cores.

5.2 Pre-treatment of laboratory samples taken before and during laying

5.2.1 Binder drainage

If any binder drainage has occurred, collect and weigh as much of the drained material as possible and record the details. When the laboratory sample has been reduced to a suitable size for testing, add a proportionate representative weighed fraction of the drained material to the test portion. Record if the drained material can not be collected.

5.2.2 Uncoated aggregate

Record the presence of any uncoated or fractured aggregate but do not remove such aggregate.

5.3 Pre-treatment of laboratory samples taken after laying

5.3.1 General

If possible, record the average thickness (or thickness if there is more than one course) in accordance with prEN 12697-36:1996 and the presence of any extraneous material. Remove all extraneous material in accordance with the appropriate clause of this European Standard. If complete removal is not possible, this shall be recorded.

NOTE In most cases, total removal can only be effected by sawing.

5.3.2 Coated chippings

If possible, remove chippings by hand before starting the tests. If removal is not possible (e.g. due to deep embedment), record this and proceed with the tests.

NOTE 1 Coated chippings may normally be removed with a suitable tool after warming the sample. For this purpose a temperature approximately 40 °C below the appropriate maximum temperature given in Table 1 is suitable.

NOTE 2 It may be possible to identify and remove the chippings after extraction of the binder and if this is done an allowance for the mass of the chippings should be made in the test and the fact recorded on the test report.

5.3.3 Surface dressings

Remove any surface dressing, if possible. Record the presence of any visible penetration of the surface dressing binder into the sample.

NOTE Total removal will require sawing.

5.3.4 Tack coat or blinding grit

Record the presence of any tack coat or blinding grit.

5.3.5 Fractured aggregate

Record the presence of any fractured aggregate but do not remove such aggregate.

NOTE To reduce the effect of fractured aggregate on the test result, slabs are preferred to cores.

5.3.6 Multi-course slab or core

If necessary, use a circular, stone cutting saw to separate courses, particularly with core samples. In situations where this approach and other physical methods of cold separation are impractical, lay the slab or core upside down on a clean sheet metal tray and warm it in a conventional oven just sufficiently to soften the material so that the courses may be separated.

NOTE 1 In some cases, insertion at the interface of the courses of a paint-stripping knife with a wide blade, or similar tool, will assist in the separation.

NOTE 2 Only when other representative samples are not available should the separation of the courses of a sample that has broken be attempted. In such cases if separation by hand picking is attempted, test results will be unreliable and this should be clearly stated in the test report.

5.3.7 Free water

If the water content is not being determined and free water is visible on the material, or if the laboratory sample feels wet to the touch or if there is any reason to suppose that the material may contain water that is unevenly dispersed, break the material into pieces, after warming if necessary, of such a size that the water can readily evaporate. Leave the broken material exposed as a thin layer on a clean, hard surface, in a laboratory for at least 24 h at $(21 \pm 3) ^\circ\text{C}$. Then treat the sample as described in 5.4 or 5.5 as appropriate.

5.4 Heat treatment before reducing the laboratory sample

5.4.1

Determine an accurate water content of the sample before sample reduction using no more heat than is required to facilitate the breaking up of the sample.

5.4.2

Treat laboratory samples that can not be remixed at room temperature as follows. Heat the entire sample or separated course in a suitable oven at a temperature not exceeding the appropriate value given in Table 1 until it is just sufficiently soft to be readily mixed and divided. Do not leave the material in the oven for more than 4 h.

NOTE 1 The temperature and time constraints minimize loss of the volatile constituents of the binder.

NOTE 2 Conventional ovens are considered suitable for most instances. However, for the preparation of soft asphalt samples that may include light components, the use of a microwave oven may reduce the risk of binder hardening.

Table 1 — Temperatures of the oven for reheating laboratory samples prior to sample reduction

Nominal grade of binder in sample	Maximum temperature of oven °C
> 330 penetration at 25 °C	105
Above 60 up to 330 penetration at 25 °C	120
25 to 60 penetration at 25 °C	135
Less than 25 penetration at 25 °C	150

5.5 Sample reduction for the determination of binder content, water content and grading

5.5.1

Weigh the entire laboratory sample, or each portion representing the separate courses, and place on a clean hard surface, e.g. a sheet metal tray. Mix the material thoroughly and reduce it to the quantity required for test, as given in Table 2, either by using a sample splitter, which may be heated or slightly oiled or by quartering as described in 5.5.2 to 5.5.8.

NOTE 1 The use of a sample splitter for nominal sizes of 20 mm and larger is likely to be quicker and will provide a sample of accuracy equal to or greater than that obtained by quartering. The width of the chutes should be at least 1,5 times the diameter of the largest aggregate.

NOTE 2 Oil used for lubricating the sample splitter should be kept to a minimum and be light oil, not diesel (gas oil).

NOTE 3 By assuming equal subdivision of the laboratory sample after each quartering process it is possible, by weighing the original sample, to estimate whether the mass remaining after quartering will be within the appropriate range given in Table 2. If the estimated mass is above the upper limit of the appropriate range given in Table 2, the mass of the original sample may be reduced by one quarter. This should be done by quartering twice, rejecting two opposite quarters from the second quartering process, combining the remainder from the second quartering process with the material put aside from the first quartering process and then carrying out the procedure as described in 5.5.2 to 5.5.8 (see Figures 2 and 3).

Table 2 — Mass of material for each determination

Type of material	Largest size of aggregate mm	Mass of test portion for each determination	
		Minimum (Normative) g	Maximum (Informative) g
Bituminous mixture	63 or 45	3 000	5 000
	40	2 500	4 000
	31,5	1 500	2 800
	22,4 or 20	1 000	2 000
	16 or 14 or 12,5	800	1 400
	11,2 or 10 or 8	300	1 000
	6,3 or 5,6 or 4 or 2	150	500
Coated chippings	All sizes	2 000	3 000
NOTE Maximum masses are given for guidance only.			

5.5.2

Mix the material thoroughly by heaping it into a cone and turning it over to form a new cone three times as described in 5.5.3 to 5.5.8.

5.5.3

Form a conical heap by depositing each shovelful of the material on the apex of the cone. Distribute any material that rolls down the sides as evenly as possible, so that the centre of the cone is not displaced. Push back to the edge of the heap any larger pieces of aggregate that may scatter round the base.

5.5.4

Flatten the third cone formed from the mixed sample by repeated vertical insertions of the edge of a shovel or board, commencing about the centre and working progressively round the cone, lifting the shovel or board clear of the material after each insertion.

5.5.5

Ensure that the heap thus formed is reasonably uniform in thickness and diameter and that its centre coincides with the centre of the cone from which it was produced.

5.5.6

Quarter the heap along two diameters that intersect at right angles. Combine one pair of diagonally opposite quarters and discard the remainder.

5.5.7

Repeat 5.5.2 to 5.5.6 until the mass remaining is about four times the mass of the required test specimen. When required, repeat 5.5.2 to 5.5.6 once more and set aside, in a sealed container, for the estimations of water content the quarters that would otherwise be discarded. However, if the binder content and hence water content is to be calculated using the hot extractor method discard these quarters.

5.5.8

Repeat 5.5.2 to 5.5.6 once more to obtain the required test specimen.

NOTE 1 The use of a quartering cross of wood or sheet metal, which can be forced through the heap, often facilitates quartering in cases where the material tends to segregate.

NOTE 2 If drained binder was collected during the earlier treatment of the sample (see 5.2.1) a proportionate amount of binder should be added to the test specimen.

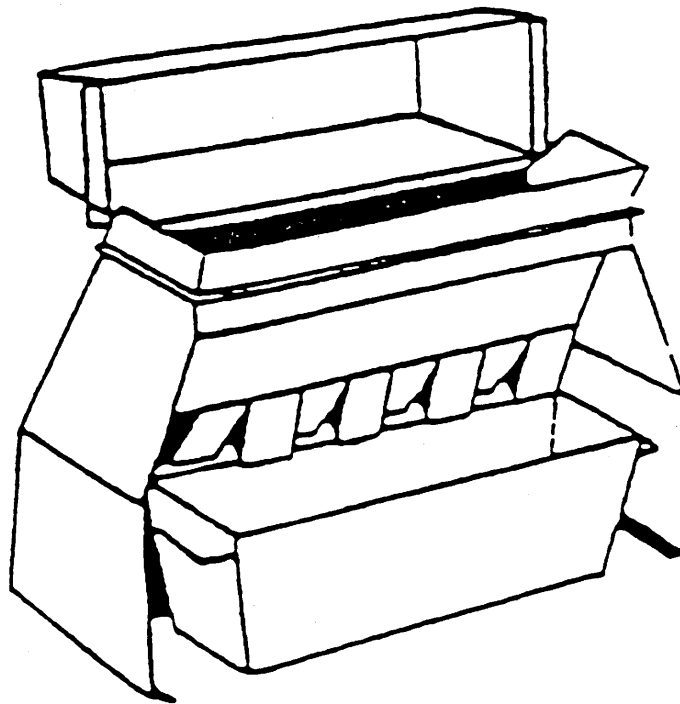


Figure 1 — Typical sample splitter

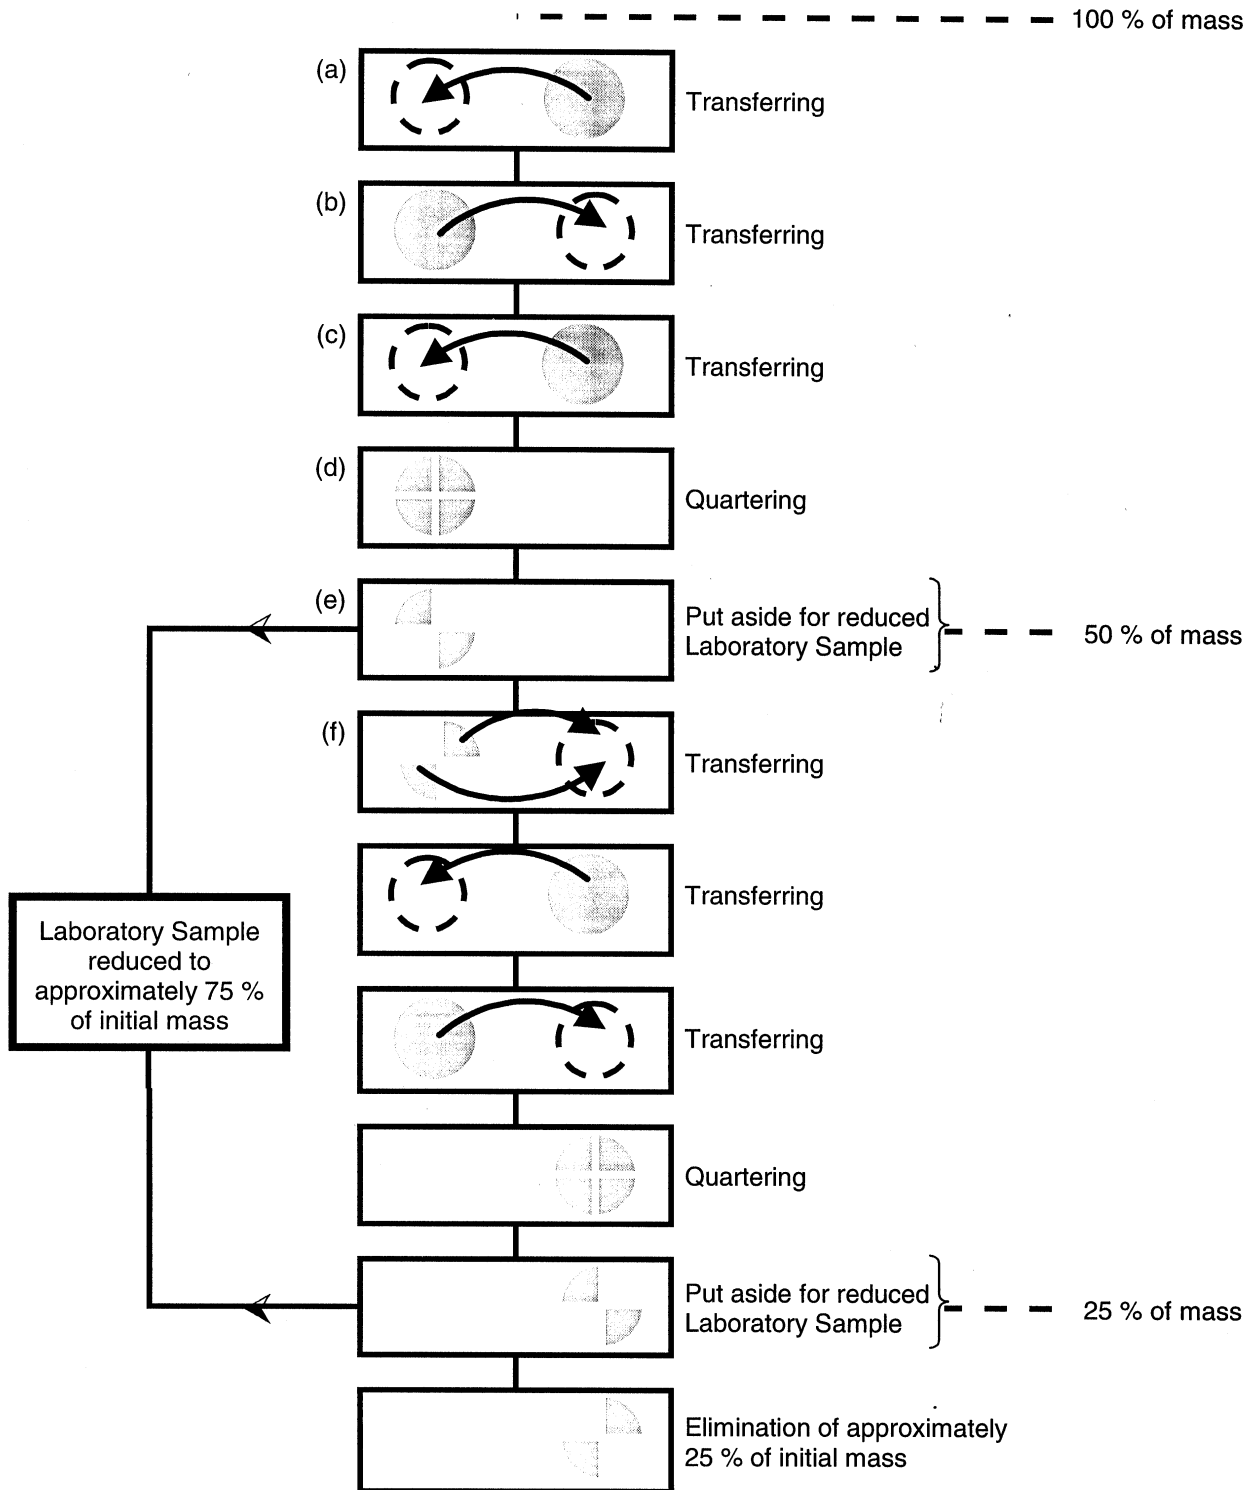


Figure 2 — Diagram of subdivision to reduce mass of laboratory sample by one quarter

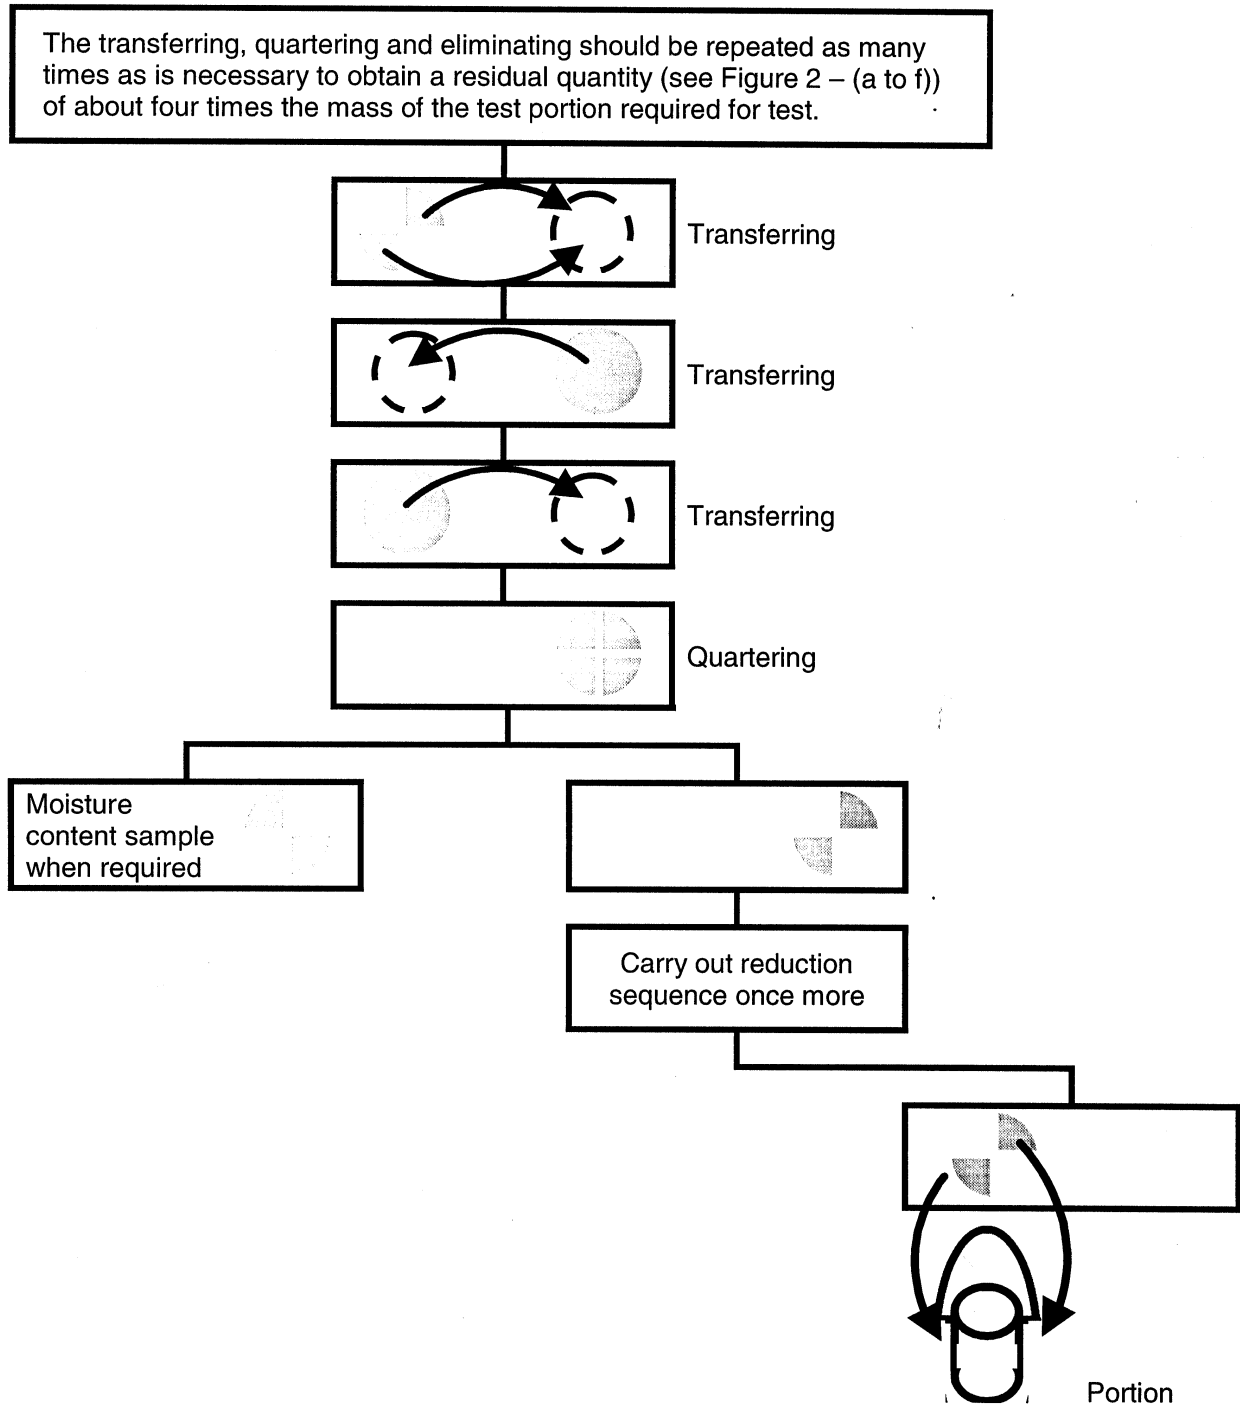


Figure 3 — Diagram of subdivision to provide test portion for both water content and binder content

BSI — British Standards Institution

BSI is the independent national body responsible for preparing British Standards. It presents the UK view on standards in Europe and at the international level. It is incorporated by Royal Charter.

Revisions

British Standards are updated by amendment or revision. Users of British Standards should make sure that they possess the latest amendments or editions.

It is the constant aim of BSI to improve the quality of our products and services. We would be grateful if anyone finding an inaccuracy or ambiguity while using this British Standard would inform the Secretary of the technical committee responsible, the identity of which can be found on the inside front cover. Tel: 020 8996 9000. Fax: 020 8996 7400.

BSI offers members an individual updating service called PLUS which ensures that subscribers automatically receive the latest editions of standards.

Buying standards

Orders for all BSI, international and foreign standards publications should be addressed to Customer Services. Tel: 020 8996 9001. Fax: 020 8996 7001. Standards are also available from the BSI website at <http://www.bsi-global.com>.

In response to orders for international standards, it is BSI policy to supply the BSI implementation of those that have been published as British Standards, unless otherwise requested.

Information on standards

BSI provides a wide range of information on national, European and international standards through its Library and its Technical Help to Exporters Service. Various BSI electronic information services are also available which give details on all its products and services. Contact the Information Centre. Tel: 020 8996 7111. Fax: 020 8996 7048.

Subscribing members of BSI are kept up to date with standards developments and receive substantial discounts on the purchase price of standards. For details of these and other benefits contact Membership Administration. Tel: 020 8996 7002. Fax: 020 8996 7001. Further information about BSI is available on the BSI website at <http://www.bsi-global.com>.

Copyright

Copyright subsists in all BSI publications. BSI also holds the copyright, in the UK, of the publications of the international standardization bodies. Except as permitted under the Copyright, Designs and Patents Act 1988 no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means – electronic, photocopying, recording or otherwise – without prior written permission from BSI.

This does not preclude the free use, in the course of implementing the standard, of necessary details such as symbols, and size, type or grade designations. If these details are to be used for any other purpose than implementation then the prior written permission of BSI must be obtained.

If permission is granted, the terms may include royalty payments or a licensing agreement. Details and advice can be obtained from the Copyright Manager. Tel: 020 8996 7070.