

Products and systems for the protection and repair of concrete structures — Test methods — Determination of resistance to carbonation

The European Standard EN 13295:2004 has the status of a
British Standard

ICS 91.080.40

National foreword

This British Standard is the official English language version of EN 13295:2004.

The UK participation in its preparation was entrusted by Technical Committee B/517, Concrete, to Subcommittee B/517/8, Protection and repair of concrete structures, which has the responsibility to:

- aid enquirers to understand the text;
- present to the responsible international/European committee any enquiries on the interpretation, or proposals for change, and keep the UK interests informed;
- monitor related international and European developments and promulgate them in the UK.

A list of organizations represented on this subcommittee can be obtained on request to its secretary.

Cross-references

The British Standards which implement international or European publications referred to in this document may be found in the *BSI Catalogue* under the section entitled “International Standards Correspondence Index”, or by using the “Search” facility of the *BSI Electronic Catalogue* or of British Standards Online.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

Compliance with a British Standard does not of itself confer immunity from legal obligations.

Summary of pages

This document comprises a front cover, an inside front cover, the EN title page, pages 2 to 15 and a back cover.

The BSI copyright notice displayed in this document indicates when the document was last issued.

Amendments issued since publication

Amd. No.	Date	Comments

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 12 July 2004

© BSI 12 July 2004

ISBN 0 580 44036 2

EUROPEAN STANDARD

EN 13295

NORME EUROPÉENNE

EUROPÄISCHE NORM

May 2004

ICS 91.080.40

English version

Products and systems for the protection and repair of concrete structures - Test methods - Determination of resistance to carbonation

Produits et systèmes de protection et de réparation des structures en béton - Méthodes d'essai - Détermination de la résistance à la carbonatation

Produkte und Systeme für den Schutz und die Instandsetzung von Betontragwerken - Prüfverfahren - Bestimmung des Karbonatisierungswiderstands

This European Standard was approved by CEN on 24 March 2004.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Central Secretariat or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the Central Secretariat has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

Management Centre: rue de Stassart, 36 B-1050 Brussels

Contents

Page

Foreword.....	3
1 Scope	4
2 Normative references	4
3 Terms and definitions.....	4
4 Principle.....	5
5 Equipment.....	5
6 Preparation	5
6.1 General.....	5
6.2 Mixing and curing	6
6.3 Dry conditioning.....	6
7 Procedure	7
7.1 General.....	7
7.2 Standard measuring procedure.....	7
7.3 Effect of dense aggregates	8
7.4 Effect of voids / porous aggregates / extreme values of d_{max}	8
8 Precision and reproducibility	8
9 Test results and test reports.....	8
Annex A (normative) Summary of temperatures and humidities for the curing, conditioning and testing of repair products and systems	14
A.1 Curing.....	14
A.2 Standard laboratory climate	14
Bibliography	15

Foreword

This document (EN 13295:2004) has been prepared by Technical Committee CEN/TC 104 "Concrete and related products", the secretariat of which is held by DIN.

It has been prepared by sub-committee 8 "Protection and repairs of concrete structures" (Secretariat AFNOR).

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by November 2004, and conflicting national standards shall be withdrawn at the latest by November 2004.

Annex A is normative.

This European Standard is one of a series dealing with products and systems for the protection and repair of concrete structures. It describes a method for determining the resistance to carbonation of a test specimen made from a repair product or system, excluding application of a protective coating system.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom.

1 Scope

This European Standard specifies an accelerated laboratory method for measuring the resistance against carbon dioxide penetration through repair products and systems, as defined in prEN 1504-3. The method is based on measurement of the depth of carbonation of the sample in a concentrated carbon dioxide atmosphere over a fixed time interval. The method is suitable for assessing the performance of repair grouts, mortars and concretes without a protective coating system applied.

The method does not measure the resistance to reduction in pH-value that may occur by absorption of other acidic gases (e.g. SO₂, HCl).

2 Normative references

This European Standard incorporates, by dated or undated reference, provisions from other publications. These normative references are cited at the appropriate places in the text and the publications are listed hereafter. For dated references, subsequent amendments to or revisions of any of these publications apply to this European Standard only when incorporated in it by amendment or revision. For undated references the latest edition of the publication referred to applies (including amendments).

EN 196-1, *Methods of testing cement — Part 1: Determination of strength*.

EN 1504-1:1998, *Products and systems for the protection and repair of concrete structures — Definitions, requirements, quality control and evaluation of conformity — Part 1: Definitions*.

EN 1015-2, *Methods of test for mortar for masonry — Part 2: Bulk sampling of mortars and preparation of test mortars*.

EN 1766, *Products and systems for the protection and repair of concrete structures — Test methods — Reference concretes for testing*.

prEN 14630:2003, *Products and systems for the protection and repair of concrete structures — Test methods — Determination of carbonation depth in hardened concrete by the phenolphthalein method*.

3 Terms and definitions

For the purposes of this European Standard, the terms and definitions given in EN 1504-1:1998 and the following apply.

3.1 Carbonation
alkaline components (e.g. calcium hydroxide) in the cement paste react with atmospheric carbon dioxide, after which the pH of the mortar or concrete is reduced.

3.2 Carbonation Depth
carbonation depth (d_k) is the average distance, measured in mm, from the surface of the concrete or mortar where the carbon dioxide (CO₂) has reduced the alkalinity of the hydrated cement to an extent such that an indicator solution based on phenolphthalein remains colourless.

4 Principle

The resistance of the repair product or system against carbonation is measured by an accelerated laboratory test, where samples are exposed to an atmosphere containing 1 % CO₂ at a temperature of (21 ± 2) °C and relative humidity (RH) of (60 ± 10) %.

NOTE The concentration of 1 % CO₂ in air develops the same reaction products with hydrated cement as a normal atmosphere at 0,03 % CO₂. The relative humidity of (60 ± 10) % results in the fastest rate of carbonation of CC and PCC materials.

The carbonation depth is measured by applying phenolphthalein indicator on a freshly broken piece of the specimen, following the procedure set out in clause 4.2 of prEN 14630:2003. The same specimen may be used several times to measure the increase in carbonation depth with time, by removing a small slice of the specimen for each measurement.

5 Equipment

5.1 Sealed cabinet for specimen exposure, with provision for gas inlets and outlets such that a uniform flow of CO₂ reaches all parts of the cabinet.

5.2 Gas supply of 1 % CO₂ in air, which should be supplied in a premixed bottled form.

5.3 Humidity controller designed to maintain (60 ± 10) % RH inside the cabinet in the presence of concrete samples that react with CO₂ to liberate extra moisture.

5.4 Phenolphthalein solution comprising 1 g of phenolphthalein indicator in a solution of 70 ml ethanol and 30 ml demineralised water.

5.5 Concrete cutting tools including a hammer and chisel for breaking pieces off the specimens.

5.6 Moulds for producing specimens made from non absorbent, rigid material, not attacked by cement paste or polymers.

5.7 Mortar mixer, in accordance with EN 196-1, or **forced action pan mixer**.

5.8 Compaction tools and equipment for repair grouts, mortars and concretes according to EN 196-1 or EN 1015-2.

NOTE The compaction method should be in accordance with the manufacturer's instructions.

5.9 Curing and conditioning room in accordance with annex A.

5.10 Measuring equipment, e.g. ruler or calliper.

6 Preparation

6.1 General

The test shall be carried out on rectangular specimens of various sizes. For a grout, mortar or concrete, a prism-shaped specimen to EN 196-1 40 mm x 40 mm x 160 mm shall be the minimum size used. For a concrete, with a maximum aggregate size of > 10 mm the minimum size of specimen shall be 100 mm x 100 mm x 400 mm.

The test is carried out on two parallel samples of repair product or system, and compared alongside two samples of control concrete.

6.2 Mixing and curing

Unless otherwise instructed by the manufacturer, use the following mixing technique for preparing the specimens.

For PCC and CC mortar, use the mortar mixer (5.7) set to a low speed, pouring the liquid into the bowl and adding the dry ingredients, mixing for a total period of two minutes.

For concrete mixes that contain coarse aggregates (> 4 mm), preparation shall be in accordance with EN 196-1, using a concrete mixer (5.7), or as otherwise instructed by the manufacturer. Where manufacturers' instructions preclude use of part bags of material, a concrete mixer (5.7) or other method recommended by the manufacturer shall be used.

NOTE 1 It has been found that certain types of repair mortar can foam excessively under the action of the mortar mixer specified in EN 196-1. An alternative is to use a concrete mixer (5.7).

Place the mixed material carefully into the moulds, compacting thoroughly. The specimens shall be finished flush with the sides of the mould using a steel float.

NOTE 2 The air content, strength and density of the CC and PCC mixes should normally be determined to characterise the mortar under test.

The specimens to be tested shall be compared against prisms of reference concrete type C (0,45), as defined in EN 1766. No air entraining admixture shall be used in the mix. The moulds shall be at least 100 mm x 100 mm x 400 mm and shall be filled and compacted on a vibrating table.

All specimens shall be stripped from their moulds and then cured in accordance with the requirements of annex A. The sides of the specimens shall be free from contaminants (e.g. demoulding agents or other materials), which could influence the carbonation rate.

6.3 Dry conditioning

The test specimens and concrete control specimens shall be brought to an even moisture content by storage in the standard laboratory climate defined in annex A, until the weight change is less than 0,2 % in a 24-hour period.

NOTE The necessary period of storage shall be at least 14 days.

7 Procedure

7.1 General

After preparation and conditioning, the specimens shall be placed on knife edge supports inside the sealed cabinet and exposed to the test gas, adjusting the flow rate to provide positive pressure.

NOTE The gas flow rate into the chamber will depend on the size of chamber and number of specimens behaving as CO₂ absorbers. The flow rate should be checked and verified as satisfactory by periodic sampling of the gas in representative areas of the cabinets, including likely still-air positions.

The depth of carbonation (d_k) shall be measured for both the test specimen and control concrete specimen at the end of the Dry conditioning period and then after 56 days in the cabinet.

The depth of carbonation shall be measured, using the procedure given in prEN 14630:2003 clause 4.2, on freshly broken faces from each prism. For each measurement a slice of 15 mm minimum thickness shall be broken off the prism using the chisel or bolster and the piece sprayed with the phenolphthalein indicator solution. Measurement of the depth of carbonation shall then be made (60 ± 5) min after spraying. The carbonation depth for the specimen (d_k) is the average depth on all four sides, measured in accordance with the following procedure, with Side 1 being the trowelled face.

7.2 Standard measuring procedure

7.2.1 General

The result should produce a level, pink coloration in the uncarbonated concrete on each side of the specimen except for the edges, which are rounded and should be ignored for the measurement. The standard result is termed shape A as shown in Figure 1a. The normal length (l) of level surface shall be not less than 30 mm.

NOTE Greater depths of carbonation occur in the corner areas of specimens, where carbon dioxide can penetrate from two sides at once. This effect should be omitted from the calculation.

For each surface in turn, the length of level surface (l) shall be divided into four equal parts, forming five points, as shown in Figure 1a. With the help of a ruler or calliper (**5.10**) the carbonation depth shall be measured at each point, determined perpendicular to the surface, to the nearest 0,1 mm. The average carbonation depth (e.g. d_{k1}) on that side of the specimen shall be calculated from the five individual values, rounded to the nearest 0,5 mm. The measurement shall then be repeated for the three remaining sides. The average of these four calculated values is the average carbonation depth (d_k) for the specimen.

The measurements shall then be repeated for the duplicate specimen. The carbonation depth on duplicate specimens should not differ by more than 20 %. If the difference is ≥ 20 %, both values should be reported. If the difference is < 20 %, report the average value.

If the edges of the uncarbonated area are rounded, reducing the length of the level portion on one or more sides (l) to less than 30 mm, then a shorter length may be used, to a minimum of 20 mm. The reduced length shall be divided into two equal parts, giving three measurement points, calculating the average carbonation depth (e.g. d_{k1}) from the three measurements (see Figure 1b) and then the average for all four sides (d_k).

If $l < 20$ mm, the test shall be halted and a larger prismatic specimen used.

If the carbonation front does not run as a straight line parallel to the surface, as shown in Figure 1, but is of uneven depth on one or more sides of the specimen, then the results for that side shall not be used in calculating the average result for the specimen and the depth of carbonation for that side (or sides) shall be determined in the following manner.

7.2.2 Wave front, shown as shape B in Figure 2a: in this case an estimated average value (d_{k1}) shall be calculated, using a graphical or equivalent method, and the maximum value ($d_{k1,max}$) shall also be recorded.

7.2.3 Isolated deep carbonation, shown as shape C in Figure 2b: in this case the average depth (d_{k1}) shall be determined in accordance with the standard procedure, recording also the maximum depth of carbonation ($d_{k1,max}$). If the difference between the results for any one side (e.g. d_{k1} and $d_{k1,max}$) is greater than 4 mm, then both the maximum depth and the average for that side (d_{k1}) shall be reported.

7.3 Effect of dense aggregates

Dense aggregate that is lying within the carbonation front will not be coloured by the phenolphthalein solution and the carbonation front will be interrupted (Figure 3a). Where such aggregate coincides with a measuring point, the carbonation front (e.g. d_{k1}) shall be drawn through the aggregate, connecting the limits on each side of the grain.

7.4 Effect of voids / porous aggregates / extreme values of d_{max}

When there are voids in the concrete or pieces of porous aggregate in the carbonation front, high values of carbonation depth may occur (Figure 3b). When the values of d_{max} are less than 4 mm for concrete or 1,5 mm for mortar, they can be ignored. With higher values of d_{max} , an estimate of the maximum depth of carbonation shall be given.

8 Precision and reproducibility

The precision of the carbonation measurements, expressed as a standard deviation is:

$$sd = 0,5 \text{ mm}$$

The reproducibility (i.e. the variation between laboratories using the same materials), expressed as standard deviation, depends on the depth of carbonation and can be calculated from the following formula:

$$sd = 0,21 d_k + 0,64$$

where

d_k is the average carbonation depth.

9 Test results and test reports


The test report shall include the following information:

- a) reference to the test method standard;
- b) name and address of the test laboratory;
- c) identification number and date of the test;
- d) name and address of the manufacturer or supplier of the product;
- e) name and identification marks or batch number of the product;
- f) date of supply of the product;

- g) date of preparation of the test specimens and any deviation from the prescribed method of preparation;
- h) conditions of storage of prepared specimens prior to test, including curing and conditioning data for the test specimens, (duration, temperature, RH) and environmental conditions during the test (temperature, RH, CO₂ concentration);
- i) date of test and details of the test equipment used, including the make, type and capacity and the calibration details or the identification number of the apparatus;
- j) test results for the specimens and the control concrete, including: the average depth of carbonation on each side (i.e. d_{k1} , d_{k2} , d_{k3} , d_{k4}) to the nearest 0,5 mm with details of the position of the face relative to the trowelled face; the shape of the carbonation front (i.e. shape A (normal), B or C); other irregularities in the shape of the carbonation front from the normal shape A, including values of d_{kmax} where required (i.e. as shown in Figures 2 & 3); the mean value of all four sides for each specimen (d_k) (where appropriate).

NOTE The results should be expressed in tabular form, including specimen dimensions, carbonation depth, exposure time. The results may also include a photograph of the phenolphthalein-sprayed fracture surface.

- k) precision data;
- l) date of test report and signature.

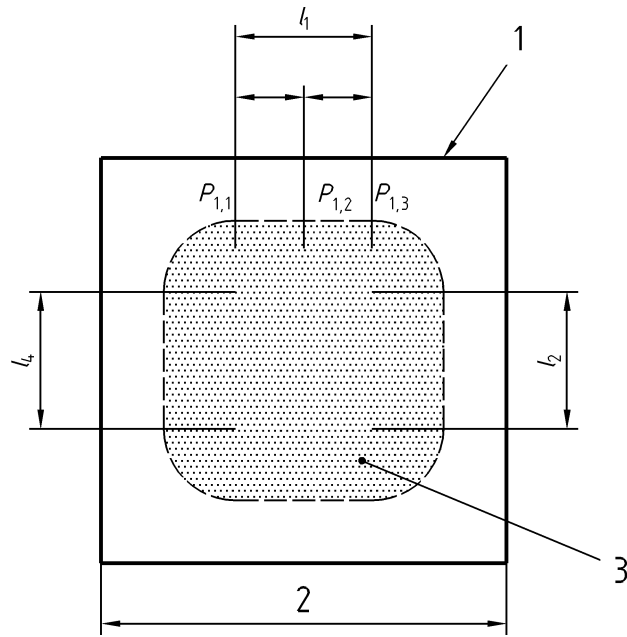

$$d_{k,1} = \frac{\sum(p_{1,1-3})}{3}$$


20 mm ≤ l < 30 mm

Key

- 1 Side 1, trowelled face
- 2 Prism side dimension
- 3 Area stained pink by phenolphthalein indicator solution

Figure 1b — Shape A, large corner effect, with three measurements per side


Figure 1 — Standard carbonation, Shape A

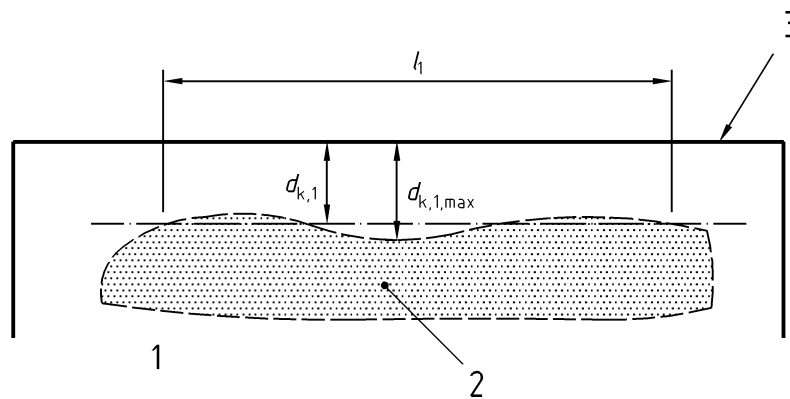

Key

- 1 $d_{k,1}$ determined graphically
- 2 Area stained pink by phenolphthalein indicator solution
- 3 Side 1, trowelled face

Figure 2a — Shape B, with irregular profile

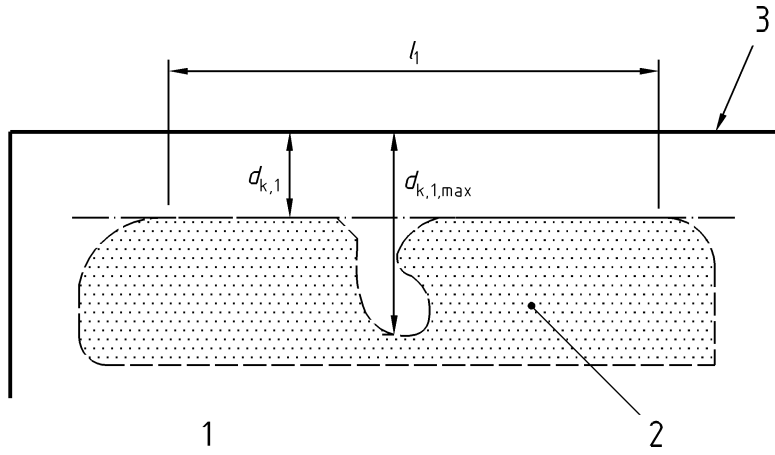

Key

- 1 $d_{k,1}$ determined graphically
- 2 Area stained pink by phenolphthalein indicator solution
- 3 Side 1, trowelled face

Figure 2b — Shape C, with local deep carbonation

Figure 2 — Abnormal profiles for the carbonation front


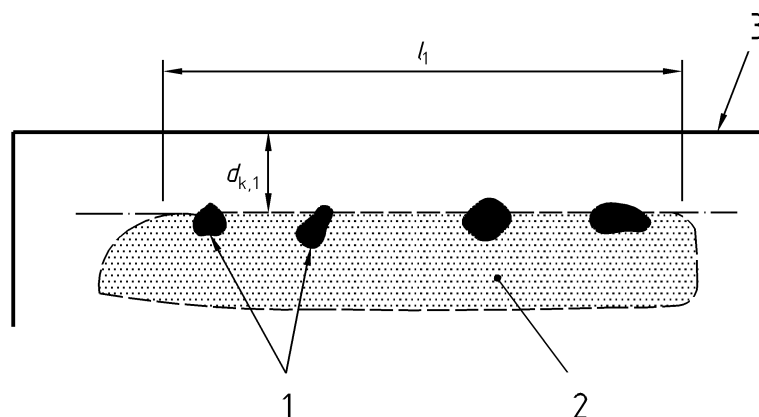


Figure 3a — Interference from large, dense aggregate pieces

Key

- 1 Dense aggregate pieces
- 2 Area stained pink by phenolphthalein indicator solution
- 3 Side 1 trowelled face

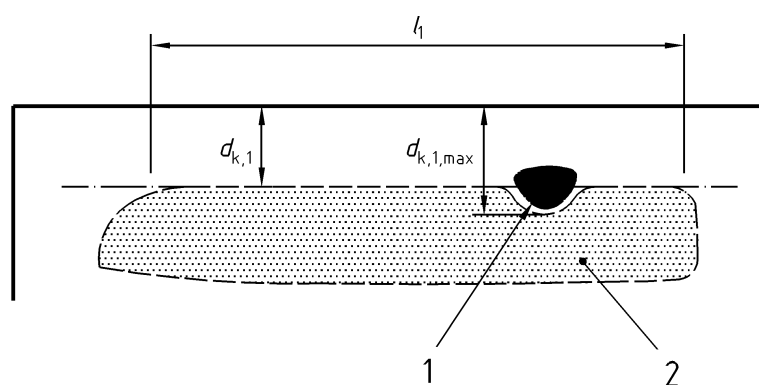

Key

- 1 Carbonate proceeding through porous aggregate
- 2 Area stained pink by phenolphthalein indicator solution

Figure 3b — Influence of porous aggregate pieces

Figure 3 — Influence of aggregate

Annex A (normative)

Summary of temperatures and humidities for the curing, conditioning and testing of repair products and systems

A.1 Curing

A.1.1 CC (grouts, mortars and concretes)

- Prepare as EN 196-1, cover in film for 24 h.
- Demould after 24 h.
- Cure under water at (21 ± 2) °C for 27 days.

A.1.2 PCC (grouts, mortars and concretes)

- Prepare as EN 196-1, cover in film for 24 h.
- Demould after 24 h and wrap in film for 48 h.
- Unwrap and cure for 25 days in a standard laboratory climate of (21 ± 2) °C and (60 ± 10) % RH.

A.2 Standard laboratory climate

- (21 ± 2) °C and (60 ± 10) % RH.

Bibliography

prEN 1504-3, *Products and systems for the protection and repair of concrete structures — Definitions, requirements, quality control and evaluation of conformity — Part 3: Structural and non-structural repair.*

BSI — British Standards Institution

BSI is the independent national body responsible for preparing British Standards. It presents the UK view on standards in Europe and at the international level. It is incorporated by Royal Charter.

Revisions

British Standards are updated by amendment or revision. Users of British Standards should make sure that they possess the latest amendments or editions.

It is the constant aim of BSI to improve the quality of our products and services. We would be grateful if anyone finding an inaccuracy or ambiguity while using this British Standard would inform the Secretary of the technical committee responsible, the identity of which can be found on the inside front cover.
Tel: +44 (0)20 8996 9000. Fax: +44 (0)20 8996 7400.

BSI offers members an individual updating service called PLUS which ensures that subscribers automatically receive the latest editions of standards.

Buying standards

Orders for all BSI, international and foreign standards publications should be addressed to Customer Services. Tel: +44 (0)20 8996 9001.
Fax: +44 (0)20 8996 7001. Email: orders@bsi-global.com. Standards are also available from the BSI website at <http://www.bsi-global.com>.

In response to orders for international standards, it is BSI policy to supply the BSI implementation of those that have been published as British Standards, unless otherwise requested.

Information on standards

BSI provides a wide range of information on national, European and international standards through its Library and its Technical Help to Exporters Service. Various BSI electronic information services are also available which give details on all its products and services. Contact the Information Centre.
Tel: +44 (0)20 8996 7111. Fax: +44 (0)20 8996 7048. Email: info@bsi-global.com.

Subscribing members of BSI are kept up to date with standards developments and receive substantial discounts on the purchase price of standards. For details of these and other benefits contact Membership Administration.
Tel: +44 (0)20 8996 7002. Fax: +44 (0)20 8996 7001.
Email: membership@bsi-global.com.

Information regarding online access to British Standards via British Standards Online can be found at <http://www.bsi-global.com/bsonline>.

Further information about BSI is available on the BSI website at <http://www.bsi-global.com>.

Copyright

Copyright subsists in all BSI publications. BSI also holds the copyright, in the UK, of the publications of the international standardization bodies. Except as permitted under the Copyright, Designs and Patents Act 1988 no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means – electronic, photocopying, recording or otherwise – without prior written permission from BSI.

This does not preclude the free use, in the course of implementing the standard, of necessary details such as symbols, and size, type or grade designations. If these details are to be used for any other purpose than implementation then the prior written permission of BSI must be obtained.

Details and advice can be obtained from the Copyright & Licensing Manager.
Tel: +44 (0)20 8996 7070. Fax: +44 (0)20 8996 7553.
Email: copyright@bsi-global.com.