

# Fixed firefighting systems — Gas extinguishing systems —

**Part 3: Physical properties and system  
design of gas extinguishing systems for  
HCFC Blend A extinguishant**

ICS 13.220.20

## National foreword

This British Standard is the UK implementation of EN 15004-3:2008. It supersedes BS ISO 14520-6:2006 which is withdrawn.

The UK participation in its preparation was entrusted by Technical Committee FSH/18, Fixed firefighting systems, to Subcommittee FSH/18/6, Gaseous extinguishing media and systems.

A list of organizations represented on this committee can be obtained on request to its secretary.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

**Compliance with a British Standard cannot confer immunity from legal obligations.**

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 30 November 2008

© BSI 2008

ISBN 978 0 580 59944 6

### Amendments/corrigenda issued since publication

Date	Comments

ICS 13.220.20

English Version

**Fixed firefighting systems - Gas extinguishing systems - Part 3:  
Physical properties and system design of gas extinguishing  
systems for HCFC Blend A extinguishant (ISO 14520-6:2006,  
modified)**

Installations fixes de lutte contre l'incendie - Installations  
d'extinction à gaz - Partie 3 : Propriétés physiques et  
conception des systèmes pour agent extincteur HCFC,  
mélange A (ISO 14520-6:2006, modifiée)

Ortsfeste Brandbekämpfungsanlagen - Löschanlagen mit  
gasförmigen Löschmitteln - Teil 3: Physikalische  
Eigenschaften und Anlagenauslegung für Feuerlöschmittel  
HCFC/A (ISO 14520-6:2006, modifiziert)

This European Standard was approved by CEN on 26 April 2008.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION  
COMITÉ EUROPÉEN DE NORMALISATION  
EUROPÄISCHES KOMITEE FÜR NORMUNG

**Management Centre: rue de Stassart, 36 B-1050 Brussels**

## Contents

Page

Foreword.....	3
Foreword of ISO 14520-6:2006 .....	5
1 Scope .....	6
2 Normative references .....	6
3 Terms and definitions .....	6
4 Characteristics and uses .....	6
4.1 General.....	6
4.2 Use of HCFC Blend A systems.....	7
5 Safety of personnel.....	9
6 System design.....	10
6.1 Fill density .....	10
6.2 Superpressurization .....	11
6.3 Extinguishant quantity .....	11

## Foreword

This document (EN 15004-3:2008) has been prepared by Technical Committee CEN/TC 191 "Fixed firefighting systems", the secretariat of which is held by BSI.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by December 2008, and conflicting national standards shall be withdrawn at the latest by December 2008.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN [and/or CENELEC] shall not be held responsible for identifying any or all such patent rights.

The text of the International Standard ISO 14520-6:2006 from Technical Committee ISO/TC 21 "Equipment for fire protection and fire fighting" of the International Organization for Standardization (ISO) has been taken over as a European Standard by Technical Committee CEN/TC 191 "Fixed firefighting systems", the secretariat of which is held by BSI, with common modifications which are indicated by a straight line in the margin of the text.

This European Standard will consist of the following parts, under the general title *Fixed firefighting systems – Gas extinguishing systems*:

- *Part 1: Design, installation and maintenance (ISO 14520-1, modified)*
- *Part 2: Physical properties and system design of gas extinguishing systems for FK-5-1-12 extinguishant (ISO 14520-5, modified)*
- *Part 3: Physical properties and system design of gas extinguishing systems for HCFC Blend A extinguishant (ISO 14520-6, modified)*
- *Part 4: Physical properties and system design of gas extinguishing systems for HFC 125 extinguishant (ISO 14520-8, modified)*
- *Part 5: Physical properties and system design of gas extinguishing systems for HFC 227ea extinguishant (ISO 14520-9, modified)*
- *Part 6: Physical properties and system design of gas extinguishing systems for HFC 23 extinguishant (ISO 14520-10, modified)*
- *Part 7: Physical properties and system design of gas extinguishing systems for IG-01 extinguishant (ISO 14520-12, modified)*
- *Part 8: Physical properties and system design of gas extinguishing systems for IG-100 extinguishant (ISO 14520-13, modified)*
- *Part 9: Physical properties and system design of gas extinguishing systems for IG-55 extinguishant (ISO 14520-14, modified)*
- *Part 10: Physical properties and system design of gas extinguishing systems for IG-541 extinguishant (ISO 14520-15, modified)*

The International Standards ISO 14520-2 and ISO 14520-11, which dealt with CF<sub>3</sub>I and HFC 236fa extinguishants, respectively, have not been implemented by CEN, as CF<sub>3</sub>I extinguishant is only valid for local

**BS EN 15004-3:2008**  
**EN 15004-3:2008 (E)**

application and HFC 236fa extinguishant is only applicable for portable fire extinguishers and local application, respectively, which is not covered by the scope.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and the United Kingdom.

## Foreword of ISO 14520-6:2006

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 2.

The main task of technical committees is to prepare International Standards. Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

ISO 14520-6 was prepared by Technical Committee ISO/TC 21, Equipment for fire protection and fire fighting, Subcommittee SC 8, *Gaseous media and firefighting systems using gas*.

This second edition cancels and replaces the first edition (ISO 14520-6:2000), which has been technically revised.

ISO 14520 consists of the following parts, under the general title *Gaseous media fire extinguishing systems — Physical properties and system design*:

- Part 1: *General requirements*
- Part 2: *CF<sub>3</sub>I extinguishant*
- Part 5: *FK-5-1-12 extinguishant*
- Part 6: *HCFC Blend A extinguishant*
- Part 8: *HFC 125 extinguishant*
- Part 9: *HFC 227ea extinguishant*
- Part 10: *HFC 23 extinguishant*
- Part 11: *HFC 236fa extinguishant*
- Part 12: *IG-01 extinguishant*
- Part 13: *IG-100 extinguishant*
- Part 14: *IG-55 extinguishant*
- Part 15: *IG-541 extinguishant*

Parts 3, 4 and 7, which dealt with FC-2-1-8, FC-3-1-10 and HCFC 124 extinguishants, respectively, have been withdrawn, as these types are no longer manufactured.

## 1 Scope

This document gives specific requirements for gaseous fire-extinguishing systems, with respect to the HCFC Blend A extinguishant. It includes details of physical properties, specification, usage and safety aspects and is applicable to systems operating at nominal pressures of 25 bar and 42 bar with nitrogen propellant. This does not preclude the use of other systems.

## 2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 15004-1:2008, *Fixed firefighting systems – Gas extinguishing systems - Design, installation and maintenance (ISO 14520-1, modified)*

## 3 Terms and definitions

For the purposes of this document, the terms and definitions given in EN 15004-1:2008 apply.

## 4 Characteristics and uses

### 4.1 General

Extinguishant HCFC Blend A shall comply with the specification according to Table 1. The tolerances of its components shall be in accordance with Table 2.

HCFC Blend A is a colourless, electrically non-conductive gas with a citrus-like odour and a density approximately 11 times that of air.

The physical properties are given in Table 3.

HCFC Blend A extinguishes fires mainly by physical means, but also by some chemical means.

**Table 1 — Specification for HCFC Blend A**

Property	Requirement
Purity	99,6 % by mass, min.
Acidity	$3 \times 10^{-4}$ by mass, max.
Water content	$10 \times 10^{-4}$ % by mass, max.
Non-volatile residue	0,01 % by mass, max.
Suspended matter or sediment	None visible



Table 2 — HCFC Blend A component specification

Component	Tolerance (by mass)
CHCl <sub>2</sub> CF <sub>3</sub>	± 0,5 %
CHClF <sub>2</sub>	± 0,8 %
CHClFCF <sub>3</sub>	± 0,9 %
C <sub>10</sub> H <sub>16</sub>	± 0,5 %

Table 3 — Physical properties of HCFC Blend A

Property	Unit	Value
Molecular mass	—	92,9
Boiling point at 1,013 bar (absolute)	°C	– 38,3
Freezing point	°C	< – 107,2
Critical temperature	°C	125
Critical pressure	bar <sup>a</sup>	66,50
Critical volume	cm <sup>3</sup> /mol	170
Critical density	kg/m <sup>3</sup>	580
Vapour pressure 20 °C	bar abs <sup>a</sup>	8,25
Liquid density 20 °C	kg/m <sup>3</sup>	1 200
Saturated vapour density 20 °C	kg/m <sup>3</sup>	31
Specific volume of superheated vapour at 1,013 bar and 20 °C	m <sup>3</sup> /kg	0,259
Chemical formula	<b>Component</b>	<b>%</b>
	CHCl <sub>2</sub> CF <sub>3</sub>	4,75 %
	CHClF <sub>2</sub>	82 %
	CHClFCF <sub>3</sub>	9,5 %
	C <sub>10</sub> H <sub>16</sub>	3,75 %

<sup>a</sup> 1 bar = 0,1 MPa = 10<sup>5</sup> Pa; 1 MPa = 1 N/mm<sup>2</sup>.

#### 4.2 Use of HCFC Blend A systems

HCFC Blend A total flooding systems may be used for extinguishing fires of all classes within the limits specified in EN 15004-1:2008, Clause 4.

The extinguishant requirements per volume of protected space are given in Table 4 for various levels of concentration. These are based on methods given in EN 15004-1:2008, 7.6.

The extinguishing concentrations and design concentrations for heptane and Surface Class A hazards are given in Table 5.

Table 4 — HCFC Blend A total flooding quantity

Temperature <i>T</i>  °C	Specific vapour volume <i>S</i> m <sup>3</sup> /kg	HCFC Blend A mass requirements per unit volume of protected space, <i>m/V</i> (kg/m <sup>3</sup> ) This information refers only to the product HCFC Blend A, and may not represent any other products containing dichlorotrifluoroethane, chlorodifluoromethane, chlorotetrafluoroethane or isopropenyl-1-methylcyclohexane as components.									
		Design concentration (by volume)									
		7 %	8 %	9 %	10 %	11 %	12 %	13 %	14 %	15 %	16 %
-35	0,210	0,358	0,413	0,470	0,528	0,588	0,648	0,710	0,774	0,839	0,906
-30	0,215	0,351	0,405	0,461	0,517	0,576	0,635	696	0,758	0,822	0,887
-25	0,219	0,343	0,397	0,451	0,507	0,564	0,622	682	0,743	0,805	0,869
-20	0,224	0,337	0,389	0,442	0,497	0,553	0,610	668	0,728	0,790	0,852
-15	0,228	0,330	0,381	0,434	0,487	0,542	0,598	0,655	0,714	0,774	0,835
-10	0,232	0,324	0,374	0,426	0,478	0,532	0,587	0,643	0,700	0,760	0,819
-5	0,237	0,318	0,367	0,418	0,469	0,522	0,576	0,631	0,687	0,745	0,804
0	0,241	0,312	0,360	0,410	0,461	0,512	0,565	0,619	0,675	0,731	0,789
5	0,246	0,306	0,354	0,403	0,452	0,503	0,555	0,608	0,663	0,718	0,775
10	0,250	0,301	0,348	0,396	0,444	0,494	0,545	0,598	0,651	0,706	0,762
15	0,254	0,296	0,342	0,389	0,437	0,486	0,536	0,587	0,640	0,693	0,748
20	0,259	0,291	0,336	0,382	0,429	0,477	0,527	0,577	0,629	0,682	0,736
25	0,263	0,286	0,330	0,376	0,422	0,469	0,518	0,568	0,618	0,670	0,723
30	0,268	0,281	0,325	0,369	0,415	0,462	0,509	0,558	0,608	0,659	0,711
35	0,272	0,277	0,320	0,363	0,408	0,454	0,501	0,549	0,598	0,648	0,700
40	0,277	0,272	0,314	0,358	0,402	0,447	0,493	0,540	0,589	0,638	0,689
45	0,281	0,268	0,310	0,352	0,395	0,440	0,485	0,532	0,579	0,628	0,678
50	0,285	0,264	0,305	0,347	0,389	0,433	0,478	0,524	0,570	0,618	0,667
55	0,290	0,260	0,300	0,341	0,383	0,427	0,471	0,516	0,562	0,609	0,657
60	0,294	0,256	0,296	0,336	0,378	0,420	0,463	0,508	0,553	0,600	0,647
65	0,299	0,252	0,291	0,331	0,372	0,414	0,457	0,500	0,545	0,591	0,638
70	0,303	0,248	0,287	0,326	0,367	0,408	0,450	0,493	0,537	0,582	0,628
75	0,307	0,245	0,283	0,322	0,361	0,402	0,444	0,486	0,529	0,573	0,620
80	0,312	0,241	0,279	0,317	0,356	0,396	0,437	0,479	0,522	0,566	0,611
85	0,317	0,238	0,275	0,313	0,351	0,391	0,432	0,472	0,515	0,558	0,602
90	0,321	0,235	0,271	0,308	0,346	0,385	0,425	0,466	0,508	0,550	0,594
95	0,325	0,232	0,267	0,304	0,342	0,380	0,419	0,460	0,501	0,543	0,586

*m/V* is the agent mass requirements (in kilograms per cubic metre); i.e. mass, *m*, in kilograms of agent required per cubic metre of protected volume *V* to produce the indicated concentration at the temperature specified.

*V* is the net volume of hazard (in cubic metres); i.e. the enclosed volume minus the fixed structures impervious to extinguishant.

$$m = \left( \frac{c}{100 - c} \right) \frac{V}{S}$$

*T* is the temperature (in degree Celsius); i.e. the design temperature in the hazard area.

*S* is the specific volume (in cubic metre per kilogram); the specific volume of superheated HCFC Blend A vapour at a pressure of 1,013 bar may be approximated by the formula:

$$S = k_1 + k_2 T$$

where

$$k_1 = 0,2413; k_2 = 0,00088.$$

*c* is the concentration (in percent); i.e. the volumetric concentration of HCFC Blend A in air at the temperature indicated, and a pressure of 1,013 bar absolute.

Table 5 — HCFC Blend A reference extinguishing and design concentrations

Fuel	Extinguishment % by volume	Minimum design % by volume
<b>Class B</b>		
Heptane (cup burner)	10,0	13,0
Heptane (room test)	9,9	
<b>Surface Class A</b>		
Wood crib	6,0	a
PMMA	—	
PP	—	
ABS	—	
<b>Higher Hazard Class A</b>	b	12,4
<p>The extinguishment values for the Class B and the Surface Class A fuels are determined by testing in accordance with EN 15004-1:2008, Annexes B and C.</p> <p>The minimum design concentration for the Class B fuel is the higher value of the heptane cup burner or room test heptane extinguishment concentration multiplied by 1,3.</p> <p>The minimum design concentration for Surface Class A fuel is the highest value of the wood crib, PMMA, PP or ABS extinguishment concentrations multiplied by 1,3. In the absence of any of the 4 extinguishment values, the minimum design concentration for Surface Class A shall be that of Higher Hazard Class A.</p> <p>See EN 15004-1:2008, 7.5.1.3, for guidance on Class A fuels.</p> <p>The extinguishing and design concentrations for room-scale test fires are for informational purposes only. Lower and higher extinguishing concentrations than those shown for room-scale test fires may be achieved and allowed when validated by test reports from internationally recognized laboratories.</p> <p><sup>a</sup> The minimum design concentration for Higher Hazard Class A fuels shall be the higher of the Surface Class A or 95 % of the Class B minimum design concentration.</p> <p><sup>b</sup> The minimum design concentration for Surface Class A fuel is the highest value of the wood crib, PMMA, PP or ABS extinguishment concentrations multiplied by 1,3. In the absence of any of the 4 extinguishment values, the minimum design concentration for Surface Class A shall be that of Higher Hazard Class A.</p>		

## 5 Safety of personnel

Any hazard to personnel created by the discharge of HCFC Blend A shall be considered in the design of the system.

Potential hazards can arise from the following:

- a) the extinguishant itself;
- b) the combustion products of the fire;
- c) breakdown products of the extinguishant resulting from exposure to fire.

For minimum safety requirements, see EN 15004-1:2008, Clause 5.

Toxicological information for HCFC Blend A is given in Table 6.

When the design concentrations exceed the LOAEL under normal design conditions, HCFC Blend A shall only be used for total flooding in normally unoccupied areas.

**Table 6 — Toxicological information for HCFC Blend A**

Property	Value % by volume
4 h LC <sub>50</sub> <sup>a</sup>	64
No observed adverse effect level (NOAEL)	10
Lowest observed adverse effect level (LOAEL)	> 10
<sup>a</sup> 4 h LC <sub>50</sub> is the concentration lethal to 50 % of a rat population during a 4 h exposure.	

## 6 System design

### 6.1 Fill density

The fill density of the container shall not exceed the values given in Tables 7 and 8 for 25 bar and 42 bar systems, respectively.

**Table 7 — Storage container characteristics for HCFC Blend A – 25 bar**

Property	Unit	Value
Maximum fill density	kg/m <sup>3</sup>	900
Maximum container working pressure at 50 °C	bar <sup>a</sup>	35
Superpressurization at 20 °C	bar <sup>a</sup>	25
Reference should be made to Figure 1 for further data on pressure/temperature relationships.		
<sup>a</sup> 1 bar = 0,1 MPa = 10 <sup>5</sup> Pa; 1 MPa = 1 N/mm <sup>2</sup> .		

**Table 8 — Storage container characteristics for HCFC Blend A – 42 bar**

Property	Unit	Value
Maximum fill density	kg/m <sup>3</sup>	900
Maximum container working pressure at 50 °C	bar <sup>a</sup>	53
Superpressurization at 20 °C	bar <sup>a</sup>	42
Reference should be made to Figure 2 for further data on pressure/temperature relationships.		
<sup>a</sup> 1 bar = 0,1 MPa = 10 <sup>5</sup> Pa; 1 MPa = 1 N/mm <sup>2</sup> .		

Exceeding the maximum fill density may result in the container becoming “liquid full”, with the effect that an extremely high rise in pressure occurs with small increases in temperature, which could adversely affect the integrity of the container assembly.

The relationships between pressure and temperature are shown in Figures 1 and 2 for maximum fill density.


## 6.2 Superpressurization

Containers shall be superpressurized with nitrogen with a moisture content of not more than  $60 \times 10^{-6}$  % by mass to an equilibrium pressure of  $(25 + {}^{1,25}_0)$  bar and  $(42 + {}^{2,1}_0)$  bar at a temperature of 20 °C (see Clause 1 for exception).

## 6.3 Extinguishant quantity

The quantity of extinguishant shall be the minimum required to achieve the design concentration within the hazard volume at the minimum expected temperature, determined using Table 4 and the method according to EN 15004-1:2008, 7.6.

The design concentrations shall be those specified for relevant hazards in Table 5, including a 1,3 safety factor on the extinguishing concentration. Consideration should be given to increasing this for particular hazards, while seeking advice from the relevant authority.

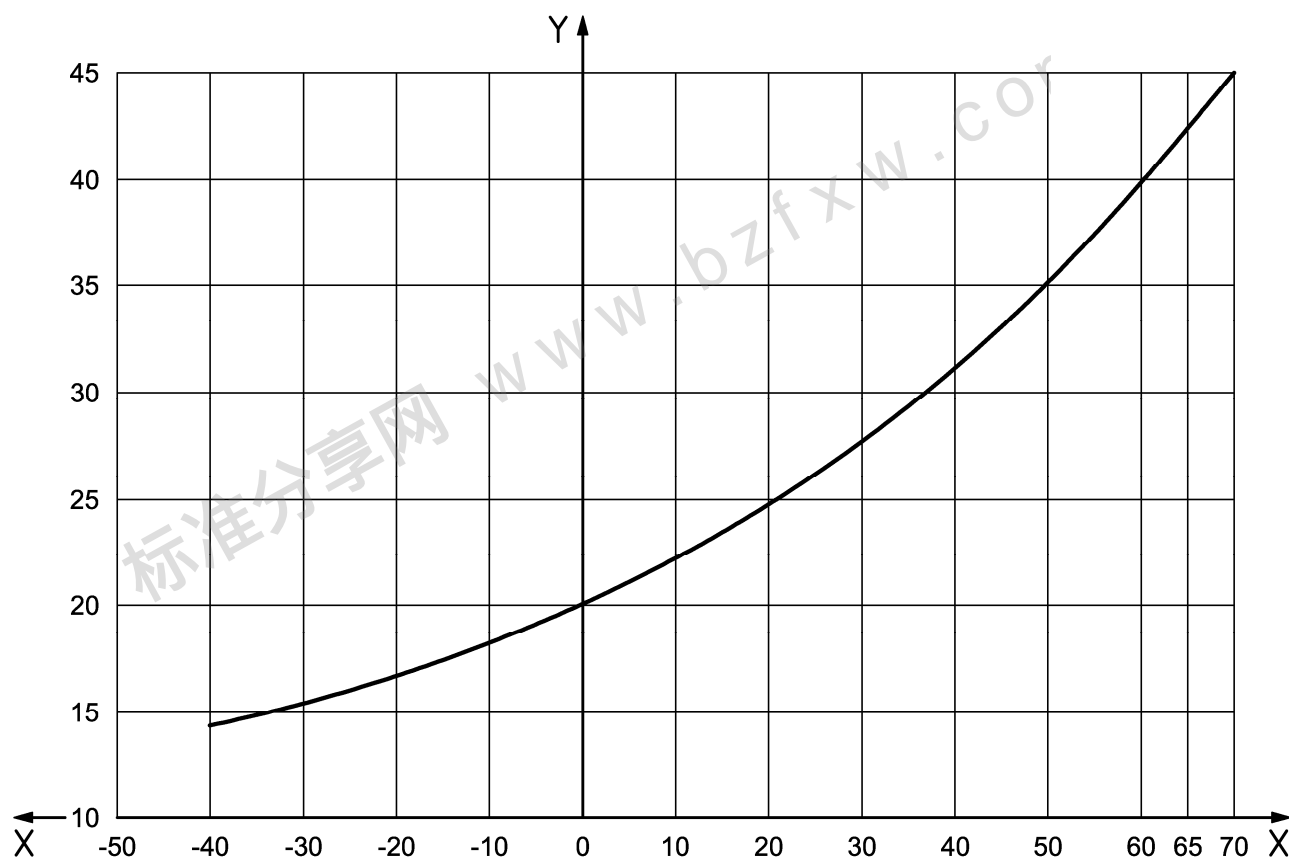


### Key

X temperature, °C

Y pressure, bar

Figure 1 — Temperature/pressure graph for HCFC Blend A – Superpressurized with nitrogen to 25 bar at 20 °C

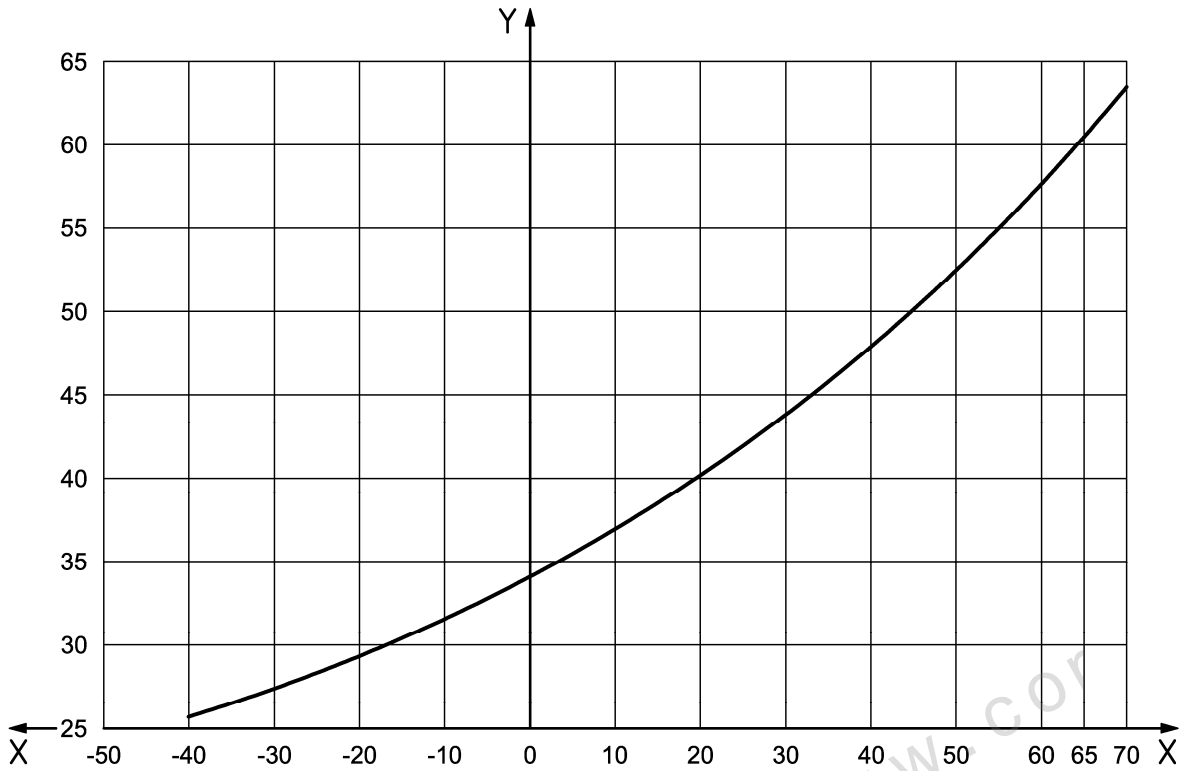

**Key**

- X temperature, °C
- Y pressure, bar

**Figure 2 — Temperature/pressure graph for HCFC Blend A – Superpressurized with nitrogen to 42 bar at 20 °C**

标准分享网 [www.bzfxw.com](http://www.bzfxw.com)

---

---

## British Standards Institution (BSI)

BSI is the independent national body responsible for preparing British Standards. It presents the UK view on standards in Europe and at the international level. It is incorporated by Royal Charter.

### Revisions

British Standards are updated by amendment or revision. Users of British Standards should make sure that they possess the latest amendments or editions.

It is the constant aim of BSI to improve the quality of our products and services. We would be grateful if anyone finding an inaccuracy or ambiguity while using this British Standard would inform the Secretary of the technical committee responsible, the identity of which can be found on the inside front cover.  
Tel: +44 (0)20 8996 9000 Fax: +44 (0)20 8996 7400

BSI offers members an individual updating service called PLUS which ensures that subscribers automatically receive the latest editions of standards.

### Buying standards

Orders for all BSI, international and foreign standards publications should be addressed to Customer Services.

Tel: +44 (0)20 8996 9001 Fax: +44 (0)20 8996 7001

Email: [orders@bsigroup.com](mailto:orders@bsigroup.com)

You may also buy directly using a debit/credit card from the BSI Shop on the Website <http://www.bsigroup.com/shop>.

In response to orders for international standards, it is BSI policy to supply the BSI implementation of those that have been published as British Standards, unless otherwise requested.

### Information on standards

BSI provides a wide range of information on national, European and international standards through its Library and its Technical Help to Exporters Service. Various BSI electronic information services are also available which give details on all its products and services. Contact the Information Centre.

Tel: +44 (0)20 8996 7111 Fax: +44 (0)20 8996 7048

Email: [info@bsigroup.com](mailto:info@bsigroup.com)

Subscribing members of BSI are kept up to date with standards developments and receive substantial discounts on the purchase price of standards. For details of these and other benefits contact Membership Administration.

Tel: +44 (0)20 8996 7002 Fax: +44 (0)20 8996 7001

Email: [membership@bsigroup.com](mailto:membership@bsigroup.com)

Information regarding online access to British Standards via British Standards Online can be found at <http://www.bsigroup.com/BSOL>.

Further information about BSI is available on the BSI website at <http://www.bsigroup.com>.

### Copyright

Copyright subsists in all BSI publications. BSI also holds the copyright, in the UK, of the publications of the international standardization bodies. Except as permitted under the Copyright, Designs and Patents Act 1988 no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means – electronic, photocopying, recording or otherwise – without prior written permission from BSI.

This does not preclude the free use, in the course of implementing the standard, of necessary details such as symbols, and size, type or grade designations. If these details are to be used for any other purpose than implementation then the prior written permission of BSI must be obtained.

Details and advice can be obtained from the Copyright & Licensing Manager.

Tel: +44 (0)20 8996 7070 Email: [copyright@bsigroup.com](mailto:copyright@bsigroup.com)