

# Heating boilers — Energy assessment of hot water storage systems

The European Standard EN 15332:2007 has the status of a  
British Standard

ICS 91.140.65

## National foreword

This British Standard is the UK implementation of EN 15332:2007.

The UK participation in its preparation was entrusted to Technical Committee RHE/10, Heating boilers.

A list of organizations represented on this committee can be obtained on request to its secretary.

This British Standard (BS EN 15332) is one method of assessing the performance of an indirectly heated hot water system comprising of a heating boiler and hot water storage cylinder and where there is a known relationship between the cylinder and the heating boiler. The system is assessed with boiler input occurring during draw off which is not normal UK practice for typical family domestic premises. A more suitable methodology for the assessment and performance comparison of indirectly heated unvented cylinders in domestic premises is contained in BS EN 12897.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

**Compliance with a British Standard cannot confer immunity from legal obligations.**

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 30 November 2007

© BSI 2007

ISBN 978 0 580 55785 9

### Amendments issued since publication

Amd. No.	Date	Comments

ICS 91.140.65

English Version

## Heating boilers - Energy assessment of hot water storage systems

Chaudières de chauffage - Evaluation de la performance  
énergétique des préparateurs d'eau chaude

Heizkessel - Energetische Bewertung von  
Warmwasserspeichersystemen

This European Standard was approved by CEN on 22 March 2007.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION  
COMITÉ EUROPÉEN DE NORMALISATION  
EUROPÄISCHES KOMITEE FÜR NORMUNG

Management Centre: rue de Stassart, 36 B-1050 Brussels

**Contents**

Page

Foreword.....	3
1 Scope .....	4
2 Normative references .....	4
3 Terms and definitions .....	4
4 Requirements on the hot water storage tanks .....	6
4.1 Energy assessment .....	6
4.2 Estimating the hot water capacity from the actual storage capacity .....	9
4.3 Estimating the hot water capacity with known heat exchanger performance .....	9
4.4 Measuring the hot water capacity .....	10
5 Measurements.....	10
5.1 Connection of the storage tank.....	10
5.2 Measurement of the heat exchanger performance .....	10
5.3 Measurement of the hot water capacity .....	10
5.4 Measurement of the standby-loss.....	13
6 Requirements on the test rig .....	15
6.1 Environment.....	15
6.2 Measuring accuracy .....	15

## Foreword

This document (EN 15332:2007) has been prepared by Technical Committee CEN/TC 57 “Central heating boilers”, the secretariat of which is held by DIN.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by May 2008, and conflicting national standards shall be withdrawn at the latest by May 2008.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard : Austria, Belgium, Bulgaria, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom.

## 1 Scope

This European Standard specifies a method for the energy assessment of a domestic hot water system comprising an external heating boiler of specified minimum output indirectly heating an unvented (closed) hot water tank of up to 1 500 l. Whilst tanks intended primarily for direct heating are not covered by this European Standard, it does allow the provision of electric heating elements for auxiliary use.

## 2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 12897, *Water supply — Specification for indirectly heated unvented (closed) storage water heaters*

## 3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

**3.1 indirectly heated un-vented (closed) hot water storage tanks**  
storage vessels used for heating up domestic hot water with an external heat source where the hot water side is not vented to atmosphere, including all devices delivered with it

**3.2 hot water side**  
side of the storage tank which contains domestic hot water

NOTE If a mixing valve is delivered with the storage tank, it is considered as part of the hot water side.

**3.3 heating side**  
side of the storage tank which contains the heating medium

**3.4 temperature of the cold water**  
 $\vartheta_c$   
temperature at the entrance of the hot water side of the storage tank in °C

**3.5 temperature of the warm water**  
 $\vartheta_w$   
temperature at the outlet of the hot water side in °C

**3.6 usable hot water temperature**  
 $\vartheta_u$   
minimum temperature for the hot water to be usable

NOTE Minimum temperature for the hot water defined here as difference between the temperature of the warm water  $\vartheta_w = 45$  °C minus the temperature of cold water  $\vartheta_c = 10$  °C ( $\vartheta_u = \vartheta_w - \vartheta_c = 35$  K).

**3.7****heating medium supply temperature** $\vartheta_h$ 

heating medium temperature at the entrance of the heating side of the water heater

**3.8****heating medium return temperature** $\vartheta_r$ 

heating medium temperature at the outlet of the heating side of the water heater

**3.9****storage temperature** $\vartheta_s$ 

temperature of the storage tank measured at the thermostat position, which is intended for this purpose

**3.10****ambient temperature** $\vartheta_a$ 

temperature in the environment of the hot water storage tank measured according to 5.4.1

**3.11****storage excess temperature** $\Delta\vartheta_x$ 

temperature difference between the storage temperature and the ambient temperature:

$$\Delta\vartheta_x = \vartheta_s - \vartheta_a$$

**3.12****tapping volume flow** $V_w$ 

flow of warm water through the hot water side in l/s

**3.13****tapping mass flow** $m_w$ 

flow of warm water through the hot water side in kg/h

**3.14****loading mass flow** $m_l$ 

flow of heating medium through the heating side in kg/h

**3.15****rated storage capacity** $C_R$ 

capacity of the storage tank assigned by the manufacturer in l

**3.16****actual storage capacity** $C_A$ 

water content of the hot water and the heating side determined by volume measuring or balancing in l

**3.17**

**hot water capacity**

$C_U$

quantity of hot water in litre at usable hot water temperature  $t_h$  which could be tapped at one 10 min tapping at a cold water temperature of  $t_c = 10\text{ }^\circ\text{C}$  and a maximum hot water temperature of  $t_w = 65\text{ }^\circ\text{C}$  ( $\Delta t_w = t_w - t_c = 55\text{ K}$ ) with reheating

**3.18**

**heat exchanger performance**

$P_e$

continuous transferable heat power from the heating side to the hot water side in kW at standard conditions of  $t_c = 10\text{ }^\circ\text{C}$ ,  $t_w = 60\text{ }^\circ\text{C}$  and  $t_h = 80\text{ }^\circ\text{C}$

**3.19**

**standby loss**

$Q_B$

energy loss in kWh/d at nominal storage temperature against environment with an ambient temperature of  $t_a = 20\text{ }^\circ\text{C}$ , but at least 45 K excess temperature

**3.20**

**cold condition**

condition at which the temperature in no side of the storage tank is more than 10 K over the cold water temperature  $t_c$

**3.21**

**cycle time**

$\Delta\tau$

time interval of the data acquisition in s

**3.22**

**nominal operating conditions**

index n

operation conditions resulting from the measurement or given by the manufacturer

**3.23**

**nominal storage temperature**


temperature of the stored water in the tank as measured by the thermostat

## **4 Requirements on the hot water storage tanks**


### **4.1 Energy assessment**

For the energy assessment of the hot water storage tank, the standby loss shall be rated against the hot water capacity according to Figure 1.



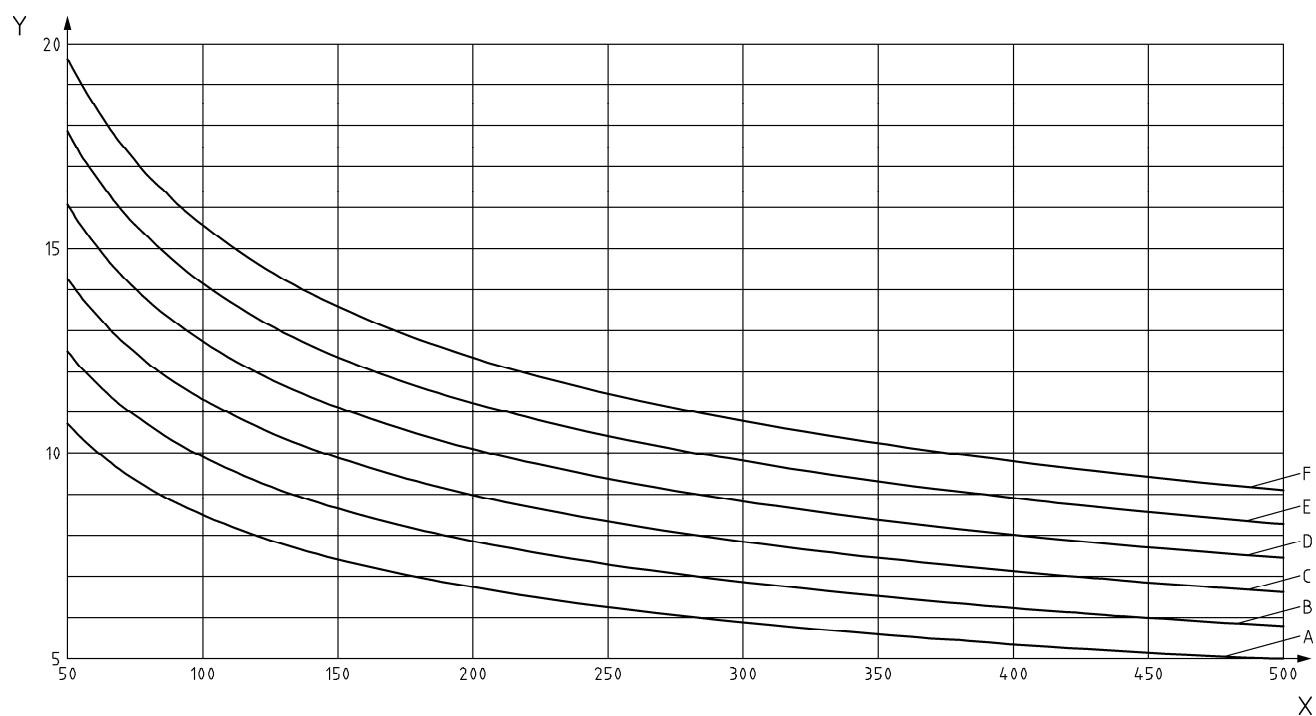

a)

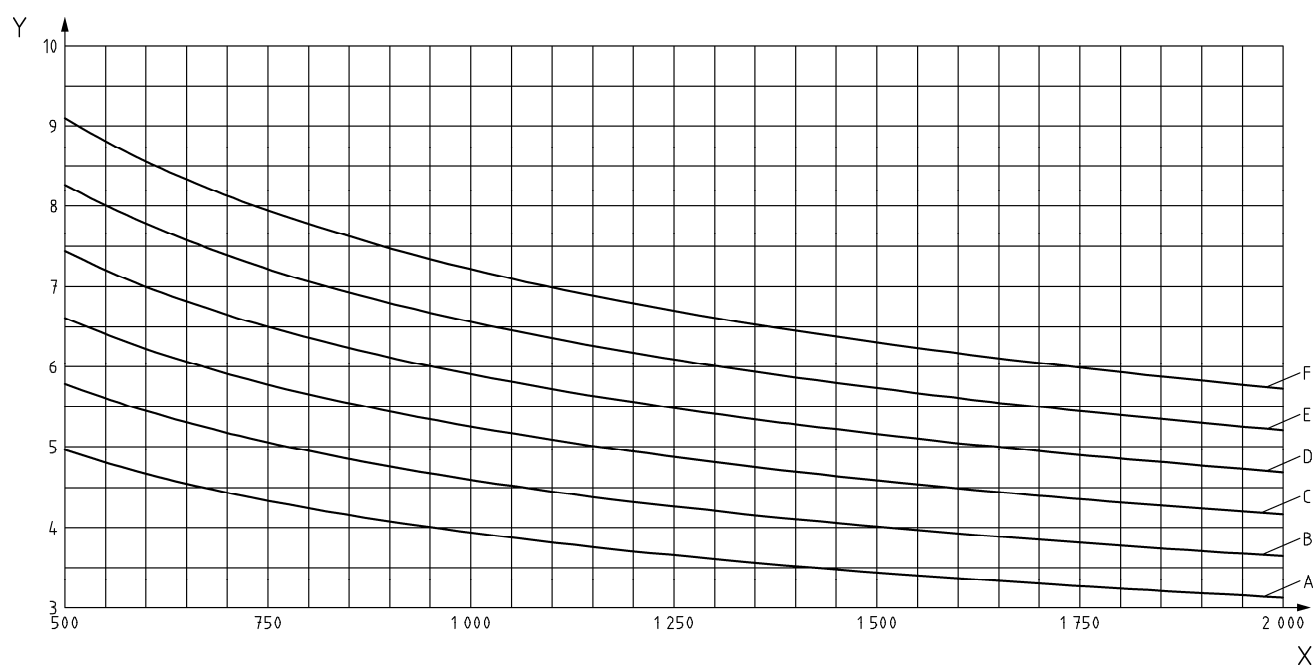

b)

**Key**

Y standby loss related to the hot water capacity in (Wh/l)/d

X hot water capacity  $C_u$  in litres

A to F coefficient for the rational use of energy, see explanation to the Equations (1) to (3)

**Figure 1 — Labelling of hot water storage tanks based on the hot water capacity**

The maximal standby loss  $Q_{B,max}$  for the different quality levels shall be calculated according to Equations (1) to (3) depending by the used method:

$$Q_{B,max} = QL(n) \times 52,5 \times C_R^{-1/3} \quad (1)$$

$$Q_{B,max} = QL(n) \times 52,5 \times C_A^{-1/3} \quad (2)$$

$$Q_{B,max} = QL(n) \times 52,5 \times C_U^{-1/3} \quad (3)$$

where

$Q_{B,max}$  is the maximal standby loss in kWh/d;

$C_R$  is the rated storage capacity in l;

$C_A$  is the actual storage capacity in l;

$C_U$  is the hot water capacity in l;

$QL(n)$  is the coefficient for rational use of energy, see Figure 1

with n from A to F

$QL(A) = 0,75$ ;

$QL(B) = 0,875$ ;

$QL(C) = 1,0$ ;

$QL(D) = 1,125$ ;

$QL(E) = 1,25$ ;

$QL(F) = 1,375$ .

The hot water capacity depends on the construction of the storage tank.

The hot water capacity could be:

- estimated with the real storage volume (4.2);
- estimated with the real storage volume and the heat exchanger performance (4.3);
- measured (4.4).

The standby loss shall be measured according to 5.4 or any other method which is proven to give the equivalent results.

## 4.2 Estimating the hot water capacity from the actual storage capacity


If no measurement has been taken, the behaviour of the storage tank shall be assumed to be fully mixing.

This means that under the conditions of cold water temperature  $\vartheta_c = 10\text{ °C}$ , usable hot water temperature  $\vartheta_u = 45\text{ °C}$ , storage temperature after loading  $\vartheta_s = 65\text{ °C}$  the hot water capacity  $C_u$  can only achieve 4/7 of the actual storage capacity.

If the heat exchanger performance is not known, the hot water storage capacity shall be determined as the intersection of actual storage capacity line and y-axis in Figure 2.

## 4.3 Estimating the hot water capacity with known heat exchanger performance

If the heat exchanger performance is measured according to 5.2 and assuming a fully mixing storage tank, the hot water capacity could be calculated with the actual storage capacity as shown in Figure 2:

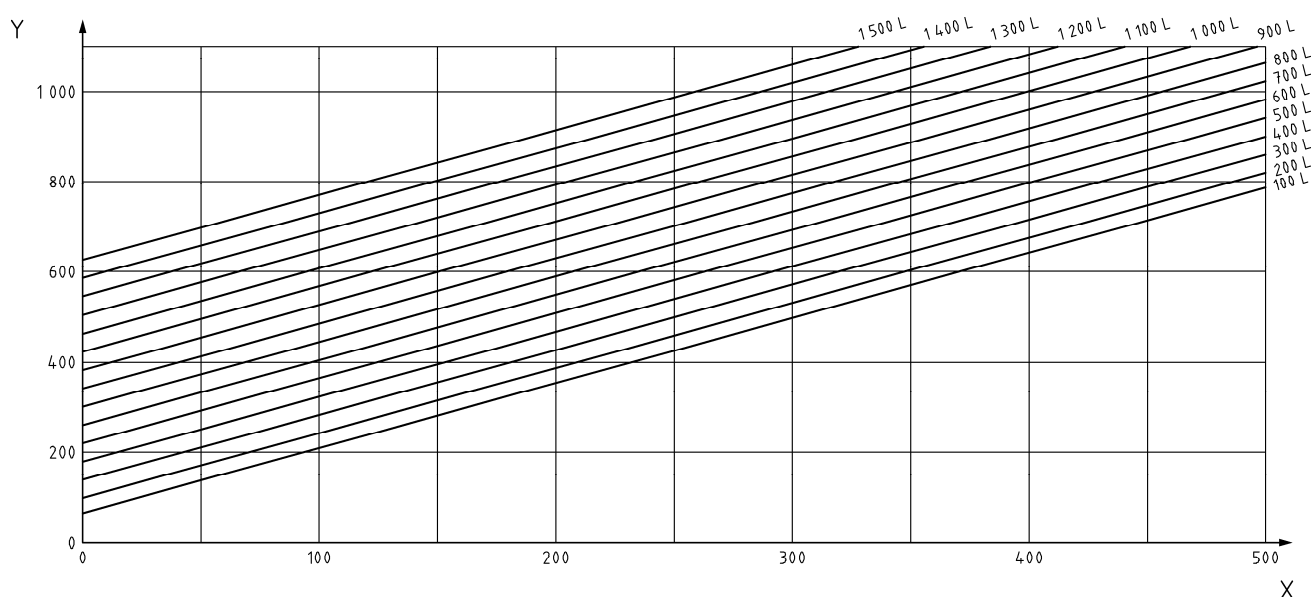

### Key

Y hot water capacity  $C_u$  in litres

X heat exchanger performance  $P_e$  in kW

**Figure 2 — Hot water capacity calculated with actual storage capacity of up to 1 000 l and heat exchanger performance**

The diagram in Figure 2 is based on Equation (4):

$$C_u = \frac{4}{7} \left( C_A + P_E \times \left( \frac{\tau_t}{c_w \times \Delta \vartheta_u} \times \rho_w \right) \right) = \frac{4}{7} (C_A + P_E \times 4,1) \quad (4)$$

where

$c_w$  is the specific heat capacity of water (constant 4,18 kJ/kg K);

$\tau_t$  is the tapping time (600 s);

$\rho_w$  is the density of water (1 kg/l).

#### 4.4 Measuring the hot water capacity

The hot water capacity shall be measured according to 5.3 or according to EN 12897.

NOTE Other methods can be used if these methods give equivalent results.

### 5 Measurements

#### 5.1 Connection of the storage tank

The storage tank shall be tested with the accessories it is delivered with. The storage tank shall be connected to the heat source as indicated by the manufacturer. If the water heater has a circulation connection, it shall be closed.

#### 5.2 Measurement of the heat exchanger performance

The heat exchanger performance shall be measured under continuous operation.

The cold and hot water temperature, the heating medium supply and return temperature and the heating medium mass flow  $m_h$  or the warm water mass flow  $m_w$  shall be measured.

If the mass flow is not given by the manufacturer, the heat supply to the water heater and the mass flow of the warm water and the heating medium shall be regulated in such a way that the temperature difference between heating medium supply temperature and cold water temperature is  $\vartheta_h - \vartheta_c = (70 \pm 2)$  K, the temperature difference between heating medium supply and return temperature is  $\vartheta_h - \vartheta_r = (20 \pm 1)$  K and the temperature difference between warm and cold water temperature is  $\vartheta_w - \vartheta_c = (50 \pm 1)$  K.

The steady-state condition shall be considered as reached, if the mass flow does not vary more than  $\pm (1 \% + 1 \text{ kg/s})$ , and the temperatures no more than  $\pm 0,2$  K around the measured average value of 10 measured values taken up within 10 min.

The heat performance  $P_e$  in kW results as product of flow of the warmed up water, rise in temperature and specific heat capacity of the water according to Equation (5):

$$P_e = m_w \times c_w \times (\vartheta_w - \vartheta_c) \times \frac{1}{3600} \text{ in kW.} \quad (5)$$

#### 5.3 Measurement of the hot water capacity

##### 5.3.1 General

The cold water temperature for the test can be between  $\vartheta_c = 8$  °C to 18 °C, but is not allowed to fluctuate during the test by more than  $\pm 1$  K. All given temperatures refer to a cold water temperature of  $\vartheta_c = 10$  °C. If the cold water temperature differs, the measurement has to take place with the according temperature differences which are given in brackets named with  $\Delta\vartheta = \vartheta - \vartheta_c$ .

The storage tank shall be regarded as loaded when the loading controller switches off. The hot water temperature shall never exceed  $\vartheta_{w,\max} = 65$  °C ( $\Delta\vartheta_{w,\max} = 55$  K).

The storage tank shall be regarded as empty when the hot water temperature falls below the usable hot water temperature  $\vartheta_u = 45$  °C ( $\Delta\vartheta_u = 35$  K).

### 5.3.2 Preparation

The storage tank shall be connected to a heat source. The heating supply temperature shall be limited to  $\vartheta_h - \vartheta_c = (70 \pm 2)$  K.

The supply mass flow shall be set to the value determined in 5.2. The heat generator shall be switched on and off together with the pump by a loading controller with a two point behaviour and a switching difference of max. 5 K shall be used.

The controller sensor shall be positioned in the tank thermostat pocket, which is provided for this purpose.

### 5.3.3 Procedure

The temperature gradient of cold and warm water and the warm water mass flow shall be logged during the measurement tapping within an interval of max. 10 s.

The measurement cycle shall consist of at least three tappings: at least two pre-tappings and one measurement tapping.

The tapping volume flow  $V_w$  for all tappings shall be set at such a level that the tank is emptied during the measurement tapping within  $(10 \pm 1)$  min. The setting of the right tapping volume flow may require a number of iteration loops. The tapping volume flow shall not be changed during the measurement.

If the storage tank could not be emptied within 10 min due to temperature or volume flow restrictions (e.g. instantaneous heating of the hot water), the volume flow shall be set to the highest possible value.


The storage tank shall be first loaded from the cold condition. The set point of the loading controller shall be set at such a level that the heat source is switched off when the nominal storage temperature is reached. As soon as the tank is loaded the first pre-tapping shall start. The tapping shall stop when the loading controller starts reloading. Immediately after ending reloading the second pre-tapping shall start. If the hot water temperature exceeds the maximum hot water temperature within this tapping, the set value of the loading controller shall be adapted and another pre-tapping is performed. This iteration is done until no further adaptation of the set point is necessary.

The measurement tapping shall start as soon as the reload of the last preliminary tapping is stopped by the controller at  $\tau_{m0}$ . In this case tapping shall continue until the storage tank is empty, which means that the hot water temperature falls below the usable hot water temperature at  $\tau_{m1}$ .

If the hot water temperature exceeds  $\vartheta_{w,max} = 65$  °C ( $\Delta \vartheta_{w,max} = 55$  K) at any time during the test, the set point of the loading controller has to be adjusted again, and the measurement cycle repeated.

The set point of the loading controller at which the measurement tapping takes place shall be noted as the nominal storage temperature  $\vartheta_{sn}$ .

The diagram in Figure 3 shows the principle of the measurement cycle.

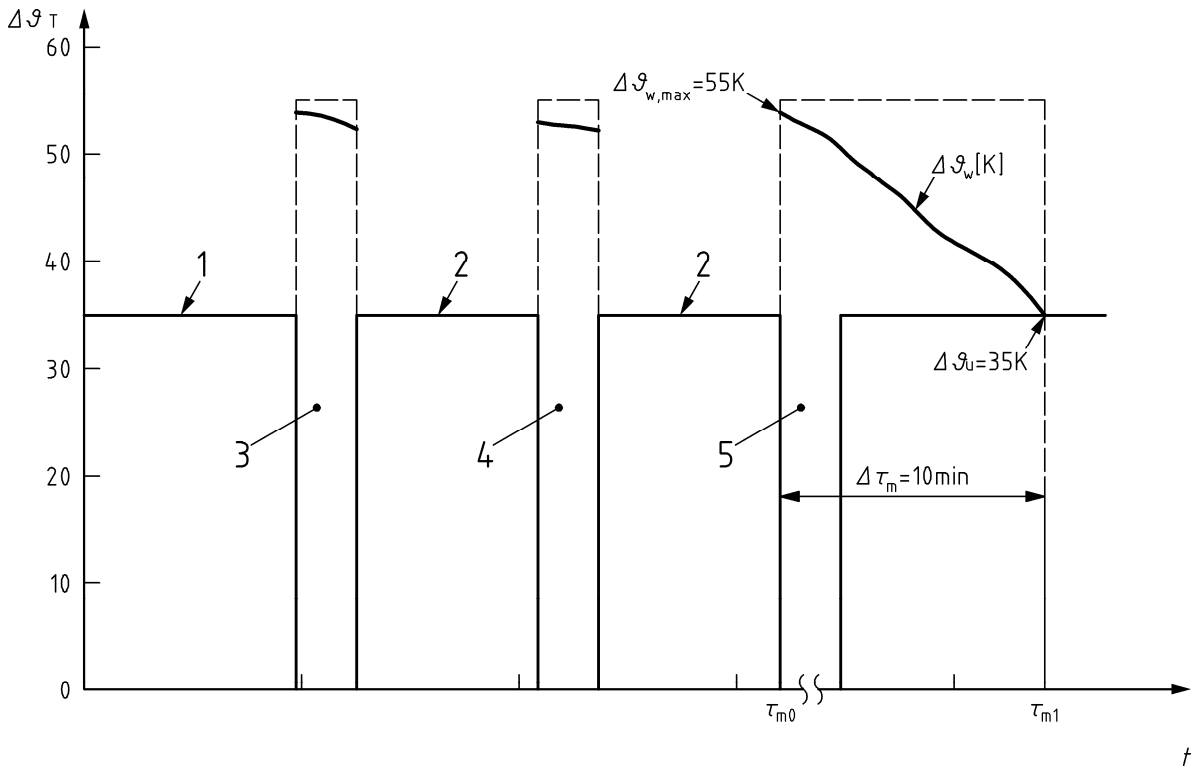

**Key**

- 1 loading
- 2 reloading
- 3 first pre-tapping
- 4 second pre-tapping (repeated if necessary)
- 5 measurement tapping

**Figure 3 — Principle of the measurement cycle**

**5.3.4 Evaluation**

The quantity of hot water that could be tapped with the usable hot water temperature within the measurement tapping shall be calculated according to Equation (6).

$$C_u = \sum_{\tau_{m0}}^{\tau_{m1}} V_w \times \Delta\tau_m \times \frac{(t_w - t_c)}{(t_u - 10^\circ\text{C})} \tag{6}$$

where  $\Delta\tau_m = (\tau_{m1} - \tau_{m0}) = (10 \pm 1)$  min.

If the storage tank could not be emptied within 10 min due to temperature or volume flow restrictions (e.g. instantaneous heating of the hot water), the measurement is evaluated for  $\Delta\tau_m = 10$  min.

## 5.4 Measurement of the standby-loss

### 5.4.1 General

The standby loss shall be measured by keeping the storage temperature constant with the help of an electrical heating and a controller. Therefore the storage tank shall be equipped with an additional electrical immersion heater within the lower third.

The average ambient temperature shall be  $t_{\text{amb}} = (20 \pm 5) ^\circ\text{C}$ , but shall not fluctuate more than  $\pm 1$  K.

The ambient temperature  $t_{\text{amb}}$  shall be measured in the half height and 1 m distance from the storage tank. If the distance between storage tank and wall is smaller than 2 m, then it shall be measured in the middle of this distance.

The storage water temperature shall be measured at the place, which is intended by the manufacturer for it (e.g. thermostat pocket). If there is no such place, the temperature should be measured in the upper third of the storage tank.

The medium storage temperature shall be the nominal storage temperature  $t_{\text{sn}} \pm 5$  K, at least  $65 ^\circ\text{C}$ .

The medium storage excess temperature shall be the nominal storage excess temperature  $t_{\text{xn}} \pm 3$  K, at least  $\Delta t_x = 45$  K.

The controller switching difference shall be lower than 0,8 K.

The standby loss corresponds to the electrical energy consumption in the steady state condition.

### 5.4.2 Preparation

The storage tank shall be separated during the test from any external connection. During the entire test, the storage tank shall be completely filled with water.

All water containing connections shall be insulated with an insulation material with a thermal conductivity of  $0,030 \text{ W}/(\text{m K}) < \lambda < 0,035 \text{ W}/(\text{m K})$ . All pipework shall be insulated with an insulation of 30 mm, excepting connections not for water driving purpose (e.g. thermostat pocket).

There shall be free space of at least 70 cm around the storage tank, and at least 100 cm above the storage tank.

Wall hung storage tanks shall be mounted on a separate wall which is at least 15 cm from the room wall with the delivered mounting kit. The free space below the storage tank shall be at least 25 cm.

5.4.3 Execution of the measurement

The test remains up for at least 24 h after reaching the steady state condition and begins and ends with a switch of the temperature controller.

The consumption of electrical energy  $E_1$  within this time  $t_1$  shall be measured, see Figure 4.

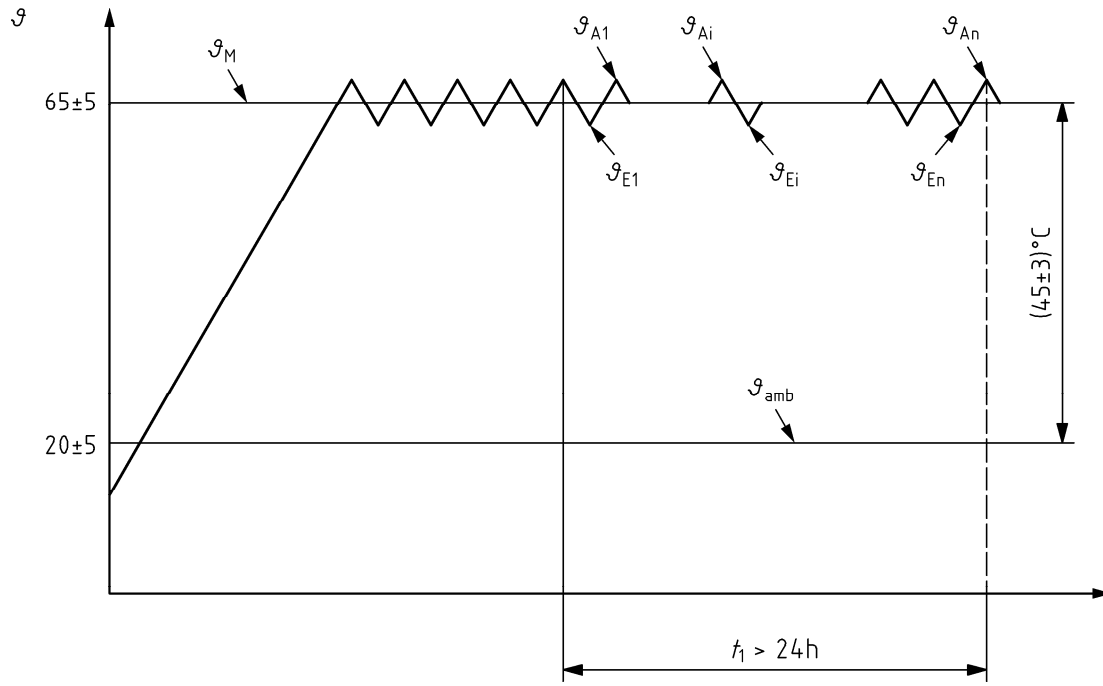


Figure 4 — Measurement of consumption of electrical energy

5.4.4 Evaluation

The energy consumption within 24 h shall be calculated according to Equation (7):

$$E = \frac{E_1 \cdot 24}{t_1} \tag{7}$$

The medium storage temperature shall be calculated according to Equation (8):

$$\vartheta_M = \frac{\vartheta_A + \vartheta_E}{2} \tag{8}$$

with

$$\vartheta_A = \frac{\sum_{i=1}^n \vartheta_{Ai}}{n} \text{ and } \vartheta_E = \frac{\sum_{i=1}^n \vartheta_{Ei}}{n}$$

The heat loss within 24 h shall be calculated according to Equation (9):

$$Q_B = \frac{\min(45K; \vartheta_{xn})}{\vartheta_M - \vartheta_{amb}} \cdot E \tag{9}$$



## 6 Requirements on the test rig

### 6.1 Environment

Ambient temperature should be between 15 °C and 28 °C. Air speed in the area shall not exceed 0,25 m/s.

The relative humidity shall be lower than 85 %.

The water heater shall be protected from radiation from the environment.

The cold water temperature  $\vartheta_c$  shall not vary more than  $\pm 1$  K during the test, and has to be below 18 °C and higher than 8°C.

### 6.2 Measuring accuracy

#### 6.2.1 Temperature

Temperatures shall be measured with a minimum accuracy of  $\pm 0,1$  K. It shall be guaranteed by appropriate installation of the temperature probes that on the measuring points the medium caloric temperature of the water is measured. The time constant for the temperature measurement shall not be larger than 5 s.

#### 6.2.2 Mass and volume flow

The mass and volume flow of the water shall be measured with minimum accuracy of 1 %.

#### 6.2.3 Time

The time shall be measured with a minimum accuracy of  $\pm 1$  s.

#### 6.2.4 Electrical energy

Electrical energy shall be measured with a minimum accuracy of 1 %, at least  $\pm 10$  Wh.

#### 6.2.5 Measurement cycle time

The cycle time for the measurement after 5.3 shall not be larger than 10 s.

For all other measurements according to Clause 4 the cycle time should not be larger than 60 s.

#### 6.2.6 Volume

The actual storage capacity of the storage tank shall be measured with a minimum accuracy of 1 %.

---

---

## BSI — British Standards Institution

BSI is the independent national body responsible for preparing British Standards. It presents the UK view on standards in Europe and at the international level. It is incorporated by Royal Charter.

### Revisions

British Standards are updated by amendment or revision. Users of British Standards should make sure that they possess the latest amendments or editions.

It is the constant aim of BSI to improve the quality of our products and services. We would be grateful if anyone finding an inaccuracy or ambiguity while using this British Standard would inform the Secretary of the technical committee responsible, the identity of which can be found on the inside front cover.  
Tel: +44 (0)20 8996 9000. Fax: +44 (0)20 8996 7400.

BSI offers members an individual updating service called PLUS which ensures that subscribers automatically receive the latest editions of standards.

### Buying standards

Orders for all BSI, international and foreign standards publications should be addressed to Customer Services. Tel: +44 (0)20 8996 9001.  
Fax: +44 (0)20 8996 7001. Email: [orders@bsi-global.com](mailto:orders@bsi-global.com). Standards are also available from the BSI website at <http://www.bsi-global.com>.

In response to orders for international standards, it is BSI policy to supply the BSI implementation of those that have been published as British Standards, unless otherwise requested.

### Information on standards

BSI provides a wide range of information on national, European and international standards through its Library and its Technical Help to Exporters Service. Various BSI electronic information services are also available which give details on all its products and services. Contact the Information Centre.  
Tel: +44 (0)20 8996 7111. Fax: +44 (0)20 8996 7048. Email: [info@bsi-global.com](mailto:info@bsi-global.com).

Subscribing members of BSI are kept up to date with standards developments and receive substantial discounts on the purchase price of standards. For details of these and other benefits contact Membership Administration.  
Tel: +44 (0)20 8996 7002. Fax: +44 (0)20 8996 7001.  
Email: [membership@bsi-global.com](mailto:membership@bsi-global.com).

Information regarding online access to British Standards via British Standards Online can be found at <http://www.bsi-global.com/bsonline>.

Further information about BSI is available on the BSI website at <http://www.bsi-global.com>.

### Copyright

Copyright subsists in all BSI publications. BSI also holds the copyright, in the UK, of the publications of the international standardization bodies. Except as permitted under the Copyright, Designs and Patents Act 1988 no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means – electronic, photocopying, recording or otherwise – without prior written permission from BSI.

This does not preclude the free use, in the course of implementing the standard, of necessary details such as symbols, and size, type or grade designations. If these details are to be used for any other purpose than implementation then the prior written permission of BSI must be obtained.

Details and advice can be obtained from the Copyright & Licensing Manager.  
Tel: +44 (0)20 8996 7070. Fax: +44 (0)20 8996 7553.  
Email: [copyright@bsi-global.com](mailto:copyright@bsi-global.com).