



BSI Standards Publication

**Information technology —
Automated infrastructure
management (AIM) systems —
Requirements, data exchange
and applications**

National foreword

This British Standard is the UK implementation of EN 50667:2016.

The UK participation in its preparation was entrusted to Technical Committee TCT/7, Telecommunications - Installation requirements.

A list of organizations represented on this committee can be obtained on request to its secretary.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

© The British Standards Institution 2017.
Published by BSI Standards Limited 2017

ISBN 978 0 580 94098 9

ICS 35.110; 35.240.99

Compliance with a British Standard cannot confer immunity from legal obligations.

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 31 January 2017.

Amendments/corrigenda issued since publication

Date	Text affected
------	---------------

EUROPEAN STANDARD

EN 50667

NORME EUROPÉENNE

EUROPÄISCHE NORM

December 2016

ICS 35.110; 35.240.99

English Version

Information technology - Automated infrastructure management (AIM) systems - Requirements, data exchange and applications

Technologies de l'information - Systèmes de gestion d'infrastructure automatisée (AIM, Automated infrastructure management) - Exigences, interfaces et applications

Informationstechnik - Systeme für automatisiertes Infrastrukturmanagement (AIM) - Anforderungen, Schnittstellen und Anwendungen

This European Standard was approved by CENELEC on 2016-10-24. CENELEC members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CENELEC member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CENELEC member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CENELEC members are the national electrotechnical committees of Austria, Belgium, Bulgaria, Croatia, Cyprus, the Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, the Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.



European Committee for Electrotechnical Standardization
Comité Européen de Normalisation Electrotechnique
Europäisches Komitee für Elektrotechnische Normung

CEN-CENELEC Management Centre: Avenue Marnix 17, B-1000 Brussels

Contents

Page

European foreword.....	4
Introduction.....	5
1 Scope.....	6
2 Normative references.....	6
3 Terms, definitions and abbreviations	6
3.1 Terms and definitions	6
3.2 Abbreviations	9
4 Conformance	9
5 Automated infrastructure management (AIM) systems	10
5.1 Functional elements.....	10
5.2 System requirements.....	10
5.3 Functional requirements	10
5.3.1 Documentation and maintenance of information within AIM software	10
5.3.2 Management and usage of information within AIM software	11
5.3.3 Integrity of information within AIM software	12
5.4 Functional recommendations	12
6 AIM solutions: business benefits	12
6.1 General	12
6.2 Intrinsic benefits of stand-alone AIM systems.....	12
6.2.1 Accurate documentation	12
6.2.2 Asset management	13
6.2.3 Capacity management	13
6.2.4 Change management	13
6.2.5 Incident management	14
6.3 Extrinsic benefits of AIM when linked with other business information and network management systems.....	14
6.3.1 General	14
6.3.2 IT-related systems.....	15
6.3.3 Building management systems	18
6.3.4 Data centre infrastructure management (DCIM)	18
6.3.5 Configuration management database (CMDB) applications	20
7 AIM solutions: Data exchange framework.....	21
7.1 General	21
7.2 Data exchange format and protocols.....	21
7.3 Commands	21
7.4 Common data model definition	22
7.4.1 General	22

7.4.2 Element reference ID.....	22
7.4.3 Element and attribute definitions	23
7.4.4 Containment rules and hierarchy	29
Annex A (informative) Hierarchy and containment rules.....	30
Annex B (informative) Field descriptions	32
Annex C (normative) Implementation requirements and recommendations	34
C.1 General	34
C.2 Design.....	34
C.3 Specification	34
C.4 Installation	35
C.5 Operation	35
Annex D (informative) Optional lower level data exchange framework	36
Bibliography.....	37
Figures	
Figure 1 — Example of a helpdesk work flow integrated with an AIM system	17
Figure 2 — Relationship between AIM systems and CMDB applications	20
Figure A.1 — Spaces.....	30
Figure A.2 — Telecommunications equipment	31
Figure A.3 — Work orders	31
Tables	
Table 1 — Work order management commands.....	21
Table 2 — Asset management	22
Table 3 — Alarms and events	22
Table 4 — Circuit tracing	22
Table 5 — Attribute key.....	23
Table 6 — Connectivity	23
Table 7 — Premises/space	24
Table 8 — Furniture.....	24
Table 9 — Telecommunications equipment	25
Table 10 — Organizational element.....	27
Table 11 — Work Order.....	28
Table 12 — Work Order Task	28
Table 13 — Event.....	28
Table 14 — Alarm	29
Table B.1 — AIM software fields	32
Table D.1 — Port level.....	36
Table D.2 — Port level work actions.....	36

European foreword

This document (EN 50667:2016) has been prepared by CLC/TC 215 “Electrotechnical aspects of telecommunication equipment”, based upon ISO/IEC 18598:2016 “Information technology – Automated infrastructure management (AIM) systems – Requirements, data exchange and applications”.

The following dates are fixed:

latest date by which this document has to be implemented at national level by publication of an identical national standard or by endorsement	(dop)	[2017-07-24]
---	-------	--------------

latest date by which the national standards conflicting with this document have to be withdrawn	(dow)	[2019-10-24]
---	-------	--------------

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CENELEC shall not be held responsible for identifying any or all such patent rights.

Introduction

This European Standard is intended for:

- a) premises owners and facility managers;
- b) suppliers of AIM solutions;
- c) planners of network infrastructures;
- d) network operation managers;
- e) data centre operation managers;
- f) IT process managers;
- g) suppliers of management system software;
- h) software integrators.

This European Standard is one of a number of documents prepared in support of European Standards and Technical Reports produced by CLC/TC 215.

1 Scope

This European Standard specifies the requirements and recommendations for the attributes of automated infrastructure management (AIM) systems.

This European Standard explains how AIM systems can contribute to operational efficiency and deliver benefits to:

- a) cabling infrastructure and connected device administration;
- b) facilities and IT management processes and systems;
- c) other networked management processes and systems (e.g. intelligent building systems);
- d) business information systems covering asset tracking and asset management together with event notifications and alerts that assist with physical network security.

This European Standard specifies a framework of requirements and recommendations for data exchange with other systems.

2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

Not applicable.

3 Terms, definitions and abbreviations

3.1 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

3.1.1

AIM-enabled port

port which is able to automatically detect the insertion and removal of a cord and process that event as part of an automated infrastructure management system

3.1.2

AIM hardware

combination of patch panels and controllers that are designed to automatically detect the insertion or removal of cords, to record connectivity information, and to exchange connectivity information with AIM software

3.1.3

AIM system

integrated hardware and software system that automatically detects the insertion or removal of cords, documents the cabling infrastructure including connected equipment enabling management of the infrastructure and data exchange with other systems

3.1.4

alarm

event of sufficient importance to be highlighted within the AIM system

3.1.5

application programming interface

API

set of commands, functions and protocols that specify how software components should interact

3.1.6

basic connectivity configuration

list of information including, but not restricted to, number and type of ports, number of slots, expansion cards, MAC and IP address

3.1.7

business information system

system that is used to analyse and facilitate strategic and operational activities for an organization

3.1.8

building management system

BMS

computer-based control system installed in a building that controls and monitors mechanical and electrical equipment such as heating, ventilation and air-conditioning (HVAC), power systems and access control systems

3.1.9

cabling connectivity information

combination of connection information automatically detected by AIM and additional cabling infrastructure information from various sources

3.1.10

cabling infrastructure

cables, connecting hardware, panels and other closures, cabinets, frames, racks together with pathways and spaces providing their accommodation

3.1.11

circuit

series of electromagnetically connected components or devices

3.1.12

closure

fixture or fitting of either open or closed construction intended to contain connecting hardware

[SOURCE: EN 50174-1:2009, 3.1.8]

3.1.13

command

defined method which either provides data or performs an internal operation within an AIM system based on a request

Note 1 to entry: A command may contain zero or more parameters.

3.1.14

configuration management database

repository of information related to all the components of an information system

3.1.15

connecting hardware

device or combination of devices used to connect cables or cable elements

3.1.16

connection information

record of an event generated by the insertion or removal of a connector at an AIM-enabled port

3.1.17

cord

cable unit or cable element with a minimum of one termination

[SOURCE: EN 50173-1:2011, 3.1.30]

3.1.18

data

value or set of values that describes information within an AIM system

3.1.19

data exchange

ability of an AIM system and other systems to work together reliably

3.1.20

discoverable equipment

equipment with a network address

Note 1 to entry: Discoverable equipment could be treated as non-discoverable equipment according to end user choice.

3.1.21

end device

equipment that is either the source or the destination of a message on a networked system

3.1.22

event

change in state of an element within the AIM system

3.1.23

information security management system

part of the overall management system, based on a business risk approach, that establishes, implements, operates, monitors, reviews, maintains and improves information security

Note 1 to entry: The management system includes organizational structure, policies, planning activities, responsibilities, practices, procedures, processes and resources.

3.1.24

interoperability

ability for two or more independent systems to exchange data or information

3.1.25

managed network distribution equipment

discoverable network distribution equipment that uses communications protocols such as the simple network management protocol (SNMP) to exchange management information

3.1.26

network distribution equipment

electronic equipment that provides connectivity and supports data exchange between end-devices

3.1.27

non-discoverable equipment

equipment without a network address

3.1.28

patch panel

closure designed to be mounted in a cabinet, frame or rack

3.1.29

permissions

set of rules which describe what a user or group of users may access or control within an AIM system

3.1.30

telecommunications infrastructure

cabling infrastructure together with the network distribution equipment, end devices and their accommodation

3.1.31

work order

set of one or more actions that should be performed by a technician or user of the system

3.2 Abbreviations

For the purposes of this document, the following abbreviations apply.

AIM	automated infrastructure management
API	application programming interface
BMS	building management system
CMDB	configuration management database
DCIM	data centre infrastructure management
HVAC	heating, ventilation and air-conditioning
HTTP	Hypertext Transfer Protocol
IP	Internet Protocol
IT	information technology
ITIL	Information Technology Infrastructure Library
JSON	JavaScript Object Notation
MAC	media access control
PC	personal computer
PoE	Power over Ethernet
REST	Representational State Transfer
SNMP	simple network management protocol
SOAP	Simple Object Access Protocol
WAP	wireless access point
XML	extended markup language

4 Conformance

For an AIM system to conform to this European Standard, it shall

- a) comprise hardware and software components which together meet the requirements of Clause 5;
- b) meet the requirements of Clause 7;

- c) be implemented in accordance with the requirements of Annex C.

5 Automated infrastructure management (AIM) systems

5.1 Functional elements

An AIM system shall include the following two functional elements:

- a) hardware that automatically detects the insertion and removal of cords;
- b) software that:
 - collects and stores the resulting connection information;
 - relates the connection information to cabling connectivity information;
 - relates the cabling connectivity information to information from other sources;
 - makes the connection information accessible to either an authorized user or to other systems.

It is important to note that although the initial detection of connectivity is generally accomplished through electrical, electronic, electro-mechanical or optical means, the different functions and features using this data are implemented in software.

The software used for AIM systems shall include either application programming interfaces (APIs) or data exchange formats as described in Clause 7 to allow data from the AIM system to be shared with other systems used by the organization. This is an important aspect for enhancing and automating the management and operational functions in the building and data centres.

5.2 System requirements

An AIM system shall be able to:

- a) automatically detect connectivity between AIM-enabled panel ports;
- b) automatically detect connectivity between AIM-enabled panel ports and other equipment (with AIM-enabled ports) or document and/or infer connectivity between AIM-enabled panel ports and other equipment (without AIM-enabled ports);
- c) monitor the connections and disconnections of a) and b).

5.3 Functional requirements

5.3.1 Documentation and maintenance of information within AIM software

Once configured, an AIM system shall be able to:

- a) accommodate the chosen identification scheme for the items to be documented within the AIM software (including identification schemes in accordance with EN 81346-1 and EN 50174-1, an implementation of which is described in ISO/IEC/TR 14763-2-1);
- b) record the connections between elements within the cabling infrastructure;
- c) automatically detect, document and monitor the presence of discoverable equipment connected to the network and

- 1) the basic connectivity configuration of managed network distribution equipment;
- 2) the network-related information of end devices;
- d) automatically update records when any monitored connections (including those of 5.2) are modified;
- e) manually document asset information for non-discoverable equipment;
- f) document the physical location of the network distribution equipment connected to the network;
- g) document and/or infer connectivity between non-AIM enabled ports and other equipment;
- h) document the presence and physical location of AIM hardware;
- i) identify and track the physical location of end devices connected to the network;
- j) maintain a history of events relating to items a) to i);
- k) enable the display of mapped items documented within the AIM software to a physical location on building plans and layouts.

5.3.2 Management and usage of information within AIM software

An AIM system shall be able to:

- a) enable the user to define conditions in which an event generates an alarm;
- b) enable a user to define the conditions in which an alarm generates a notification;
- c) enable a user to view graphical representation of connectivity (circuit trace) and other relational information for the items documented within the AIM software;
- d) provide recommendations on the cabling connectivity tasks required within work orders for service provision;
- e) enable a user to manage work orders related to items documented within the AIM software:
 - 1) create;
 - 2) assign or re-assign;
 - 3) schedule or re-schedule;
 - 4) perform;
 - 5) track (status);
 - 6) close;
- f) maintain a work order history;
- g) provide access to electronic work orders and other information maintained by the AIM system in the spaces where the AIM hardware is located;
- h) provide a means to automatically detect the accuracy of implementation of connect/disconnect work order tasks between AIM-enabled ports:
 - 1) provide a means to alert of an incorrect implementation;
 - 2) automatically update the task status following correct implementation;

- i) generate reports (both automatically and on-demand) related to items documented within the AIM software.

5.3.3 Integrity of information within AIM software

Upon recovery from disruption to an AIM system or its components, the system shall provide the ability to:

- a) maintain the integrity of information within the AIM software;
- b) reflect the current state of monitored connectivity.

5.4 Functional recommendations

An AIM system should be able to generate formatted data for the production of labels.

6 AIM solutions: business benefits

6.1 General

Clause 6 maps the intrinsic capabilities of AIM systems defined in Clause 5 to real-world benefits and provides examples of where the extension of the capabilities by linkage to external systems may provide additional benefits to an organization.

6.2 Intrinsic benefits of stand-alone AIM systems

6.2.1 Accurate documentation

Poorly documented systems are difficult to troubleshoot. AIM systems can provide automated up-to-date documentation that can improve system availability. Easily accessible and current documentation allows organizations to spend less time obtaining information necessary to troubleshoot cabling infrastructure and network problems.

6.2.2 Asset management

The purpose and intent of asset management is to improve the effective utilization and availability of business assets with the aim of reducing operating cost.

Assets include all elements of software and hardware that are found in the business environment.

Information technology (IT) asset management is an important part of an organization's strategy. It usually involves gathering detailed hardware and software inventory information which is then used to make decisions about hardware and software purchases and redistribution. IT inventory management helps organizations manage their systems more effectively. It also saves time and money by avoiding unnecessary asset purchases and promoting the harvesting of existing resources.

AIM systems are capable of manually documenting asset information for passive components and have the capability to discover the presence of, and maintain information about the network connectivity status and derived location of:

- a) network distribution equipment, e.g. routers, switches, wireless access points (WAPs);
- b) end devices, e.g. servers, personal computers (PCs), Internet Protocol (IP) telephones, IP cameras, access control equipment, etc.

To limit disruption of business operations and information security, organizations utilize incident management processes. AIM systems are able to enhance these processes through recording events and generating notifications, alerts and alarms in response to the recorded events.

There are also potential benefits to the storage of acceptance test or configuration information within the record of the connected network distribution equipment or end devices (see 6.3.2.3).

6.2.3 Capacity management

An organization is able to use the record of capacity and utilization of telecommunications infrastructure facilities, network distribution equipment or end devices maintained by the AIM system to improve the speed and accuracy of planning of moves, adds and changes. Examples include the following.

- a) In all situations, through its ability to analyse physical status of equipment ports and correlate that information to logical status of these ports, the AIM system is able to pinpoint unused ports that could be freed up for production use, thereby maximizing the utilization of existing network equipment and possibly eliminating future asset purchases.
- b) In office environments, the record of switch ports with a patched connection may be related to the number of switch ports without an end-device connection and used to create a work order to remove cords from unused ports – ensuring the maximum use of existing ports and potentially negating the need to purchase additional capacity.
- c) In data centres, the record of total telecommunications infrastructure space and occupied telecommunications infrastructure space may be used to accurately assess the available space to house incoming telecommunications infrastructure equipment and to assist in the planning of the new location.

6.2.4 Change management

Many industries have risk management regulations or recommendations that include requirements or recommendations for change management control. For example:

- a) in the finance industry: Sarbanes–Oxley Act and BASEL III;
- b) in data centres: the EU Code of Conduct and ITIL;

- c) in the pharmaceutical industry: US. Food and Drugs Administration – Good Manufacturing Practices.

Changes to the cabling infrastructure, network distribution equipment and end devices are maintained within AIM systems and include but are not limited to the real-time information about:

- 1) authorized and unauthorized patching activities;
- 2) generation of move, add, change work orders or a linkage with work order management systems in order to reduce the time required to implement connectivity changes, and to deliver improved accuracy by minimizing possibilities of human errors;
- 3) automated tracking of work order completion;
- 4) scheduled work order history;
- 5) monitoring changes to connectivity, providing user defined alerts, maintaining a change history as described in 6.3.5.

6.2.5 Incident management

AIM systems are able to record events and generate notifications, alerts and alarms in response to the recorded events. This facility can enhance security by notification of unauthorized connections, disconnections or access to the AIM system. This information can be provided to IT or physical security staff within the organization. The real-time event notification may be sent using a variety of methods depending on the functionality of the AIM system (e.g. email, text messaging, SNMP traps).

6.3 Extrinsic benefits of AIM when linked with other business information and network management systems

6.3.1 General

Exchange of data between an AIM system and business information or network management systems can provide enhanced functionality to both systems (IP telephony management, helpdesk applications, etc.).

Other business information systems are a broad category that may apply to many different systems or applications within customer owned premises. The following non-exhaustive list of systems and applications are covered because of their importance and impact when linked with AIM systems.

- a) IT-related systems:
- Internet Protocol (IP) telephony management;
 - network management systems;
 - helpdesk or incident management applications;
 - information security management systems.
- b) Building management systems:
- energy management systems;
 - lighting control systems.
- c) Data centre infrastructure management (DCIM).
- d) Configuration management database (CMDB) applications.

6.3.2 IT-related systems

6.3.2.1 IP telephony management

Traditionally, locating a call from a voice over IP (VoIP) phone means relying on a database that is updated and verified manually, meaning information could be out-of-date or incorrect. In times of emergency, corporate security needs to have the ability to quickly and accurately pinpoint the location from where an emergency call was originated. The AIM system tracks physical location of end devices that are connected to the cabling infrastructure including VoIP phones. Through integration with a VoIP management system, the location information maintained by the AIM system can be displayed on the VoIP phone screens that are used by corporate security. In this way a security officer will have access to the location information as soon as an emergency call is received. Additionally, depending on features of VoIP phones, the AIM system could provide a snapshot of a floor plan with the location of the caller highlighted.

6.3.2.2 Network management systems

Network management systems manage the network elements, also called managed devices. Device management includes fault, configuration, accounting, performance, and security management.

Management tasks include discovering network inventory, monitoring device health and status, providing alerts to conditions that impact system performance, and identification of problems, their source(s) and possible solutions.

The benefits of interoperability with AIM systems include:

- a) the consolidation of all alerts related to network elements in a single console to streamline network fault management by correlating alerts received from network elements as well as from cabling infrastructure – this is provided by the ability of AIM systems to generate events about a status change in cabling infrastructure and forward these events as SNMP traps to network management software applications;
- b) an expansion of the existing ability for discovering network inventory based on a logical network map with an ability to display physical connectivity between network elements;
- c) the ability to pinpoint physical location of each discovered network element.

6.3.2.3 Helpdesk applications

The helpdesk is one of several ITIL functions. It covers handling of incidents and requests, and provides an interface for other IT service management processes. In other industry sectors, it is also known as “service desk”.

The primary purposes of a helpdesk include:

- a) incident management: life-cycle management of all service requests;
- b) communication: keeping a customer informed of progress and advising on workarounds.

The benefits of interoperability with AIM systems include:

- 1) real-time notification of changes to connectivity;
- 2) enhanced information relating to the physical network including network distribution equipment, end devices and cabling infrastructure;
- 3) automation of service ticket creation process related to move, add and change activities;
- 4) ability to remotely troubleshoot cabling connectivity incidents;
- 5) ability to automatically update service ticket status upon completion of move, add and change activities.

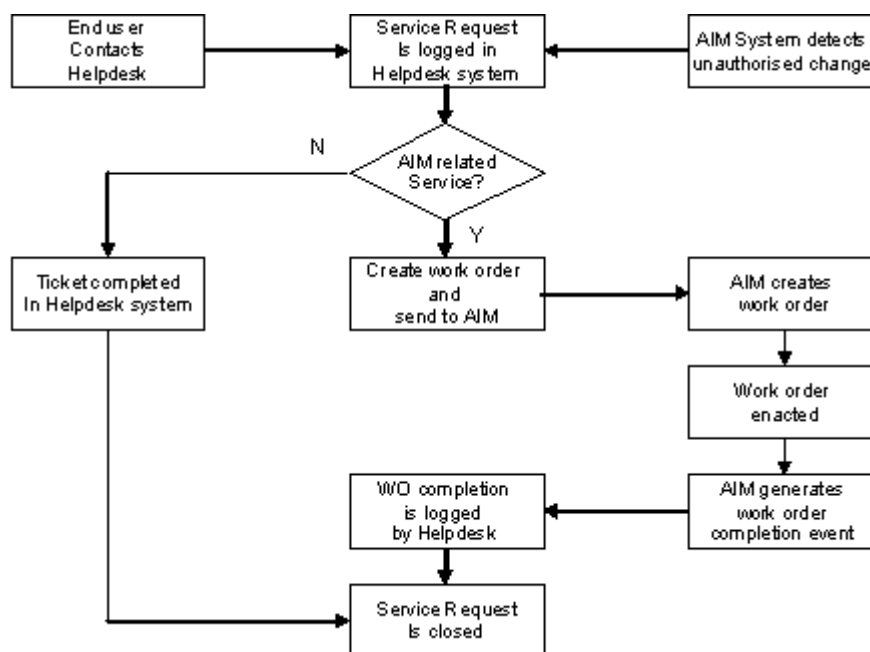


Figure 1 — Example of a helpdesk work flow integrated with an AIM system

The example shown in Figure 1 illustrates how using an AIM system tied to the helpdesk system can improve the efficiency of service request management.

6.3.2.4 Information security management systems

6.3.2.4.1 General

Network security, which is one of the domains described in ISO/IEC 27001, assumes importance to the organization. Networks change frequently as new users and devices are added. Newer data communication technologies are introduced, usage of various networking, communications, and computing technologies are employed to effectively meet these needs.

Sensitive data are increasingly transmitted over networks and proliferation of internet access has increased vulnerability as employees use the internet more for information and knowledge. The information security management system should communicate with the AIM system in such a way as to ensure that the data are not accessible or readable by unauthorized persons. Appropriate and secure authentication methods should be implemented to prevent unauthorized access to data at any AIM access point.

AIM should be considered as an additional means to enhance the network security via the cabling infrastructure.

6.3.2.4.2 Tracking of and response to unauthorized changes

Since the AIM system can track unauthorized changes, a linkage with the organization's physical security system would potentially allow the capture of photographic evidence of the person responsible for the unauthorized change. It can also be possible to automate a response to an unauthorized connection attempt, e.g. send SNMP trap.

6.3.2.4.3 Critical network circuits

Where the information security management system defines certain parts of the physical network as critical connectivity elements, a linkage with an AIM system would potentially enable the generation of real-time notification of breaches to these critical elements as required (audio alarm, urgent text, flashing pop-up, etc.).

6.3.3 Building management systems

6.3.3.1 General

An increasing number of building management systems (BMS) and security systems are adopting an IP-based communication and their control equipment and elements are becoming connected using generic, structured cabling infrastructure.

When used in combination with IP-based BMS, an AIM system is able to provide the BMS management software with valuable information about the physical location of its control equipment within a facility, as well as sending real-time alerts in case if any equipment gets disconnected from the network to assist with troubleshooting.

Subclauses 6.3.3.2 to 6.3.3.5 highlight particular linkages.

6.3.3.2 Energy management systems in buildings

Energy management is a key aspect of facility management that that can deliver increased energy efficiency and reduced energy costs while minimizing overall environmental impact.

With a considerable proportion of the world's electricity consumed inside office buildings, reducing that share is a key objective for all building stakeholders.

Cabling infrastructure that is connected to sensors and controllers or used for delivering Power over Ethernet (PoE) to powered terminal devices plays a significant role in facilitating energy management systems, and an AIM system provides the capability for accurate identification of physical locations of connected devices in real time.

Providing real-time physical location information for connected devices to energy management applications allows these applications to apply real-time location based energy policies.

6.3.3.3 Lighting management systems

Lighting in commercial buildings is often not turned off in unoccupied areas of a building leading to wasted energy, additional maintenance, and poor environmental impact. An AIM system may be integrated with a lighting management system to combine asset, location and usage data to better manage and control devices or implement energy savings plans.

6.3.3.4 Building security

Interaction between BMS and AIM systems may improve building security in some environments by relating connect/disconnect events with security events. For example, since the AIM system can infer the connection location associated with the arrival of a previously unknown MAC address this information could be linked to an image or series of images from an IP security camera in that area. This information can then be passed to the network administrator and/or building security staff.

6.3.3.5 Access control

In conjunction with energy management of PoE and employee time and attendance systems and/or access control systems, AIM systems are able to utilize data from external sources, such as badge/card readers, to identify areas of the building which are not in use. This information may be used to control the power supplied to those areas including employees' equipment e.g. IP phone. The resultant reduction in power consumption has potential financial and environmental benefits for an organization.

6.3.4 Data centre infrastructure management (DCIM)

At a high level, DCIM is able to help infrastructure managers to holistically manage the entire physical infrastructure across both telecommunications infrastructure and the wider data centre facility domains – all assets, systems and their interdependencies.

A DCIM application set is able to improve efficiency and lower costs across six key management areas:

- a) operations;
- b) resources;
- c) assets and connectivity;
- d) change;
- e) availability;
- f) capacity planning/demand.

DCIM is able to:

- 1) identify and eliminate sources of risk to increase availability of critical IT systems;
- 2) identify interdependencies between IT and wider data centre facility assets to alert the manager to gaps in system performance or redundancy;
- 3) assist in modelling the cost structures of building and maintaining the huge accumulation of assets which form the data centre, over long periods of time.

To support this functionality, DCIM needs access to real-time data from both the telecommunications infrastructure and the wider data centre facilities.

AIM is able to provide the DCIM platform with real-time-data information from the cabling infrastructure.

The contribution of AIM to DCIM includes but is not limited to:

- operations management: identifying unplanned or unauthorized changes to infrastructure connectivity and generating alarms to alert DCIM console about these changes;
- assets and connectivity management:
 - a) providing visibility into network path redundancy through the ability of an AIM system to discover the different physical network paths that can exist between assets;
 - b) maintaining complete physical connectivity documentation along with information about the presence of interconnected network distribution equipment and end devices (device discovery);
- change management: automated tracking of connectivity changes to support moves, adds, and changes of IT assets, such as the commissioning and decommissioning of servers;
- availability management: providing connectivity information to help with root cause analysis and other alarm management activities related to physical connectivity, such as diagnosing and resolving network issues;
- capacity planning: accurate port capacity information for patch panels and network distribution equipment to enhance the capacity planning of the DCIM software which may be enhanced if it can be related to the availability of power and cooling.

6.3.5 Configuration management database (CMDB) applications

A linkage to an AIM system can provide automated updating of the physical location of networked IT assets, which ensures the information accuracy that is maintained by CMDB applications.

A key success factor in implementing CMDB applications is the ability to automatically discover information about the items of the CMDB and to track changes as they happen.

Integration with an AIM system could benefit CMDB applications with automatically updated data related to IT assets and their interrelationship via connectivity information that is maintained, monitored and managed within the AIM system. For example, an AIM system could update the items within the CMDB with location information whenever that information changes either due to scheduled or unscheduled connectivity changes.

Figure 2 describes several modules within an AIM system that could be used for updating data in CMDB applications.

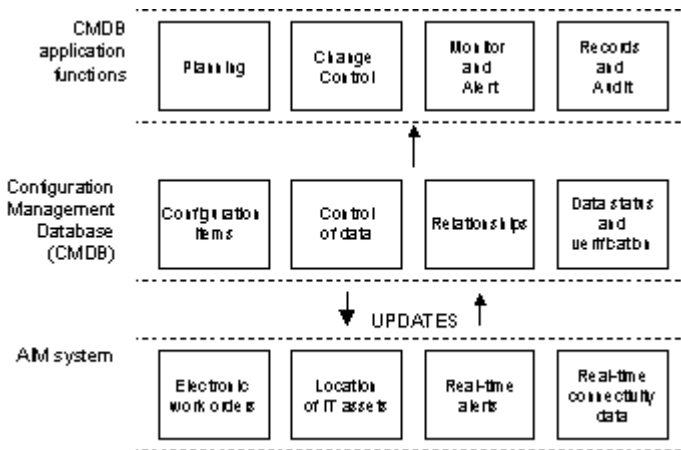


Figure 2 — Relationship between AIM systems and CMDB applications

7 AIM solutions: Data exchange framework

7.1 General

Clause 7 sets out a framework for interoperability between AIM systems and/or other third party applications. It addresses data exchange format, protocols and commands and defines a common data model describing elements (which can be assets or cabling infrastructure) contained within an AIM system.

The AIM system shall provide a system level data exchange framework as described in 7.3 using one of the formats or protocols described in 7.2.

Where a lower level data exchange framework is specified, it should conform to the commands and data model described in Annex D.

7.2 Data exchange format and protocols

The data exchange may be performed by one or more interfaces which are exposed by the AIM system. These interfaces shall conform to either:

- a) an HTTP SOAP (Simple Object Access Protocol) based web service or;
- b) a RESTful HTTP based web service exposing XML or JSON objects.

The data exchange format(s) and protocols shall be defined for an AIM system.

The data exchange interface or interfaces shall expose commands of 7.3.

7.3 Commands

Commands are used to query, create, delete or modify data (based upon defined permissions) within the AIM system. The specific naming of each operation may vary according to the AIM system, however they should conform to the input parameters and response parameters described in Table 1 to Table 4.

Operations may be supplemented by additional parameters. Where the parameter or response is surrounded by {} if refers to a data object described in 7.4.

Table 1 — Work order management commands

Operation	Description	Parameters	Response
Create work order	Creates a new work order within the AIM system.	Name, Description, Start date, End date, Manager, Technician	Status, Work Order ID
Create work order task/step	Creates a work order step within an existing work order	Work Order ID, {Work Order Task}	Status
Query work order	Get information about an existing work order and its tasks	Work Order ID	Status, {Work Order}
Delete work order	Delete an existing work order and all its tasks	Work Order ID	Status

Table 2 — Asset management

Operation	Description	Parameters	Response
Create asset	Create a new asset within the system	Parent Element ID, Asset ({Premises/space}, {Furniture}, {Telecommunications equipment})	Status, Element ID
Query asset	Query an existing asset within the system	Element ID	Status, Asset ({Premises/space}, {Furniture}, {Telecommunications equipment})
Delete asset	Delete an existing asset within the system	Element ID	Status

Table 3 — Alarms and events

Operation	Description	Parameters	Response
Query events	Query all events matching a specified criterion	Event type, Start time, End time	Status, List of {Events}
Query event	Query an existing event within the system	Event ID	Status, {Events}
Query alarms	Query all alarms matching a specified criterion	Alarm type, Start time, End time	Status, List of {Alarms}

Table 4 — Circuit tracing

Operation	Description	Parameters	Response
Query circuit trace	Query a circuit trace based on a specified port	Element ID, Port ID	Status, {Circuit}

7.4 Common data model definition

7.4.1 General

The common data model definition defines all physical and non-physical elements within the system. This includes derived connectivity information such as circuit segment connections and circuits.

7.4.2 Element reference ID

All the elements, i.e. telecommunications or non-telecommunications objects, managed by the AIM software shall have a unique element reference ID.

7.4.3 Element and attribute definitions

7.4.3.1 General

Elements of AIM software are described by name and required attributes. 7.4.3 provides a reference to ISO/IEC/TR 14763-2-1 where applicable. These are the minimal attributes for such elements within AIM software, and some software may provide more attributes. Annex B provides a description of AIM software fields.

Where elements have an attribute describing a parent element they will be part of a defined hierarchy which should be adhered to, this is also described.

Table 5 provides a key for designations applied to attributes of the elements.

Table 5 — Attribute key

Key	Parameter	Description
D	Derived value	The value of this field may be immutable and automatically generated by the system
O	Optional	Attributes for this field or element might not be present in all AIM systems

7.4.3.2 Connectivity

Connectivity represents either a connection, circuit segment or a circuit. A connection represents the connection of an A and B Element (for example a patch cord connected to a port). A circuit segment represents a connection at A and a connection at B connected via a common element C (for example ports A and B connected using a patch cord C). A circuit is a derived collection of circuit segment records. This represents an end to end connectivity in a network. See Table 6 for details.

Table 6 — Connectivity

Name	Attributes
Connection	ID A Element B Element
Circuit Segment	ID Name (D) A Element (D) B Element (D) C Common Element – (O)(D)
Circuit	ID Ordered List of Circuit Segments (D)

7.4.3.3 Premises/space

Premises/space represents a physical area whether it be an asset (i.e. building) or a designated area (region). See Table 7 for details and see Figure A.1 for hierarchical structure and containment rules.

Table 7 — Premises/space

Name	Attributes	Name	Attributes
Geographic Area	ID Name Description Location	Room	ID Name Description Location
Campus	ID Name Description Location	Zone	ID Name Description Location
Building	ID Name Description Location	Floor	ID Name Description Location

7.4.3.4 Furniture

Furniture represents any non-telecommunications equipment that may be managed or referenced in an AIM system. This may be office, data centre or outside equipment but is not part of the network infrastructure. See Table 8 for details. There are no current references to furniture in ISO/IEC/TR 14763-2-1.

Table 8 — Furniture

Name	Attributes
Desk (O)	ID Name Description Parent (Organizational Element)

7.4.3.5 Telecommunications equipment

Telecommunications equipment refers to any equipment which forms a physical part of the network infrastructure. IDs should be constructed using the ISO/IEC/TR 14763-2-1 references. See Table 9 for details and see Figure A.2 for hierarchical structure and containment rules.

Table 9 — Telecommunications equipment

Name	Attributes	Name	Attributes
Cabinet	ID Name Description Vendor (O) Part Number (O) Colour (O) Space (D) U Capacity Catalogue image (O)	Port	ID Name Description Vendor (O) Part Number (O) Colour(O) Parent Element (D) Catalogue image (O) Port Type Performance Level (O) Port status Service (D) (O) Cord Length (O)
Rack	ID Name Description Vendor (O) Part Number (O) Colour (O) Space (D) U Capacity Catalogue image (O)	Module	ID Name Description Vendor (O) Part Number (O) Colour (O) Parent Element (D) Position List of front ports List of back ports Port front-back mapping Template (O) Catalogue image (O)
Frame	ID Name Description Vendor (O) Part Number (O) Colour (O) Space (D) U Capacity Catalogue image (O)	Cable	ID Name Part Number (O) Type Vendor (O) Colour (O) Catalogue image (O) Cable Bundle Identifier (O) Length (O)

Name	Attributes
Cord (O)	ID Name Part Number (O) Colour (O) Vendor Length Connector A Connector B Cable Catalogue image (O)
Closure	ID Name Description Vendor (O) Part Number (O) Colour (O) Parent Element (D) Catalogue image (O) U Height (O) List of modules (O) List of ports Template (O)
Patch Panel	ID Name Description Vendor (O) Part Number (O) Colour (O) Container (D) Position Catalogue image (O) U Height (O) List of modules (O) List of front ports List of back ports Port front-back mapping Template (O)

Name	Attributes
Connector (O)	ID Name Connector Type Catalogue image (O)
Network distribution equipment and end device (rack mounted)	ID Name Description Vendor (O) Part Number (O) Colour (O) Parent Element(D) Position (O) Catalogue image (O) U Height (O) List of modules (O) List of ports Template (O) Network Address (O) MAC Address (O) Maximum Port Power Delivery (O)
Network distribution equipment and end device (non-rack mounted)	ID Name Description Vendor (O) Part Number (O) Colour (O) Parent Element(D) Position (O) Catalogue image (O) U Height (O) List of modules (O) List of ports Template (O) Network Address (O) MAC Address (O)

Name	Attributes

Name	Attributes
	Maximum Port Power Delivery (O)

7.4.3.6 Organizational Element

An Organizational Element is an element which represents one or more people. All Organizational Elements can have a parent element (of type Organizational Element), but 'Person' cannot be a parent itself. See Table 10 for details.

Table 10 — Organizational element

Name	Attributes
Organization	ID Name Description
Group	ID Name Description Parent (Organizational Element)
Department	ID Name Description Parent (Organizational Element)
Team	ID Name Description Parent (Organizational Element)
Cost Centre	ID Name Description Parent (Organizational Element)
Person	ID Name Description Parent (Organizational Element)

7.4.3.7 Work Order

A Work Order is a task or a set of tasks related to elements or attributes of elements within an AIM system. It may contain one or more Work Order Tasks, is assigned to an Organizational Element and implemented by an Organizational Element. See Table 11 for details and Figure A.3 for hierarchical structure and containment rules.

Table 11 — Work Order

Work Order	ID Name Description Scheduled Start Time Scheduled End Time List of Work Order Tasks Assigned (Organizational Element) Implementer (Organizational Element) Work Order State
-------------------	--

7.4.3.8 Work Order Task

A work order task is an actionable task which applies to an element or an attribute of an element. See Annex A for containment rules. See Table 12 for details.

Table 12 — Work Order Task

Work Order Task	ID Name Description Task Type List of affected Elements Scheduled Start Time Scheduled End Time Implementer (A member of WO Organizational Element) Dependencies (O) Task Status
------------------------	---

7.4.3.9 Event

An Event is anything which creates or changes the state of an element, Organizational Element, connection, work order or work order task and shall have a timestamp. See Table 13 for details.

Table 13 — Event

Event	ID Name Description Event Type List of Related Elements Timestamp
--------------	--

7.4.3.10 Alarm

An Alarm is any event of sufficient importance to require a notification or escalation to a user of the AIM system. See Table 14 for details.

Table 14 — Alarm

Alarm	ID Event ID Name Description Alarm Type Notification Details
--------------	---


7.4.4 Containment rules and hierarchy

For an element with a parent attribute a containment rule is defined. This states valid parent elements for the given element. An element lower in the hierarchy cannot contain one that appears higher. See Annex A for the hierarchical structure of the elements of the data model.

Annex A (informative)

Hierarchy and containment rules

Figures A.1 to A.3 describe the hierarchical structure and containment rules for the elements of the data model of 7.4.



NOTE A **Zone** can be a child of any premises/space.

Figure A.1 — Spaces

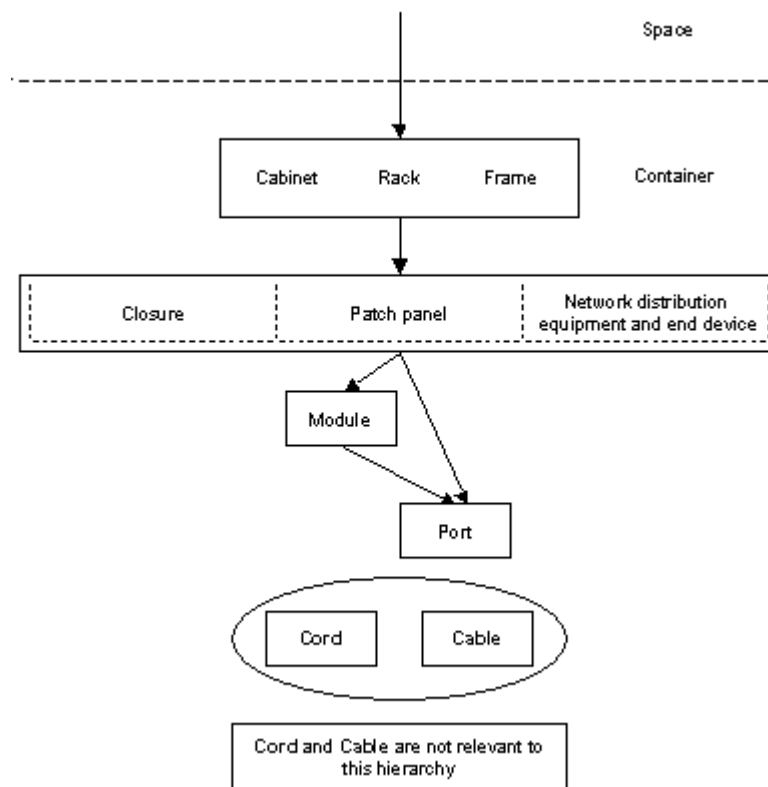


Figure A.2 — Telecommunications equipment




Figure A.3 — Work orders

Annex B (informative)

Field descriptions

Table B.1 provides descriptions of AIM software fields and these can differ from the terms and definitions of 3.1.

Table B.1 — AIM software fields

Name	Description
Connection	A physical connection between connectivity elements (i.e. a connector to a port)
Circuit Segment	A physical link formed of connections (i.e. two ports connected via a common cable)
Circuit	A collection of circuit segment elements which form a physical circuit
Geographic Area	An area describing a country, region or geographical location
Campus	A geographical area containing buildings
Building	A physical building or complex
Floor	A physical floor in a building
Room	A room located in a building
Zone	Any physical or logical sub-division of a space
Outdoor Space	A space at any level outside a building
Desk	A physical desk asset
Chair	A physical chair asset
Cabinet	A telecommunications cabinet as defined in EN 50174-2
Rack	A telecommunications rack as defined in EN 50174-2
Frame	A telecommunications frame as defined in EN 50174-2
Closure	A telecommunications closure, which contains connectivity
Patch Panel	A telecommunications panel which allows multiple connections through the front and rear of the panel and contains ports
Port	A port on the front or rear of a patch panel, closure, network distribution equipment or end device
Module	A module within a patch panel, network distribution equipment or end device
Cable	A physical cable containing either fibre or copper connectivity
Network distribution equipment and end device	A physical equipment which actively manages or routes data (i.e. a switch or router)
Organization	A company/organization or sub-division of a company/organization
Group	A non-exclusive group of people
Department	A sub-division of an organization
Team	A non-exclusive group of people
Cost Centre	An organizational reference which maps to multiple people or assets

Person	A person acting within an AIM system
--------	--------------------------------------

Annex C (normative)

Implementation requirements and recommendations

C.1 General

The purpose of the AIM system is to contribute to operational efficiency and to provide end users with a variety of benefits that are described in Clause 6. The realization of these benefits requires proper implementation of the system. The system shall be fully configured, tested and operational on the day when a customer is taking over ownership of the system.

AIM systems should be implemented by vendor qualified specialists.

As stated in EN 50174-1, there are four phases in the successful implementation of information technology cabling that are also applicable to AIM systems:

- a) design;
- b) specification;
- c) installation;
- d) operation.

C.2 Design

Design of the AIM system should be undertaken in consultation with:

- a) the cabling system designer;
- b) the customer to determine required features;
- c) other business systems that are intended to exchange data;
- d) network administrators.

C.3 Specification

C.3.1 Business, operational and system requirements

These requirements may include activation of specific features such as discovery of devices, service provisioning, configuration of event notifications, configuration of reports, naming conventions, etc.

It should be noted that the data collection “rules” or access rights imposed on the network by the business may affect the ability of the AIM system to automatically collect device data and this issue should be taken into account during the planning phase.

The business should define during the specification stage the reports/sets of information that are to be automatically generated and at which time interval. Examples include:

- a) when the device was first connected to the network;

- b) if and when it was removed from the network;
- c) if and when it was moved;
- d) how long it has been active or inactive;
- e) define system backup and failover mechanisms.

C.3.2 Integration requirements for data exchange with other applications

These requirements may include integration with helpdesk applications and CMDB, etc.

C.3.3 System test plan

A system test plan shall be established to validate activated features and installed cabling infrastructure.

C.4 Installation

Installation shall be undertaken according to system-specific installation guidelines including:

- a) AIM software installation and configuration with customer specific information;
- b) AIM hardware installation and configuration with customer specific information if necessary;
- c) AIM hardware synchronization/activation with AIM software;
- d) system testing according to the system test plan;
- e) definition of user privileges.

C.5 Operation

Prior to the operational phase, the following activities shall be considered:

- a) training of the operations staff;
- b) AIM system integration into the existing operational work flow;
- c) system handover to the customer;
- d) generation and implementation of work orders to establish cabling circuits.

Annex D (informative)

Optional lower level data exchange framework

Annex D describes a lower level data exchange framework which does not on its own constitute an AIM system but which allows data exchange with the AIM enabled hardware.

Lower level data exchange is not a conformance requirement for an AIM system. In the case where such a framework is provided, it should support the commands stated in Table D.1 and Table D.2. The specific naming of each operation may vary according to the implementation.

Table D.1 — Port level

Operation	Description	Parameters	Response
Get port information	Obtains port and plug information	Element, Module Port	Port Status, Plug Data (optional)

Table D.2 — Port level work actions

Operation	Description	Parameters	Response
Create work order action – connect	Creates a work order action (with guidance) to connect one or more ports	Set of { Element ID, Module ID, Port ID}	Confirmation
Create work order action – disconnect	Creates a work order action to disconnect one or more ports	Set of { Element ID, Module ID, Port ID}	Confirmation

Bibliography

- EN 50173-1:2011, *Information technology - Generic cabling systems - Part 1: General requirements*
- EN 50174-1, *Information technology - Cabling installation - Part 1: Installation specification and quality assurance*
- EN 50174-2, *Information technology - Cabling installation - Part 2: Installation planning and practices inside buildings*
- EN 81346-1, *Industrial systems, installations and equipment and industrial products - Structuring principles and reference designations - Part 1: Basic rules (IEC 81346-1)*
- ISO/IEC/TR 14763-2-1, *Information technology — Implementation and operation of customer premises cabling — Part 2-1: Planning and installation - Identifiers within administration systems*
- ISO/IEC 27001:2013, *Information technology — Security techniques — Information security management systems — Requirements*
- ITIL: *Information Technology Infrastructure Library*
- ITU-T L.64, *ID tag requirements for infrastructure and network elements management*
- BASEL III. www.bis.org/bcbs/basel3.htm?q1=1
- EU Code of Conduct: *EU Code of Conduct on Data Centres (Best Practices)*
- U.S. Food and Drugs Administration – Good Manufacturing Practices:
www.fda.gov/Drugs/GuidanceComplianceRegulatoryInformation/Guidances/ucm064971.htm
- ACT S.-O. www.gpo.gov/fdsys/pkg/PLAW-107publ204/html/PLAW-107publ204.htm

British Standards Institution (BSI)

BSI is the national body responsible for preparing British Standards and other standards-related publications, information and services.

BSI is incorporated by Royal Charter. British Standards and other standardization products are published by BSI Standards Limited.

About us

We bring together business, industry, government, consumers, innovators and others to shape their combined experience and expertise into standards-based solutions.

The knowledge embodied in our standards has been carefully assembled in a dependable format and refined through our open consultation process. Organizations of all sizes and across all sectors choose standards to help them achieve their goals.

Information on standards

We can provide you with the knowledge that your organization needs to succeed. Find out more about British Standards by visiting our website at bsigroup.com/standards or contacting our Customer Services team or Knowledge Centre.

Buying standards

You can buy and download PDF versions of BSI publications, including British and adopted European and international standards, through our website at bsigroup.com/shop, where hard copies can also be purchased.

If you need international and foreign standards from other Standards Development Organizations, hard copies can be ordered from our Customer Services team.

Copyright in BSI publications

All the content in BSI publications, including British Standards, is the property of and copyrighted by BSI or some person or entity that owns copyright in the information used (such as the international standardization bodies) and has formally licensed such information to BSI for commercial publication and use.

Save for the provisions below, you may not transfer, share or disseminate any portion of the standard to any other person. You may not adapt, distribute, commercially exploit, or publicly display the standard or any portion thereof in any manner whatsoever without BSI's prior written consent.

Storing and using standards

Standards purchased in soft copy format:

- A British Standard purchased in soft copy format is licensed to a sole named user for personal or internal company use only.
- The standard may be stored on more than 1 device provided that it is accessible by the sole named user only and that only 1 copy is accessed at any one time.
- A single paper copy may be printed for personal or internal company use only.

Standards purchased in hard copy format:

- A British Standard purchased in hard copy format is for personal or internal company use only.
- It may not be further reproduced – in any format – to create an additional copy. This includes scanning of the document.

If you need more than 1 copy of the document, or if you wish to share the document on an internal network, you can save money by choosing a subscription product (see 'Subscriptions').

Reproducing extracts

For permission to reproduce content from BSI publications contact the BSI Copyright & Licensing team.

Subscriptions

Our range of subscription services are designed to make using standards easier for you. For further information on our subscription products go to bsigroup.com/subscriptions.

With **British Standards Online (BSOL)** you'll have instant access to over 55,000 British and adopted European and international standards from your desktop. It's available 24/7 and is refreshed daily so you'll always be up to date.

You can keep in touch with standards developments and receive substantial discounts on the purchase price of standards, both in single copy and subscription format, by becoming a **BSI Subscribing Member**.

PLUS is an updating service exclusive to BSI Subscribing Members. You will automatically receive the latest hard copy of your standards when they're revised or replaced.

To find out more about becoming a BSI Subscribing Member and the benefits of membership, please visit bsigroup.com/shop.

With a **Multi-User Network Licence (MUNL)** you are able to host standards publications on your intranet. Licences can cover as few or as many users as you wish. With updates supplied as soon as they're available, you can be sure your documentation is current. For further information, email subscriptions@bsigroup.com.

Revisions

Our British Standards and other publications are updated by amendment or revision.

We continually improve the quality of our products and services to benefit your business. If you find an inaccuracy or ambiguity within a British Standard or other BSI publication please inform the Knowledge Centre.

Useful Contacts

Customer Services

Tel: +44 345 086 9001

Email (orders): orders@bsigroup.com

Email (enquiries): cservices@bsigroup.com

Subscriptions

Tel: +44 345 086 9001

Email: subscriptions@bsigroup.com

Knowledge Centre

Tel: +44 20 8996 7004

Email: knowledgecentre@bsigroup.com

Copyright & Licensing

Tel: +44 20 8996 7070

Email: copyright@bsigroup.com

BSI Group Headquarters

389 Chiswick High Road London W4 4AL UK