

# Electrical insulating materials used under severe ambient conditions — Test methods for evaluating resistance to tracking and erosion

The European Standard EN 60587:2007 has the status of a  
British Standard

ICS 17.220.99; 29.035.01

## National foreword

This British Standard is the UK implementation of EN 60587:2007. It is identical to IEC 60587:2007. It supersedes BS 5604:1986 which is withdrawn.

The UK participation in its preparation was entrusted to Technical Committee GEL/112, Evaluation and qualification of electrical insulating materials and systems.

A list of organizations represented on this committee can be obtained on request to its secretary.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

**Compliance with a British Standard cannot confer immunity from legal obligations.**

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 31 August 2007

© BSI 2007

ISBN 978 0 580 56252 5

### Amendments issued since publication

Amd. No.	Date	Comments

**Electrical insulating materials  
used under severe ambient conditions -  
Test methods for evaluating resistance to tracking and erosion  
(IEC 60587:2007)**

Matériaux isolants électriques utilisés  
dans des conditions ambiantes sévères -  
Méthodes d'essai pour évaluer  
la résistance au cheminement  
et à l'érosion  
(CEI 60587:2007)

Elektroisolierstoffe, die unter erschwerten  
Bedingungen eingesetzt werden -  
Prüfverfahren zur Bestimmung  
der Beständigkeit gegen  
Kriechwegbildung und Erosion  
(IEC 60587:2007)

This European Standard was approved by CENELEC on 2007-06-01. CENELEC members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Central Secretariat or to any CENELEC member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CENELEC member into its own language and notified to the Central Secretariat has the same status as the official versions.

CENELEC members are the national electrotechnical committees of Austria, Belgium, Bulgaria, Cyprus, the Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, the Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and the United Kingdom.

## CENELEC

European Committee for Electrotechnical Standardization  
Comité Européen de Normalisation Electrotechnique  
Europäisches Komitee für Elektrotechnische Normung

**Central Secretariat: rue de Stassart 35, B - 1050 Brussels**

## Foreword

The text of document 112/56/FDIS, future edition 3 of IEC 60587, prepared by IEC TC 112, Evaluation and qualification of electrical insulating materials and systems, was submitted to the IEC-CENELEC parallel vote and was approved by CENELEC as EN 60587 on 2007-06-01.

This European Standard supersedes HD 380 S2:1987.

The main changes from HD 380 S2:1987 are as follows:

- experience has indicated the need for improved description of the experimental method;
- for the preparation of the test specimens, abrasion is recommended only if necessary;
- the ventilation of the test chamber is described in detail;
- for specimens of soft elastomeric materials a mounting support is described;
- the maximum depth of erosion has to be reported in the classification.

The following dates were fixed:

- |  |       |            |
|--|-------|------------|
| – latest date by which the EN has to be implemented at national level by publication of an identical national standard or by endorsement | (dop) | 2008-03-01 |
| – latest date by which the national standards conflicting with the EN have to be withdrawn   | (dow) | 2010-06-01 |

---

## Endorsement notice

The text of the International Standard IEC 60587:2007 was approved by CENELEC as a European Standard without any modification.

---

## CONTENTS

1	Scope.....	4
2	Terms and definitions .....	4
3	Test specimens .....	5
3.1	Dimensions .....	5
3.2	Preparation .....	5
4	Apparatus.....	5
4.1	Electrical apparatus.....	5
4.2	Electrodes .....	7
4.3	Contaminant.....	8
4.4	Timing device .....	9
4.5	Depth gauge.....	9
4.6	Ventilation .....	9
5	Procedure .....	10
5.1	Preparation of the test.....	10
5.2	Method 1: Application of constant tracking voltage .....	12
5.3	Method 2: stepwise tracking voltage .....	13
5.4	End-point criteria.....	13
6	Test report.....	14
Table 1 – Test parameters .....		7
Figure 1 – Test specimen with holes for fixing electrodes .....		5
Figure 2 – Schematic circuit diagram .....		6
Figure 3 – Example: typical circuit for an overcurrent delay relay (F in Figure 2).....		7
Figure 4 – Top electrode, stainless steel 0,5 mm thick .....		8
Figure 5 – Bottom electrode, stainless steel 0,5 mm thick.....		8
Figure 6 – Assembly of the electrodes .....		9
Figure 7 – Test assembly, schematic .....		10
Figure 8 – Mounting support .....		11
Figure 9 – Filter-paper (eight sheets requested for each top electrode).....		11

# ELECTRICAL INSULATING MATERIALS USED UNDER SEVERE AMBIENT CONDITIONS – TEST METHODS FOR EVALUATING RESISTANCE TO TRACKING AND EROSION

## 1 Scope

This International standard describes two test methods for the evaluation of electrical insulating materials for use under severe ambient conditions at power frequencies (45 Hz to 65 Hz) by measurement of the resistance to tracking and erosion, using a liquid contaminant and inclined plane specimens. The two methods are as follows:

- Method 1: constant tracking voltage;
- Method 2: stepwise tracking voltage.

NOTE 1 Method 1 is the most widely used method as there is less need for continual inspection.

NOTE 2 The test conditions are designed to accelerate the production of the effects, but do not reproduce all the conditions encountered in service.

## 2 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

### 2.1

#### **track**

partially conducting path created by localized deterioration on the surface of an insulating material

### 2.2

#### **tracking**

progressive degradation of the surface of a solid insulating material by local discharges to form conducting or partially conducting paths

NOTE Tracking usually occurs due to surface contamination.

[IEC 60050-212-01-42<sup>1</sup>]

### 2.3

#### **erosion, electrical**

loss of material by leakage current or electrical discharge

### 2.4

#### **time-to-track**

time required to produce tracks under the specified conditions of test


---

<sup>1</sup> IEC 60050-212:1990, *International Electrotechnical Vocabulary – Chapter 212: Insulating solids, liquids and gases*

### 3 Test specimens

#### 3.1 Dimensions

Flat specimens with a size of at least 50 mm X 120 mm shall be used. The preferred thickness shall be 6 mm. Other thicknesses may be used, but must be mentioned in the test report. The specimens shall be drilled as shown in Figure 1, to attach the electrodes.

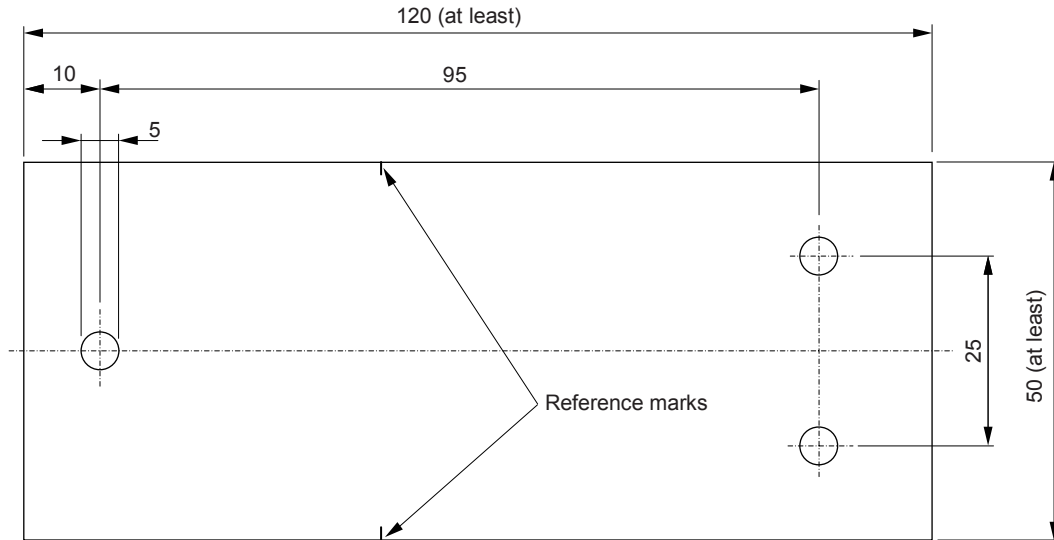

IEC 672/07

Dimensions in millimetres

Figure 1 – Test specimen with holes for fixing electrodes

#### 3.2 Preparation

The specimens shall be washed with a suitable solvent (e.g. isopropyl alcohol) to remove leftovers such as fat from handling. After that the specimens shall be rinsed with distilled water.

The cleaned specimens shall be mounted carefully to avoid contamination.

If the contaminant does not wet the surface evenly within the observation time mentioned in 5.1, the surface of the specimens can be slightly abraded. The abrasion should be done with a fine (U.S. grade (CAMI): 400 mesh; European grade (FEPA): P800) aluminium-oxide- or zirconia-alumina-abrasive under water until the whole surface wets and appears uniformly matt when dry. When abraded the specimen shall be cleaned another time with distilled water.

Abrasion has to be mentioned in the test report.


Specimens used for criterion B (see 5.4) shall have reference marks on both edges, 25 mm above the lower electrode (see Figures 1 and 7).

### 4 Apparatus

#### 4.1 Electrical apparatus

A schematic circuit is given in Figure 2. As the test will be carried out at high voltages, it is obviously necessary to use an earthed safety enclosure. The circuit comprises:

- A 45 Hz to 65 Hz power supply with an output voltage stabilized to  $\pm 5\%$  which can be varied up to about 6 kV with a rated current not less than 0,1 A for each specimen. Preferred test voltages are 2,5 kV, 3,5 kV and 4,5 kV, for method 1.

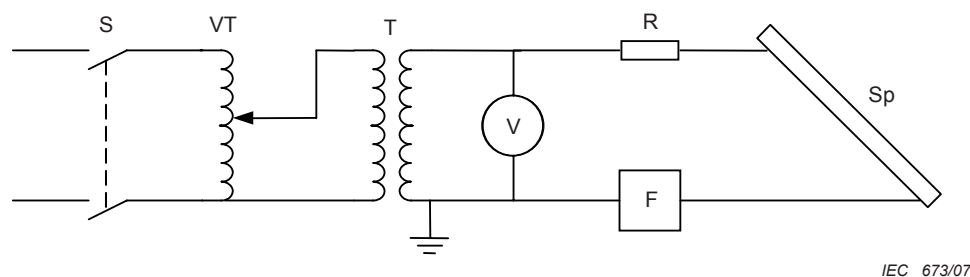

#### Components

S	power supply switch
VT	variable ratio transformer
T	high-voltage transformer
R	series resistor
V	voltmeter
Sp	specimen
F	overcurrent device, fuse or relay

**Figure 2 – Schematic circuit diagram**

NOTE If only one power supply is used for several specimens, each should have a circuit-breaker or a similar device (see 4.1, last sentence).


- A 200 W resistor with  $\pm 10\%$  tolerance in series with each specimen at the high-voltage side of the power supply. The resistance of the resistor shall be taken from Table 1.



Table 1 – Test parameters

Test voltage kV	Preferred test voltage for method 1 kV	Contaminant flow rate ml/min	Series resistor, Resistance kΩ
1,0 to 1,75	-	0,075	1
2,0 to 2,75	2,5	0,15	10
3,0 to 3,75	3,5	0,30	22
4,0 to 4,75	4,5	0,60	33
5,0 to 6,0	-	0,90	33

- A true r.m.s. voltmeter with an accuracy of 1,5 % of reading shall be used.
- An overcurrent delay relay (for example see Figure 3) or any other device which operates when  $60 \text{ mA} \pm 6 \text{ mA}$  or more has persisted in the high-voltage circuit for 2 s to 3 s.

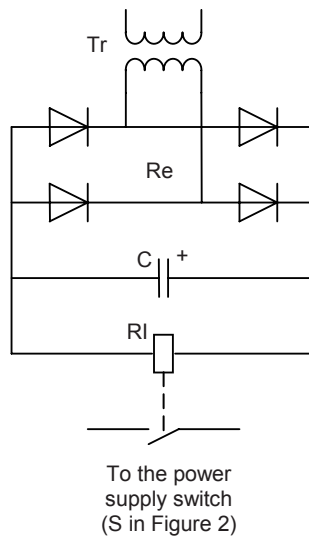

IEC 674/07

**Components**

- Re rectifier
- Tr transformer (winding 300/900 turns)
- RI relay (2 500 Ω/11 000 turns)
- C capacitor (200 μF)


Figure 3 – Example: typical circuit for an overcurrent delay relay (F in Figure 2)

**4.2 Electrodes**

All electrodes, fixtures and assembly elements associated with the electrodes, such as screws, shall be made of stainless steel e.g. grade 302. The electrode assembly is shown in Figure 6.

NOTE The electrodes shall be cleaned prior to each test and replaced when necessary.


The top electrode is shown in Figure 4. The bottom electrode is shown in Figure 5.

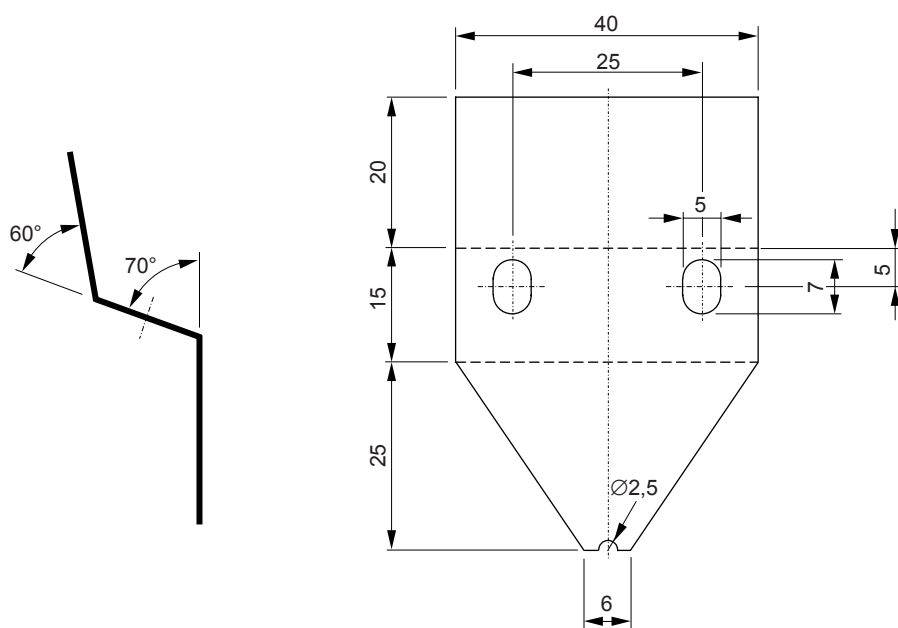

IEC 675/07

Dimensions in millimetres

Figure 4 – Top electrode, stainless steel 0,5 mm thick

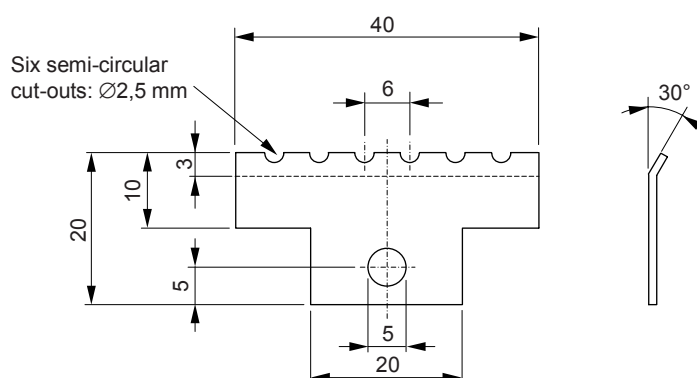

IEC 676/07

Dimensions in millimetres

Figure 5 – Bottom electrode, stainless steel 0,5 mm thick


#### 4.3 Contaminant

Unless otherwise specified use

- 0,1 % ± 0,002 % by mass of NH<sub>4</sub>Cl (ammonium chloride) analytical quality, and
- 0,02 % ± 0,002 % by mass of isoctylphenoxypolyethoxyethanol (a non-ionic wetting agent) in distilled or de-ionized water.
- This contaminant shall have a resistivity of 3,95 Ωm ± 0,05 Ωm at 23 °C ± 1 °C.
- The contaminant shall be not more than four weeks old and its resistivity shall be checked before each series of tests.
- Eight layers of filter-paper with a thickness of 0,2 mm ± 0,02 mm, of the approximate dimensions given in Figure 9, are clamped between the top electrode and the specimen to act as a reservoir for the contaminant.
- The contaminant shall be fed into this filter-paper pad so that a uniform flow between the top and the bottom electrodes shall occur before voltage application.

NOTE This can be done by pumping the contaminant through a tube into the filter-paper pad. The tube can be held between the filter papers by a clip of stainless steel. Another possibility is to drip the contaminant into the filter-paper pad with a fixed drop size and fixed number of drops per minute.

- The rate of application of contaminant shall be that within  $\pm 10\%$  specified in Table 1 in relation to the applied voltage.

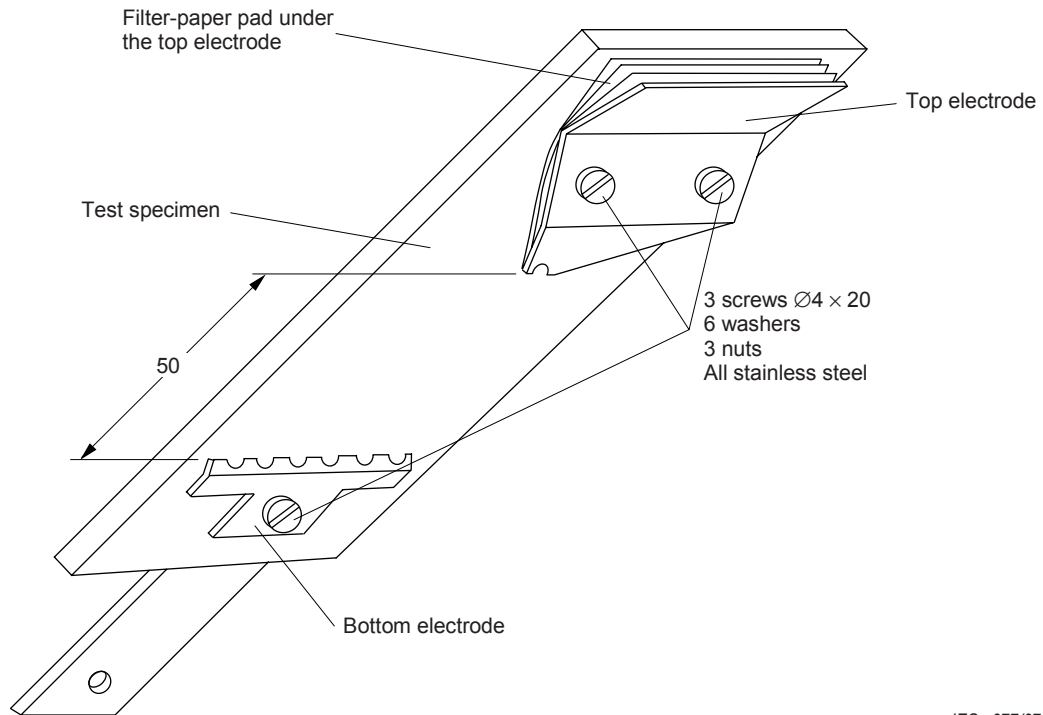

IEC 677/07

Dimensions in millimetres

Figure 6 – Assembly of the electrodes

#### 4.4 Timing device

A timing device with an accuracy of about  $\pm 1$  min/h shall be used.

NOTE For example a 1 min pulser with a counter is acceptable.

#### 4.5 Depth gauge

A depth gauge with an accuracy of  $\pm 0,01$  mm shall be used. The point of the probe shall be hemispherical with a radius of 0,25 mm.

#### 4.6 Ventilation

The test chamber shall be equipped with a ventilation to allow an exhaust of steam and gaseous decomposition products. The ventilation of the test chamber should be moderate and constant to avoid permanent condensation of water. Direct airflow across the test specimens shall be avoided.


NOTE Experience shows that the intensity of ventilation may influence the test result.

## 5 Procedure

### 5.1 Preparation of the test

Unless otherwise specified, the test shall be carried out at an ambient temperature of  $23\text{ }^{\circ}\text{C} \pm 2\text{ }^{\circ}\text{C}$  on sets of at least five specimens for each material.

Mount the specimen, with the flat test surface on the underside, at an angle of  $45^{\circ} \pm 2^{\circ}$  from the horizontal as shown in Figure 7, with the electrodes  $50\text{ mm} \pm 0,5\text{ mm}$  apart. The test for further 5 specimen can be achieved either simultaneously or respectively.

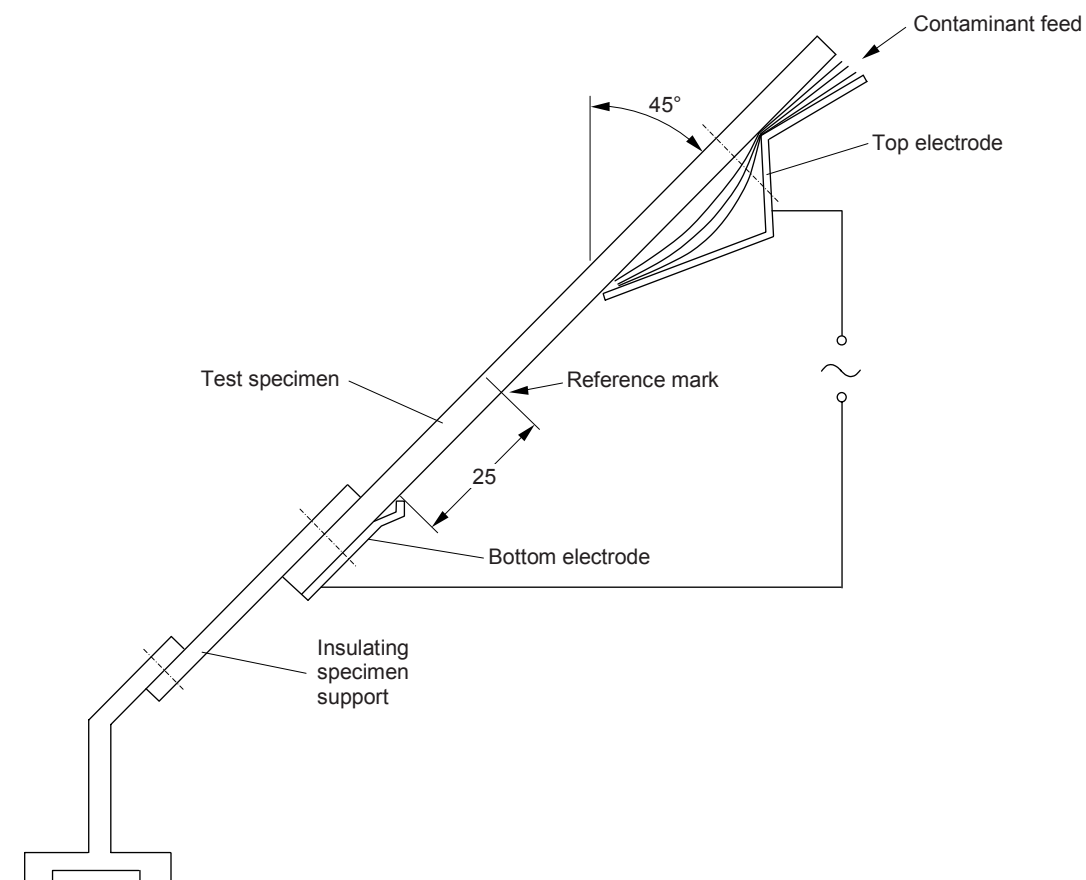

IEC 678/07


*Dimensions in millimetres*

**Figure 7 – Test assembly, schematic**

NOTE 1 For each test, use a new filter-paper pad (see Figure 9).

If the specimen is not self-supporting an insulating mounting support for the specimen must be used. The mounting support shall be such that the heat dissipation from the back of the sample is not hindered and the material shall be heat resistant and electrically insulating (e.g. PTFE). An example of a mounting support is shown in Figure 8.

Start introducing the contaminant into the filter-paper pad allowing the contaminant to wet the paper thoroughly. Adjust the contaminant flow and calibrate to give a flow rate as specified in Table 1. Observe the flow for at least 10 min and ensure that the contaminant flows steadily down the face of the test specimen between the electrodes. The contaminant shall flow from the quill hole of the top electrode and not from the sides or the top of the filter-paper.

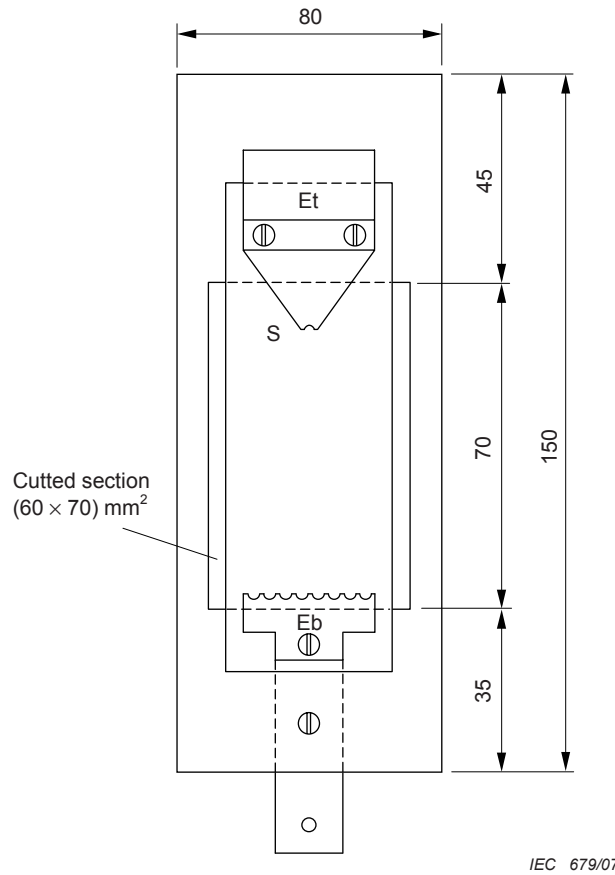


Dimensions in millimetres

**Components**

- Et top electrode
- Eb bottom electrode
- MS mounting support
- S specimen

**Figure 8 – Mounting support**

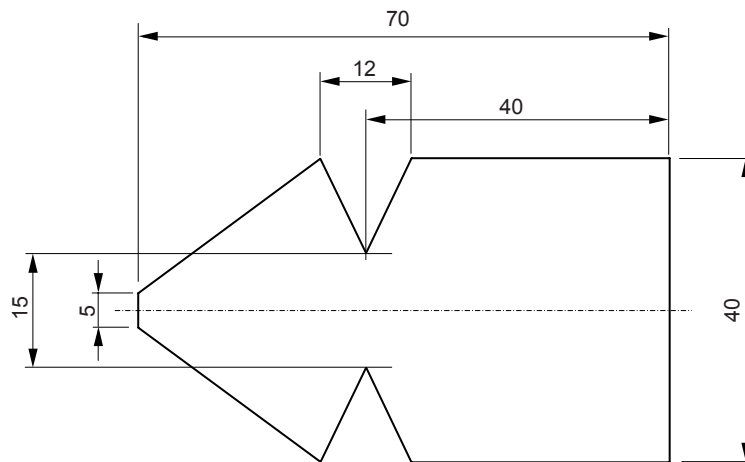

Dimensions in millimetres

**Figure 9 – Filter-paper (eight sheets requested for each top electrode)**

## 5.2 Method 1: Application of constant tracking voltage

With the contaminant flowing uniformly at the specified rate, according to Table 1, switch on and raise the voltage to one of the preferred test voltages, 2,5 kV, 3,5 kV or 4,5 kV, which should be reached within a maximum of 10 s, and start the timing device. The voltage shall be maintained constant for 6 h.

If the test has to be repeated at a higher or lower voltage, a further set of five specimens shall be tested for each selected preferred voltage.

The constant tracking voltage is the highest voltage withstood by all five specimens for 6 h without failure (see 5.4).

Classification of the material is as follows:

### *Class 1A 0 or 1B 0*

if any specimen fails at 2,5 kV in less than 6 h according to criterion A or B of 5.4.

### *Class 1A 2,5 or 1B 2,5*

if all five specimens survive 6 h at 2,5 kV and if any specimen fails at 3,5 kV in less than 6 h.

### *Class 1A 3,5 or 1B 3,5*

if all five specimens survive 6 h at 3,5 kV and if any specimen fails at 4,5 kV in less than 6 h.

### *Class 1A 4,5 or 1B 4,5*

if all five specimens survive 6 h at 4,5 kV.

In each case, the maximum depth of erosion is to be reported.

### 5.3 Method 2: stepwise tracking voltage

Select a starting voltage, being a multiple of 250 V, such that failure according to criterion A of 5.4 (current exceeding 60 mA) does not occur sooner than the third voltage step (a preliminary trial test may be necessary). With the contaminant flowing uniformly at the specified rate, switch on and raise the voltage to the selected value. Maintain this voltage for 1 h and increase the voltage by a step of 250 V for each subsequent hour until failure by criterion A is recorded. As the voltage is increased the contaminant flow rate and the resistance value of the series resistor are increased according to Table 1.

The stepwise tracking voltage is the highest voltage withstood by all five specimens for 1 h without failure.

Classification of the material is as follows:

Class 2A x or 2B x, where x is the highest voltage, in kilovolts, withstood by the material under test.

NOTE 1 Effective scintillation is essential and if not obtained, the electrical circuit, the contaminant flow characteristics and contaminant resistivity should be carefully checked.

Scintillation means the existence of small yellow to white (with some materials occasionally blue) arcs just above the teeth of the lower electrode, within a few minutes of application of the voltage. These discharges should occur in an essentially continuous manner, although they may jump from one tooth to another. These discharges will burn away the specimen surface and may ultimately lead to tracking failure. Discharges which move rapidly over the surface between the two electrodes are not likely to produce tracks.

The condition of effective scintillation may also be observed with a cathode-ray oscilloscope. The signal may be picked up across a resistor (e.g. 330  $\Omega$ , 2 W) placed in series with the overcurrent device. Proper scintillation is observed as a continual, but non-uniform, break-up of the power frequency current wave during each half cycle.

NOTE 2 The overcurrent device should operate before the track reaches the top electrode when a 60 mA current flows in the conducting track and in the stream of electrolyte remaining on the surface.

NOTE 3 Erosion depth is measured after scraping away or otherwise removing decomposed insulation and debris, taking care not to remove any undamaged test material.

### 5.4 End-point criteria

Two criteria for determining the end point of the test are in use:

Criterion A:

The end point is reached when the value of the current in the high voltage circuit through the specimen exceeds 60 mA (an overcurrent device then breaks this current not before 2 s, but not later than 4 s) or when a specimen shows a hole due to intensive erosion or the specimen ignites.

NOTE 1 The 60 mA end point criterion permits the use of an automatic apparatus testing several specimens simultaneously.

NOTE 2 Flammability failure occurs with some materials which ignite during the test.

Criterion B:

The end point is reached when the track reaches a mark on the specimen surface 25 mm from the lower electrode (see Figures 1 and 7) or when a specimen shows a hole due to intensive erosion or the specimen ignites.

NOTE 3 This end point criterion (criterion B) requires constant visual supervision and manual control.

NOTE 4 Criterion A without ignition is the preferred criterion.

## 6 Test report

The report shall include:

- a) type and designation of material tested;
  - b) details of the specimens: fabrication and dimensions, cleaning procedure and solvent used, surface treatment if any, pre-conditioning. The thickness shall be reported;
  - c) orientation of composite specimen (like fibre-reinforced plastic) with respect to the electrodes (i.e. machine direction, cross-machine direction, bias, etc.);
  - d) method for the application of the voltage and end point criterion used. Classification according to 5.2;
  - e) the maximum depth of erosion has to be reported in the classification. For example a maximum erosion depth of 0,5 mm as 1 A 3,5 – 0,5.
-





---

---

# BSI — British Standards Institution

BSI is the independent national body responsible for preparing British Standards. It presents the UK view on standards in Europe and at the international level. It is incorporated by Royal Charter.

## Revisions

British Standards are updated by amendment or revision. Users of British Standards should make sure that they possess the latest amendments or editions.

It is the constant aim of BSI to improve the quality of our products and services. We would be grateful if anyone finding an inaccuracy or ambiguity while using this British Standard would inform the Secretary of the technical committee responsible, the identity of which can be found on the inside front cover.  
Tel: +44 (0)20 8996 9000. Fax: +44 (0)20 8996 7400.

BSI offers members an individual updating service called PLUS which ensures that subscribers automatically receive the latest editions of standards.

## Buying standards

Orders for all BSI, international and foreign standards publications should be addressed to Customer Services. Tel: +44 (0)20 8996 9001.  
Fax: +44 (0)20 8996 7001. Email: [orders@bsi-global.com](mailto:orders@bsi-global.com). Standards are also available from the BSI website at <http://www.bsi-global.com>.

In response to orders for international standards, it is BSI policy to supply the BSI implementation of those that have been published as British Standards, unless otherwise requested.

## Information on standards

BSI provides a wide range of information on national, European and international standards through its Library and its Technical Help to Exporters Service. Various BSI electronic information services are also available which give details on all its products and services. Contact the Information Centre.  
Tel: +44 (0)20 8996 7111. Fax: +44 (0)20 8996 7048. Email: [info@bsi-global.com](mailto:info@bsi-global.com).

Subscribing members of BSI are kept up to date with standards developments and receive substantial discounts on the purchase price of standards. For details of these and other benefits contact Membership Administration.  
Tel: +44 (0)20 8996 7002. Fax: +44 (0)20 8996 7001.  
Email: [membership@bsi-global.com](mailto:membership@bsi-global.com).

Information regarding online access to British Standards via British Standards Online can be found at <http://www.bsi-global.com/bsonline>.

Further information about BSI is available on the BSI website at <http://www.bsi-global.com>.

## Copyright

Copyright subsists in all BSI publications. BSI also holds the copyright, in the UK, of the publications of the international standardization bodies. Except as permitted under the Copyright, Designs and Patents Act 1988 no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means – electronic, photocopying, recording or otherwise – without prior written permission from BSI.

This does not preclude the free use, in the course of implementing the standard, of necessary details such as symbols, and size, type or grade designations. If these details are to be used for any other purpose than implementation then the prior written permission of BSI must be obtained.

Details and advice can be obtained from the Copyright & Licensing Manager.  
Tel: +44 (0)20 8996 7070. Fax: +44 (0)20 8996 7553.  
Email: [copyright@bsi-global.com](mailto:copyright@bsi-global.com).