

BS EN 60900:2012



BSI Standards Publication

**Live working — Hand tools
for use up to 1 000 V a.c.
and 1 500 V d.c.**

bsi.

...making excellence a habit.™

National foreword

This British Standard is the UK implementation of EN 60900:2012. It is identical to IEC 60900:2012. It supersedes BS EN 60900:2004, which is withdrawn.

The UK participation in its preparation was entrusted to Technical Committee PEL/78, Tools for live working.

A list of organizations represented on this committee can be obtained on request to its secretary.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

© The British Standards Institution 2012.

Published by BSI Standards Limited 2012.

ISBN 978 0 580 78736 2

ICS 13.260; 29.240.20; 29.260.99

Compliance with a British Standard cannot confer immunity from legal obligations.

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 31 December 2012.

Amendments issued since publication

Amd. No.	Date	Text affected
-----------------	-------------	----------------------

EUROPEAN STANDARD
NORME EUROPÉENNE
EUROPÄISCHE NORM

EN 60900

August 2012

ICS 13.260; 29.240.20; 29.260.99

Supersedes EN 60900:2004

English version

**Live working -
Hand tools for use up to 1000 V a.c. and 1500 V d.c.
(IEC 60900:2012)**

Travaux sous tension -
Outils à main pour usage jusqu'à 1000 V
en courant alternatif et 1500 V en courant
continu
(CEI 60900:2012)

Arbeiten unter Spannung -
Handwerkzeuge zum Gebrauch bis AC
1000 V und DC 1500 V
(IEC 60900:2012)

This European Standard was approved by CENELEC on 2012-07-19. CENELEC members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CENELEC member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CENELEC member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CENELEC members are the national electrotechnical committees of Austria, Belgium, Bulgaria, Croatia, Cyprus, the Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, the Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.

CENELEC

European Committee for Electrotechnical Standardization
Comité Européen de Normalisation Electrotechnique
Europäisches Komitee für Elektrotechnische Normung

Management Centre: Avenue Marnix 17, B - 1000 Brussels

Foreword

The text of document 78/947/FDIS, future edition 3 of IEC 60900, prepared by IEC/TC 78 "Live working" was submitted to the IEC-CENELEC parallel vote and approved by CENELEC as EN 60900:2012.

The following dates are fixed:

- latest date by which the document has to be implemented at national level by publication of an identical national standard or by endorsement (dop) 2013-04-19
- latest date by which the national standards conflicting with the document have to be withdrawn (dow) 2015-07-19

This document supersedes EN 60900:2004.

EN 60900:2012 includes the following significant technical changes with respect to EN 60900:2004:

- general review of the requirements and test provisions;
- preparation of the elements of evaluation of defects, and general application of EN 61318:2008;
- deletion of Annexes D and E, not applicable according to EN 61318;
- introduction of a new normative Annex D on chronology of type tests;
- introduction of a new normative Annex F on classification of defects.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CENELEC [and/or CEN] shall not be held responsible for identifying any or all such patent rights.

Endorsement notice

The text of the International Standard IEC 60900:2012 was approved by CENELEC as a European Standard without any modification.

In the official version, for Bibliography, the following note has to be added for the standard indicated:

IEC 60743 NOTE Harmonized as EN 60743.

Annex ZA
(normative)
**Normative references to international publications
with their corresponding European publications**

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

NOTE When an international publication has been modified by common modifications, indicated by (mod), the relevant EN/HD applies.

<u>Publication</u>	<u>Year</u>	<u>Title</u>	<u>EN/HD</u>	<u>Year</u>
IEC 60060-1	-	High-voltage test techniques - Part 1: General definitions and test requirements	EN 60060-1	-
IEC 60212	-	Standard conditions for use prior to and during the testing of solid electrical insulating materials	EN 60212	-
IEC 61318	-	Live working - Conformity assessment applicable to tools, devices and equipment	EN 61318	-
IEC 61477	-	Live working - Minimum requirements for the utilization of tools, devices and equipment	EN 61477	-
IEC 60417	Data base	Graphical symbols for use on equipment	-	-
ISO 1174-1	-	Assembly tools for screw and nuts - Driving squares - Part 1: Driving squares for hand socket tools	-	-
ISO 9654	-	Pliers and nippers for electronics - Single-purpose nippers - Cutting nippers	-	-
ISO 9655	-	Pliers and nippers for electronics - Single-purpose nippers - Pliers for gripping and manipulating	-	-
ISO 9656	-	Pliers and nippers for electronics - Test methods	-	-
ISO 9657	-	Pliers and nippers for electronics - General technical requirements	-	-

CONTENTS

INTRODUCTION	7
1 Scope	8
2 Normative references	8
3 Terms and definitions	8
4 Requirements	9
4.1 General requirements	9
4.1.1 Safety	9
4.1.2 Performance under load	9
4.1.3 Multiple-ended hand tools	10
4.1.4 Marking	10
4.1.5 Separating of covers	11
4.1.6 Instructions for correct adjustment and assembly	11
4.2 Requirements concerning insulating materials	11
4.2.1 General	11
4.2.2 Thermal stability	11
4.3 Additional requirements	11
4.3.1 Hand tools capable of being assembled	11
4.3.2 Screwdrivers	14
4.3.3 Wrenches – uninsulated areas	15
4.3.4 Adjustable wrenches	15
4.3.5 Pliers, strippers, cable scissors, cable-cutting hand tools	16
4.3.6 Scissors	19
4.3.7 Knives	20
4.3.8 Tweezers	21
5 Tests	22
5.1 General	22
5.2 Visual check	23
5.3 Dimensional check	23
5.4 Impact tests	23
5.4.1 Type test	23
5.4.2 Alternative means in case of insulated and insulating hand tools having completed the production phase	26
5.5 Dielectric tests	26
5.5.1 General requirements	26
5.5.2 Conditioning (for type test only)	26
5.5.3 Dielectric testing of insulated hand tools	27
5.5.4 Dielectric testing of insulating hand tools	30
5.6 Indentation test (for insulated hand tools)	31
5.6.1 Type test	31
5.6.2 Alternative means in case of insulated hand tools having completed the production phase	32
5.7 Test for adhesion of the insulating material coating (for insulated hand tools)	32
5.7.1 Conditioning	32

5.7.2	Type test	33
5.7.3	Alternative means in case of insulated hand tools having completed the production phase	38
5.7.4	Test of adhesion of insulating covers of conductive adjusting or switching elements	39
5.8	Mechanical tests	39
5.8.1	Insulated hand tools	39
5.8.2	Insulating hand tools	40
5.8.3	Tweezers.....	40
5.8.4	Retaining force test	40
5.9	Durability of marking	42
5.10	Flame retardancy test.....	42
5.10.1	Type test	42
5.10.2	Alternative means in case of hand tools having completed the production phase	43
6	Conformity assessment of hand tools having completed the production phase	44
7	Modifications	44
Annex A (informative)	Mechanical strength of insulating hand tools	45
Annex B (normative)	Suitable for live working; double triangle (IEC 60417-5216:2002-10).....	47
Annex C (informative)	Recommendation for use and in-service care	48
Annex D (normative)	General type test procedure	49
Annex E (normative)	Examples of calculation of the unwinded length of coating and acceptable leakage current	50
Annex F (normative)	Classification of defects and tests to be allocated	51
Bibliography.....		52
Figure 1	– Marking of the electrical working limit adjacent to the symbol double triangle	10
Figure 2	– Description of the insulating overlapping element and different assembly configurations for hand tools capable of being assembled with square drives	12
Figure 3	– Marking symbol for hand tools capable of being assembled and designed to be interchangeable between different manufacturers	13
Figure 4	– Illustration of insulation of typical hand tools	14
Figure 5	– Insulated adjustable wrench	16
Figure 6	– Insulation of pliers.	17
Figure 7	– Insulation of multiple slip joint pliers	17
Figure 8	– Insulation of pliers with a functional area below the joint	18
Figure 9	– Illustration of insulation of pliers and nippers for electronics.	19
Figure 10	– Insulation of scissors.....	20
Figure 11	– Insulation of knives	21
Figure 12	– Example of insulation of the handles of tweezers	22
Figure 13	– Example of test arrangement for the impact test – Method A	24
Figure 14	– Example of test arrangement for the impact test – Method B	25
Figure 15	– Dielectric testing arrangement for insulated hand tools	28
Figure 16	– Description of dummies for dielectric tests for hand tools capable of being assembled with square drives	29
Figure 17	– Dielectric testing arrangement for insulating hand tools.....	30

Figure 18 – Indentation test	32
Figure 19 – Principle of the testing device for checking adhesion of the insulating coating on conductive parts of the insulated hand tools – Test on the working head –	
Method A	34
Figure 20 – Principle of the testing device for checking adhesion of the insulating coating on conductive parts of the insulated hand tools – Test on the working head –	
Method B	35
Figure 21 – Testing device for checking adhesion of the insulating coating of screwdrivers on conductive parts and the handle	36
Figure 22 – Example of mountings for checking stability of adhesion of the insulation of the entire hand tool	38
Figure 23 – Dummies for testing locking systems used with square drives nominal size 12,5 mm of ISO 1174	41
Figure 24 – Dummies for testing locking systems used with square drives nominal size 10 mm of ISO 1174	41
Figure 25 – Example of a flame retardancy test arrangement.	43
Table 1 – Dimensions and tolerances of the insulating overlapping element	13
Table 2 – Dimensions and tolerances for dummies to be used for dielectric tests	29
Table A.1 – Torque values for insulating screwdrivers	45
Table D.1 – Sequential order for performing type tests ^a	49
Table F.1 – Classification of defects and associated requirements and tests	51

INTRODUCTION

This International Standard has been prepared in accordance with the requirements of IEC 61477 where applicable.

The product covered by this standard may have an impact on the environment during some or all stages of its life cycle. These impacts can range from slight to significant, be of short-term or long-term, and occur at the global, regional or local level.

This standard does not include requirements and test provisions for the manufacturers of the product, or recommendations to the users of the product for environmental improvement. However, all parties intervening in its design, manufacture, packaging, distribution, use, maintenance, repair, reuse, recovery and disposal are invited to take account of environmental considerations.

LIVE WORKING – HAND TOOLS FOR USE UP TO 1 000 V AC AND 1 500 V DC

1 Scope

This International Standard is applicable to insulated and insulating hand tools used for working live or close to live parts at nominal voltages up to 1 000 V a.c. and 1 500 V d.c.

The products designed and manufactured according to this standard contribute to the safety of the users provided they are used by skilled persons, in accordance with safe methods of work and the instructions for use (where appropriate).

2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60060-1, *High-voltage test techniques – Part 1: General definitions and test requirements*

IEC 60212, *Standard conditions for use prior to and during the testing of solid electrical insulating materials*

IEC 60417, *Graphical symbols for use on equipment*

IEC 61318, *Live working – Conformity assessment applicable to tools, devices and equipment*

IEC 61477, *Live working – Minimum requirements for the utilization of tools, devices and equipment*

ISO 1174-1, *Assembly tools for screw and nuts – Driving squares – Part 1: Driving squares for hand socket tools*

ISO 9654, *Pliers and nippers for electronics – Single-purpose nippers – Cutting nippers*

ISO 9655, *Pliers and nippers for electronics – Single-purpose pliers – Pliers for gripping and manipulating*

ISO 9656, *Pliers and nippers for electronics – Test methods*

ISO 9657, *Pliers and nippers for electronics – General technical requirements*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in IEC 61318 and the following apply.

NOTE For the definitions of general terms in this document, reference should be made to the IEC 60050 series or to special definitions laid down in IEC 60743. Nomenclature of hand tools are found in the relevant ISO standards such as ISO 1703, ISO 5742 and ISO 8979.

3.1

hand tool (for live working)

hand held insulated or insulating tool

Note 1 to entry: Hand tools are normally tools such as screwdrivers, pliers, wrenches or knives.

[SOURCE: IEC 60050-651:1999, 651-01-27, modified – The scope of the definition has been enlarged.]

3.2

insulated hand tool

hand tool made of conductive materials, fully or partially covered by insulating materials

[SOURCE: IEC 60050-651:1999, 651-01-25, modified – The definition has been changed to refer specifically to hand tools.]

3.3

insulating hand tool

hand tool made totally or essentially from insulating materials except for inserts made from conductive materials used for reinforcement, but with no exposed conductive parts

[SOURCE: IEC 60050-651:1999, 651-01-26, modified - The definition has been changed to refer specifically to hand tools and its scope has been narrowed.]

4 Requirements

4.1 General requirements

4.1.1 Safety

Insulated and insulating hand tools shall be manufactured and dimensioned in such a way that they protect the user from electric shock.

NOTE Insulated hand tools completely covered by insulating materials and insulating tools minimize the risk of short circuits between two parts at different potentials when they are used in the correct manner.

The following requirements have been prepared in order that the hand tools covered by this standard are designed and manufactured to contribute to the safety of the users, provided they are used by persons skilled for live working, in accordance with safe methods of work and the instructions for use (where appropriate).

4.1.2 Performance under load

The mechanical specifications for insulated hand tools shall comply with the corresponding ISO standards, or, where no ISO standard exists, with a standard specified by the manufacturer or the customer, (for example a national standard). The mechanical specifications for the working parts of the hand tools shall be retained even after application of an insulating layer.

Insulating hand tools specially designed for live working may have lower stress resistance than insulated hand tools, but they shall withstand the expected workloads without failing due to remaining deformation or breaking. These hand tools can be equipped with devices that limit the workloads that can be applied with them, for example by overload slipping clutches (see also Annex A).

4.1.3 Multiple-ended hand tools

Multiple-ended hand tools, such as box wrenches, keys for hexagonal socket screws, double-ended socket-wrenches, double-head open-end wrenches, etc., are not allowed for insulated hand tools but are allowed for insulating hand tools if the design assures that there is no conductive connection between two of the working heads.

4.1.4 Marking

The marking shall be clearly identifiable by persons with normal or corrected sight without further magnification. Each hand tool and/or tool component shall be legibly and permanently marked with the following items of marking:

- on the insulating material or on the metal part:
 - marking of the origin (manufacturer's name or trade mark);
- on the insulating material:
 - model/type reference;
 - year of manufacture (at least the last two digits of the year);
 - symbol IEC 60417-5216:2002-10 – Suitable for live working; double triangle (see Annex B);

NOTE For the symbol, the exact ratio of the height of the figure to the base of the triangle is 1,43. For the purpose of convenience, this ratio can be between the values of 1,4 and 1,5.

- indication 1 000 V (i.e. the electrical working limit for alternating current), immediately adjacent to the symbol double triangle (see Figure 1 for an example);



IEC 1042/12

Figure 1 – Marking of the electrical working limit adjacent to the symbol double triangle

- number of the relevant IEC standard immediately adjacent to the symbol double triangle, (IEC 60900);
- for hand tools designed for use at extremely low temperature: letter “C” (see 4.2.2);
- additional marking for hand tools capable of being assembled and designed to be interchangeable between different manufacturers (see 4.3.1.3.2);
- additional marking where specified by the customer (for example ownership mark).

The hand tools shall bear no voltage marking apart from those described above.

NOTE For example, the indication of test voltage may lead to the assumption that the hand tool is suitable for work at that voltage.

Other characteristics or information not needed at the work location, like the year of publication of the standard, shall be associated to the product item by other means, such as coded information (bar codes, microchips, etc.), or shall be associated to its packaging.

The symbol double triangle shall be at least 3 mm high; the letter and the figures of the electrical working limit shall be at least 2 mm (see Figure 1).

4.1.5 Separating of covers

If hand tools have conductive elements (for example: torque adjusting screws, operating direction switches, etc.) which are insulated with covers of insulating materials, these covers shall be well fastened, so that they do not come off during normal use (see 5.7.4).

4.1.6 Instructions for correct adjustment and assembly

Where the manufacturer deems that instructions are necessary for correct adjustment or assembly, then the manufacturer shall provide these in accordance with the general provisions given in IEC 61477 (see also Annex C).

4.2 Requirements concerning insulating materials

4.2.1 General

The insulating material shall be selected according to the electrical, mechanical and thermal stresses to which it may be exposed during use. In addition, the insulating material shall have an adequate resistance to ageing and be flame retardant.

The insulating coating may consist of one or more layers. If two or more layers are adopted, contrasting colours may be used.

The design and construction of the handles shall provide a secure handhold and prevent unintentional hand slipping.

4.2.2 Thermal stability

The service ability of the hand tools shall not be impaired within the temperature range -20 °C to $+70\text{ °C}$.

The insulating material applied on hand tools shall adhere securely to the conductive part from -20 °C to $+70\text{ °C}$.

Hand tools intended for use at extremely low temperatures (down to -40 °C) shall be designated "Category C" and shall be designed for this purpose.

4.3 Additional requirements

4.3.1 Hand tools capable of being assembled

4.3.1.1 Retaining devices for hand tools capable of being assembled

Hand tools capable of being assembled shall have suitable retaining devices to prevent unintentional separation of the assembly. The retaining forces shall be tested according to 5.8.4.


4.3.1.2 Insulation design for hand tools capable of being assembled

In the case of connecting parts of hand tools capable of being assembled, the insulation shall be applied in such a manner that if any part becomes detached during use by exceeding the retaining forces according to 5.8.4, no conductive part, which may still be live, can be inadvertently touched or cause a disruptive discharge.

4.3.1.3 Hand tools capable of being assembled with square drives

4.3.1.3.1 General

Hand tools capable of being assembled with square drives shall have square drives and square sockets in accordance with ISO 1174-1 (for separating forces, see 5.8.4.2). To ensure compatibility of insulation between different manufacturers, these hand tools shall be designed with overlapping elements described in Figure 2. Their dimensions and tolerances shall be in accordance with Table 1.

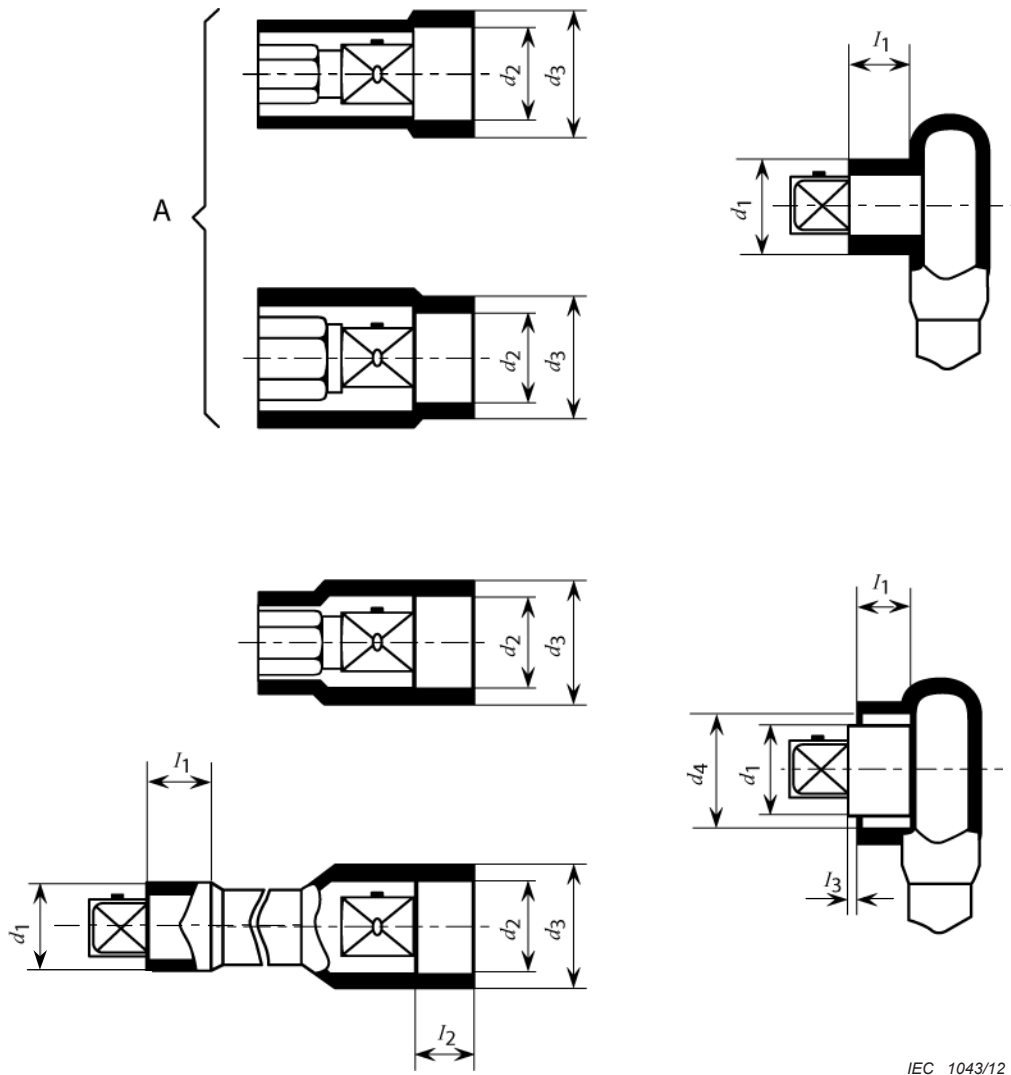

Key

A admitted shapes

Figure 2 – Description of the insulating overlapping element and different assembly configurations for hand tools capable of being assembled with square drives

Table 1 – Dimensions and tolerances of the insulating overlapping element

Dimensions in millimetres

Nominal size of the square drive	I_1 min.	I_2 $\begin{smallmatrix} +2 \\ 0 \end{smallmatrix}$	I_3 $\begin{smallmatrix} +0,5 \\ -0,5 \end{smallmatrix}$	d_1 $\begin{smallmatrix} 0 \\ -1,5 \end{smallmatrix}$	d_2 $\begin{smallmatrix} +1,5 \\ 0 \end{smallmatrix}$	d_3 $\begin{smallmatrix} 0 \\ -1,5 \end{smallmatrix}$	d_4 $\begin{smallmatrix} +1,5 \\ 0 \end{smallmatrix}$
6,3	19	16	2	12,5	13	18	19
10	19	16	2	17,5	18	23	24
12,5	19	16	2	21,5	22	27	28
20	19	16	2	32	33	38	39

$I_1, I_2, I_3, d_1, d_2, d_3$ and d_4 are described in Figure 2.

4.3.1.3.2 Interchangeability of components made by different manufacturers

Hand tools capable of being assembled and designed to be interchangeable between different manufacturers shall be specifically marked as such.

The marking symbol and the dimensions are given in Figure 3. The dimension H shall be greater than or equal to 5 mm.

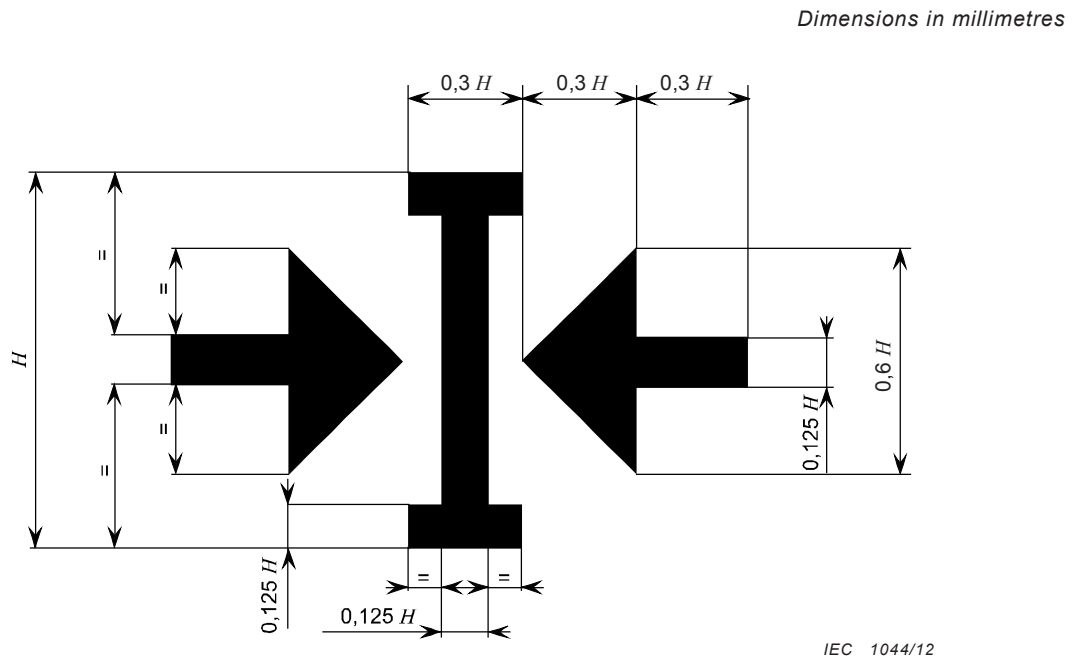


Figure 3 – Marking symbol for hand tools capable of being assembled and designed to be interchangeable between different manufacturers


The reliable function of locking systems used for those hand tools shall be tested by applying a separation test in accordance with 5.8.4 with a corresponding dummy.

For this kind of hand tools, instructions for correct assembly are mandatory. The manufacturer shall include the following information: "To assure that the complete assembly of insulated hand tool components from different manufacturers will withstand separating forces that are expected during the intended use, prior to the use of any assembly the user shall assure, by pulling by hand in a separating direction, that the retaining devices of all used elements are working efficiently".

4.3.2 Screwdrivers

4.3.2.1 Uninsulated areas

For screwdrivers, an uninsulated conductive area having a maximum length of 18 mm is permissible on the working head (see Figure 4).

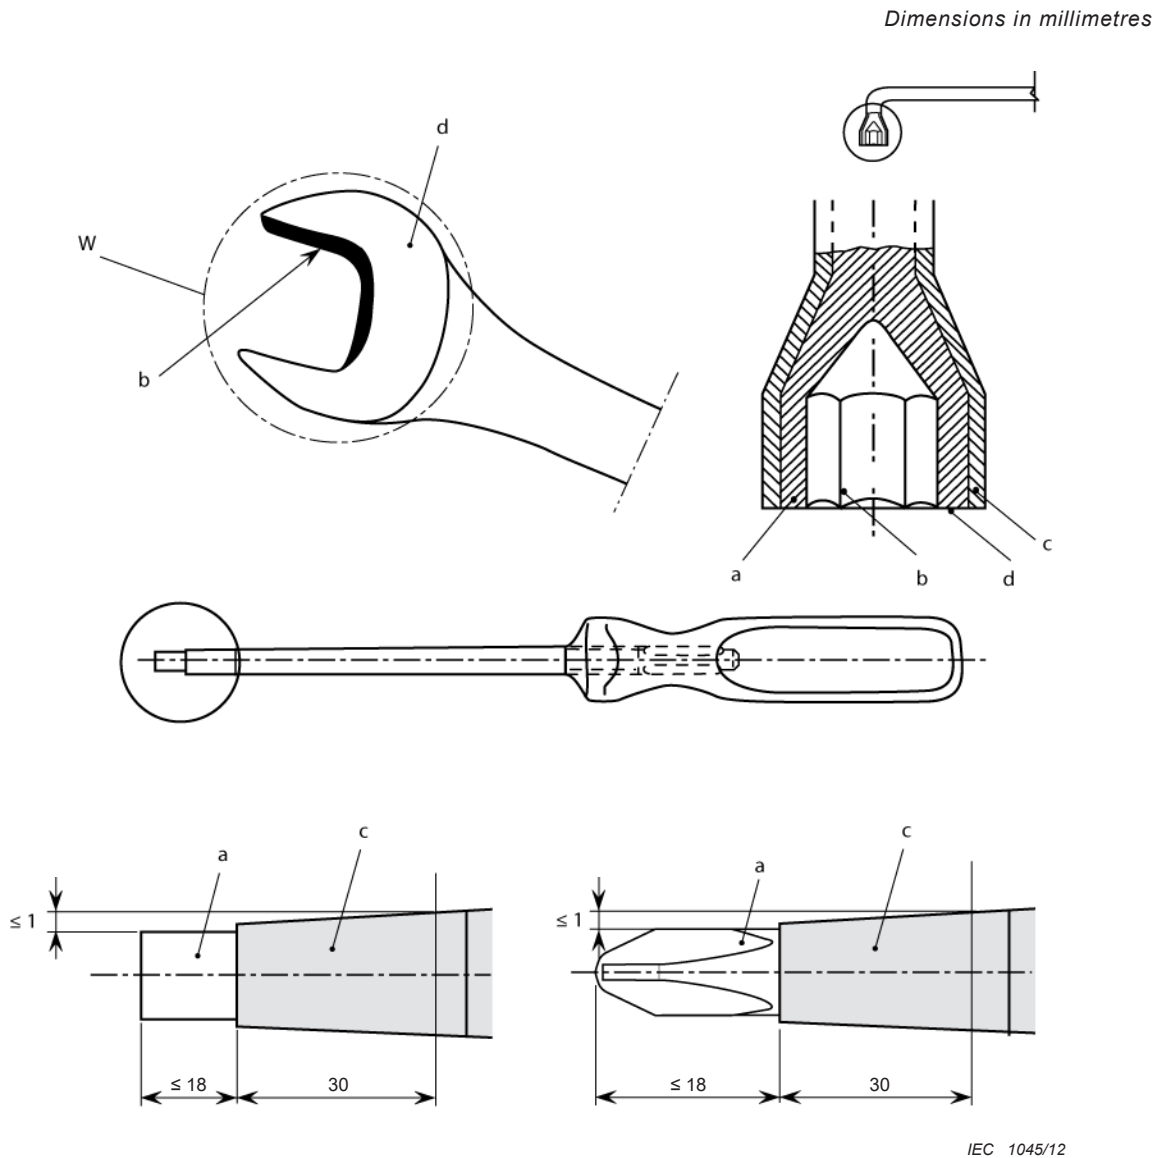

Key

- a conductive part
- b working surface
- c insulation
- d contact area
- W working head

Figure 4 – Illustration of insulation of typical hand tools

4.3.2.2 Shape of shaft insulation

The shaft insulation of screwdrivers shall be bonded to the handle. The outer diameter of the insulation, over a length of 30 mm, in area c of Figure 4, shall not exceed by more than 2 mm

the width of the shaft at the tip or the width of the tip, whatever is the larger dimension. This area may be parallel or tapered towards the tip.

This requirement does not apply to insulated bit sockets (or insulated socket drivers).

4.3.2.3 Screwdrivers with exchangeable working heads

Screwdrivers with exchangeable working heads are regarded as hand tools capable of being assembled. They shall meet the relevant requirements. The outer diameter of the insulation may exceed the dimensions of 4.3.2.2.

4.3.2.4 Screwdrivers with screw retaining devices

If a screwdriver has a screw retaining device, the screwdriver itself shall meet the requirements of this standard. The outer diameter of the retaining device may exceed the dimensions of 4.3.2.2. The retaining device shall be made from insulating material.

4.3.3 Wrenches – uninsulated areas

The following uninsulated areas and lengths on the working head are permissible (see Figure 4):


- engineers' wrenches: the working surface;
NOTE At the request of the customer, the uninsulated area may be extended to the working head.
- box wrenches, socket-wrenches, tee wrenches: the working surface and the contact area.

4.3.4 Adjustable wrenches

The insulation of adjustable wrenches shall be applied as far as possible towards the working head.

The uninsulated area may be extended to the working head. If the working head remains uninsulated, a guard shall be applied so that the hand is prevented from slipping towards the uncovered conductive parts of the head (see an example in Figure 5).

Dimensions in millimetres

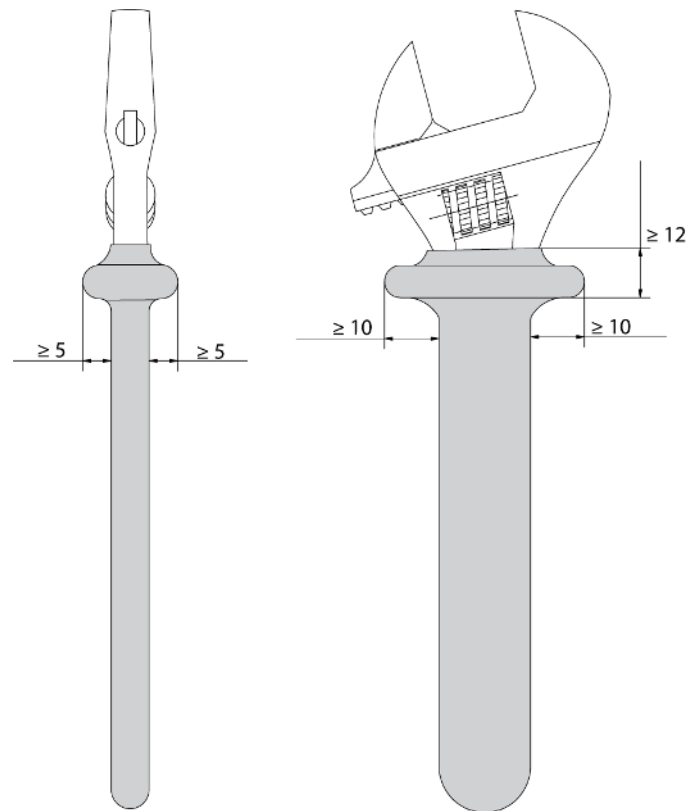

IEC 1046/12

Figure 5 – Insulated adjustable wrench

4.3.5 Pliers, strippers, cable scissors, cable-cutting hand tools

The handle insulation shall have a guard so that the hand is prevented from slipping towards the uncovered conductive parts of the head (see Figure 6 as an example).

The height of the guard shall be sufficient to prevent the slipping of the fingers towards the uncovered conductive parts during the work.

For pliers, the minimum dimensions of the guard shall be (see Figure 6 as an example):

- 10 mm on the left and on the right of the pliers held on a flat surface;
- 5 mm on the upper and lower part of the pliers held on a flat surface.

The minimum insulated distance between the inner edge of each guard and any non-insulated parts shall be 12 mm (see Figure 6). The insulation portion in front of the guard shall extend as far as possible towards the working head.

Dimensions in millimetres

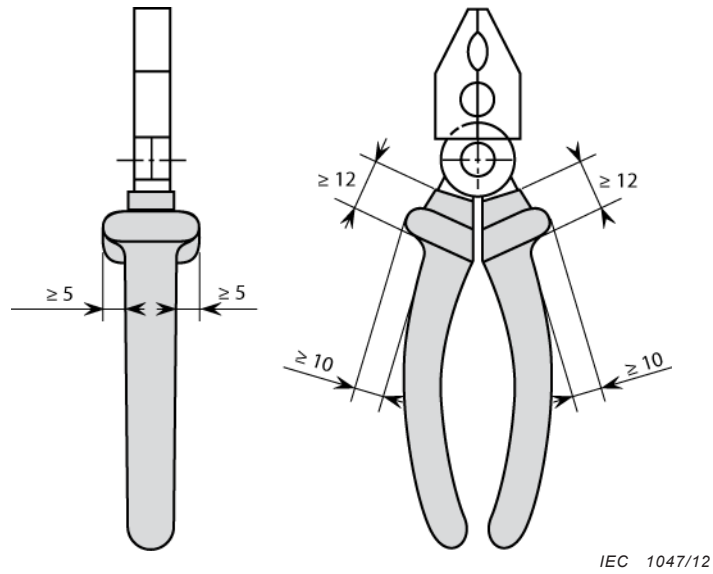


Figure 6 – Insulation of pliers

In the case of a slip joint, a guard of 5 mm shall be provided for the inner part of the handles. Refer to Figure 7 for further dimensioning.

Dimensions in millimetres

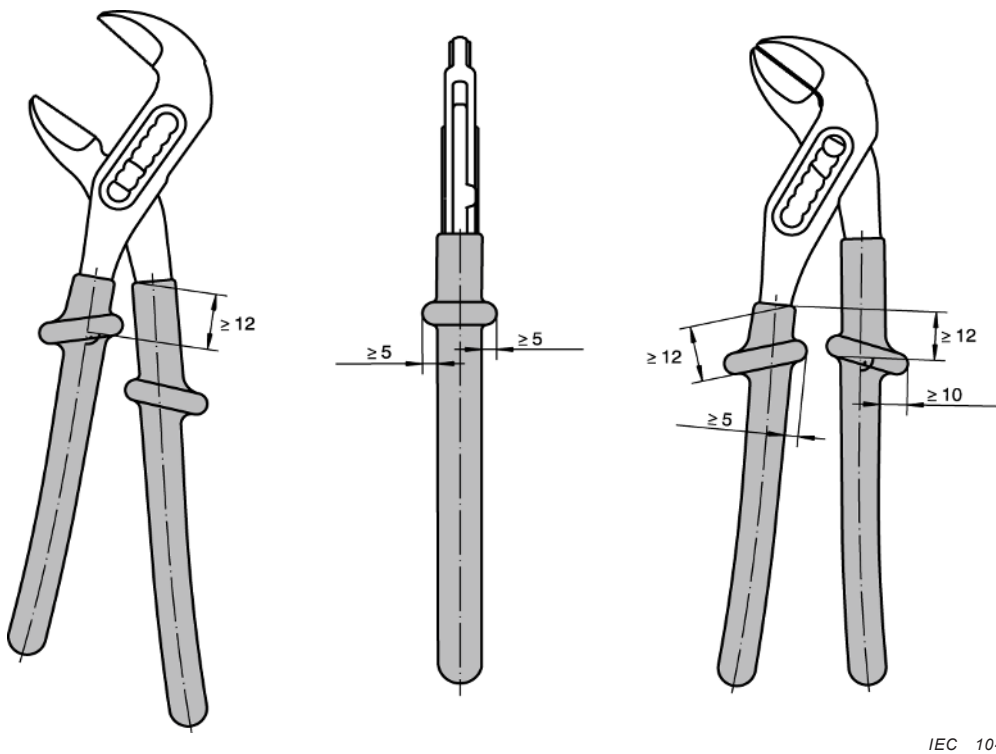


Figure 7 – Insulation of multiple slip joint pliers

Where there is a functional surface below the joint, an inner guard shall be provided (as used with multiple slip joint pliers). See Figure 8.

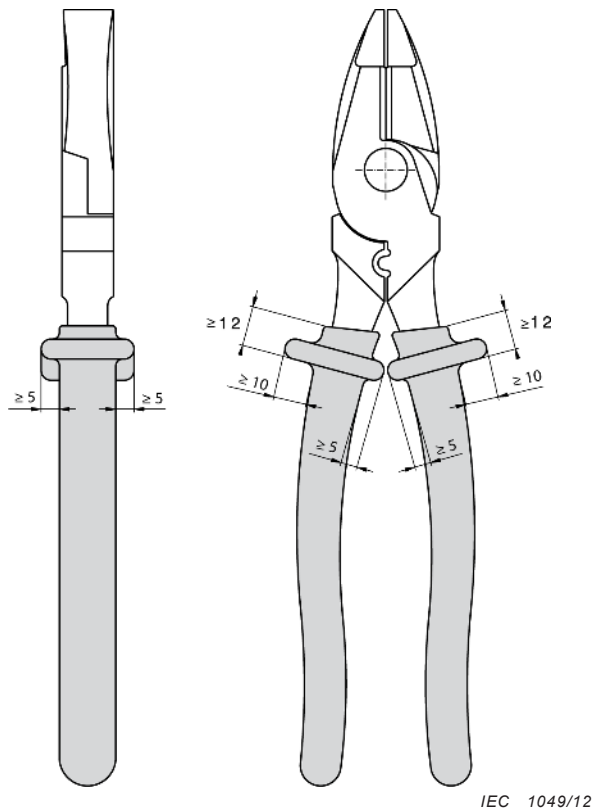


Figure 8 – Insulation of pliers with a functional area below the joint


Where the handles of the hand tools are longer than 400 mm, a guard is not required.

In case of insulated pliers and nippers for electronics, the dimensions of the guard shall be at least:

- 5 mm on left and right of the pliers held on a flat surface;
- 3 mm on the upper part and the lower part of the pliers held on a flat surface.

The minimum insulated distance between the inner edge of the guard and the non-insulated part shall be 12 mm. The insulation portion in front of the guard shall extend as far as possible towards the working head (see Figure 9).

Pliers and nippers for electronics shall be in accordance with ISO 9656 and ISO 9657 and, where relevant, with ISO 9654 or ISO 9655

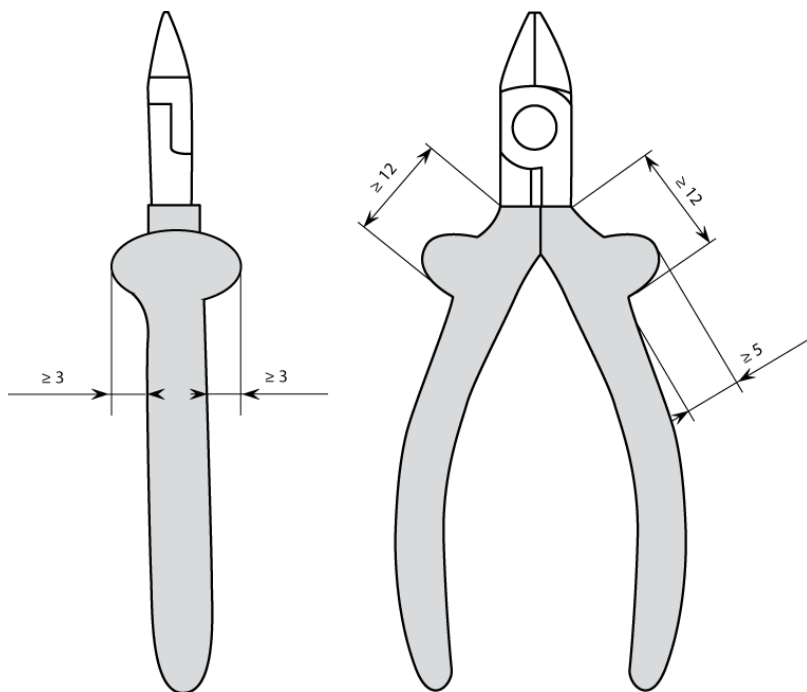

IEC 1050/12

Figure 9 – Illustration of insulation of pliers and nippers for electronics

4.3.6 Scissors

A typical insulation of scissors is shown in Figure 10.

The shackles of the scissors shall have one of both designs presented in Figures 10a and 10b.

The maximum length of the uninsulated parts of scissors shall not exceed 100 mm.

The insulation portion in front of the guard shall extend as far as possible towards the working head. If the insulated length in front of the shackle is less than 50 mm, at least one guard is required.

Dimensions in millimetres

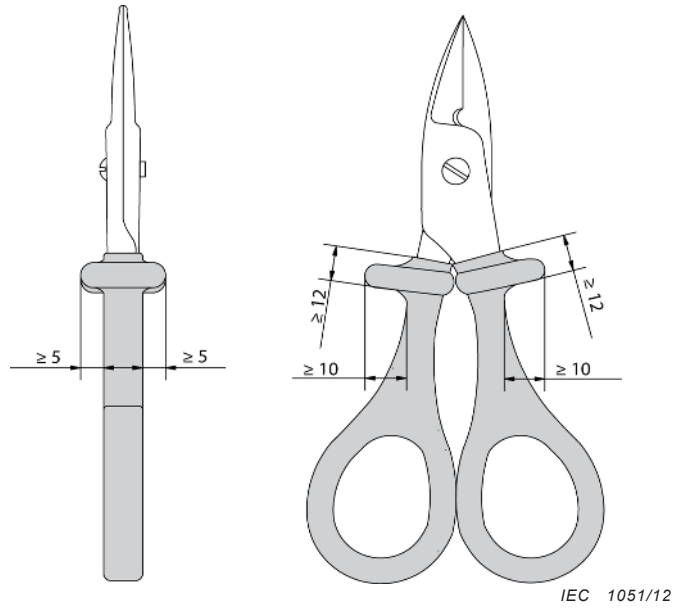


Figure 10a


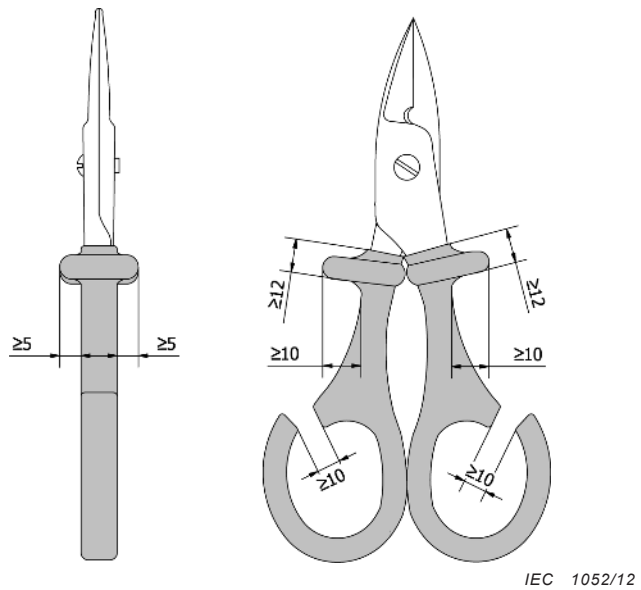


Figure 10b

Figure 10 – Insulation of scissors

4.3.7 Knives

Figure 11 shows an example for the application of the insulation of knives. The dimensions of insulated knives shall be in accordance with Figure 11.

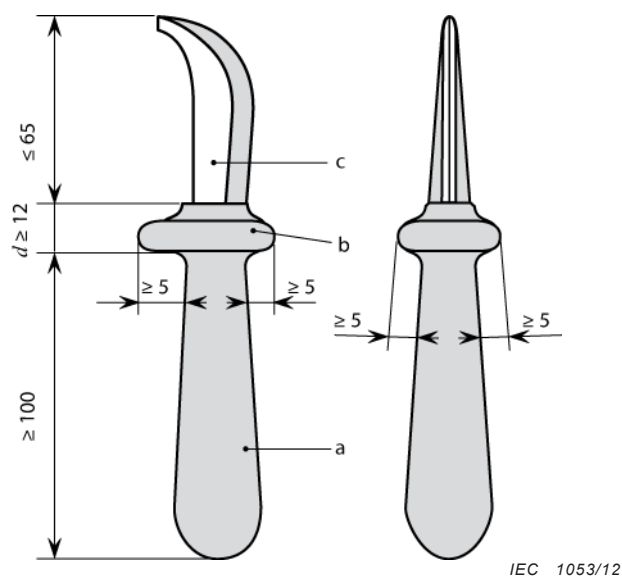

Key

- a insulated handle or leg
- b guard
- c working head (not insulated)
- d distance between the inner edge of the guard and the non-insulated part

Figure 11 – Insulation of knives

4.3.8 Tweezers


The total length l shall be 130 mm minimum and 200 mm maximum. The length of the handles g shall be 80 mm minimum (see Figure 12).

Both handles of the tweezers shall have a guard towards the working head. The guard shall not be movable. Its height h and width b shall be sufficient (5 mm minimum) to prevent any slipping of the fingers during the work towards the uninsulated length u of the working head. On both handles, the insulated length e between the guard and the working head shall be 12 mm minimum and 35 mm maximum (see Figure 12).

The uninsulated length u of the working head shall not exceed 20 mm (see Figure 12).

In the case of tweezers with a metallic working head, the metallic part shall have a minimum hardness of 35 HRC at least from the working head up to the handles.

Insulating tweezers shall not have exposed conductive parts.

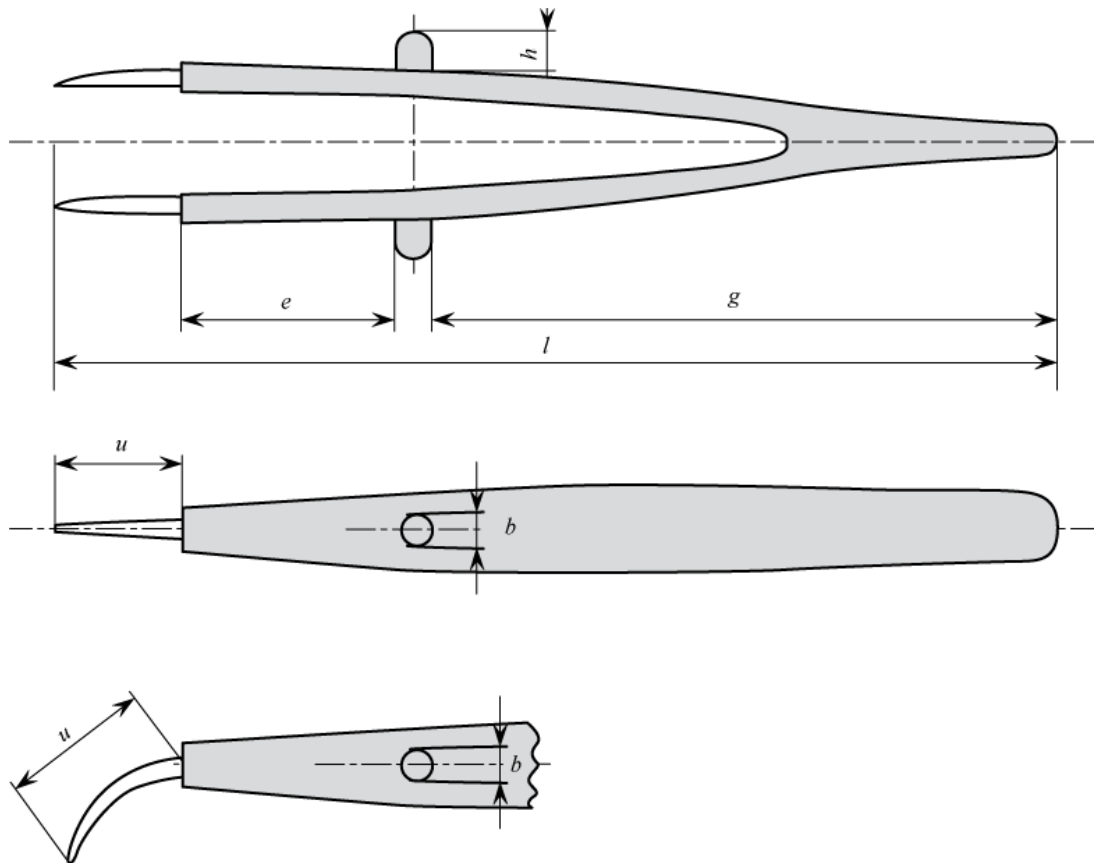

IEC 1054/12

Key

- l* total length of the tweezers
- g* length of the handle (grip)
- b* width of the guard
- h* height of the guard
- e* insulated part of the handle between the guard and the working head
- u* uninsulated part of the working head

Figure 12 – Example of insulation of the handles of tweezers

5 Tests

5.1 General

The present standard provides testing provisions to demonstrate compliance of the product to the requirements of Clause 4. These testing provisions are primarily intended to be used as type tests for validation of the design input. Where relevant, alternative means (calculation, examination, tests, etc.), are specified within the test subclauses for the purpose of hand tools having completed the production phase.

The type tests specified in 5.2 to 5.10 shall be carried out on at least three hand tools of the same design and in the sequence specified in Annex D.

Should a hand tool fail any part of the type test, the type test shall be repeated on at least six further hand tools of the same design. Should any one of these six hand tools fail any part of the type test, the whole test shall be regarded as having been failed.

All hand tools that have failed the type test shall be either destroyed or rendered unsuitable for use in live working.

Unless otherwise stated, the type tests shall be carried out after a minimum storage time of 16 h under IEC climatic conditions, $23\text{ °C} \pm 5\text{ °C}$, relative humidity 45 % to 75 %.

Unless otherwise stated, tolerances of $\pm 5\%$ from any type test values required are permissible.

5.2 Visual check

The hand tool (in particular the insulation) shall be visually checked and shall be free from external defects.

The marking shall be checked for legibility and completeness in accordance with 4.1.4.

The compliance with the relevant complementary requirements of the following subclauses shall be checked by visual inspection:

- subclause 4.3.1.2, in the case of connecting parts of hand tools capable of being assembled;
- subclause 4.3.1.3.2 for instructions for use in the case of hand tools capable of being assembled and designed to be interchangeable between different manufacturers;
- subclause 4.3.2.4 for the type of material of the screw retaining devices of screwdrivers;
- subclause 4.3.3 for uninsulated areas of wrenches.

5.3 Dimensional check

The dimensional requirements of 4.3 shall be checked. The dimensions of certain elements of marking shall be checked according to 4.1.4.

5.4 Impact tests

5.4.1 Type test

5.4.1.1 General

The test shall be carried out according to one of the two methods shown in Figures 13 and 14. In any doubt, method “B” applies (see Figure 14).


In case of hand tools capable of being assembled, the tool components shall be tested separately.

The hammer used in the apparatus of Figure 13 and the hammer and intermediate piece used in apparatus of Figure 14 shall be made of steel with a hardness between 20 HRC and 46 HRC.


At least three points of the insulating material or insulating layer shall be selected as testing points, these being points which could be damaged when the hand tool drops on a flat surface.

The test shall be considered as passed if the insulating material shows no breaks, exfoliations, or cracks penetrating the insulating layer of the insulated hand tool or likely to reduce the solidity of the insulating hand tool.

Dimensions in millimetres

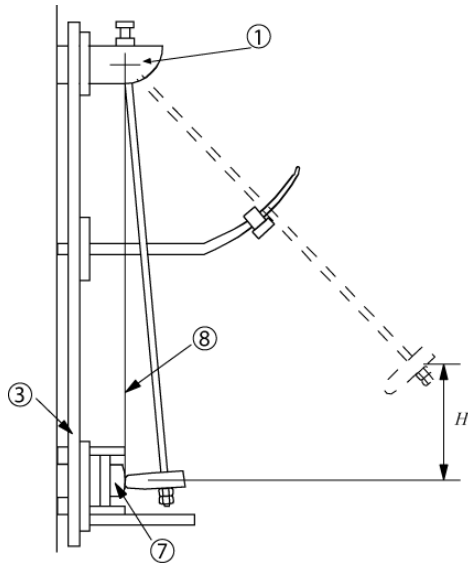


Side view

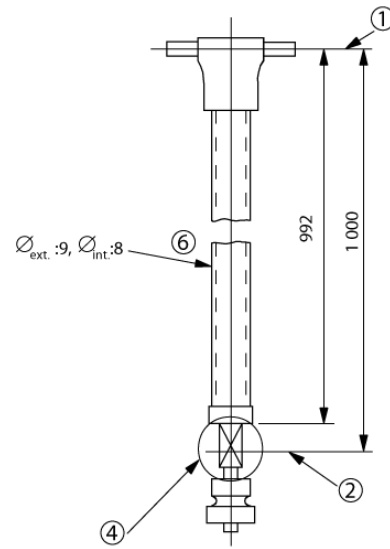


Front view

IEC 1055/12

Dimensions in millimetres

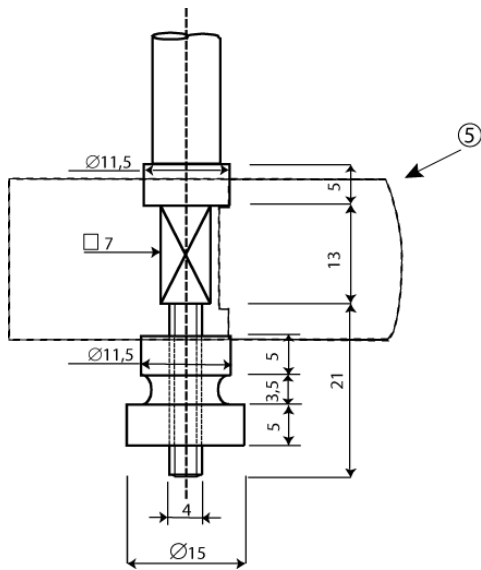

Detail of the assembly of hammer

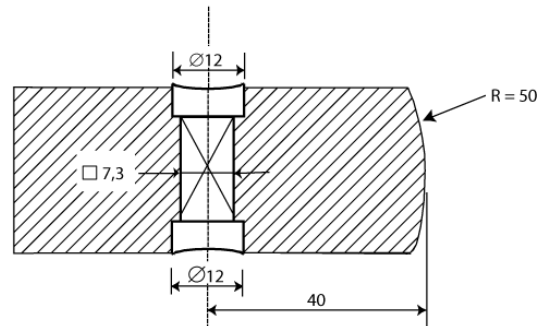

Detail of hammer head


IEC 1056/12

Key

- | | |
|----------------------------|---|
| 1 axis of swing adjustable | 5 hammer head – Rockwell hardness of material between 20 HRC and 46 HRC |
| 2 axe of hammer | 6 steel tube |
| H fall height | 7 test piece |
| 3 frame | 8 vertical plane through axis of pendulum |
| 4 hammer | |

Figure 13 – Example of test arrangement for the impact test – Method A

Dimensions in millimetres

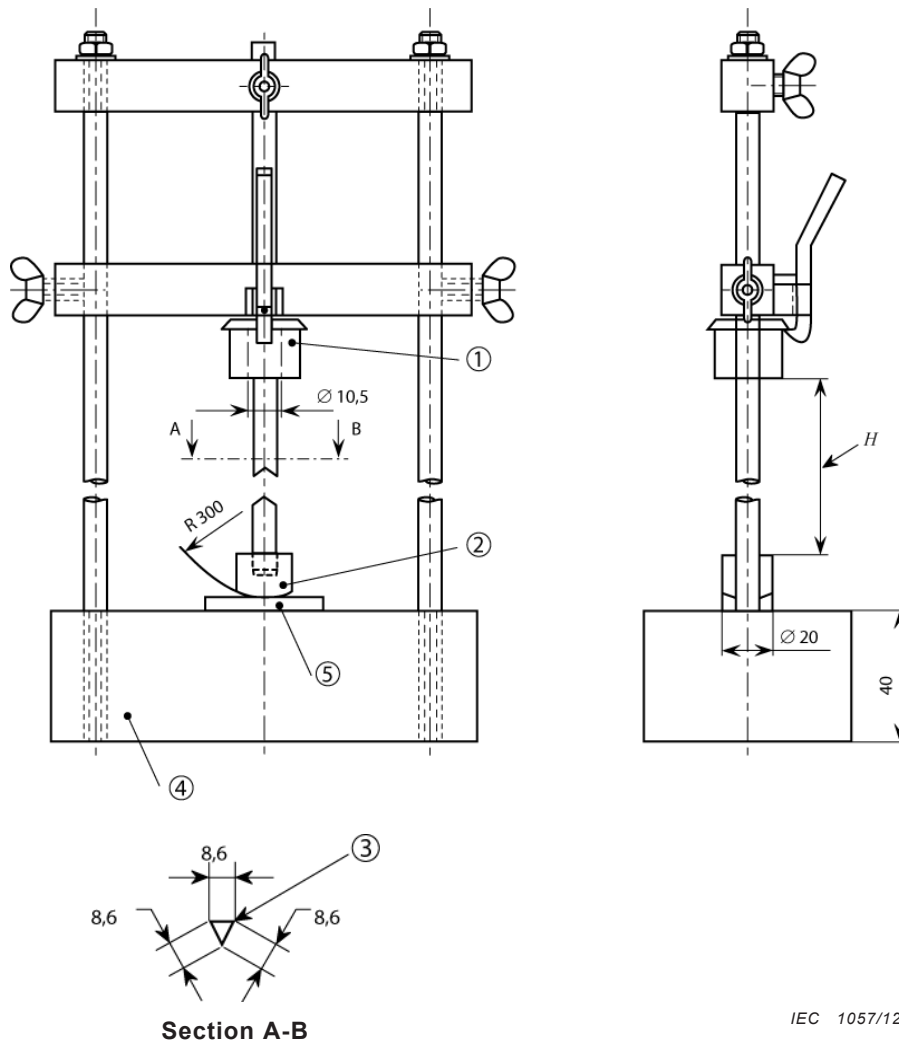

IEC 1057/12

Key

- H* fall height
- 1 hammer
- 2 steel intermediate piece 100 g
- 3 slightly rounded edges
- 4 steel part 10 kg
- 5 test piece

Figure 14 – Example of test arrangement for the impact test – Method B

5.4.1.2 Ambient temperature impact test

The hand tool shall be tested at the ambient temperature, $23\text{ °C} \pm 5\text{ °C}$, of the test room.

The height of fall *H* of the hammer shall be determined as a function of its weight *P*, so that the energy *W* of impact on the hand tool to be tested shall be equal to that of this tool falling on a hard surface from a height of 2 m:

$$H = \frac{W}{P} = \frac{2 \times F}{P}$$

where

H is the height of fall of the hammer, in metres;
 F is the weight of the hand tool tested, in newtons;
 P the weight of the hammer, in newtons.

5.4.1.3 Low temperature impact test

Hand tools, excluding those of category "C", shall be conditioned in a cooling chamber for 2 h at $-25\text{ °C} \pm 3\text{ °C}$. The impact test shall start 120 s after removal from the cooling chamber. The ambient temperature of the test room shall be $23\text{ °C} \pm 5\text{ °C}$.

The height of fall H of the hammer shall be determined as a function of its weight P , so that the energy W of impact on the hand tool to be tested shall be equal to that of this tool falling on a hard surface from a height of 0,6 m:

$$H = \frac{W}{P} = \frac{0,6 \times F}{P}$$

where

H is the height of fall of the hammer, in metres;
 F is the weight of the hand tool tested, in newtons;
 P is the weight of the hammer, in newtons.

5.4.1.4 Extreme low temperature impact test

Hand tools of category "C" shall be conditioned in a cooling chamber for 2 h at $-40\text{ °C} \pm 3\text{ °C}$.

The impact test shall be carried out according to 5.4.1.3.

5.4.2 Alternative means in case of insulated and insulating hand tools having completed the production phase

For conformity evaluation of insulated and insulating hand tools having completed the production phase, the manufacturer shall prove that he has followed the same documented production procedure as per the type tested device.

The manufacturer shall document components and procedures that could affect the impact resistance.

In any doubt, a sampling test in accordance with IEC 61318, using the test method defined for the type test, applies.

5.5 Dielectric tests

5.5.1 General requirements

For tests to be carried out according to IEC 60060-1, the test voltage shall be increased and reduced at a uniform rate of approximately 1 000 V/s.

The dielectric testing shall be started at the latest 5 min after conditioning is completed.

5.5.2 Conditioning (for type test only)

5.5.2.1 General

Before testing (according to 5.5.3 or 5.5.4), the hand tools shall be conditioned in accordance with one of the two possibilities described in 5.5.2.2 and 5.5.2.3.

5.5.2.2 Water bath

The hand tools shall be totally immersed in a bath of tap water at room temperature as specified in 5.1 ($23\text{ °C} \pm 5\text{ °C}$) for $24\text{ h} \pm 0,5\text{ h}$. The water shall have a minimum conductivity of $100\text{ }\mu\text{S/cm}$. After this conditioning, the hand tools shall be wiped dry and submitted to the dielectric test.

5.5.2.3 Wet chamber

The hand tools shall be stored at a relative humidity of $(93 \pm 2)\%$ at a temperature of $23\text{ °C} \pm 5\text{ °C}$ for 48 h. Hand tools capable of being assembled shall not be assembled prior to conditioning.

NOTE This humidity conditioning may be obtained by storing the hand tools in a closed chamber which contains a saturated solution of sodium sulphate decahydrate $\text{Na}_2\text{SO}_4 \cdot 10\text{H}_2\text{O}$ (Glauber's salt) having a large exposed surface.

5.5.3 Dielectric testing of insulated hand tools

5.5.3.1 Type test

5.5.3.1.1 General

The hand tool shall be immersed with its insulated part in a bath of tap water up to a level of $24\text{ mm} \pm 2\text{ mm}$ from the nearest non-insulated part. The water shall have a minimum conductivity of $100\text{ }\mu\text{S/cm}$. The conductive part shall be above the water level (see Figure 15).

Pliers and similar hand tools shall be tested in such a position that the gap d between the two inner sides of the insulated handles is 2 mm to 3 mm, or the minimum possible by the tool's construction but not less than 2 mm (see Figure 15).

For hand tools capable of being assembled and for those tools where the design does not allow testing in a water bath, the water bath shall be replaced by a bath of nickel stainless steel balls 3 mm in diameter (measured with normal industrial tolerances).

A voltage of 10 kV r.m.s. at 50 Hz or 60 Hz shall then be continuously applied for 3 min according to IEC 60060-1, and the leakage current is measured. This current shall be smaller than 1 mA for 200 mm of coated hand tool. This corresponds to a maximum value of the leakage current of:

$$I_M = 5 L$$

where


I_M is the maximum leakage current (in milliamperes) rounded to the upper value in milliamperes;
 L is the unwinded length (in metres) of coating rounded to the lower value in centimetres.

NOTE Annex E gives examples of calculation of the unwinded length of coating and the limits of acceptable leakage current.

Hand tools capable of being assembled shall be tested in all variations of the assembly that are specified by the manufacturer. For tools capable of being assembled with square drives, dummies may be used for the electrical test (see 5.5.3.1.2). Hand tools with retaining devices shall be tested on both end positions, if applicable.

The test shall be considered as passed if no electrical puncture, sparkover or flashover occurs during the test period, and if the limits of leakage current are not exceeded.

Dimensions in millimetres

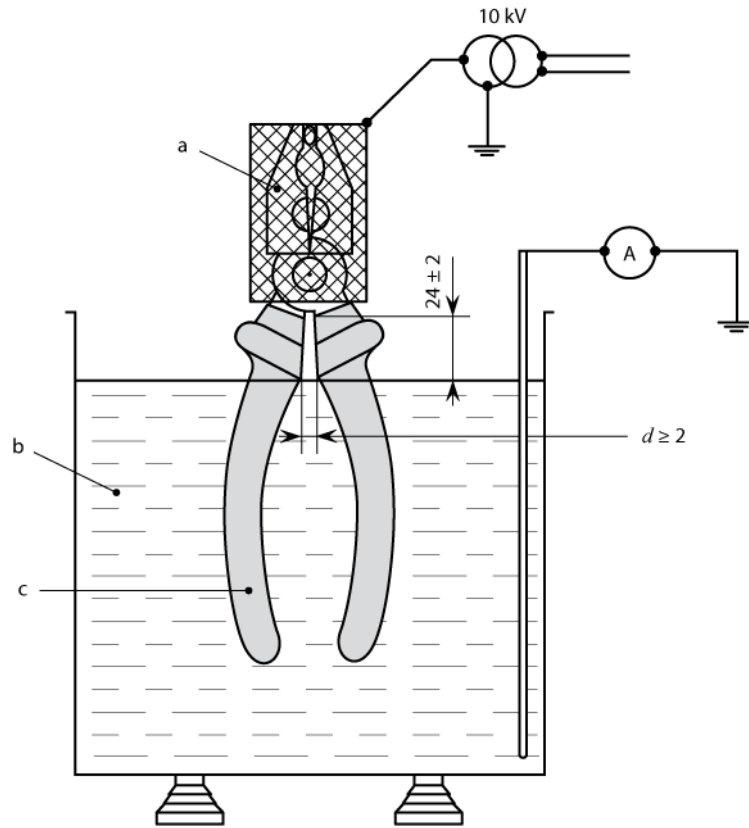

IEC 1058/12


Key

- a conductive working head
- b tap water bath
- c insulated part of the hand tool
- d gap to be maintained between the two inner sides of the legs
- A ammeter

Figure 15 – Dielectric testing arrangement for insulated hand tools

5.5.3.1.2 Tests of hand tools capable of being assembled with square drives
(see 4.3.1.3.1)

In case of hand tools capable of being assembled with square drives, the tools can be tested in separate parts, if the parts are assembled with dummies described in Figure 16. The dimensions and tolerances of the dummies shall be in accordance with Table 2.

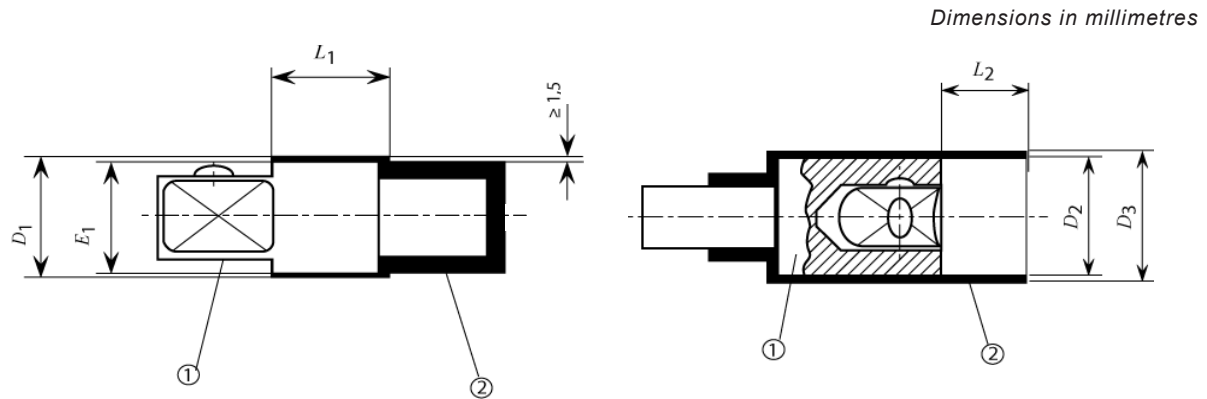

IEC 1059/12

Dummy part 1 to be used with female hand tool ends

Dummy part 2 to be used with male hand tool ends

Key

- 1 conductive part
- 2 insulation

Figure 16 – Description of dummies for dielectric tests for hand tools capable of being assembled with square drives

Table 2 – Dimensions and tolerances for dummies to be used for dielectric tests

Dimensions in millimetres

Nominal size	$L_1 \pm 0,1$	$L_2 \pm 0,1$	$E_1 \pm 0,05$	$D_1 \pm 0,05$	$D_2 \pm 0,05$	$D_3 \pm 0,05$
6,3	19	16	8,4	11	14,5	16,5
10	19	16	12,7	16	19,5	21,5
12,5	19	16	16,9	20	23,5	25,5
20	19	16	25,4	30,5	34,5	35,6

L_1, L_2, E_1, D_1, D_2 and D_3 are described in Figure 16.

Dummy part 1 shall be assembled with female tool ends and dummy part 2 with male tool ends.

On all single parts tested with dummies, the dielectric testing on the complete assembly is not required.

The test shall be considered as passed if no electrical puncture, sparkover or flashover occurs during the test period, and if the limits of leakage current are not exceeded.

5.5.3.2 Alternative means in case of insulated hand tools having completed the production phase

For conformity evaluation of hand tools having completed the production phase the test of 5.5.3.1 shall be performed but

- conditioning as specified in 5.5.2 is not necessary;
- the test time shall be 10 s after reaching the specified voltage;
- the distance of the water level (or ball level) from the nearest exposed metal part shall be 24^{+4}_{-2} mm;
- the leakage current measurement is not carried out.


5.5.4 Dielectric testing of insulating hand tools

5.5.4.1 Type test

Tools having no exposed conductive parts shall be tested as follows.

NOTE The purpose of this test is to check the dielectric quality of the material used for the tool.

Electrodes of conductive tape or conductive paint, in 5 mm wide strips, shall be placed on the surface of the handle at intervals of $24 \text{ mm} \pm 2 \text{ mm}$ (see Figure 17). In accordance with IEC 60060-1, a voltage of 10 kV r.m.s. at 50 Hz or 60 Hz shall then be continuously applied for 3 min between each adjacent electrode.

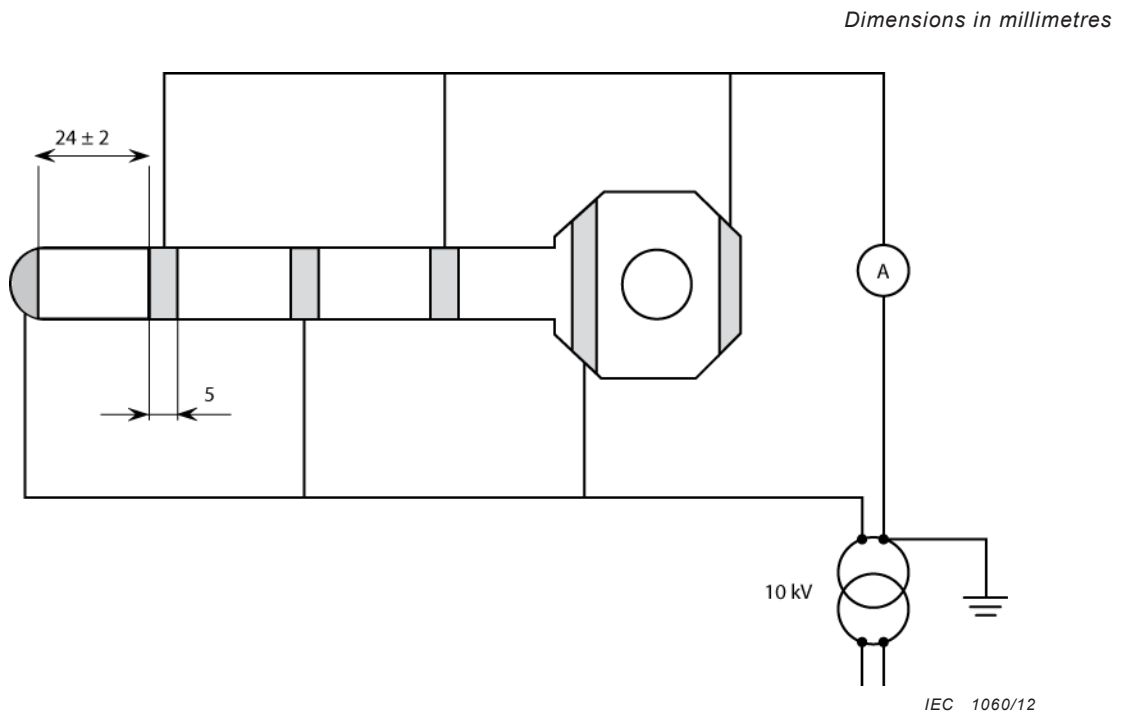

Key

A ammeter

Figure 17 – Dielectric testing arrangement for insulating hand tools

The test shall be considered as passed if no electrical puncture, sparkover or flashover occurs during the test period, and if the leakage current is less than 0,5 mA multiplied by the number of inter-electrode spacings.

5.5.4.2 Alternative means in case of insulating hand tools having completed the production phase

For conformity evaluation of insulating hand tools having completed the production phase, the manufacturer shall prove that he has followed the same documented manufacturing procedure as per the type tested device.

The manufacturer shall document components and procedures that could affect the dielectric performance.

In any doubt, a sampling test in accordance with IEC 61318, using the test method defined for the type test, applies.

5.6 Indentation test (for insulated hand tools)

5.6.1 Type test

All parts of the insulating coating of insulated hand tools, electrically tested as indicated in the relevant subclauses of 5.5 shall pass this test. The test shall be performed on the most vulnerable part(s) for screwdrivers with insulated shaft, and for other hand tools at the external middle part of the handle or legs.


If the radius R at the test point is equal to or larger than 10 mm, the test shall be made with a test device according to Figure 18a. The part of the mass m in contact with the test piece shall be a stainless steel hemispheric nose-piece of 5 mm diameter. The applied force F shall be 20 N.

If the radius R at the test point is less than 10 mm, a rod of 4 mm diameter and at least 30 mm in length placed at right angles to the tool axis shall be used with the same force F of 20 N (see Figure 18b).


The hand tool shall be clamped in such a way that the insulating material coating at the test point is in a horizontal position. After setting up the testing device, the arrangement shall be held according to code 2 h/70 °C/<20 % of IEC 60212, in a heating chamber with ventilation. At the end of the heating time and after a cooling period outside the chamber of 5 min, a voltage of 5 kV r.m.s. at 50 Hz or 60 Hz shall be applied continuously, in accordance with IEC 60060-1, between the testing device and the metal part of the hand tool for 3 min, using the code 18 °C - 28 °C/45 % - 75 % of IEC 60212.

The test shall be considered as passed if no electrical puncture, sparkover or flashover occurs during the test period.

Dimensions in millimetres

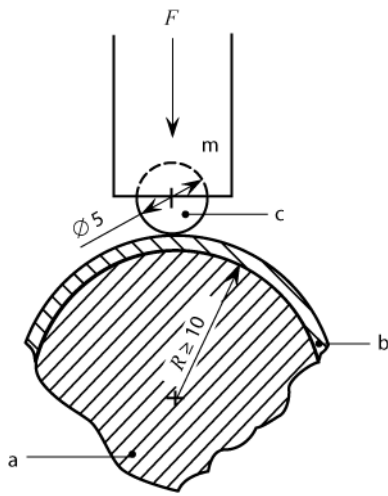

IEC 1061/12

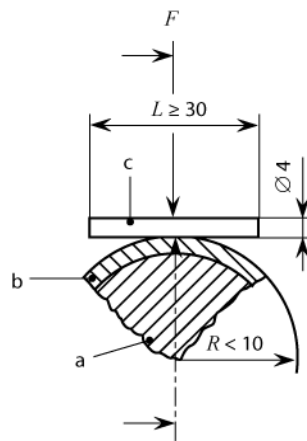

IEC 1062/12

Key

- a conductive part
- b insulation (test point)
- c hemispheric nose-piece
- R radius at the test point of the hand tool
- m testing mass

Key

- a conductive part
- b insulation (test point)
- c rod
- R radius at the test point of the hand tool

Figure 18a – Radius at the test point of the hand tool ≥ 10 mm

Figure 18b – Radius at the test point of the hand tool < 10 mm

Figure 18 – Indentation test

5.6.2 Alternative means in case of insulated hand tools having completed the production phase

For conformity evaluation of insulated hand tools having completed the production phase, the manufacturer shall prove that he has followed the same documented production procedure as per the type tested device.

The manufacturer shall document components and procedures that could affect the indentation resistance.

In any doubt, a sampling test in accordance with IEC 61318, using the test method defined for the type test, applies.

5.7 Test for adhesion of the insulating material coating (for insulated hand tools)

5.7.1 Conditioning

Before the test, the hand tools shall be conditioned in a heating chamber with ventilation at a temperature of $70\text{ °C} \pm 3\text{ °C}$ for 168 h.

The following tests shall be started at ambient temperature 3 min after removal from the heating chamber, using the code $18\text{ °C} - 28\text{ °C}/45\% - 75\%$ of IEC 60212.

5.7.2 Type test

5.7.2.1 Test on the working head

The test shall be made on the following hand tools:

- wrenches;
- open-jaw holding wrenches;
- hand tools capable of being assembled (except for pieces acting as screwdrivers).


The test may be carried out using either method A or method B as shown in Figures 19 and 20 respectively. In any doubt, method “A” shall apply.

Method A (see Figure 19):

A hook having a cutting edge of 5 mm width shall be placed on the working head in such a manner that it does not touch the conductive part.

A force F of 50 N shall be applied in the direction of the line dividing the insulating material coating from the conductive part for 3 min.

Dimensions in millimetres

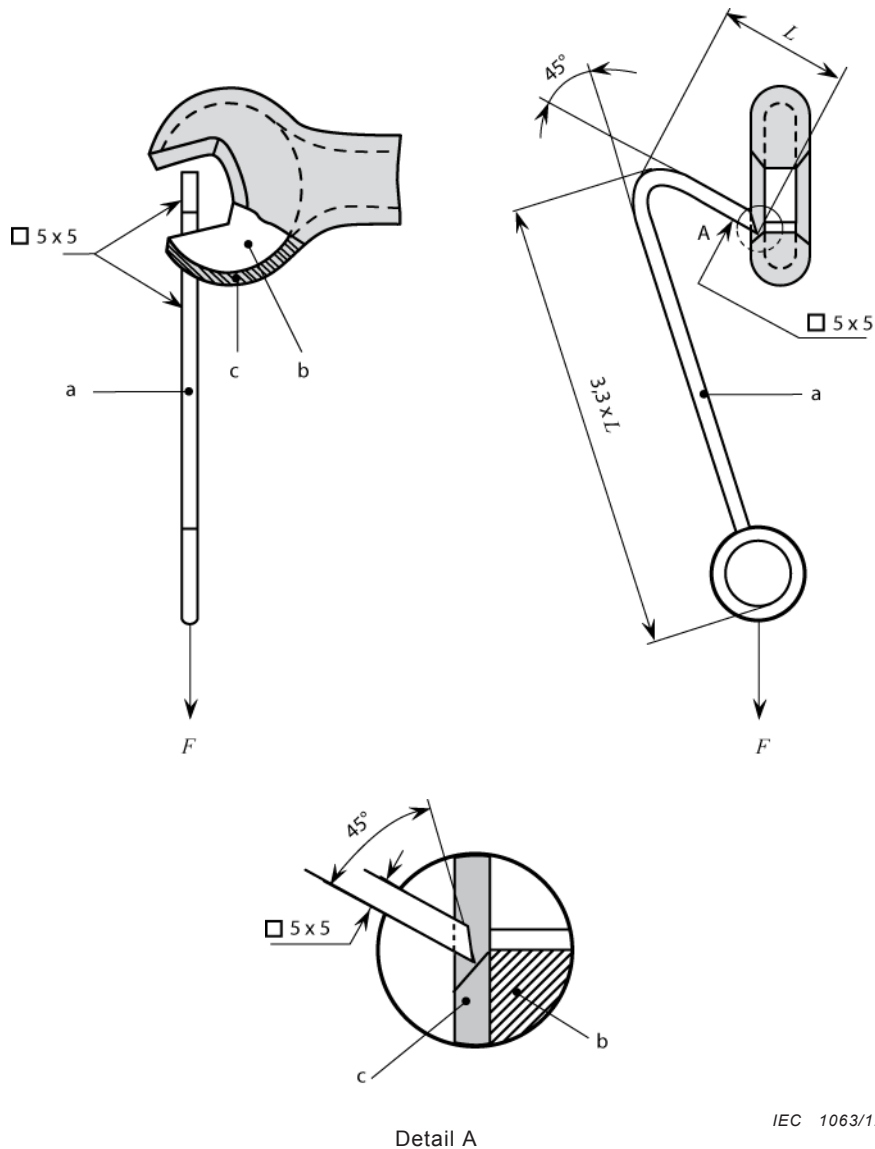

IEC 1063/12

Key


- a hook (the length of the handle depends on the size of the hand tool)
- b conductive part
- c insulating material coating
- L length of the short arm of the hook

Figure 19 – Principle of the testing device for checking adhesion of the insulating coating on conductive parts of the insulated hand tools – Test on the working head – Method A

Method B (see Figure 20):

A device having two cutting edges, each of 5 mm width, shall be placed on the working head in such a manner that it does not touch the conductive part.

A force F of 100 N shall then be applied in the direction of the line dividing the insulating material coating from the conductive part for 3 min.

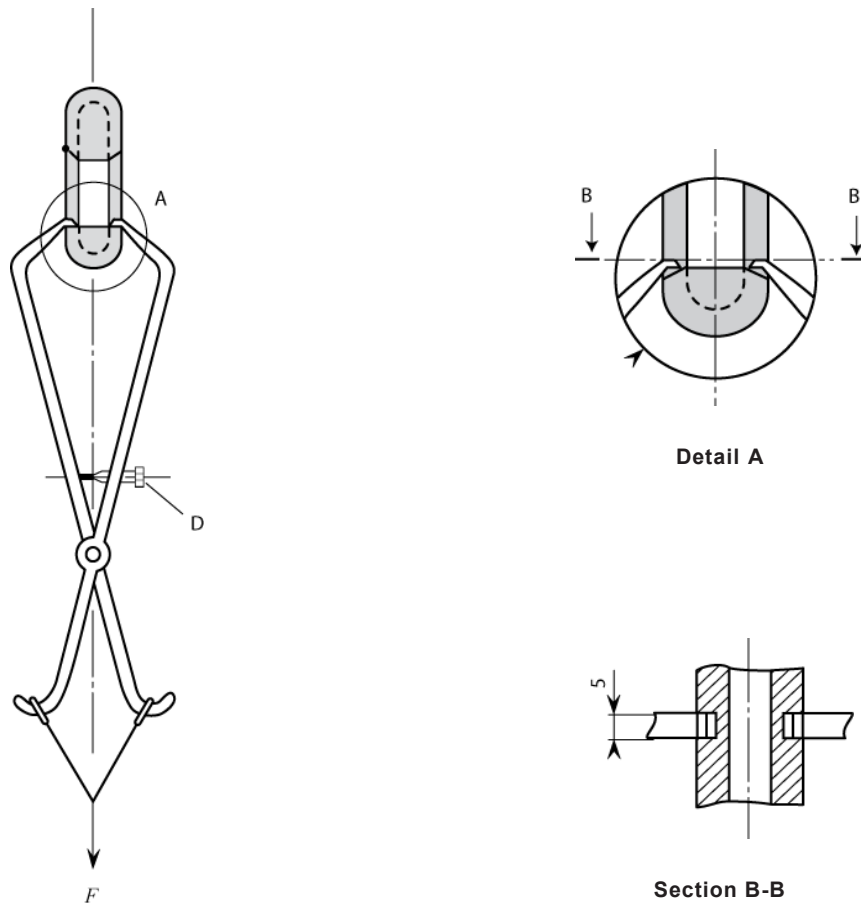

IEC 1064/12

Key

D adjusting device


Figure 20 – Principle of the testing device for checking adhesion of the insulating coating on conductive parts of the insulated hand tools – Test on the working head – Method B

Either test shall be considered as passed if the insulating material coating does not move more than 3 mm from its initial location on the conductive part, and without any breakage of the insulating material.

5.7.2.2 Test on the insulation of the shafts of screwdrivers

The test shall be carried out on screwdrivers or on parts of hand tools capable of being assembled acting as screwdrivers with the testing apparatus as shown in Figure 21.

Dimensions in millimetres

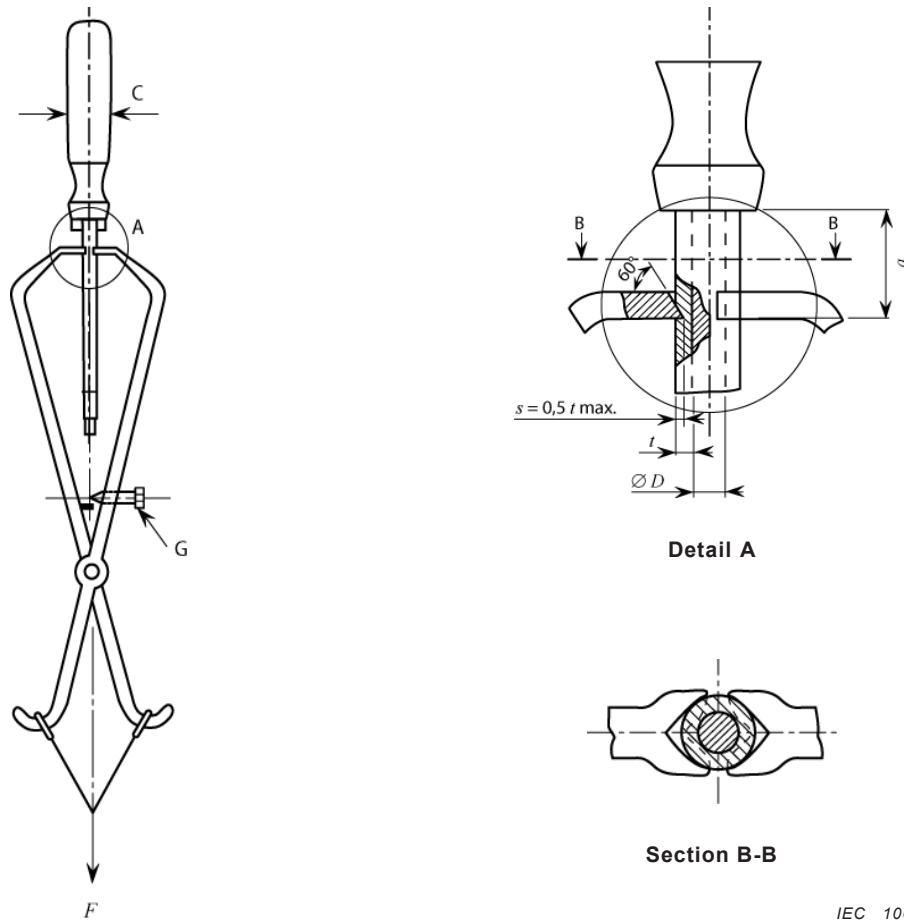

IEC 1065/12

Key

- s depth of penetration ($s \leq 0,5 t$)
- t thickness of the insulating material coating
- F testing force
- a spacing of 10 mm to 15 mm between the point where the shaft comes out of the handle and the cutting edge of the testing appliance
- C suitable clamping device to hold the tested screwdriver in position with the shaft vertical downwards during the test
- D shaft diameter
- G adjusting device

Figure 21 – Testing device for checking adhesion of the insulating coating of screwdrivers on conductive parts and the handle

The penetration depth of the cutting edges s of the testing apparatus shall not exceed 50 % of the thickness t of the insulating material coating. The cutting edges shall be placed on the shaft insulation at a distance a of 10 mm to 15 mm from the point where the shaft emerges from the handle or from the body of the hand tools capable of being assembled acting as screwdrivers.

If the cutting edges slide on the insulation it is permissible to cut a groove in the shaft insulation of up to 50 % of its thickness, to prevent movement.

The force F in newtons shall be equal to 35 times the shaft diameter or 35 times the greatest dimension of the shaft cross-section in millimetres. The maximum force to be applied is 200 N. It shall be applied in the axial direction of the shaft for 1 min.

The test shall be considered as passed if the insulating coating does not move more than 3 mm from its initial location on the conductive part and if there is no breakage of the insulating material.

5.7.2.3 Test of adhesion of the insulation of the entire hand tool


The test shall be made on pliers, strippers, cable-cutting hand tools, cable scissors and knives with the testing apparatus according to Figure 22.

The force F of 500 N shall be applied for 3 min.

The test shall be considered as passed


- if the handle remains firmly attached to the conducting part, and
- if the guard(s) remain firmly attached to the handles.

NOTE Deformation of the insulating coating is not considered as a failure.

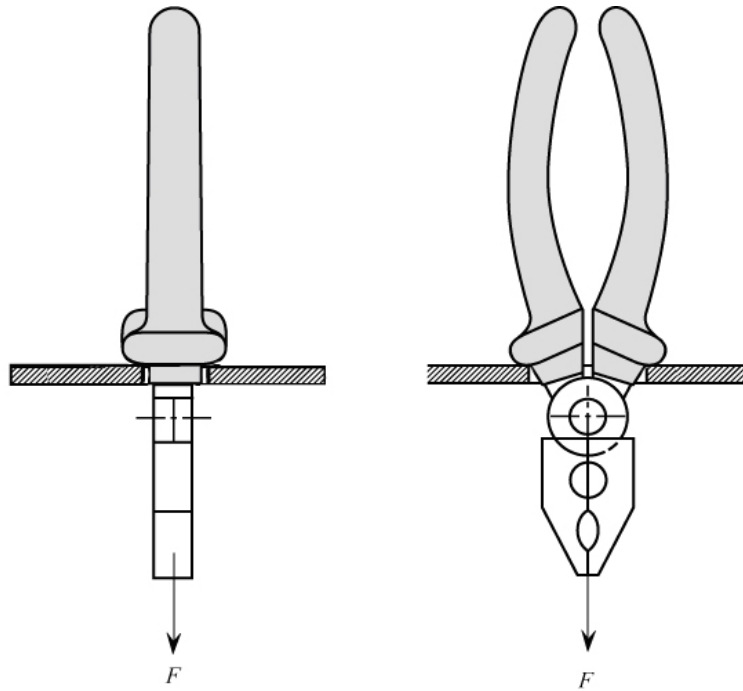

IEC 1066/12

Figure 22a

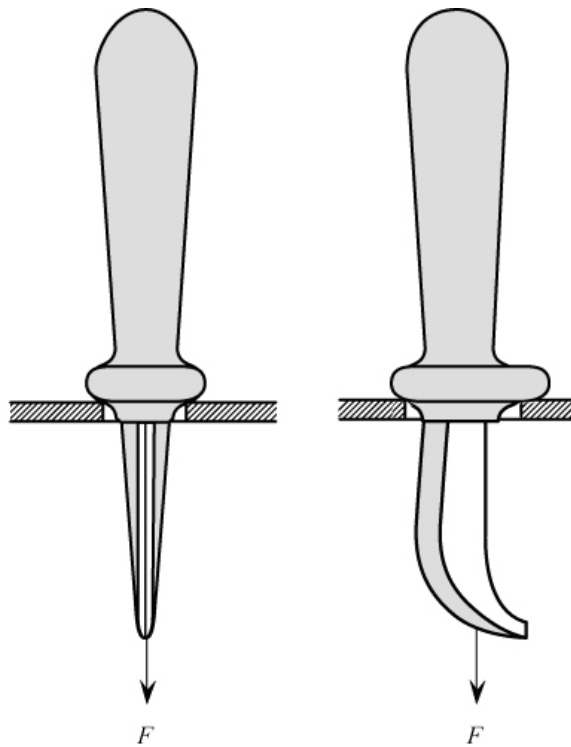

IEC 1067/12

Figure 22b

Figure 22 – Example of mountings for checking stability of adhesion of the insulation of the entire hand tool

5.7.3 Alternative means in case of insulated hand tools having completed the production phase

In case of insulated hand tools having completed the production phase, the conditioning time can be reduced to 2 h.

If the test devices shown in Figures 19, 20 and 22 leave marks on the tested hand tools, it is up to the manufacturer to shape the contact areas between tool and test devices with a customized fit to the tested tools.

The manufacturer shall prove that he has followed the same documented production procedure as per the type tested device.

The manufacturer shall document components and procedures that could affect the adhesion resistance.

In any doubt, a sampling test in accordance with IEC 61318, using the test method defined for the type test, applies.

5.7.4 Test of adhesion of insulating covers of conductive adjusting or switching elements

5.7.4.1 Type test

A separating force of 50 N shall be applied to the cover in a possible separating direction by a suitable device for 3 min.

The test shall be considered as passed if the covers do not come off the elements they are insulating, if the function of the elements they are insulating is still given and if the dielectric test of 5.5.3.1 is passed after this test.

Deformation of the covers due to this test is not considered to be a failure.

If covers are used in areas that are not touched during work, this test needs not be performed. Also the test needs not be performed, where the design of the sealing elements does not allow application of a separating force.

5.7.4.2 Alternative means in case of hand tools having completed the production phase

In case of hand tools having completed the production phase, the test of 5.7.4.1 shall be performed but the time for the application of the separating force shall be limited to 10 s and the test of 5.5.3.1 shall be performed with a conditioning time of 2 h.

In any doubt, a sampling test in accordance with IEC 61318, using the test method defined for the type test, applies.

5.8 Mechanical tests

5.8.1 Insulated hand tools

5.8.1.1 Type test

The hand tools shall comply with all the specific mechanical requirements of ISO standards corresponding to the different types of hand tools. If no ISO standard exists, the hand tools shall comply with a standard specified by the manufacturer or the customer (for example: a national standard). The manufacturer shall provide the reports of these tests at the request of the customer.

5.8.1.2 Alternative means in case of insulated hand tools having completed the production phase

For conformity evaluation of insulated hand tools having completed the production phase, the manufacturer shall prove that he has followed the same documented production procedure as per the type tested device.

The manufacturer shall document components and procedures that could affect the mechanical stability of the hand tool. This includes documentation concerning the basic hand tools that have been insulated.

In any doubt, a sampling test in accordance with IEC 61318, using the test method defined for the type test, applies.

5.8.2 Insulating hand tools

5.8.2.1 Type test

Insulating hand tools specially designed for live working may have lower stress resistance than insulated hand tools, but they shall withstand the expected workloads without failing due to remaining deformation or breaking (see Annex A).

The manufacturer shall provide the reports of the type tests performed on the insulating hand tools, at the request of the customer.

5.8.2.2 Alternative means in case of insulating hand tools having completed the production phase

For conformity evaluation of insulating hand tools having completed the production phase, the manufacturer shall prove that he has followed the same documented production procedure as per the type tested device.

The manufacturer shall document components and procedures that could affect the mechanical stability of the hand tool.

In any doubt, a sampling test in accordance with IEC 61318, using the test method defined for the type test, applies.

5.8.3 Tweezers

A clamping force of 10 N shall be applied 10 mm behind the guard, clamping a test piece with a thickness of 2 mm, a width and length of 10 mm and a hardness of not less than 35 HRC. This stress shall not cause any permanent deformation.

5.8.4 Retaining force test

5.8.4.1 General procedure


The hand tool shall be maintained in such position that the dismantling direction of the detachable part is vertical and downwards.

The load shall be gradually applied along the dismantling direction to reach the value given in 5.8.4.2 or 5.8.4.3 within 2 s; it shall then be held for 1 min.


In case of interchangeable components made by different manufacturers (see 4.3.1.3.2), the reliable function of locking systems used for those hand tools shall be tested with a corresponding dummy. Those dummies can be shaped to the needs of the measuring devices used for the test, but the dimensions of the female square drive part shall be in accordance with Figures 23 and 24. To assure that the intended function is given with all possible combinations of tolerances according to ISO 1174, always a “min” and a “max” dummy shall be used.

Due to a lack of information concerning relevant dimensions, the design of the dummies has been limited to the nominal dimensions 10 mm and 12,5 mm. The test shall be considered as passed if the assembly does not come apart.

Dimensions in millimetres

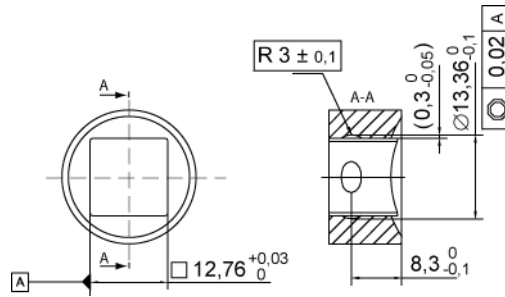

Dummy "MIN"

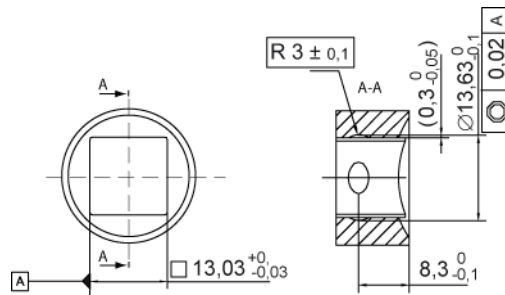


Dummy "MAX"


IEC 1068/12

Figure 23 – Dummies for testing locking systems used with square drives nominal size 12,5 mm of ISO 1174

Dimensions in millimetres

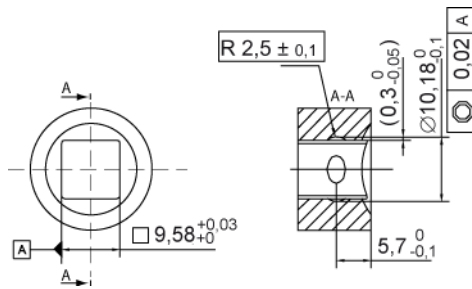

Dummy "MIN"

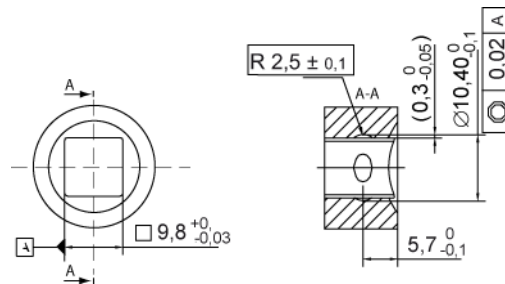

Dummy "MAX"

IEC 1069/12

Figure 24 – Dummies for testing locking systems used with square drives nominal size 10 mm of ISO 1174

5.8.4.2 Not mechanically locked retaining systems

For hand tools capable of being assembled with retaining systems without mechanical lock, that means that no locking element has to be activated before elements of the assembly can be exchanged (for example retaining systems acting based on magnetic retaining forces or systems acting by a spring loaded element only), the following values shall be used for evaluation:

- 4 N for drives up to 6,50 mm;
- 11 N for drives from 6,51 mm to 10,00 mm;
- 30 N for drives from 10,01 mm to 13,50 mm;
- 80 N when drives exceed 13,50 mm.

NOTE The nominal size of the drives is measured across flats. If there are no parallel flats (for example triangular drive, pentagon drive, etc.), the nominal size should be specified in a comparable manner.

5.8.4.3 Mechanically locked retaining systems

In the case of mechanically locked retaining systems, that means that a locking element (for example a screwed fitting, lever, ring, etc.) has to be activated before elements of the assembly can be exchanged, a load of 500 N shall be used.

5.9 Durability of marking

The items of marking shall be rubbed for 15 s with a rag soaked in water, and then for 15 s with a rag soaked in isopropanol (CH₃-CH(OH)-CH₃).

NOTE 1 It is the employer's duty to ensure that any relevant legislation and any specific safety instructions regarding the use of isopropanol are fully observed.

After this rubbing, the marking shall still be legible.

NOTE 2 For special service requirements, the customer may specify extra tests for the durability of marking.

5.10 Flame retardancy test

5.10.1 Type test

The test shall be carried out in a draught-free room. The hand tool to be tested shall be clamped in a horizontal position. A small burner shall be arranged in such a way that the axis of the burner nozzle and the axis of the handle of the hand tool are at right angles and form a vertical plane.


The gas supply shall be technical grade methane gas with a suitable regulator and meter to produce a uniform gas flow.

NOTE If natural gas is used as an alternative to methane, its heat content should be approximately 37 MJ/m³, which has been found to provide similar results.

The nozzle of the burner shall have a diameter of 9,5 mm ± 0,5 mm to produce a 20 mm ± 2 mm high blue flame.

The burner is placed remote from the hand tool, ignited and adjusted in the vertical position to produce a blue flame 20 mm ± 2 mm high. The flame is then obtained by adjusting the gas supply and the air ports of the burner until a 20 mm ± 2 mm yellow-tipped blue flame is produced; the air supply is then increased until the yellow tip disappears. The height of the flame is measured again, and corrected if necessary.

The burner shall then be placed in the test position as shown in Figure 25, with the axis of the flame at right angles to that of the hand tool.

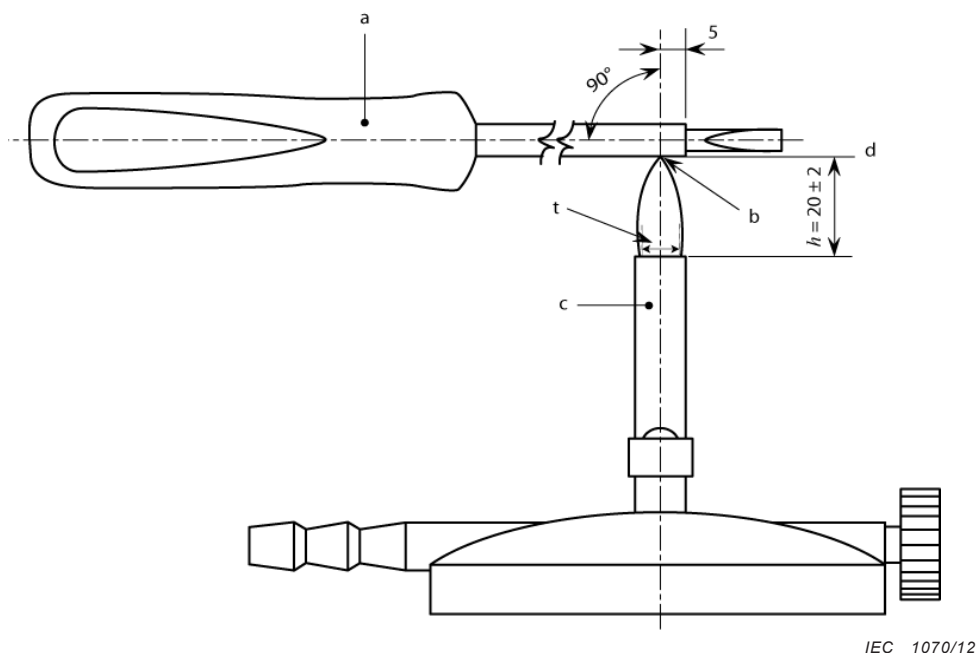

Key

- a test piece
- b tip of the flame
- c burner
- d horizontal reference line
- t inner diameter of burner tube $9,5 \text{ mm} \pm 0,5 \text{ mm}$
- h height of the flame of the gas burner

Figure 25 – Example of a flame retardancy test arrangement

At the start of the test, the tip of the testing flame shall touch the insulating material at the lower part of the working head facing the hand tool to be tested (see Figure 25).

The horizontal reference line d of Figure 25 at the level of the lower end of the insulating material is the datum for measuring the flame height.

If different types of insulating material are used for the same hand tool, the test shall be made on each individual type of insulating material.

The testing flame shall act upon the hand tool to be tested for 10 s. After this period, the flame shall be withdrawn. It shall be ensured that no air draught interferes with the test. The propagation of the flame on the hand tool shall be observed for 20 s after the withdrawal of the testing flame.

The test shall be considered as passed if the flame height on the hand tool does not exceed 120 mm during the 20 s of the observation period.

5.10.2 Alternative means in case of hand tools having completed the production phase

For conformity evaluation of insulating and insulated hand tools having completed the production phase, the manufacturer shall prove that he has followed the same documented production procedure as per the type tested device.

The manufacturer shall document components and procedures that could affect the flame retardancy of the insulation.

In any doubt, a sampling test in accordance with IEC 61318, using the test method defined for the type test, applies.

6 Conformity assessment of hand tools having completed the production phase

For conducting the conformity assessment during the production phase, IEC 61318 shall be used in conjunction with the present standard.

Annex F, issued of a risk analysis on the performance of the hand tools, provides the classification of defects and identifies the associated tests applicable in case of production follow-up.

7 Modifications

Any modification of the hand tools shall require the type tests to be repeated, in whole or in part (if the degree of modification so justifies), as well as a change in hand tool reference literature.

Annex A (informative)

Mechanical strength of insulating hand tools

A.1 Context

Hand tools complying with ISO standards are often tested with test loads far beyond loads that can really be applied by hand. Among the reasons for this are

- that the application of these universal hand tools is not always known in detail, and
- that such hand tools are required to resist various improper uses that are to be expected, without failing and endangering the user.

For live working, the workers have to have a much better training level and the applications of some hand tools are very well defined. The following informative proposals are based on loads that can be applied by hand only and under regular conditions.

Insulating hand tools specially designed for live working applications may have lower stress resistance than insulated hand tools, if they withstand the expected workloads without failing due to permanent deformation or breaking.

A.2 General

To check the ability of insulating hand tools to withstand the expected maximum workloads specified in Clauses A.3 to A.6, tests should be carried out in accordance with the test procedures defined in ISO standards for similar insulated hand tools. If such ISO standards do not exist, tests may be specified by the manufacturer or by the customer. For those tests the IEC climatic conditions and tolerances of 5.1 apply.

If insulating hand tools are equipped with devices that limit the workloads that can be applied with them, for example overload slipping clutches, these limiting devices are activated before these tools reach the test loads specified hereafter.

A.3 Insulating screwdrivers

Table A.1 – Torque values for insulating screwdrivers

Blade diameter mm	Test torque N·m
More than 8,0	10
6,5 to 7,9	8,0
5,5 to 6,4	5,5
4,5 to 5,4	4,5
4,0 to 4,4	2,5
3,5 to 3,9	1,3
3,0 to 3,4	0,7
2,5 to 2,9	0,4
Up to 2,4	0,3

A.4 Insulating wrenches and ratchets

Wrenches and ratchets: maximum hand force = 500 N

The force is applied 35 mm away from the outer extremities of the handles right angled to the axle of the work piece to be turned.

A.5 Insulating T- wrenches

T-wrenches: maximum hand force = 250 N

The force is applied simultaneously on both handles in opposite directions, 35 mm away from the outer extremities of the handles right angled to the axle of the work piece to be turned.

A.6 Insulating pliers and cable shears


A hand load test in accordance with ISO 5744 should be carried out with a load of 500 N.

The load is to be applied 35 mm away from the outer extremities of the handles squeezing the handles.

A torsion test in accordance with ISO 5744 should be carried out for gripping pliers with a flat nose. The force for clamping is to be 350 N, applied 35 mm away from the outer extremities of the handle. The torque to be applied is 4 N·m. The maximum permissible twist angle at this torque is 20°.

Annex B
(normative)

Suitable for live working; double triangle
(IEC 60417-5216:2002-10)

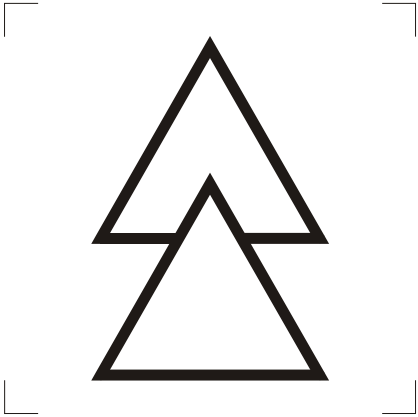

Annex C (informative)

Recommendation for use and in-service care

C.1 General

The following is for guidance only concerning the maintenance, inspection, retest and use of hand tools after purchase.

C.2 Storage

Insulated or insulating hand tools should be properly stored to minimise the risk of damage to the insulation due to storage or transportation. These hand tools should be stored generally separated from other tools to avoid mechanical damage or confusion. Furthermore, these hand tools should be prevented from excessive heat (for example heating or steam pipes) as well as UV- radiation.

C.3 Inspection before use

Before use, each hand tool should be visually inspected by the user.

If there is any doubt concerning the safety of the hand tool, it should either be scrapped or subjected to examination by a competent person and retested, if necessary.

C.4 Temperature

According to their capability, hand tools should be used only in areas having temperatures between -20 °C and $+70\text{ °C}$ and, for tools marked "C", between -40 °C and $+70\text{ °C}$.

C.5 Periodic examination and electrical retesting

An annual visual examination by a suitably trained person is recommended to determine the suitability of the hand tool for further service. If an electrical retest is required by national regulation or by customer specifications or in case of doubt after visual examination, the dielectric test of 5.5.3.2 for insulated tools and the test of 5.5.4.1 for insulating tools should be performed.

Annex D (normative)



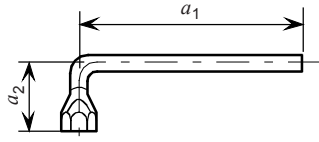
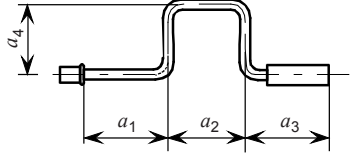
General type test procedure

Table D.1 – Sequential order for performing type tests^a

Sequential order	Type test	Subclause	Requirements
1	Visual check	5.2	4.1.1, 4.1.4, 4.1.6, 4.3.1.2, 4.3.1.3.2, 4.3.2.4, 4.3.3
1	Dimensional check	5.3	4.1.4, 4.3
2	Impact test – at ambient temperature (for all hand tools)	5.4.1 5.4.1.2	4.2.1 and 4.2.2
3	Impact test – at low temperature (all hand tools except category “C”) – at extremely low temperature (hand tools of category “C”)	5.4.1 5.4.1.3 5.4.1.4	
4	Dielectric testing (insulated hand tools)	5.5.1, 5.5.2 and 5.5.3.1	4.2.1
4	Dielectric testing (insulating hand tools)	5.5.1, 5.5.2 and 5.5.4.1	4.2.1
5	Indentation test (insulated hand tools)	5.6.1	4.2.1 and 4.2.2
6	Test for adhesion of the insulating material coating (insulated tools) – test on the working head (5.7.2.1) – test on the insulation of the shafts of screwdrivers (5.7.2.2) – test of the insulation of the entire hand tool (5.7.2.3) – test of insulating covers of conductive adjusting or switching elements	5.7.1 and 5.7.2	4.2.1 and 4.2.2
		5.7.4.1	4.1.5
7	Mechanical tests – performance under load (insulated hand tools) – performance under load (insulating hand tools) – tweezers – retaining force test	5.8	4.1.2
		5.8.1.1	4.1.2
		5.8.2.1	4.1.2
		5.8.3 5.8.4	4.1.2 4.3.1.1
8	Durability of marking	5.9	4.1.4
9	Flame retardancy test	5.10.1	4.2.1
^a Type tests with the same sequential number can be performed in the more convenient order.			

Annex E
(normative)

**Examples of calculation of the unwinded length
of coating and acceptable leakage current**

Designations	Unwinded length of coating L	Limits of acceptable leakage current $I_M = 5 L$
 <p>Engineers' wrench single head</p>	$L = a$ <i>Example:</i> $L = a = 0,20 \text{ m}$	$5 L = 1$ $I_M = 1 \text{ mA}$
 <p>All-purpose pliers</p>	$L = a_1 + a_2 = 2a_1$ <i>Example:</i> $a_1 = a_2 = 0,14 \text{ m}$ $L = 0,28 \text{ m}$	$5 L = 1,4$ rounded to $I_M = 2 \text{ mA}$
 <p>Socket wrench, single head</p>	$L = a_1 + a_2$ <i>Example:</i> $a_1 = 0,30 \text{ m}$ $a_2 = 0,10 \text{ m}$ $L = 0,40 \text{ m}$	$5 L = 2$ $I_M = 2 \text{ mA}$
 <p>Speed brace</p>	$L = a_1 + a_2 + a_3 + 2a_4$ <i>Example:</i> $a_1 = 0,30 \text{ m}$ $a_2 = 0,15 \text{ m}$ $a_3 = 0,15 \text{ m}$ $a_4 = 0,25 \text{ m}$ $L = 1,10 \text{ m}$	$5 L = 5,50$ rounded to $I_M = 6 \text{ mA}$

Annex F (normative)

Classification of defects and tests to be allocated

This annex was developed to address the type of defects of a manufactured hand tool (critical, major or minor) in a consistent manner (see IEC 61318). For each requirement identified in Table F.1, both the type of defect and the associated test are specified.

Table F.1 – Classification of defects and associated requirements and tests

Requirements		Type of defects			Tests
		Critical	Major	Minor	
General (4.1)					
4.1.1	General integrity	X			5.2, 5.3
4.1.2	Performance under load – Insulated hand tools – Insulating hand tools – Tweezers		X X X		5.8.1.2 5.8.2.2 5.8.3
4.1.4	Marking – Correctness – Durability			X X	5.2, 5.3 5.9
4.1.5	Separating of covers	X			5.7.4.2
4.1.6	Instructions for use			X	5.2
General requirements concerning insulating materials (4.2)					
4.2.1	Resistance to electrical stress – Insulated hand tools – Insulating hand tools	X	X		5.5 5.5.3.2 5.5.4.2
4.2.1 and 4.2.2	Resistance to mechanical stress – Impact resistance – Insulated hand tools – resistance to indentation – Insulated hand tools – adhesion of the insulating materials			X X	5.4.2 5.6.2
			X		5.7.3
4.2.1	Flame retardancy			X	5.10.2
Additional requirements – Tools capable of being assembled (4.3.1)					
4.3.1.1	Retaining devices			X	5.8.4
4.3.1.2	Insulation design	X			5.2
4.3.1.3.1	Hand tools capable of being assembled with square drives – General requirements		X		5.3
4.3.1.3.2	– Interchangeability of components made by different manufacturers		X		5.2, 5.3, 5.8.4
4.3.1.3.2	– Instructions for use	X			5.2
Additional requirements – Screwdrivers (4.3.2)					
4.3.2.1	Uninsulated areas	X			5.3
4.3.2.2	Shape of shaft insulation	X			
4.3.2.3	Bit screwdrivers	X			5.2, 5.3
4.3.2.4	Screwdrivers with screw retaining devices	X			
Additional requirements – Wrenches – uninsulated areas (4.3.3)					
		X			5.2
Additional requirements – Adjustable wrenches (4.3.4)					
		X			5.2, 5.3
Additional requirements – Pliers, strippers, cable scissors, cable-cutting hand tools (4.3.5)					
		X			5.2, 5.3
Additional requirements – Scissors (4.3.6)					
		X			5.2, 5.3
Additional requirements – Knives (4.3.7)					
		X			5.3
Additional requirements – Tweezers (4.3.8)					
		X			5.2, 5.3

Bibliography

IEC 60050 (all parts), *International Electrotechnical Vocabulary* (available at <http://www.electropedia.org>)

IEC 60743, *Live working – Terminology for tools, equipment and devices*

ISO 1703, *Assembly tools for screws and nuts – Designation and nomenclature*

ISO 5742, *Pliers and nippers – Nomenclature*

ISO 5744, *Pliers and nippers – Methods of test*

ISO 8979, *Pliers and nippers for electronics – Nomenclature*

British Standards Institution (BSI)

BSI is the national body responsible for preparing British Standards and other standards-related publications, information and services.

BSI is incorporated by Royal Charter. British Standards and other standardization products are published by BSI Standards Limited.

About us

We bring together business, industry, government, consumers, innovators and others to shape their combined experience and expertise into standards-based solutions.

The knowledge embodied in our standards has been carefully assembled in a dependable format and refined through our open consultation process. Organizations of all sizes and across all sectors choose standards to help them achieve their goals.

Information on standards

We can provide you with the knowledge that your organization needs to succeed. Find out more about British Standards by visiting our website at bsigroup.com/standards or contacting our Customer Services team or Knowledge Centre.

Buying standards

You can buy and download PDF versions of BSI publications, including British and adopted European and international standards, through our website at bsigroup.com/shop, where hard copies can also be purchased.

If you need international and foreign standards from other Standards Development Organizations, hard copies can be ordered from our Customer Services team.

Subscriptions

Our range of subscription services are designed to make using standards easier for you. For further information on our subscription products go to bsigroup.com/subscriptions.

With **British Standards Online (BSOL)** you'll have instant access to over 55,000 British and adopted European and international standards from your desktop. It's available 24/7 and is refreshed daily so you'll always be up to date.

You can keep in touch with standards developments and receive substantial discounts on the purchase price of standards, both in single copy and subscription format, by becoming a **BSI Subscribing Member**.

PLUS is an updating service exclusive to BSI Subscribing Members. You will automatically receive the latest hard copy of your standards when they're revised or replaced.

To find out more about becoming a BSI Subscribing Member and the benefits of membership, please visit bsigroup.com/shop.

With a **Multi-User Network Licence (MUNL)** you are able to host standards publications on your intranet. Licences can cover as few or as many users as you wish. With updates supplied as soon as they're available, you can be sure your documentation is current. For further information, email bsmusales@bsigroup.com.

BSI Group Headquarters

389 Chiswick High Road London W4 4AL UK

Revisions

Our British Standards and other publications are updated by amendment or revision.

We continually improve the quality of our products and services to benefit your business. If you find an inaccuracy or ambiguity within a British Standard or other BSI publication please inform the Knowledge Centre.

Copyright

All the data, software and documentation set out in all British Standards and other BSI publications are the property of and copyrighted by BSI, or some person or entity that owns copyright in the information used (such as the international standardization bodies) and has formally licensed such information to BSI for commercial publication and use. Except as permitted under the Copyright, Designs and Patents Act 1988 no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means – electronic, photocopying, recording or otherwise – without prior written permission from BSI. Details and advice can be obtained from the Copyright & Licensing Department.

Useful Contacts:

Customer Services

Tel: +44 845 086 9001

Email (orders): orders@bsigroup.com

Email (enquiries): cservices@bsigroup.com

Subscriptions

Tel: +44 845 086 9001

Email: subscriptions@bsigroup.com

Knowledge Centre

Tel: +44 20 8996 7004

Email: knowledgecentre@bsigroup.com

Copyright & Licensing

Tel: +44 20 8996 7070

Email: copyright@bsigroup.com



...making excellence a habit.™