



## **BSI Standards Publication**

# **Engineering data exchange format for use in industrial automation systems engineering - Automation markup language**

Part 2: Role class libraries

**bsi.**

...making excellence a habit.<sup>TM</sup>

**National foreword**

This British Standard is the UK implementation of EN 62714-2:2015. It is identical to IEC 62714-2:2015.

The UK participation in its preparation was entrusted to Technical Committee AMT/7, Industrial communications: process measurement and control, including fieldbus.

A list of organizations represented on this committee can be obtained on request to its secretary.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

© The British Standards Institution 2015.  
Published by BSI Standards Limited 2015

ISBN 978 0 580 79430 8  
ICS 25.040.40; 35.060; 35.240.50

**Compliance with a British Standard cannot confer immunity from legal obligations.**

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 31 May 2015.

**Amendments/corrigenda issued since publication**

---

Date	Text affected
------	---------------

May 2015

ICS 25.040.40; 35.060; 35.240.50

English Version

Engineering data exchange format for use in industrial  
automation systems engineering - Automation markup  
language - Part 2: Role class libraries  
(IEC 62714-2:2015)

Format d'échange de données techniques pour une  
utilisation dans l'ingénierie des systèmes d'automatisation  
industrielle - Automation markup language - Partie 2:  
Bibliothèques de classes de rôles  
(IEC 62714-2:2015)

Datenaustauschformat für Planungsdaten industrieller  
Automatisierungssysteme - Automation markup language -  
Teil 2: Rollenbibliotheken  
(IEC 62714-2:2015)

This European Standard was approved by CENELEC on 2015-05-04. CENELEC members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CENELEC member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CENELEC member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CENELEC members are the national electrotechnical committees of Austria, Belgium, Bulgaria, Croatia, Cyprus, the Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, the Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.



European Committee for Electrotechnical Standardization  
Comité Européen de Normalisation Electrotechnique  
Europäisches Komitee für Elektrotechnische Normung

CEN-CENELEC Management Centre: Avenue Marnix 17, B-1000 Brussels

## Foreword

The text of document 65E/300/CDV, future edition 1 of IEC 62714-2, prepared by SC 65E "Devices and integration in enterprise systems", of IEC/TC 65 "Industrial-process measurement, control and automation" was submitted to the IEC-CENELEC parallel vote and approved by CENELEC as EN 62714-2:2015.

The following dates are fixed:

- latest date by which the document has to be implemented at (dop) 2016-02-04 national level by publication of an identical national standard or by endorsement
- latest date by which the national standards conflicting with the document have to be withdrawn (dow) 2018-05-04

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CENELEC [and/or CEN] shall not be held responsible for identifying any or all such patent rights.

## Endorsement notice

The text of the International Standard IEC 62714-2:2015 was approved by CENELEC as a European Standard without any modification.

In the official version, for Bibliography, the following notes have to be added for the standards indicated:

IEC 61512-1	NOTE	Harmonized as EN 61512-1.
IEC 62264-1:2013	NOTE	Harmonized as EN 62264-1:2013 (not modified).

**Annex ZA**  
(normative)

**Normative references to international publications  
with their corresponding European publications**

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

NOTE 1 When an International Publication has been modified by common modifications, indicated by (mod), the relevant EN/HD applies.

NOTE 2 Up-to-date information on the latest versions of the European Standards listed in this annex is available here: [www.cenelec.eu](http://www.cenelec.eu).

<u>Publication</u>	<u>Year</u>	<u>Title</u>	<u>EN/HD</u>	<u>Year</u>
IEC 61360-4	-	Standard data element types with associated classification scheme for electric components - Part 4: IEC reference collection of standard data element types and component classes	EN 61360-4	-
IEC 62424	2008	Representation of process control engineering - Requests in P&I diagrams and data exchange between P&ID tools and PCE-CAE tools	EN 62424	2009
IEC 62714-1	2014	Engineering data exchange format for use in industrial automation systems engineering - Automation markup language - Part 1: Architecture and general requirements	EN 62714-1	2014



# NORME INTERNATIONALE



**Engineering data exchange format for use in industrial automation systems  
engineering – Automation markup language –  
Part 2: Role class libraries**

**Format d'échange de données techniques pour une utilisation dans l'ingénierie  
des systèmes d'automatisation industrielle – Automation markup language –  
Partie 2: Bibliothèques de classes de rôles**

INTERNATIONAL  
ELECTROTECHNICAL  
COMMISSION

COMMISSION  
ELECTROTECHNIQUE  
INTERNATIONALE

ICS 25.040.40; 35.06; 35.240.50

ISBN 978-2-8322-2407-6

**Warning! Make sure that you obtained this publication from an authorized distributor.**

**Attention! Veuillez vous assurer que vous avez obtenu cette publication via un distributeur agréé.**

## CONTENTS

FOREWORD .....	7
INTRODUCTION .....	9
1    Scope .....	11
2    Normative references .....	11
3    Terms, definitions and abbreviations .....	11
3.1    Terms and definitions .....	11
3.2    Abbreviations .....	12
4    Conformity .....	12
5    AML role classes .....	13
5.1    Structure and references .....	13
5.2    AML role class library for discrete manufacturing industry – AutomationMLDMIRoleClassLib .....	14
5.2.1    General .....	14
5.2.2    RoleClass DiscManufacturingEquipment .....	15
5.2.3    RoleClass Transport .....	16
5.2.4    RoleClass Storage .....	16
5.2.5    RoleClass Fixture .....	16
5.2.6    RoleClass Gate .....	16
5.2.7    RoleClass Robot .....	17
5.2.8    RoleClass Tool .....	17
5.2.9    RoleClass Carrier .....	17
5.2.10    RoleClass Machine .....	17
5.2.11    RoleClass StaticObject .....	18
5.3    AML role class library for continuous manufacturing industry – AutomationMLCMIRoleClassLib .....	18
5.3.1    General .....	18
5.3.2    RoleClass ContManufacturingEquipment .....	19
5.4    AML role class library for batch manufacturing industry – AutomationMLBMRoleClassLib .....	19
5.4.1    General .....	19
5.4.2    RoleClass BatchManufacturingEquipment .....	20
5.5    AML role class library for control systems – AutomationMLCSRoleClassLib .....	20
5.5.1    General .....	20
5.5.2    RoleClass ControlEquipment .....	21
5.5.3    RoleClass Communication .....	22
5.5.4    RoleClass ControlHardware .....	22
5.5.5    RoleClass PC .....	22
5.5.6    RoleClass IPC .....	22
5.5.7    RoleClass Handheld .....	22
5.5.8    RoleClass EmbeddedDevice .....	23
5.5.9    RoleClass Sensor .....	23
5.5.10    RoleClass Actuator .....	23
5.5.11    RoleClass Controller .....	23
5.5.12    RoleClass PLC .....	24
5.5.13    RoleClass NC .....	24
5.5.14    RoleClass RC .....	24

5.5.15    RoleClass PAC .....	24
Annex A (informative) AML extended role class library .....	25
A.1    General.....	25
A.2    RoleClass PLCFacet.....	26
A.3    RoleClass HMIFacet .....	27
A.4    RoleClass Enterprise .....	27
A.5    RoleClass Site .....	28
A.6    RoleClass Area.....	28
A.7    RoleClass ProductionLine .....	29
A.8    RoleClass WorkCell .....	29
A.9    RoleClass ProcessCell.....	29
A.10   RoleClass Unit.....	30
A.11   RoleClass ProductionUnit .....	30
A.12   RoleClass StorageZone .....	30
A.13   RoleClass StorageUnit.....	31
A.14   RoleClass Turntable .....	31
A.15   RoleClass Conveyor .....	31
A.16   RoleClass BeltConveyor .....	32
A.17   RoleClass RollConveyor .....	32
A.18   RoleClass ChainConveyor .....	32
A.19   RoleClass PalletConveyor.....	32
A.20   RoleClass OverheadConveyor .....	33
A.21   RoleClass LiftingTable .....	33
A.22   RoleClass AGV .....	33
A.23   RoleClass Transposer.....	33
A.24   RoleClass CarrierHandlingSystem .....	34
A.25   RoleClass BodyStore .....	34
A.26   RoleClass Lift .....	34
A.27   RoleClass Rollerbed .....	34
A.28   RoleClass StationaryTool.....	35
A.29   RoleClass MovableTool .....	35
A.30   RoleClass ControlCabinet .....	35
A.31   RoleClass IODevice .....	35
A.32   RoleClass HMI.....	36
A.33   RoleClass WarningEquipment.....	36
A.34   RoleClass ActuatingDrive .....	36
A.35   RoleClass MotionController.....	36
A.36   RoleClass Panel .....	37
A.37   RoleClass MeasuringEquipment.....	37
A.38   RoleClass Clamp .....	37
A.39   RoleClass ProcessController .....	37
A.40   RoleClass Loader .....	38
A.41   RoleClass Unloader .....	38
Annex B (informative) Examples of usage of RoleClasses .....	39
B.1    General.....	39
B.2    Example plant unit .....	39
Annex C (informative) User-defined RoleClass libraries .....	44
C.1    General.....	44
C.2    External semantics of attributes .....	45

Annex D (informative) XML representation of AML libraries .....	46
D.1    AutomationMLMDIRoleClassLib .....	46
D.2    AutomationMLCMIRoleClassLib .....	46
D.3    AutomationMLBMRoleClassLib .....	47
D.4    AutomationMLCSRolleClassLib.....	47
D.5    AutomationMLExtendedRoleClassLib.....	48
Bibliography.....	51
 Figure 1 – Overview of the engineering data exchange format (AML).....	9
Figure 2 – AutomationMLBaseRoleClassLib defined in IEC 62714-1:2014 .....	13
Figure 3 – AutomationMLMDIRoleClassLib .....	15
Figure 4 – XML grid of the AutomationMLMDIRoleClassLib.....	15
Figure 5 – XML text of the AutomationMLMDIRoleClassLib.....	15
Figure 6 – AutomationMLCMIRoleClassLib .....	18
Figure 7 – XML grid of the AutomationMLCMIRoleClassLib.....	18
Figure 8 – XML text of the AutomationMLCMIRoleClassLib.....	19
Figure 9 – AutomationMLBMRoleClassLib .....	19
Figure 10 – XML grid of the AutomationMLBMRoleClassLib .....	19
Figure 11 – XML text of the AutomationMLBMRoleClassLib .....	19
Figure 12 – AutomationMLCSRolleClassLib .....	20
Figure 13 – XML grid of the AutomationMLCSRolleClassLib .....	21
Figure 14 – XML text of the AutomationMLCSRolleClassLib .....	21
Figure A.1 – AutomationMLExtendedRoleClassLib.....	26
Figure A.2 – Resource structure [SOURCE: IEC 62264-1:2013].....	28
Figure B.1 – Usage of roles in the mapping process .....	39
Figure B.2 – Example for usage of roles .....	40
Figure B.3 – Example AML model .....	40
Figure B.4 – Example InstanceHierarchy for usage of roles .....	41
Figure B.5 – XML grid of the example InstanceHierarchy for usage of roles .....	41
Figure B.6 – XML text of the example InstanceHierarchy for usage of roles .....	41
Figure B.7 – External RoleClassLib reference .....	42
Figure B.8 – Usage of external role class in example .....	42
Figure B.9 – Example SystemUnitClass library for usage of roles .....	43
Figure B.10 – XML grid of the example SystemUnitClass library for usage of roles .....	43
Figure B.11 – XML text of the example SystemUnitClass library for usage of roles .....	43
Figure C.1 – AML user-defined RoleClassLib FoodAndBeverage .....	44
Figure C.2 – Example for external attribute semantics .....	45
 Table 1 – Abbreviations .....	12
Table 2 – Structure of AML role class libraries .....	13
Table 3 – RoleClass DiscManufacturingEquipment .....	16
Table 4 – RoleClass Transport.....	16
Table 5 – RoleClass Storage .....	16
Table 6 – RoleClass Fixture .....	16

Table 7 – RoleClass Gate .....	17
Table 8 – RoleClass Robot .....	17
Table 9 – RoleClass Tool.....	17
Table 10 – RoleClass Carrier .....	17
Table 11 – RoleClass Machine.....	18
Table 12 – RoleClass StaticObject.....	18
Table 13 – RoleClass ContManufacturingEquipment.....	19
Table 14 – RoleClass BatchManufacturingEquipment .....	20
Table 15 – RoleClass ControlEquipment .....	21
Table 16 – RoleClass Communication.....	22
Table 17 – RoleClass ControlHardware .....	22
Table 18 – RoleClass PC .....	22
Table 19 – RoleClass IPC .....	22
Table 20 – RoleClass Handheld .....	23
Table 21 – RoleClass EmbeddedDevice .....	23
Table 22 – RoleClass Sensor.....	23
Table 23 – RoleClass Actuator.....	23
Table 24 – RoleClass Controller .....	23
Table 25 – RoleClass PLC .....	24
Table 26 – RoleClass NC.....	24
Table 27 – RoleClass RC.....	24
Table 28 – RoleClass PAC.....	24
Table A.1 – RoleClass PLCFacet .....	27
Table A.2 – RoleClass HMIFacet .....	27
Table A.3 – RoleClass Enterprise .....	27
Table A.4 – RoleClass Site .....	28
Table A.5 – RoleClass Area .....	29
Table A.6 – RoleClass ProductionLine .....	29
Table A.7 – RoleClass WorkCell .....	29
Table A.8 – RoleClass ProcessCell.....	30
Table A.9 – RoleClass Unit .....	30
Table A.10 – RoleClass ProductionUnit.....	30
Table A.11 – RoleClass StorageZone .....	31
Table A.12 – RoleClass StorageUnit .....	31
Table A.13 – RoleClass Turntable.....	31
Table A.14 – RoleClass Conveyor.....	32
Table A.15 – RoleClass BeltConveyor.....	32
Table A.16 – RoleClass RollConveyor.....	32
Table A.17 – RoleClass ChainConveyor.....	32
Table A.18 – RoleClass PalletConveyor.....	33
Table A.19 – RoleClass OverheadConveyor .....	33
Table A.20 – RoleClass LiftingTable .....	33
Table A.21 – RoleClass AGV .....	33

Table A.22 – RoleClass Transposer .....	34
Table A.23 – RoleClass CarrierHandlingSystem.....	34
Table A.24 – RoleClass BodyStore .....	34
Table A.25 – RoleClass Lift.....	34
Table A.26 – RoleClass Rollerbed .....	35
Table A.27 – RoleClass StationaryTool.....	35
Table A.28 – RoleClass MovableTool.....	35
Table A.29 – RoleClass ControlCabinet .....	35
Table A.30 – RoleClass IODevice .....	36
Table A.31 – RoleClass HMI .....	36
Table A.32 – RoleClass WarningEquipment .....	36
Table A.33 – RoleClass ActuatingDrive.....	36
Table A.34 – RoleClass MotionController.....	37
Table A.35 – RoleClass Panel .....	37
Table A.36 – RoleClass MeasuringEquipment.....	37
Table A.37 – RoleClass Clamp .....	37
Table A.38 – RoleClass ProcessController.....	38
Table A.39 – RoleClass Loader.....	38
Table A.40 – RoleClass Unloader .....	38

## INTERNATIONAL ELECTROTECHNICAL COMMISSION

---

**ENGINEERING DATA EXCHANGE FORMAT FOR USE  
IN INDUSTRIAL AUTOMATION SYSTEMS ENGINEERING –  
AUTOMATION MARKUP LANGUAGE –**
**Part 2: Role class libraries****FOREWORD**

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 62714-2 has been prepared by subcommittee 65E: Devices and integration in enterprise systems, of IEC technical committee 65: Industrial-process measurement, control and automation.

The text of this standard is based on the following documents:

CDV	Report on voting
65E/300/CDV	65E/390/RVC

Full information on the voting for the approval of this standard can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all parts in the IEC 62714 series, published under the general title *Engineering data exchange format for use in industrial automation systems engineering – Automation Markup Language*, can be found on the IEC website.

The committee has decided that the contents of this publication will remain unchanged until the stability date indicated on the IEC website under "<http://webstore.iec.ch>" in the data related to the specific publication. At this date, the publication will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

**IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.**

## INTRODUCTION

The data exchange format defined in IEC 62714 (Automation Markup Language, AML) is an XML schema based data format and has been developed in order to support the data exchange between engineering tools in a heterogeneous engineering tool landscape. IEC 62714-1 gives an overview about the format.


The goal of AML is to interconnect engineering tools from the existing heterogeneous tool landscape in their different disciplines, e.g. mechanical plant engineering, electrical design, process engineering, process control engineering, HMI development, PLC programming, robot programming, etc.

AML stores engineering information following the object oriented paradigm and allows modelling of physical and logical plant components as data objects encapsulating different aspects. An object may consist of other sub-objects and may itself be part of a larger composition or aggregation. Typical objects in plant automation comprise information on topology, geometry, kinematics and logic, whereas logic comprises sequencing, behaviour and control.

AML combines existing industry data formats that are designed for the storage and exchange of different aspects of engineering information. These data formats are used on “as-is” basis within their own specifications and are not branched for AML needs.

The core of AML is the top-level data format CAEX that connects the different data formats. Therefore, AML has an inherent distributed document architecture.

Figure 1 illustrates the basic AML architecture and the distribution of topology, geometry, kinematic and logic information.

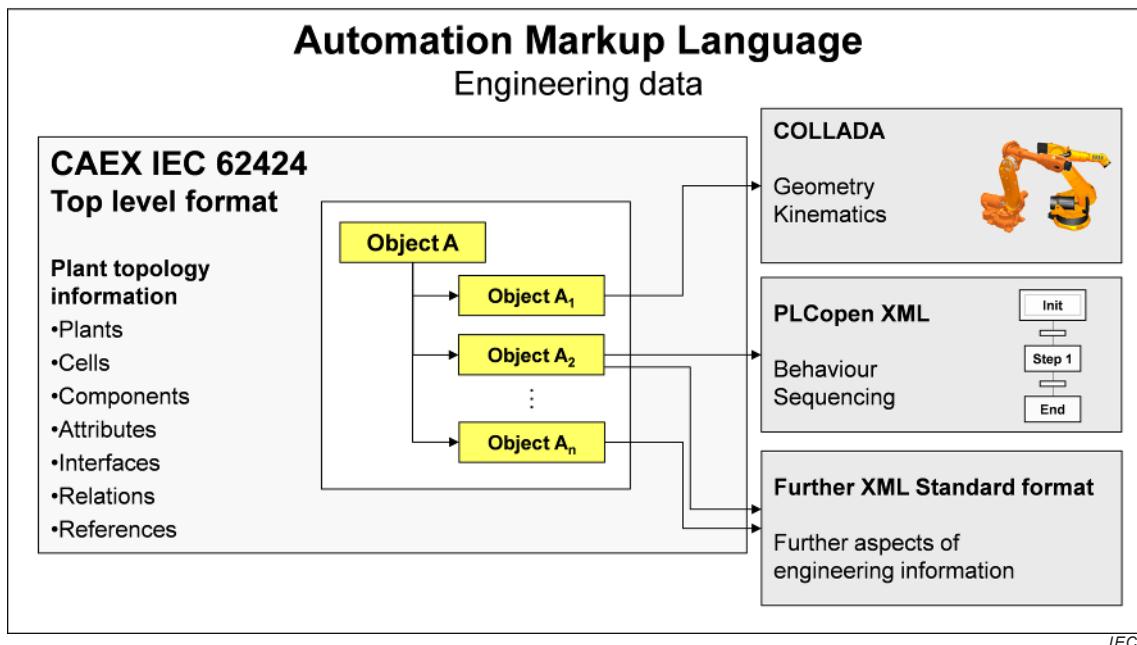

**Figure 1 – Overview of the engineering data exchange format (AML)**

Due to the different aspects of AML, IEC 62714 consists of different parts focussing on different aspects.

- IEC 62714-1: Architecture and general requirements

This part specifies the general AML architecture, the modelling of engineering data, classes, instances, relations, references, hierarchies, basic AML libraries and extended AML concepts.

- IEC 62714-2: Role class libraries

This part specifies additional AML libraries.

- IEC 62714-3<sup>1</sup>: Geometry and kinematics

This forthcoming part is intended to specify the modelling of geometry and kinematics information.

In addition, another part (possibly Part 4) will specify the modelling of logics, sequencing, behaviour and control related information.

Further parts may be added in the future in order to interconnect further data standards to AML.

Clause 5 describes normative role class libraries within AML.

Annex A describes the informative AML extended role class library.

Annex B gives an informative example for the usage of AML role classes.

Annex C shows some user-defined role class libraries of different origins.

Annex D gives an informative XML representation of the libraries defined in this part of IEC 62714.

---

<sup>1</sup> Under consideration.

# ENGINEERING DATA EXCHANGE FORMAT FOR USE IN INDUSTRIAL AUTOMATION SYSTEMS ENGINEERING – AUTOMATION MARKUP LANGUAGE –

## Part 2: Role class libraries

### 1 Scope

The IEC 62714 series specifies an engineering data exchange format for use in industrial automation systems.

This part of IEC 62714 specifies normative as well as informative AML role class libraries for the modelling of engineering information for the exchange between engineering tools in the plant automation area by means of AML. Moreover, it presents additional user defined libraries as an example. Its provisions apply to the export/import applications of related tools.

This part of IEC 62714 does not define details of the data exchange procedure or implementation requirements for the import/export tools.

### 2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 62714-1:2014, *Engineering data exchange format for use in industrial automation systems engineering – Automation Markup Language – Part 1: Architecture and general requirements*

IEC 61360-4, *Standard data element types with associated classification scheme for electric components – Part 4: IEC reference collection of standard data element types and component classes* (available at <http://std.iec.ch/iec61360>)

IEC 62424:2008, *Representation of process control engineering – Requests in P&I diagrams and data exchange between P&ID tools and PCE-CAE tools*

Extensible Markup Language (XML) 1.0:2004, W3C Recommendation (available at <http://www.w3.org/TR/2004/REC-xml-20040204/>)

### 3 Terms, definitions and abbreviations

#### 3.1 Terms and definitions

For the purposes of this document, the terms and definitions given in IEC 62714-1:2014, as well as the following apply.

**3.1.1****robot**

industrial robot

automatically controlled, reprogrammable, multipurpose manipulator, programmable in three or more axes, which can be either fixed in place or mobile for use in industrial automation applications

[SOURCE: ISO 8373:2012, 2.9, modified – the notes have been removed]

**3.1.2****sensor**

unit that detects objects or obstacles in its monitoring range or that is affected by a measurand and which provides an electrical signal or data representing the detection or the measurement

EXAMPLE Limit switch, proximity sensor, pressure transmitter, vibration transducer, strain gauge, photo detector.

**3.1.3****measurand**

particular quantity subject to measurement

[SOURCE: IEC 60050-311:2001, 311-01-03]

**3.1.4****actuator**

functional unit that generates the manipulated variable, required to drive the final controlling element, from the output variable of the controlling element

EXAMPLE Contactor, variable speed drive.

[SOURCE: IEC 60050-351:2013, 351-49-07, modified – the notes, example, and figures have been removed]

## 3.2 Abbreviations

For the purposes of this document the abbreviations given in IEC 62714-1:2014, as well as those given in Table 1, apply.

**Table 1 – Abbreviations**

AGV	Automated guided vehicle
IPC	Industrial PC
NC	Numerical controller
PAC	Programmable automation controller
PC	Personal computer
RC	Robot controller

## 4 Conformity

To claim conformity to this part of IEC 62714 with respect to the support of AML, the requirements of Clause 5 shall be fulfilled.

## 5 AML role classes

### 5.1 Structure and references

Table 2 gives an overview about the AML related role class libraries specified in IEC 62714-1 and this part of IEC 62714.


**Table 2 – Structure of AML role class libraries**

AutomationMLBaseRoleClassLib	IEC 62714-1 – normative
AutomationMLMDMIRoleClassLib	IEC 62714-2 – normative
AutomationMLCMIRoleClassLib	
AutomationMLBMRoleClassLib	
AutomationMLCSRoleClassLib	
AutomationMLExtendedRoleClassLib	IEC 62714-2 – informative
UserDefinedRoleClassLib_RedBookVDMA	IEC 62714-2 – informative, user-defined examples
UserDefinedRoleClassLibCompanySpecificStructure	
UserDefinedRoleClassLib_FoodAndBeverage	
UserDefinedRoleClassLibPandixPCE	
UserDefinedRoleClassLibPandixPPE	

NOTE 1 The concept of role class libraries, especially user-defined role class libraries is described in IEC 62424:2008 and IEC 62714-1:2014, 7.4.

NOTE 2 The role class tree (see Figure 2) does not necessarily reflect the inheritance relations between the classes, but only serves for better readability. The inheritance relation is depicted by the class referenced in curly brackets.

All role class libraries defined in this part of IEC 62714 are based on the AutomationMLBaseRoleClassLib defined in IEC 62714-1:2014 which is shown in Figure 2.

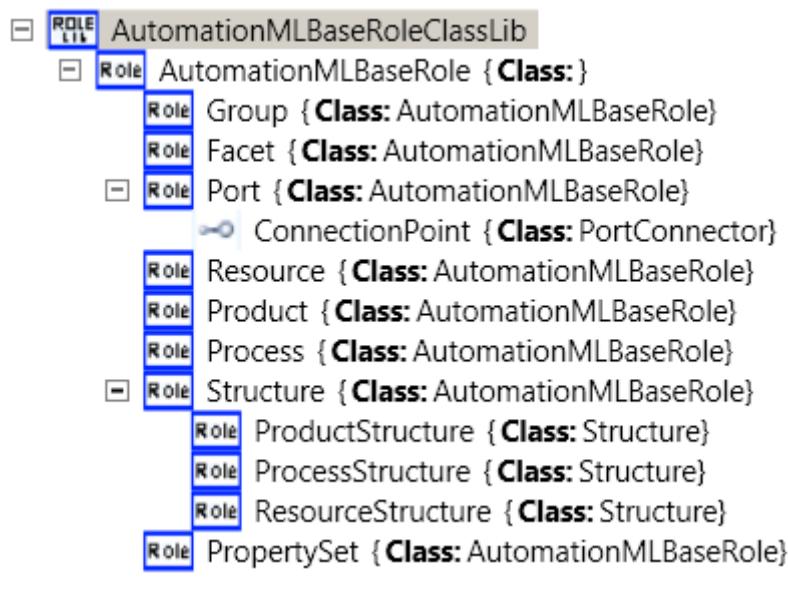

IEC

**Figure 2 – AutomationMLBaseRoleClassLib defined in IEC 62714-1:2014**

Subclause 5.2 defines a normative AML role class library for the discrete manufacturing industry (AutomationMLMDMIRoleClassLib).

NOTE 3 The terms discrete, continuous, and batch manufacturing are used according to IEC 62264-1:2013.

Subclause 5.3 defines a normative AML role class library for the continuous manufacturing industry (AutomationMLCMIRoleClassLib).

Subclause 5.4 defines a normative AML role class library for the batch manufacturing industry (AutomationMLBMIRoleClassLib).

Subclause 5.5 defines a normative AML role class library for the control system (AutomationMLCSRoleClassLib).

Annex A shows an informative AML extended role class library (AutomationMLExtendedRoleClassLib).

Annex B shows an example for the usage of AML role classes.

Annex C shows some exemplary user-defined role class libraries.

As defined in IEC 62714-1:2014, the version of AML is defined in the CAEX element “AdditionalInformation” as child of the CAEXFile root element. The AML version addressed in this document is “2.0”. Additionally, every role class library contains an individual library version which is defined in the CAEX element “Version” of the “RoleClassLib” element.

Role classes in AML can contain attributes according to IEC 62424:2008. The definition of the attribute shall be placed within the CAEX element “Description”. Attributes shall be defined by

- 1) referencing the Component Data Dictionary (IEC 61360-4-DB) or, if not possible,
- 2) referencing existing IEC standards or, if not possible,
- 3) user-defined textual explanations.


## **5.2 AML role class library for discrete manufacturing industry – AutomationMLDMIRoleClassLib**

### **5.2.1 General**

NOTE 1 The version of this AML discrete manufacturing industry role class library is 2.4.0.

Figure 3, Figure 4, and Figure 5 present the normative AutomationMLDMIRoleClassLib as object tree. This library provides a set of basic discrete manufacturing industry related role classes. Details to each role class are given in 5.2.2 to 5.2.11.

NOTE 2 According to IEC 62424:2008, user-defined attributes can be added.

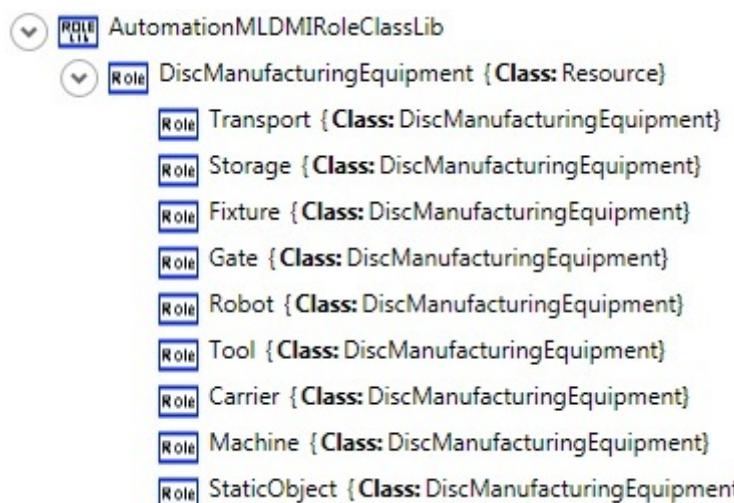

IEC

**Figure 3 – AutomationML MDMIRoleClassLib**

RoleClassLib		
= Name	AutomationML MDMIRoleClassLib	
(*) Description	Automation Markup Language Discrete Manufacturing Industry Role Class Library	
(*) Version	2.4.0	
RoleClass		
= Name	DiscManufacturingEquipment	
= RefBaseClassPa...	AutomationMLBaseRoleClassLib@AutomationMLBaseRoleClassLib/AutomationMLBaseRole/Resource	
RoleClass (9)		
	= Name	= RefBaseClassPath
1	Transport	DiscManufacturingEquipment
2	Storage	DiscManufacturingEquipment
3	Fixture	DiscManufacturingEquipment
4	Gate	DiscManufacturingEquipment
5	Robot	DiscManufacturingEquipment
6	Tool	DiscManufacturingEquipment
7	Carrier	DiscManufacturingEquipment
8	Machine	DiscManufacturingEquipment
9	StaticObject	DiscManufacturingEquipment

IEC

**Figure 4 – XML grid of the AutomationML MDMIRoleClassLib**

```

<RoleClassLib Name="AutomationML MDMIRoleClassLib">
  <Description>Automation Markup Language Discrete Manufacturing Industry Role Class Library</Description>
  <Version>2.4.0</Version>
  <RoleClass Name="DiscManufacturingEquipment" RefBaseClassPath="AutomationMLBaseRoleClassLib@AutomationMLBaseRoleClassLib/AutomationMLBaseRole/Resource">
    <RoleClass Name="Transport" RefBaseClassPath="DiscManufacturingEquipment"/>
    <RoleClass Name="Storage" RefBaseClassPath="DiscManufacturingEquipment"/>
    <RoleClass Name="Fixture" RefBaseClassPath="DiscManufacturingEquipment"/>
    <RoleClass Name="Gate" RefBaseClassPath="DiscManufacturingEquipment"/>
    <RoleClass Name="Robot" RefBaseClassPath="DiscManufacturingEquipment"/>
    <RoleClass Name="Tool" RefBaseClassPath="DiscManufacturingEquipment"/>
    <RoleClass Name="Carrier" RefBaseClassPath="DiscManufacturingEquipment"/>
    <RoleClass Name="Machine" RefBaseClassPath="DiscManufacturingEquipment"/>
    <RoleClass Name="StaticObject" RefBaseClassPath="DiscManufacturingEquipment"/>
  </RoleClass>
</RoleClassLib>
  
```

IEC

**Figure 5 – XML text of the AutomationML MDMIRoleClassLib**

### 5.2.2 RoleClass DiscManufacturingEquipment

Table 3 specifies the role class “DiscManufacturingEquipment”.

**Table 3 – RoleClass DiscManufacturingEquipment**

<b>Class name</b>	DiscManufacturingEquipment
<b>Description</b>	The role class “DiscManufacturingEquipment” shall be used for equipment related to discrete manufacturing industries.
<b>Parent class</b>	AutomationMLBaseRoleClassLib/AutomationMLBaseRole/Resource

### 5.2.3 RoleClass Transport

Table 4 specifies the role class “Transport”.

**Table 4 – RoleClass Transport**

<b>Class name</b>	Transport
<b>Description</b>	The role class “Transport” shall be used for equipment that performs transport processes to transfer items.
<b>Parent class</b>	AutomationMLDMIRoleClassLib/DiscManufacturingEquipment

EXAMPLE Conveyor, turntable, lift/lifter, AGV (automated guided vehicle), band conveyor, roll conveyor, rotating tower, lifting table, crane.

### 5.2.4 RoleClass Storage

Table 5 specifies the role class “Storage”.

**Table 5 – RoleClass Storage**

<b>Class name</b>	Storage
<b>Description</b>	The role class “Storage” shall be used for equipment that is used to buffer products or material temporarily within the plant. It can also be used to feed products or materials into the production process or to export products or materials out of the production process.
<b>Parent class</b>	AutomationMLDMIRoleClassLib/DiscManufacturingEquipment

EXAMPLE Buffer, LCA (low cost automation).

### 5.2.5 RoleClass Fixture

Table 6 specifies the role class “Fixture”.

**Table 6 – RoleClass Fixture**

<b>Class name</b>	Fixture
<b>Description</b>	The role class “Fixture” shall be used for equipment that reduces the degrees of freedom of an item.
<b>Parent class</b>	AutomationMLDMIRoleClassLib/DiscManufacturingEquipment

EXAMPLE Fixing element, clamp, restraint.

### 5.2.6 RoleClass Gate

Table 7 specifies the role class “Gate”.

**Table 7 – RoleClass Gate**

<b>Class name</b>	Gate
<b>Description</b>	The role class “Gate” shall be used for equipment that can block or monitor an entrance, departure, or a passage way.
<b>Parent class</b>	AutomationMLDMIRoleClassLib/DiscManufacturingEquipment

EXAMPLE Safety door, equipment that monitors or controls a transit area.

### 5.2.7 RoleClass Robot

Table 8 specifies the role class “Robot”.

**Table 8 – RoleClass Robot**

<b>Class name</b>	Robot
<b>Description</b>	The role class “Robot” shall be used for robots.
<b>Parent class</b>	AutomationMLDMIRoleClassLib/DiscManufacturingEquipment

### 5.2.8 RoleClass Tool

Table 9 specifies the role class “Tool”.

**Table 9 – RoleClass Tool**

<b>Class name</b>	Tool
<b>Description</b>	The role class “Tool” shall be used for equipment used by resources that is necessary to or aids in the performance of an operation on the product.
<b>Parent class</b>	AutomationMLDMIRoleClassLib/DiscManufacturingEquipment

EXAMPLE Manipulating, controlling, proofing or assembling tool, chisel, welding gun, milling tool.

### 5.2.9 RoleClass Carrier

Table 10 specifies the role class “Carrier”.

**Table 10 – RoleClass Carrier**

<b>Class name</b>	Carrier
<b>Description</b>	The role class “Carrier” shall be used for transport equipment that carries items.
<b>Parent class</b>	AutomationMLDMIRoleClassLib/DiscManufacturingEquipment

EXAMPLE Palette, container, handling aids, skid.

### 5.2.10 RoleClass Machine

Table 11 specifies the role class “Machine”.

**Table 11 – RoleClass Machine**

<b>Class name</b>	Machine
<b>Description</b>	The role class “Machine” shall be used for mechanic or mechatronic equipment that creates added value on products and is designed expressly to perform specific tasks.
<b>Parent class</b>	AutomationMLDMIRoleClassLib/DiscManufacturingEquipment

EXAMPLE Milling machine, welding machine, grinding machine.

### 5.2.11 RoleClass StaticObject

Table 12 specifies the role class “StaticObject”.

**Table 12 – RoleClass StaticObject**

<b>Class name</b>	StaticObject
<b>Description</b>	The role class “StaticObject” shall be used for passive, static items positioned in the production environment.
<b>Parent class</b>	AutomationMLDMIRoleClassLib/DiscManufacturingEquipment

EXAMPLE Fence, jamb.


## 5.3 AML role class library for continuous manufacturing industry – AutomationMLCMIRoleClassLib

### 5.3.1 General

NOTE 1 The version of this AML continuous manufacturing industry role class library is 1.1.0.

Figure 6, Figure 7 and Figure 8 present the normative AutomationMLCMIRoleClassLib as object tree. Role classes of continuous manufacturing industry shall be derived directly or indirectly from an element of this library.

NOTE 2 User-defined attributes can be added.

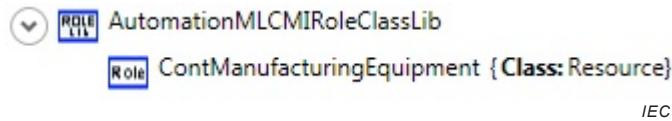**Figure 6 – AutomationMLCMIRoleClassLib**

<b>RoleClassLib</b>
= Name AutomationMLCMIRoleClassLib
⌚ Description Automation Markup Language Continuous Manufacturing Industry Role Class Library
⌚ Version 1.1.0
<b>RoleClass</b>
= Name ContManufacturingEquipment
= RefBaseClassPa... AutomationMLBaseRoleClassLib@AutomationMLBaseRoleClassLib/AutomationMLBaseRole/Resource

IEC

**Figure 7 – XML grid of the AutomationMLCMIRoleClassLib**

```
<RoleClassLib Name="AutomationMLCMIRoleClassLib">
  <Description>Automation Markup Language Continuous Manufacturing Industry Role Class Library</Description>
  <Version>1.1.0</Version>
  <RoleClass Name="ContManufacturingEquipment" RefBaseClassPath="AutomationMLBaseRoleClassLib@AutomationMLBaseRoleClassLib/AutomationMLBaseRole/Resource" />
</RoleClassLib>
```

IEC

**Figure 8 – XML text of the AutomationMLCMIRoleClassLib**

### 5.3.2 RoleClass ContManufacturingEquipment

Table 13 specifies the role class “ContManufacturingEquipment”.

**Table 13 – RoleClass ContManufacturingEquipment**

<b>Class name</b>	ContManufacturingEquipment
<b>Description</b>	The role class “ContManufacturingEquipment” shall be used for equipment related to continuous manufacturing.
<b>Parent class</b>	AutomationMLBaseRoleClassLib/AutomationMLBaseRole/Resource


## 5.4 AML role class library for batch manufacturing industry – AutomationMLBMRoleClassLib

### 5.4.1 General

NOTE 1 The version of this AML batch manufacturing industry role class library is 1.1.0.

Figure 9, Figure 10 and Figure 11 present the normative AutomationMLBMRoleClassLib as object tree. Role classes of batch manufacturing industry shall be derived directly or indirectly from an element of this library.

NOTE 2 User-defined attributes can be added.

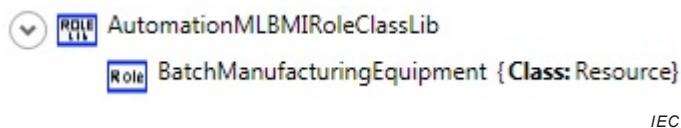

IEC

**Figure 9 – AutomationMLBMRoleClassLib**

▲ RoleClassLib	
= Name	AutomationMLBMRoleClassLib
() Description	Automation Markup Language Batch Manufacturing Industry Role Class Library
() Version	1.1.0
▲ RoleClass	
= Name	BatchManufacturingEquipment
= RefBaseClassPa...	AutomationMLBaseRoleClassLib@AutomationMLBaseRoleClassLib/AutomationMLBaseRole/Resource

IEC

**Figure 10 – XML grid of the AutomationMLBMRoleClassLib**

```
<RoleClassLib Name="AutomationMLBMRoleClassLib">
  <Description>Automation Markup Language Batch Manufacturing Industry Role Class Library</Description>
  <Version>1.1.0</Version>
  <RoleClass Name="BatchManufacturingEquipment" RefBaseClassPath="AutomationMLBaseRoleClassLib@AutomationMLBaseRoleClassLib/AutomationMLBaseRole/Resource" />
</RoleClassLib>
```

IEC

**Figure 11 – XML text of the AutomationMLBMRoleClassLib**

### 5.4.2 RoleClass BatchManufacturingEquipment

Table 14 specifies the role class “BatchManufacturingEquipment”.

**Table 14 – RoleClass BatchManufacturingEquipment**

<b>Class name</b>	BatchManufacturingEquipment
<b>Description</b>	The role class “BatchManufacturingEquipment” shall be used for equipment related to batch manufacturing .
<b>Parent class</b>	AutomationMLBaseRoleClassLib/AutomationMLBaseRole/Resource


## 5.5 AML role class library for control systems – AutomationMLCSRoleClassLib

### 5.5.1 General

NOTE 1 The version of this AML control system role class library is 2.3.0.

Figure 12, Figure 13, and Figure 14 present the AutomationMLCSRoleClassLib as object tree, XML grid and XML text. Details to each role class are given in 5.5.2 to 5.5.15.

NOTE 2 User-defined attributes can be added.

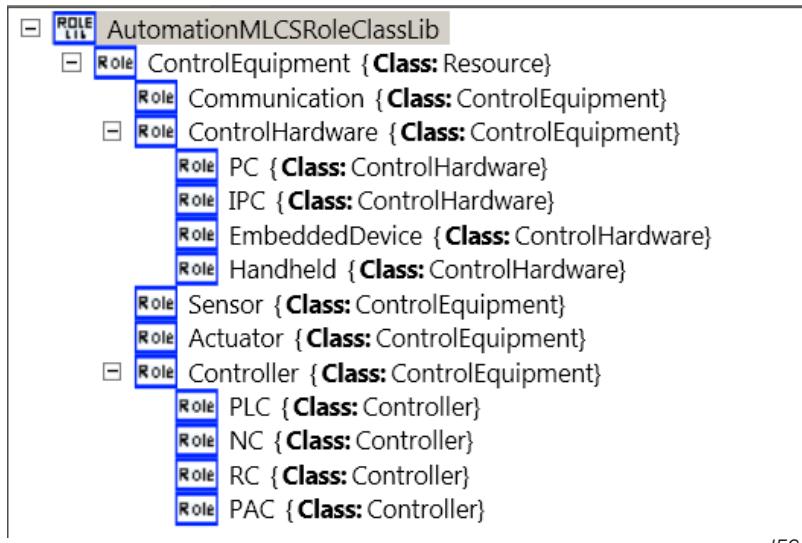

IEC

**Figure 12 – AutomationMLCSRoleClassLib**

<b>RoleClassLib</b>			
= Name	AutomationMLCSRoleClassLib		
⌚ Description	Automation Markup Language Control Industry Role Class Library		
⌚ Version	2.3.0		
<b>RoleClass</b>			
= Name	ControlEquipment		
= RefBaseClassPath	AutomationMLBaseRoleClassLib@AutomationMLBaseRoleClassLib/AutomationMLBaseRole/Resource		
<b>RoleClass (5)</b>			
	= Name	= RefBaseClassPath	⌚ RoleClass
1	Communication	ControlEquipment	
2	ControlHardware	ControlEquipment	<b>RoleClass (4)</b>
			<b>RoleClass (4)</b>
	= Name	= RefBaseClassPath	
1	PC	ControlHardware	
2	IPC	ControlHardware	
3	EmbeddedDevice	ControlHardware	
4	Handheld	ControlHardware	
3	Sensor	ControlEquipment	
4	Actuator	ControlEquipment	
5	Controller	ControlEquipment	<b>RoleClass (4)</b>
	= Name	= RefBaseClassPath	
1	PLC	Controller	
2	NC	Controller	
3	RC	Controller	
4	PAC	Controller	

IEC

**Figure 13 – XML grid of the AutomationMLCSRoleClassLib**

```

<RoleClassLib Name="AutomationMLCSRoleClassLib">
  <Description>Automation Markup Language Control Industry Role Class Library</Description>
  <Version>2.3.0</Version>
  <RoleClass Name="ControlEquipment" RefBaseClassPath="AutomationMLBaseRoleClassLib@AutomationMLBaseRoleClassLib/AutomationMLBaseRole/Resource">
    <RoleClass Name="Communication" RefBaseClassPath="ControlEquipment" />
    <RoleClass Name="ControlHardware" RefBaseClassPath="ControlEquipment" />
    <RoleClass Name="PC" RefBaseClassPath="ControlHardware" />
    <RoleClass Name="IPC" RefBaseClassPath="ControlHardware" />
    <RoleClass Name="EmbeddedDevice" RefBaseClassPath="ControlHardware" />
    <RoleClass Name="Handheld" RefBaseClassPath="ControlHardware" />
  </RoleClass>
  <RoleClass Name="Sensor" RefBaseClassPath="ControlEquipment" />
  <RoleClass Name="Actuator" RefBaseClassPath="ControlEquipment" />
  <RoleClass Name="Controller" RefBaseClassPath="ControlEquipment" />
    <RoleClass Name="PLC" RefBaseClassPath="Controller" />
    <RoleClass Name="NC" RefBaseClassPath="Controller" />
    <RoleClass Name="RC" RefBaseClassPath="Controller" />
    <RoleClass Name="PAC" RefBaseClassPath="Controller" />
  </RoleClass>
</RoleClass>
</RoleClassLib>

```

IEC

**Figure 14 – XML text of the AutomationMLCSRoleClassLib**

### 5.5.2 RoleClass ControlEquipment

Table 15 specifies the role class “ControlEquipment”.

**Table 15 – RoleClass ControlEquipment**

<b>Class name</b>	ControlEquipment
<b>Description</b>	The role class “ControlEquipment” shall be used for equipment related to a control system. ControlEquipment can be used for every type of industry.
<b>Parent class</b>	AutomationMLBaseRoleClassLib/AutomationMLBaseRole/Resource

### 5.5.3 RoleClass Communication

Table 16 specifies the role class “Communication”.

**Table 16 – RoleClass Communication**

<b>Class name</b>	Communication
<b>Description</b>	The role class “Communication” shall be used for items dedicated to communication.
<b>Parent class</b>	AutomationMLCSRoleClassLib/ControlEquipment

### 5.5.4 RoleClass ControlHardware

Table 17 specifies the role class “ControlHardware”.

**Table 17 – RoleClass ControlHardware**

<b>Class name</b>	ControlHardware
<b>Description</b>	The role class “ControlHardware” shall be used for hardware that provides runtime environments.
<b>Parent class</b>	AutomationMLCSRoleClassLib/ControlEquipment

### 5.5.5 RoleClass PC

Table 18 specifies the role class “PC”.

**Table 18 – RoleClass PC**

<b>Class name</b>	PC
<b>Description</b>	The role class “PC” shall be used for any general-purpose computer that provides runtime environments for software being executed on it.
<b>Parent class</b>	AutomationMLCSRoleClassLib/ControlEquipment/ControlHardware

### 5.5.6 RoleClass IPC

Table 19 specifies the role class “IPC”.

**Table 19 – RoleClass IPC**

<b>Class name</b>	IPC
<b>Description</b>	The role class “IPC” shall be used for any PC-based computing platform for industrial applications that provides runtime environments for software being executed on it.
<b>Parent class</b>	AutomationMLCSRoleClassLib/ControlEquipment/ControlHardware

### 5.5.7 RoleClass Handheld

Table 20 specifies the role class “Handheld”.

**Table 20 – RoleClass Handheld**

<b>Class name</b>	Handheld
<b>Description</b>	The role class “Handheld” shall be used for any portable, programmable, electronic device with an own power supply for particular applications.
<b>Parent class</b>	AutomationMLCSRoleClassLib/ControlEquipment/ControlHardware

**5.5.8 RoleClass EmbeddedDevice**

Table 21 specifies the role class “EmbeddedDevice”.

**Table 21 – RoleClass EmbeddedDevice**

<b>Class name</b>	EmbeddedDevice
<b>Description</b>	The role class “EmbeddedDevice” shall be used for any device designed to perform one or a few dedicated software functions. It is embedded as part of another device often including hardware and mechanical parts.
<b>Parent class</b>	AutomationMLCSRoleClassLib/ControlEquipment/ControlHardware

**5.5.9 RoleClass Sensor**

Table 22 specifies the role class “Sensor”.

**Table 22 – RoleClass Sensor**

<b>Class name</b>	Sensor
<b>Description</b>	The role class “Sensor” shall be used for sensors.
<b>Parent class</b>	AutomationMLCSRoleClassLib/ControlEquipment

**5.5.10 RoleClass Actuator**

Table 23 specifies the role class “Actuator”.

**Table 23 – RoleClass Actuator**

<b>Class name</b>	Actuator
<b>Description</b>	The role class “Actuator” shall be used for actuators.
<b>Parent class</b>	AutomationMLCSRoleClassLib/ControlEquipment

**5.5.11 RoleClass Controller**

Table 24 specifies the role class “Controller”.

**Table 24 – RoleClass Controller**

<b>Class name</b>	Controller
<b>Description</b>	The role class “Controller” shall be used for self-acting functionalities that process signals according to a predefined logic and generate output signals in order to reach an intended behaviour of technical processes.
<b>Parent class</b>	AutomationMLCSRoleClassLib/ControlEquipment

NOTE Controller functionalities can be realized by software or hardware.

### 5.5.12 RoleClass PLC

Table 25 specifies the role class “PLC”.

**Table 25 – RoleClass PLC**

<b>Class name</b>	PLC
<b>Description</b>	The role class “PLC” shall be used for programmable control functionality focusing the processing of signals.
<b>Parent class</b>	AutomationMLCSRoleClassLib/ControlEquipment/Controller

NOTE PLC functionality can be realized by software or hardware.

### 5.5.13 RoleClass NC

Table 26 specifies the role class “NC”.

**Table 26 – RoleClass NC**

<b>Class name</b>	NC
<b>Description</b>	The role class “NC” shall be used for programmable control functionality focusing the processing of numerical signals.
<b>Parent class</b>	AutomationMLCSRoleClassLib/ControlEquipment/Controller

NOTE NC functionality can be realized by software or hardware.

### 5.5.14 RoleClass RC

Table 27 specifies the role class “RC”.

**Table 27 – RoleClass RC**

<b>Class name</b>	RC
<b>Description</b>	The role class “RC” shall be used for programmable control functionality driving robots in order to reach an intended behaviour of the robot kinematic system and corresponding connected periphery.
<b>Parent class</b>	AutomationMLCSRoleClassLib/ControlEquipment/Controller

NOTE RC functionality can be realized by software or hardware.

### 5.5.15 RoleClass PAC

Table 28 specifies the role class “PAC”.

**Table 28 – RoleClass PAC**

<b>Class name</b>	PAC
<b>Description</b>	The role class “PAC” shall be used for programmable automation functionality focusing on cross-domain functionality like binary, motion and continuous control.
<b>Parent class</b>	AutomationMLCSRoleClassLib/ControlEquipment/Controller

NOTE PAC functionality can be realized by software or hardware.


**Annex A**  
(informative)**AML extended role class library****A.1 General**

The AutomationMLExtendedRoleClassLibrary is a recommended extension of the AutomationMLBaseRoleClassLib and the AutomationMLDMIRoleClassLib and covers a wide area of typical roles of the discrete manufacturing industry.

Figure A.1 presents the AutomationMLExtendedRoleClassLib as object tree.

NOTE 1 The version of this AML extended role class library is 2.7.0.

NOTE 2 According to IEC 62424:2008, user-defined attributes can be added.

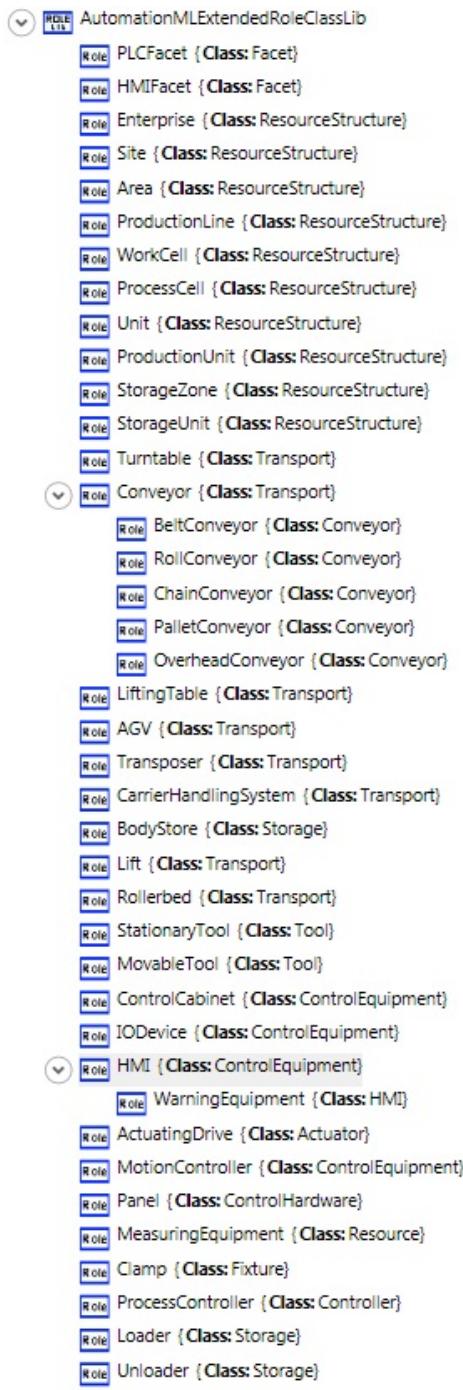

IEC

**Figure A.1 – AutomationMLExtendedRoleClassLib**

## A.2 RoleClass PLCFacet

Table A.1 specifies the role class “PLCFacet”.

**Table A.1 – RoleClass PLCFacet**

<b>Class name</b>	PLCFacet
<b>Description</b>	The role class “PLCFacet” should be used to model separate views concerning everything involved in PLC control code generators: PLC view on AML objects which points to information concerning PLC.
<b>Parent class</b>	AutomationMLBaseRoleClassLib/AutomationMLBaseRole/Facet

### A.3 RoleClass HMIFacet

Table A.2 specifies the role class “HMIFacet”.

**Table A.2 – RoleClass HMIFacet**


<b>Class name</b>	HMIFacet
<b>Description</b>	The role class “HMIFacet” should be used to model separate views concerning everything involved in HMI: HMI view on AML objects which points to information concerning HMI.
<b>Parent class</b>	AutomationMLBaseRoleClassLib/AutomationMLBaseRole/Facet

### A.4 RoleClass Enterprise

Table A.3 specifies the role class “Enterprise”. Figure A.2 illustrates the structure defined in IEC 62264-1:2013.

**Table A.3 – RoleClass Enterprise**

<b>Class name</b>	Enterprise
<b>Description</b>	The role class “Enterprise” should be used for business structures. The definition of an “Enterprise” is given in IEC 62264-1:2013, 5.3.2:  “An enterprise is a collection of sites and areas and represents the top level of a role-based equipment hierarchy. The enterprise is responsible for determining what products will be manufactured, at which sites they will be manufactured, and in general how they will be manufactured.”
<b>Parent class</b>	AutomationMLBaseRoleClassLib/AutomationMLBaseRole/Structure/ResourceStructure

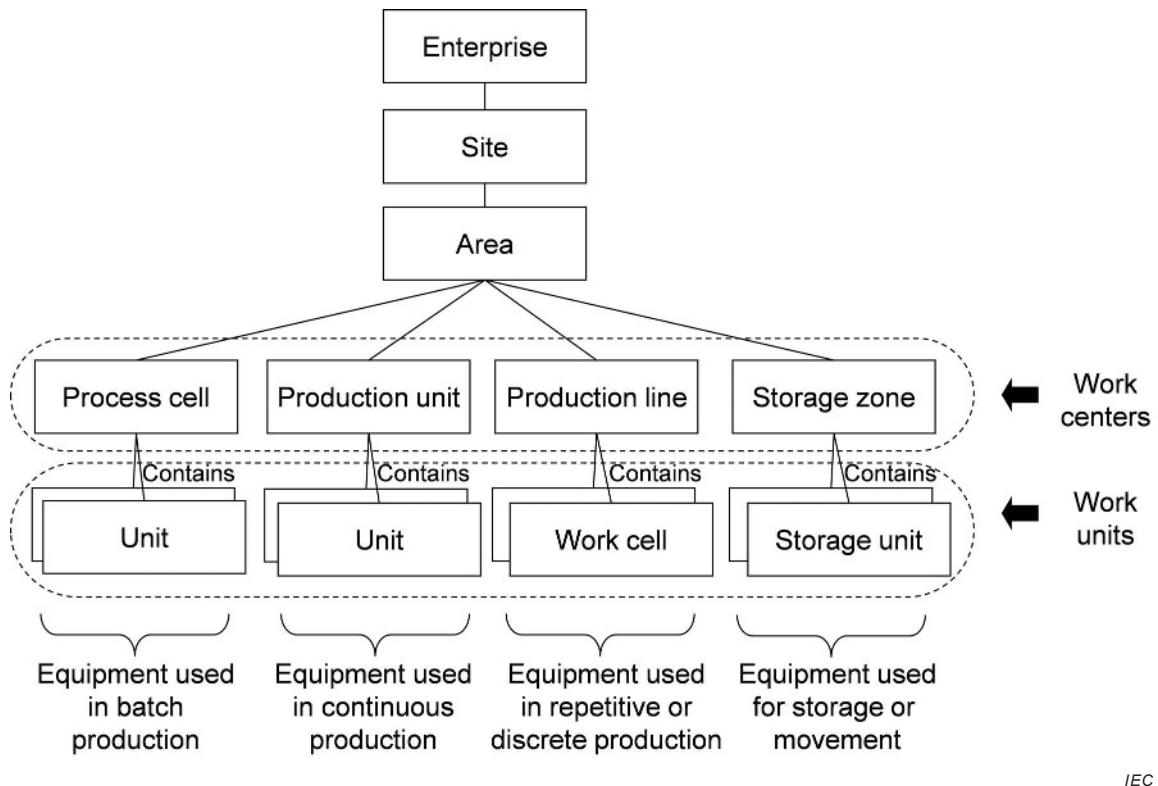**Figure A.2 – Resource structure [SOURCE: IEC 62264-1:2013]**

## A.5 RoleClass Site

Table A.4 specifies the role class “Site”.

**Table A.4 – RoleClass Site**

Class name	Site
Description	<p>The role class “Site” should be used for the position determination of a site. It is also used as element of a hierarchical organisation.</p> <p>The definition of a “Site” is given in IEC 62264-1:2013, 5.3.3:</p> <p>“A site is a physical, geographical, or logical grouping determined by the enterprise. It may contain areas, production lines, process cells, and production units.”</p>
Parent class	AutomationMLBaseRoleClassLib/AutomationMLBaseRole/Structure/ResourceStructure

EXAMPLE Plant, manufacturing facility.

## A.6 RoleClass Area

Table A.5 specifies the role class “Area”.

**Table A.5 – RoleClass Area**

<b>Class name</b>	Area
<b>Description</b>	<p>The role class “Area” should be used for production buildings and their subdivisions (structure/hall). It is also used as element of a hierarchical organisation.</p> <p>The definition of an “Area” is given in IEC 62264-1:2013, 5.3.4:</p> <p>“An area is a physical, geographical, or logical grouping determined by the site. It may contain work centers such as process cells, production units, production lines, and storage zones.”</p>
<b>Parent class</b>	AutomationMLBaseRoleClassLib/AutomationMLBaseRole/Structure/ResourceStructure

EXAMPLE A hall.

## A.7 RoleClass ProductionLine

Table A.6 specifies the role class “ProductionLine”.

**Table A.6 – RoleClass ProductionLine**

<b>Class name</b>	ProductionLine
<b>Description</b>	<p>The role class “ProductionLine” should be used for defining the role based equipment hierarchy defined in IEC 62264-1:2013, 5.3.7, for discrete manufacturing at the work cell level:</p> <p>“Production lines and work cells are the lowest levels of equipment ... for discrete manufacturing processes. Work cells are usually only identified when there is flexibility in the routing of work within a production line. Production lines and work cells may be composed of lower-level elements.... The major processing activity often identifies the production line.”</p>
<b>Parent class</b>	AutomationMLBaseRoleClassLib/AutomationMLBaseRole/Structure/ResourceStructure

## A.8 RoleClass WorkCell

Table A.7 specifies the role class “WorkCell”.

**Table A.7 – RoleClass WorkCell**

<b>Class name</b>	WorkCell
<b>Description</b>	<p>The role class “WorkCell” should be used for defining the role based equipment hierarchy defined in IEC 62264-1:2013 at the work cell level:</p> <p>for sub units/sub production steps of units/production lines, stations, processes single components, cycle, location in which the production step takes place. It is used for hierarchization.</p> <p>The definition of a “WorkCell” is given in IEC 62264-1:2013, 5.3.7:</p> <p>“Production lines and work cells are the lowest levels of equipment ... for discrete manufacturing processes. Work cells are usually only identified when there is flexibility in the routing of work within a production line. Production lines and work cells may be composed of lower-level elements.... The major processing activity often identifies the production line.”</p>
<b>Parent class</b>	AutomationMLBaseRoleClassLib/AutomationMLBaseRole/Structure/ResourceStructure

## A.9 RoleClass ProcessCell

Table A.8 specifies the role class “ProcessCell”.

**Table A.8 – RoleClass ProcessCell**

<b>Class name</b>	ProcessCell
<b>Description</b>	The role class “ProcessCell” should be used for sub units/sub production steps of units/production lines, station, processes single component, cycle, location in which the production step takes place. It is used for hierarchization.  The definition of a “ProcessCell” is given in IEC 62264-1:2013, 5.3.8:  “Process cells and units are the lowest level of ... batch manufacturing processes. .... The major processing capability or family of products produced often identifies the process cell.”
<b>Parent class</b>	AutomationMLBaseRoleClassLib/AutomationMLBaseRole/Structure/ResourceStructure

## A.10 RoleClass Unit

Table A.9 specifies the role class “Unit”.

**Table A.9 – RoleClass Unit**

<b>Class name</b>	Unit
<b>Description</b>	The role class “Unit” should be used for linked chained production plants. It is used for hierarchization.  The definition of a “Unit” is given in IEC 62264-1:2013, 5.3.8:  “Process cells and units are the lowest level of equipment ... for batch manufacturing processes. .... The major processing capability or family of products produced often identifies the process cell.”
<b>Parent class</b>	AutomationMLBaseRoleClassLib/AutomationMLBaseRole/Structure/ResourceStructure

## A.11 RoleClass ProductionUnit

Table A.10 specifies the role class “ProductionUnit”.

**Table A.10 – RoleClass ProductionUnit**

<b>Class name</b>	ProductionUnit
<b>Description</b>	The role class “ProductionUnit” should be used for sub units/sub production steps of units/production lines, station, processes single component, cycle, location in which the production step takes place. It is used for hierarchization.  The definition of a “ProductionUnit” is given in IEC 62264-1:2013, 5.3.6:  “Production units and units are the lowest level of equipment ... for continuous manufacturing processes. Production units are composed of units and units are composed lower level elements, such as equipment modules, sensors, and actuators.... A production unit generally encompasses all of the equipment required for a segment of continuous production that operates in a relatively autonomous manner. It generally converts, separates, or reacts one or more feed stocks to produce intermediate or final products. The major processing activity or product generated often identifies the production unit.”
<b>Parent class</b>	AutomationMLBaseRoleClassLib/AutomationMLBaseRole/Structure/ResourceStructure

## A.12 RoleClass StorageZone

Table A.11 specifies the role class “StorageZone”.

**Table A.11 – RoleClass StorageZone**

<b>Class name</b>	StorageZone
<b>Description</b>	<p>The role class “StorageZone” should be used for defining the role based equipment hierarchy defined in IEC 62264-1:2013 at the storage zone level:</p> <p>The definition of a “StorageZone” is given in IEC 62264-1: 2013, 5.3.9:</p> <p>“Storage zones and storage units are the lowest level of material movement equipment ... for discrete, batch and continuous manufacturing processes. A storage zone is a type of work center and a storage unit is a type of work unit that is organized as elements within an area. These are the lower-level elements of an equipment hierarchy used in material storage and movement activities. A storage zone typically has the capability needed for the receipt, storage, retrieval, movement and shipment of materials. This may include the movement of materials from one work center to another work center within or between enterprises.”</p>
<b>Parent class</b>	AutomationMLBaseRoleClassLib/AutomationMLBaseRole/Structure/ResourceStructure

EXAMPLE Warehouse, tank farm, holding area.

### A.13 RoleClass StorageUnit

Table A.12 specifies the role class “StorageUnit”.

**Table A.12 – RoleClass StorageUnit**

<b>Class name</b>	StorageUnit
<b>Description</b>	<p>The role class “StorageUnit” should be used for defining the role based equipment hierarchy defined in IEC 62264-1:2013 at the storage unit level:</p> <p>The definition of a “StorageUnit” is given in IEC 62264-1: 2013, 5.3.9:</p> <p>“Storage zones and storage units are the lowest level of material movement equipment ... for discrete, batch and continuous manufacturing processes. A storage zone is a type of work center and a storage unit is a type of work unit that is organized as elements within an area. These are the lower-level elements of an equipment hierarchy used in material storage and movement activities. A storage zone typically has the capability needed for the receipt, storage, retrieval, movement and shipment of materials. This may include the movement of materials from one work center to another work center within or between enterprises.”</p>
<b>Parent class</b>	AutomationMLBaseRoleClassLib/AutomationMLBaseRole/Structure/ResourceStructure

EXAMPLE Rack, bin, slot, tank, pallet, barrel.

### A.14 RoleClass Turntable

Table A.13 specifies the role class “Turntable”.

**Table A.13 – RoleClass Turntable**

<b>Class name</b>	Turntable
<b>Description</b>	The role class “Turntable” should be used for rotating transport equipment which changes the horizontal transport direction of a product and/or carrier.
<b>Parent class</b>	AutomationMLDMIRoleClassLib/DiscManufacturingEquipment/Transport

### A.15 RoleClass Conveyor

Table A.14 specifies the role class “Conveyor”.

**Table A.14 – RoleClass Conveyor**

<b>Class name</b>	Conveyor
<b>Description</b>	The role class “Conveyor” should be used for generic equipment which performs linear transport.
<b>Parent class</b>	AutomationMLDMIRoleClassLib/DiscManufacturingEquipment/Transport

EXAMPLE Transport with start and stop points and without branching points.

### A.16 RoleClass BeltConveyor

Table A.15 specifies the role class “BeltConveyor”.

**Table A.15 – RoleClass BeltConveyor**

<b>Class name</b>	BeltConveyor
<b>Description</b>	The role class “BeltConveyor” should be used for equipment which performs linear transport realized by one or more belts as transport platform.
<b>Parent class</b>	AutomationMLExtendedRoleClassLib/Conveyor

### A.17 RoleClass RollConveyor

Table A.16 specifies the role class “RollConveyor”.

**Table A.16 – RoleClass RollConveyor**

<b>Class name</b>	RollConveyor
<b>Description</b>	The role class “RollConveyor” should be used for equipment which performs linear transport realized by a sequence of rolls as transport platform.
<b>Parent class</b>	AutomationMLExtendedRoleClassLib/Conveyor

### A.18 RoleClass ChainConveyor

Table A.17 specifies the role class “ChainConveyor”.

**Table A.17 – RoleClass ChainConveyor**

<b>Class name</b>	ChainConveyor
<b>Description</b>	The role class “ChainConveyor” should be used for equipment which performs linear transport driven by an endless chain as transport medium.
<b>Parent class</b>	AutomationMLExtendedRoleClassLib/Conveyor

### A.19 RoleClass PalletConveyor

Table A.18 specifies the role class “PalletConveyor”.

**Table A.18 – RoleClass PalletConveyor**

<b>Class name</b>	PalletConveyor
<b>Description</b>	The role class “PalletConveyor” should be used for equipment which is especially designed for linear transport of pallets.
<b>Parent class</b>	AutomationMLExtendedRoleClassLib/Conveyor

## A.20 RoleClass OverheadConveyor

Table A.19 specifies the role class “OverheadConveyor”.

**Table A.19 – RoleClass OverheadConveyor**

<b>Class name</b>	OverheadConveyor
<b>Description</b>	The role class “OverheadConveyor” should be used for equipment that performs overhead transport of hanging products or carriers.
<b>Parent class</b>	AutomationMLExtendedRoleClassLib/Conveyor

## A.21 RoleClass LiftingTable

Table A.20 specifies the role class “LiftingTable”.

**Table A.20 – RoleClass LiftingTable**

<b>Class name</b>	LiftingTable
<b>Description</b>	The role class “LiftingTable” should be used for equipment that performs discrete vertical transport. The transport medium is also lifted. Normally used for minor heights.
<b>Parent class</b>	AutomationMLDMIRoleClassLib/DiscManufacturingEquipment/Transport

## A.22 RoleClass AGV

Table A.21 specifies the role class “AGV”.

**Table A.21 – RoleClass AGV**

<b>Class name</b>	AGV
<b>Description</b>	The role class “AGV” should be used for equipment that performs automated transportation of discrete units independent of other transport equipment.
<b>Parent class</b>	AutomationMLDMIRoleClassLib/DiscManufacturingEquipment/Transport

## A.23 RoleClass Transposer

Table A.22 specifies the role class “Transposer”.

**Table A.22 – RoleClass Transposer**

<b>Class name</b>	Transposer
<b>Description</b>	The role class “Transposer” should be used for transport equipment that performs the change of the transport medium. Changes the classification or relation of product to the carrier (one to another).
<b>Parent class</b>	AutomationMLDMIRoleClassLib/DiscManufacturingEquipment/Transport

**A.24 RoleClass CarrierHandlingSystem**

Table A.23 specifies the role class “CarrierHandlingSystem”.

**Table A.23 – RoleClass CarrierHandlingSystem**

<b>Class name</b>	CarrierHandlingSystem
<b>Description</b>	The role class “CarrierHandlingSystem” should be used for equipment that performs an action to the carrier.
<b>Parent class</b>	AutomationMLDMIRoleClassLib/DiscManufacturingEquipment/Transport

EXAMPLE Forklift.

**A.25 RoleClass BodyStore**

Table A.24 specifies the role class “BodyStore”.

**Table A.24 – RoleClass BodyStore**

<b>Class name</b>	BodyStore
<b>Description</b>	The role class “BodyStore” should be used for buffering discrete products.
<b>Parent class</b>	AutomationMLDMIRoleClassLib/DiscManufacturingEquipment/Storage

EXAMPLE Body buffer.

**A.26 RoleClass Lift**

Table A.25 specifies the role class “Lift”.

**Table A.25 – RoleClass Lift**

<b>Class name</b>	Lift
<b>Description</b>	The role class “Lift” should be used for equipment that performs discrete vertical transport. Normally used for larger heights.
<b>Parent class</b>	AutomationMLDMIRoleClassLib/DiscManufacturingEquipment/Transport

EXAMPLE Lifter.

**A.27 RoleClass Rollerbed**

Table A.26 specifies the role class “Rollerbed”.

**Table A.26 – RoleClass Rollerbed**

<b>Class name</b>	Rollerbed
<b>Description</b>	The role class “Rollerbed” should be used for a sequence of rolls. None of these rolls are driven.
<b>Parent class</b>	AutomationMLDMIRoleClassLib/DiscManufacturingEquipment/Transport

**A.28 RoleClass StationaryTool**

Table A.27 specifies the role class “StationaryTool”.

**Table A.27 – RoleClass StationaryTool**

<b>Class name</b>	StationaryTool
<b>Description</b>	The role class “StationaryTool” should be used for tools fixed at one place.
<b>Parent class</b>	AutomationMLDMIRoleClassLib/DiscManufacturingEquipment/Tool

**A.29 RoleClass MovableTool**

Table A.28 specifies the role class “MovableTool”.

**Table A.28 – RoleClass MovableTool**

<b>Class name</b>	MovableTool
<b>Description</b>	The role class “MovableTool” should be used for tools which can be moved by equipment e.g. robots.
<b>Parent class</b>	AutomationMLDMIRoleClassLib/DiscManufacturingEquipment/Tool

**A.30 RoleClass ControlCabinet**

Table A.29 specifies the role class “ControlCabinet”.

**Table A.29 – RoleClass ControlCabinet**

<b>Class name</b>	ControlCabinet
<b>Description</b>	The role class “ControlCabinet” should be used for enclosed electrical and/or electronic assembly.
<b>Parent class</b>	AutomationMLCSRoleClassLib/ControlEquipment

EXAMPLE Switch cabinet, control box.

**A.31 RoleClass IODevice**

Table A.30 specifies the role class “IODevice”.

**Table A.30 – RoleClass IODevice**

<b>Class name</b>	IODevice
<b>Description</b>	The role class “IODevice” should be used for devices providing the functionality to connect sensors or actuators with an automation system. IODevice can consist of different modules.
<b>Parent class</b>	AutomationMLCSRoleClassLib/ControlEquipment

EXAMPLE Device consisting of analog/digital input/output modules.

### A.32 RoleClass HMI

Table A.31 specifies the role class “HMI”.

**Table A.31 – RoleClass HMI**

<b>Class name</b>	HMI
<b>Description</b>	The role class “HMI” should be used for the functionality to visualize an industrial control and monitoring system for the effective operation and control of the machine by humans.
<b>Parent class</b>	AutomationMLCSRoleClassLib/ControlEquipment

### A.33 RoleClass WarningEquipment

Table A.32 specifies the role class “WarningEquipment”.

**Table A.32 – RoleClass WarningEquipment**

<b>Class name</b>	WarningEquipment
<b>Description</b>	The role class “WarningEquipment” should be used for equipment providing warning functionality. NOTE The functionality can be realized in auditive, visual, haptic or other way.
<b>Parent class</b>	AutomationMLExtendedRoleClassLib/HMI

EXAMPLE Horn, signal light, vibration, siren, signal lamp.

### A.34 RoleClass ActuatingDrive

Table A.33 specifies the role class “ActuatingDrive”.

**Table A.33 – RoleClass ActuatingDrive**

<b>Class name</b>	ActuatingDrive
<b>Description</b>	The role class “ActuatingDrive” should be used for physical units used for driving mechanically actuated final controlling elements.
<b>Parent class</b>	AutomationMLCSRoleClassLib/ControlEquipment/Actuator

EXAMPLE Electric, hydraulic, pneumatic drive.

### A.35 RoleClass MotionController

Table A.34 specifies the role class “MotionController”.

**Table A.34 – RoleClass MotionController**

<b>Class name</b>	MotionController
<b>Description</b>	The role class “MotionController” should be used for logic to generate set points (the desired output or motion profile) and close a position or velocity feedback loop.
<b>Parent class</b>	AutomationMLCSRoleClassLib/ControlEquipment

### A.36 RoleClass Panel

Table A.35 specifies the role class “Panel”.

**Table A.35 – RoleClass Panel**

<b>Class name</b>	Panel
<b>Description</b>	The role class “Panel” should be used for physical objects providing one possibility for humans to interact with machines.
<b>Parent class</b>	AutomationMLCSRoleClassLib/ControlEquipment/ControlHardware

EXAMPLE Control panel, scanner, monitoring panel, key panel.

### A.37 RoleClass MeasuringEquipment

Table A.36 specifies the role class “MeasuringEquipment”.

**Table A.36 – RoleClass MeasuringEquipment**

<b>Class name</b>	MeasuringEquipment
<b>Description</b>	The role class “MeasuringEquipment” should be used for defining equipment defined in IEC 60050-311:2001, 311-03-05: “assembly of measuring instruments intended for specified measurement purposes”
<b>Parent class</b>	AutomationMLBaseRoleClassLib/AutomationMLBaseRole/Resource

EXAMPLE Surface measuring machine, paint thickness gauge.

### A.38 RoleClass Clamp

Table A.37 specifies the role class “Clamp”.

**Table A.37 – RoleClass Clamp**

<b>Class name</b>	Clamp
<b>Description</b>	The role class “Clamp” should be used for equipment that performs fixation processes to hold items at one specific point.
<b>Parent class</b>	AutomationMLDMIRoleClassLib/DiscManufacturingEquipment/Fixture

### A.39 RoleClass ProcessController

Table A.38 specifies the role class “ProcessController”.

**Table A.38 – RoleClass ProcessController**

<b>Class name</b>	ProcessController
<b>Description</b>	The role class “ProcessController” should be used for the control of a specific tool or machine that performs process steps on a product.
<b>Parent class</b>	AutomationMLCSRoleClassLib/ControlEquipment/Controller

EXAMPLE Welding control, technology control, glue control, combination of control and regulation of process.

#### A.40 RoleClass Loader

Table A.39 specifies the role class “Loader”.

**Table A.39 – RoleClass Loader**

<b>Class name</b>	Loader
<b>Description</b>	The role class “Loader” should be used for equipment to introduce products into the production process.
<b>Parent class</b>	AutomationMLDMIRoleClassLib/DiscManufacturingEquipment/Storage

EXAMPLE Magazine loader.

#### A.41 RoleClass Unloader

Table A.40 specifies the role class “Unloader”.

**Table A.40 – RoleClass Unloader**

<b>Class name</b>	Unloader
<b>Description</b>	The role class “Unloader” should be used for equipment to export products out of the production process.
<b>Parent class</b>	AutomationMLDMIRoleClassLib/DiscManufacturingEquipment/Storage


## Annex B (informative)

### Examples of usage of RoleClasses

#### B.1 General

RoleClasses are vendor independent and generic entities. They are used in order to assign a generic semantics to an object instance and to describe requirements of this object instance. Additionally, they can help in mapping data models of different engineering tools.


Figure B.1 explains this by means of an example: An object RB1 in the data model of Tool1 is modelled in AML as InternalElement which is derived from the SystemUnitClass Type\_RB and additionally associated with the RoleClass Robot. Tool2 has an InstanceHierarchy with an InternalElement 3285\_AB which is of type Rob and points to the same RoleClass Robot. A mapping between these two models can be derived by the RoleClass Robot (common to both InternalElements).

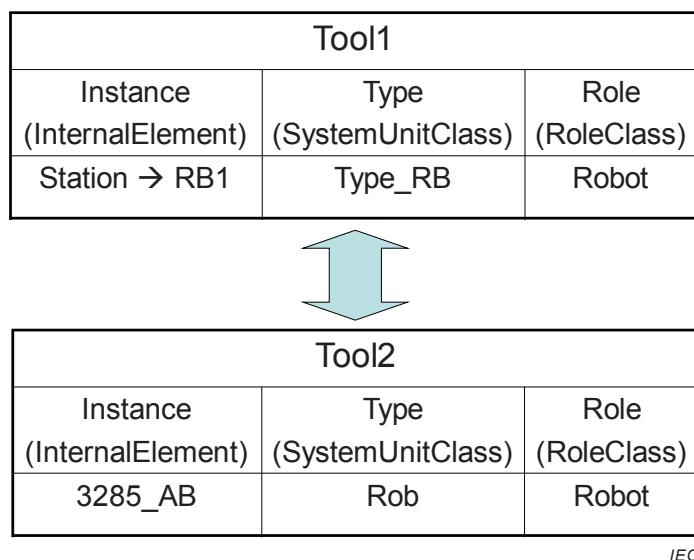

**Figure B.1 – Usage of roles in the mapping process**

#### B.2 Example plant unit

The usage of RoleClasses will be explained by means of a simple example cell. The plant cell is depicted in Figure B.2. It consists of three plant components, a conveyor, a robot and a turntable. The robot places parts on the conveyor. The conveyor transports the parts to the turntable and the turntable forwards the parts to further plant cells.

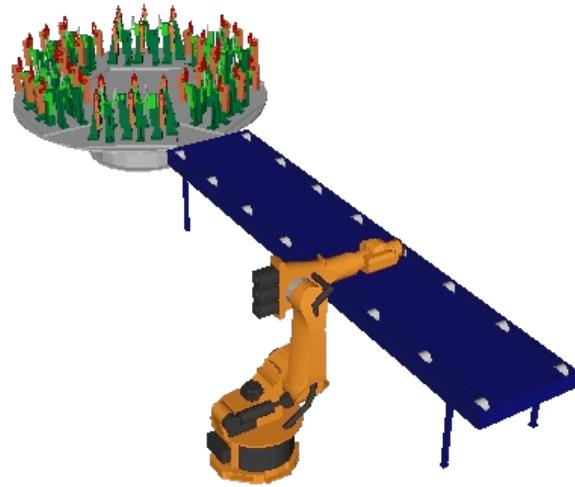

IEC

**Figure B.2 – Example for usage of roles**

The example (see Figure B.3) consists of the AML standard libraries (AutomationMLBaseRoleClassLib, AutomationMLMDIRoleClassLib, AutomationMLExtendedRoleClassLib), the concrete plant within an InstanceHierarchy (RoleExample), and different plant component types within a SystemUnitClass library (ExampleSystemUnitClassLib). The RoleClassLibs and the contained RoleClasses are explained in IEC 62714-1:2014, as well as Clause 5 and Annex A of this part of IEC 62714.

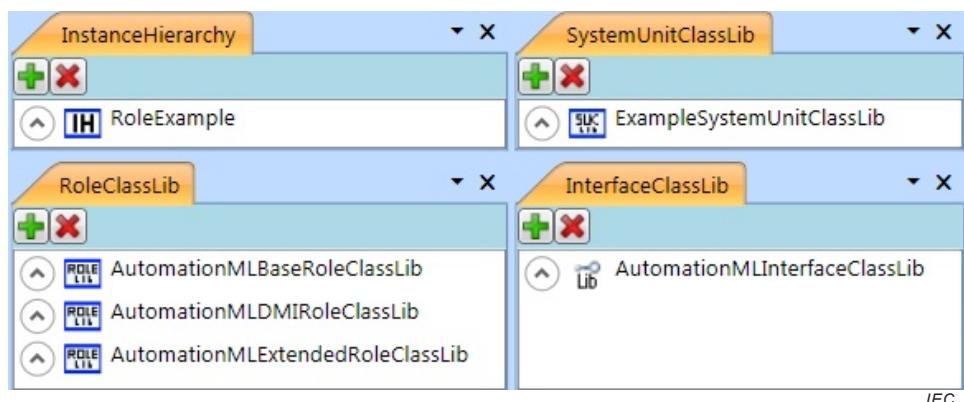
**Figure B.3 – Example AML model**

Figure B.4, Figure B.5, and Figure B.6 depict the InstanceHierarchy of the example called RoleExample. The example plant describes a cell which is indicated by the RoleClass WorkCell of the AutomationMLExtendedRoleClassLib. The reference to this role class means that the hierarchy element (InternalElement) describes a production line or a station in which the production step takes place. Additionally, the cell points to the RoleClass ResourceStructure of the AutomationMLBaseRoleClassLib. This means that the cell is a resource oriented object hierarchy.

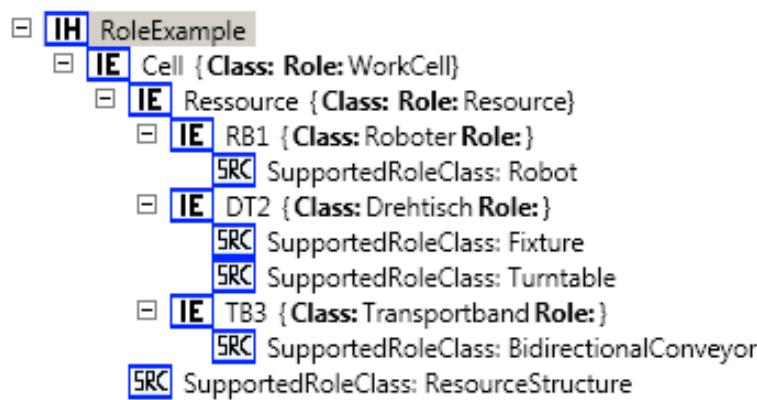


Figure B.4 – Example InstanceHierarchy for usage of roles

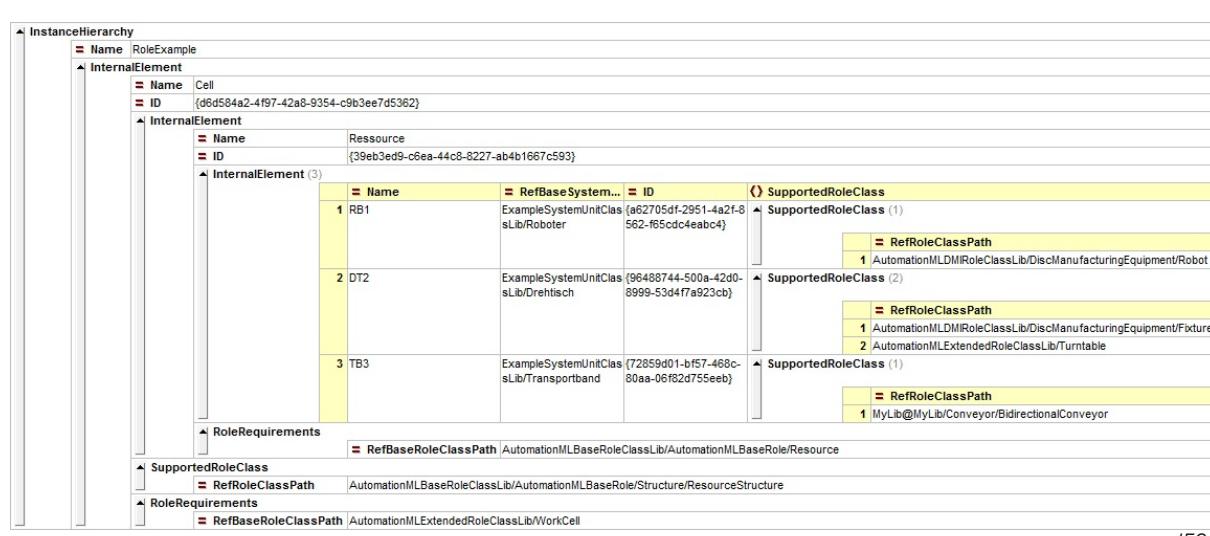


Figure B.5 – XML grid of the example InstanceHierarchy for usage of roles

```

<InstanceHierarchy Name="RoleExample">
  <InternalElement Name="Cell" ID="{d6d584a2-4f97-42a8-9354-c9b3ee7d5362}">
    <InternalElement Name="Ressource" ID="{39eb3ed9-c6ea-44c8-8227-ab4b1667c593}">
      <InternalElement Name="RB1" RefBaseSystemUnitPath="ExampleSystemUnitClassLib/Roboter" ID="{a62705df-2951-4a2f-8562-f65cdc4eabc4}">
        <SupportedRoleClass RefRoleClassPath="AutomationMLMDMIRoleClassLib/DiscManufacturingEquipment/Robot"/>
      </InternalElement>
      <InternalElement Name="DT2" RefBaseSystemUnitPath="ExampleSystemUnitClassLib/Drehtisch" ID="{96488744-500a-42d0-8999-53d4f7a923cb}">
        <SupportedRoleClass RefRoleClassPath="AutomationMLMDMIRoleClassLib/DiscManufacturingEquipment/Fixture"/>
        <SupportedRoleClass RefRoleClassPath="AutomationMLExtendedRoleClassLib/Turntable"/>
      </InternalElement>
      <InternalElement Name="TB3" RefBaseSystemUnitPath="ExampleSystemUnitClassLib/Transportband" ID="{72859d01-bf57-468c-80aa-06f82d755eeb}">
        <SupportedRoleClass RefRoleClassPath="MyLib@MyLib/Conveyor/BidirectionalConveyor"/>
      </InternalElement>
      <RoleRequirements RefBaseRoleClassPath="AutomationMLBaseRoleClassLib/AutomationMLBaseRole/Resource"/>
    </InternalElement>
    <SupportedRoleClass RefRoleClassPath="AutomationMLBaseRoleClassLib/AutomationMLBaseRole/Structure/ResourceStructure"/>
    <RoleRequirements RefBaseRoleClassPath="AutomationMLExtendedRoleClassLib/WorkCell"/>
  </InternalElement>
</InstanceHierarchy>
  
```

IEC

Figure B.6 – XML text of the example InstanceHierarchy for usage of roles

On the next hierarchy level, the InternalElement Cell gets an explicit InternalElement Ressource which references the RoleClass Resource of the AutomationMLBaseRoleClassLib. The concept of division into resource, product and process is described in IEC 62714-1:2014. Resources describe plants, equipment or other production resources.

Below the InternalElement Ressource, there are three different plant components:

- The InternalElement RB1 which references the RoleClass Robot. This RoleClass is a standard AML RoleClass defined within the AutomationMLDMIRoleClassLib. This means that this InternalElement represents automatically controlled, reprogrammable, multipurpose manipulators, programmable in three or more axes, which can be either fixed in place or mobile for use in industrial automation applications. Furthermore, the technical implementation is given by the derivation from the SystemUnitClass Roboter described hereinafter.
- The InternalElement DT2 which references the RoleClass Turntable defined within the informative AutomationMLExtendedRoleClassLib. Furthermore, it possesses a reference to the standard RoleClass Fixture of the AutomationMLDMIRoleClassLib. This means that it represents rotating transport equipment which changes the horizontal transport direction of a product and/or carrier. But at the same time, the InternalElement is equipment that reduces the degrees of freedom of an item. Both RoleClasses are supported by this InternalElement. Furthermore, the technical implementation is given by the derivation from the SystemUnitClass Drehtisch described hereinafter.
- The InternalElement TB3 which references the RoleClass BidirectionalConveyor. This RoleClass is a user-defined RoleClass. The definition of the RoleClass can be found via the ExternalReference (see Figure B.7) which points to the file c://xyz\_lib.aml on the localhost and is identified via the Alias MyLib. The RoleClass BidirectionalConveyor is referenced by means of the RefRoleClassPath element containing the string "MyLib@MyLib/Conveyor/BidirectionalConveyor" (see Figure B.8). This means that this InternalElement is a user-defined element which is because of restrictions of the AML specification derived directly or indirectly from the AutomationMLBaseRoleClass. Furthermore, the technical implementation is given by the derivation from the SystemUnitClass Transportband described hereinafter.

 **ExternalReference** Path=..//xyz\_lib.aml Alias=MyLib

```
<ExternalReference Path="..//xyz_lib.aml" Alias="MyLib"/>
```

IEC

**Figure B.7 – External RoleClassLib reference**

3	TB3	ExampleSystemUnitClassLib/Transportband	{72859d01-bf57-468c-80aa-06f82d755eeb}	SupportedRoleClass (1)
				 <b>RefRoleClassPath</b> 1 MyLib@MyLib/Conveyor/BidirectionalConveyor

```
<InternalElement Name="TB3" RefBaseSystemUnitPath="ExampleSystemUnitClassLib/Transportband" ID="{72859d01-bf57-468c-80aa-06f82d755eeb}">
  <SupportedRoleClass RefRoleClassPath="MyLib@MyLib/Conveyor/BidirectionalConveyor"/>
</InternalElement>
```

IEC

**Figure B.8 – Usage of external role class in example**


Figure B.9, Figure B.10, and Figure B.11 depict the SystemUnitClass library of the example called ExampleSystemUnitClassLib. Within the library, three plant component types are modeled. These are:

- The class Roboter which points to the RoleClass Robot. This RoleClass is a standard AML RoleClass defined within the AutomationMLDMIRoleClassLib. This means that this SystemUnitClass represents automatically controlled, reprogrammable, multipurpose, manipulators programmable in three or more axes, which may be either fixed in place or mobile for use in industrial automation applications.
- The class Drehtisch which points to the RoleClass Turntable and Clamp defined within the informative AutomationMLExtendedRoleClassLib. This means that it represents rotating transport equipment which changes the horizontal transport direction of a product and/or

carrier. But at the same time, the SystemUnitClass is able to perform fixation processes to hold items at one specific point. Both RoleClasses are supported by this SystemUnitClass.

- The class Transportband which points to the RoleClass Transport. This RoleClass is a standard AML RoleClass defined within the AutomationMLDMIRoleClassLib. This means that this SystemUnitClass is equipment that performs transport processes to transfer items from one location to another.

The SystemUnitClasses of this example describe the plant component types. This type can be system specific or language dependent. In the present case, the class names are in German. The roles make an independent understanding possible, even if German is not supported as a language.

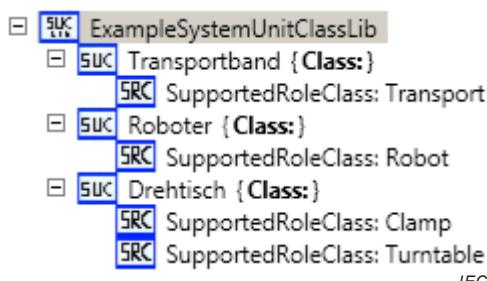

**Figure B.9 – Example SystemUnitClass library for usage of roles**

SystemUnitClassLib		
= Name	ExampleSystemUnitClassLib	
⌚ Version	1.0.1	
▲ SystemUnitClass (3)		
= Name	⌚ SupportedRoleClass	
1 Transportband	▲ SupportedRoleClass (1)	
	= RefRoleClassPath	
	1 AutomationMLDMIRoleClassLib/DiscManufacturingEquipment/Transport	
2 Roboter	▲ SupportedRoleClass (1)	
	= RefRoleClassPath	
	1 AutomationMLDMIRoleClassLib/DiscManufacturingEquipment/Robot	
3 Drehtisch	▲ SupportedRoleClass (2)	
	= RefRoleClassPath	
	1 AutomationMLExtendedRoleClassLib/Clamp	
	2 AutomationMLExtendedRoleClassLib/Turntable	

IEC

**Figure B.10 – XML grid of the example SystemUnitClass library for usage of roles**

```

<SystemUnitClassLib Name="ExampleSystemUnitClassLib">
    <Version>1.0.1</Version>
    <SystemUnitClass Name="Transportband">
        <SupportedRoleClass RefRoleClassPath="AutomationMLDMIRoleClassLib/DiscManufacturingEquipment/Transport"/>
    </SystemUnitClass>
    <SystemUnitClass Name="Roboter">
        <SupportedRoleClass RefRoleClassPath="AutomationMLDMIRoleClassLib/DiscManufacturingEquipment/Robot"/>
    </SystemUnitClass>
    <SystemUnitClass Name="Drehtisch">
        <SupportedRoleClass RefRoleClassPath="AutomationMLExtendedRoleClassLib/Clamp"/>
        <SupportedRoleClass RefRoleClassPath="AutomationMLExtendedRoleClassLib/Turntable"/>
    </SystemUnitClass>
</SystemUnitClassLib>
    
```

IEC

**Figure B.11 – XML text of the example SystemUnitClass library for usage of roles**

## Annex C (informative)

### User-defined RoleClass libraries

#### C.1 General

Some existing user-defined libraries of different type and origin are listed here as an example. These consist of:

- UserDefinedRoleClassLibFoodAndBeverage.aml  
One industry-specific library in the context of food and beverage (see Figure C.1).
- UserDefinedRoleClassLibRedBookVDMA.aml  
One association-specific library from the VDMA (Verband Deutscher Maschinen- und Anlagenbau – German Engineering Federation) and VDW (Verein Deutscher Werkzeugmaschinenhersteller – German Machine Tool Manufacturers Union) – the RedBook: Every one of the different types of machines supplied by German machine tool manufacturers can be found in this directory.
- UserDefinedRoleClassLibCompanySpecificStructure.aml  
One company-specific library including structure related classes. This library is a concrete working example which shows how to build up such libraries in practice.
- UserDefinedRoleClassLibPandixPCE.aml and  
UserDefinedRoleClassLibPandixPPE.aml  
StandardLibraries related to the process industry according to the format PandIX. PandIX is a data model to describe the piping and instrumentation information of a process plant with focus on process automation aspects. It offers modelling guidelines for process control engineering data described in the P&ID (piping and instrumentation diagram) and hence formalized access to this data. For this, it provides CAEX libraries especially designed for process automation.

These examples are not explained in detail within the IEC 62714 series. Further tool-specific libraries or libraries consisting of company standards are also possible.


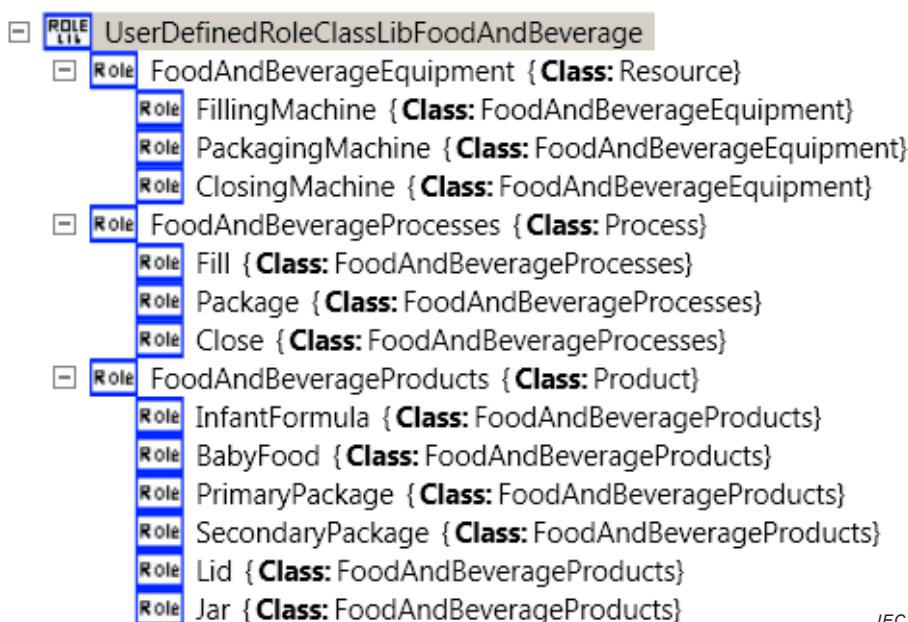


Figure C.1 – AML user-defined RoleClassLib FoodAndBeverage

## C.2 External semantics of attributes

To include references to external definitions of attributes, the CAEX element “RefSemantic” can be used. This element enables referencing attribute semantics defined in other standards. In Figure C.2, the ExampleRole possesses an attribute Height. This attribute is defined in the IEC 60050-113:2011, 113-01-21, which is depicted by means of the CorrespondingAttributePath. This mechanism helps to reference externally defined attribute definitions.

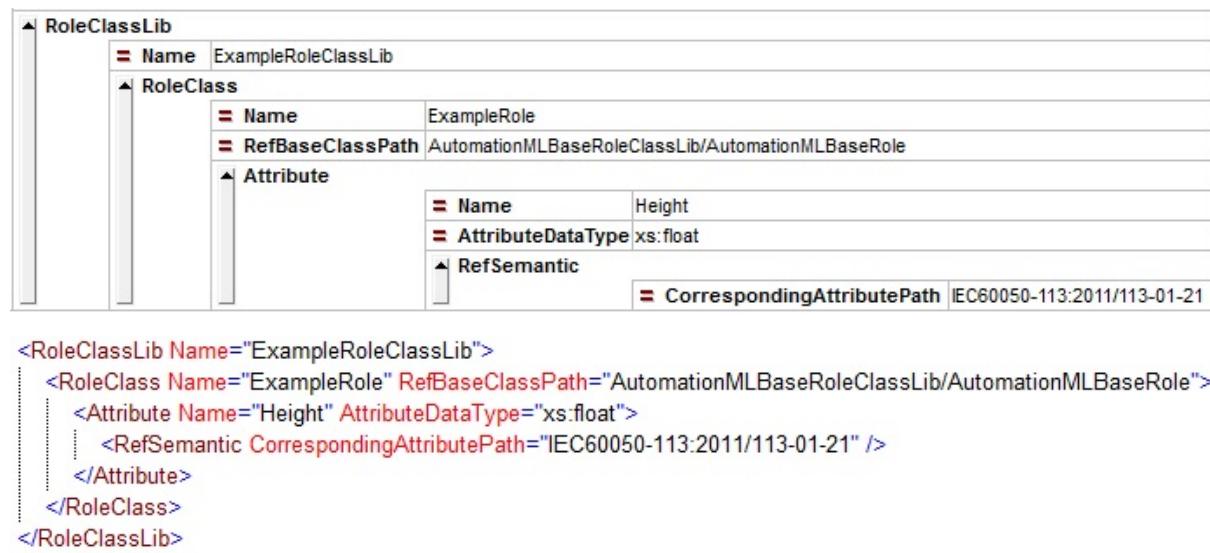

**Figure C.2 – Example for external attribute semantics**

## Annex D (informative)

### XML representation of AML libraries

#### D.1 AutomationMLDMIRoleClassLib

```

<?xml version="1.0" encoding="utf-8"?>
<CAEXFile FileName="AutomationMLDMIRoleClassLib.aml" SchemaVersion="2.15"
    xsi:noNamespaceSchemaLocation="CAEX_ClassModel_V2.15.xsd"
    xmlns:xsi="http://www.w3.org/2001/XMLSchema-instance">
<AdditionalInformation AutomationMLVersion="2.0" />
<AdditionalInformation>
    <WriterHeader>
        <WriterName>IEC SC65E WG 9</WriterName>
        <WriterID>IEC SC65E WG 9</WriterID>
        <WriterVendor>IEC</WriterVendor>
        <WriterVendorURL>www.iec.ch</WriterVendorURL>
        <WriterVersion>1.0</WriterVersion>
        <WriterRelease>1.0.0</WriterRelease>
        <LastWritingDateTime>2013-03-01</LastWritingDateTime>
        <WriterProjectTitle>Automation Markup Language Standard
            Libraries</WriterProjectTitle>
        <WriterProjectID>Automation Markup Language Standard
            Libraries</WriterProjectID>
    </WriterHeader>
</AdditionalInformation>
<ExternalReference Path="AutomationMLBaseRoleClassLib.aml"
    Alias="AutomationMLBaseRoleClassLib" />
<RoleClassLib Name="AutomationMLDMIRoleClassLib">
<Description>Automation Markup Language Discrete Manufacturing Industry Role
    Class Library</Description>
<Version>2.4.0</Version>
<RoleClass Name="DiscManufacturingEquipment"
    RefBaseClassPath="AutomationMLBaseRoleClassLib@AutomationMLBaseRoleClass
    Lib/AutomationMLBaseRole/Resource">
    <RoleClass Name="Transport" RefBaseClassPath="DiscManufacturingEquipment"
        />
    <RoleClass Name="Storage" RefBaseClassPath="DiscManufacturingEquipment" />
    <RoleClass Name="Fixture" RefBaseClassPath="DiscManufacturingEquipment" />
    <RoleClass Name="Gate" RefBaseClassPath="DiscManufacturingEquipment" />
    <RoleClass Name="Robot" RefBaseClassPath="DiscManufacturingEquipment" />
    <RoleClass Name="Tool" RefBaseClassPath="DiscManufacturingEquipment" />
    <RoleClass Name="Carrier" RefBaseClassPath="DiscManufacturingEquipment" />
    <RoleClass Name="Machine" RefBaseClassPath="DiscManufacturingEquipment" />
    <RoleClass Name="StaticObject"
        RefBaseClassPath="DiscManufacturingEquipment" />
</RoleClass>
</RoleClassLib>
</CAEXFile>
```

#### D.2 AutomationMLCMIRoleClassLib

```

<?xml version="1.0" encoding="utf-8"?>
<CAEXFile FileName="AutomationMLCMIRoleClassLib.aml" SchemaVersion="2.15"
    xsi:noNamespaceSchemaLocation="CAEX_ClassModel_V2.15.xsd"
    xmlns:xsi="http://www.w3.org/2001/XMLSchema-instance">
<AdditionalInformation AutomationMLVersion="2.0" />
<AdditionalInformation>
    <WriterHeader>
        <WriterName>IEC SC65E WG 9</WriterName>
        <WriterID>IEC SC65E WG 9</WriterID>
        <WriterVendor>IEC</WriterVendor>
        <WriterVendorURL>www.iec.ch</WriterVendorURL>
        <WriterVersion>1.0</WriterVersion>
```

```

<WriterRelease>1.0.0</WriterRelease>
<LastWritingDateTime>2013-03-01</LastWritingDateTime>
<WriterProjectTitle>Automation Markup Language Standard
    Libraries</WriterProjectTitle>
<WriterProjectID>Automation Markup Language Standard
    Libraries</WriterProjectID>
</WriterHeader>
</AdditionalInformation>
<ExternalReference Path="AutomationMLBaseRoleClassLib.aml"
    Alias="AutomationMLBaseRoleClassLib" />
<RoleClassLib Name="AutomationMLCMIRoleClassLib">
<Description>Automation Markup Language Continuous Manufacturing Industry Role
    Class Library</Description>
<Version>1.1.0</Version>
<RoleClass Name="ContManufacturingEquipment"
    RefBaseClassPath="AutomationMLBaseRoleClassLib@AutomationMLBaseRoleClass
    Lib/AutomationMLBaseRole/Resource" />
</RoleClassLib>
</CAEXFile>

```

### D.3 AutomationMLBMRoleClassLib

```

<?xml version="1.0" encoding="utf-8"?>
<CAEXFile FileName="AutomationMLBMRoleClassLib.aml" SchemaVersion="2.15"
    xsi:noNamespaceSchemaLocation="CAEX_ClassModel_V2.15.xsd"
    xmlns:xsi="http://www.w3.org/2001/XMLSchema-instance">
<AdditionalInformation AutomationMLVersion="2.0" />
<AdditionalInformation>
<WriterHeader>
    <WriterName>IEC SC65E WG 9</WriterName>
    <WriterID>IEC SC65E WG 9</WriterID>
    <WriterVendor>IEC</WriterVendor>
    <WriterVendorURL>www.iec.ch</WriterVendorURL>
    <WriterVersion>1.0</WriterVersion>
    <WriterRelease>1.0.0</WriterRelease>
    <LastWritingDateTime>2013-03-01</LastWritingDateTime>
    <WriterProjectTitle>Automation Markup Language Standard
        Libraries</WriterProjectTitle>
    <WriterProjectID>Automation Markup Language Standard
        Libraries</WriterProjectID>
</WriterHeader>
</AdditionalInformation>
<ExternalReference Path="AutomationMLBaseRoleClassLib.aml"
    Alias="AutomationMLBaseRoleClassLib" />
<RoleClassLib Name="AutomationMLBMRoleClassLib">
<Description>Automation Markup Language Batch Manufacturing Industry Role
    Class Library</Description>
<Version>1.1.0</Version>
<RoleClass Name="BatchManufacturingEquipment"
    RefBaseClassPath="AutomationMLBaseRoleClassLib@AutomationMLBaseRoleClass
    Lib/AutomationMLBaseRole/Resource" />
</RoleClassLib>
</CAEXFile>

```

### D.4 AutomationMLCSRoleClassLib

```

<?xml version="1.0" encoding="utf-8"?>
<CAEXFile FileName="AutomationMLCSRoleClassLib.aml" SchemaVersion="2.15"
    xsi:noNamespaceSchemaLocation="CAEX_ClassModel_V2.15.xsd"
    xmlns:xsi="http://www.w3.org/2001/XMLSchema-instance">
<AdditionalInformation AutomationMLVersion="2.0" />
<AdditionalInformation>
<WriterHeader>
    <WriterName>IEC SC65E WG 9</WriterName>
    <WriterID>IEC SC65E WG 9</WriterID>
    <WriterVendor>IEC</WriterVendor>
    <WriterVendorURL>www.iec.ch</WriterVendorURL>
    <WriterVersion>1.0</WriterVersion>
    <WriterRelease>1.0.0</WriterRelease>

```

```

<LastWritingDateTime>2013-03-01</LastWritingDateTime>
<WriterProjectTitle>Automation Markup Language Standard
    Libraries</WriterProjectTitle>
<WriterProjectID>Automation Markup Language Standard
    Libraries</WriterProjectID>
</WriterHeader>
</AdditionalInformation>
<ExternalReference Path="AutomationMLBaseRoleClassLib.aml"
    Alias="AutomationMLBaseRoleClassLib" />
<RoleClassLib Name="AutomationMLCSRoleClassLib">
    <Description>Automation Markup Language Control Industry Role Class
        Library</Description>
    <Version>2.3.0</Version>
<RoleClass Name="ControlEquipment"
    RefBaseClassPath="AutomationMLBaseRoleClassLib@AutomationMLBaseRoleClass
        Lib/AutomationMLBaseRole/Resource">
    <RoleClass Name="Communication" RefBaseClassPath="ControlEquipment" />
    <RoleClass Name="ControlHardware" RefBaseClassPath="ControlEquipment">
        <RoleClass Name="PC" RefBaseClassPath="ControlHardware" />
        <RoleClass Name="IPC" RefBaseClassPath="ControlHardware" />
        <RoleClass Name="EmbeddedDevice" RefBaseClassPath="ControlHardware" />
        <RoleClass Name="Handheld" RefBaseClassPath="ControlHardware" />
    </RoleClass>
    <RoleClass Name="Sensor" RefBaseClassPath="ControlEquipment" />
    <RoleClass Name="Actuator" RefBaseClassPath="ControlEquipment" />
    <RoleClass Name="Controller" RefBaseClassPath="ControlEquipment">
        <RoleClass Name="PLC" RefBaseClassPath="Controller" />
        <RoleClass Name="NC" RefBaseClassPath="Controller" />
        <RoleClass Name="RC" RefBaseClassPath="Controller" />
        <RoleClass Name="PAC" RefBaseClassPath="Controller" />
    </RoleClass>
</RoleClass>
</RoleClassLib>
</CAEXFile>

```

## D.5 AutomationMLExtendedRoleClassLib

```

<?xml version="1.0" encoding="utf-8"?>
<CAEXFile FileName="AutomationMLExtendedRoleClassLib.aml" SchemaVersion="2.15"
    xsi:noNamespaceSchemaLocation="CAEX_ClassModel_V2.15.xsd"
    xmlns:xsi="http://www.w3.org/2001/XMLSchema-instance">
    <AdditionalInformation AutomationMLVersion="2.0" />
    <AdditionalInformation>
        <WriterHeader>
            <WriterName>IEC SC65E WG 9</WriterName>
            <WriterID>IEC SC65E WG 9</WriterID>
            <WriterVendor>IEC</WriterVendor>
            <WriterVendorURL>www.iec.ch</WriterVendorURL>
            <WriterVersion>1.0</WriterVersion>
            <WriterRelease>1.0.0</WriterRelease>
            <LastWritingDateTime>2013-03-01</LastWritingDateTime>
            <WriterProjectTitle>Automation Markup Language Standard
                Libraries</WriterProjectTitle>
            <WriterProjectID>Automation Markup Language Standard
                Libraries</WriterProjectID>
        </WriterHeader>
    </AdditionalInformation>
    <ExternalReference Path="AutomationMLBaseRoleClassLib.aml"
        Alias="AutomationMLBaseRoleClassLib" />
    <ExternalReference Path="AutomationMLDMIRoleClassLib.aml"
        Alias="AutomationMLDMIRoleClassLib" />
    <ExternalReference Path="AutomationMLCSRoleClassLib.aml"
        Alias="AutomationMLCSRoleClassLib" />
    <RoleClassLib Name="AutomationMLExtendedRoleClassLib">
        <Version>2.7.0</Version>
    <RoleClass Name="PLCFacet"
        RefBaseClassPath="AutomationMLBaseRoleClassLib@AutomationMLBaseRoleClass
            Lib/AutomationMLBaseRole/Facet" />

```

```

<RoleClass Name="HMIFacet"
    RefBaseClassPath="AutomationMLBaseRoleClassLib@AutomationMLBaseRoleClass
    Lib/AutomationMLBaseRole/Facet" />
<RoleClass Name="Enterprise"
    RefBaseClassPath="AutomationMLBaseRoleClassLib@AutomationMLBaseRoleClass
    Lib/AutomationMLBaseRole/Structure/ResourceStructure" />
<RoleClass Name="Site"
    RefBaseClassPath="AutomationMLBaseRoleClassLib@AutomationMLBaseRoleClass
    Lib/AutomationMLBaseRole/Structure/ResourceStructure" />
<RoleClass Name="Area"
    RefBaseClassPath="AutomationMLBaseRoleClassLib@AutomationMLBaseRoleClass
    Lib/AutomationMLBaseRole/Structure/ResourceStructure" />
<RoleClass Name="ProductionLine"
    RefBaseClassPath="AutomationMLBaseRoleClassLib@AutomationMLBaseRoleClass
    Lib/AutomationMLBaseRole/Structure/ResourceStructure" />
<RoleClass Name="WorkCell"
    RefBaseClassPath="AutomationMLBaseRoleClassLib@AutomationMLBaseRoleClass
    Lib/AutomationMLBaseRole/Structure/ResourceStructure" />
<RoleClass Name="ProcessCell"
    RefBaseClassPath="AutomationMLBaseRoleClassLib@AutomationMLBaseRoleClass
    Lib/AutomationMLBaseRole/Structure/ResourceStructure" />
<RoleClass Name="Unit"
    RefBaseClassPath="AutomationMLBaseRoleClassLib@AutomationMLBaseRoleClass
    Lib/AutomationMLBaseRole/Structure/ResourceStructure" />
<RoleClass Name="ProductionUnit"
    RefBaseClassPath="AutomationMLBaseRoleClassLib@AutomationMLBaseRoleClass
    Lib/AutomationMLBaseRole/Structure/ResourceStructure" />
<RoleClass Name="StorageZone"
    RefBaseClassPath="AutomationMLBaseRoleClassLib@AutomationMLBaseRoleClass
    Lib/AutomationMLBaseRole/Structure/ResourceStructure" />
<RoleClass Name="StorageUnit"
    RefBaseClassPath="AutomationMLBaseRoleClassLib@AutomationMLBaseRoleClass
    Lib/AutomationMLBaseRole/Structure/ResourceStructure" />
<RoleClass Name="Turntable"
    RefBaseClassPath="AutomationMLDMIRoleClassLib@AutomationMLDMIRoleClassLi
    b/DiscManufacturingEquipment/Transport" />
<RoleClass Name="Conveyor"
    RefBaseClassPath="AutomationMLDMIRoleClassLib@AutomationMLDMIRoleClassLi
    b/DiscManufacturingEquipment/Transport">
    <RoleClass Name="BeltConveyor" RefBaseClassPath="Conveyor" />
    <RoleClass Name="RollConveyor" RefBaseClassPath="Conveyor" />
    <RoleClass Name="ChainConveyor" RefBaseClassPath="Conveyor" />
    <RoleClass Name="PalletConveyor" RefBaseClassPath="Conveyor" />
    <RoleClass Name="OverheadConveyor" RefBaseClassPath="Conveyor" />
</RoleClass>
<RoleClass Name="LiftingTable"
    RefBaseClassPath="AutomationMLDMIRoleClassLib@AutomationMLDMIRoleClassLi
    b/DiscManufacturingEquipment/Transport" />
<RoleClass Name="AGV"
    RefBaseClassPath="AutomationMLDMIRoleClassLib@AutomationMLDMIRoleClassLi
    b/DiscManufacturingEquipment/Transport" />
<RoleClass Name="Transposer"
    RefBaseClassPath="AutomationMLDMIRoleClassLib@AutomationMLDMIRoleClassLi
    b/DiscManufacturingEquipment/Transport" />
<RoleClass Name="CarrierHandlingSystem"
    RefBaseClassPath="AutomationMLDMIRoleClassLib@AutomationMLDMIRoleClassLi
    b/DiscManufacturingEquipment/Transport" />
<RoleClass Name="BodyStore"
    RefBaseClassPath="AutomationMLDMIRoleClassLib@AutomationMLDMIRoleClassLi
    b/DiscManufacturingEquipment/Storage" />
<RoleClass Name="Lift"
    RefBaseClassPath="AutomationMLDMIRoleClassLib@AutomationMLDMIRoleClassLi
    b/DiscManufacturingEquipment/Transport" />
<RoleClass Name="Rollerbed"
    RefBaseClassPath="AutomationMLDMIRoleClassLib@AutomationMLDMIRoleClassLi
    b/DiscManufacturingEquipment/Transport" />
<RoleClass Name="StationaryTool"
    RefBaseClassPath="AutomationMLDMIRoleClassLib@AutomationMLDMIRoleClassLi
    b/DiscManufacturingEquipment/Tool" />

```

```
<RoleClass Name="MovableTool"
    RefBaseClassPath="AutomationMLDMIRoleClassLib@AutomationMLDMIRoleClassLi
    b/DiscManufacturingEquipment/Tool" />
<RoleClass Name="ControlCabinet"
    RefBaseClassPath="AutomationMLCSRoleClassLib@AutomationMLCSRoleClassLib/
    ControlEquipment" />
<RoleClass Name="IODevice"
    RefBaseClassPath="AutomationMLCSRoleClassLib@AutomationMLCSRoleClassLib/
    ControlEquipment" />
<RoleClass Name="HMI"
    RefBaseClassPath="AutomationMLCSRoleClassLib@AutomationMLCSRoleClassLib/
    ControlEquipment">
<RoleClass Name="WarningEquipment"
    RefBaseClassPath="AutomationMLExtendedRoleClassLib/HMI" />
</RoleClass>
<RoleClass Name="ActuatingDrive"
    RefBaseClassPath="AutomationMLCSRoleClassLib@AutomationMLCSRoleClassLib/
    ControlEquipment/Actuator" />
<RoleClass Name="MotionController"
    RefBaseClassPath="AutomationMLCSRoleClassLib@AutomationMLCSRoleClassLib/
    ControlEquipment" />
<RoleClass Name="Panel"
    RefBaseClassPath="AutomationMLCSRoleClassLib@AutomationMLCSRoleClassLib/
    ControlEquipment/ControlHardware" />
<RoleClass Name="MeasuringEquipment"
    RefBaseClassPath="AutomationMLBaseRoleClassLib@AutomationMLBaseRoleClass
    Lib/AutomationMLBaseRole/Resource" />
<RoleClass Name="Clamp"
    RefBaseClassPath="AutomationMLDMIRoleClassLib@AutomationMLDMIRoleClassLi
    b/DiscManufacturingEquipment/Fixture" />
<RoleClass Name="ProcessController"
    RefBaseClassPath="AutomationMLCSRoleClassLib@AutomationMLCSRoleClassLib/
    ControlEquipment/Controller" />
<RoleClass Name="Loader"
    RefBaseClassPath="AutomationMLDMIRoleClassLib@AutomationMLDMIRoleClassLi
    b/DiscManufacturingEquipment/Storage" />
<RoleClass Name="Unloader"
    RefBaseClassPath="AutomationMLDMIRoleClassLib@AutomationMLDMIRoleClassLi
    b/DiscManufacturingEquipment/Storage" />
</RoleClassLib>
</CAEXFile>
```

## Bibliography

ISO 8373:2012, *Robots and robotic devices – Vocabulary*

IEC 60050 (all parts), *International Electrotechnical Vocabulary* (available at <http://www.electropedia.org>)

IEC 60050-113:2011, *International Electrotechnical Vocabulary – Part 113: Physics for electrotechnology*

IEC 60050-311:2001, *International Electrotechnical Vocabulary – Electrical and electronic measurements and measuring instruments – Part 311: General terms relating to measurements*

IEC 60050-351:2013, *International electrotechnical vocabulary – Part 351: Control technology*

IEC 61512-1, *Batch control – Part 1: Models and terminology*

IEC 62264-1:2013, *Enterprise-control system integration – Part 1: Models and terminology*

IEC 62714-32: —, *Engineering data exchange format for use in industrial automation systems engineering – Automation Markup Language – Geometry and kinematics*

ANSI/ISA-88.01-1995, *Batch control – Part 1: Models and Terminology*

---

<sup>2</sup> Under consideration.

*This page deliberately left blank*

# British Standards Institution (BSI)

BSI is the national body responsible for preparing British Standards and other standards-related publications, information and services.

BSI is incorporated by Royal Charter. British Standards and other standardization products are published by BSI Standards Limited.

## About us

We bring together business, industry, government, consumers, innovators and others to shape their combined experience and expertise into standards-based solutions.

The knowledge embodied in our standards has been carefully assembled in a dependable format and refined through our open consultation process. Organizations of all sizes and across all sectors choose standards to help them achieve their goals.

## Information on standards

We can provide you with the knowledge that your organization needs to succeed. Find out more about British Standards by visiting our website at [bsigroup.com/standards](http://bsigroup.com/standards) or contacting our Customer Services team or Knowledge Centre.

## Buying standards

You can buy and download PDF versions of BSI publications, including British and adopted European and international standards, through our website at [bsigroup.com/shop](http://bsigroup.com/shop), where hard copies can also be purchased.

If you need international and foreign standards from other Standards Development Organizations, hard copies can be ordered from our Customer Services team.

## Subscriptions

Our range of subscription services are designed to make using standards easier for you. For further information on our subscription products go to [bsigroup.com/subscriptions](http://bsigroup.com/subscriptions).

With **British Standards Online (BSOL)** you'll have instant access to over 55,000 British and adopted European and international standards from your desktop. It's available 24/7 and is refreshed daily so you'll always be up to date.

You can keep in touch with standards developments and receive substantial discounts on the purchase price of standards, both in single copy and subscription format, by becoming a **BSI Subscribing Member**.

**PLUS** is an updating service exclusive to BSI Subscribing Members. You will automatically receive the latest hard copy of your standards when they're revised or replaced.

To find out more about becoming a BSI Subscribing Member and the benefits of membership, please visit [bsigroup.com/shop](http://bsigroup.com/shop).

With a **Multi-User Network Licence (MUNL)** you are able to host standards publications on your intranet. Licences can cover as few or as many users as you wish. With updates supplied as soon as they're available, you can be sure your documentation is current. For further information, email [bsmusales@bsigroup.com](mailto:bsmusales@bsigroup.com).

## BSI Group Headquarters

389 Chiswick High Road London W4 4AL UK

## Rewvisions

Our British Standards and other publications are updated by amendment or revision. We continually improve the quality of our products and services to benefit your business. If you find an inaccuracy or ambiguity within a British Standard or other BSI publication please inform the Knowledge Centre.

## Copyright

All the data, software and documentation set out in all British Standards and other BSI publications are the property of and copyrighted by BSI, or some person or entity that owns copyright in the information used (such as the international standardization bodies) and has formally licensed such information to BSI for commercial publication and use. Except as permitted under the Copyright, Designs and Patents Act 1988 no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means – electronic, photocopying, recording or otherwise – without prior written permission from BSI. Details and advice can be obtained from the Copyright & Licensing Department.

## Useful Contacts:

### Customer Services

**Tel:** +44 845 086 9001

**Email (orders):** [orders@bsigroup.com](mailto:orders@bsigroup.com)

**Email (enquiries):** [cservices@bsigroup.com](mailto:cservices@bsigroup.com)

### Subscriptions

**Tel:** +44 845 086 9001

**Email:** [subscriptions@bsigroup.com](mailto:subscriptions@bsigroup.com)

### Knowledge Centre

**Tel:** +44 20 8996 7004

**Email:** [knowledgecentre@bsigroup.com](mailto:knowledgecentre@bsigroup.com)

### Copyright & Licensing

**Tel:** +44 20 8996 7070

**Email:** [copyright@bsigroup.com](mailto:copyright@bsigroup.com)



...making excellence a habit.<sup>TM</sup>