

BS ISO 4261:2013



BSI Standards Publication

Petroleum products — Fuels (class F) — Specifications of gas turbine fuels for industrial and marine applications

bsi.

...making excellence a habit.™

National foreword

This British Standard is the UK implementation of ISO 4261:2013.

The UK participation in its preparation was entrusted to Technical Committee PTI/7, Lubricants and process fluids.

A list of organizations represented on this committee can be obtained on request to its secretary.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

© The British Standards Institution 2013.
Published by BSI Standards Limited 2013

ISBN 978 0 580 78543 6
ICS 75.160.20

Compliance with a British Standard cannot confer immunity from legal obligations.

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 30 September 2013.

Amendments/corrigenda issued since publication

Date	Text affected
------	---------------

INTERNATIONAL
STANDARD

BS ISO 4261:2013

ISO
4261

Second edition
2013-09-01

**Petroleum products — Fuels (class
F) — Specifications of gas turbine fuels
for industrial and marine applications**

*Produits pétroliers — Combustibles (classe F) — Spécifications des
combustibles pour turbines à gaz en service dans l'industrie et la marine*



Reference number
ISO 4261:2013(E)

© ISO 2013



COPYRIGHT PROTECTED DOCUMENT

© ISO 2013

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
Case postale 56 • CH-1211 Geneva 20
Tel. + 41 22 749 01 11
Fax + 41 22 749 09 47
E-mail copyright@iso.org
Web www.iso.org

Published in Switzerland

Contents

Page

Foreword	iv
1 Scope	1
2 Normative references	1
3 General requirements	2
4 Detailed requirements	2
5 Sampling	2
6 Precision and interpretation of test results	2
Annex A (normative) Method of calculation of specific energy	5
Annex B (informative) Trace metal limits of fuel entering turbine combustion chambers	7
Annex C (informative) Significance of specifications for gas turbine fuels	10
Bibliography	17

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2. www.iso.org/directives

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received. www.iso.org/patents

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

The committee responsible for this document is ISO/TC 28, *Petroleum products and lubricants*, Subcommittee SC 4, *Classifications and specifications*, WG 5, *Gas turbine fuels*.

This second edition cancels and replaces the first edition (ISO 4261:1993), of which it constitutes a minor revision with the following changes:

- Reference to ISO 4260 has been removed;
- Reference to ISO 4262 has been removed;
- Reference is made to ISO 10370.

[Annex A](#) forms an integral part of this International Standard. [Annex B](#) and [C](#) are for information only.

Petroleum products — Fuels (class F) — Specifications of gas turbine fuels for industrial and marine applications

WARNING — The use of this International Standard may involve hazardous materials, operations, and equipment. This International Standard does not purport to address all of the safety problems associated with its use. It is the responsibility of the user of this International Standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.

1 Scope

This International Standard specifies the requirements for petroleum fuels for gas turbines (see ISO 3977) used in public utility, industrial, and marine applications. It does not cover requirements for gas turbine fuels for aviation use. This International Standard is intended for the guidance of users such as turbine manufacturers, suppliers, and purchasers of gas turbine fuels.

This International Standard sets out the properties of fuels at the time and place of transfer of custody to the user. Further information and recommendations for the quality of the fuel entering the turbine combustion chambers are provided in [Annex B](#).

The terminology used and the test methods referred to in these specifications are presented in [Annex C](#).

NOTE 1 Additional information on fuels for gas turbines is given in ISO 3977.

NOTE 2 The requirements for petroleum fuels for diesel engines and steam turbines for marine use are given in ISO 8217.

The fuel categories in this International Standard have been classified in accordance with ISO 8216-2:1986.

2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 2160, *Petroleum products — Corrosiveness to copper — Copper strip test*

ISO 2719, *Determination of flash point — Pensky-Martens closed cup method*

ISO 3104, *Petroleum products — Transparent and opaque liquids — Determination of kinematic viscosity and calculation of dynamic viscosity*

ISO 3170, *Petroleum liquids — Manual sampling*

ISO 3171, *Petroleum liquids — Automatic pipeline sampling*

ISO 3405, *Petroleum products — Determination of distillation characteristics at atmospheric pressure*

ISO 3675, *Crude petroleum and liquid petroleum products — Laboratory determination of density — Hydrometer method*

ISO 3733, *Petroleum products and bituminous materials — Determination of water — Distillation method*

ISO 3735, *Crude petroleum and fuel oils — Determination of sediment — Extraction method*

ISO 4259, *Petroleum products — Determination and application of precision data in relation to methods of test*

ISO 6245, *Petroleum products — Determination of ash*

ISO 8217, *Petroleum products — Fuels (class F) — Specifications of marine fuels*

ISO 8754, *Petroleum products — Determination of sulfur content — Energy-dispersive X-ray fluorescence spectrometry*

ISO 10370, *Petroleum products — Determination of carbon residue — Micro method*

3 General requirements

3.1 The fuel shall be a homogeneous mixture of hydrocarbons, free from inorganic acids and adventitious foreign matter.

NOTE Guidelines for limits for trace metals for fuels entering the turbine combustion chambers are contained in [Annex A](#).

3.2 Fuels of all categories shall remain homogeneous during storage and handling in the countries or locality where the fuel is to be used, taking into account local storage conditions, handling, and duration of storage.

4 Detailed requirements

NOTE The properties listed in this specification are those which permit acceptable performance of the turbine. However, certain metals, even in trace quantities, are detrimental to gas turbine service life. Information on the significance and concentration of critical metallic elements in the fuel as it enters the turbine combustion chambers is provided in [Annex B](#).

4.1 The various categories of gas turbine fuels shall conform to the limiting requirements shown in [Table 1](#) when the fuel is tested by the methods specified.

4.2 Incorporation of additives by the fuel supplier for legal purposes or to improve certain aspects of performance is permitted, provided that the amount and type incorporated do not cause the additive-treated fuel properties to fall outside the general requirements and specification limits laid down in [Table 1](#).

NOTE Additives may also be introduced subsequent to delivery, as noted in [Annex C](#).

4.3 A limit for low-temperature operability is a requirement of this International Standard, but limits cannot be included in [Table 1](#) because of the need to conform to local or national requirements. When this specification is called up, such limits, together with the test methods required, shall be stated.

Information on internationally available test methods for low-temperature operability is given in [Annex C](#) (C.2.5).

5 Sampling

Sampling for the requirements in [Table 1](#) shall be carried out by the methods described in ISO 3170, ISO 3171, or equivalent International Standards.

NOTE If sampling for trace metals is agreed upon by the interested parties, the recommendations in [Annex B](#) should be followed.

6 Precision and interpretation of test results

The majority of test methods specified in [Table 1](#) contain a statement of the precision (repeatability and reproducibility) to be expected from it. Attention is drawn to ISO 4259, which covers the use of precision data in the interpretation of test results; this procedure shall be used in cases of dispute.

Table 1 — Detailed requirements for gas turbine fuels at time and place of custody transfer to user

Property	Test method	ISO-F Category ^a					
		DST.0	DST.1/ DMT.1	DST.2/ DMT.2	DST.3/ DMT.3	RST.3/ RMT.3	RST.4/ RMT.4
		Low flash point petroleum distillate (naphtha type)	Medium flash point petroleum distillate (jet fuel [kerosine] type)	Petroleum distillate (gas-oil type)	Low ash petroleum distillate	Low ash residual fuel or a distillate fuel containing heavy components from petroleum processing	Petroleum fuel containing heavy components from petroleum processing
Flash point, °C, min.	ISO 2719 ^b		inland: 38 marine: 43 ^c	inland: 56 marine: 60	inland: 56 marine: 60	60	60
Kinematic viscosity at 40 °C to 100 °C, in mm ² /s, max.	ISO 3104	1,3 min. ^d	1,3 to 2,4 ^d	1,3 to 5,5	1,3 to 11,0	1,3 to 20,0	55 (see C.2.2)
Density at 15 °C in kg/m ³ , max. ^e	ISO 3675	Value to be reported	Value to be reported	880	900 (see B.5)	920 (see B.5)	996 (see B.5)
Distillation 90 % (V/V) recovered at °C, max.	ISO 3405	288	288	365	—	—	—
Low-temperature operability, °C	See 4.3	Value to be reported	Value to be reported	Value to be reported	Value to be reported	Value to be reported	Value to be reported
Carbon residue % (m/m), max.	ISO 10370	0,15 (on 10 % residue)	0,15 (on 10 % residue)	0,15 (on 10 % residue)	0,25	1,50	Value to be reported ^f
Ash content % (m/m), max.	ISO 6245	0,01	0,01	0,01	0,01	0,03	0,15
Water % (V/V), max.	ISO 3733	0,05	0,05	0,05	0,30	0,50	1,0

a Crude oils, because of their varied properties, do not necessarily fit any category designation. If crude oil is considered as a turbine fuel for industrial applications, the manner of its use should be agreed between the turbine manufacturer and user.

b Other methods may be required by law for the determination of minimum flash point.

c In marine applications, this category is for use in engines for emergency purposes and shall conform to the requirements of ISO 8217.

d Fuel with a viscosity below the minimum value of 1,3 mm²/s at 40 °C may be substituted by agreement with the turbine manufacturer.

e Density measured at 15 °C, in kilogram per litre or in units of similar magnitude, shall be multiplied by 1 000 before comparison with these values.

f An assessment of the significance of carbon residue for RST.4/RMT.4 is given in C.2.6.

g Gas turbines with waste heat recovery equipment may require additional sulfur control to prevent cold end corrosion (see C.2.9).

Table 1 (continued)

Property	Test method	ISO-F Category ^a					
		DST.0	DST.1/ DMT.1	DST.2/ DMT.2	DST.3/ DMT.3	RST.3/ RMT.3	RST.4/ RMT.4
		Low flash point petroleum distillate (naphtha type)	Medium flash point petroleum distillate (jet fuel [kerosine] type)	Petroleum distillate (gas-oil type)	Low ash petroleum distillate	Low ash residual fuel or a distillate fuel containing heavy components from petroleum processing	Petroleum fuel containing heavy components from petroleum processing
Sediment % (m/m), max.	ISO 3735	0,01	0,01	0,01	0,05	0,05	0,25
Sulfur % (m/m), max. ^g	ISO 8754	0,5	0,5	1,3	2,0	2,0	4,5
Copper corrosion classification, max.	ISO 2160	1	1	1	—	—	—
Calculated net specific energy in MJ/kg, min. (lower calorific value)	See Annex A	Value to be reported	42,8	41,6	40,0	40,0	39,4
<p>a Crude oils, because of their varied properties, do not necessarily fit any category designation. If crude oil is considered as a turbine fuel for industrial applications, the manner of its use should be agreed between the turbine manufacturer and user.</p> <p>b Other methods may be required by law for the determination of minimum flash point.</p> <p>c In marine applications, this category is for use in engines for emergency purposes and shall conform to the requirements of ISO 8217.</p> <p>d Fuel with a viscosity below the minimum value of 1,3 mm²/s at 40 °C may be substituted by agreement with the turbine manufacturer.</p> <p>e Density measured at 15 °C, in kilogram per litre or in units of similar magnitude, shall be multiplied by 1 000 before comparison with these values.</p> <p>f An assessment of the significance of carbon residue for RST.4/RMT.4 is given in C.2.6.</p> <p>g Gas turbines with waste heat recovery equipment may require additional sulfur control to prevent cold end corrosion (see C.2.9).</p>							

Annex A (normative)

Method of calculation of specific energy

A.1 Specific energy (lower calorific value) is controlled indirectly by the specification of other properties. Specific energy shall be calculated with a degree of accuracy acceptable for normal purposes from the density of the fuel, applying corrections as follows for any sulfur, water, and incombustible (ash) content that may be present (see C.2.11):


Specific energy (net), MJ/kg

$$= (46\,704 - 8\,802 \rho^2 \times 10^{-6} + 3\,167 \rho \times 10^{-3}) [1 - 0,01 (x + y + s)] + 0,01 (9\,420 s - 2\,449 x)$$

where

- ρ is the fuel density at 15 °C, in kilogram per cubic metre (see [Table 1](#));
- x is the water content, expressed as a percentage by mass;
- y is the ash content, expressed as a percentage by mass;
- s is the sulfur content, expressed as a percentage by mass.

NOTE [Figure A.1](#) may be used for a rapid estimation of the specific energy.

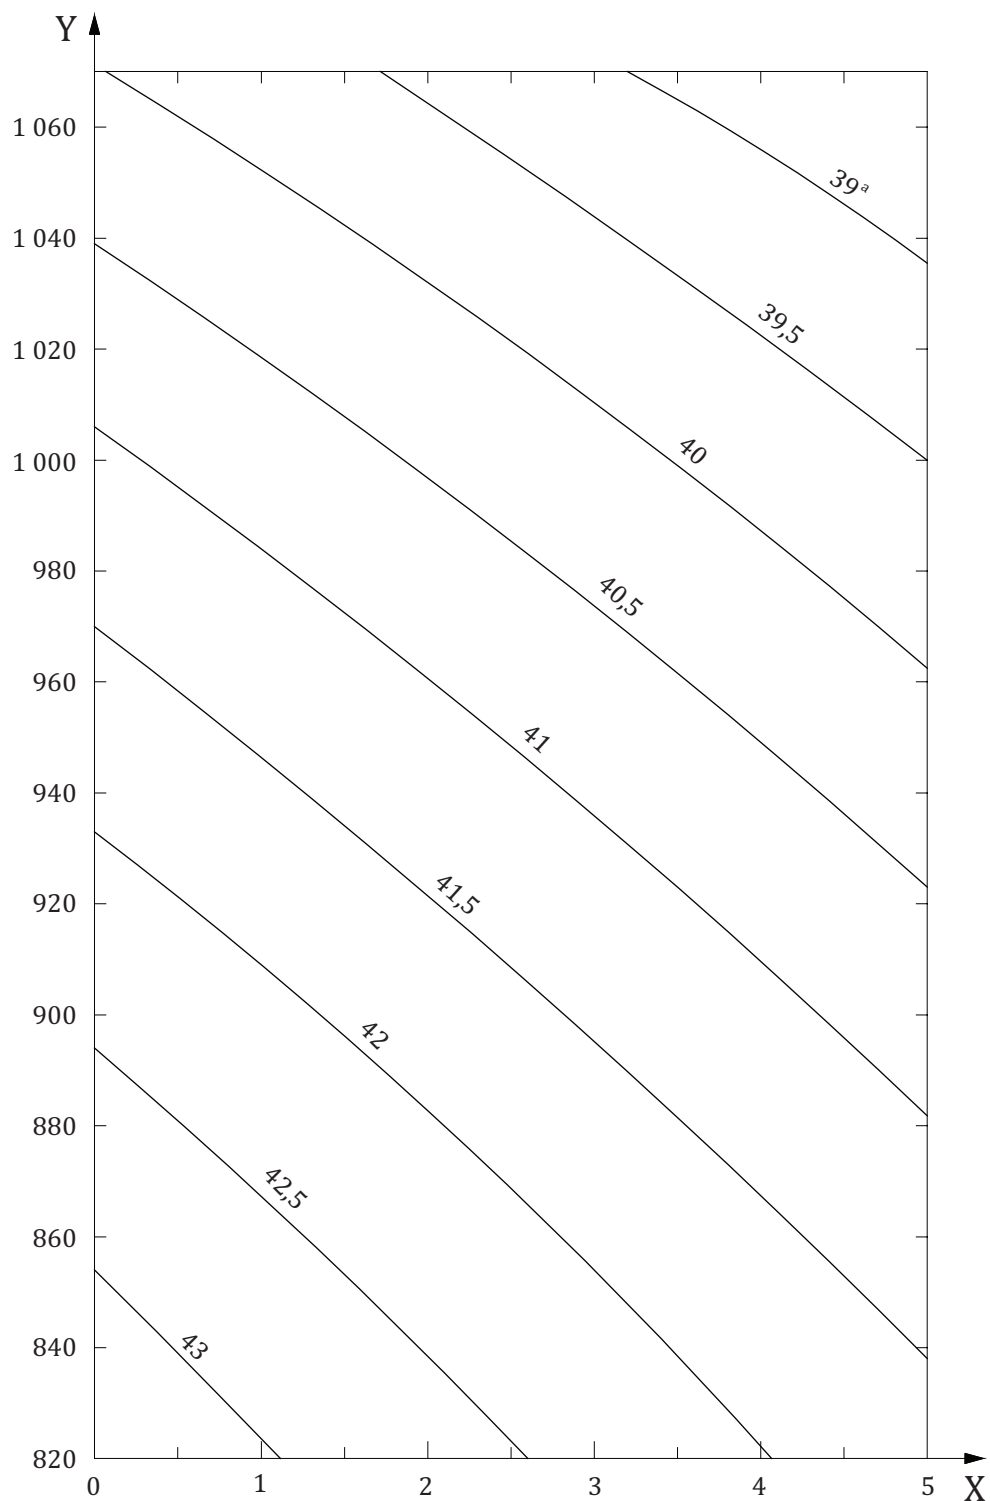

Key

- X sulfur content, expressed as a percentage by mass
- Y density at 15 °C, expressed in kilogram per cubic metre
- a Specific energy.

Figure A.1 — Specific energy expressed in megajoules per kilogram

Annex B (informative)

Trace metal limits of fuel entering turbine combustion chambers

B.1 Introduction

The turbine user should confirm that arrangements are made to ensure that the fuel entering the combustion chambers meets the manufacturer's requirements. This might include transportation arrangements with the fuel supplier, particular care in fuel storage, quality control at the point of use, and fuel purification procedures. Distillate fuels are usually of satisfactory purity as refined fuels, but suppliers rarely have control over possible trace contamination by metals during distribution and storage. The limits in the present Annex, although recommended for the fuel entering combustion chambers, do not apply to the fuel as delivered unless mutually agreed upon by the interested parties. Fuels may, therefore, require further treatment, quality control procedures, special handling, or other arrangements. The significance of trace metals in respect to hot corrosion of turbine components is discussed in C.4. In the absence of specific guidance from the turbine manufacturer, the present Annex gives guideline limits for trace metals in the fuel entering the combustion chambers. These limits are shown in [Table B.1](#).

B.2 Analytical methods

Appropriate reference methods for the determination of trace metals are under development. Other methods may be agreed between the user, fuel supplier, and turbine manufacturer for quality control purposes. Adapted methods for the determination of concentrations of sodium, potassium, calcium, and lead are under development. For vanadium, the recommended method is ISO 8691; for sodium, potassium, lead, and calcium, a suitable method is ASTM D 3605^[Z] or equivalent methods pending the publication of relevant International Standards.

B.3 Exceptions to [Table B.1](#)

There is a relationship between operating conditions, materials, material life, and the corrosive trace metal content of the fuel. However, although maintenance may be reduced and the life of turbine parts prolonged by exceptionally low levels of metals in fuels, the availability of such fuels may be restricted. The user may choose to adopt levels different from those of [Table B.1](#) if, after discussion with the turbine manufacturer and the fuel supplier, he determines that his overall operation can thereby be optimized.

B.4 Alternative to trace metals determination

In order to minimize high-temperature corrosion, it is important that the melting point of the ash be well above the maximum temperature of materials in the gas passage. Therefore, by agreement between the manufacturer of the turbine and the user, either the melting point or the sticking point can be determined and may be used as an alternative to the limits given in [Table B.1](#). This point is discussed further in C.4.

B.5 Fuel purification procedures

The turbine user and manufacturer should agree on the most appropriate method for the removal of solid contaminants and water-soluble compounds so as to ensure the required final quality of the oil at the entrance to the turbine combustion chambers. Fuels of categories 3 and 4 near the density limit specified in [Table B.1](#) may require special consideration or the limits be modified to relate to existing fuel purification systems available.

Dimensions in milligrams per kilogram

Table B.1 — Guideline maximum limits for trace metals in fuel entering turbine combustion chambers

Category	Vanadium (V)	Sodium plus potassium (Na + K)	Calcium (Ca)	Lead (Pb)
DST.0 DST.1/DMT.1 DST.2/DMT.2 DST.3/DMT.3	0,5	0,5	0,5	0,5
RST.3/RMT.3 RST.4/RMT.4	Consult turbine manufacturer			

B.6 Sampling for trace metal determinations

B.6.1 General

For the purposes of control of trace metals, fuel may be sampled at a point upstream from the point of entry to the combustion chambers, provided that the sample is representative of fuel entering the combustion chambers. Because of the extremely low levels of elements being analysed in distillate fuels, great care has to be taken to ensure that the sample taken for analysis is representative.

B.6.2 Fuel sampling points

Sampling of the fuel at the critical points in the fuel system is recommended to assess the quality of the delivered fuel, to monitor the performance of the fuel clean-up or treatment system, and to ensure that the fuel at the gas turbine combustion chambers meets specifications. The sampling points will depend upon the specific fuel system in question. These will include:

- a) a sample taken on delivery during transfer into the fuel storage tank;
- b) fuel storage tank samples, including both tank bottom samples and samples at various levels in the tank. These should be taken at a frequency determined by the user based on the rate of accumulation of water and other dispersed contaminants. Where the system consists of multiple tankage, it is suggested that such samples be taken preparatory to drawing fuel from a given tank. Where the gas turbine is used for standby or emergency service, the sample should be taken according to a closely observed schedule;
- c) input and output samples in installations which include fuel clean-up and/or treatment to monitor the performance of the equipment;
- d) input and output samples to monitor the effectiveness of fuel filters;

- e) a sample taken as close as practicable to the gas turbine combustion chambers, which is essential to ensure that the fuel meets specifications, especially for critical thresholds of trace metal contaminants.

B.6.3 Sample containers

Samples destined specifically for analysis of trace metals should be taken in containers manufactured from plastics materials which are hydrocarbon resistant and low in trace metal content. These materials include polyethylene, polypropylene, and polytetrafluorethylene. Metal and glass containers with unperforated liners of hydrocarbon-resistant plastic film materials are also suitable. Unlined metal and glass containers, while suitable for sampling for some analyses, can both add and remove significant amounts of trace metal contaminants.

The sample container should be filled only three-quarters full to allow shaking of the contents before the sample aliquot is taken for analysis.

B.6.4 Inspection and analysis of samples

Inspection and analysis of fuel to determine fuel quality at various sampling locations and at different times in the fuel storage tanks and the feed system are very important to ensure that only fuel of acceptable quality will reach the turbine combustion chambers. Brief visual inspections may serve to suggest the presence of some contaminants, but established methods of fuel analysis, including chemical analysis for trace elements, are needed for more complete evaluation of fuel quality.

The effectiveness of a fuel separation system can best be judged by the use of specialized analytical methods, as recommended by the suppliers of the equipment or the fuel. These might include measurement of conductivity, dielectric properties, colour, content and quality of particulate matter, turbidity, spectral properties, or filterability. From such data, useful deductions may be made to supplement more detailed chemical analysis.

Annex C (informative)

Significance of specifications for gas turbine fuels

C.1 Introduction

The properties selected for specification in [Table 1](#) are those that are considered to be of most importance in determining the characteristics of fuels used in various gas turbine applications, and are chosen to ensure that adequate care has been taken in the handling of these fuels prior to the transfer of custody to the user. In general, these specifications are the same as those required for fuels used in industrial and marine engines and boilers, but gas turbine experience has shown that additional controls on the chemical nature of the fuel ash are desirable to restrict the corrosion potential of certain slag-forming substances which can be deposited on those turbine parts which may operate above 590 °C. This topic is discussed in [Annex B](#) above, and further details are given in C.4.

C.2 Significance of properties specified in [Table 1](#)

C.2.1 Flash point

The flash point is a guide to the fire hazard associated with the storage and use of gas turbine fuels. Specification of minimum flash point temperature is usually mandatory.

C.2.2 Viscosity

Viscosity is a measure of the resistance of the fuel to flow. For gas turbine fuels, it is extremely important, as it is a measure of how well the fuel will flow or can be pumped and also of the ease of atomization at the fuel nozzles.

A minimum viscosity is specified for categories 0, 1, 2, and 3, as some fuel pumps may not operate satisfactorily if the viscosity is below this figure. A maximum viscosity is specified for these fuels to prevent excessive pressure losses in the system, pumping problems, and poor atomization. For category 4, a maximum viscosity is specified because of possible limitations of the fuel preheating equipment. However, fuels of a maximum viscosity higher than that specified for this category may be used, subject to agreement between suppliers, turbine manufacturers, and turbine users. In this case, the limitation will be the maximum heat load in the fuel preheater. This load should not exceed 1,5 W/cm² in a dynamic system or 1,2 W/cm² in a static system, and the maximum preheater surface temperature should be 175 °C to avoid fouling problems.

C.2.3 Density

Knowledge of the fuel density is necessary to establish mass/volume relationships and to calculate specific energy. Maximum densities are specified for categories 2, 3, and 4 to ensure that water can be separated in any fuel treatment process, although for fuels for which these maximum densities are approached, special considerations regarding water separation may be needed.

C.2.4 Distillation

Specifications on other fuel properties in the case of categories 0, 1, and 2 make it unnecessary to specify distillation requirements, apart from the maximum 90 % recovery temperature which is included to control high-boiling material that could affect combustion performance. Fiscal requirements for fuels may require further controls on distillation limits to be specified in some countries.

No distillation requirements are considered necessary for categories 3 and 4, but turbines designed to operate on these fuels may have to start up initially using a fuel of the more volatile categories.

C.2.5 Low-temperature operability

A number of test methods for assessing low-temperature operability of gas turbine fuels are available. The method chosen will depend on the category of fuel and on local practice.

C.2.5.1 Category 0

No requirements need be specified as this category will flow freely under all conditions of storage and use. Use at extreme temperatures however, of below $-50\text{ }^{\circ}\text{C}$, may need a demonstration of suitability.

C.2.5.2 Category 1

Kerosine-type jet fuels should flow freely under all conditions of storage and use down to $-30\text{ }^{\circ}\text{C}$. The freezing point test (see ISO 3013) indicates the minimum flow temperature of fuels stored at lower temperatures.

C.2.5.3 Category 2

There are several different methods for assessing low-temperature properties of gas-oil type fuels.

- a) **Cloud point** (for determination, see ISO 3015), i.e. the temperature, expressed to the nearest $1\text{ }^{\circ}\text{C}$, at which a cloud or haze of wax crystals appears at the bottom of the test jar when the oil is cooled under specified conditions. It is the most restrictive method of low-temperature performance assessment. Most gas-oil type fuels are still capable of flow at temperatures somewhat below their cloud point, but at such temperatures, any fine filter in the fuel line may become obstructed and restrict or prevent flow.
- b) **Pour point** (for determination, see ISO 3016), i.e. the lowest temperature at which movement of the oil is observed when the sample is cooled under prescribed conditions and examined at intervals of $3\text{ }^{\circ}\text{C}$ for flow characteristics. Pour point can be reduced significantly by the use of certain types of additives (see 4.2).
- c) **Cold filter plugging point**¹⁾, i.e. the highest temperature, expressed to the nearest $1\text{ }^{\circ}\text{C}$, at which the fuel, when cooled under the prescribed conditions, either will not flow through a fine mesh filter or a nominal aperture width of $45\text{ }\mu\text{m}$ or will require more than 60 s for 20 ml of fuel to pass such a filter or aperture when subjected to a vacuum of 2,0 kPa.

C.2.5.4 Categories 3 and 4

These fuels usually require provision of heating facilities for storage and handling. For fuels approaching the maximum viscosity allowed for category 4, a minimum storage temperature of $45\text{ }^{\circ}\text{C}$ and a minimum tank outflow temperature of $55\text{ }^{\circ}\text{C}$ are required. Guidance on type of equipment required and the minimum storage and outflow temperatures should be obtained.

C.2.6 Carbon residue

The test for carbon residue measures the amount of carbonaceous residue formed during the evaporation and pyrolysis of a petroleum product when burnt with limited excess air. It is intended to provide some indication of the relative coke-forming tendency. The residue is not entirely formed of carbon but is a coke which can be changed further by pyrolysis. Petroleum products containing naturally occurring ash-forming constituents or additives will have an erroneously high carbon residue when measured by the test, depending on the amount of ash which can be formed.

1) Pending the publication of an International Standard, a suitable method has been prepared by the European Committee for Standardization (CEN) as EN 116, *Diesel and domestic heating fuels — Determination of cold filter plugging point*.

For fuel categories 0, 1, and 2, the carbon residue is determined on the residuum after 90 % of the fuel has been distilled. This improves the precision of the test.

Combustion systems designed for use on fuel categories 0, 1, 2, and 3 will be insensitive to carbon residue within the specification limits set for these categories. No limit is specified for category 4, but carbon residue should be determined and reported to permit evaluation of fuel behaviour in combustion systems.

C.2.7 Ash

The ash test specified in [Table 1](#) should not be related to the corrosive ash-forming tendencies discussed in C.4. This test (see ISO 6245) measures material remaining after combustion at 775 °C from ash-forming constituents naturally present in the fuel or from additives or inorganic contaminants.

Fuel ash can form deposits in the hot gas path through the turbine and affect satisfactory performance. It may also cause high-temperature corrosion of metal surfaces. This aspect is dealt with in more detail in C.4 and C.2.9.

C.2.8 Water and sediment

The limits for this adventitious contamination are set at the lowest level, consistent with normal transport and handling procedures and with the propensity of a particular category of fuel to hold these materials in suspension. Sediment is defined for this purpose as material insoluble in toluene (see C.4.2.2).

C.2.9 Sulfur

Sulfur is present to some degree in all petroleum fuels. Category selection will normally be made on economic and performance grounds, but fuel sulfur content may be a limiting factor in some localities owing to environmental requirements, and lower maximum limits may need to be specified.

The sulfur components in the fuel are converted to sulfur oxides during the combustion process. These can be corrosive to heat exhaust equipment used in tandem with a gas turbine where metal surfaces are below the sulfuric acid dewpoint. The minimum metal temperatures of such surfaces should be kept above this dewpoint to avoid low-temperature corrosion.

While the sulfur oxides are not by themselves harmful to the hot sections of the gas turbine, they will combine with any traces of alkali metals in the fuel to form sulfates which can participate in high-temperature metal corrosion.

C.2.10 Copper corrosion

Corrosive sulfur, if present in appreciable amounts, can result in corrosive attacks on metallic fuel-handling components of a gas turbine installation.

C.2.11 Calculated specific energy

C.2.11.1 Fuel quantities

The calculated lower specific energy is given as a guide to the minimum value of energy output that can be expected for each category of fuel. It is not a critical parameter for routine gas turbine operation but rather serves to estimate fuel needs and aids the user and fuel supplier in negotiations.

The formula given in [Annex A](#) is a convenient method for calculation of specific energy compared to other experimental techniques. The accuracy depends largely on the accuracy with which density and the proportions by mass of water, ash, and sulfur are measured.

In general, these properties can be measured with greater precision than the specific energy by experimental techniques. Because of coefficients in the formula which depend on the chemical composition of the fuel itself, the formula may from time to time need revision as refining techniques and crude sources change.

C.2.11.2 Turbine performance

When gas turbine performance is being evaluated, precise values for the specific energy and density are needed to establish exactly how much fuel energy is being consumed by the turbine as the output is being measured.

In this case, the higher specific energy at constant volume may be determined by means of a bomb calorimeter such as that described in ASTM D 240^[8] and the lower specific energy at constant volume determined by deducting the latent heat of the calculated amount of water vapour produced from the measured hydrogen content of the fuel. The technique used to measure specific energy is usually agreed upon prior to the performance test. It is recommended that samples of fuel at the beginning, during, and at the end of the test are evaluated.

C.3 Category selection

C.3.1 General considerations

The selection of a particular gas turbine fuel for use in a given gas turbine requires consideration of a number of factors, including

- a) the availability of the fuel,
- b) the design of the gas turbine and fuel-handling system,
- c) the maintenance of the gas turbine, and
- d) the operating requirements of the gas turbine.

For guidance, commercially available fuel streams are indicated below in the category into which they fall in this specification.

C.3.2 ISO-F-DST.0

This category includes light naphthas from petroleum processing, condensate naphthas from natural gas processing, wide-cut aviation fuel, and other low flash point and low viscosity hydrocarbon liquids. Fuels in this category may have high vapour pressures at ambient temperatures, which will affect the design of fuel-handling systems.

C.3.3 ISO-F-DST.1/DMT.1

This category is a light distillate fuel suitable for use in nearly all gas turbines. It includes aviation and domestic kerosines and some light gas-oil components that do not meet the flash point requirements of category ISO-F-DST.2/DMT.2.

C.3.4 ISO-F-DST.2/DMT.2

This category includes most automotive, domestic, industrial, and marine gas oils; heating of the fuel may be required for satisfactory fuel handling, depending on the fuel system design and/or the ambient conditions.

C.3.5 ISO-F-DST.3/DMT.3 and ISO-F-RST.3/RMT.3

This category may be a heavy distillate fuel, a light residual fuel meeting the low ash and carbon residue requirements, or a blend of distillate fuel with residual fuel. A typical example would be blended marine diesel fuel.

C.3.6 ISO-F-RST.4/RMT.4

This category includes most residual fuel oils and some topped crude oils. Since special fuel handling and treatment requirements and operating condition restrictions are likely to apply, the gas turbine manufacturer should be consulted on the acceptability of fuel properties related to his gas turbine.

C.4 Significance of properties indicated in [Annex B](#)

C.4.1 Fuel ash

Ash results from the non-combustible material in a fuel. Ash-forming contaminants occur in liquid fuels in three forms: suspended solid particulates, dispersed salt water, and oil-soluble compounds. The solid particulates and salt water can cause maintenance problems in the fuel system. A greater concern is the formation of fouling and corrosive combustion ash deposits from all three types of ash-forming contaminants when the fuel is burned. With distillate-type fuels, these potential problems can be avoided or minimized by maintaining strict cleanliness of the fuel.

The primary condition for corrosion of a metal surface in a hot gas path by an overlying ash deposit is that the metal temperature be higher than the melting point of the ash. A melted ash can dissolve a protective oxide layer and attack the metal substrate, whereas a dry ash could be inert or interact with the underlying metal at a much slower rate. Different compounds present in the combustion ash have different melting points, depending on the specific chemical composition of the ash and the local turbine environment. The major metallic elements occurring in fuel which contribute to corrosion are sodium, potassium, vanadium, and lead.

Even very small concentrations of corrosive contaminants in fuel can form significant ash deposits. As an example, at a fuel consumption rate of 25 t/h, each 1 mg of ash per kilogram of fuel means 25 g of ash passing through the turbine each hour.

The total ash in distillate fuels is usually very small and is the result of salt water or gasoline contamination during fuel transportation, handling, and storage. Residual fuels (and crude oils) have much higher ash contents due to a higher retention of dispersed water and solids and to the presence of soluble organometallic compounds of vanadium, nickel, and possibly, iron. The ash content of distillate fuels is normally less than 100 mg/kg fuel and is typically 2 mg/kg to 10 mg/kg for a clean fuel. Residual fuels, on the other hand, may contain several hundred milligrams of ash per kilogram, usually necessitating complete fuel treatment (desalting and vanadium inhibition by an additive, usually magnesium- and sometimes silicon-based).

Ash-forming contaminants may also enter the gas turbine in the turbine inlet air, particularly in marine and industrial environments. Unless removed by proper inlet air filtration, these airborne contaminants by themselves, or in combination with fuel ash, may also cause corrosion of hot metal parts.

C.4.2 Corrosive fuel ash

Corrosive combustion ash will form whenever there are significant contaminant levels of vanadium, sodium, potassium, or lead in a liquid fuel.

C.4.2.1 Vanadium

Vanadium occurs as an oil-soluble organometallic compound in crude oils, varying in concentration from less than 1 mg/kg to over 100 mg/kg depending largely on the geographic origin of the crude oil. During petroleum refining, the vanadium concentrates in the residual oil, the distillates being virtually vanadium free. Vanadium cannot be economically removed from crude oils or residual oils to produce vanadium-free fuels.

During combustion, vanadium is converted to vanadium pentoxide, melting at 675 °C. If sodium is present with vanadium, sodium vanadates with melting points as low as 535 °C can form.

The melting point of the ash can be raised by adding a magnesium compound to the fuel. Excess sodium content will counteract this reaction, so consequently the lower the sodium content, the better the response to the magnesium additive. Silicon compounds exert a physical dilution effect, reducing the corrosive action of sodium/vanadium complexes. Whenever additives are used, fouling but nonaggressive ash deposits will build up in the turbine hot gas path and reduce the output of the turbine. They have to be removed periodically to maintain turbine performance.

C.4.2.2 Sodium and potassium

Sodium and potassium are components of salt water, a common contaminant in liquid petroleum fuels. The sodium concentration in salt water is several times the concentration of potassium, and both are capable of forming highly corrosive combustion ash.

Sodium sulfate is formed when liquid fuels are burned; it melts at 884 °C, causing “sulfidation” attack.

Sodium- and potassium-caused corrosion is usually controlled by removal of salt water from the fuel by settling, centrifuging or electrostatic separation, or coalescing filtration. Careful design and management of storage facilities, combined with adequate settling times, will contribute to fuel cleanliness, thus significantly reducing the effects of water-soluble contaminants, and may reduce the need for further separation techniques. Chromium-based additives have been reported to be effective in combatting the corrosive action of sodium.

C.4.2.3 Lead

The presence of lead in gas turbine distillate fuels is usually the result of the fuel being contaminated with leaded gasoline or used lubricating oils during transportation and handling. Lead contaminants are oil-soluble and cannot be removed by fuel cleaning. During combustion, lead is converted to lead oxide or lead sulfate. These compounds have fairly high melting points, but the presence of minor amounts of sodium will lower the ash melting point to around 600 °C.

Strict fuel management during transportation, handling, and storage is the best way to avoid lead contaminants. Some success has been reported in using additives based on magnesium and chromium to increase the ash melting point of a lead-containing fuel.

C.4.2.4 Other elements

Nickel, zinc, arsenic, and other heavy metals which are sometimes present in category 4 fuels may form low-melting eutectics with other metals and cause corrosion.

C.4.2.5 Ash content

The amounts of all harmful elements should be kept as low as possible in a gas turbine fuel. However, the ash content has a great influence on the corrosive effect of these elements. The effect of 1 mg sodium and 1 mg vanadium per kilogram fuel can have different significances depending on the total ash content. This is shown in [Table C.1](#).

Table C.1 — Influence of ash content

	Fuel A	Fuel B
Sodium content	1 mg/kg fuel	1 mg/kg fuel
Vanadium content	1 mg/kg fuel	1 mg/kg fuel
Ash content	10 mg/kg fuel	100 mg/kg fuel
Na + V as % of total ash content	20 % (m/m)	2 % (m/m)
Influence on ash melting point	Great	Small

Fuel A can be corrosive in the gas turbine while Fuel B can be acceptable, despite the fact that they have the same sodium and vanadium contents. The behaviour of the ash of Fuel A can be converted into that of the ash of Fuel B by adding an additive that contributes a further 90 mg/kg fuel of inert or high melting point material to the ash.

C.4.3 Fouling ash deposits

The combustion ash may be harmless due to its high melting point, but accumulation of fouling deposits will disturb blade and vane efficiency and reduce throughput area, resulting in decreased power and increased fuel consumption. The rate of build-up of fouling deposits is a function of many factors, such as total fuel ash content and composition, particle capture efficiency, turbine operating temperature, turbine design, and size.

Additive combinations, like magnesium + silicon, can significantly reduce the fouling rate. The turbine manufacturer should always be consulted for recommendations for the use of such additive combinations.

The use of high ash content fuel of category 3 or 4 may result in fouling to such a degree that periodic ash removal from the turbine hot gas path is required.

Calcium in a fuel is not harmful from a corrosion standpoint; in fact, it serves to inhibit the corrosive action of vanadium. However, calcium can lead to hard-bonded deposits difficult to remove even with water washing. Calcium is not a problem with distillate fuel categories 0, 1, and 2, but it may occur in category 3 and 4 fuels. Fuel-washing systems, normally required for category 3 and 4 fuels, also reduce the calcium contaminant level.

C.4.4 Fuel ash evaluation

A fuel ash evaluation should provide information on both the amount of ash formed during fuel combustion and the potential corrosiveness of this ash. The total amount of ash is determined by carefully burning a measured volume of fuel in the laboratory and weighing the residue obtained from ashing the combustion residue.

Two methods are available for assessing the potential corrosiveness of the combustion ash. The first is the determination of the trace metallic element concentrations in the fuel. The second is a melting point measurement of a fuel ash prepared in the laboratory. Turbine manufacturers set limits on trace metal contents or ash melting point (ash sticking temperature may be used in place of ash melting point) based on correlations with turbine performance experience. Both ash evaluation methods have an uncertainty because the ash deposit formed at a given point in the turbine hot gas path may not have the same composition as the ash produced outside the turbine in the laboratory. Ash-forming elements may not deposit in the turbine in the same proportions in which they are present in the fuel. Composition of turbine deposits can differ at different deposition sites, and given deposits may not be homogeneous.

Low ash content distillate fuels require very careful burning and subsequent ashing of large quantities of fuel to provide the minimum amount of ash required for ash content determination and for ash melting point tests.

Bibliography

- [1] ISO 3013, *Petroleum products — Determination of the freezing point of aviation fuels*
- [2] ISO 3015, *Petroleum products — Determination of cloud point*
- [3] ISO 3016, *Petroleum products — Determination of pour point*
- [4] ISO 3977, *Gas turbines — Procurement*
- [5] ISO 8216-2:1986, *Petroleum products — Fuels (class F) — Classification — Part 2: Categories of gas turbine fuels for industrial and marine applications*
- [6] ISO 8691, *Petroleum products — Low levels of vanadium in liquid fuels — Determination by flameless atomic absorption spectrometry after ashing*
- [7] ASTM D 3605:2000, *Trace metals in gas turbine fuels by atomic absorption and flame emission spectroscopy*
- [8] ANSI. ASTM D 240-09, *Heat of combustion of liquid hydrocarbon fuels by bomb calorimeter*

British Standards Institution (BSI)

BSI is the national body responsible for preparing British Standards and other standards-related publications, information and services.

BSI is incorporated by Royal Charter. British Standards and other standardization products are published by BSI Standards Limited.

About us

We bring together business, industry, government, consumers, innovators and others to shape their combined experience and expertise into standards-based solutions.

The knowledge embodied in our standards has been carefully assembled in a dependable format and refined through our open consultation process. Organizations of all sizes and across all sectors choose standards to help them achieve their goals.

Information on standards

We can provide you with the knowledge that your organization needs to succeed. Find out more about British Standards by visiting our website at bsigroup.com/standards or contacting our Customer Services team or Knowledge Centre.

Buying standards

You can buy and download PDF versions of BSI publications, including British and adopted European and international standards, through our website at bsigroup.com/shop, where hard copies can also be purchased.

If you need international and foreign standards from other Standards Development Organizations, hard copies can be ordered from our Customer Services team.

Subscriptions

Our range of subscription services are designed to make using standards easier for you. For further information on our subscription products go to bsigroup.com/subscriptions.

With **British Standards Online (BSOL)** you'll have instant access to over 55,000 British and adopted European and international standards from your desktop. It's available 24/7 and is refreshed daily so you'll always be up to date.

You can keep in touch with standards developments and receive substantial discounts on the purchase price of standards, both in single copy and subscription format, by becoming a **BSI Subscribing Member**.

PLUS is an updating service exclusive to BSI Subscribing Members. You will automatically receive the latest hard copy of your standards when they're revised or replaced.

To find out more about becoming a BSI Subscribing Member and the benefits of membership, please visit bsigroup.com/shop.

With a **Multi-User Network Licence (MUNL)** you are able to host standards publications on your intranet. Licences can cover as few or as many users as you wish. With updates supplied as soon as they're available, you can be sure your documentation is current. For further information, email bsmusales@bsigroup.com.

BSI Group Headquarters

389 Chiswick High Road London W4 4AL UK

Revisions

Our British Standards and other publications are updated by amendment or revision.

We continually improve the quality of our products and services to benefit your business. If you find an inaccuracy or ambiguity within a British Standard or other BSI publication please inform the Knowledge Centre.

Copyright

All the data, software and documentation set out in all British Standards and other BSI publications are the property of and copyrighted by BSI, or some person or entity that owns copyright in the information used (such as the international standardization bodies) and has formally licensed such information to BSI for commercial publication and use. Except as permitted under the Copyright, Designs and Patents Act 1988 no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means – electronic, photocopying, recording or otherwise – without prior written permission from BSI. Details and advice can be obtained from the Copyright & Licensing Department.

Useful Contacts:

Customer Services

Tel: +44 845 086 9001

Email (orders): orders@bsigroup.com

Email (enquiries): cservices@bsigroup.com

Subscriptions

Tel: +44 845 086 9001

Email: subscriptions@bsigroup.com

Knowledge Centre

Tel: +44 20 8996 7004

Email: knowledgecentre@bsigroup.com

Copyright & Licensing

Tel: +44 20 8996 7070

Email: copyright@bsigroup.com



...making excellence a habit.™