

BS ISO 10803:2011



BSI Standards Publication

Design method for ductile iron pipes

bsi.

...making excellence a habit.™

National foreword

This British Standard is the UK implementation of ISO 10803:2011.

The UK participation in its preparation was entrusted to Technical Committee PSE/10, Iron pipes and fittings.

A list of organizations represented on this committee can be obtained on request to its secretary.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

© The British Standards Institution 2012

ISBN 978 0 580 65917 1

ICS 23.040.10

Compliance with a British Standard cannot confer immunity from legal obligations.

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 31 January 2012.

Amendments issued since publication

Date	Text affected
------	---------------

INTERNATIONAL STANDARD

BS ISO 10803:2011

ISO
10803

Second edition
2011-12-01

Design method for ductile iron pipes

Méthode de calcul des tuyaux en fonte ductile



Reference number
ISO 10803:2011(E)

© ISO 2011



COPYRIGHT PROTECTED DOCUMENT

© ISO 2011

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
Case postale 56 • CH-1211 Geneva 20
Tel. + 41 22 749 01 11
Fax + 41 22 749 09 47
E-mail copyright@iso.org
Web www.iso.org

Published in Switzerland

Contents

Page

Foreword	iv
1 Scope	1
2 Normative references	1
3 Terms and definitions	1
4 Design procedure	2
5 Design for internal pressure	3
6 Design for external loads	3
Annex A (informative) Dimensions of preferred and other class pipes	9
Annex B (informative) Allowable depths of cover for pipes conforming to ISO 2531	12
Annex C (informative) Allowable depths of cover for pipes conforming to ISO 7186	54
Annex D (informative) Trench types	58
Annex E (informative) Soil classification	59
Bibliography	60

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 2.

The main task of technical committees is to prepare International Standards. Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

ISO 10803 was prepared by Technical Committee ISO/TC 5, *Ferrous metal pipes and metallic fittings*, Subcommittee SC 2, *Cast iron pipes, fittings and their joints*.

This second edition cancels and replaces the first edition (ISO 10803:1999), which has been technically revised.

Design method for ductile iron pipes

1 Scope

This International Standard specifies the design of ductile iron pipes used for conveying water, sewerage and other fluids

- with or without internal pressure, and
- with or without earth and traffic loading.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 2531, *Ductile iron pipes, fittings, accessories and their joints for water applications*

ISO 7186, *Ductile iron products for sewerage applications*

ISO 7268, *Pipe components — Definition of nominal pressure*

ISO 10802, *Ductile iron pipelines — Hydrostatic testing after installation*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in ISO 7268 and the following apply.

3.1

allowable operating pressure

PFA

maximum internal pressure, excluding surge, which a component can safely withstand in permanent service

3.2

allowable maximum operating pressure

PMA

maximum internal pressure, including surge, which a component can safely withstand in service

3.3

allowable site test pressure

PEA

maximum hydrostatic pressure that a newly installed component can withstand for a relatively short duration, when either fixed above ground level or laid and backfilled underground, in order to ensure the integrity and leaktightness of the pipeline

NOTE This test pressure is different from the system test pressure, which is related to the design pressure of the pipeline.

**3.4
embedment**
arrangement and type(s) of material around a buried pipeline, which contribute to its structural performance

See Figure D.1.

**3.5
bedding**
lower part of the embedment, composed of the lower bedding (if necessary) and the upper bedding

See Figure D.1.

**3.6
bedding reaction angle**
conventional angle used in the calculation model to account for the actual soil pressure distribution at pipe invert

**3.7
compaction**
deliberate densification of soil during the installation process

**3.8
standard Proctor density**
degree of soil compaction, as defined in AASHTO T99 using a 2,5 kg rammer and a 305 mm drop

4 Design procedure

4.1 The pipe wall thickness shall provide adequate strength against the internal pressure of the fluid and against the effects of external loads due to backfill and surcharge, i.e. traffic loadings.

Ductile iron pipes in compliance with ISO 2531 are classified according to their allowable operating pressure for use in water applications. Ductile iron pipes in compliance with ISO 7186 are for sewerage applications either under pressure or under gravity. Using the equations given in Clauses 5 and 6, the design of buried pipes is performed by determining

- a) the minimum pipe wall thickness for the allowable operating pressure (PFA), and
- b) the depths of cover as given in Annexes B and C.

4.2 The design procedure for the pipes is the following:

- a) from the allowable operating pressure of the pipeline, select the class of pipe as appropriate from ISO 2531 or ISO 7186 [the minimum pipe wall thickness of these pipes has been calculated from Equation (1)];
- b) calculate the allowable depth of cover in accordance with Clause 6;
- c) if the allowable depth of cover is not adequate, select higher a pressure class of pipe and repeat steps 4.2 a) and b) until the allowable depth of cover is acceptable.

NOTE 1 In practice, in most cases, the pressure class and the allowable depth of cover for the pipes can be selected from the appropriate tables in Annexes B or C without carrying out the detailed calculations as explained above.

NOTE 2 When installed and operated under the conditions for which they are designed, ductile iron pipes, fittings, accessories and their joints maintain all their functional characteristics over their operating life, due to constant material properties, to the stability of their cross-section and to their design with high safety factors.

NOTE 3 In certain countries, national standards or regulations can specify other design procedures.

5 Design for internal pressure

5.1 Design equation for wall thickness

The minimum wall thickness of pipes, e_{\min} , shall be not less than 3 mm (as specified in ISO 2531) or 2,4 mm (ISO 7186) and shall be determined using Equation (1):

$$e_{\min} = \frac{\text{PFA} \times \text{SF} \times \text{DE}}{20R_m + (\text{PFA} \times \text{SF})} \quad (1)$$

where

- e_{\min} is the minimum pipe wall thickness to resist hoop stress due to internal pressure, in millimetres;
- PFA is the allowable operating pressure, in bar¹⁾ (see 5.2);
- SF is the design safety factor (see 5.2);
- DE is the nominal pipe external diameter, in millimetres (see Annex A);
- R_m is the minimum ultimate tensile strength of the ductile iron, in megapascals ($R_m = 420$ MPa in ISO 2531 and ISO 7186).

Nominal wall thickness, e_{nom} , of the pipe is calculated as given by Equation (2):

$$e_{\text{nom}} = e_{\min} + (1,3 + 0,001\text{DN}) \quad (2)$$

where DN is the nominal diameter of pipe as defined in ISO 2531 and ISO 7186, in millimetres.

Nominal pipe wall thicknesses for various classes in accordance with ISO 2531 are given in Table A.1 and nominal pipe wall thicknesses for pressure and gravity pipe classes in accordance with ISO 7186 are given in Table A.2.

5.2 Design safety factors

The minimum pipe wall thickness, e_{\min} , shall be calculated with a design safety factor of 2,5 for the maximum allowable operating pressure (i.e. PMA as indicated in ISO 2531 and ISO 7186) and a design safety factor of 3 for the allowable operating pressure (i.e. PFA as indicated in ISO 2531 and ISO 7186).

NOTE This allows field testing of installed ductile iron pipelines in compliance with ISO 10802 by application of test pressures up to the allowable test pressures given in ISO 2531 and ISO 7186.

6 Design for external loads

6.1 Design equation

$$\Delta = 100 \frac{K_x q}{8S + 0,061E'} \quad (3)$$

or

1) 100 kPa = 1 bar = 0,1 MPa; 1 MPa = 1 N/mm².

$$q = \frac{\Delta(8S + 0,061E')}{K_x + 100} \quad (3)$$

where

Δ is the pipe diametral deflection, in percent of external diameter, D ;

K_x is the deflection coefficient depending on bedding reaction angle;

q is the vertical pressure at pipe crown due to all external loads, in megapascals;

S is the pipe diametral stiffness, in megapascals,

$$S = \frac{EI}{(D)^3}$$

where

E is the modulus of elasticity of the pipe wall material, in megapascals (170 000 MPa for ductile iron);

$I = \left(\frac{e_{\text{stiff}}^3}{12} \right)$ is the second moment of area of the pipe wall per unit length, in millimetres to the third power;

D is the mean diameter of pipe ($DE - e_{\text{stiff}}$), in millimetres;

DE is the nominal pipe external diameter as specified in ISO 2531 and ISO 7186, in millimetres;

e_{stiff} is the average of the minimum pipe wall thickness of the pipe and nominal wall thickness of pipe, in millimetres;


E' is the modulus of soil reaction, in megapascals.

Pipe material stiffness values, S , may be taken from the relevant annexes of ISO 2531 and ISO 7186.

The values of E' and K_x are given in Table 1 for each trench type and soil group.

NOTE The design equation is based on the Spangler model (see Figure 1), where the vertical pressure, q , is acting downward and:

- is uniformly distributed at the pipe crown over a diameter;
- is in equilibrium with a pressure, acting upward at the pipe invert, uniformly distributed over the bedding reaction angle 2α ;
- causes a pipe deflection, which gives rise to a horizontal reaction pressure at pipe sides, parabolically distributed over an angle of 100° .

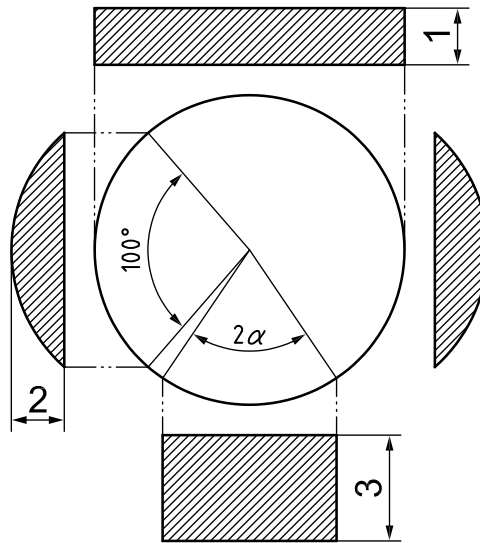

Key

- 1 vertical pressure, q
- 2 lateral reaction pressure = $0,01 \Delta E'$
- 3 vertical reaction pressure = $q/\sin \alpha$

Figure 1 — Spangler model

6.2 Loads applied to the pipe and calculation for the allowable depth of cover

6.2.1 General

The total vertical pressure, q , acting at pipe crown is the sum of the following components:

$$q = q_1 + q_2 \quad (4)$$

where

q_1 is the pressure from earth loads;

q_2 is the pressure from traffic loads;

NOTE The pressure from traffic loads, q_2 , is greater than that from normal static loads applied to the ground surface; however, any abnormal surface loading can require special consideration.

The value of q obtained from Equation (4) is basically a function of H (allowable depth of cover), i.e.

$$q = f'(H) \quad (5)$$

Equating this to Equation (3) (see 6.1):

$$f'(H) = \frac{\Delta \times (8S + 0,061E')}{(K_x) \times (100)} \quad (6)$$

The value of allowable depth of cover, H , may be determined after calculating the value of q as given in 6.2.2 and 6.2.3 and other parameters as defined.

6.2.2 Pressure from earth loads

Equation (7) shall be used to calculate q_1 from the weight of the earth prism immediately above the pipe:

$$q_1 = 0,001\gamma H \quad (7)$$

where

q_1 is the pressure at pipe crown, in megapascals;

γ is the unit weight of the backfill, in kilonewtons per cubic metre;

H is the height of cover (distance from pipe crown to ground surface), in metres.

In the absence of other data, the unit weight of the soil is taken as being equal to 20 kN/m³ in order to cover the vast majority of cases. If a preliminary geotechnical survey determines that the actual unit weight of the backfill is less than 20 kN/m³, the actual value may be used for determining q_1 .

If, however, it appears that the actual value is more than 20 kN/m³, the actual value should be used.

6.2.3 Pressure from traffic loads

The value of q_2 shall be calculated using Equation (8), based on wheel load taken from national and/or local applicable standards and regulations.

$$q_2 = 0,04 \frac{\beta}{H} (1 - 2 \times 10^{-4} \text{ DN}) \quad (8)$$

where

q_2 is the pressure at pipe crown, in megapascals;

β is a traffic load factor; the following are the given values:

- 1,5: this is the general case, except access roads;
- 0,75: roads where truck traffic is prohibited;
- 0,50: all other cases;

H is the height of cover, in metres;

DN is the nominal size.

NOTE 1 Equation (8) is not applicable when $H < 0,3$ m.

In the case where a national standard exists for the traffic loadings, the value of β may be given as follows:

$$\beta = \frac{P}{100} \quad (9)$$

where P is the wheel load, in kilonewtons, for a particular type of road according to the respective national standard.

All pipelines shall be designed for at least $\beta = 0,5$ and pipelines laid adjacent to roads shall be designed to withstand the full road loading.

NOTE 2 For pipelines under railroads or airports or subjected to heavy construction traffic, special requirements can apply according to the respective national standard and regulations.

6.3 Soil and pipe interaction

The bedding reaction angle depends on the installation conditions (bedding, sidefill compaction) and on the pipe diametral deflection (especially for large sizes).

The modulus of soil reaction, E' , of the sidefills depends on the type of soil used for the embedment and upon the trench type (see Annex D). In the absence of applicable standards or other data, the values of E' indicated in Table 1 may be used at the design stage for five typical trench types and for six soil groups (see Annex E for the classification of soils).

These data are valid for pipes laid under embankments as well as in trenches.

A preliminary geotechnical survey should be carried out to facilitate identification of the soil and proper selection of E' values.

E' values given in Table 1 apply when trench shoring is left in place or removed in such a way as to allow compaction of sidefill against the native trench wall; otherwise, reduced E' values should be applied.

In very poor ground conditions, it may be necessary to use soil stabilization matting to prevent migration of embedment with resultant loss of soil reaction modulus, E' .

Table 1 — Modulus of soil reaction, E'

Trench type	1	2	3	4	5
Placement of embedment	Dumped	Very light compaction	Light compaction	Medium compaction	High compaction
Standard Proctor density of sidefill, %	^a	>75	>80	>85	>90
Bedding reaction angle (2α)	30°	45°	60°	90°	150°
K_x	0,108	0,105	0,102	0,096	0,085
E' (MPa)					
Soil group A	4	4	5	7	10
Soil group B	2,5	2,5	3,5	5	7
Soil group C	1	1,5	2	3	5
Soil group D	0,5	1	1,5	2,5	3,5
Soil group E	b	b	b	b	b
Soil group F	b	b	b	b	b

^a Depending on the type of soil and its moisture content, a standard Proctor density of 70 % to 80 % should normally be achieved by simply dumping the soil in the trench.

^b Use an E' value of 0 unless it can be ensured that a higher value is achieved consistently.

6.4 Allowable pipe diametral deflection

The allowable pipe diametral deflection, Δ_{max} , may be taken from relevant annexes of ISO 2531 and ISO 7186. These values provide sufficient safety against yield bending strength of the pipe wall, lining deformation, joint leak tightness and hydraulic capacity of the pipe. However, national standards and/or the manufacturer's catalogues may introduce more stringent limitations, for instance 3 % for cement mortar linings.

For each DN, the allowable pipe diametral deflection, Δ_{\max} , is the lowest of the following:

a) Δ_1 , which provides a safety factor of 2 against irreversible damage of the lining:

— for cement mortar linings ($DN \geq DN 300$):

$$\Delta_1 = 3 + \frac{DN - 300}{500}, \text{ with a maximum of 4 \%};$$

— for flexible linings:

$$\Delta_1 = 5 \%;$$

b) Δ_2 , which provides a safety factor of 1,5 against the yield bending strength of the ductile iron pipe wall:

$$\Delta_2 = 100 \times \frac{R_f \times (DE - e_{\text{nom}})}{SF \times E \times e_{\text{nom}} \times DF} \quad (10)$$

where

R_f is the yield bending strength of the pipe wall material ($R_f = 500$ MPa for ductile iron);

DE is the pipe external diameter as defined in ISO 2531 and ISO 7186, in millimetres;

e_{nom} is the nominal pipe wall thickness, in millimetres;

SF is the safety factor (= 1,5);

E is the modulus of elasticity of the pipe wall material ($E = 170\,000$ MPa for ductile iron);

DF is the deformation factor which depends mainly on the pipe diametral stiffness (for ductile iron pipes, $DF = 3,5$).

Annex A (informative)

Dimensions of preferred and other class pipes

A.1 Dimensions of preferred and other class pipes for pipes conforming to ISO 2531

Dimensions of preferred and other class pipes with flexible joints classified by the allowable operating pressure, in bar (PFA), prefixed by the letter C, i.e. C20, C25, C30, C40, C64 and C100 are given in this annex. These are derived from Equation (1) and the data of Clause 5, and are in compliance with ISO 2531.

Table A.1 — Dimensions of preferred and other class pipes for pipes conforming to ISO 2531

DN	DE ^a mm	Nominal iron wall thickness, e_{nom} mm ^b						
		C20	C25	C30	C40	C50	C64	C100
40	56				4,4 ^c	4,4	4,4	4,4
50	66				4,4 ^c	4,4	4,4	4,4
60	77				4,4 ^c	4,4	4,4	4,4
65	82				4,4 ^c	4,4	4,4	4,4
80	98				4,4 ^c	4,4	4,4	4,8
100	118				4,4 ^c	4,4	4,4	5,5
125	144				4,5 ^c	4,5	4,8	6,5
150	170				4,5 ^c	4,5	5,3	7,4
200	222				4,7 ^c	5,4	6,5	9,2
250	274				5,5 ^c	6,4	7,8	11,1
300	326			5,1	6,2 ^c	7,4	8,9	12,9
350	378		5,1	6,3 ^{cd}	7,1	8,4	10,2	14,8
400	429		5,5	6,5 ^{cd}	7,8	9,3	11,3	16,5
450	480		6,1	6,9 ^c	8,6	10,3	12,6	18,4
500	532		6,5	7,5 ^c	9,3	11,2	13,7	20,2
600	635		7,6	8,7 ^c	10,9	13,1	16,1	23,8
700	738	7,3	8,8 ^{cd}	9,9	12,4	15,0	18,5	27,5
800	842	8,1	9,6 ^c	11,1	14,0	16,9	21,0	
900	945	8,9	10,6 ^c	12,3	15,5	18,8	23,4	
1000	1 048	9,8	11,6 ^c	13,4	17,1	20,7		
1100	1 152	10,6	12,6 ^c	14,7	18,7	22,7		
1200	1 255	11,4	13,6 ^c	15,8	20,2			
1400	1 462	13,1	15,7 ^c	18,2				
1500	1 565	13,9	16,7 ^c	19,4				

Table A.1 (continued)

DN	DE ^a mm	Nominal iron wall thickness, e_{nom}						
		mm ^b						
		C20	C25	C30	C40	C50	C64	C100
1600	1 668	14,8	17,7 ^c	20,6				
1800	1 875	16,4	19,7 ^c	23,0				
2000	2 082	18,1	21,8 ^c	25,4				
2200	2 288	19,8	23,8 ^c					
2400	2 495	21,4	25,8					
2600	2 702	23,1	27,9 ^c					

^a A tolerance of +1 mm applies.

^b For pipes with weld beads, see ISO 10804.

^c Preferred classes.

^d For preferred classes, thicknesses are greater than the thicknesses calculated for "smoothing" between C40 and C30, and also between C30 and C25.

A.2 Dimensions of pressure and gravity sewer pipes conforming to ISO 7186

Table A.2 — Dimensions of pressure and gravity sewer pipes conforming to ISO 7186

DN	DE ^a mm	Nominal iron wall thickness, e_{nom}		Pressure pipe: corresponding preferred pressure class of ISO 2531
		mm		
		Pressure pipe	Gravity pipe	
80	98	4,4	3,4	C40
100	118	4,4	3,4	C40
125	144	4,5	3,4	C40
150	170	4,5	3,4	C40
200	222	4,7	3,4	C40
250	274	4,9	4,1	C30
300	326	5,1	4,8	C30
350	378	5,7 ^b	5,5	C30
400	429	6,3 ^b		C30
450	480	6,4		C25
500	532	6,5		C25
600	635	7,5		C25
700	738	8,5 ^b		C25
800	842	9,6		C25
900	945	10,6		C25
1000	1 048	11,6		C25
1100	1 152	12,6		C25

Table A.2 (continued)

DN	DE ^a mm	Nominal iron wall thickness, e_{nom} mm		Pressure pipe: corresponding preferred pressure class of ISO 2531
		Pressure pipe	Gravity pipe	
1200	1 255	13,6		C25
1400	1 462	15,7		C25
1500	1 565	16,7		C25
1600	1 668	17,7		C25
1800	1 875	19,7		C25
2000	2 082	21,8		C25
2200	2 288	23,8		C25
2400	2 496	25,8		C25
2600	2 702	27,9		C25
<p>^a A tolerance of +1 mm applies.</p> <p>^b For preferred classes, thicknesses are greater than the thicknesses calculated for "smoothing" between C40 and C30, and also between C30 and C25.</p>				

Annex B (informative)

Allowable depths of cover for pipes conforming to ISO 2531

B.1 General

Tables B.1 to B.14 show the allowable depth of cover calculated from the equations and data of Clause 6, assuming three different values of β , six soil groups and five different trench types.

NOTE The E' value of 0 has been taken for soil groups E and F; this is a limit case, which can occur in soils of very poor load-bearing capacity and/or in uncompacted, very cohesive soils.

B.2 Allowable depths of cover for pressure class pipes conforming to ISO 2531

For Tables B.1 to B.14:

- a) minimum allowable depth of cover is 1 m. For depths of cover less than this, further consideration may be necessary;
- b) NR stands for “not recommended”.

Table B.1 — Allowable depths of cover for C20 pipes conforming to ISO 2531 — Cement mortar lining

DN	Soil group	Allowable depth of cover m ($\beta = 0,5/0,75/1,5$)				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
700	A	5,4/5,3/5,1	5,5/5,6/5,2	6,9/6,8/6,6	9,8/9,8/9,6	15,2/15,2/15,1
	B	3,7/3,6/3,1	3,8/3,7/3,3	5,2/5,1/4,8	7,4/7,3/7,1	11,1/11,0/10,9
	C	1,9/1,5/NR	2,6/2,4/NR	3,4/3,2/2,6	4,9/4,8/4,5	8,3/8,3/8,1
	D	NR	2,0/1,6/NR	2,7/2,5/NR	4,2/4,1/3,8	6,3/6,2/6,0
	E/F	NR	NR	NR	NR	NR
800	A	5,6/5,6/5,3	5,8/5,7/5,5	7,2/7,1/7,0	10,2/10,2/10,1	15,9/15,9/15,8
	B	3,9/3,8/3,3	4,0/3,9/3,5	5,4/5,3/5,0	7,7/7,6/7,4	11,6/11,5/11,4
	C	2,0/1,6/NR	2,7/2,5/NR	3,5/3,4/2,8	5,1/5,0/4,7	8,7/8,6/8,5
	D	NR	2,1/1,7/NR	2,8/2,7/NR	4,4/4,3/4,0	6,5/6,4/6,2
	E/F	NR	NR	NR	NR	NR
900	A	5,6/5,5/5,3	5,7/5,7/5,4	7,1/7,1/6,9	10,2/10,1/10,0	15,8/15,8/15,7
	B	3,8/3,7/3,3	3,9/3,8/3,4	5,3/5,2/5,0	7,6/7,6/7,4	11,5/11,5/11,4
	C	1,9/1,5/NR	2,7/2,5/NR	3,4/3,3/2,8	5,0/4,9/4,6	8,6/8,6/8,4
	D	NR	2,1/1,7/NR	2,8/2,6/NR	4,3/4,2/3,9	6,4/6,4/6,2
	E/F	NR	NR	NR	NR	NR

Table B.1 (continued)

DN	Soil group	Allowable depth of cover m ($\beta = 0,5/0,75/1,5$)				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
1000	A	5,6/5,5/5,3	5,8/5,7/5,5	7,1/7,1/6,9	10,2/10,1/10,0	15,8/15,8/15,7
	B	3,8/3,7/3,3	3,9/3,8/3,5	5,3/5,2/5,0	7,6/7,6/7,4	11,5/11,5/11,4
	C	1,9/1,6/NR	2,7/2,5/NR	3,4/3,3/2,8	5,0/4,9/4,7	8,6/8,6/8,4
	D	NR	2,0/1,7/NR	2,8/2,6/NR	4,4/4,3/3,9	6,4/6,4/6,2
	E/F	NR	NR	NR	NR	NR
$(\beta = 0,5/0,75/1,5)$						
1100	A	5,5/5,5/5,2	5,7/5,6/5,4	7,1/7,1/6,9	10,1/10,1/10,0	15,8/15,8/15,7
	B	3,8/3,7/3,3	3,9/3,8/3,4	5,3/5,2/5,0	7,6/7,5/7,4	11,5/11,4/11,3
	C	1,9/1,5/NR	2,7/2,5/NR	3,4/3,3/2,8	5,0/4,9/4,6	8,6/8,5/8,4
	D	NR	2,0/1,7/NR	2,7/2,6/NR	4,3/4,2/3,9	6,4/6,3/6,1
	E/F	NR	NR	NR	NR	NR
1200	A	5,5/5,4/5,2	5,7/5,6/5,4	7,1/7,0/6,9	10,1/10,1/9,9	15,8/15,7/15,7
	B	3,8/3,6/3,3	3,9/3,8/3,4	5,2/5,2/4,9	7,5/7,5/7,3	11,4/11,4/11,3
	C	1,9/1,5/NR	2,6/2,4/NR	3,4/3,2/2,8	4,9/4,9/4,6	8,5/8,5/8,3
	D	NR	1,9/1,6/NR	2,7/2,6/NR	4,3/4,2/3,9	6,3/6,3/6,1
	E/F	NR	NR	NR	NR	NR
1400	A	5,5/5,4/5,2	5,7/5,6/5,4	7,1/7,0/6,8	10,1/10,0/9,9	15,7/15,7/15,6
	B	3,7/3,6/3,3	3,9/3,8/3,4	5,2/5,2/4,9	7,5/7,5/7,3	11,4/11,4/11,3
	C	1,9/1,5/NR	2,6/2,5/NR	3,4/3,2/2,8	4,9/4,8/4,6	8,5/8,5/8,3
	D	NR	1,9/1,7/NR	2,7/2,6/1,7	4,3/4,2/3,9	6,3/6,3/6,1
	E/F	NR	NR	NR	NR	NR
1500	A	5,5/5,4/5,2	5,7/5,6/5,4	7,0/7,0/6,8	10,1/10,0/9,9	15,7/15,7/15,6
	B	3,7/3,6/3,3	3,8/3,8/3,4	5,2/5,1/4,9	7,5/7,4/7,3	11,4/11,3/11,3
	C	1,8/1,5/NR	2,6/2,4/NR	3,3/3,2/2,8	4,9/4,8/4,6	8,5/8,4/8,3
	D	NR	1,9/1,7/NR	2,7/2,5/1,8	4,2/4,2/3,9	6,3/6,2/6,1
	E/F	NR	NR	NR	NR	NR
1600	A	5,5/5,4/5,2	5,7/5,6/5,4	7,1/7,0/6,8	10,1/10,0/9,9	15,7/15,7/15,6
	B	3,7/3,6/3,3	3,9/3,8/3,4	5,2/5,2/4,9	7,5/7,5/7,3	11,4/11,4/11,3
	C	1,9/1,6/NR	2,6/2,5/1,6	3,4/3,2/2,8	4,9/4,8/4,6	8,5/8,5/8,3
	D	1,0/NR/NR	1,9/1,7/NR	2,7/2,6/1,9	4,3/4,2/3,9	6,3/6,3/6,1
	E/F	NR	NR	NR	NR	NR

Table B.1 (continued)

DN	Soil group	Allowable depth of cover				
		m ($\beta = 0,5/0,75/1,5$)				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
1800	A	5,5/5,4/5,2	5,6/5,6/5,4	7,0/7,0/6,8	10,0/10,0/9,9	15,7/15,6/15,6
	B	3,7/3,6/3,3	3,8/3,7/3,4	5,2/5,1/4,9	7,5/7,4/7,3	11,3/11,3/11,2
	C	1,9/1,6/NR	2,6/2,4/1,7	3,3/3,2/2,8	4,9/4,8/4,6	8,5/8,4/8,3
	D	1,0/NR/NR	1,9/1,7/NR	2,7/2,5/1,9	4,2/4,1/3,9	6,3/6,2/6,1
	E/F	NR	NR	NR	NR	NR
2000	A	5,5/5,4/5,2	5,6/5,6/5,4	7,0/7,0/6,8	10,0/10,0/9,9	15,7/15,6/15,6
	B	3,7/3,6/3,3	3,8/3,7/3,5	5,2/5,1/4,9	7,5/7,4/7,3	11,3/11,3/11,2
	C	1,9/1,6/NR	2,6/2,5/1,9	3,3/3,2/2,9	4,9/4,8/4,6	8,5/8,4/8,3
	D	1,1/NR/NR	1,9/1,7/NR	2,7/2,6/2,0	4,2/4,2/3,9	6,3/6,2/6,1
	E/F	NR	NR	NR	NR	NR
2200	A	5,5/5,4/5,3	5,6/5,6/5,4	7,0/7,0/6,9	10,0/10,0/9,9	15,7/15,6/15,6
	B	3,7/3,6/3,4	3,8/3,8/3,5	5,2/5,1/5,0	7,5/7,4/7,3	11,3/11,3/11,2
	C	1,9/1,7/NR	2,6/2,5/2,0	3,3/3,3/2,9	4,9/4,8/4,6	8,5/8,4/8,3
	D	1,1/NR/NR	2,0/1,8/NR	2,7/2,6/2,1	4,2/4,2/3,9	6,3/6,2/6,1
	E/F	NR	NR	NR	NR	NR
2400	A	5,5/5,4/5,3	5,6/5,6/5,4	7,0/7,0/6,8	10,0/10,0/9,9	15,6/15,6/15,6
	B	3,7/3,6/3,4	3,8/3,8/3,5	5,2/5,1/5,0	7,4/7,4/7,3	11,3/11,3/11,2
	C	1,9/1,7/NR	2,6/2,5/2,0	3,3/3,2/3,0	4,9/4,8/4,6	8,4/8,4/8,3
	D	1,1/NR/NR	2,0/1,8/NR	2,7/2,6/2,2	4,2/4,2/3,9	6,3/6,2/6,1
	E/F	NR	NR	NR	NR	NR
2600	A	5,5/5,4/5,3	5,6/5,6/5,4	7,0/7,0/6,9	10,0/10,0/9,9	15,6/15,6/15,6
	B	3,7/3,7/3,4	3,8/3,8/3,6	5,2/5,1/5,0	7,4/7,4/7,3	11,3/11,3/11,2
	C	1,9/1,7/NR	2,6/2,5/2,1	3,3/3,3/3,0	4,9/4,8/4,7	8,4/8,4/8,3
	D	1,2/NR/NR	2,0/1,8/NR	2,7/2,6/2,2	4,2/4,2/4,0	6,3/6,2/6,1
	E/F	NR	NR	NR	NR	NR

NR Not recommended

Table B.2 — Allowable depths of cover for C20 pipes conforming to ISO 2531 — Flexible lining

DN	Soil group	Allowable depth of cover				
		m				
		$(\beta = 0,5/0,75/1,5)$				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
700	A	7,2/7,1/7,0	7,4/7,4/7,2	9,2/9,1/9,0	12,9/12,9/12,8	20,0/20,0/19,9
	B	5,0/4,9/4,6	5,2/5,1/4,8	6,9/6,8/6,6	9,7/9,7/9,6	14,6/14,6/14,5
	C	2,8/2,6/NR	3,7/3,5/3,1	4,6/4,5/4,1	6,5/6,4/6,2	11,0/11,0/10,9
	D	1,9/1,5/NR	2,9/2,7/NR	3,8/3,7/3,2	5,7/5,6/5,4	8,3/8,3/8,1
	E/F	NR	NR	NR	NR	NR
800	A	7,1/7,0/6,9	7,3/7,3/7,1	9,1/9,0/8,9	12,8/12,8/12,7	19,9/19,9/19,8
	B	4,9/4,8/4,6	5,1/5,0/4,7	6,8/6,7/6,5	9,6/9,6/9,5	14,5/14,5/14,4
	C	2,7/2,5/NR	3,6/3,4/2,9	4,5/4,4/4,0	6,4/6,3/6,1	10,9/10,9/10,7
	D	1,8/1,4/NR	2,8/2,6/NR	3,7/3,6/3,1	5,6/5,5/3,0	8,2/8,1/8,0
	E/F	NR	NR	NR	NR	1,4/NR/NR
900	A	7,0/7,0/6,8	7,3/7,2/7,0	9,0/8,9/8,8	12,8/12,7/12,6	19,8/19,8/19,7
	B	4,9/4,8/4,5	5,0/4,9/4,7	6,7/6,6/6,5	9,6/9,5/9,4	14,4/14,4/14,3
	C	2,6/2,4/NR	3,5/3,4/2,9	4,4/4,3/4,0	6,3/6,3/6,1	10,8/10,8/10,7
	D	1,7/1,1/NR	2,7/2,5/NR	3,6/3,5/3,0	5,5/5,4/5,2	8,1/8,0/7,9
	E/F	NR	NR	NR	NR	1,3/NR/NR
1000	A	7,0/7,0/6,8	7,3/7,2/7,0	9,0/8,9/8,8	12,8/12,7/12,6	19,8/19,8/19,7
	B	4,9/4,8/4,5	5,0/4,9/4,7	6,7/6,7/6,5	9,6/9,5/9,4	14,4/14,4/14,3
	C	2,6/2,4/NR	3,5/3,4/2,9	4,4/4,3/4,0	6,3/6,3/6,1	10,8/10,8/10,7
	D	1,8/1,3/NR	2,7/2,5/NR	3,6/3,5/3,1	5,5/5,5/5,2	8,1/8,1/7,9
	E/F	NR	NR	NR	NR	1,3/NR/NR
1100	A	7,0/6,9/6,8	7,1/7,1/7,0	8,9/8,9/8,8	12,7/12,7/12,6	19,8/19,7/19,7
	B	4,8/4,7/4,5	5,0/4,9/4,6	6,7/6,6/6,4	9,5/9,5/9,3	14,4/14,3/14,3
	C	2,6/2,4/NR	3,5/3,3/2,9	4,4/4,3/3,9	6,3/6,2/6,0	10,8/10,7/10,6
	D	1,7/1,1/NR	2,7/2,5/NR	3,6/3,5/3,0	5,5/5,4/5,2	8,0/8,0/7,8
	E/F	NR	NR	NR	NR	1,2/NR/NR
1200	A	7,0/6,9/6,7	7,2/7,1/6,9	8,9/8,9/8,7	12,7/12,6/12,5	19,7/19,7/19,6
	B	4,8/4,7/4,4	4,9/4,9/4,6	6,6/6,6/6,4	9,5/9,4/9,3	14,3/14,3/14,2
	C	2,5/2,3/NR	3,4/3,3/2,8	4,3/4,2/3,9	6,2/6,2/6,0	10,7/10,7/10,6
	D	1,7/1,7/NR	2,6/2,4/NR	3,5/3,4/3,0	5,4/5,4/5,1	8,0/7,9/7,8
	E/F	NR	NR	NR	NR	1,1/NR/NR
1400	A	6,9/6,9/6,7	7,1/7,1/6,9	8,9/8,8/8,7	12,6/12,6/12,5	19,7/19,7/19,6
	B	4,8/4,7/4,4	4,9/4,8/4,6	6,6/6,5/6,4	9,4/9,4/9,3	14,3/14,3/14,2
	C	2,5/2,3/NR	3,4/3,3/2,9	4,3/4,2/3,9	6,2/6,2/6,0	10,7/10,6/10,5
	D	1,7/1,2/NR	2,6/2,4/NR	3,5/3,4/3,0	5,4/5,3/5,1	8,0/7,9/7,8
	E/F	NR	NR	NR	NR	1,1/NR/NR

Table B.2 (continued)

DN	Soil group	Allowable depth of cover m ($\beta = 0,5/0,75/1,5$)				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
1500	A	6,9/6,9/6,7	7,1/7,1/6,9	8,8/8,8/8,7	12,6/12,6/12,5	19,6/19,6/19,6
	B	4,8/4,7/4,4	4,9/4,8/4,6	6,6/6,5/6,4	9,4/9,4/9,3	14,2/14,2/14,2
	C	2,5/2,3/NR	3,4/3,3/2,9	4,3/4,2/3,9	6,2/6,1/6,0	10,6/10,6/10,5
	D	1,7/1,2/NR	2,6/2,4/NR	3,5/3,4/3,0	5,4/5,3/5,1	7,9/7,9/7,7
	E/F	NR	NR	NR	NR	1,1/NR/NR
1600	A	6,9/6,9/6,7	7,1/7,1/6,9	8,9/8,8/8,7	12,6/12,6/12,5	19,7/19,6/19,6
	B	4,7/4,7/4,4	4,9/4,8/4,6	6,6/6,5/6,4	9,4/9,4/9,3	14,3/14,2/14,2
	C	2,5/2,4/NR	3,4/3,3/2,9	4,3/4,2/3,9	6,2/6,1/6,0	10,7/10,6/10,5
	D	1,7/1,3/NR	2,6/2,6/1,6	3,5/3,4/3,0	5,4/5,3/5,1	7,9/7,9/7,8
	E/F	NR	NR	NR	NR	1,2/NR/NR
1800	A	6,9/6,8/6,7	7,1/7,0/6,9	8,8/8,8/8,7	12,6/12,5/12,5	19,6/19,6/19,5
	B	4,7/4,7/4,4	4,9/4,8/4,6	6,5/6,5/6,3	9,4/9,3/9,2	14,2/14,2/14,1
	C	2,5/2,3/NR	3,4/3,3/2,9	4,3/4,2/3,9	6,2/6,1/5,9	10,6/10,6/10,5
	D	1,7/1,3/NR	2,6/2,4/1,7	3,5/3,4/3,0	5,4/5,3/5,1	7,9/7,9/7,7
	E/F	NR	NR	NR	NR	1,1/NR/NR
2000	A	6,9/6,8/6,7	7,1/7,0/6,9	8,8/8,8/8,7	12,6/12,5/12,5	19,6/19,6/19,5
	B	4,7/4,7/4,5	4,9/4,8/4,6	6,5/6,5/6,4	9,4/9,3/9,2	14,2/14,2/14,1
	C	2,5/2,4/1,6	3,4/3,3/2,9	4,3/4,2/3,9	6,2/6,1/6,0	10,6/10,6/10,5
	D	1,7/1,4/NR	2,6/2,4/1,8	3,5/3,4/3,1	5,4/5,3/5,1	7,9/7,8/7,7
	E/F	NR	NR	NR	NR	1,2/NR/NR
2200	A	6,9/6,8/6,7	7,1/7,0/6,9	8,8/8,8/8,7	12,6/12,5/12,5	19,6/19,6/19,5
	B	4,7/4,7/4,5	4,9/4,8/4,6	6,5/6,5/6,4	9,4/9,3/9,2	14,2/14,2/14,1
	C	2,5/2,4/1,8	3,4/3,3/3,0	4,3/4,2/4,0	6,2/6,1/6,0	10,6/10,6/10,5
	D	1,7/1,4/NR	2,6/2,5/1,9	3,5/3,4/3,1	5,4/5,3/5,1	7,9/7,8/7,7
	E/F	NR	NR	NR	NR	1,2/NR/NR
2400	A	6,9/6,8/6,7	7,1/7,0/6,9	8,8/8,8/8,7	12,5/12,5/12,4	19,6/19,5/19,5
	B	4,7/4,7/4,5	4,9/4,8/4,6	6,5/6,5/6,4	9,3/9,3/9,2	14,2/14,1/14,1
	C	2,5/2,4/1,9	3,4/3,3/3,0	4,2/4,2/4,0	6,1/6,1/6,0	10,6/10,5/10,5
	D	1,7/1,5/NR	2,6/2,5/2,0	3,5/3,4/3,1	5,3/5,3/5,1	7,9/7,8/7,7
	E/F	NR	NR	NR	0,8/NR/NR	1,2/NR/NR
2600	A	6,9/6,8/6,7	7,1/7,0/6,9	8,8/8,8/8,7	12,5/12,5/12,5	19,6/19,5/19,5
	B	4,7/4,7/4,5	4,9/4,8/4,6	6,5/6,5/6,4	9,3/9,3/9,2	14,2/14,1/14,1
	C	2,5/2,4/2,0	3,4/3,3/3,0	4,2/4,2/4,0	6,1/6,1/6,0	10,6/10,5/10,5
	D	1,7/1,5/NR	2,6/2,5/2,1	3,5/3,4/3,1	5,3/5,3/5,1	7,9/7,8/7,7
	E/F	NR	NR	NR	0,9/NR/NR	1,3/NR/NR

NR Not recommended

Table B.3 — Allowable depths of cover for C25 pipes conforming to ISO 2531 — Cement mortar lining

DN	Soil group	Allowable depth of cover				
		m				
		$(\beta = 0,5/0,75/1,5)$				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
350	A	5,8/5,7/5,4	5,9/5,9/5,6	7,1/7,0/6,8	9,5/9,5/9,3	14,2/14,1/14,0
	B	4,4/4,3/3,9	4,6/4,4/4,1	5,7/5,6/5,3	7,5/7,5/7,3	10,8/10,8/10,6
	C	3,0/2,8/NR	3,6/3,5/2,9	4,2/4,1/3,7	5,5/5,4/5,2	8,5/8,5/8,3
	D	2,5/2,3/NR	3,1/2,9/2,0	3,7/3,6/3,1	5,0/4,9/4,6	6,9/6,8/6,6
	E/F	2,0/1,5/NR	2,1/1,7/NR	2,1/1,8/NR	2,3/2,1/NR	2,8/2,5/NR
400	A	5,7/5,6/5,3	5,8/5,8/5,5	7,0/6,9/6,7	9,5/9,5/9,3	14,2/14,2/14,0
	B	4,3/4,1/3,7	4,4/4,3/3,9	5,5/5,4/5,2	7,4/7,4/7,2	10,8/10,7/10,6
	C	2,8/2,6/NR	3,4/3,2/2,6	4,0/3,9/3,5	5,4/5,3/5,0	8,4/8,4/8,2
	D	2,3/2,2/NR	2,9/2,7/NR	3,5/3,4/2,8	4,8/4,7/4,4	6,7/6,6/6,4
	E/F	1,7/NR/NR	1,7/NR/NR	1,8/NR/NR	2,0/1,6/NR	2,4/2,2/NR
450	A	5,9/5,8/5,5	6,1/6,0/5,7	7,3/7,2/7,0	9,8/9,8/9,7	14,7/14,7/14,6
	B	4,4/4,3/3,9	4,6/4,5/4,1	5,7/5,7/5,4	7,7/7,7/7,5	11,1/11,1/11,0
	C	2,9/2,7/NR	3,6/3,4/2,9	4,2/4,1/3,7	5,6/5,5/5,2	8,7/8,7/8,5
	D	2,4/2,1/NR	3,0/2,9/1,9	3,7/3,5/3,0	5,0/4,9/4,6	6,9/6,9/6,7
	E/F	1,8/NR/NR	1,9/1,4/NR	2,0/1,6/NR	2,2/1,9/NR	2,6/2,4/NR
500	A	5,8/5,8/5,5	6,0/5,9/5,7	7,2/7,2/7,0	9,9/9,8/9,7	14,9/14,8/14,7
	B	4,3/4,2/3,8	4,5/4,4/4,0	5,7/5,6/5,3	7,7/7,6/7,5	11,2/11,1/11,0
	C	2,8/2,6/NR	3,4/3,3/2,7	4,1/4,0/3,5	5,5/5,4/5,1	8,7/8,7/8,5
	D	2,2/1,9/NR	2,9/2,7/NR	3,5/3,4/2,9	4,9/4,8/4,5	6,9/6,8/6,6
	E/F	1,6/NR/NR	1,7/NR/NR	1,8/NR/NR	2,0/1,5/NR	2,3/2,1/NR
600	A	6,2/6,1/5,9	6,3/6,3/6,0	7,6/7,6/7,4	10,4/10,4/10,3	15,7/15,7/15,6
	B	4,6/4,5/4,1	4,7/4,6/4,3	6,0/5,9/5,7	8,1/8,1/7,9	11,8/11,8/11,7
	C	3,0/2,8/1,7	3,6/3,5/3,0	4,3/4,2/3,8	5,8/5,7/5,5	9,2/9,2/9,0
	D	2,4/2,1/NR	3,1/2,9/2,1	3,8/3,6/3,1	5,2/5,1/4,8	7,2/7,2/7,0
	E/F	1,7/NR/NR	1,8/1,2/NR	1,9/1,5/NR	2,1/1,8/NR	2,5/2,3/NR
700	A	6,6/6,5/6,3	6,8/6,7/6,5	8,1/8,1/7,9	11,1/11,1/10,9	16,7/16,6/16,6
	B	4,9/4,8/4,5	5,1/5,0/4,7	6,4/6,3/6,1	8,7/8,6/8,5	12,6/12,5/12,4
	C	3,2/3,1/2,5	3,9/3,8/3,4	4,7/4,6/4,2	6,2/6,1/5,9	9,8/9,8/9,6
	D	2,6/2,4/NR	3,3/3,2/2,6	4,1/4,0/3,6	5,6/5,5/5,3	7,7/7,7/7,5
	E/F	2,0/1,6/NR	2,1/1,8/NR	2,2/1,9/NR	2,4/2,1/NR	2,8/2,6/NR
800	A	6,7/6,6/6,4	6,9/6,8/6,6	8,3/8,2/8,1	11,4/11,3/11,2	17,2/17,2/17,1
	B	4,9/4,8/4,5	5,1/5,0/4,7	6,5/6,4/6,2	8,8/8,8/8,6	12,9/12,8/12,7
	C	3,1/3,0/2,3	3,9/3,7/3,3	4,6/4,5/4,2	6,2/6,2/5,9	10,0/9,9/9,8
	D	2,5/2,3/NR	3,2/3,1/2,5	4,0/3,9/3,5	5,6/5,5/5,2	7,8/7,7/7,6
	E/F	1,8/1,3/NR	1,9/1,5/NR	2,0/1,6/NR	2,2/1,9/NR	2,5/2,3/NR

Table B.3 (continued)

DN	Soil group	Allowable depth of cover				
		m				
		$(\beta = 0,5/0,75/1,5)$				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
900	A	6,6/6,5/6,3	6,8/6,7/6,5	8,2/8,2/8,0	11,3/11,3/11,1	17,1/17,1/17,0
	B	4,9/4,8/4,5	5,0/4,9/4,6	6,4/6,3/6,1	8,7/8,7/8,5	12,8/12,7/12,6
	C	3,1/2,9/2,2	3,8/3,7/3,2	4,5/4,4/4,1	6,2/6,1/5,9	9,9/9,8/9,7
	D	2,4/2,2/NR	3,2/3,0/2,4	3,9/3,8/3,4	5,5/5,4/5,2	7,7/7,7/7,5
	E/F	1,7/NR/NR	1,8/1,3/NR	1,9/1,5/NR	2,1/1,8/NR	2,5/2,2/NR
1000	A	6,5/6,5/6,3	6,7/6,7/6,5	8,2/8,1/7,9	11,2/11,2/11,1	17,0/17,0/16,9
	B	4,8/4,7/4,4	4,9/4,9/4,6	6,3/6,3/6,1	8,7/8,6/8,5	12,7/12,7/12,6
	C	3,0/2,9/2,2	3,7/3,6/3,2	4,5/4,4/4,1	6,1/6,0/5,8	9,8/9,8/9,7
	D	2,4/2,2/NR	3,1/3,0/2,3	3,9/3,7/3,3	5,4/5,4/5,1	7,6/7,6/7,4
	E/F	1,7/NR/NR	1,7/1,2/NR	1,8/1,4/NR	2,0/1,7/NR	2,4/2,2/NR
1100	A	6,5/6,4/6,2	6,7/6,6/6,4	8,1/8,1/7,9	11,2/11,2/11,0	17,0/16,9/16,9
	B	4,8/4,7/4,4	4,9/4,8/4,5	6,3/6,2/6,0	8,6/8,6/8,4	12,6/12,6/12,5
	C	3,0/2,8/2,1	3,7/3,6/3,2	4,4/4,3/4,0	6,0/6,0/5,8	9,8/9,7/9,6
	D	2,3/2,1/NR	3,1/2,9/2,3	3,8/3,7/3,3	5,4/5,3/5,1	7,6/7,5/7,4
	E/F	1,6/NR/NR	1,7/NR/NR	1,8/1,4/NR	2,0/1,6/NR	2,3/2,1/NR
1200	A	6,5/6,4/6,2	6,7/6,6/6,4	8,1/8,0/7,9	11,1/11,1/11,0	16,9/16,9/16,8
	B	4,7/4,6/4,4	4,9/4,8/4,5	6,2/6,2/6,0	8,6/8,5/8,4	12,6/12,6/12,5
	C	2,9/2,8/2,1	3,7/3,5/3,1	4,4/4,3/4,0	6,0/5,9/5,7	9,7/9,7/9,6
	D	2,3/2,1/NR	3,0/2,9/2,3	3,8/3,7/3,3	5,4/5,3/5,0	7,5/7,5/7,3
	E/F	1,6/NR/NR	1,7/NR/NR	1,7/1,3/NR	1,9/1,6/NR	2,3/2,1/NR
1400	A	6,5/6,4/6,2	6,6/6,6/6,4	8,1/8,0/7,9	11,1/11,1/11,0	16,9/16,9/16,8
	B	4,7/4,6/4,4	4,9/4,8/4,5	6,2/6,2/6,0	8,6/8,5/8,4	12,6/12,6/12,5
	C	2,9/2,8/2,2	3,6/3,5/3,2	4,4/4,3/4,0	6,0/5,9/5,7	9,7/9,7/9,5
	D	2,3/2,1/NR	3,0/2,9/2,3	3,8/3,7/3,3	5,3/5,3/5,0	7,5/7,5/7,3
	E/F	1,6/NR/NR	1,7/1,2/NR	1,8/1,4/NR	1,9/1,6/NR	2,3/2,1/NR
1500	A	6,4/6,4/6,2	6,6/6,6/6,4	8,0/8,0/7,9	11,1/11,1/11,0	16,9/16,9/16,8
	B	4,7/4,6/4,4	4,8/4,8/4,5	6,2/6,2/6,0	8,5/8,5/8,4	12,6/12,5/12,4
	C	2,9/2,8/2,2	3,6/3,5/3,2	4,4/4,3/4,0	6,0/5,9/5,7	9,7/9,6/9,5
	D	2,3/2,1/NR	3,0/2,9/2,3	3,7/3,6/3,3	5,3/5,2/5,0	7,5/7,4/7,3
	E/F	1,6/NR/NR	1,7/1,2/NR	1,7/1,4/NR	1,9/1,6/NR	2,3/2,1/NR
1600	A	6,4/6,4/6,2	6,6/6,5/6,4	8,0/8,0/7,8	11,1/11,1/11,0	16,9/16,8/16,8
	B	4,7/4,6/4,4	4,8/4,7/4,5	6,2/6,1/6,0	8,5/8,5/8,4	12,5/12,5/12,4
	C	2,9/2,8/2,2	3,6/3,5/3,2	4,4/4,3/4,0	5,9/5,9/5,7	9,6/9,6/9,5
	D	2,3/2,1/NR	3,0/2,9/2,3	3,7/3,6/3,3	5,3/5,2/5,0	7,5/7,4/7,3
	E/F	1,6/NR/NR	1,6/1,2/NR	1,7/1,4/NR	1,9/1,6/NR	2,2/2,0/NR

Table B.3 (continued)

DN	Soil group	Allowable depth of cover m ($\beta = 0,5/0,75/1,5$)				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
1800	A	6,4/6,3/6,2	6,6/6,5/6,4	8,0/7,9/7,8	11,0/11,0/10,9	16,8/16,8/16,7
	B	4,6/4,6/4,3	4,8/4,7/4,5	6,2/6,1/5,9	8,5/8,4/8,3	12,5/12,5/12,4
	C	2,9/2,7/2,2	3,6/3,5/3,1	4,3/4,2/4,0	5,9/5,9/5,7	9,6/9,6/9,5
	D	2,2/2,1/NR	3,0/2,8/2,4	3,7/3,6/3,3	5,3/5,2/5,0	7,4/7,4/7,2
	E/F	1,5/1,0/NR	1,6/1,2/NR	1,7/1,4/NR	1,9/1,6/NR	2,2/2,0/NR
2000	A	6,4/6,3/6,2	6,6/6,5/6,4	8,0/7,9/7,8	11,0/11,0/10,9	16,8/16,8/16,7
	B	4,7/4,6/4,4	4,8/4,7/4,5	6,2/6,1/6,0	8,5/8,5/8,3	12,5/12,5/12,4
	C	2,9/2,8/2,3	3,6/3,5/3,2	4,3/4,3/4,0	5,9/5,9/5,7	9,6/9,6/9,5
	D	2,3/2,1/NR	3,0/2,9/2,4	3,7/3,6/3,3	5,3/5,2/5,0	7,4/7,4/7,3
	E/F	1,6/1,3/NR	1,7/1,3/NR	1,7/1,5/NR	1,9/1,7/NR	2,2/2,0/NR
2200	A	6,4/6,3/6,2	6,6/6,5/6,4	8,0/7,9/7,8	11,0/11,0/10,9	16,8/16,8/16,7
	B	4,6/4,6/4,4	4,8/4,7/4,5	6,1/6,1/6,0	8,5/8,4/8,3	12,5/12,4/12,4
	C	2,9/2,8/2,3	3,6/3,5/3,2	4,3/4,2/4,0	5,9/5,8/5,7	9,6/9,5/9,5
	D	2,2/2,1/NR	3,0/2,9/2,5	3,7/3,6/3,3	5,2/5,2/5,0	7,4/7,4/7,2
	E/F	1,6/1,3/NR	1,6/1,4/NR	1,7/1,5/NR	1,9/1,7/NR	2,2/2,0/NR
2400	A	6,3/6,3/6,2	6,5/6,5/6,4	7,9/7,9/7,8	11,0/11,0/10,9	16,7/16,7/16,7
	B	4,6/4,6/4,4	4,8/4,7/4,5	6,1/6,1/5,9	8,4/8,4/8,3	12,4/12,4/12,3
	C	2,9/2,8/2,4	3,6/3,5/3,2	4,3/4,2/4,0	5,9/5,8/5,7	9,5/9,5/9,4
	D	2,2/2,1/NR	3,0/2,9/2,5	3,7/3,6/3,4	5,2/5,2/5,0	7,4/7,3/7,2
	E/F	1,6/1,3/NR	1,7/1,4/NR	1,7/1,5/NR	1,9/1,7/NR	2,2/2,0/NR
2600	A	6,4/6,3/6,2	6,5/6,5/6,4	7,9/7,9/7,8	11,0/11,0/10,9	16,8/16,7/16,7
	B	4,6/4,6/4,4	4,8/4,7/4,6	6,1/6,1/6,0	8,5/8,4/8,3	12,4/12,4/12,4
	C	2,9/2,8/2,5	3,6/3,5/3,3	4,3/4,2/4,1	5,9/5,8/5,7	9,6/9,5/9,5
	D	2,2/2,1/1,5	3,0/2,9/2,6	3,7/3,6/3,4	5,2/5,2/5,0	7,4/7,4/7,3
	E/F	1,6/1,4/NR	1,7/1,5/NR	1,8/1,6/NR	1,9/1,7/NR	2,2/2,1/1,4

NR Not recommended

Table B.4 — Allowable depths of cover for C25 pipes conforming to ISO 2531 — Flexible lining

DN	Soil group	Allowable depth of cover				
		m				
		$(\beta = 0,5/0,75/1,5)$				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
350	A	7,7/7,7/7,5	8,0/7,9/7,7	9,4/9,4/9,2	12,7/12,6/12,5	18,7/18,7/18,6
	B	6,0/5,9/5,6	6,1/6,1/5,8	7,6/7,5/7,3	10,0/10,0/9,8	14,3/14,3/14,2
	C	4,1/4,0/3,6	4,9/4,8/4,5	5,7/5,6/5,3	7,4/7,3/7,1	11,4/11,3/11,2
	D	3,5/3,4/2,8	4,3/4,2/3,8	5,1/5,0/4,6	6,7/6,7/6,4	9,1/9,1/8,9
	E/F	2,9/2,7/NR	3,0/2,8/NR	3,1/2,9/2,0	3,3/3,2/2,5	3,8/3,7/3,2
400	A	7,7/7,7/7,5	8,0/7,9/7,7	9,5/9,5/9,3	12,9/12,8/12,7	19,2/19,2/19,1
	B	5,9/5,8/5,5	6,0/6,0/5,7	7,5/7,5/7,3	10,0/10,0/9,9	14,6/14,5/14,4
	C	4,0/3,8/3,4	4,7/4,6/4,3	5,6/5,5/5,2	7,3/7,3/7,1	11,4/11,4/11,3
	D	3,3/3,1/2,5	4,1/4,0/3,5	4,9/4,8/4,5	6,6/6,6/6,3	9,1/9,0/8,9
	E/F	2,6/2,4/NR	2,7/2,5/NR	2,8/2,6/2,0	3,0/2,9/1,9	3,5/3,4/2,8
450	A	7,8/7,8/7,6	8,1/8,0/7,8	9,6/9,6/9,4	13,0/13,0/12,9	19,4/19,4/19,3
	B	6,0/5,9/5,6	6,1/6,1/5,8	7,7/7,6/7,4	10,2/10,2/10,1	14,7/14,7/14,6
	C	4,0/3,9/3,5	4,8/4,7/4,4	5,7/5,6/5,3	7,5/7,4/7,2	11,6/11,6/11,4
	D	3,4/3,2/2,6	4,2/4,1/3,6	5,0/4,9/4,6	6,7/6,7/6,5	9,2/9,2/9,0
	E/F	2,7/2,5/NR	2,8/2,6/NR	2,9/2,7/NR	3,1/3,0/2,2	3,6/3,5/2,9
500	A	7,9/7,8/7,6	8,1/8,0/7,9	9,7/9,7/9,5	13,2/13,2/13,1	19,8/19,8/19,8
	B	5,9/5,8/5,6	6,1/6,0/5,8	7,7/7,6/7,4	10,3/10,3/10,1	15,0/14,9/14,8
	C	3,9/3,8/3,3	4,7/4,6/4,3	5,6/5,5/5,2	7,4/7,4/7,2	11,7/11,6/11,5
	D	3,2/3,1/2,4	4,0/3,9/3,5	4,9/4,8/4,5	6,7/6,7/6,4	9,2/9,2/9,0
	E/F	2,5/2,3/NR	2,6/2,4/NR	2,7/2,5/NR	2,9/2,7/NR	3,4/3,2/2,6
600	A	8,0/7,9/7,8	8,2/8,2/8,0	9,9/9,8/9,7	13,5/13,4/13,3	20,2/20,2/20,1
	B	6,0/5,9/5,7	6,2/6,1/5,9	7,8/7,7/7,5	10,5/10,5/10,3	15,2/15,2/15,1
	C	4,0/3,8/3,4	4,8/4,7/4,4	5,7/5,6/5,3	7,5/7,5/7,3	11,9/11,8/11,7
	D	3,3/3,1/2,5	4,1/4,0/3,6	4,9/4,8/4,5	6,8/6,7/6,5	9,4/9,3/9,2
	E/F	2,5/2,3/NR	2,6/2,4/NR	2,7/2,5/NR	2,9/2,8/NR	3,4/3,2/2,7
700	A	8,1/8,1/7,9	8,3/8,3/8,1	10,0/10,0/9,8	13,6/13,6/13,5	20,4/20,4/20,3
	B	6,1/6,0/5,8	6,3/6,2/6,0	7,9/7,8/7,7	10,6/10,6/10,5	15,4/15,3/15,3
	C	4,1/4,0/3,6	4,9/4,8/4,5	5,8/5,7/5,4	7,7/7,6/7,4	12,0/12,0/11,9
	D	3,4/3,2/2,7	4,2/4,1/3,7	5,1/5,0/4,7	6,9/6,8/6,6	9,5/9,5/9,3
	E/F	2,6/2,4/NR	2,7/2,5/NR	2,8/2,7/NR	3,1/2,9/2,1	3,5/3,4/2,9
800	A	8,1/8,1/7,9	8,4/8,3/8,2	10,1/10,1/9,9	13,8/13,8/13,7	20,9/20,9/20,8
	B	6,0/6,0/5,7	6,2/6,2/5,9	7,9/7,8/7,7	10,7/10,7/10,6	15,6/15,6/15,5
	C	3,9/3,8/3,4	4,8/4,7/4,4	5,7/5,6/5,3	7,6/7,6/7,4	12,1/12,1/12,0
	D	3,2/3,0/2,4	4,0/3,9/3,5	4,9/4,8/4,5	6,8/6,8/6,6	9,5/9,5/9,3
	E/F	2,4/2,2/NR	2,5/2,3/NR	2,6/2,4/NR	2,8/2,6/NR	3,2/3,1/2,5

Table B.4 (continued)

DN	Soil group	Allowable depth of cover				
		m				
		$(\beta = 0,5/0,75/1,5)$				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
900	A	8,2/8,1/8,0	8,4/8,4/8,2	10,2/10,1/10,0	14,0/13,9/13,9	21,1/21,1/21,1
	B	6,1/6,0/5,8	6,2/6,2/6,0	7,9/7,9/7,7	10,8/10,8/10,7	15,8/15,8/15,7
	C	3,9/3,8/3,4	4,8/4,7/4,4	5,7/5,6/5,4	7,7/7,6/7,4	12,2/12,2/12,1
	D	3,2/3,0/2,4	4,0/3,9/3,5	4,9/4,8/4,5	6,9/6,8/6,6	9,6/9,5/9,4
	E/F	2,4/2,1/NR	2,5/2,2/NR	2,6/2,3/NR	2,8/2,6/NR	3,2/3,0/2,4
1000	A	8,2/8,2/8,0	8,5/8,4/8,3	10,2/10,2/10,1	14,1/14,0/14,0	21,3/21,3/21,2
	B	6,1/6,0/5,8	6,3/6,2/6,0	8,0/7,9/7,8	10,9/10,8/10,7	15,9/15,9/15,8
	C	3,9/3,8/3,4	4,8/4,7/4,4	5,7/5,6/5,4	7,7/7,6/7,5	12,3/12,3/12,2
	D	3,1/3,0/2,4	4,0/3,9/3,5	4,9/4,8/4,6	6,9/6,8/6,6	9,6/9,6/9,4
	E/F	2,3/2,1/NR	2,4/2,2/NR	2,5/2,3/NR	2,7/2,5/NR	3,2/3,0/2,4
1100	A	8,2/8,1/8,0	8,4/8,4/8,2	10,2/10,1/10,0	14,0/14,0/13,9	21,2/21,2/21,2
	B	6,0/6,0/5,7	6,2/6,1/5,9	7,9/7,9/7,7	10,8/10,8/10,7	15,8/15,8/15,7
	C	3,8/3,7/3,3	4,7/4,6/4,3	5,6/5,6/5,3	7,6/7,6/7,4	12,2/12,2/12,1
	D	3,1/2,9/2,3	3,9/3,8/3,5	4,9/4,8/4,5	6,8/6,7/6,6	9,5/9,5/9,4
	E/F	2,3/2,0/NR	2,4/2,1/NR	2,5/2,3/NR	2,7/2,5/NR	3,1/2,9/2,3
1200	A	8,1/8,1/7,9	8,4/8,3/8,2	10,1/10,1/10,0	14,0/13,9/13,9	21,2/21,2/21,1
	B	6,0/5,9/5,7	6,2/6,1/5,9	7,9/7,8/7,7	10,8/10,7/10,6	15,8/15,8/15,7
	C	3,8/3,7/3,3	4,7/4,6/4,3	5,6/5,5/5,3	7,6/7,5/7,4	12,2/12,2/12,1
	D	3,0/2,9/2,3	3,9/3,8/3,4	4,8/4,7/4,5	6,8/6,7/6,5	9,5/9,4/9,3
	E/F	2,2/2,0/NR	2,3/2,1/NR	2,4/2,2/NR	2,6/2,4/NR	3,0/2,9/2,3
1400	A	8,1/8,1/7,9	8,4/8,3/8,2	10,1/10,1/10,0	13,9/13,9/13,8	21,2/21,1/21,1
	B	6,0/5,9/5,7	6,1/6,1/5,9	7,8/7,8/7,7	10,8/10,7/10,6	15,8/15,7/15,7
	C	3,8/3,7/3,3	4,7/4,6/4,3	5,6/5,5/5,3	7,5/7,5/7,3	12,2/12,1/12,0
	D	3,0/2,9/2,3	3,9/3,8/3,5	4,8/4,7/4,5	6,7/6,7/6,5	9,4/9,4/9,3
	E/F	2,2/2,0/NR	2,3/2,1/NR	2,4/2,2/NR	2,6/2,4/NR	3,0/2,9/2,3
1500	A	8,1/8,0/7,9	8,3/8,3/8,1	10,1/10,0/9,9	13,9/13,9/13,8	21,1/21,1/21,0
	B	5,9/5,9/5,7	6,1/6,1/5,9	7,8/7,8/7,6	10,7/10,7/10,6	15,7/15,7/15,6
	C	3,8/3,6/3,3	4,6/4,5/4,3	5,5/5,5/5,3	7,5/7,5/7,3	12,1/12,1/12,0
	D	3,0/2,9/2,3	3,9/3,8/3,4	4,8/4,7/4,4	6,7/6,7/6,5	9,4/9,4/9,3
	E/F	2,2/2,0/NR	2,3/2,1/NR	2,4/2,2/NR	2,6/2,4/NR	3,0/2,8/2,3
1600	A	8,1/8,0/7,9	8,3/8,3/8,1	10,1/10,0/9,9	13,9/13,9/13,8	21,1/21,1/21,0
	B	5,9/5,9/5,7	6,1/6,0/5,9	7,8/7,7/7,6	10,7/10,7/10,6	15,7/15,7/15,6
	C	3,7/3,6/3,3	4,6/4,5/4,3	5,5/5,4/5,2	7,5/7,4/7,3	12,1/12,1/12,0
	D	3,0/2,8/2,3	3,8/3,7/3,4	4,7/4,7/4,4	6,7/6,6/6,5	9,4/9,3/9,2
	E/F	2,2/2,0/NR	2,3/2,1/NR	2,4/2,2/NR	2,5/2,4/NR	2,9/2,8/2,3

Table B.4 (continued)

DN	Soil group	Allowable depth of cover				
		m ($\beta = 0,5/0,75/1,5$)				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
1800	A	8,0/8,0/7,9	8,3/8,2/8,1	10,0/10,0/9,9	13,8/13,8/13,7	21,0/21,0/21,0
	B	5,9/5,8/5,6	6,0/6,0/5,8	7,7/7,7/7,6	10,6/10,6/10,5	15,6/15,6/15,5
	C	3,7/3,6/3,3	4,6/4,5/4,2	5,5/5,4/5,2	7,4/7,4/7,3	12,0/12,0/11,9
	D	2,9/2,8/2,3	3,8/3,7/3,4	4,7/4,6/4,4	6,6/6,6/6,4	9,3/9,3/9,2
	E/F	2,2/2,0/NR	2,2/2,1/NR	2,3/2,1/NR	2,5/2,3/NR	2,9/2,8/2,3
2000	A	8,0/8,0/7,9	8,3/8,2/8,1	10,0/10,0/9,9	13,8/13,8/13,7	21,0/21,0/21,0
	B	5,9/5,8/5,7	6,1/6,0/5,8	7,7/7,7/7,6	10,6/10,6/10,5	15,6/15,6/15,6
	C	3,7/3,6/3,3	4,6/4,5/4,3	5,5/5,4/5,2	7,4/7,4/7,3	12,0/12,0/11,9
	D	3,0/2,8/2,4	3,8/3,7/3,4	4,7/4,6/4,4	6,6/6,6/6,4	9,3/9,3/9,2
	E/F	2,2/2,0/NR	2,3/2,1/NR	2,3/2,2/NR	2,5/2,4/1,7	2,9/2,8/2,3
2200	A	8,0/8,0/7,9	8,2/8,2/8,1	10,0/10,0/9,9	13,8/13,8/13,7	21,0/21,0/20,9
	B	5,9/5,8/5,7	6,0/6,0/5,8	7,7/7,7/7,6	10,6/10,6/10,5	15,6/15,6/15,5
	C	3,7/3,6/3,3	4,5/4,5/4,3	5,4/5,4/5,2	7,4/7,4/7,3	12,0/12,0/11,9
	D	2,9/2,8/2,4	3,8/3,7/3,5	4,7/4,6/4,4	6,6/6,6/6,4	9,3/9,3/9,2
	E/F	2,2/2,0/NR	2,2/2,1/NR	2,3/2,2/NR	2,5/2,4/1,8	2,9/2,8/2,4
2400	A	8,0/7,9/7,8	8,2/8,2/8,1	10,0/9,9/9,8	13,8/13,8/13,7	21,0/20,9/20,9
	B	5,8/5,8/5,6	6,0/6,0/5,8	7,7/7,7/7,6	10,6/10,6/10,5	15,6/15,5/15,5
	C	3,7/3,6/3,3	4,5/4,5/4,3	5,4/5,4/5,2	7,4/7,3/7,2	12,0/11,9/11,9
	D	2,9/2,8/2,5	3,8/3,7/3,5	4,7/4,6/4,4	6,6/6,5/6,4	9,3/9,2/9,1
	E/F	2,1/2,0/NR	2,2/2,1/NR	2,3/2,2/1,5	2,5/2,4/1,8	2,9/2,8/2,4
2600	A	8,0/7,9/7,9	8,2/8,2/8,1	10,0/9,9/9,9	13,8/13,8/13,7	21,0/20,9/20,9
	B	5,8/5,8/5,7	6,0/6,0/5,8	7,7/7,7/7,6	10,6/10,6/10,5	15,6/15,6/15,5
	C	3,7/3,6/3,4	4,5/4,5/4,3	5,4/5,4/5,2	7,4/7,4/7,3	12,0/11,9/11,9
	D	2,9/2,8/2,5	3,8/3,7/3,5	4,7/4,6/4,5	6,6/6,6/6,4	9,3/9,2/9,2
	E/F	2,2/2,0/NR	2,2/2,1/1,5	2,3/2,2/1,7	2,5/2,4/2,0	2,9/2,8/2,5
NR Not recommended						

Table B.5 — Allowable depths of cover for C30 pipes conforming to ISO 2531 — Cement mortar lining

DN	Soil group	Allowable depth of cover				
		m				
		$(\beta = 0,5/0,75/1,5)$				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
300	A	7,0/6,9/6,7	7,2/7,2/6,9	8,4/8,3/8,1	10,8/10,8/10,6	15,5/15,4/15,4
	B	5,7/5,6/5,3	5,9/5,8/5,5	7,0/6,9/6,7	8,9/8,8/8,7	12,2/12,2/12,1
	C	4,4/4,3/3,9	5,0/4,9/4,6	5,6/5,5/5,2	7,0/6,9/6,7	10,1/10,0/9,9
	D	3,9/3,8/3,3	4,5/4,4/4,0	5,1/5,0/4,7	6,5/6,4/6,2	8,4/8,4/8,2
	E/F	3,5/3,3/2,7	3,6/3,5/2,9	3,7/3,6/3,1	4,0/3,9/3,4	4,6/4,5/4,1
350	A	8,6/8,5/8,3	8,8/8,8/8,6	10,0/10,0/9,8	12,6/12,6/12,5	17,6/17,6/17,5
	B	7,2/7,2/7,0	7,4/7,4/7,2	8,6/8,5/8,4	10,6/10,6/10,5	14,3/14,2/14,2
	C	5,9/5,8/5,5	6,5/6,4/6,2	7,2/7,1/6,9	8,7/8,6/8,4	12,0/12,0/11,9
	D	5,4/5,3/5,0	6,1/6,0/5,7	6,7/6,6/6,4	8,2/8,1/7,9	10,4/10,3/10,2
	E/F	5,0/4,9/4,6	5,1/5,0/4,7	5,3/5,2/4,9	5,6/5,6/5,3	6,4/6,3/6,1
400	A	7,5/7,4/7,2	7,7/7,6/7,5	8,9/8,9/8,7	11,5/11,5/11,4	16,5/16,5/16,4
	B	6,1/6,0/5,8	6,3/6,2/6,0	7,5/7,4/7,2	9,5/9,4/9,3	13,0/13,0/12,9
	C	4,7/4,6/4,2	5,3/5,2/4,9	6,0/5,9/5,7	7,4/7,4/7,2	10,7/10,7/10,6
	D	4,2/4,1/3,7	4,8/4,7/4,4	5,5/5,4/5,1	6,9/6,8/6,6	9,0/8,9/8,8
	E/F	3,7/3,6/3,1	3,9/3,7/3,3	4,0/3,9/3,4	4,3/4,2/3,8	4,9/4,8/4,5
500	A	7,3/7,2/7,0	7,5/7,4/7,2	8,7/8,7/8,5	11,5/11,4/11,3	16,6/16,6/16,5
	B	5,8/5,7/5,4	6,0/5,9/5,6	7,2/7,1/6,9	9,3/9,2/9,1	13,0/12,9/12,8
	C	4,3/4,2/3,8	4,9/4,8/4,5	5,6/5,5/5,3	7,1/7,0/6,8	10,5/10,5/10,3
	D	3,8/3,6/3,2	4,4/4,3/3,9	5,1/5,0/4,7	6,5/6,5/6,2	8,7/8,6/8,4
	E/F	3,3/3,1/2,4	3,4/3,2/2,6	3,5/3,3/2,8	3,7/3,6/3,1	4,3/4,2/3,8
600	A	7,5/7,5/7,3	7,7/7,7/7,5	9,1/9,0/8,9	11,9/11,9/11,8	17,4/17,4/17,3
	B	6,0/5,9/5,6	6,1/6,1/5,8	7,4/7,4/7,2	9,6/9,6/9,4	13,5/13,5/13,4
	C	4,4/4,3/3,9	5,1/5,0/4,7	5,8/5,7/5,4	7,3/7,3/7,1	10,9/10,9/10,7
	D	3,8/3,7/3,3	4,5/4,4/4,1	5,2/5,1/4,8	6,7/6,7/6,5	8,9/8,9/8,7
	E/F	3,3/3,1/2,5	3,4/3,3/2,7	3,5/3,4/2,8	3,8/3,6/3,2	4,3/4,2/3,8
700	A	7,8/7,8/7,6	8,0/8,0/7,8	9,4/9,4/9,2	12,5/12,4/12,3	18,2/18,2/18,1
	B	6,2/6,1/5,9	6,4/6,3/6,1	7,7/7,6/7,5	10,0/10,0/9,9	14,1/14,1/14,0
	C	4,5/4,4/4,1	5,2/5,1/4,9	6,0/5,9/5,7	7,6/7,5/7,4	11,3/11,3/11,2
	D	3,9/3,8/3,4	4,6/4,6/4,2	5,4/5,3/5,0	7,0/6,9/6,7	9,3/9,2/9,1
	E/F	3,4/3,2/2,7	3,5/3,3/2,8	3,6/3,5/3,0	3,9/3,7/3,3	4,4/4,3/4,0
800	A	8,1/8,1/7,9	8,4/8,3/8,1	9,8/9,8/9,6	13,0/13,0/12,9	19,0/19,0/18,9
	B	6,4/6,3/6,1	6,6/6,5/6,3	8,0/7,9/7,8	10,4/10,4/10,3	14,7/14,7/14,6
	C	4,6/4,6/4,2	5,4/5,3/5,0	6,2/6,1/5,9	7,9/7,8/7,6	11,8/11,8/11,7
	D	4,1/3,9/3,6	4,8/4,7/4,4	5,6/5,5/5,2	7,2/7,2/7,0	9,6/9,6/9,5
	E/F	3,5/3,3/2,8	3,6/3,4/3,0	3,7/3,6/3,1	3,9/3,8/3,4	4,5/4,4/4,1

Table B.5 (continued)

DN	Soil group	Allowable depth of cover				
		m ($\beta = 0,5/0,75/1,5$)				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
900	A	8,0/8,0/7,8	8,3/8,2/8,1	9,7/9,7/9,6	12,9/12,9/12,8	18,9/18,9/18,8
	B	6,3/6,2/6,0	6,5/6,4/6,2	7,9/7,9/7,7	10,3/10,3/10,2	14,6/14,6/14,5
	C	4,6/4,5/4,2	5,3/5,2/5,0	6,1/6,0/5,8	7,8/7,7/7,6	11,7/11,7/11,6
	D	4,0/3,9/3,5	4,7/4,6/4,3	5,5/5,4/5,2	7,1/7,1/6,9	9,5/9,5/9,4
	E/F	3,4/3,2/2,7	3,5/3,4/2,9	3,6/3,5/3,0	3,9/3,7/3,3	4,4/4,3/4,0
1000	A	7,9/7,8/7,7	8,1/8,1/7,9	9,6/9,5/9,4	12,7/12,7/12,6	18,7/18,7/18,6
	B	6,2/6,1/5,9	6,4/6,3/6,1	7,8/7,7/7,5	10,2/10,1/10,0	14,4/14,4/14,3
	C	4,4/4,3/4,0	5,2/5,1/4,8	5,9/5,9/5,6	7,6/7,6/7,4	11,5/11,5/11,4
	D	3,8/3,7/3,3	4,6/4,5/4,2	5,3/5,2/5,0	7,0/6,9/6,7	9,3/9,3/9,2
	E/F	3,2/3,1/2,5	3,3/3,2/2,7	3,4/3,3/2,8	3,7/3,6/3,1	4,2/4,1/3,8
1100	A	7,9/7,9/7,7	8,2/8,1/8,0	9,6/9,6/9,4	12,8/12,7/12,6	18,8/18,7/18,7
	B	6,2/6,1/5,9	6,4/6,3/6,1	7,8/7,7/7,6	10,2/10,2/10,1	14,4/14,4/14,3
	C	4,5/4,4/4,1	5,2/5,1/4,9	6,0/5,9/5,7	7,6/7,6/7,4	11,6/11,5/11,4
	D	3,9/3,8/3,4	4,6/4,5/4,2	5,4/5,3/5,0	7,0/6,9/6,8	9,4/9,3/9,2
	E/F	3,3/3,1/2,6	3,4/3,2/2,7	3,5/3,4/2,9	3,7/3,6/3,2	4,3/4,2/3,8
1200	A	7,8/7,8/7,6	8,0/8,0/7,8	9,5/9,4/9,3	12,6/12,6/12,5	18,6/18,6/18,5
	B	6,1/6,0/5,8	6,3/6,2/6,0	7,7/7,6/7,5	10,1/10,1/9,9	14,3/14,3/14,2
	C	4,3/4,2/3,9	5,1/5,0/4,7	5,8/5,8/5,6	7,5/7,5/7,3	11,4/11,4/11,3
	D	3,7/3,6/3,3	4,5/4,4/4,1	5,2/5,2/4,9	6,9/6,8/6,6	9,2/9,2/9,1
	E/F	3,1/3,0/2,5	3,2/3,1/2,6	3,4/3,2/2,8	3,6/3,5/3,1	4,1/4,0/3,7
1400	A	7,8/7,7/7,6	8,0/7,9/7,8	9,4/9,4/9,3	12,6/12,6/12,5	18,5/18,5/18,5
	B	6,0/6,0/5,8	6,2/6,2/6,0	7,6/7,6/7,4	10,0/10,0/9,9	14,2/14,2/14,1
	C	4,3/4,2/3,9	5,0/4,9/4,7	5,8/5,7/5,5	7,5/7,4/7,3	11,3/11,3/11,2
	D	3,7/3,6/3,2	4,4/4,3/4,1	5,2/5,1/4,9	6,8/6,8/6,6	9,2/9,1/9,0
	E/F	3,1/3,0/2,4	3,2/3,1/2,6	3,3/3,2/2,7	3,5/3,4/3,0	4,0/4,0/3,6
1500	A	7,7/7,7/7,5	8,0/7,9/7,8	9,4/9,4/9,3	12,6/12,5/12,4	18,5/18,5/18,4
	B	6,0/6,0/5,8	6,2/6,1/6,0	7,6/7,5/7,4	10,0/10,0/9,9	14,2/14,2/14,1
	C	4,3/4,2/3,9	5,0/4,9/4,7	5,8/5,7/5,5	7,4/7,4/7,2	11,3/11,3/11,2
	D	3,7/3,6/3,2	4,4/4,3/4,0	5,2/5,1/4,9	6,8/6,7/6,6	9,1/9,1/9,0
	E/F	3,1/3,0/2,4	3,2/3,1/2,6	3,3/3,2/2,7	3,5/3,4/3,0	4,0/3,9/3,6
1600	A	7,7/7,7/7,5	7,9/7,9/7,8	9,4/9,4/9,2	12,5/12,5/12,4	18,5/18,5/18,4
	B	6,0/5,9/5,8	6,2/6,1/5,9	7,6/7,5/7,4	10,0/10,0/9,8	14,2/14,2/14,1
	C	4,3/4,2/3,9	5,0/4,9/4,7	5,8/5,7/5,5	7,4/7,4/7,2	11,3/11,3/11,2
	D	3,7/3,6/3,2	4,4/4,3/4,0	5,1/5,1/4,9	6,8/6,7/6,6	9,1/9,1/9,0
	E/F	3,1/2,9/2,5	3,2/3,0/2,6	3,3/3,2/2,7	3,5/3,4/3,0	4,0/3,9/3,6

Table B.5 (continued)

DN	Soil group	Allowable depth of cover				
		m ($\beta = 0,5/0,75/1,5$)				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
1800	A	7,7/7,6/7,5	7,9/7,9/7,7	9,4/9,3/9,2	12,5/12,5/12,4	18,5/18,4/18,4
	B	6,0/5,9/5,7	6,1/6,1/5,9	7,5/7,5/7,4	9,9/9,9/9,8	14,1/14,1/14,0
	C	4,2/4,2/3,9	5,0/4,9/4,7	5,7/5,7/5,5	7,4/7,3/7,2	11,3/11,2/11,1
	D	3,6/3,5/3,2	4,4/4,3/4,0	5,1/5,0/4,8	6,7/6,7/6,5	9,1/9,1/8,9
	E/F	3,0/2,9/2,5	3,1/3,0/2,6	3,2/3,1/2,7	3,5/3,4/3,0	4,0/3,9/3,6
2000	A	7,7/7,6/7,5	7,9/7,8/7,7	9,3/9,3/9,2	12,5/12,5/12,4	18,4/18,4/18,4
	B	5,9/5,9/5,7	6,1/6,1/5,9	7,5/7,5/7,4	9,9/9,9/9,8	14,1/14,1/14,0
	C	4,2/4,1/3,9	4,9/4,9/4,7	5,7/5,6/5,5	7,4/7,3/7,2	11,2/11,2/11,1
	D	3,6/3,5/3,2	4,3/4,3/4,0	5,1/5,0/4,8	6,7/6,7/6,5	9,1/9,0/8,9
	E/F	3,0/2,9/2,5	3,1/3,0/2,6	3,2/3,1/2,8	3,5/3,4/3,0	3,9/3,9/3,6
NR Not recommended						

Table B.6 — Allowable depths of cover for C30 pipes conforming to ISO 2531 — Flexible lining

DN	Soil group	Allowable depth of cover				
		m				
		$(\beta = 0,5/0,75/1,5)$				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
300	A	8,3/8,2/8,0	8,5/8,5/8,3	9,9/9,8/9,7	12,7/12,7/12,6	18,2/18,2/18,1
	B	6,8/6,7/6,5	7,0/6,9/6,7	8,3/8,2/8,0	10,5/10,4/10,3	14,4/14,4/14,3
	C	5,2/5,1/4,8	5,9/5,8/5,6	6,6/6,6/6,3	8,2/8,2/8,0	11,9/11,8/11,7
	D	4,7/4,6/4,3	5,4/5,3/5,0	6,1/6,0/5,8	7,6/7,6/7,4	9,9/9,9/9,7
	E/F	4,2/4,1/3,6	4,3/4,2/3,8	4,5/4,4/4,0	4,8/4,7/4,3	5,4/5,3/5,1
350	A	9,1/9,1/8,9	9,4/9,4/9,2	10,7/10,6/10,5	13,5/13,4/13,3	18,8/18,8/18,7
	B	7,7/7,7/7,5	7,9/7,9/7,7	9,2/9,1/9,0	11,4/11,3/11,2	15,2/15,2/15,1
	C	6,3/6,2/6,0	7,0/6,9/6,7	7,7/7,6/7,4	9,2/9,2/9,0	12,9/12,8/12,7
	D	5,8/5,7/5,5	6,5/6,4/6,2	7,2/7,1/6,9	8,7/8,7/8,5	11,1/11,0/10,9
	E/F	5,3/5,2/4,9	5,5/5,4/5,1	5,7/5,6/5,3	6,0/6,0/5,7	6,9/6,8/6,6
400	A	8,5/8,5/8,3	8,8/8,7/8,6	10,2/10,1/10,0	13,1/13,1/13,0	18,8/18,8/18,7
	B	7,0/6,9/6,7	7,2/7,1/6,9	8,5/8,5/8,3	10,8/10,8/10,6	14,9/14,8/14,7
	C	5,4/5,3/4,0	6,1/6,0/5,8	6,9/6,8/6,6	8,5/8,4/8,2	12,2/12,2/12,1
	D	4,9/4,8/4,4	5,6/5,5/5,2	6,3/6,2/6,0	7,9/7,8/7,6	10,3/10,2/10,1
	E/F	4,3/4,2/3,8	4,5/4,4/4,0	4,6/4,5/4,1	4,9/4,8/4,5	5,6/5,5/5,2
500	A	8,4/8,3/8,2	8,6/8,6/8,4	10,1/10,0/9,9	13,2/13,2/13,1	19,2/19,2/19,1
	B	6,7/6,6/6,4	6,9/6,8/6,6	8,3/8,3/8,1	10,7/10,7/10,6	15,0/14,9/14,8
	C	5,0/4,9/4,6	5,7/5,7/5,4	6,5/6,4/6,2	8,2/8,2/8,0	12,1/12,1/12,0
	D	4,4/4,3/3,9	5,2/5,1/4,8	5,9/5,8/5,6	7,6/7,5/7,3	10,0/10,0/9,8
	E/F	3,8/3,7/3,2	4,0/3,8/3,4	4,1/4,0/3,6	4,4/4,3/3,9	5,0/4,9/4,6
600	A	8,4/8,4/8,2	8,7/8,6/8,5	10,2/10,1/10,0	13,4/13,4/13,3	19,5/19,5/19,4
	B	6,7/6,6/6,4	6,9/6,8/6,6	8,3/8,3/8,1	10,8/10,8/10,6	15,1/15,1/15,0
	C	5,0/4,9/4,5	5,7/5,6/5,4	6,5/6,4/6,2	8,2/8,2/8,0	12,2/12,2/12,1
	D	4,4/4,3/3,9	5,1/5,0/4,7	5,9/5,8/5,6	7,6/7,5/7,3	10,0/10,0/9,9
	E/F	3,8/3,6/3,2	3,9/3,8/3,3	4,0/3,9/3,5	4,3/4,2/3,8	4,9/4,8/4,5
700	A	8,5/8,4/8,3	8,7/8,7/8,5	10,2/10,2/10,1	13,6/13,6/13,5	19,9/19,9/19,8
	B	6,7/6,6/6,4	6,9/6,8/6,6	8,4/8,3/8,2	10,9/10,9/10,8	15,4/15,4/15,3
	C	4,9/4,8/4,5	5,7/5,6/5,4	6,5/6,4/6,2	8,3/8,2/8,0	12,4/12,4/12,2
	D	4,3/4,2/3,8	5,1/5,0/4,7	5,8/5,8/5,5	7,6/7,5/7,4	10,1/10,1/9,9
	E/F	3,7/3,6/3,1	3,8/3,7/3,3	3,9/3,8/3,4	4,2/4,1/3,7	4,8/4,7/4,3
800	A	8,5/8,5/8,3	8,8/8,7/8,6	10,3/10,3/10,1	13,6/13,6/13,5	19,9/19,9/19,8
	B	6,7/6,7/6,4	6,9/6,9/6,7	8,4/8,3/8,2	10,9/10,9/10,8	15,4/15,4/15,3
	C	4,9/4,8/4,5	5,7/5,6/5,3	6,5/6,4/6,2	8,3/8,2/8,0	12,4/12,4/12,2
	D	4,3/4,2/3,8	5,0/5,0/4,7	5,8/5,8/5,5	7,6/7,5/7,4	10,1/10,1/9,9
	E/F	3,6/3,5/3,1	3,8/3,6/3,2	3,9/3,8/3,4	4,2/4,1/3,7	4,8/4,7/4,3

Table B.6 (continued)

DN	Soil group	Allowable depth of cover				
		m ($\beta = 0,5/0,75/1,5$)				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
900	A	8,5/8,5/8,4	8,8/8,8/8,6	10,3/10,3/10,2	13,7/13,7/13,6	20,1/20,1/20,0
	B	6,7/6,7/6,5	6,9/6,9/6,7	8,4/8,4/8,2	11,0/11,0/10,8	15,5/15,5/15,4
	C	4,9/4,8/4,5	5,7/5,6/5,3	6,5/6,4/6,2	8,3/8,2/8,1	12,4/12,4/12,3
	D	4,3/4,1/3,8	5,0/4,9/4,7	5,8/5,8/5,5	7,6/7,5/7,4	10,1/10,1/10,0
	E/F	3,6/3,5/3,0	3,7/3,6/3,2	3,9/3,7/3,3	4,1/4,0/3,7	4,7/4,6/4,3
1000	A	8,5/8,5/8,4	8,8/8,8/8,6	10,4/10,3/10,2	13,8/13,8/13,7	20,3/20,2/20,2
	B	6,7/6,6/6,4	6,9/6,8/6,6	8,4/8,4/8,2	11,0/11,0/10,9	15,6/15,6/15,5
	C	4,8/4,7/4,4	5,6/5,5/5,3	6,4/6,4/6,2	8,2/8,2/8,0	12,5/12,4/12,3
	D	4,2/4,1/3,7	5,0/4,9/4,6	5,8/5,7/5,5	7,6/7,5/7,3	10,1/10,1/10,0
	E/F	3,5/3,4/2,9	3,6/3,5/3,1	3,8/3,6/3,2	4,0/3,9/3,5	4,6/4,5/4,2
1100	A	8,6/8,5/8,4	8,8/8,8/8,6	10,4/10,4/10,2	13,8/13,8/13,7	20,3/20,3/20,2
	B	6,7/6,7/6,5	6,9/6,9/6,7	8,4/8,4/8,2	11,1/11,0/10,9	15,6/15,6/15,5
	C	4,8/4,8/4,5	5,6/5,6/5,3	6,5/6,4/6,2	8,3/8,2/8,1	12,5/12,5/12,4
	D	4,2/4,1/3,8	5,0/4,9/4,6	5,8/5,7/5,5	7,6/7,5/7,4	10,2/10,1/10,0
	E/F	3,6/3,4/3,0	3,7/3,6/3,1	3,8/3,7/3,3	4,1/4,0/3,6	4,6/4,6/4,3
1200	A	8,5/8,4/8,3	8,7/8,7/8,5	10,3/10,2/10,1	13,7/13,7/13,6	20,1/20,1/20,1
	B	6,6/6,5/6,4	6,8/6,7/6,6	8,3/8,3/8,1	10,9/10,9/10,8	15,5/15,4/15,4
	C	4,7/4,6/4,4	5,5/5,4/5,2	6,5/6,4/6,2	8,1/8,1/8,0	12,4/12,3/12,2
	D	4,1/4,0/3,6	4,9/4,8/4,5	5,7/5,6/5,4	7,5/7,4/7,2	10,0/10,0/9,9
	E/F	3,4/3,3/2,9	3,6/3,4/3,3	3,7/3,6/3,2	3,9/3,8/3,5	4,5/4,4/4,1
1400	A	8,4/8,4/8,2	8,6/8,6/8,5	10,2/10,2/10,1	13,6/13,6/13,5	20,1/20,0/20,0
	B	6,5/6,5/6,3	6,7/6,7/6,5	8,2/8,2/8,1	10,9/10,8/10,7	15,4/15,4/15,3
	C	4,7/4,6/4,3	5,5/5,4/5,2	6,3/6,2/6,0	8,1/8,0/7,9	12,3/12,2/12,2
	D	4,0/3,9/3,6	4,8/4,7/4,5	5,6/5,6/5,3	7,4/7,3/7,2	9,9/9,9/9,8
	E/F	3,4/3,3/2,8	3,5/3,4/3,3	3,6/3,5/3,1	3,9/3,8/3,4	4,4/4,3/4,0
1500	A	8,4/8,3/8,2	8,6/8,6/8,5	10,2/10,1/10,0	13,6/13,6/13,5	20,0/20,0/20,0
	B	6,5/6,5/6,3	6,7/6,7/6,5	8,2/8,2/8,1	10,8/10,8/10,7	15,4/15,3/15,3
	C	4,6/4,6/4,3	5,4/5,4/5,2	6,3/6,2/6,0	8,1/8,0/7,9	12,2/12,2/12,1
	D	4,0/3,9/3,6	4,8/4,7/4,5	5,6/5,5/5,3	7,4/7,3/7,2	9,9/9,9/9,8
	E/F	3,4/3,3/2,8	3,5/3,4/3,0	3,6/3,5/3,1	3,8/3,7/3,4	4,4/4,3/4,0
1600	A	8,4/8,3/8,2	8,6/8,6/8,4	10,2/10,1/10,0	13,6/13,5/13,5	20,0/20,0/19,9
	B	6,5/6,5/6,3	6,7/6,7/6,5	8,2/8,2/8,0	10,8/10,8/10,7	15,3/15,3/15,2
	C	4,6/4,6/4,3	5,4/5,4/5,1	6,2/6,2/6,0	8,0/8,0/7,9	12,2/12,2/12,1
	D	4,0/3,9/3,6	4,8/4,7/4,5	5,6/5,5/5,3	7,3/7,3/7,2	9,9/9,8/9,7
	E/F	3,4/3,2/2,8	3,5/3,4/3,0	3,6/3,5/3,1	3,8/3,7/3,4	4,4/4,3/4,0

Table B.6 (continued)

DN	Soil group	Allowable depth of cover				
		m				
		$(\beta = 0,5/0,75/1,5)$				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
1800	A	8,3/8,3/8,2	8,6/8,5/8,4	10,1/10,1/10,0	13,5/13,5/13,4	20,0/19,9/19,9
	B	6,5/6,4/6,3	6,7/6,6/6,5	8,2/8,1/8,0	10,8/10,7/10,6	15,3/15,3/15,2
	C	4,6/4,5/4,3	5,4/5,3/5,1	6,2/6,2/6,0	8,0/8,0/7,8	12,2/12,2/12,1
	D	4,0/3,9/3,6	4,7/4,7/4,4	5,5/5,5/5,3	7,3/7,3/7,1	9,8/9,8/9,7
	E/F	3,3/3,2/2,8	3,4/3,3/3,0	3,5/3,4/3,1	3,8/3,7/3,4	4,3/4,2/4,0
2000	A	8,3/8,3/8,2	8,5/8,5/8,4	10,1/10,1/10,0	13,5/13,5/13,4	19,9/19,9/19,9
	B	6,4/6,4/6,3	6,6/6,6/6,4	8,1/8,1/8,0	10,7/10,7/10,6	15,3/15,2/15,2
	C	4,6/4,5/4,3	5,4/5,3/5,1	6,2/6,1/6,0	8,0/7,9/7,8	12,1/12,1/12,0
	D	3,9/3,9/3,6	4,7/4,6/4,4	5,5/5,5/5,3	7,3/7,2/7,1	9,8/9,8/9,7
	E/F	3,3/3,2/2,9	3,4/3,3/3,0	3,5/3,4/3,1	3,8/3,7/3,4	4,3/4,2/4,0
NR Not recommended						

Table B.7 — Allowable depths of cover for C40 pipes conforming to ISO 2531 — Cement mortar lining

DN	Soil group	Allowable depth of cover				
		m				
		$(\beta = 0,5/0,75/1,5)$				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
40	A	126,0/126,0/126,0	129,6/129,6/129,6	133,6/133,6/133,6	142,4/142,4/142,4	161,5/161,5/161,5
	B	125,7/125,7/125,7	129,3/129,3/129,3	133,3/133,3/133,3	142,0/142,0/142,0	160,8/160,8/160,8
	C	125,4/125,4/125,4	129,1/129,1/129,1	133,0/133,0/133,0	141,5/141,5/141,5	160,3/160,3/160,3
	D	125,4/125,4/125,3	129,0/129,0/129,0	132,9/132,9/132,9	141,4/141,4/141,4	160,0/160,0/160,0
	E/F	125,3/125,3/125,2	128,8/128,8/128,8	132,6/132,6/132,6	140,9/140,9/140,9	159,2/159,2/159,1
50	A	88,9/88,9/88,9	91,5/91,5/91,5	94,4/94,4/94,4	100,8/100,8/100,8	114,7/114,7/114,7
	B	88,6/88,6/88,6	91,1/91,1/91,1	94,1/94,1/94,1	100,3/100,3/100,3	113,9/113,9/113,8
	C	88,3/88,3/88,3	90,9/90,9/90,0	93,7/93,7/93,7	99,8/99,8/99,8	113,3/113,3/113,3
	D	88,2/88,2/88,1	90,8/90,8/90,8	93,6/93,6/93,6	99,7/99,7/99,7	112,9/112,9/112,9
	E/F	88,1/88,1/88,0	90,6/90,6/90,6	93,2/93,2/93,2	99,1/99,1/99,1	119,9/119,9/119,9
65	A	56,6/56,6/56,6	58,2/58,2/58,2	60,2/60,2/60,2	64,6/64,6/64,6	74,1/74,1/74,0
	B	56,2/56,2/56,2	57,8/57,8/57,8	59,8/59,8/59,8	64,0/64,0/64,0	73,0/73,0/73,0
	C	55,8/55,8/55,8	57,5/57,5/57,5	59,4/59,3/59,3	63,4/63,4/63,4	72,3/72,3/72,3
	D	55,6/55,6/55,6	57,4/57,4/57,3	59,2/59,2/59,2	63,2/63,2/63,2	71,8/71,8/71,7
	E/F	55,5/55,5/55,5	57,1/57,1/57,1	58,8/58,8/58,7	62,4/62,4/62,4	70,5/70,5/70,5

Table B.7 (continued)

DN	Soil group	Allowable depth of cover				
		m				
		$(\beta = 0,5/0,75/1,5)$				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
80	A	39,4/39,4/39,4	40,5/40,5/40,5	42,1/42,1/42,0	45,5/45,5/45,4	52,7/52,6/52,6
	B	38,9/38,9/38,9	40,0/40,0/40,0	41,6/41,5/41,5	44,7/44,7/44,7	51,4/51,4/51,3
	C	38,4/38,4/38,3	39,7/39,7/39,6	41,0/41,0/41,0	44,0/44,0/43,9	50,5/50,5/50,5
	D	38,2/38,2/38,2	39,5/39,5/39,4	40,8/40,8/40,8	43,8/43,8/43,7	49,9/49,9/49,8
	E/F	38,1/38,1/38,0	39,2/39,1/39,1	40,3/40,3/40,3	42,8/42,8/42,8	48,4/48,4/48,3
100	A	27,3/27,3/27,3	28,1/28,1/28,1	29,4/29,4/29,3	32,1/32,1/32,1	37,9/37,9/37,8
	B	26,7/26,7/26,7	27,5/27,5/27,4	28,7/28,7/28,7	31,2/31,2/31,2	36,3/36,3/36,3
	C	26,1/26,1/26,0	27,1/27,1/27,0	28,1/28,1/28,0	30,3/30,3/30,2	35,3/35,3/35,2
	D	25,9/25,9/25,8	26,9/26,8/26,8	27,9/27,9/27,8	30,1/30,1/30,0	34,5/34,5/34,4
	E/F	25,7/25,7/25,6	26,4/26,4/26,4	27,2/27,2/27,1	28,9/28,9/28,9	32,7/32,7/32,6
125	A	19,9/19,8/19,8	20,4/20,4/20,3	21,6/21,5/21,5	24,0/24,0/23,9	29,0/29,0/29,0
	B	19,1/19,1/19,0	19,7/19,7/19,6	20,8/20,8/20,7	22,9/22,9/22,8	27,1/27,1/27,1
	C	18,4/18,4/18,3	19,2/19,2/19,1	20,0/20,0/19,9	21,8/21,8/21,7	25,9/25,9/25,8
	D	18,2/18,1/18,0	18,9/18,9/18,8	19,7/19,7/19,6	21,5/21,5/21,4	25,0/24,9/24,9
	E/F	17,9/17,9/17,8	18,4/18,4/18,3	19,0/18,9/18,9	20,2/20,1/20,1	22,8/22,8/22,7
150	A	14,9/14,9/14,8	15,4/15,3/15,2	16,4/16,4/16,3	18,8/18,7/18,7	23,4/23,4/23,4
	B	14,0/14,0/13,9	14,5/14,4/14,3	15,5/15,5/15,4	17,5/17,4/17,4	21,2/21,2/21,1
	C	13,2/13,1/13,0	13,9/13,8/13,7	14,6/14,5/14,4	16,1/16,1/16,0	19,7/19,7/19,6
	D	12,9/12,8/12,7	13,6/13,5/13,4	14,3/14,2/14,1	15,8/15,8/15,7	18,6/18,6/18,5
	E/F	12,6/12,5/12,4	12,9/12,9/12,8	13,3/13,3/13,2	14,2/14,1/14,0	16,0/16,0/15,9
200	A	10,9/10,9/10,7	11,2/11,2/11,1	12,3/12,3/12,2	14,8/14,8/14,7	19,5/19,5/19,4
	B	9,8/9,8/9,6	10,1/10,0/9,9	11,2/11,1/11,0	13,1/13,1/13,0	16,7/16,7/16,6
	C	8,7/8,6/8,5	9,3/9,3/9,1	10,0/10,0/9,8	11,5/11,4/11,3	14,8/14,8/14,7
	D	8,3/8,3/8,1	9,0/8,9/8,7	9,6/9,6/9,4	11,1/11,0/10,9	13,4/13,4/13,3
	E/F	8,0/7,9/7,7	8,2/8,1/7,9	8,4/8,4/8,2	9,0/8,9/8,8	10,2/10,1/10,0
250	A	10,8/10,7/10,6	11,1/11,0/10,9	12,2/12,2/12,1	14,7/14,7/14,7	19,6/19,6/19,5
	B	9,6/9,5/9,4	9,9/9,8/9,7	11,0/10,9/10,8	13,0/13,0/12,8	16,7/16,6/16,5
	C	8,4/8,4/8,2	9,1/9,0/8,8	9,7/9,7/9,5	11,2/11,2/11,1	14,7/14,7/14,6
	D	8,0/8,0/7,8	8,7/8,6/8,4	9,3/9,3/9,1	10,8/10,8/10,6	13,2/13,2/13,1
	E/F	7,6/7,6/7,4	7,9/7,8/7,6	8,1/8,0/7,8	8,6/8,6/8,4	9,8/9,7/9,6
300	A	10,4/10,4/10,2	10,7/10,7/10,5	11,9/11,9/11,8	14,5/14,5/14,4	19,5/19,5/19,4
	B	9,2/9,1/9,0	9,5/9,4/9,2	10,6/10,6/10,4	12,7/12,6/12,5	16,4/16,4/16,3
	C	7,9/7,9/7,7	8,6/8,5/8,4	9,3/9,2/9,1	10,8/10,8/10,6	14,3/14,3/14,2
	D	7,5/7,5/7,3	8,2/8,1/7,9	8,9/8,8/8,6	10,4/10,3/10,2	12,8/12,7/12,6
	E/F	7,1/7,0/6,8	7,3/7,3/7,1	7,5/7,5/7,3	8,0/8,0/7,8	9,1/9,0/8,9

Table B.7 (continued)

DN	Soil group	Allowable depth of cover				
		m				
		$(\beta = 0,5/0,75/1,5)$				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
350	A	10,6/10,6/10,4	10,9/10,9/10,7	12,1/12,1/12,0	14,8/14,7/14,6	19,8/19,8/19,7
	B	9,4/9,3/9,1	9,6/9,6/9,4	10,8/10,8/10,6	12,9/12,9/12,7	16,7/16,7/16,6
	C	8,1/8,0/7,9	8,8/8,7/8,5	9,5/9,4/9,3	11,0/11,0/10,8	14,6/14,5/14,4
	D	7,7/7,6/7,4	8,3/8,3/8,1	9,0/9,0/8,8	10,5/10,5/10,4	13,0/13,0/12,8
	E/F	7,3/7,2/7,0	7,5/7,4/7,2	7,7/7,6/7,4	8,2/8,1/8,0	9,3/9,2/9,1
400	A	10,1/10,0/9,9	10,4/10,3/10,2	11,6/11,5/11,4	14,2/14,1/14,0	19,2/19,2/19,1
	B	8,8/8,8/8,6	9,1/9,0/8,9	10,2/10,2/10,0	12,3/12,3/12,1	16,0/16,0/15,9
	C	7,6/7,5/7,3	8,2/8,2/8,0	8,9/8,9/8,7	10,4/10,4/10,2	13,9/13,9/13,8
	D	7,1/7,1/6,9	7,8/7,7/7,5	8,5/8,4/8,2	9,9/9,9/9,8	12,3/12,3/12,2
	E/F	6,7/6,6/6,4	6,9/6,9/6,6	7,1/7,1/6,9	7,6/7,5/7,3	8,6/8,6/8,4
450	A	9,9/9,9/9,7	10,2/10,2/10,0	11,4/11,4/11,2	14,0/14,0/13,9	19,0/19,0/18,9
	B	8,7/8,6/8,5	8,9/8,9/8,7	10,1/10,0/9,9	12,1/12,1/12,0	15,8/15,8/15,7
	C	7,4/7,4/7,2	8,1/8,0/7,8	8,8/8,7/8,5	10,3/10,2/10,1	13,7/13,7/13,6
	D	7,0/6,9/6,7	7,6/7,6/7,4	8,3/8,3/8,1	9,8/9,7/9,6	12,1/12,1/12,0
	E/F	6,6/6,5/6,3	6,8/6,7/6,5	7,0/6,9/6,7	7,4/7,4/7,2	8,4/8,4/8,2
500	A	9,6/9,5/9,4	9,8/9,8/9,6	11,0/11,0/10,8	13,6/13,5/13,4	18,5/18,5/18,4
	B	8,3/8,2/8,1	8,5/8,5/8,3	9,7/9,6/9,5	11,7/11,7/11,5	15,3/15,3/15,2
	C	7,0/7,0/6,8	7,7/7,6/7,4	8,4/8,3/8,1	9,8/9,8/9,6	13,2/13,2/13,1
	D	6,6/6,5/6,3	7,2/7,2/7,0	7,9/7,9/7,7	9,4/9,3/9,2	11,7/11,6/11,5
	E/F	6,2/6,1/5,9	6,4/6,3/6,1	6,6/6,5/6,3	7,0/6,9/6,7	7,9/7,9/7,7
600	A	9,4/9,4/9,2	9,7/9,6/9,5	10,9/10,8/10,7	13,4/13,4/13,3	18,3/18,3/18,2
	B	8,2/8,1/7,9	8,4/8,3/8,2	9,5/9,5/9,3	11,5/11,5/11,4	15,2/15,1/15,0
	C	6,9/6,8/6,6	7,5/7,5/7,3	8,2/8,1/8,0	9,7/9,6/9,5	13,1/13,0/12,9
	D	6,5/6,4/6,2	7,1/7,0/6,8	7,8/7,7/7,5	9,2/9,1/9,0	11,5/11,4/11,3
	E/F	6,0/6,0/5,7	6,2/6,2/5,9	6,4/6,4/6,1	6,8/6,8/6,6	7,8/7,7/7,5
700	A	9,1/9,1/8,9	9,4/9,4/9,2	10,6/10,5/10,4	13,1/13,1/13,0	18,0/18,0/17,9
	B	7,9/7,8/7,7	8,1/8,1/7,9	9,2/9,2/9,1	11,2/11,2/11,1	14,8/14,8/14,7
	C	6,6/6,6/6,4	7,3/7,2/7,0	7,9/7,9/7,7	9,4/9,3/9,2	12,7/12,7/12,6
	D	6,2/6,1/5,9	6,8/8,8/6,6	7,5/7,4/7,2	8,9/8,9/8,7	11,1/11,1/11,0
	E/F	5,8/5,7/5,5	6,0/5,9/5,6	6,1/6,1/5,8	6,5/6,5/6,3	7,4/7,4/7,2
800	A	9,1/9,0/8,9	9,3/9,3/9,1	10,5/10,5/10,3	13,0/13,0/12,9	17,9/17,9/17,8
	B	7,8/7,8/7,6	8,0/8,0/7,8	9,2/9,1/9,0	11,2/11,1/11,1	14,7/14,7/14,6
	C	6,6/6,5/6,3	7,2/7,1/6,9	7,8/7,8/7,6	9,3/9,2/9,1	12,6/12,6/12,5
	D	6,1/6,1/5,8	6,7/6,7/6,5	7,4/7,3/7,2	8,8/8,8/8,6	11,0/11,0/10,9
	E/F	5,7/5,6/5,4	5,9/5,8/5,6	6,1/6,0/5,8	6,5/6,4/6,2	7,3/7,3/7,1

Table B.7 (continued)

DN	Soil group	Allowable depth of cover				
		m ($\beta = 0,5/0,75/1,5$)				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
900	A	8,9/8,9/8,7	9,2/9,1/9,0	10,3/10,3/10,2	12,8/12,8/12,7	17,7/17,7/17,6
	B	7,6/7,6/7,4	7,9/7,8/7,7	9,0/8,9/8,8	11,0/10,9/10,8	14,5/14,5/14,4
	C	6,4/6,3/6,1	7,0/7,0/6,8	7,7/7,6/7,4	9,1/9,1/8,9	12,4/12,4/12,3
	D	6,0/5,9/5,7	6,6/6,5/6,3	7,2/7,2/7,0	8,6/8,6/8,4	10,8/10,8/10,7
	E/F	5,5/5,5/5,2	5,7/5,6/5,4	5,9/5,8/5,6	6,3/6,2/6,0	7,1/7,1/6,9
1000	A	8,9/8,8/8,7	9,1/9,1/9,0	10,3/10,3/10,1	12,8/12,8/12,7	17,7/17,6/17,6
	B	7,6/7,6/7,4	7,9/7,8/7,6	9,0/8,9/8,8	11,0/10,9/10,8	14,5/14,5/14,4
	C	6,4/6,3/6,1	7,0/6,9/6,7	7,6/7,6/7,4	9,1/9,0/8,9	12,4/12,4/12,3
	D	5,9/5,9/5,7	6,6/6,5/6,3	7,2/7,1/7,0	8,6/8,6/8,4	10,8/10,8/10,7
	E/F	5,5/5,4/5,2	5,7/5,6/5,4	5,9/5,8/5,6	6,2/6,2/6,0	7,1/7,0/6,9
1100	A	8,9/8,8/8,7	9,1/9,1/8,9	10,3/10,2/10,1	12,8/12,8/12,7	17,6/17,6/17,5
	B	7,6/7,5/7,4	7,8/7,8/7,6	8,9/8,9/8,8	10,9/10,9/10,8	14,5/14,4/14,3
	C	6,3/6,3/6,1	7,0/6,9/6,7	7,6/7,6/7,4	9,0/9,0/8,9	12,3/12,3/12,2
	D	5,9/5,9/5,6	6,5/6,5/6,3	7,2/7,1/6,9	8,6/8,5/8,4	10,8/10,7/10,6
	E/F	5,5/5,4/5,2	5,7/5,6/5,4	5,8/5,8/5,5	6,2/6,2/5,9	7,1/7,0/6,8
1200	A	8,8/8,7/8,6	9,0/9,0/8,8	10,2/10,1/10,0	12,7/12,6/12,6	17,5/17,5/17,4
	B	7,5/7,4/7,3	7,7/7,7/7,5	8,8/8,8/8,7	10,8/10,8/10,7	14,3/14,3/14,2
	C	6,2/6,2/6,0	6,9/6,8/6,6	7,5/7,5/7,3	8,9/8,9/8,8	12,2/12,2/12,1
	D	5,8/5,7/5,5	6,4/6,4/6,2	7,1/7,0/6,8	8,5/8,4/8,3	10,6/10,6/10,5
	E/F	5,4/5,3/5,1	5,6/5,5/5,3	5,7/5,7/5,4	6,1/6,0/5,8	6,9/6,9/6,7
NR Not recommended						

Table B.8 — Allowable depths of cover for C40 pipes conforming to ISO 2531 — Flexible lining

DN	Soil group	Allowable depth of cover				
		m				
		$(\beta = 0,5/0,75/1,5)$				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
40	A	126,0/126,0/126,0	129,6/129,6/129,6	133,6/133,6/133,6	142,4/142,4/142,4	161,5/161,5/161,5
	B	125,7/125,7/125,7	129,3/129,3/129,3	133,3/133,3/133,3	142,0/142,0/141,9	160,8/160,8/160,8
	C	125,4/125,4/125,4	129,1/129,1/129,1	133,0/133,0/133,0	141,5/141,5/141,5	160,3/160,3/160,3
	D	125,4/125,3/125,3	129,0/129,0/129,0	132,9/132,9/132,9	141,4/141,4/141,4	160,0/160,0/160,0
	E/F	125,3/125,3/125,2	128,8/128,8/128,8	132,6/132,6/132,6	140,9/140,9/140,9	159,2/159,2/159,1
50	A	88,9/88,9/88,9	91,5/91,5/91,5	94,4/94,4/94,4	100,8/100,8/100,8	114,7/114,7/114,7
	B	88,6/88,6/88,6	91,1/91,1/91,1	94,1/94,1/94,0	100,3/100,3/100,3	113,9/113,9/113,8
	C	88,3/88,3/88,3	90,9/90,9/90,9	93,7/93,7/93,7	99,8/99,8/99,8	113,3/113,3/113,3
	D	88,2/88,2/88,1	90,8/90,8/90,8	93,6/93,6/93,6	99,7/99,7/99,7	112,9/112,9/112,9
	E/F	88,1/88,1/88,0	90,6/90,6/90,6	93,2/93,2/93,2	99,1/99,1/99,0	111,9/111,9/111,9
60	A	64,5/64,5/64,4	66,3/66,3/66,3	68,5/68,5/68,5	73,4/73,4/73,4	83,9/83,9/83,9
	B	64,1/64,1/64,1	65,9/65,9/65,9	68,1/68,1/68,1	72,8/72,8/72,8	82,9/82,9/82,9
	C	63,7/63,7/63,7	65,6/65,6/65,6	67,7/67,7/67,7	72,2/72,2/72,2	82,3/82,3/82,2
	D	63,6/63,6/63,5	65,5/65,5/65,5	67,6/67,6/67,6	72,1/72,1/72,1	81,8/81,8/81,7
	E/F	63,4/63,4/63,4	65,2/65,2/65,2	67,2/67,2/67,1	71,4/71,4/71,3	80,6/80,6/80,6
65	A	56,6/56,6/56,6	58,2/58,2/58,2	60,2/60,2/60,2	64,6/64,6/64,6	74,1/74,1/74,0
	B	56,2/56,2/56,2	57,8/57,8/57,8	59,8/59,8/59,8	64,0/64,0/64,0	73,0/73,0/73,0
	C	55,8/55,8/55,7	57,5/57,5/57,5	59,4/59,3/59,3	63,4/63,4/63,4	72,3/72,3/72,3
	D	55,6/55,6/55,6	57,4/57,4/57,3	59,2/59,2/59,2	63,2/63,2/63,2	71,8/71,8/71,7
	E/F	55,5/55,5/55,5	57,1/57,1/57,1	58,8/58,8/58,7	62,4/62,4/62,4	70,5/70,5/70,5
80	A	39,4/39,4/39,4	40,5/40,5/40,5	42,1/42,1/42,0	45,5/45,5/45,4	52,7/52,6/52,6
	B	38,9/38,9/38,9	40,0/40,0/40,0	41,6/41,5/41,5	44,7/44,7/44,7	51,4/51,4/51,3
	C	38,4/38,4/38,3	39,7/39,7/39,6	41,0/41,0/41,0	44,0/44,0/43,9	50,5/50,5/50,5
	D	38,2/38,2/38,2	39,5/39,5/39,4	40,8/40,8/40,8	43,8/43,8/43,7	49,9/49,9/49,8
	E/F	38,1/38,1/38,0	39,2/39,1/39,1	40,3/40,3/40,3	42,8/42,8/42,8	48,4/48,4/48,3
100	A	27,3/27,3/27,3	28,1/28,1/28,1	29,4/29,4/29,3	32,1/32,1/32,1	37,9/37,9/37,8
	B	26,7/26,7/26,7	27,5/27,5/27,4	28,7/28,7/28,7	31,2/31,2/31,2	36,3/36,3/36,3
	C	26,1/26,1/26,0	27,1/27,1/27,0	28,1/28,1/28,0	30,3/30,3/30,2	35,3/35,3/35,2
	D	25,9/25,9/25,8	26,9/26,8/26,8	27,9/27,9/27,8	30,1/30,1/30,0	34,5/34,5/34,4
	E/F	25,7/25,7/25,6	26,4/26,4/26,4	27,2/27,2/27,1	28,9/28,9/28,9	32,7/32,7/32,6
125	A	19,9/19,8/19,8	20,4/20,4/20,3	21,6/21,5/21,5	24,0/24,0/23,9	29,0/29,0/29,0
	B	19,1/19,1/19,0	19,7/19,7/19,6	20,8/20,8/20,7	22,9/22,9/22,8	27,1/27,1/27,1
	C	18,4/18,4/18,3	19,2/19,2/19,1	20,0/20,0/19,9	21,8/21,8/21,7	25,9/25,9/25,8
	D	18,2/18,1/18,0	18,9/18,9/18,8	19,7/19,7/19,6	21,5/21,5/21,4	25,0/24,9/24,9
	E/F	17,9/17,9/17,8	18,4/18,4/18,3	19,0/18,9/18,9	20,2/20,1/20,1	22,8/22,8/22,7

Table B.8 (continued)

DN	Soil group	Allowable depth of cover				
		m				
		$(\beta = 0,5/0,75/1,5)$				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
150	A	14,9/14,9/14,8	15,4/15,3/15,2	16,4/16,4/16,3	18,8/18,7/18,7	23,4/23,4/23,4
	B	14,0/14,0/13,9	14,5/14,4/14,3	15,5/15,5/15,4	17,5/17,4/17,4	21,2/21,2/21,1
	C	13,2/13,1/13,0	13,9/13,8/13,7	14,6/14,5/14,4	16,1/16,1/16,0	19,7/19,7/19,6
	D	12,9/12,8/12,7	13,6/13,5/13,4	14,3/14,2/14,1	15,8/15,8/15,7	18,6/18,6/18,5
	E/F	12,6/12,5/12,4	12,9/12,9/12,8	13,3/13,3/13,2	14,2/14,1/14,0	16,0/16,0/15,9
200	A	10,9/10,9/10,7	11,2/11,2/11,1	12,3/12,3/12,2	14,8/14,8/14,7	19,5/19,5/19,4
	B	9,8/9,8/9,6	10,1/10,0/9,9	11,2/11,1/11,0	13,1/13,1/13,0	16,7/16,7/16,6
	C	8,7/8,6/8,5	9,3/9,3/9,1	10,0/10,0/9,8	11,5/11,4/11,3	14,8/14,8/14,7
	D	8,3/8,3/8,1	9,0/8,9/8,7	9,6/9,6/9,4	11,1/11,0/10,9	13,4/13,4/13,3
	E/F	8,0/7,9/7,7	8,2/8,1/7,9	8,4/8,4/8,2	9,0/8,9/8,8	10,2/10,1/10,0
250	A	10,8/10,7/10,6	11,1/11,0/10,9	12,2/12,2/12,1	14,7/14,7/14,6	19,6/19,6/19,5
	B	9,6/9,5/9,4	9,9/9,8/9,7	11,0/10,9/10,8	13,0/13,0/12,8	16,7/16,6/16,5
	C	8,4/8,4/8,2	9,1/9,0/8,8	9,7/9,7/9,5	11,2/11,2/11,1	14,7/14,7/14,6
	D	8,0/8,0/7,8	8,7/8,6/8,4	9,3/9,3/9,1	10,8/10,8/10,6	13,2/13,2/13,1
	E/F	7,6/7,6/7,4	7,9/7,8/7,6	8,1/8,0/7,8	8,6/8,6/8,4	9,8/9,7/9,6
300	A	10,4/10,4/10,2	10,7/10,7/10,5	11,9/11,9/11,8	14,5/14,5/14,4	19,5/19,5/19,4
	B	9,2/9,1/9,0	9,5/9,4/9,2	10,6/10,6/10,4	12,7/12,6/12,5	16,4/16,4/16,3
	C	7,9/7,9/7,7	8,6/8,5/8,4	9,3/9,2/9,1	10,8/10,8/10,6	14,3/14,3/14,2
	D	7,5/7,5/7,3	8,2/8,1/7,9	8,9/8,8/8,6	10,4/10,3/10,2	12,8/12,7/12,6
	E/F	7,1/7,0/6,8	7,3/7,3/7,1	7,5/7,5/7,3	8,0/8,0/7,8	9,1/9,0/8,9
350	A	10,6/10,6/10,4	10,9/10,9/10,7	12,1/12,1/12,0	14,8/14,7/14,6	19,8/19,8/19,7
	B	9,4/9,3/9,1	9,6/9,6/9,4	10,8/10,8/10,6	12,9/12,9/12,7	16,7/16,7/16,6
	C	8,1/8,0/7,9	8,8/8,7/8,5	9,5/9,4/9,3	11,0/11,0/10,8	14,6/14,5/14,4
	D	7,7/7,6/7,4	8,3/8,3/8,1	9,0/9,0/8,8	10,5/10,5/10,4	13,0/13,0/12,8
	E/F	7,3/7,2/7,0	7,5/7,4/7,2	7,7/7,6/7,4	8,2/8,1/8,0	9,3/9,2/9,1
400	A	10,1/10,0/9,9	10,4/10,3/10,2	11,6/11,5/11,4	14,2/14,1/14,0	19,2/19,1/19,1
	B	8,8/8,8/8,6	9,1/9,0/8,9	10,2/10,2/10,0	12,3/12,3/12,1	16,0/16,0/15,9
	C	7,6/7,5/7,3	8,2/8,2/8,0	8,9/8,9/8,7	10,4/10,4/10,2	13,9/13,9/13,8
	D	7,1/7,1/6,9	7,8/7,7/7,5	8,5/8,4/8,2	9,9/9,9/9,8	12,3/12,3/12,2
	E/F	6,7/6,6/6,4	6,9/6,9/6,6	7,1/7,1/6,9	7,6/7,5/7,3	8,6/8,6/8,4
450	A	9,9/9,9/9,7	10,2/10,2/10,0	11,4/11,4/11,2	14,0/14,0/13,9	19,0/19,0/18,9
	B	8,7/8,6/8,5	8,9/8,9/8,7	10,1/10,0/9,9	12,1/12,1/12,0	15,8/15,8/15,7
	C	7,4/7,4/7,2	8,1/8,0/7,8	8,8/8,7/8,5	9,8/9,7/9,6	13,7/13,7/13,6
	D	7,0/6,9/6,7	7,6/7,6/7,4	8,3/8,3/8,1	9,9/9,9/9,8	12,1/12,1/12,0
	E/F	6,6/6,5/6,3	6,8/6,7/6,5	7,0/6,9/6,7	7,4/7,4/7,2	8,4/8,4/8,2

Table B.8 (continued)

DN	Soil group	Allowable depth of cover				
		m				
		$(\beta = 0,5/0,75/1,5)$				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
500	A	9,6/9,5/9,4	9,8/9,8/9,6	11,0/11,0/10,8	13,6/13,5/13,4	18,5/18,5/18,4
	B	8,3/8,2/8,1	8,5/8,5/8,3	9,7/9,6/9,5	11,7/11,7/11,5	15,3/15,3/15,2
	C	7,0/7,0/6,8	7,7/7,6/7,4	8,4/8,3/8,1	9,8/9,8/9,6	13,2/13,2/13,1
	D	6,6/6,5/6,3	7,2/7,2/7,0	7,9/7,9/7,7	9,4/9,3/9,2	11,7/11,6/11,5
	E/F	6,2/6,1/5,9	6,4/6,3/6,1	6,6/6,5/6,3	7,0/6,9/6,7	7,9/7,9/7,7
600	A	9,4/9,4/9,2	9,7/9,6/9,5	10,9/10,8/10,7	13,4/13,4/13,3	18,3/18,3/18,2
	B	8,3/8,1/7,9	8,4/8,3/8,2	9,5/9,5/9,3	11,5/11,5/11,4	15,2/15,1/15,0
	C	6,9/6,8/6,6	7,5/7,5/7,3	8,2/8,1/8,0	9,7/9,6/9,5	13,1/13,0/12,9
	D	6,5/6,4/6,2	7,1/7,0/6,8	7,8/7,7/7,5	9,2/9,1/9,0	11,5/11,4/11,3
	E/F	6,0/6,0/5,7	6,2/6,2/5,9	6,4/6,4/6,1	6,8/6,8/6,6	7,8/7,7/7,5
700	A	9,1/9,1/8,9	9,4/9,4/9,2	10,6/10,5/10,4	13,1/13,1/13,0	18,0/18,0/17,9
	B	7,9/7,8/7,7	8,1/8,1/7,9	9,2/9,2/9,1	11,2/11,2/11,1	14,8/14,8/14,7
	C	6,6/6,6/6,4	7,3/7,2/7,0	7,9/7,9/7,7	9,4/9,3/9,2	12,7/12,7/12,6
	D	6,2/6,1/5,9	6,8/6,8/6,6	7,5/7,4/7,2	8,9/8,9/8,7	11,1/11,1/11,0
	E/F	5,8/5,7/5,5	6,0/5,9/5,6	6,1/6,1/5,8	6,5/6,5/6,3	7,4/7,4/7,2
800	A	9,1/9,0/8,9	9,3/9,3/9,1	10,5/10,5/10,3	13,0/13,0/12,9	17,9/17,9/17,8
	B	7,8/7,8/7,6	8,0/8,0/7,8	9,2/9,1/9,0	11,2/11,1/11,0	14,7/14,7/14,6
	C	6,6/6,5/6,3	7,2/7,1/6,9	7,8/7,8/7,6	9,3/9,2/9,1	12,6/12,6/12,5
	D	6,1/6,1/5,8	6,7/6,7/6,5	7,4/7,3/7,2	8,8/8,8/8,6	11,0/11,0/10,9
	E/F	5,7/5,6/5,4	5,9/5,8/5,6	6,1/6,0/5,8	6,5/6,4/6,2	7,3/7,3/7,1
900	A	8,9/8,9/8,7	9,2/9,1/9,0	10,3/10,3/10,2	12,8/12,8/12,7	17,7/17,7/17,6
	B	7,6/7,6/7,4	7,9/7,8/7,7	9,0/8,9/8,8	11,0/10,9/10,8	14,5/14,5/14,4
	C	6,4/6,3/6,1	7,0/7,0/6,8	7,7/7,6/7,4	9,1/9,1/8,9	12,4/12,4/12,3
	D	6,0/5,9/5,7	6,6/6,5/6,3	7,2/7,2/7,0	8,6/8,6/8,4	10,8/10,8/10,7
	E/F	5,5/5,5/5,2	5,7/5,6/5,4	5,9/5,8/5,6	6,3/6,2/6,0	7,1/7,1/6,9
1000	A	8,9/8,8/8,7	9,1/9,1/9,0	10,3/10,3/10,1	12,8/12,8/12,7	17,7/17,6/17,6
	B	7,6/7,6/7,4	7,9/7,8/7,6	9,0/8,9/8,8	11,0/10,9/10,8	14,5/14,5/14,4
	C	6,4/6,3/6,1	7,0/6,9/6,7	7,6/7,6/7,4	9,1/9,0/8,9	12,4/12,4/12,3
	D	5,9/5,9/5,7	6,6/6,5/6,3	7,2/7,1/7,0	8,6/8,6/8,4	10,8/10,8/10,7
	E/F	5,5/5,4/5,2	5,7/5,6/5,4	5,9/5,8/5,6	6,2/6,2/6,0	7,1/7,0/6,9
1100	A	8,9/8,8/8,7	9,1/9,1/8,9	10,3/10,2/10,1	12,8/12,8/12,7	17,6/17,6/17,5
	B	7,6/7,5/7,4	7,8/7,8/7,6	8,9/8,9/8,8	10,9/10,9/10,8	14,5/14,4/14,3
	C	6,3/6,3/6,1	7,0/6,9/6,7	7,6/7,6/7,4	9,0/9,0/8,9	12,3/12,3/12,2
	D	5,9/5,8/5,6	6,5/6,5/6,3	7,2/7,1/6,9	8,6/8,5/8,4	10,8/10,7/10,6
	E/F	5,5/5,4/5,2	5,7/5,6/5,4	5,8/5,8/5,5	6,2/6,2/5,9	7,1/7,0/6,8

Table B.8 (continued)

DN	Soil group	Allowable depth of cover				
		m ($\beta = 0,5/0,75/1,5$)				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
1200	A	8,8/8,7/8,6	9,0/9,0/8,8	10,2/10,1/10,0	12,7/12,6/12,6	17,5/17,5/17,4
	B	7,5/7,4/7,3	7,7/7,7/7,5	8,8/8,8/8,7	10,8/10,8/10,7	14,3/14,3/14,2
	C	6,2/6,2/6,0	6,9/6,8/6,6	7,5/7,5/7,3	8,9/8,9/8,8	12,2/12,2/12,1
	D	5,8/5,7/5,5	6,4/6,4/6,2	7,1/7,0/6,8	8,5/8,4/8,3	10,6/10,6/10,5
	E/F	5,4/5,3/5,1	5,6/5,5/5,3	5,7/5,7/5,4	6,1/6,0/5,8	6,9/6,9/6,7
NR Not recommended						

Table B.9 — Allowable depths of cover for C50 pipes conforming to ISO 2531 — Cement mortar lining

DN	Soil group	Allowable depth of cover				
		m ($\beta = 0,5/0,75/1,5$)				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
40	A	126,0/126,0/126,0	129,6/129,6/129,6	133,6/133,6/133,6	142,4/142,4/142,4	161,5/161,5/161,5
	B	125,7/125,7/125,7	129,3/129,3/129,3	133,3/133,3/133,3	142,0/142,0/141,9	160,8/160,8/160,8
	C	125,4/125,4/125,4	129,1/129,1/129,1	133,0/133,0/133,0	141,5/141,5/141,5	160,3/160,3/160,3
	D	125,4/125,3/125,3	129,0/129,0/129,0	132,9/132,9/132,9	141,4/141,4/141,4	160,0/160,0/160,0
	E/F	125,3/125,3/125,2	128,8/128,8/128,8	132,6/132,6/132,6	140,9/140,9/140,9	159,2/159,2/159,1
50	A	88,9/88,9/88,9	91,5/91,5/91,5	94,4/94,4/94,4	100,8/100,8/100,8	114,7/114,7/114,7
	B	88,6/88,6/88,6	91,1/91,1/91,1	94,1/94,1/94,0	100,3/100,3/100,3	113,9/113,9/113,8
	C	88,3/88,3/88,3	90,9/90,9/90,9	93,7/93,7/93,7	99,8/99,8/99,8	113,3/113,3/113,3
	D	88,2/88,2/88,1	90,8/90,8/90,8	93,6/93,6/93,6	99,7/99,7/99,7	112,9/112,9/112,9
	E/F	88,1/88,1/88,0	90,6/90,6/90,6	93,2/93,2/93,2	99,1/99,1/99,0	111,9/111,9/111,9
60	A	64,5/64,5/64,4	66,3/66,3/66,3	68,5/68,5/68,5	73,4/73,4/73,4	83,9/83,9/83,9
	B	64,1/64,1/64,1	65,9/65,9/65,9	68,1/68,1/68,1	72,8/72,8/72,8	82,9/82,9/82,9
	C	63,7/63,7/63,7	65,6/65,6/65,6	67,7/67,7/67,7	72,2/72,2/72,2	82,3/82,3/82,2
	D	63,6/63,6/63,5	65,5/65,5/65,5	67,6/67,6/67,6	72,1/72,1/72,1	81,8/81,8/81,7
	E/F	63,4/63,4/63,4	65,2/65,2/65,2	67,2/67,2/67,1	71,4/71,4/71,3	80,6/80,6/80,6

Table B.9 (continued)

DN	Soil group	Allowable depth of cover				
		m				
		$(\beta = 0,5/0,75/1,5)$				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
65	A	56,6/56,6/56,6	58,2/58,2/58,2	60,2/60,2/60,2	64,6/64,6/64,6	74,1/74,1/74,0
	B	56,2/56,2/56,2	57,8/57,8/57,8	59,8/59,8/59,8	64,0/64,0/64,0	73,0/73,0/73,0
	C	55,8/55,8/55,7	57,5/57,5/57,5	59,4/59,3/59,3	63,4/63,4/63,4	72,3/72,3/72,3
	D	55,6/55,6/55,6	57,4/57,4/57,3	59,2/59,2/59,2	63,2/63,2/63,2	71,8/71,8/71,7
	E/F	55,5/55,5/55,5	57,1/57,1/57,1	58,8/58,8/58,7	62,4/62,4/62,4	70,5/70,5/70,5
80	A	39,4/39,4/39,4	40,5/40,5/40,5	42,1/42,1/42,0	45,5/45,5/45,4	52,7/52,6/52,6
	B	38,9/38,9/38,9	40,0/40,0/40,0	41,6/41,5/41,5	44,7/44,7/44,7	51,4/51,4/51,3
	C	38,4/38,4/38,3	39,7/39,7/39,6	41,0/41,0/41,0	44,0/44,0/43,9	50,5/50,5/50,5
	D	38,2/38,2/38,2	39,5/39,5/39,4	40,8/40,8/40,8	43,8/43,8/43,7	49,9/49,9/49,8
	E/F	38,1/38,1/38,0	39,2/39,1/39,1	40,3/40,3/40,3	42,8/42,8/42,8	48,4/48,4/48,3
100	A	27,3/27,3/27,3	28,1/28,1/28,1	29,4/29,4/29,3	32,1/32,1/32,1	37,9/37,9/37,8
	B	26,7/26,7/26,7	27,5/27,5/27,4	28,7/28,7/28,7	31,2/31,2/31,2	36,3/36,3/36,3
	C	26,1/26,1/26,0	27,1/27,1/27,0	28,1/28,1/28,0	30,3/30,3/30,2	35,3/35,3/35,2
	D	25,9/25,9/25,8	26,9/26,8/26,8	27,9/27,9/27,8	30,1/30,1/30,0	34,5/34,5/34,4
	E/F	25,7/25,7/25,6	26,4/26,4/26,4	27,2/27,2/27,0	28,9/28,9/28,9	32,7/32,7/32,6
125	A	19,9/19,8/19,8	20,4/20,4/20,3	21,6/21,5/21,5	24,0/24,0/23,9	29,0/29,0/29,0
	B	19,1/19,0/19,0	19,7/19,7/19,6	20,8/20,8/20,7	22,9/22,9/22,8	27,1/27,1/27,1
	C	18,4/18,4/18,3	19,2/19,2/19,1	20,0/20,0/19,9	21,8/21,8/21,7	25,9/25,9/25,8
	D	18,2/18,1/18,0	18,9/18,9/18,8	19,7/19,7/19,6	21,5/21,5/21,4	25,0/24,9/24,9
	E/F	17,9/17,9/17,8	18,4/18,4/18,3	19,0/18,9/18,9	20,2/20,1/20,1	22,8/22,8/22,7
150	A	14,9/14,9/14,8	15,4/15,3/15,2	16,4/16,4/16,3	18,8/18,7/18,7	23,4/23,4/23,4
	B	14,0/14,0/13,9	14,5/14,4/14,3	15,5/15,5/15,4	17,5/17,4/17,4	21,2/21,2/21,1
	C	13,2/13,1/13,0	13,9/13,8/13,7	14,6/14,5/14,4	16,1/16,1/16,0	19,7/19,7/19,6
	D	12,9/12,8/12,7	13,6/13,5/13,4	14,3/14,2/14,1	15,8/15,8/15,7	18,6/18,6/18,5
	E/F	12,6/12,5/12,4	12,9/12,9/12,8	13,3/13,3/13,2	14,2/14,1/14,0	16,0/16,0/15,9
200	A	14,0/14,0/13,9	14,4/14,4/14,3	15,5/15,5/15,4	17,9/17,9/17,8	22,7/22,7/22,6
	B	13,1/13,0/12,9	13,4/13,4/13,3	14,5/14,5/14,4	16,5/16,5/16,4	20,3/20,2/20,2
	C	12,1/12,1/11,9	12,8/12,7/12,6	13,5/13,5/13,4	15,1/15,0/14,9	18,6/18,6/18,5
	D	11,8/11,7/11,6	12,5/12,4/12,3	13,2/13,1/13,0	14,7/14,7/14,6	17,4/17,4/17,3
	E/F	11,5/11,4/11,3	11,8/11,8/11,6	12,1/12,1/12,0	12,9/12,9/12,8	14,6/14,6/14,5
250	A	13,9/13,9/13,8	14,3/14,3/14,2	15,4/15,4/15,3	17,9/17,9/17,8	22,7/22,7/22,7
	B	12,9/12,9/12,7	13,3/13,2/13,1	14,4/14,3/14,2	16,4/16,4/16,3	20,2/20,2/20,1
	C	11,9/11,9/11,7	12,6/12,5/12,4	13,3/13,3/13,2	14,9/14,9/14,8	18,5/18,5/18,4
	D	11,6/11,5/11,4	12,2/12,2/12,1	13,0/12,9/12,8	14,5/14,5/14,4	17,3/17,2/17,2
	E/F	11,2/11,2/11,1	11,6/11,5/11,4	11,9/11,9/11,7	12,7/12,6/12,5	14,3/14,3/14,2

Table B.9 (continued)

DN	Soil group	Allowable depth of cover				
		m				
		$(\beta = 0,5/0,75/1,5)$				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
300	A	13,8/13,8/13,7	14,2/14,2/14,1	15,4/15,3/15,2	17,9/17,8/17,8	22,8/22,8/22,7
	B	12,8/12,8/12,6	13,2/13,1/13,0	14,3/14,2/14,1	16,3/16,3/16,2	20,2/20,2/20,1
	C	11,8/11,7/11,6	12,5/12,4/12,3	13,2/13,2/13,0	14,8/14,8/14,7	18,5/18,4/18,4
	D	11,4/11,4/11,3	12,1/12,1/11,9	12,8/12,8/12,7	14,4/14,4/14,3	17,2/17,1/17,1
	E/F	11,1/11,0/10,9	11,4/11,4/11,2	11,7/11,7/11,6	12,5/12,4/12,3	14,1/14,1/14,0
350	A	13,8/13,7/13,6	14,2/14,1/14,0	15,3/15,3/15,2	17,9/17,8/17,8	22,9/22,8/22,8
	B	12,7/12,7/12,6	13,1/13,1/13,0	14,2/14,2/14,1	16,3/16,3/16,2	20,2/20,2/20,1
	C	11,7/11,6/11,5	12,4/12,3/12,2	13,1/13,1/13,0	14,7/14,7/14,6	18,4/18,4/18,3
	D	11,3/11,3/11,2	12,0/12,0/11,9	12,7/12,7/12,6	14,3/14,3/14,2	17,1/17,1/17,0
	E/F	11,0/10,9/10,8	11,3/11,3/11,1	11,6/11,6/11,5	12,4/12,3/12,2	14,0/14,0/13,9
400	A	13,2/13,2/13,1	13,6/13,6/13,5	14,7/14,7/14,6	17,2/17,2/17,1	22,1/22,1/22,1
	B	12,2/12,1/12,0	12,5/12,5/12,4	13,6/13,6/13,5	15,7/15,6/15,5	19,5/19,5/19,4
	C	11,1/11,1/10,9	11,8/11,7/11,6	12,5/12,5/12,4	14,1/14,1/14,0	17,7/17,7/17,6
	D	10,8/10,7/10,6	11,4/11,4/11,3	12,1/12,1/12,0	13,7/13,7/13,6	16,4/16,3/16,3
	E/F	10,4/10,4/10,2	10,7/10,7/10,5	11,0/11,0/10,9	11,7/11,7/11,6	13,3/13,2/13,1
450	A	13,1/13,1/13,0	13,5/13,5/13,3	14,6/14,6/14,5	17,1/17,1/17,0	22,0/22,0/21,9
	B	12,1/12,0/11,9	12,4/12,4/12,3	13,5/13,5/13,4	15,5/15,5/15,4	19,3/19,3/19,3
	C	11,0/11,0/10,8	11,7/11,6/11,5	12,5/12,5/12,4	14,0/13,9/13,8	17,6/17,5/17,5
	D	10,7/10,6/10,5	11,3/11,3/11,2	12,0/12,0/11,9	13,6/13,5/13,4	16,2/16,2/16,1
	E/F	10,3/10,3/10,1	10,6/10,6/10,4	10,9/10,9/10,7	11,6/11,6/11,5	13,1/13,1/13,0
500	A	12,7/12,6/12,5	13,0/13,0/12,9	14,2/14,1/14,0	16,6/16,6/16,5	21,4/21,4/21,4
	B	11,6/11,6/11,5	12,0/11,9/11,8	13,0/13,0/12,9	15,1/15,0/14,9	18,8/18,8/18,7
	C	10,6/10,5/10,4	11,2/11,2/11,1	11,9/11,9/11,8	13,5/13,4/13,3	17,0/17,0/16,9
	D	10,2/10,2/10,0	10,9/10,8/10,7	11,6/11,5/11,4	13,1/13,1/12,9	15,7/15,7/15,6
	E/F	9,9/9,8/9,7	10,1/10,1/10,0	10,5/10,4/10,3	11,1/11,1/11,0	12,6/12,5/12,4
600	A	12,3/12,3/12,2	12,7/12,6/12,5	13,8/13,8/13,7	16,2/16,2/16,1	21,0/21,0/20,9
	B	11,3/11,2/11,1	11,6/11,6/11,4	12,7/12,6/12,5	14,7/14,6/14,5	18,3/18,3/18,2
	C	10,2/10,2/10,0	10,9/10,8/10,7	11,6/11,5/11,4	13,1/13,0/12,9	16,6/16,5/16,5
	D	9,9/9,8/9,7	10,5/10,5/10,3	11,2/11,2/11,0	12,7/12,7/12,5	15,2/15,2/15,1
	E/F	9,5/9,5/9,3	9,8/9,7/9,6	10,1/10,0/9,9	10,7/10,7/10,6	12,1/12,1/12,0
700	A	12,1/12,0/11,9	12,4/12,4/12,3	13,5/13,5/13,4	15,9/15,9/15,8	20,7/20,7/20,6
	B	11,0/11,0/10,9	11,3/11,3/11,2	12,4/12,4/12,3	14,4/14,3/14,3	18,0/18,0/17,9
	C	10,0/9,9/9,8	10,6/10,6/10,4	11,3/11,3/11,1	12,8/12,8/12,7	16,3/16,2/16,1
	D	9,6/9,6/9,4	10,3/10,2/10,1	10,9/10,9/10,8	12,4/12,4/12,3	14,9/14,9/14,8
	E/F	9,3/9,2/9,1	9,5/9,5/9,3	9,8/9,8/9,6	10,4/10,4/10,3	11,8/11,8/11,7

Table B.9 (continued)

DN	Soil group	Allowable depth of cover				
		m				
		$(\beta = 0,5/0,75/1,5)$				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
800	A	11,8/11,8/11,7	12,2/12,2/12,0	13,3/13,3/13,2	15,7/15,7/15,6	20,4/20,4/20,3
	B	10,8/10,8/10,6	11,1/11,1/11,0	12,2/12,1/12,0	14,1/14,1/14,0	17,7/17,7/17,7
	C	9,7/9,7/9,6	10,4/10,3/10,2	11,1/11,0/10,9	12,6/12,5/12,4	16,0/15,9/15,9
	D	9,4/9,3/9,2	10,0/10,0/9,9	10,7/10,7/10,5	12,2/12,1/12,0	14,6/14,6/14,5
	E/F	9,0/9,0/8,8	9,3/9,3/9,1	9,6/9,5/9,4	10,2/10,2/10,0	11,5/11,5/11,4
900	A	11,7/11,7/11,6	12,0/12,0/11,9	13,1/13,1/13,0	15,5/15,5/15,4	20,2/20,2/20,2
	B	10,7/10,6/10,5	11,0/10,9/10,8	12,0/12,0/11,9	14,0/13,9/13,9	17,6/17,5/17,5
	C	9,6/9,6/9,4	10,2/10,2/10,1	10,9/10,9/10,8	12,4/12,4/12,3	15,8/15,8/15,7
	D	9,3/9,2/9,1	9,9/9,8/9,7	10,6/10,5/10,4	12,0/12,0/11,9	14,5/14,4/14,4
	E/F	8,9/8,9/8,7	9,2/9,1/9,0	9,4/9,4/9,3	10,0/10,0/9,9	11,4/11,3/11,2
1000	A	11,6/11,6/11,5	11,9/11,9/11,8	13,0/13,0/12,9	15,4/15,4/15,3	20,1/20,1/20,0
	B	10,5/10,5/10,4	10,9/10,8/10,7	11,9/11,9/11,8	13,9/13,8/13,7	17,4/17,4/17,3
	C	9,5/9,5/9,3	10,1/10,1/10,0	10,8/10,8/10,7	12,3/12,2/12,1	15,7/15,6/15,6
	D	9,1/9,1/9,0	9,8/9,7/9,6	10,4/10,4/10,3	11,9/11,9/11,7	14,3/14,3/14,2
	E/F	8,8/8,7/8,6	9,0/9,0/8,9	9,3/9,3/9,1	9,9/9,9/9,7	11,2/11,2/11,1
1100	A	11,6/11,6/11,5	11,9/11,9/11,8	13,0/13,0/12,9	15,4/15,4/15,3	20,1/20,1/20,0
	B	10,6/10,5/10,4	10,9/10,8/10,7	11,9/11,9/11,8	13,9/13,8/13,8	17,5/17,4/17,4
	C	9,5/9,5/9,3	10,1/10,1/10,0	10,8/10,8/10,7	12,3/12,3/12,2	15,7/15,7/15,6
	D	9,2/9,1/9,0	9,8/9,7/9,6	10,5/10,4/10,3	11,9/11,9/11,8	14,3/14,3/14,2
	E/F	8,8/8,8/8,6	9,1/9,0/8,9	9,3/9,3/9,2	9,9/9,9/9,8	11,2/11,2/11,1
NR Not recommended						

Table B.10 — Allowable depths of cover for C50 pipes conforming to ISO 2531 — Flexible lining

DN	Soil group	Allowable depth of cover				
		m				
		$(\beta = 0,5/0,75/1,5)$				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
40	A	126,0/126,0/126,0	129,6/129,6/129,6	133,6/133,6/133,6	142,4/142,4/142,4	161,5/161,5/161,5
	B	125,7/125,7/125,7	129,3/129,3/129,3	133,3/133,3/133,3	142,0/142,0/141,9	160,8/160,8/160,8
	C	125,4/125,4/125,4	129,1/129,1/129,1	133,0/133,0/133,0	141,5/141,5/141,5	160,3/160,3/160,3
	D	125,4/125,3/125,3	129,0/129,0/129,0	132,9/132,9/132,9	141,4/141,4/141,4	160,0/160,0/160,0
	E/F	125,3/125,3/125,2	128,8/128,8/128,8	132,6/132,6/132,6	140,9/140,9/140,9	159,2/159,2/159,1
50	A	88,9/88,9/88,9	91,5/91,5/91,5	94,4/94,4/94,4	100,8/100,8/100,8	114,7/114,7/114,7
	B	88,6/88,6/88,6	91,1/91,1/91,1	94,1/94,1/94,0	100,3/100,3/100,3	113,9/113,9/113,8
	C	88,3/88,3/88,3	90,9/90,9/90,9	93,7/93,7/93,7	99,8/99,8/99,8	113,3/113,3/113,3
	D	88,2/88,2/88,1	90,8/90,8/90,8	93,6/93,6/93,6	99,7/99,7/99,7	112,9/112,9/112,9
	E/F	88,1/88,1/88,0	90,6/90,6/90,6	93,2/93,2/93,2	99,1/99,1/99,0	111,9/111,9/111,9
60	A	64,5/64,5/64,4	66,3/66,3/66,3	68,5/68,5/68,5	73,4/73,4/73,4	83,9/83,9/83,9
	B	64,1/64,1/64,1	65,9/65,9/65,9	68,1/68,1/68,1	72,8/72,8/72,8	82,9/82,9/82,9
	C	63,7/63,7/63,7	65,6/65,6/65,6	67,7/67,7/67,7	72,2/72,2/72,2	82,3/82,3/82,2
	D	63,6/63,6/63,5	65,5/65,5/65,5	67,6/67,6/67,6	72,1/72,1/72,1	81,8/81,8/81,7
	E/F	63,4/63,4/63,4	65,2/65,2/65,2	67,2/67,2/67,1	71,4/71,4/71,3	80,6/80,6/80,6
65	A	56,6/56,6/56,6	58,2/58,2/58,2	60,2/60,2/60,2	64,6/64,6/64,6	74,1/74,1/74,0
	B	56,2/56,2/56,2	57,8/57,8/57,8	59,8/59,8/59,8	64,0/64,0/64,0	73,0/73,0/73,0
	C	55,8/55,8/55,7	57,5/57,5/57,5	59,4/59,3/59,3	63,4/63,4/63,4	72,3/72,3/72,3
	D	55,6/55,6/55,6	57,4/57,4/57,3	59,2/59,2/59,2	63,2/63,2/63,2	71,8/71,8/71,7
	E/F	55,5/55,5/55,5	57,1/57,1/57,1	58,8/58,8/58,7	62,4/62,4/62,4	70,5/70,5/70,5
80	A	39,4/39,4/39,4	40,5/40,5/40,5	42,1/42,1/42,0	45,5/45,5/45,4	52,7/52,6/52,6
	B	38,9/38,9/38,9	40,0/40,0/40,0	41,6/41,5/41,5	44,7/44,7/44,7	51,4/51,4/51,3
	C	38,4/38,4/38,3	39,7/39,7/39,6	41,0/41,0/41,0	44,0/44,0/43,9	50,5/50,5/50,5
	D	38,2/38,2/38,2	39,5/39,5/39,4	40,8/40,8/40,8	43,8/43,8/43,7	49,9/49,9/49,8
	E/F	38,1/38,1/38,0	39,2/39,1/39,0	40,3/40,3/40,3	42,8/42,8/42,8	48,4/48,4/48,3
100	A	27,3/27,3/27,3	28,1/28,1/28,1	29,4/29,4/29,3	32,1/32,1/32,1	37,9/37,9/37,8
	B	26,7/26,7/26,7	27,5/27,5/27,4	28,7/28,7/28,7	31,2/31,2/31,2	36,3/36,3/36,3
	C	26,1/26,1/26,0	27,1/27,1/27,0	28,1/28,1/28,0	30,3/30,3/30,2	35,3/35,3/35,2
	D	25,9/25,9/25,8	26,9/26,8/26,8	27,9/27,9/27,8	30,1/30,1/30,0	34,5/34,5/34,4
	E/F	25,7/25,7/25,6	26,4/26,4/26,4	27,2/27,2/27,1	28,9/28,9/28,9	32,7/32,7/32,6
125	A	19,9/19,8/19,8	20,4/20,4/20,3	21,6/21,5/21,5	24,0/24,0/23,9	28,9/28,9/28,8
	B	19,1/19,1/19,0	19,7/19,7/19,6	20,8/20,8/20,7	22,9/22,9/22,8	29,0/29,0/29,0
	C	18,4/18,4/18,3	19,2/19,2/19,1	20,0/20,0/19,9	21,8/21,8/21,7	27,1/27,1/27,1
	D	18,2/18,1/18,0	18,9/18,9/18,8	19,7/19,7/19,6	21,5/21,5/21,4	25,0/24,9/24,9
	E/F	17,9/17,9/17,8	18,4/18,4/18,3	19,0/18,9/18,9	20,2/20,1/20,1	22,8/22,8/22,7

Table B.10 (continued)

DN	Soil group	Allowable depth of cover				
		m				
		$(\beta = 0,5/0,75/1,5)$				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
150	A	14,9/14,9/14,8	15,4/15,3/15,2	16,4/16,4/16,3	18,8/18,7/18,7	23,4/23,4/23,4
	B	14,0/14,0/13,9	14,5/14,4/14,3	15,5/15,5/15,4	17,5/17,4/17,4	21,2/21,2/21,1
	C	13,2/13,1/13,0	13,9/13,8/13,7	14,6/14,5/14,4	16,1/16,1/16,0	19,7/19,7/19,6
	D	12,9/12,8/12,7	13,6/13,5/13,4	14,3/14,2/14,1	15,8/15,8/15,7	18,6/18,6/18,5
	E/F	12,6/12,5/12,4	12,9/12,9/12,8	13,3/13,3/13,2	14,2/14,1/14,0	16,0/16,0/15,9
200	A	14,0/14,0/13,9	14,4/14,4/14,3	15,5/15,5/15,4	17,9/17,9/17,8	22,7/22,7/22,6
	B	13,1/13,0/12,9	13,4/13,4/13,3	14,5/14,5/14,4	16,5/16,5/16,4	20,3/20,3/20,2
	C	12,1/12,1/11,9	12,8/12,7/12,6	13,5/13,5/13,4	15,1/15,0/14,9	18,6/18,6/18,5
	D	11,8/11,7/11,6	12,5/12,4/12,3	13,2/13,1/13,0	14,7/14,7/14,6	17,4/17,4/17,3
	E/F	11,5/11,4/11,3	11,8/11,8/11,6	12,1/12,1/12,0	12,9/12,9/12,8	14,6/14,6/14,5
250	A	13,9/13,9/13,8	14,3/14,3/14,2	15,4/15,4/15,3	17,9/17,9/17,8	22,7/22,7/22,7
	B	12,9/12,9/12,7	13,3/13,2/13,1	14,4/14,3/14,2	16,4/16,4/16,3	20,2/20,2/20,1
	C	11,9/11,9/11,7	12,6/12,5/12,4	13,3/13,3/13,1	14,9/14,9/14,8	18,5/18,5/18,4
	D	11,6/11,5/11,4	12,2/12,2/12,1	13,0/12,9/12,8	14,5/14,5/14,4	17,3/17,2/17,2
	E/F	11,2/11,1/11,1	11,6/11,5/11,4	11,9/11,9/11,7	12,7/12,6/12,5	14,3/14,3/14,2
300	A	13,8/13,8/13,7	14,2/14,2/14,1	15,4/15,3/15,2	17,9/17,8/17,8	22,8/22,8/22,7
	B	12,8/12,8/12,6	13,2/13,1/13,0	14,3/14,2/14,1	16,3/16,3/16,2	20,2/20,2/20,1
	C	11,8/11,7/11,6	12,5/12,4/12,3	13,2/13,1/13,0	14,8/14,8/14,7	18,5/18,4/18,4
	D	11,4/11,4/11,3	12,1/12,1/11,9	12,8/12,8/12,7	14,4/14,4/14,3	17,2/17,1/17,1
	E/F	11,1/11,0/10,9	11,4/11,4/11,2	11,7/11,7/11,6	12,5/12,4/12,3	14,1/14,1/14,0
350	A	13,8/13,7/13,6	14,2/14,1/14,0	15,3/15,3/15,2	17,9/17,8/17,8	22,9/22,8/22,8
	B	12,7/12,7/12,6	13,1/13,1/13,0	14,2/14,2/14,1	16,3/16,3/16,2	20,2/20,2/20,1
	C	11,7/11,6/11,5	12,4/12,3/12,2	13,1/13,1/13,0	14,7/14,7/14,6	18,4/18,4/18,3
	D	11,3/11,3/11,2	12,0/12,0/11,9	12,7/12,7/12,6	14,3/14,3/14,2	17,1/17,1/17,0
	E/F	11,0/10,9/10,8	11,3/11,3/11,1	11,6/11,6/11,5	12,4/12,3/12,2	14,0/14,0/13,9
400	A	13,2/13,2/13,1	13,6/13,6/13,5	14,7/14,7/14,6	17,2/17,2/17,1	22,1/22,1/22,1
	B	12,2/12,1/12,0	12,5/12,5/12,4	13,6/13,6/13,5	15,7/15,6/15,5	19,5/19,5/19,4
	C	11,1/11,1/10,9	11,8/11,7/11,6	12,5/12,5/12,4	14,1/14,1/14,0	17,7/17,7/17,6
	D	10,8/10,7/10,6	11,4/11,4/11,3	12,1/12,1/12,0	13,7/13,7/13,6	16,4/16,3/16,3
	E/F	10,4/10,4/10,2	10,7/10,7/10,5	11,0/11,0/10,9	11,7/11,7/11,6	13,3/13,2/13,1
450	A	13,1/13,1/13,0	13,5/13,5/13,3	14,6/14,6/14,5	17,1/17,1/17,0	22,0/22,0/21,9
	B	12,1/12,0/11,9	12,4/12,4/12,3	13,5/13,5/13,4	15,5/15,5/15,4	19,3/19,3/19,3
	C	11,0/11,0/10,8	11,7/11,6/11,5	12,4/12,4/12,3	14,0/13,9/13,8	17,6/17,5/17,5
	D	10,7/10,6/10,5	11,3/11,3/11,2	12,0/12,0/11,9	13,6/13,5/13,4	16,2/16,2/16,1
	E/F	10,3/10,3/10,1	10,6/10,6/10,4	10,9/10,9/10,7	11,6/11,6/11,5	13,1/13,1/13,0

Table B.10 (continued)

DN	Soil group	Allowable depth of cover				
		m ($\beta = 0,5/0,75/1,5$)				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
500	A	12,7/12,6/12,5	13,0/13,0/12,9	14,2/14,1/14,0	16,6/16,6/16,5	21,4/21,4/21,4
	B	11,6/11,6/11,5	12,0/11,9/11,8	13,0/13,0/12,9	15,1/15,0/14,9	18,8/18,8/18,7
	C	10,6/10,5/10,4	11,2/11,2/11,1	11,9/11,9/11,8	13,5/13,4/13,3	17,0/17,0/16,9
	D	10,2/10,2/10,0	10,9/10,8/10,7	11,6/11,5/11,4	13,1/13,1/12,9	15,7/15,7/15,6
	E/F	9,9/9,8/9,7	10,1/10,1/10,0	10,5/10,4/10,3	11,1/11,1/11,0	12,6/12,5/12,4
600	A	12,3/12,3/12,2	12,7/12,6/12,5	13,8/13,8/13,7	16,2/16,2/16,1	21,0/21,0/20,9
	B	11,3/11,2/11,1	11,6/11,6/11,4	12,7/12,6/12,5	14,7/14,6/14,5	18,3/18,3/18,2
	C	10,2/10,2/10,0	10,9/10,8/10,7	11,6/11,5/11,4	13,1/13,0/12,9	16,6/16,5/16,5
	D	9,9/9,8/9,7	10,5/10,5/10,3	11,2/11,2/11,0	12,7/12,7/12,5	15,2/15,2/15,1
	E/F	9,5/9,5/9,3	9,8/9,7/9,6	10,1/10,0/9,9	10,7/10,7/10,6	12,1/12,1/12,0
700	A	12,1/12,0/11,9	12,4/12,4/12,3	13,5/13,5/13,4	15,9/15,9/15,8	20,7/20,7/20,6
	B	11,0/11,0/10,9	11,3/11,3/11,2	12,4/12,4/12,3	14,4/14,3/14,3	18,0/18,0/17,9
	C	10,0/9,9/9,8	10,6/10,6/10,4	11,3/11,3/11,1	12,8/12,8/12,7	16,3/16,2/16,1
	D	9,6/9,6/9,4	10,3/10,2/10,1	10,9/10,9/10,8	12,4/12,4/12,3	14,9/14,9/14,8
	E/F	9,3/9,2/9,1	9,5/9,5/9,3	9,8/9,8/9,6	10,4/10,4/10,3	11,8/11,8/11,7
800	A	11,8/11,8/11,7	12,2/12,2/12,0	13,3/13,3/13,2	15,7/15,7/15,6	20,4/20,4/20,3
	B	10,8/10,8/10,6	11,1/11,1/11,0	12,2/12,1/12,0	14,1/14,1/14,0	17,7/17,7/17,7
	C	9,7/9,7/9,6	10,4/10,3/10,2	11,1/11,0/10,9	12,6/12,5/12,4	16,0/15,9/15,9
	D	9,4/9,3/9,2	10,0/10,0/9,9	10,7/10,7/10,5	12,2/12,1/12,0	14,6/14,5/14,5
	E/F	9,0/9,0/8,8	9,3/9,3/9,1	9,6/9,5/9,4	10,2/10,2/10,0	11,5/11,5/11,4
900	A	11,7/11,7/11,6	12,0/12,0/11,9	13,1/13,1/13,0	15,5/15,5/15,4	20,2/20,2/20,2
	B	10,7/10,6/10,5	11,0/10,9/10,8	12,0/12,0/11,9	14,0/13,9/13,9	17,6/17,5/17,5
	C	9,6/9,6/9,4	10,2/10,2/10,1	10,9/10,9/10,8	12,4/12,4/12,3	15,8/15,8/15,7
	D	9,3/9,2/9,1	9,9/9,8/9,7	10,6/10,5/10,4	12,0/12,0/11,9	14,5/14,4/14,4
	E/F	8,9/8,9/8,7	9,2/9,1/9,0	9,4/9,4/9,3	10,0/10,0/9,9	11,4/11,3/11,2
1000	A	11,6/11,6/11,5	11,9/11,9/11,8	13,0/13,0/12,9	15,4/15,4/15,3	20,1/20,1/20,0
	B	10,5/10,5/10,4	10,9/10,8/10,7	11,9/11,9/11,8	13,9/13,8/13,7	17,4/17,4/17,3
	C	9,5/9,5/9,3	10,1/10,1/10,0	10,8/10,8/10,7	12,3/12,2/12,1	15,7/15,6/15,6
	D	9,1/9,1/9,0	9,8/9,7/9,6	10,4/10,4/10,3	11,9/11,9/11,7	14,3/14,3/14,2
	E/F	8,8/8,7/8,6	9,0/9,0/8,9	9,3/9,3/9,1	9,9/9,9/9,7	11,2/11,2/11,1
1100	A	11,6/11,6/11,5	11,9/11,9/11,8	13,0/13,0/12,9	15,4/15,4/15,3	20,1/20,1/20,0
	B	10,6/10,5/10,4	10,9/10,8/10,7	11,9/11,9/11,8	13,9/13,8/13,8	17,5/17,4/17,4
	C	9,5/9,5/9,3	10,1/10,1/10,0	10,8/10,8/10,7	12,3/12,3/12,2	15,7/15,7/15,6
	D	9,2/9,1/9,0	9,8/9,7/9,6	10,5/10,4/10,3	11,9/11,9/11,8	14,3/14,3/14,2
	E/F	8,8/8,8/8,6	9,1/9,0/8,9	9,3/9,3/9,2	9,9/9,9/9,8	11,2/11,2/11,1
NR Not recommended						

**Table B.11 — Allowable depths of cover for C64 pipes conforming to ISO 2531 —
Cement mortar lining**

DN	Soil group	Allowable depth of cover				
		m				
		$(\beta = 0,5/0,75/1,5)$				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
40	A	126,0/126,0/126,0	129,6/129,6/129,6	133,6/133,6/133,6	142,4/142,4/142,4	161,5/161,5/161,5
	B	125,7/125,7/125,7	129,3/129,3/129,3	133,3/133,3/133,3	142,0/142,0/141,9	160,8/160,8/160,8
	C	125,4/125,4/125,4	129,1/129,1/129,1	133,0/133,0/133,0	141,5/141,5/141,5	160,3/160,3/160,3
	D	125,4/125,3/125,3	129,0/129,0/129,0	132,9/132,9/132,9	141,4/141,4/141,4	160,0/160,0/160,0
	E/F	125,3/125,3/125,2	128,8/128,8/128,8	132,6/132,6/132,6	140,9/140,9/140,9	159,2/159,2/159,1
50	A	88,9/88,9/88,9	91,5/91,5/91,5	94,4/94,4/94,4	100,8/100,8/100,8	114,7/114,7/114,7
	B	88,6/88,6/88,6	91,1/91,1/91,1	94,1/94,1/94,0	100,3/100,3/100,3	113,9/113,9/113,8
	C	88,3/88,3/88,3	90,9/90,9/90,9	93,7/93,7/93,7	99,8/99,8/99,8	113,3/113,3/113,3
	D	88,2/88,2/88,1	90,8/90,8/90,8	93,6/93,6/93,6	99,7/99,7/99,7	112,9/112,9/112,9
	E/F	88,1/88,1/88,0	90,6/90,6/90,6	93,2/93,2/93,2	99,1/99,1/99,0	111,9/111,9/111,9
60	A	64,5/64,5/64,4	66,3/66,3/66,3	68,5/68,5/68,5	73,4/73,4/73,4	83,9/83,9/83,9
	B	64,1/64,1/64,1	65,9/65,9/65,9	68,1/68,1/68,1	72,8/72,8/72,8	82,9/82,9/82,9
	C	63,7/63,7/63,7	65,6/65,6/65,6	67,7/67,7/67,7	72,2/72,2/72,2	82,3/82,3/82,2
	D	63,6/63,6/63,5	65,5/65,5/65,5	67,6/67,6/67,6	72,1/72,1/72,1	81,8/81,8/81,7
	E/F	63,4/63,4/63,4	65,2/65,2/65,2	67,2/67,2/67,1	71,4/71,4/71,3	80,6/80,6/80,6
65	A	56,6/56,6/56,6	58,2/58,2/58,2	60,2/60,2/60,2	64,6/64,6/64,6	74,1/74,1/74,0
	B	56,2/56,2/56,2	57,8/57,8/57,8	59,8/59,8/59,8	64,0/64,0/64,0	73,0/73,0/73,0
	C	55,8/55,8/55,7	57,5/57,5/57,5	59,4/59,3/59,3	63,4/63,4/63,4	72,3/72,3/72,3
	D	55,6/55,6/55,6	57,4/57,4/57,3	59,2/59,2/59,2	63,2/63,2/63,2	71,8/71,8/71,7
	E/F	55,5/55,5/55,5	57,1/57,1/57,1	58,8/58,8/58,7	62,4/62,4/62,4	70,5/70,5/70,5
80	A	39,4/39,4/39,4	40,5/40,5/40,5	42,1/42,1/42,0	45,5/45,5/45,4	52,7/52,6/52,6
	B	38,9/38,9/38,9	40,0/40,0/40,0	41,6/41,5/41,5	44,7/44,7/44,7	51,4/51,4/51,3
	C	38,4/38,4/38,3	39,7/39,7/39,6	41,0/41,0/41,0	44,0/44,0/43,9	50,5/50,5/50,5
	D	38,2/38,2/38,2	39,5/39,5/39,4	40,8/40,8/40,8	43,8/43,8/43,7	49,9/49,9/49,8
	E/F	38,1/38,1/38,0	39,2/39,1/39,1	40,3/40,3/40,3	42,8/42,8/42,8	48,4/48,4/48,3
100	A	27,3/27,3/27,3	28,1/28,1/28,1	29,4/29,4/29,3	32,1/32,1/32,1	37,9/37,9/37,8
	B	26,7/26,7/26,7	27,5/27,5/27,4	28,7/28,7/28,7	31,2/31,2/31,2	36,3/36,3/36,3
	C	26,1/26,1/26,0	27,1/27,1/27,0	28,1/28,1/28,0	30,3/30,3/30,2	35,3/35,3/35,2
	D	25,9/25,9/25,8	26,9/26,8/26,8	27,9/27,9/27,8	30,1/30,1/30,0	34,5/34,5/34,4
	E/F	25,7/25,7/25,6	26,4/26,4/26,4	27,2/27,2/27,1	28,9/28,9/28,9	32,7/32,7/32,6
125	A	23,0/23,0/23,0	23,7/23,7/23,6	24,9/24,9/24,8	27,5/27,5/27,4	32,8/32,8/32,7
	B	22,4/22,3/22,3	23,0/23,0/22,9	24,2/24,1/24,1	26,5/26,4/26,4	31,1/31,0/31,0
	C	21,7/21,6/21,6	22,5/22,5/22,4	23,4/23,4/23,4	25,4/25,4/25,3	29,9/29,9/29,8
	D	21,4/21,4/21,3	22,3/22,3/22,2	23,2/23,2/23,1	25,2/25,1/25,1	29,0/29,0/28,9
	E/F	21,2/21,2/21,1	21,8/21,8/21,7	22,5/22,4/22,4	23,9/23,9/23,8	27,0/27,0/26,9

Table B.11 (continued)

DN	Soil group	Allowable depth of cover				
		m ($\beta = 0,5/0,75/1,5$)				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
150	A	21,2/21,2/21,2	21,9/21,8/21,8	23,0/23,0/22,9	25,6/25,6/25,5	30,8/30,7/30,7
	B	20,5/20,5/20,4	21,1/21,1/21,0	22,2/22,2/22,1	24,5/24,4/24,4	28,9/28,9/28,8
	C	19,8/19,7/19,7	20,6/20,6/20,5	21,5/21,4/21,4	23,4/23,3/23,3	27,6/27,6/27,6
	D	19,5/19,5/19,4	20,3/20,3/20,2	21,2/21,2/21,1	23,1/23,1/23,0	26,7/26,7/26,6
	E/F	19,3/19,2/19,2	19,8/19,8/19,7	20,4/20,4/20,3	21,7/21,7/21,6	24,5/24,5/24,4
200	A	20,4/20,3/20,3	21,0/20,9/20,9	22,1/22,1/22,0	24,7/24,7/24,6	29,9/29,9/29,8
	B	19,6/19,6/19,5	20,1/20,1/20,0	21,3/21,3/21,2	23,5/23,5/23,4	27,9/27,9/27,8
	C	18,8/18,8/18,7	19,6/19,6/19,5	20,5/20,4/20,4	22,3/22,3/22,3	26,6/26,6/26,5
	D	18,5/18,5/18,4	19,3/19,3/19,2	20,2/20,2/20,1	22,0/22,0/22,0	25,6/25,6/25,5
	E/F	18,3/18,2/18,2	18,8/18,8/18,7	19,3/19,3/19,2	20,6/20,5/20,5	23,2/23,2/23,2
250	A	20,4/20,4/20,3	21,0/21,0/20,9	22,2/22,1/22,1	24,8/24,8/24,7	30,1/30,0/30,0
	B	19,6/19,6/19,5	20,1/20,1/20,0	21,3/21,3/21,2	23,6/23,5/23,5	28,0/28,0/27,9
	C	18,8/18,7/18,7	19,6/19,6/19,5	20,4/20,4/20,4	22,3/22,3/22,3	26,6/26,6/26,5
	D	18,5/18,5/18,4	19,3/19,3/19,2	20,2/20,1/20,1	22,0/22,0/22,0	25,6/25,6/25,5
	E/F	18,2/18,2/18,1	18,7/18,7/18,6	19,3/19,3/19,2	20,5/20,5/20,4	23,2/23,2/23,1
300	A	19,5/19,5/19,4	20,1/20,1/20,0	21,3/21,3/21,2	23,9/23,9/23,8	29,1/29,1/29,1
	B	18,7/18,7/18,6	19,2/19,2/19,1	20,4/20,4/20,3	22,6/22,6/22,5	27,0/27,0/26,9
	C	17,8/17,8/17,7	18,6/18,6/18,5	19,5/19,5/19,4	21,3/21,3/21,3	25,6/25,5/25,5
	D	17,6/17,5/17,4	18,3/18,3/18,2	19,2/19,2/19,1	21,0/21,0/20,9	24,5/24,5/24,4
	E/F	17,3/17,2/17,2	17,8/17,7/17,7	18,3/18,3/18,2	19,4/19,4/19,3	22,0/21,9/21,9
350	A	19,7/19,6/19,6	20,2/20,2/20,1	21,4/21,4/21,4	24,1/24,0/24,0	29,4/29,4/29,3
	B	18,8/18,8/18,7	19,4/19,3/19,3	20,5/20,5/20,4	22,8/22,8/22,7	27,2/27,2/27,1
	C	18,0/17,9/17,8	18,8/18,7/18,7	19,6/19,6/19,5	21,5/21,5/21,4	25,7/25,7/25,7
	D	17,7/17,6/17,6	18,5/18,4/18,4	19,3/19,3/19,2	21,2/21,2/21,1	24,7/24,6/24,6
	E/F	17,4/17,4/17,3	17,9/17,9/17,8	18,4/18,4/18,3	19,6/19,5/19,5	22,1/22,1/22,0
400	A	18,7/18,7/18,6	19,3/19,2/19,2	20,4/20,4/20,4	23,0/23,0/22,9	28,2/28,2/28,1
	B	17,9/17,8/17,8	18,4/18,4/18,3	19,5/19,5/19,4	21,7/21,7/21,6	26,0/26,0/25,9
	C	17,0/17,0/16,9	17,8/17,8/17,7	18,6/18,6/18,5	20,4/20,4/20,3	24,5/24,5/24,5
	D	16,7/16,7/16,6	17,5/17,5/17,4	18,3/18,3/18,2	20,1/20,1/20,0	23,5/23,4/23,4
	E/F	16,4/16,4/16,3	16,9/16,9/16,8	17,4/17,4/17,3	18,5/18,5/18,4	20,9/20,9/20,8
450	A	18,9/18,8/18,8	19,4/19,4/19,3	20,6/20,6/20,5	23,2/23,2/23,1	28,4/28,3/28,3
	B	18,0/18,0/17,9	18,5/18,5/18,4	19,7/19,7/19,6	21,9/21,9/21,8	26,2/26,2/26,1
	C	17,2/17,1/17,0	17,9/17,9/17,8	18,8/18,8/18,7	20,6/20,6/20,5	24,7/24,7/24,7
	D	16,9/16,8/16,8	17,6/17,6/17,5	18,5/18,4/18,4	20,3/20,3/20,2	23,6/23,6/23,6
	E/F	16,6/16,6/16,5	17,1/17,0/17,0	17,6/17,5/17,5	18,7/18,6/18,6	21,1/21,1/21,0

Table B.11 (continued)

DN	Soil group	Allowable depth of cover				
		m				
		$(\beta = 0,5/0,75/1,5)$				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
500	A	18,1/18,1/18,0	18,6/18,6/18,5	19,8/19,8/19,7	22,3/22,3/22,2	27,4/27,4/27,3
	B	17,3/17,2/17,2	17,8/17,7/17,6	18,9/18,9/18,8	21,0/21,0/20,9	25,2/25,2/25,1
	C	16,4/16,4/16,3	17,2/17,1/17,1	18,0/17,9/17,9	19,7/19,7/19,7	23,8/23,7/23,7
	D	16,1/16,1/16,0	16,9/16,8/16,8	17,7/17,6/17,6	19,4/19,4/19,3	22,7/22,7/22,6
	E/F	15,8/15,8/15,7	16,3/16,3/16,2	16,8/16,7/16,7	17,8/17,8/17,7	20,1/20,1/20,0
600	A	17,7/17,7/17,6	18,2/18,2/18,1	19,4/19,3/19,3	21,9/21,8/21,8	26,9/26,9/26,8
	B	16,8/16,8/16,7	17,3/17,3/17,2	18,5/18,4/18,4	20,6/20,6/20,5	24,7/24,7/24,6
	C	16,0/16,0/15,9	16,7/16,7/16,6	17,5/17,5/17,4	19,3/19,3/19,2	23,2/23,2/23,2
	D	15,7/15,7/15,6	16,5/16,4/16,3	17,2/17,2/17,1	19,0/18,9/18,9	22,2/22,1/22,1
	E/F	15,4/15,4/15,3	15,9/15,8/15,8	16,3/16,3/16,2	17,4/17,3/17,3	19,6/19,6/19,5
700	A	17,4/17,4/17,3	17,9/17,9/17,8	19,1/19,0/19,0	21,5/21,5/21,5	26,5/26,5/26,4
	B	16,6/16,5/16,5	17,0/17,0/16,9	18,1/18,1/18,1	20,3/20,2/20,2	24,3/24,3/24,3
	C	15,7/15,7/15,6	16,4/16,4/16,3	17,2/17,2/17,1	19,0/18,9/18,9	22,9/22,9/22,8
	D	15,4/15,4/15,3	16,2/16,1/16,0	16,9/16,9/16,8	18,6/18,6/18,6	21,8/21,8/21,7
	E/F	15,1/15,1/15,0	15,6/15,5/15,5	16,0/16,0/15,9	17,0/17,0/16,9	19,3/19,2/19,2
800	A	17,4/17,4/17,3	17,9/17,9/17,8	19,0/19,0/18,9	21,5/21,5/21,4	26,5/26,5/26,4
	B	16,5/16,5/16,4	17,0/17,0/16,9	18,1/18,1/18,0	20,2/20,2/20,1	24,3/24,3/24,2
	C	15,7/15,6/15,6	16,4/16,4/16,3	17,2/17,2/17,1	18,9/18,9/18,8	22,8/22,8/22,8
	D	15,4/15,4/15,3	16,1/16,1/16,0	16,9/16,9/16,8	18,6/18,6/18,5	21,7/21,7/21,7
	E/F	15,1/15,1/15,0	15,5/15,5/15,4	16,0/16,0/15,9	17,0/17,0/16,9	19,2/19,2/19,1
900	A	17,2/17,2/17,1	17,7/17,7/17,6	18,8/18,8/18,7	21,3/21,3/21,2	26,2/26,2/26,2
	B	16,3/16,3/16,2	16,8/16,8/16,7	17,9/17,9/17,8	20,0/20,0/19,9	24,1/24,0/24,0
	C	15,5/15,5/15,4	16,2/16,2/16,1	17,0/17,0/16,9	18,7/18,7/18,6	22,6/22,6/22,5
	D	15,2/15,2/15,1	15,9/15,9/15,8	16,7/16,7/16,6	18,4/18,4/18,3	21,5/21,5/21,4
	E/F	14,9/14,9/14,8	15,3/15,3/15,2	15,8/15,8/15,7	16,8/16,8/16,7	19,0/18,9/18,9
NR Not recommended						

Table B.12 — Allowable depths of cover for C64 pipes conforming to ISO 2531 — Flexible lining

DN	Soil group	Allowable depth of cover				
		m ($\beta = 0,5/0,75/1,5$)				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
40	A	126,0/126,0/126,0	129,6/129,6/129,6	133,6/133,6/133,6	142,4/142,4/142,4	161,5/161,5/161,5
	B	125,7/125,7/125,7	129,3/129,3/129,3	133,3/133,3/133,3	142,0/142,0/141,9	160,8/160,8/160,8
	C	125,4/125,4/125,4	129,1/129,1/129,1	133,0/133,0/133,0	141,5/141,5/141,5	160,3/160,3/160,3
	D	125,4/125,3/125,3	129,0/129,0/129,0	132,9/132,9/132,9	141,4/141,4/141,4	160,0/160,0/160,0
	E/F	125,3/125,3/125,2	128,8/128,8/128,8	132,6/132,6/132,6	140,9/140,9/140,9	159,2/159,2/159,1
50	A	88,9/88,9/88,9	91,5/91,5/91,5	94,4/94,4/94,4	100,8/100,8/100,8	114,7/114,7/114,7
	B	88,6/88,6/88,6	91,1/91,1/91,1	94,1/94,1/94,0	100,3/100,3/100,3	113,9/113,9/113,8
	C	88,3/88,3/88,3	90,9/90,9/90,9	93,7/93,7/93,7	99,8/99,8/99,8	113,3/113,3/113,3
	D	88,2/88,2/88,1	90,8/90,8/90,8	93,6/93,6/93,6	99,7/99,7/99,7	112,9/112,9/112,9
	E/F	88,1/88,1/88,0	90,6/90,6/90,6	93,2/93,2/93,2	99,1/99,1/99,0	111,9/111,9/111,9
60	A	64,5/64,5/64,4	66,3/66,3/66,3	68,5/68,5/68,5	73,4/73,4/73,4	83,9/83,9/83,9
	B	64,1/64,1/64,1	65,9/65,9/65,9	68,1/68,1/68,1	72,8/72,8/72,8	82,9/82,9/82,9
	C	63,7/63,7/63,7	65,6/65,6/65,6	67,7/67,7/67,7	72,2/72,2/72,2	82,3/82,3/82,2
	D	63,6/63,6/63,5	65,5/65,5/65,5	67,6/67,6/67,6	72,1/72,1/72,1	81,8/81,8/81,7
	E/F	63,4/63,4/63,4	65,2/65,2/65,2	67,2/67,2/67,1	71,4/71,4/71,3	80,6/80,6/80,6
65	A	56,6/56,6/56,6	58,2/58,2/58,2	60,2/60,2/60,2	64,6/64,6/64,6	74,1/74,1/74,0
	B	56,2/56,2/56,2	57,8/57,8/57,8	59,8/59,8/59,8	64,0/64,0/64,0	73,0/73,0/73,0
	C	55,8/55,8/55,7	57,5/57,5/57,5	59,4/59,3/59,3	63,4/63,4/63,4	72,3/72,3/72,3
	D	55,6/55,6/55,6	57,4/57,4/57,3	59,2/59,2/59,2	63,2/63,2/63,2	71,8/71,8/71,7
	E/F	55,5/55,5/55,5	57,1/57,1/57,1	58,8/58,8/58,7	62,4/62,4/62,4	70,5/70,5/70,5
80	A	39,4/39,4/39,4	40,5/40,5/40,5	42,1/42,1/42,0	45,5/45,5/45,4	52,7/52,6/52,6
	B	38,9/38,9/38,9	40,0/40,0/40,0	41,6/41,5/41,5	44,7/44,7/44,7	51,4/51,4/51,3
	C	38,4/38,4/38,3	39,7/39,7/39,6	41,0/41,0/41,0	44,0/44,0/43,9	50,5/50,5/50,5
	D	38,2/38,2/38,2	39,5/39,5/39,4	40,8/40,8/40,8	43,8/43,8/43,7	49,9/49,9/49,8
	E/F	38,1/38,1/38,0	39,2/39,1/39,1	40,3/40,3/40,3	42,8/42,8/42,8	48,4/48,4/48,3
100	A	27,3/27,3/27,3	28,1/28,1/28,1	29,4/29,4/29,3	32,1/32,1/32,1	37,9/37,9/37,8
	B	26,7/26,7/26,7	27,5/27,5/27,4	28,7/28,7/28,7	31,2/31,2/31,2	36,3/36,3/36,3
	C	26,1/26,1/26,0	27,1/27,1/27,0	28,1/28,1/28,0	30,3/30,3/30,2	35,3/35,3/35,2
	D	25,9/25,9/25,8	26,9/26,8/26,8	27,9/27,9/27,8	30,1/30,1/30,0	34,5/34,5/34,4
	E/F	25,7/25,7/25,6	26,4/26,4/26,4	27,2/27,2/27,1	28,9/28,9/28,9	32,7/32,7/32,6
125	A	23,0/23,0/23,0	23,7/23,7/23,6	24,9/24,9/24,8	27,5/27,5/27,4	32,8/32,8/32,7
	B	22,4/22,3/22,3	23,0/23,0/22,9	24,2/24,1/24,1	26,5/26,4/26,4	31,1/31,0/31,0
	C	21,7/21,6/21,6	22,5/22,5/22,4	23,4/23,4/23,4	25,4/25,4/25,3	29,9/29,9/29,8
	D	21,4/21,4/21,3	22,3/22,3/22,2	23,2/23,2/23,1	25,2/25,1/25,1	29,0/29,0/28,9
	E/F	21,2/21,2/21,1	21,8/21,8/21,7	22,5/22,4/22,4	23,9/23,9/23,8	27,0/27,0/26,9

Table B.12 (continued)

DN	Soil group	Allowable depth of cover				
		m				
		$(\beta = 0,5/0,75/1,5)$				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
150	A	21,2/21,2/21,2	21,9/21,8/21,8	23,0/23,0/22,9	25,6/25,6/25,5	30,8/30,7/30,7
	B	20,5/20,5/20,4	21,1/21,1/21,0	22,2/22,2/22,1	24,5/24,4/24,4	28,9/28,9/28,8
	C	19,8/19,7/19,7	20,6/20,6/20,5	21,5/21,4/21,4	23,4/23,3/23,3	27,6/27,6/27,6
	D	19,5/19,5/19,4	20,3/20,3/20,2	21,2/21,2/21,1	23,1/23,1/23,0	26,7/26,7/26,6
	E/F	19,3/19,2/19,2	19,8/19,8/19,7	20,4/20,4/20,3	21,7/21,7/21,6	24,5/24,5/24,4
200	A	20,4/20,3/20,3	21,0/20,9/20,9	22,1/22,1/22,0	24,7/24,7/24,6	29,9/29,9/29,8
	B	19,6/19,6/19,5	20,1/20,1/20,0	21,3/21,3/21,2	23,5/23,5/23,4	27,9/27,9/27,8
	C	18,8/18,8/18,7	19,6/19,6/19,5	20,5/20,4/20,4	22,3/22,3/22,3	26,6/26,6/26,5
	D	18,5/18,5/18,4	19,3/19,3/19,2	20,2/20,2/20,1	22,0/22,0/22,0	25,6/25,6/25,5
	E/F	18,3/18,2/18,2	18,8/18,8/18,7	19,3/19,3/19,2	20,6/20,5/20,5	23,2/23,2/23,2
250	A	20,4/20,4/20,3	21,0/21,0/20,9	22,2/22,1/22,1	24,8/24,8/24,7	30,1/30,0/30,0
	B	19,6/19,6/19,5	20,1/20,1/20,0	21,3/21,3/21,2	23,6/23,5/23,5	28,0/28,0/27,9
	C	18,8/18,7/18,7	19,6/19,6/19,5	20,4/20,4/20,4	22,3/22,3/22,3	26,6/26,6/26,5
	D	18,5/18,5/18,4	19,3/19,3/19,2	20,2/20,1/20,1	22,0/22,0/22,0	25,6/25,6/25,5
	E/F	18,2/18,2/18,1	18,7/18,7/18,6	19,3/19,3/19,2	20,5/20,5/20,4	23,2/23,2/23,1
300	A	19,5/19,5/19,4	20,1/20,1/20,0	21,3/21,3/21,2	23,9/23,9/23,8	29,1/29,1/29,1
	B	18,7/18,7/18,6	19,2/19,2/19,1	20,4/20,4/20,3	22,6/22,6/22,5	27,0/27,0/26,9
	C	17,8/17,8/17,7	18,6/18,6/18,5	19,5/19,5/19,4	21,3/21,3/21,3	25,6/25,5/25,5
	D	17,6/17,5/17,4	18,3/18,3/18,2	19,2/19,2/19,1	21,0/21,0/20,9	24,5/24,5/24,4
	E/F	17,3/17,2/17,2	17,8/17,7/17,7	18,3/18,3/18,2	19,4/19,4/19,3	22,0/21,9/21,9
350	A	19,7/19,6/19,6	20,2/20,2/20,1	21,4/21,4/21,4	24,1/24,0/24,0	29,4/29,4/29,3
	B	18,8/18,8/18,7	19,4/19,3/19,3	20,5/20,5/20,4	22,8/22,8/22,7	27,2/27,2/27,1
	C	18,0/17,9/17,8	18,8/18,7/18,7	19,6/19,6/19,5	21,5/21,5/21,4	25,7/25,7/25,7
	D	17,7/17,6/17,6	18,5/18,4/18,4	19,3/19,3/19,2	21,2/21,2/21,1	24,7/24,6/24,6
	E/F	17,4/17,4/17,3	17,9/17,9/17,8	18,4/18,4/18,3	19,6/19,5/19,5	22,1/22,1/22,0
400	A	18,7/18,7/18,6	19,3/19,2/19,2	20,4/20,4/20,4	23,0/23,0/22,9	28,2/28,2/28,1
	B	17,9/17,8/17,8	18,4/18,4/18,3	19,5/19,5/19,4	21,7/21,7/21,6	26,0/26,0/25,9
	C	17,0/17,0/16,9	17,8/17,8/17,7	18,6/18,6/18,5	20,4/20,4/20,3	24,5/24,5/24,5
	D	16,7/16,7/16,6	17,5/17,5/17,4	18,3/18,3/18,2	20,1/20,1/20,0	23,5/23,4/23,4
	E/F	16,4/16,4/16,3	16,9/16,9/16,8	17,4/17,4/17,3	18,5/18,5/18,4	20,9/20,9/20,8
450	A	18,9/18,8/18,8	19,4/19,4/19,3	20,6/20,6/20,5	23,2/23,2/23,1	28,4/28,3/28,3
	B	18,0/18,0/17,9	18,5/18,5/18,4	19,7/19,7/19,6	21,9/21,9/21,8	26,2/26,2/26,1
	C	17,2/17,1/17,0	17,9/17,9/17,8	18,8/18,8/18,7	20,6/20,6/20,5	24,7/24,7/24,7
	D	16,9/16,8/16,8	17,6/17,6/17,5	18,5/18,4/18,4	20,3/20,3/20,2	23,6/23,6/23,6
	E/F	16,6/16,6/16,5	17,1/17,0/17,0	17,6/17,5/17,5	18,7/18,6/18,6	21,1/21,1/21,0

Table B.12 (continued)

DN	Soil group	Allowable depth of cover				
		m ($\beta = 0,5/0,75/1,5$)				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
500	A	18,1/18,1/18,0	18,6/18,6/18,5	19,8/19,8/19,7	22,3/22,3/22,2	27,4/27,4/27,3
	B	17,3/17,2/17,2	17,8/17,7/17,6	18,9/18,9/18,8	21,0/21,0/20,9	25,2/25,2/25,1
	C	16,4/16,4/16,3	17,2/17,1/17,1	18,0/17,9/17,9	19,7/19,7/19,7	23,8/23,7/23,7
	D	16,1/16,1/16,0	16,9/16,8/16,8	17,7/17,6/17,6	19,4/19,4/19,3	22,7/22,7/22,6
	E/F	15,8/15,8/15,7	16,3/16,3/16,2	16,8/16,7/16,7	17,8/17,8/17,7	20,1/20,1/20,0
600	A	17,7/17,7/17,6	18,2/18,2/18,1	19,4/19,3/19,3	21,9/21,8/21,8	26,9/26,9/26,8
	B	16,8/16,8/16,7	17,3/17,3/17,2	18,5/18,4/18,4	20,6/20,6/20,5	24,7/24,7/24,6
	C	16,0/16,0/15,9	16,7/16,7/16,6	17,5/17,5/17,4	19,3/19,3/19,2	23,2/23,2/23,2
	D	15,7/15,7/15,6	16,5/16,4/16,3	17,2/17,2/17,1	19,0/18,9/18,9	22,2/22,1/22,1
	E/F	15,4/15,4/15,3	15,9/15,8/15,8	16,3/16,3/16,2	17,4/17,3/17,3	19,6/19,6/19,5
700	A	17,4/17,4/17,3	17,9/17,9/17,8	19,1/19,0/19,0	21,5/21,5/21,5	26,5/26,5/26,4
	B	16,6/16,5/16,5	17,0/17,0/16,9	18,1/18,1/18,1	20,3/20,2/20,2	24,3/24,3/24,3
	C	15,7/15,7/15,6	16,4/16,4/16,3	17,2/17,2/17,1	19,0/18,9/18,9	22,9/22,9/22,8
	D	15,4/15,4/15,3	16,2/16,1/16,0	16,9/16,9/16,8	18,6/18,6/18,6	21,8/21,8/21,7
	E/F	15,1/15,1/15,0	15,6/15,5/15,5	16,0/16,0/15,9	17,0/17,0/16,9	19,3/19,2/19,2
800	A	17,4/17,4/17,3	17,9/17,9/17,8	19,0/19,0/18,9	21,5/21,5/21,4	26,5/26,5/26,4
	B	16,5/16,5/16,4	17,0/17,0/16,9	18,1/18,1/18,0	20,2/20,2/20,1	24,3/24,3/24,2
	C	15,7/15,6/15,6	16,4/16,4/16,3	17,2/17,2/17,1	18,9/18,9/18,8	22,8/22,8/22,8
	D	15,4/15,4/15,3	16,1/16,1/16,0	16,9/16,9/16,8	18,6/18,6/18,5	21,7/21,7/21,7
	E/F	15,1/15,1/15,0	15,5/15,5/15,4	16,0/16,0/15,9	17,0/17,0/16,9	19,2/19,2/19,1
900	A	17,2/17,2/17,1	17,7/17,7/17,6	18,8/18,8/18,7	21,3/21,3/21,2	26,2/26,2/26,2
	B	16,3/16,3/16,2	16,8/16,8/16,7	17,9/17,9/17,8	20,0/20,0/19,9	24,1/24,0/24,0
	C	15,5/15,5/15,4	16,2/16,2/16,1	17,0/17,0/16,9	18,7/18,7/18,6	22,6/22,6/22,5
	D	15,2/15,2/15,1	15,9/15,9/15,8	16,7/16,7/16,6	18,4/18,4/18,3	21,5/21,5/21,4
	E/F	14,9/14,9/14,8	15,3/15,3/15,2	15,8/15,8/15,7	16,8/16,8/16,7	19,0/18,9/18,9
NR Not recommended						

Table B.13 — Allowable depths of cover for C100 pipes conforming to ISO 2531 —
Cement mortar lining

DN	Soil group	Allowable depth of cover				
		m				
		$(\beta = 0,5/0,75/1,5)$				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
40	A	126,0/126,0/126,0	129,6/129,6/129,6	133,6/133,6/133,6	142,4/142,4/142,4	161,5/161,5/161,5
	B	125,7/125,7/125,7	129,3/129,3/129,3	133,3/133,3/133,3	142,0/142,0/141,9	160,8/160,8/160,8
	C	125,4/125,4/125,4	129,1/129,1/129,1	133,0/133,0/133,0	141,5/141,5/141,5	160,3/160,3/160,3
	D	125,4/125,3/125,3	129,0/129,0/129,0	132,9/132,9/132,9	141,4/141,4/141,4	160,0/160,0/160,0
	E/F	125,3/125,3/125,2	128,8/128,8/128,8	132,6/132,6/132,6	140,9/140,9/140,9	159,2/159,2/159,1
50	A	88,9/88,9/88,9	91,5/91,5/91,5	94,4/94,4/94,4	100,8/100,8/100,8	114,7/114,7/114,7
	B	88,6/88,6/88,6	91,1/91,1/91,1	94,1/94,1/94,0	100,3/100,3/100,3	113,9/113,9/113,8
	C	88,3/88,3/88,3	90,9/90,9/90,9	93,7/93,7/93,7	99,8/99,8/99,8	113,3/113,3/113,3
	D	88,2/88,2/88,1	90,8/90,8/90,8	93,6/93,6/93,6	99,7/99,7/99,7	112,9/112,9/112,9
	E/F	88,1/88,1/88,0	90,6/90,6/90,6	93,2/93,2/93,2	99,1/99,1/99,0	111,9/111,9/111,9
60	A	64,5/64,5/64,4	66,3/66,3/66,3	68,5/68,5/68,5	73,4/73,4/73,4	83,9/83,9/83,9
	B	64,1/64,1/64,1	65,9/65,9/65,9	68,1/68,1/68,1	72,8/72,8/72,8	82,9/82,9/82,9
	C	63,7/63,7/63,7	65,6/65,6/65,6	67,7/67,7/67,7	72,2/72,2/72,2	82,3/82,3/82,2
	D	63,6/63,6/63,5	65,5/65,5/65,5	67,6/67,6/67,6	72,1/72,1/72,1	81,8/81,8/81,7
	E/F	63,4/63,4/63,4	65,2/65,2/65,2	67,2/67,2/67,1	71,4/71,4/71,3	80,6/80,6/80,6
65	A	56,6/56,6/56,6	58,2/58,2/58,2	60,2/60,2/60,2	64,6/64,6/64,6	74,1/74,1/74,0
	B	56,2/56,2/56,2	57,8/57,8/57,8	59,8/59,8/59,8	64,0/64,0/64,0	73,0/73,0/73,0
	C	55,8/55,8/55,7	57,5/57,5/57,5	59,4/59,3/59,3	63,4/63,4/63,4	72,3/72,3/72,3
	D	55,6/55,6/55,6	57,4/57,4/57,3	59,2/59,2/59,2	63,2/63,2/63,2	71,8/71,8/71,7
	E/F	55,5/55,5/55,5	57,1/57,1/57,1	58,8/58,8/58,7	62,4/62,4/62,4	70,5/70,5/70,5
80	A	49,1/49,1/49,0	50,5/50,5/50,4	52,3/52,3/52,3	56,3/56,3/56,2	64,7/64,7/64,7
	B	48,6/48,6/48,6	50,0/50,0/50,0	51,8/51,8/51,8	55,6/55,6/55,5	63,5/63,5/63,5
	C	48,2/48,2/48,1	49,7/49,7/49,7	51,3/51,3/51,3	54,9/54,9/54,8	62,8/62,8/62,7
	D	48,0/48,0/48,0	49,5/49,5/49,5	51,2/51,2/51,1	54,7/54,7/54,7	62,2/62,2/62,1
	E/F	47,9/47,8/47,8	49,2/49,2/49,2	50,7/50,7/50,6	53,8/53,8/53,8	60,8/60,8/60,8
100	A	47,1/47,1/47,1	48,5/48,5/48,4	50,2/50,2/50,2	54,1/54,1/54,1	62,3/62,3/62,3
	B	46,6/46,6/46,6	48,0/48,0/47,9	49,7/49,7/49,7	53,4/53,4/53,3	61,1/61,1/61,1
	C	46,1/46,1/46,1	47,6/47,6/47,6	49,2/49,2/49,2	52,6/52,6/52,6	60,3/60,3/60,3
	D	46,0/46,0/45,9	47,5/47,5/47,4	49,0/49,0/49,0	52,5/52,5/52,4	59,7/59,7/59,6
	E/F	45,8/45,8/45,8	47,1/47,1/47,1	48,5/48,5/48,5	51,6/51,6/51,5	58,2/58,2/58,2
125	A	47,0/47,0/46,9	48,3/48,3/48,3	50,1/50,1/50,1	54,0/54,0/53,9	62,2/62,2/62,2
	B	46,5/46,5/46,4	47,8/47,8/47,8	49,6/49,6/49,5	53,2/53,2/53,2	61,0/61,0/60,9
	C	46,0/46,0/45,9	47,5/47,4/47,4	49,0/49,0/49,0	52,5/52,5/52,4	60,1/60,1/60,1
	D	45,8/45,8/45,8	47,3/47,3/47,2	48,9/48,8/48,8	52,3/52,3/52,2	59,5/59,5/59,4
	E/F	45,6/45,6/45,6	46,9/46,9/46,9	48,3/48,3/48,3	51,3/51,3/51,3	58,0/58,0/58,0

Table B.13 (continued)

DN	Soil group	Allowable depth of cover				
		m				
		$(\beta = 0,5/0,75/1,5)$				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
150	A	45,5/45,4/45,4	46,8/46,7/46,7	48,5/48,5/48,5	52,3/52,3/52,3	60,4/60,4/60,4
	B	44,9/44,9/44,9	46,2/46,2/46,2	48,0/47,9/47,9	51,5/51,5/51,5	59,1/59,1/59,1
	C	44,4/44,4/44,4	45,9/45,9/45,8	47,4/47,4/47,4	50,8/50,7/50,7	58,2/58,2/58,2
	D	44,2/44,2/44,2	45,7/45,7/45,6	47,2/47,2/47,2	50,6/50,6/50,5	57,6/57,5/57,5
	E/F	44,1/44,1/44,0	45,3/45,3/45,3	46,7/46,7/46,6	49,6/49,6/49,5	56,0/56,0/56,0
200	A	43,6/43,6/43,5	44,8/44,8/44,8	46,5/46,5/46,5	50,3/50,2/50,2	58,2/58,1/58,1
	B	43,0/43,0/43,0	44,2/44,2/44,2	45,9/45,9/45,9	49,4/49,4/49,4	56,8/56,8/56,7
	C	42,5/42,5/42,4	43,9/43,9/43,8	45,4/45,3/45,3	48,6/48,6/48,6	55,8/55,8/55,8
	D	42,3/42,3/42,2	43,7/43,7/43,6	45,2/45,2/45,1	48,4/48,4/48,4	55,1/55,1/55,1
	E/F	42,1/42,1/42,1	43,3/43,3/43,3	44,6/44,6/44,5	47,4/47,4/47,3	53,5/53,5/53,5
250	A	43,3/43,3/43,2	44,5/44,5/44,5	46,2/46,2/46,2	50,0/49,9/49,9	57,9/57,8/57,8
	B	42,7/42,7/42,7	43,9/43,9/43,9	45,6/45,6/45,6	49,1/49,1/49,1	56,4/56,4/56,4
	C	42,2/42,1/42,1	43,6/43,5/43,5	45,0/45,0/45,0	48,3/48,3/48,2	55,5/55,5/55,4
	D	42,0/42,0/41,9	43,4/43,3/43,3	44,8/44,8/44,8	48,1/48,1/48,0	54,8/54,8/54,7
	E/F	41,8/41,8/41,7	43,0/43,0/42,9	44,2/44,2/44,2	47,0/47,0/47,0	53,1/53,1/53,1
300	A	42,4/42,4/42,3	43,6/43,6/43,5	45,3/45,3/45,2	49,0/49,0/48,9	56,8/56,8/56,8
	B	41,8/41,8/41,8	43,0/43,0/43,0	44,7/44,7/44,6	48,1/48,1/48,1	55,3/55,3/55,3
	C	41,2/41,2/41,2	42,6/42,6/42,6	44,1/44,0/44,0	47,2/47,2/47,2	54,3/54,3/54,3
	D	41,0/41,0/41,0	42,4/42,4/42,4	43,9/43,8/43,8	47,0/47,0/47,0	53,6/53,6/53,6
	E/F	40,8/40,8/40,8	42,0/42,0/42,0	43,2/43,2/43,2	46,0/45,9/45,9	51,9/51,9/51,9
350	A	42,3/42,3/42,3	43,6/43,5/43,5	45,3/45,2/45,2	49,0/48,9/48,9	56,8/56,8/56,7
	B	41,8/41,8/41,7	43,0/42,9/42,9	44,6/44,6/44,6	48,1/48,1/48,0	55,3/55,3/55,3
	C	41,2/41,2/41,1	42,6/42,5/42,5	44,0/44,0/44,0	47,2/47,2/47,2	54,3/54,3/54,3
	D	41,0/41,0/40,9	42,4/42,3/42,3	43,8/43,8/43,8	47,0/47,0/46,9	53,6/53,6/53,5
	E/F	40,8/40,8/40,7	42,0/41,9/41,9	43,2/43,2/43,2	45,9/45,9/45,9	51,8/51,8/51,8
400	A	40,7/40,7/40,6	41,8/41,8/41,8	43,5/43,5/43,4	47,1/47,1/47,0	54,7/54,7/54,6
	B	40,1/40,1/40,1	41,2/41,2/41,2	42,9/42,9/42,8	46,2/46,2/46,2	53,2/53,2/53,1
	C	39,5/39,5/39,5	40,8/40,8/40,8	42,3/42,2/42,2	45,3/45,3/45,3	52,2/52,2/52,2
	D	39,3/39,3/39,3	40,6/40,6/40,6	42,0/42,0/42,0	45,1/45,1/45,1	51,5/51,4/51,4
	E/F	39,1/39,1/39,1	40,2/40,2/40,2	41,4/41,4/41,4	44,0/44,0/44,0	49,7/49,7/49,7
450	A	40,8/40,8/40,7	41,9/41,9/41,9	43,6/43,6/43,6	47,2/47,2/47,2	54,8/54,8/54,8
	B	40,2/40,2/40,2	41,3/41,3/41,3	43,0/43,0/42,9	46,3/46,3/46,3	53,3/53,3/53,3
	C	39,6/39,6/39,6	41,0/40,9/40,9	42,4/42,4/42,3	45,4/45,4/45,4	52,3/52,3/52,3
	D	39,4/39,4/39,4	40,8/40,7/40,7	42,2/42,1/42,1	45,2/45,2/45,2	51,6/51,6/51,5
	E/F	39,2/39,2/39,2	40,4/40,3/40,3	41,5/41,5/41,5	44,1/44,1/44,1	49,9/49,8/49,8

Table B.13 (continued)

DN	Soil group	Allowable depth of cover				
		m				
		$(\beta = 0,5/0,75/1,5)$				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
500	A	40,0/40,0/40,0	41,2/41,1/41,1	42,8/42,8/42,7	46,3/46,3/46,3	53,8/53,8/53,8
	B	39,4/39,4/39,4	40,6/40,5/40,5	42,2/42,2/42,1	45,5/45,4/45,4	52,3/52,3/52,3
	C	38,8/38,8/38,8	40,2/40,1/40,1	41,5/41,5/41,5	44,6/44,6/44,5	51,3/51,3/51,3
	D	38,7/38,6/38,6	40,0/39,9/39,9	41,3/41,3/41,3	44,4/44,4/44,3	50,6/50,6/50,6
	E/F	38,5/38,4/38,4	39,6/39,5/39,5	40,7/40,7/40,7	43,3/43,3/43,2	48,9/48,9/48,8
600	A	39,0/39,0/39,0	40,2/40,2/40,1	41,8/41,7/41,7	45,2/45,2/45,2	52,6/52,6/52,6
	B	38,5/38,5/38,4	39,6/39,6/39,5	41,1/41,1/41,1	44,4/44,4/44,3	51,1/51,1/51,1
	C	37,9/37,9/37,8	39,2/39,2/39,1	40,5/40,5/40,5	43,5/43,5/43,5	50,1/50,1/50,1
	D	37,7/37,7/37,6	39,0/39,0/38,9	40,3/40,3/40,3	43,3/43,3/43,2	49,4/49,4/49,3
	E/F	37,5/37,5/37,4	38,6/38,6/38,5	39,7/39,7/39,7	42,2/42,2/42,1	47,7/47,6/47,6
700	A	38,8/38,8/38,8	39,9/39,9/39,9	41,5/41,5/41,5	45,0/45,0/44,9	52,3/52,3/52,2
	B	38,2/38,2/38,2	39,3/39,3/39,3	40,9/40,9/40,8	44,1/44,1/44,1	50,8/50,8/50,8
	C	37,6/37,6/37,6	38,9/38,9/38,9	40,3/40,3/40,2	43,2/43,2/43,2	49,8/49,8/49,8
	D	37,4/37,4/37,4	38,7/38,7/38,7	40,1/40,0/40,0	43,0/43,0/43,0	49,1/49,1/49,0
	E/F	37,2/37,2/37,2	38,3/38,3/38,3	39,4/39,4/39,4	41,9/41,9/41,9	47,3/47,3/47,3
NR Not recommended						

Table B.14 — Allowable depths of cover for C100 pipes conforming to ISO 2531 — Flexible lining

DN	Soil group	Allowable depth of cover				
		m				
		$(\beta = 0,5/0,75/1,5)$				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
40	A	126,0/126,0/126,0	129,6/129,6/129,6	133,6/133,6/133,6	142,4/142,4/142,4	161,5/161,5/161,5
	B	125,7/125,7/125,7	129,3/129,3/129,3	133,3/133,3/133,3	142,0/142,0/141,9	160,8/160,8/160,8
	C	125,4/125,4/125,4	129,1/129,1/129,1	133,0/133,0/133,0	141,5/141,5/141,5	160,3/160,3/160,3
	D	125,4/125,3/125,3	129,0/129,0/129,0	132,9/132,9/132,9	141,4/141,4/141,4	160,0/160,0/160,0
	E/F	125,3/125,3/125,2	128,8/128,8/128,8	132,6/132,6/132,6	140,9/140,9/140,9	159,2/159,2/159,1
50	A	88,9/88,9/88,9	91,5/91,5/91,5	94,4/94,4/94,4	100,8/100,8/100,8	114,7/114,7/114,7
	B	88,6/88,6/88,6	91,1/91,1/91,1	94,1/94,1/94,0	100,3/100,3/100,3	113,9/113,9/113,8
	C	88,3/88,3/88,3	90,9/90,9/90,9	93,7/93,7/93,7	99,8/99,8/99,8	113,3/113,3/113,3
	D	88,2/88,2/88,1	90,8/90,8/90,8	93,6/93,6/93,6	99,7/99,7/99,7	112,9/112,9/112,9
	E/F	88,1/88,1/88,0	90,6/90,6/90,6	93,2/93,2/93,2	99,1/99,1/99,0	111,9/111,9/111,9
60	A	64,5/64,5/64,4	66,3/66,3/66,3	68,5/68,5/68,5	73,4/73,4/73,4	83,9/83,9/83,9
	B	64,1/64,1/64,1	65,9/65,9/65,9	68,1/68,1/68,1	72,8/72,8/72,8	82,9/82,9/82,9
	C	63,7/63,7/63,7	65,6/65,6/65,6	67,7/67,7/67,7	72,2/72,2/72,2	82,3/82,3/82,2
	D	63,6/63,6/63,5	65,5/65,5/65,5	67,6/67,6/67,6	72,1/72,1/72,1	81,8/81,8/81,7
	E/F	63,4/63,4/63,4	65,2/65,2/65,2	67,2/67,2/67,1	71,4/71,4/71,3	80,6/80,6/80,6
65	A	56,6/56,6/56,6	58,2/58,2/58,2	60,2/60,2/60,2	64,6/64,6/64,6	74,1/74,1/74,0
	B	56,2/56,2/56,2	57,8/57,8/57,8	59,8/59,8/59,8	64,0/64,0/64,0	73,0/73,0/73,0
	C	55,8/55,8/55,7	57,5/57,5/57,5	59,4/59,3/59,3	63,4/63,4/63,4	72,3/72,3/72,3
	D	55,6/55,6/55,6	57,4/57,4/57,3	59,2/59,2/59,2	63,2/63,2/63,2	71,8/71,8/71,7
	E/F	55,5/55,5/55,5	57,1/57,1/57,1	58,8/58,8/58,7	62,4/62,4/62,4	70,5/70,5/70,5
80	A	49,1/49,1/49,0	50,5/50,5/50,4	52,3/52,3/52,3	56,3/56,3/56,2	64,7/64,7/64,7
	B	48,6/48,6/48,6	50,0/50,0/50,0	51,8/51,8/51,8	55,6/55,6/55,5	63,5/63,5/63,5
	C	48,2/48,2/48,1	49,7/49,7/49,7	51,3/51,3/51,3	54,9/54,9/54,8	62,8/62,8/62,7
	D	48,0/48,0/48,0	49,5/49,5/49,5	51,2/51,2/51,1	54,7/54,7/54,7	62,2/62,2/62,1
	E/F	47,9/47,8/47,8	49,2/49,1/49,2	50,7/50,7/50,6	53,8/53,8/53,8	60,8/60,8/60,8
100	A	47,1/47,1/47,1	48,5/48,5/48,4	50,2/50,2/50,2	54,1/54,1/54,1	62,3/62,3/62,3
	B	46,6/46,6/46,6	48,0/48,0/47,9	49,7/49,7/49,7	53,4/53,4/53,3	61,1/61,1/61,0
	C	46,1/46,1/46,1	47,6/47,6/47,6	49,2/49,2/49,2	52,6/52,6/52,6	60,3/60,3/60,3
	D	46,0/46,0/45,9	47,5/47,5/47,4	49,0/49,0/49,0	52,5/52,5/52,4	59,7/59,7/59,6
	E/F	45,8/45,8/45,8	47,1/47,1/47,1	48,5/48,5/48,5	51,6/51,6/51,5	58,2/58,2/58,2
125	A	47,0/47,0/46,9	48,3/48,3/48,3	50,1/50,1/50,1	54,0/54,0/53,9	62,2/62,2/62,2
	B	46,5/46,5/46,4	47,8/47,8/47,8	49,6/49,6/49,5	53,2/53,2/53,2	61,0/61,0/60,9
	C	46,0/46,0/45,9	47,5/47,4/47,4	49,0/49,0/49,0	52,5/52,5/52,4	60,1/60,1/60,1
	D	45,8/45,8/45,8	47,3/47,3/47,2	48,9/48,8/48,8	52,3/52,2/52,2	59,5/59,5/59,4
	E/F	45,6/45,6/45,6	46,9/46,9/46,9	48,3/48,3/48,3	51,3/51,3/51,3	58,0/58,0/58,0

Table B.14 (continued)

DN	Soil group	Allowable depth of cover				
		m ($\beta = 0,5/0,75/1,5$)				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
150	A	45,5/45,4/45,4	46,8/46,7/46,7	48,5/48,5/48,5	52,3/52,3/52,3	60,4/60,4/60,4
	B	44,9/44,9/44,9	46,2/46,2/46,2	48,0/47,9/47,9	51,5/51,5/51,5	59,1/59,1/59,1
	C	44,4/44,4/44,4	45,9/45,9/45,8	47,4/47,4/47,4	50,8/50,7/50,7	58,2/58,2/58,2
	D	44,2/44,2/44,2	45,7/45,7/45,6	47,2/47,2/47,2	50,6/50,6/50,5	57,6/57,5/57,5
	E/F	44,1/44,1/44,0	45,3/45,3/45,3	46,7/46,7/46,6	49,6/49,6/49,5	56,0/56,0/56,0
200	A	43,6/43,6/43,5	44,8/44,8/44,8	46,5/46,5/46,5	50,3/50,2/50,2	58,2/58,1/58,1
	B	43,0/43,0/43,0	44,2/44,2/44,2	45,9/45,9/45,9	49,4/49,4/49,4	56,8/56,8/56,7
	C	42,5/42,5/42,4	43,9/43,9/43,8	45,4/45,3/45,3	48,6/48,6/48,6	55,8/55,8/55,8
	D	42,3/42,3/42,2	43,7/43,7/43,6	45,2/45,2/45,1	48,4/48,4/48,4	55,1/55,1/55,1
	E/F	42,1/42,1/42,1	43,3/43,3/43,3	44,6/44,6/44,5	47,4/47,4/47,3	53,5/53,5/53,5
250	A	43,3/43,3/43,2	44,5/44,5/44,5	46,2/46,2/46,2	50,0/49,9/49,9	57,9/57,8/57,8
	B	42,7/42,7/42,7	43,9/43,9/43,9	45,6/45,6/45,6	49,1/49,1/49,1	56,4/56,4/56,4
	C	42,2/42,1/42,1	43,6/43,5/43,5	45,0/45,0/45,0	48,3/48,3/48,2	55,5/55,5/55,4
	D	42,0/42,0/41,9	43,4/43,3/43,3	44,8/44,8/44,8	48,1/48,1/48,0	54,8/54,8/54,7
	E/F	41,8/41,8/41,7	43,0/43,0/42,9	44,2/44,2/44,2	47,0/47,0/47,0	53,1/53,1/53,1
300	A	42,4/42,4/42,3	43,6/43,6/43,5	45,3/45,3/45,2	49,0/49,0/48,9	56,8/56,8/56,8
	B	41,8/41,8/41,8	43,0/43,0/43,0	44,7/44,7/44,6	48,1/48,1/48,1	55,3/55,3/55,3
	C	41,2/41,2/41,2	42,6/42,6/42,6	44,1/44,0/44,0	47,2/47,2/47,2	54,3/54,3/54,3
	D	41,0/41,0/41,0	42,4/42,4/42,4	43,9/43,8/43,8	47,0/47,0/47,0	53,6/53,6/53,6
	E/F	40,8/40,8/40,8	42,0/42,0/42,0	43,2/43,2/43,2	46,0/45,9/45,9	51,9/51,9/51,9
350	A	42,3/42,3/42,3	43,6/43,5/43,5	45,3/45,2/45,2	49,0/48,9/48,9	56,8/56,8/56,7
	B	41,8/41,8/41,7	43,0/42,9/42,9	44,6/44,6/44,6	48,1/48,1/48,0	55,3/55,3/55,3
	C	41,2/41,2/41,1	42,6/42,5/42,5	44,0/44,0/44,0	47,2/47,2/47,2	54,3/54,3/54,3
	D	41,0/41,0/40,9	42,4/42,3/42,3	43,8/43,8/43,8	47,0/47,0/46,9	53,6/53,6/53,5
	E/F	40,8/40,8/40,7	42,0/41,9/41,9	43,2/43,2/43,2	45,9/45,9/45,9	51,8/51,8/51,8
400	A	40,7/40,7/40,6	41,8/41,8/41,8	43,5/43,5/43,4	47,1/47,1/47,0	54,7/54,7/54,6
	B	40,1/40,1/40,1	41,2/41,2/41,2	42,9/42,9/42,8	46,2/46,2/46,2	53,2/53,2/53,1
	C	39,5/39,5/39,5	40,8/40,8/40,8	42,3/42,3/42,2	45,3/45,3/45,3	52,2/52,2/52,2
	D	39,3/39,3/39,3	40,6/40,6/40,6	42,0/42,0/42,0	45,1/45,1/45,1	51,5/51,4/51,4
	E/F	39,1/39,1/39,1	40,2/40,2/40,2	41,4/41,4/41,4	44,0/44,0/44,0	49,7/49,7/49,7
450	A	40,8/40,8/40,7	41,9/41,9/41,9	43,6/43,6/43,6	47,2/47,2/47,2	54,8/54,8/54,8
	B	40,2/40,2/40,2	41,3/41,3/41,3	43,0/43,0/42,9	46,3/46,3/46,3	53,3/53,3/53,3
	C	39,6/39,6/39,6	41,0/40,9/40,9	42,4/42,4/42,3	45,4/45,4/45,4	52,3/52,3/52,3
	D	39,4/39,4/39,4	40,8/40,7/40,7	42,2/42,1/42,1	45,2/45,2/45,2	51,6/51,6/51,5
	E/F	39,2/39,2/39,2	40,4/40,3/40,3	41,5/41,5/41,5	44,1/44,1/44,1	49,9/49,8/49,8

Table B.14 (continued)

DN	Soil group	Allowable depth of cover m ($\beta = 0,5/0,75/1,5$)				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
500	A	40,0/40,0/40,0	41,2/41,1/41,1	42,8/42,8/42,7	46,3/46,3/46,3	53,8/53,8/53,8
	B	39,4/39,4/39,4	40,6/40,5/40,5	42,2/42,2/42,1	45,5/45,4/45,4	52,3/52,3/52,3
	C	38,8/38,8/38,8	40,2/40,1/40,1	41,5/41,5/41,5	44,6/44,6/44,5	51,3/51,3/51,3
	D	38,7/38,6/38,6	40,0/39,9/39,9	41,3/41,3/41,3	44,4/44,4/44,3	50,6/50,6/50,6
	E/F	38,5/38,4/38,4	39,6/39,5/39,5	40,7/40,7/40,7	43,3/43,3/43,2	48,9/48,9/48,8
600	A	39,0/39,0/39,0	40,2/40,2/40,1	41,8/41,7/41,7	45,2/45,2/45,2	52,6/52,6/52,6
	B	38,5/38,5/38,4	39,6/39,6/39,5	41,1/41,1/41,1	44,4/44,4/44,3	51,1/51,1/51,1
	C	37,9/37,9/37,8	39,2/39,2/39,1	40,5/40,5/40,5	43,5/43,5/43,5	50,1/50,1/50,1
	D	37,7/37,7/37,6	39,0/39,0/38,9	40,3/40,3/40,3	43,3/43,3/43,2	49,4/49,4/49,3
	E/F	37,5/37,5/37,4	38,6/38,6/38,5	39,7/39,7/39,7	42,2/42,2/42,1	47,7/47,6/47,6
700	A	38,8/38,8/38,8	39,9/39,9/39,9	41,5/41,5/41,5	45,0/45,0/44,9	52,3/52,3/52,2
	B	38,2/38,2/38,2	39,3/39,3/39,3	40,9/40,9/40,8	44,1/44,1/44,1	50,8/50,8/50,8
	C	37,6/37,6/37,6	38,9/38,9/38,9	40,3/40,3/40,2	43,2/43,2/43,2	49,8/49,8/49,8
	D	37,4/37,4/37,4	38,7/38,7/38,7	40,1/40,0/40,0	43,0/43,0/43,0	49,1/49,1/49,0
	E/F	37,2/37,2/37,2	38,3/38,3/38,3	39,4/39,4/39,4	41,9/41,9/41,9	47,3/47,3/47,3
NR Not recommended						

Annex C (informative)

Allowable depths of cover for pipes conforming to ISO 7186

C.1 Allowable depth of cover for pressure pipe conforming to ISO 7186

The pressure pipes specified in ISO 7186 are in accordance with the preferred classes of ISO 2531, i.e. DN 80 to DN 200 (C40), DN 250 to DN 400 (C30) and DN 450 to DN 2 600 (C25). As such, the depths of cover are as detailed in Annex B and reference should be made to the relevant tables (in Annex B) for the respective pressure classes.

C.2 Allowable depths of cover for gravity pipes conforming to ISO 7186

Tables C.1 and C.2 show the allowable depth of cover calculated from the equations and data of Clause 6, assuming three different values of β , six soil groups and five different trench types.

NOTE The E' value of 0 has been taken for soil groups E and F; this is a limit case which can occur in soils of very poor load-bearing capacity and/or in uncompacted, very cohesive soils.

For Tables C.1 and C.2:

- a) minimum allowable depth of cover is 1 m. For depths of cover less than this, further consideration may be necessary;
- b) NR stands for “not recommended”.

**Table C.1 — Allowable depths of cover for gravity pipes conforming to ISO 7186 —
Cement mortar lining**

DN	Soil group	Allowable depth of cover m ($\beta = 0,5/0,75/1,5$)				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
80	A	20,5/20,5/20,4	21,1/21,1/21,0	22,2/22,2/22,1	24,6/24,6/24,5	29,5/29,4/29,4
	B	19,9/19,8/19,8	20,4/20,4/20,3	21,5/21,5/21,4	23,6/23,6/23,5	27,8/27,8/27,7
	C	19,2/19,2/19,1	20,0/20,0/19,9	20,8/20,8/20,7	22,6/22,6/22,5	26,7/26,6/26,6
	D	19,0/19,0/18,9	19,8/19,7/19,7	20,6/20,5/20,5	22,4/22,3/22,3	25,8/25,8/25,7
	E/F	18,8/18,7/18,7	19,3/19,3/19,2	19,9/19,8/19,8	21,1/21,1/21,0	23,9/23,8/23,8
100	A	14,8/14,8/14,7	15,2/15,2/15,1	16,2/16,2/16,1	18,5/18,4/18,4	22,9/22,9/22,8
	B	14,0/14,0/13,8	14,4/14,4/14,3	15,4/15,4/15,3	17,3/17,2/17,1	20,9/20,8/20,8
	C	13,2/13,1/13,0	13,8/13,8/13,7	14,5/14,5/14,4	16,1/16,0/15,9	19,5/19,5/19,4
	D	12,9/12,9/12,8	13,6/13,5/13,4	14,2/14,2/14,1	15,8/15,7/15,6	18,5/18,5/18,4
	E/F	12,6/12,6/12,5	13,0/13,0/12,9	13,4/13,4/13,2	14,2/14,2/14,1	16,1/16,1/16,0

Table C.1 (continued)

DN	Soil group	Allowable depth of cover				
		m ($\beta = 0,5/0,75/1,5$)				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
125	A	10,9/10,8/10,7	11,2/11,2/11,0	12,2/12,2/12,1	14,5/14,5/14,4	18,9/18,9/18,8
	B	9,9/9,8/9,7	10,2/10,1/10,0	11,2/11,1/11,0	13,0/13,0/12,9	16,4/16,4/16,3
	C	8,9/8,9/8,7	9,5/9,5/9,3	10,1/10,1/9,9	11,5/11,5/11,4	14,7/14,7/14,6
	D	8,6/8,5/8,3	9,2/9,1/8,9	9,8/9,7/9,6	11,2/11,1/11,0	13,5/13,4/13,3
	E/F	8,2/8,2/8,0	8,5/8,4/8,2	8,7/8,7/8,5	9,3/9,2/9,1	10,5/10,5/10,3
150	A	8,9/8,8/8,6	9,1/9,1/8,9	10,2/10,2/10,0	12,6/12,6/12,5	17,3/17,2/17,2
	B	7,7/7,6/7,4	7,9/7,9/7,7	9,0/8,9/8,9	10,9/10,8/10,7	14,3/14,3/14,2
	C	6,5/6,4/6,2	7,1/7,0/6,8	7,7/7,7/7,5	9,1/9,1/8,9	12,3/12,3/12,2
	D	6,1/6,0/5,8	6,7/6,6/6,4	7,3/7,3/7,0	8,7/8,6/8,5	10,8/10,8/10,7
	E/F	5,7/5,6/5,3	5,9/5,8/5,5	6,1/6,0/5,7	6,5/6,4/6,1	7,3/7,3/7,1
200	A	6,0/5,9/5,7	6,2/6,1/5,8	7,3/7,2/7,0	9,7/9,6/9,5	14,2/14,2/14,1
	B	4,7/4,6/4,2	4,8/4,7/4,4	5,9/5,8/5,6	7,8/7,7/7,5	11,0/10,9/10,8
	C	3,3/3,2/2,4	3,9/3,8/3,3	4,5/4,4/4,0	5,8/5,7/5,5	8,8/8,7/8,6
	D	2,9/2,7/NR	3,4/3,3/2,6	4,0/3,9/3,4	5,3/5,2/4,9	7,2/7,1/6,9
	E/F	2,4/2,1/NR	2,5/2,2/NR	2,6/2,3/NR	2,8/2,6/NR	3,2/3,1/2,2
250	A	6,2/6,1/5,8	6,3/6,3/6,0	7,4/7,4/7,2	9,9/9,8/9,7	14,4/14,4/14,3
	B	4,8/4,7/4,4	5,0/4,9/4,6	6,1/6,0/5,7	7,9/7,9/7,7	11,2/11,1/11,0
	C	3,5/3,3/2,7	4,1/3,9/3,5	4,7/4,6/4,2	6,0/5,9/5,6	9,0/8,9/8,8
	D	3,0/2,8/NR	3,6/3,5/2,9	4,2/4,1/3,7	5,5/5,4/5,1	7,3/7,3/7,1
	E/F	2,5/2,3/NR	2,6/2,4/NR	2,7/2,5/NR	3,0/2,8/NR	3,4/3,3/2,6
300	A	6,3/6,2/5,9	6,4/6,4/6,1	7,6/7,5/7,3	10,0/9,9/9,8	14,5/14,5/14,4
	B	4,9/4,8/4,5	5,1/5,0/4,7	6,2/6,1/5,9	8,0/8,0/7,8	11,3/11,2/11,1
	C	3,6/3,5/2,9	4,2/4,1/3,6	4,8/4,7/4,3	6,1/6,0/5,8	9,1/9,1/8,9
	D	3,1/3,0/2,1	3,7/3,6/3,1	4,3/4,2/3,8	5,6/5,5/5,2	7,5/7,4/7,2
	E/F	2,7/2,4/NR	2,8/2,6/NR	2,9/2,7/NR	3,1/2,9/1,9	3,6/3,4/2,8
350	A	6,6/6,5/6,2	6,7/6,7/6,5	7,9/7,8/7,7	10,4/10,4/10,2	15,1/15,1/15,0
	B	5,2/5,1/4,8	5,4/5,3/5,0	6,5/6,4/6,2	8,4/8,4/8,2	11,8/11,7/11,6
	C	3,8/3,7/3,2	4,4/4,3/3,9	5,1/5,0/4,6	6,4/6,3/6,1	9,5/9,5/9,3
	D	3,4/3,2/2,5	4,0/3,8/3,4	4,6/4,5/4,1	5,9/5,8/5,6	7,8/7,8/7,6
	E/F	2,9/2,7/NR	3,0/2,8/NR	3,1/2,9/2,0	3,3/3,2/2,5	3,8/3,7/3,2
NR Not recommended						

Table C.2 — Allowable depths of cover for gravity pipes conforming to ISO 7186 — Flexible lining


DN	Soil group	Allowable depth of cover				
		m				
		$(\beta = 0,5/0,75/1,5)$				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
80	A	20,5/20,5/20,4	21,0/21,1/21,0	22,2/22,2/22,1	24,6/24,6/24,5	29,5/29,4/29,4
	B	19,9/19,8/19,8	20,4/20,4/20,3	21,5/21,5/21,4	23,6/23,6/23,5	27,8/27,8/27,7
	C	19,2/19,2/19,1	20,0/20,0/19,9	20,8/20,8/20,7	22,6/22,6/22,5	26,7/26,6/26,6
	D	19,0/19,0/18,9	19,8/19,7/19,7	20,6/20,5/20,5	22,4/22,3/22,3	25,8/25,8/25,7
	E/F	18,8/18,7/18,7	19,3/19,3/19,2	19,9/19,8/19,8	21,1/21,1/21,0	23,9/23,8/23,8
100	A	14,8/14,8/14,7	15,2/15,2/15,1	16,2/16,2/16,1	18,5/18,4/18,4	22,9/22,9/22,8
	B	14,0/14,0/13,8	14,4/14,4/14,3	15,4/15,4/15,3	17,3/17,2/17,1	20,9/20,8/20,8
	C	13,2/13,1/13,0	13,8/13,8/13,7	14,5/14,5/14,4	16,1/16,0/15,9	19,5/19,5/19,4
	D	12,9/12,9/12,8	13,6/13,5/13,4	14,2/14,2/14,1	15,8/15,7/15,6	18,5/18,5/18,4
	E/F	12,6/12,6/12,5	13,0/13,0/12,9	13,4/13,4/13,2	14,2/14,2/14,1	16,1/16,1/16,0
125	A	10,9/10,8/10,7	11,2/11,2/11,0	12,2/12,2/12,1	14,5/14,5/14,4	18,9/18,9/18,8
	B	9,9/9,8/9,7	10,2/10,1/10,0	11,2/11,1/11,0	13,0/13,0/12,9	16,4/16,4/16,3
	C	8,9/8,9/8,7	9,5/9,5/9,3	10,1/10,1/9,9	11,5/11,5/11,4	14,7/14,7/14,6
	D	8,6/8,5/8,3	9,2/9,1/8,9	9,8/9,7/9,6	11,2/11,1/11,0	13,5/13,4/13,3
	E/F	8,2/8,2/8,0	8,5/8,4/8,2	8,7/8,7/8,5	9,3/9,2/9,1	10,5/10,5/10,3
150	A	8,9/8,8/8,6	9,1/9,1/8,9	10,2/10,2/10,0	12,6/12,6/12,5	17,3/17,2/17,2
	B	7,7/7,6/7,4	7,9/7,9/7,7	9,0/8,9/8,8	10,9/10,8/10,7	14,3/14,3/14,2
	C	6,5/6,4/6,2	7,1/7,0/6,8	7,7/7,7/7,5	9,1/9,1/8,9	12,3/12,3/12,2
	D	6,1/6,0/5,8	6,7/6,6/6,4	7,3/7,3/7,0	8,7/8,6/8,5	10,8/10,8/10,7
	E/F	5,7/5,6/5,3	5,9/5,8/5,5	6,1/6,0/5,7	6,5/6,4/6,1	7,3/7,3/7,1
200	A	7,3/7,2/7,0	7,5/7,4/7,2	8,8/8,7/8,6	11,7/11,6/11,5	17,1/17,1/17,0
	B	5,7/5,6/5,3	5,9/5,8/5,5	7,2/7,1/6,9	9,4/9,3/9,2	13,2/13,2/13,1
	C	4,1/4,0/3,5	4,8/4,7/4,3	5,5/5,4/5,1	7,0/7,0/6,8	10,6/10,6/10,4
	D	3,6/3,4/2,8	4,2/4,1/3,7	5,0/4,8/4,5	6,5/6,4/6,1	8,6/8,6/8,4
	E/F	3,0/2,8/NR	3,1/2,9/2,0	3,2/3,1/2,2	3,5/3,3/2,7	4,0/3,9/3,4
250	A	7,6/7,6/7,4	7,9/7,8/7,6	9,2/9,2/9,0	12,2/12,1/12,0	17,7/17,7/17,6
	B	6,0/6,0/5,7	6,2/6,1/5,9	7,5/7,5/7,3	9,8/9,7/9,6	13,8/13,7/13,6
	C	4,4/4,3/3,9	5,1/5,0/4,7	5,8/5,8/5,5	7,4/7,4/7,2	11,1/11,0/10,9
	D	3,9/3,7/3,2	4,6/4,4/4,1	5,3/5,2/4,9	6,8/6,8/6,5	9,1/9,0/8,9
	E/F	3,3/3,1/2,4	3,4/3,3/2,6	3,5/3,4/2,8	3,8/3,6/3,1	4,3/4,2/3,8
300	A	7,9/7,8/7,6	8,1/8,1/7,9	9,5/9,4/9,3	12,5/12,5/12,4	18,2/18,2/18,1
	B	6,3/6,2/5,9	6,5/6,4/6,1	7,8/7,7/7,5	10,1/10,1/9,9	14,1/14,1/14,0
	C	4,6/4,5/4,1	5,3/5,2/4,9	6,1/6,0/5,7	7,7/7,6/7,4	11,4/11,4/11,0
	D	4,1/3,9/3,5	4,8/4,7/4,3	5,5/5,4/5,1	7,1/7,0/6,8	9,4/9,3/9,2
	E/F	3,5/3,3/2,7	3,6/3,5/2,9	3,7/3,6/3,1	4,0/3,9/3,4	4,6/4,5/4,1

Table C.2 (continued)

DN	Soil group	Allowable depth of cover				
		m ($\beta = 0,5/0,75/1,5$)				
		Type 1 trench	Type 2 trench	Type 3 trench	Type 4 trench	Type 5 trench
350	A	8,1/8,0/7,8	8,3/8,3/8,1	9,7/9,7/9,5	12,8/12,7/12,6	18,5/18,5/18,4
	B	6,4/6,4/6,1	6,6/6,6/6,3	8,0/7,9/7,8	10,3/10,3/10,2	14,4/14,4/14,3
	C	4,8/4,7/4,3	5,5/5,4/5,1	6,3/6,2/5,9	7,9/7,8/7,6	11,7/11,7/11,5
	D	4,2/4,1/3,7	4,9/4,8/4,5	5,7/5,6/5,3	7,3/7,2/7,0	9,6/9,6/9,4
	E/F	3,7/3,5/3,0	3,8/3,6/3,1	3,9/3,8/3,3	4,2/4,1/3,6	4,8/4,7/4,3
NR Not recommended						

Annex D (informative)

Trench types

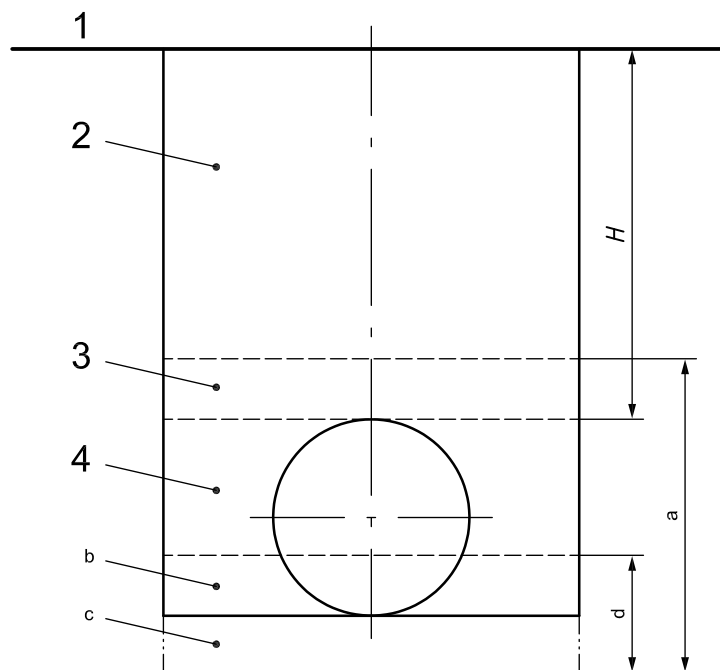

Key

- 1 surface
- 2 main backfill
- 3 initial backfill
- 4 side fill
- H depth of cover
- a Embedment.
- b Upper bedding.
- c Lower bedding.
- d Bedding.

Figure D.1 — Trench types

The trench types are the following:

- a) trench type 1: embedment dumped;
- b) trench type 2: embedment with very light compaction, greater than 75 % standard Proctor density;
- c) trench type 3: embedment with light compaction, greater than 80 % standard Proctor density;
- d) trench type 4: embedment with medium compaction, greater than 85 % standard Proctor density;
- e) trench type 5: embedment with high compaction, greater than 90 % standard Proctor density.

NOTE Pipes are normally placed on a flat-bottomed trench when a suitable uniform support can be achieved; in other cases, a layer of loose soil is used as lower bedding.

Annex E (informative)

Soil classification

The following soil groups classify different soils for embedments, i.e. soils which are used for placement in the trench surrounding the pipe, compacted or uncompacted, to provide support for the pipeline. These groups classify naturally occurring soils as well as manufactured materials. The groups are also for use in classifying undisturbed trench wall materials.

- a) Soil group A: angular graded stone (6 mm to 40 mm), also including a number of fill materials which have regional significance, such as crushed stone, crushed gravel, pea gravel and crushed shells.
- b) Soil group B: coarse; grained soils with little or no fines. No particles larger than 40 mm.
- c) Soil group C: coarse; grained soils with fines and fine-grained soils with medium to no plasticity, with more than 25 % coarse particles, liquid limit less than 50 %.
- d) Soil group D: fine; grained soils with medium to no plasticity, with less than 25 % coarse particles, liquid limit less than 50 %.
- e) Soil group E: fine; grained soils with medium to high plasticity, liquid limit greater than 50 %.
- f) Soil group F: organic soils.

Bibliography

- [1] ISO 6708, *Pipework components — Definition and selection of DN (nominal size)*
- [2] ISO 10804, *Restrained joint systems for ductile iron pipelines — Design rules and type testing*
- [3] AASHTO T99-10, *Standard Method of Test for Moisture-Density Relations of Soils Using a 2.5-kg (5.5-lb) Rammer and a 305-mm (12-in.) Drop²⁾*

2) American Association of State Highway and Transportation Officials, 444 North Capitol Street NW, Suite 249, Washington, DC 20001, USA.

British Standards Institution (BSI)

BSI is the national body responsible for preparing British Standards and other standards-related publications, information and services.

BSI is incorporated by Royal Charter. British Standards and other standardization products are published by BSI Standards Limited.

About us

We bring together business, industry, government, consumers, innovators and others to shape their combined experience and expertise into standards-based solutions.

The knowledge embodied in our standards has been carefully assembled in a dependable format and refined through our open consultation process. Organizations of all sizes and across all sectors choose standards to help them achieve their goals.

Information on standards

We can provide you with the knowledge that your organization needs to succeed. Find out more about British Standards by visiting our website at bsigroup.com/standards or contacting our Customer Services team or Knowledge Centre.

Buying standards

You can buy and download PDF versions of BSI publications, including British and adopted European and international standards, through our website at bsigroup.com/shop, where hard copies can also be purchased.

If you need international and foreign standards from other Standards Development Organizations, hard copies can be ordered from our Customer Services team.

Subscriptions

Our range of subscription services are designed to make using standards easier for you. For further information on our subscription products go to bsigroup.com/subscriptions.

With **British Standards Online (BSOL)** you'll have instant access to over 55,000 British and adopted European and international standards from your desktop. It's available 24/7 and is refreshed daily so you'll always be up to date.

You can keep in touch with standards developments and receive substantial discounts on the purchase price of standards, both in single copy and subscription format, by becoming a **BSI Subscribing Member**.

PLUS is an updating service exclusive to BSI Subscribing Members. You will automatically receive the latest hard copy of your standards when they're revised or replaced.

To find out more about becoming a BSI Subscribing Member and the benefits of membership, please visit bsigroup.com/shop.

With a **Multi-User Network Licence (MUNL)** you are able to host standards publications on your intranet. Licences can cover as few or as many users as you wish. With updates supplied as soon as they're available, you can be sure your documentation is current. For further information, email bsmusales@bsigroup.com.

BSI Group Headquarters

389 Chiswick High Road London W4 4AL UK

Revisions

Our British Standards and other publications are updated by amendment or revision.

We continually improve the quality of our products and services to benefit your business. If you find an inaccuracy or ambiguity within a British Standard or other BSI publication please inform the Knowledge Centre.

Copyright

All the data, software and documentation set out in all British Standards and other BSI publications are the property of and copyrighted by BSI, or some person or entity that owns copyright in the information used (such as the international standardization bodies) and has formally licensed such information to BSI for commercial publication and use. Except as permitted under the Copyright, Designs and Patents Act 1988 no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means – electronic, photocopying, recording or otherwise – without prior written permission from BSI. Details and advice can be obtained from the Copyright & Licensing Department.

Useful Contacts:

Customer Services

Tel: +44 845 086 9001

Email (orders): orders@bsigroup.com

Email (enquiries): cservices@bsigroup.com

Subscriptions

Tel: +44 845 086 9001

Email: subscriptions@bsigroup.com

Knowledge Centre

Tel: +44 20 8996 7004

Email: knowledgecentre@bsigroup.com

Copyright & Licensing

Tel: +44 20 8996 7070

Email: copyright@bsigroup.com



...making excellence a habit.™