

Gaseous fire-extinguishing systems — Physical properties and system design —

Part 14: IG-55 extinguishant

ICS 13.220.10

National foreword

This British Standard reproduces verbatim ISO 14520-14:2005 and implements it as the UK national standard. It supersedes BS ISO 14520-14:2000 which is withdrawn.

The UK participation in its preparation was entrusted by Technical Committee FSH/18, Fixed firefighting equipment, to Subcommittee FSH/18/6, Gaseous extinguishing media and systems, which has the responsibility to:

- aid enquirers to understand the text;
- present to the responsible international/European committee any enquiries on the interpretation, or proposals for change, and keep UK interests informed;
- monitor related international and European developments and promulgate them in the UK.

A list of organizations represented on this subcommittee can be obtained on request to its secretary.

Cross-references

The British Standards which implement international publications referred to in this document may be found in the *BSI Catalogue* under the section entitled “International Standards Correspondence Index”, or by using the “Search” facility of the *BSI Electronic Catalogue* or of British Standards Online.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

Compliance with a British Standard does not of itself confer immunity from legal obligations.

Summary of pages

This document comprises a front cover, an inside front cover, the ISO title page, pages ii and iii, a blank page, pages 1 to 7 and a back cover.

The BSI copyright notice displayed in this document indicates when the document was last issued.

Amendments issued since publication

| Amd. No. | Date | Comments |
|----------|------|----------|
| | | |
| | | |
| | | |
| | | |

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 31 May 2006

© BSI 2006

INTERNATIONAL
STANDARD

ISO
14520-14

Second edition
2005-12-15

**Gaseous fire-extinguishing systems —
Physical properties and system design —**

Part 14:
IG-55 extinguishant

*Systemes d'extinction d'incendie utilisant des agents gazeux —
Proprietés physiques et conception des systemes —*

Partie 14: Agent extincteur IG-55



Reference number
ISO 14520-14:2005(E)

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 2.

The main task of technical committees is to prepare International Standards. Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

ISO 14520-14 was prepared by Technical Committee ISO/TC 21, *Equipment for fire protection and fire fighting*, Subcommittee SC 8, *Gaseous media and firefighting systems using gas*.

This second edition cancels and replaces the first edition (ISO 14520-14:2000), which has been technically revised.

ISO 14520 consists of the following parts, under the general title *Gaseous fire-extinguishing systems — Physical properties and system design*:

- *Part 1: General requirements*
- *Part 2: CF₃I extinguishant*
- *Part 5: FK-5-1-12 extinguishant*
- *Part 6: HCFC Blend A extinguishant*
- *Part 8: HFC 125 extinguishant*
- *Part 9: HFC 227ea extinguishant*
- *Part 10: HFC 23 extinguishant*
- *Part 11: HFC 236fa extinguishant*
- *Part 12: IG-01 extinguishant*
- *Part 13: IG-100 extinguishant*
- *Part 14: IG-55 extinguishant*
- *Part 15: IG-541 extinguishant*

Parts 3, 4 and 7, which dealt with FC-2-1-8, FC-3-1-10 and HCFC 124 extinguishants, respectively, have been withdrawn, as these types are no longer manufactured.

Gaseous fire-extinguishing systems — Physical properties and system design —

Part 14: IG-55 extinguishant

1 Scope

This part of ISO 14520 gives specific requirements for gaseous fire-extinguishing systems, with respect to the IG-55 extinguishant. It includes details of physical properties, specification, usage and safety aspects and is applicable to systems operating at nominal pressures of 150 bar, 200 bar and 300 bar, at 15 °C. This does not preclude the use of other systems; however, design data for other pressures were not available at time of publication.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 14520-1:—¹⁾, *Gaseous fire-extinguishing systems — Physical properties and system design — Part 1: General requirements*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in ISO 14520-1 apply.

4 Characteristics and uses

4.1 General

Extinguishant IG-55 shall comply with the specification according to Table 1.

IG-55 is a colourless, odourless, electrically non-conductive gas with a density approximately the same as that of air. It is an inert gas mixture consisting nominally of 50 % argon and 50 % nitrogen with the following mixture specification.

- a) Argon: range of (50 ± 5) %.
- b) Nitrogen: range of (50 ± 5) %.

The physical properties are given in Table 2.

IG-55 extinguishes fires by a reduction of the oxygen concentration in the atmosphere of the hazard enclosure.

1) To be published. (Revision of ISO 14520-1:2000)

Table 1 — Specification for IG-55

| Property | Requirement | |
|---|-----------------------|-----------------------|
| | Argon | Nitrogen |
| Purity | > 99,9 % | > 99,9 % |
| Water content | < 15×10^{-6} | < 10×10^{-6} |
| Only principal contaminants are shown. Other measurements may include hydrocarbons, CO, NO, NO ² , CO ² , etc. Most are < 20×10^{-6} . | | |

Table 2 — Physical properties of IG-55

| Property | Unit | Value |
|--|--|-------|
| Molecular mass | — | 33,98 |
| Boiling point at 1,013 bar (absolute) ^a | °C | — |
| Freezing point | °C | — |
| Critical temperature | °C | — |
| Critical pressure | bar abs ^a | — |
| Critical volume | cm ³ /mol | — |
| Critical density | kg/m ³ | — |
| Vapour pressure 20 °C | bar abs ^a | — |
| Liquid density 20 °C | kg/m ³ | — |
| Saturated vapour density 20 °C | kg/m ³ | — |
| Specific volume of superheated vapour at 1,013 bar and 20 °C | m ³ /kg | 0,708 |
| Chemical formulas | N ₂ 50 % by volume Ar 50 % by volume | |
| Chemical names | Nitrogen Argon | |
| ^a 1 bar = 0,1 MPa = 10 ⁵ Pa; 1 MPa = 1 N/mm ² . | | |

4.2 Use of IG-55 systems

IG-55 total flooding systems may be used for extinguishing fires of all classes within the limits specified in ISO 14520-1:—²⁾, Clause 4.

The specific vapour volumes are shown in Table 3. The quantity, Q , of agent required per volume of protected space is determined using the equation in Table 3.

The extinguishing concentrations and design concentrations for *n*-heptane and Surface Class A hazards are given in Table 4, and concentrations for other fuels in Table 5.

2) To be published. (Revision of ISO 14520-1:2000)

Table 3 — IG-55 specific vapour volumes

| Temperature <i>T</i> °C | Specific vapour volume <i>S</i> m ³ /kg | Temperature <i>T</i> °C | Specific vapour volume <i>S</i> m ³ /kg |
|-------------------------------|--|-------------------------------|--|
| -40 | 0,5632 | 30 | 0,7323 |
| -35 | 0,5752 | 35 | 0,7444 |
| -30 | 0,5873 | 40 | 0,7564 |
| -25 | 0,5994 | 45 | 0,7685 |
| -20 | 0,6115 | 50 | 0,7806 |
| -15 | 0,6236 | 55 | 0,7927 |
| -10 | 0,6356 | 60 | 0,8048 |
| -5 | 0,6477 | 65 | 0,8168 |
| 0 | 0,6598 | 70 | 0,8289 |
| 5 | 0,6719 | 75 | 0,8410 |
| 10 | 0,6840 | 80 | 0,8531 |
| 15 | 0,6960 | 85 | 0,8652 |
| 20 | 0,7081 | 90 | 0,8772 |
| 25 | 0,7202 | 95 | 0,8893 |
| 30 | 0,7323 | 100 | 0,9014 |

This information refers only to IG-55, and may not represent any other products containing nitrogen and argon as components.

The quantity Q (in cubic metres) of agent required at a reference temperature of 20 °C and a pressure of 1,013 bar per cubic metre of protected volume to produce the indicated concentration at the temperature specified is calculated from:

$$Q_R = m \cdot S_R$$

where S_R is the specific reference volume (in cubic metres per kilogram); i.e. the specific vapour volume at the filling reference temperature for superheated IG-55 vapour at a pressure of 1,013 bar which may be approximated by the formula:

$$S_R = k_1 + k_2 \cdot T_R$$

where $k_1 = 0,6598$; $k_2 = 0,002416$; T_R is the reference temperature (in degrees Celsius), i.e. filling temperature (20 °C in the table);

$$m = \frac{V}{S} \cdot \ln\left(\frac{100}{100 - c}\right)$$

V is the net volume of hazard (in cubic metres); i.e. the enclosed volume minus the fixed structures impervious to extinguishant;

T is the temperature (in degrees Celsius); i.e. the design temperature in the hazard area;

S is the specific volume (in cubic metres per kilogram); the specific volume of superheated IG-55 vapour at a pressure of 1,013 bar may be approximated by

$$S = k_1 + k_2 \cdot T$$

c is the concentration (in percent); i.e. the volumetric concentration of IG-55 in air at the temperature indicated, and a pressure of 1,013 bar absolute.

Table 4 — IG-55 reference extinguishing and design concentrations

| Fuel | Extinguishment % by volume | Minimum design % by volume |
|---|-------------------------------|-------------------------------|
| Class B | | |
| Heptane (cup burner) | 36,5 | 47,5 |
| Heptane (room test) | 30,2 | |
| Surface Class A | | |
| Wood crib | 28,7 | 40,3 |
| PMMA | 30,7 | |
| PP | 29,3 | |
| ABS | 31,0 | |
| Higher Hazard Class A | a | 45,1 |
| <p>The extinguishment values for the Class B and the Surface Class A fuels are determined by testing in accordance with ISO 14520-1:—³⁾, Annexes B and C.</p> <p>The minimum design concentration for the Class B fuel is the higher value of the heptane cup burner or room test heptane extinguishment concentration multiplied by 1,3.</p> <p>The minimum design concentration for Surface Class A fuel is the highest value of the wood crib, PMMA, PP or ABS extinguishment concentrations multiplied by 1,3. In the absence of any of the 4 extinguishment values, the minimum design concentration for Surface Class A shall be that of Higher Hazard Class A.</p> <p>See ISO 14520-1:—³⁾, 7.5.1.3, for guidance on Class A fuels.</p> <p>The extinguishing and design concentrations for room-scale test fires are for informational purposes only. Lower and higher extinguishing concentrations than those shown for room-scale test fires may be achieved and allowed when validated by test reports from internationally recognized laboratories.</p> | | |
| <p>^a The minimum design concentration for Higher Hazard Class A fuels shall be the higher of the surface Class A or 95 % of the Class B minimum design concentration.</p> | | |

Table 5 — IG-55 extinguishing and design concentrations for other fuels

| Fuel | Extinguishment % by volume | Minimum design % by volume |
|--|-------------------------------|-------------------------------|
| Ethanol | 38,9 | 50,6 |
| <i>n</i> -Hexane | 37,0 | 48,0 |
| Isooctane | 36,5 | 47,5 |
| Methyl ethyl ketone | 38,0 | 49,4 |
| Methanol | 45,4 | 59,0 |
| <i>i</i> -Propanol | 36,5 | 47,5 |
| Toluene | 36,5 | 47,5 |
| <p>Extinguishing concentrations for all Class B fuels listed were derived in accordance with ISO 14520-1:—³⁾, Annex B.</p> <p>Minimum design values have been increased to the minimum design concentration established for heptane in accordance with ISO 14520-1:—³⁾, 7.5.1.</p> | | |

3) To be published. (Revision of ISO 14520-1:2000)

5 Safety of personnel

Any hazard to personnel created by the discharge of IG-55 shall be considered in the design of the system.

Potential hazards can arise from the following:

- a) the extinguishant itself, by oxygen reduction;
- b) the combustion products of the fire.

For minimum safety requirements, see ISO 14250-1:—⁴⁾, Clause 5.

Physiological information for IG-55 is given in Table 6.

Table 6 — Physiological information for IG-55

| Property | Value % by volume |
|--|----------------------|
| No observed adverse effect level (NOAEL) | 43 |
| Lowest observed adverse effect level (LOAEL) | 52 |
| These values are based on physiological effects in human subjects of hypoxic atmospheres. These values are the functional equivalents of NOAEL and LOAEL values, and correspond to 12 % minimum oxygen for the no-effect level and 10 % minimum oxygen for the low-effect level. | |

6 System design

6.1 Fill pressure

The fill pressure of the container shall not exceed the values given in Tables 7, 8 and 9, for systems operating at 150 bar at 15 °C, 200 bar at 15 °C and 300 bar at 15 °C, respectively.

Other pressures may be used and the minimum design pressure specified accordingly.

The relationships between pressure and temperature are shown in Figure 1.

Table 7 — Storage container characteristics for IG-55 — 150 bar

| Property | Unit | Value |
|--|------------------|-------|
| Filling pressure at 15 °C | bar ^a | 150 |
| Maximum container working pressure at 50 °C | bar ^a | 178 |
| Reference should be made to Figure 1 for further data on pressure/temperature relationships. | | |
| ^a 1 bar = 0,1 MPa = 10 ⁵ Pa; 1 MPa = 1 N/mm ² . | | |

4) To be published. (Revision of ISO 14520-1:2000)

Table 8 — Storage container characteristics for IG-55 — 200 bar

| Property | Unit | Value |
|--|------------------|-------|
| Filling pressure at 15 °C | bar ^a | 200 |
| Maximum container working pressure at 50 °C | bar ^a | 240 |
| Reference should be made to Figure 1 for further data on pressure/temperature relationships. | | |
| ^a 1 bar = 0,1 MPa = 10 ⁵ Pa; 1 MPa = 1 N/mm ² . | | |

Table 9 — Storage container characteristics for IG-55 — 300 bar

| Property | Unit | Value |
|--|------------------|-------|
| Filling pressure at 15 °C | bar ^a | 300 |
| Maximum container working pressure at 50 °C | bar ^a | 366 |
| Reference should be made to Figure 1 for further data on pressure/temperature relationships. | | |
| ^a 1 bar = 0,1 MPa = 10 ⁵ Pa; 1 MPa = 1 N/mm ² . | | |

6.2 Superpressurization

Containers for IG-55 are not superpressurized.

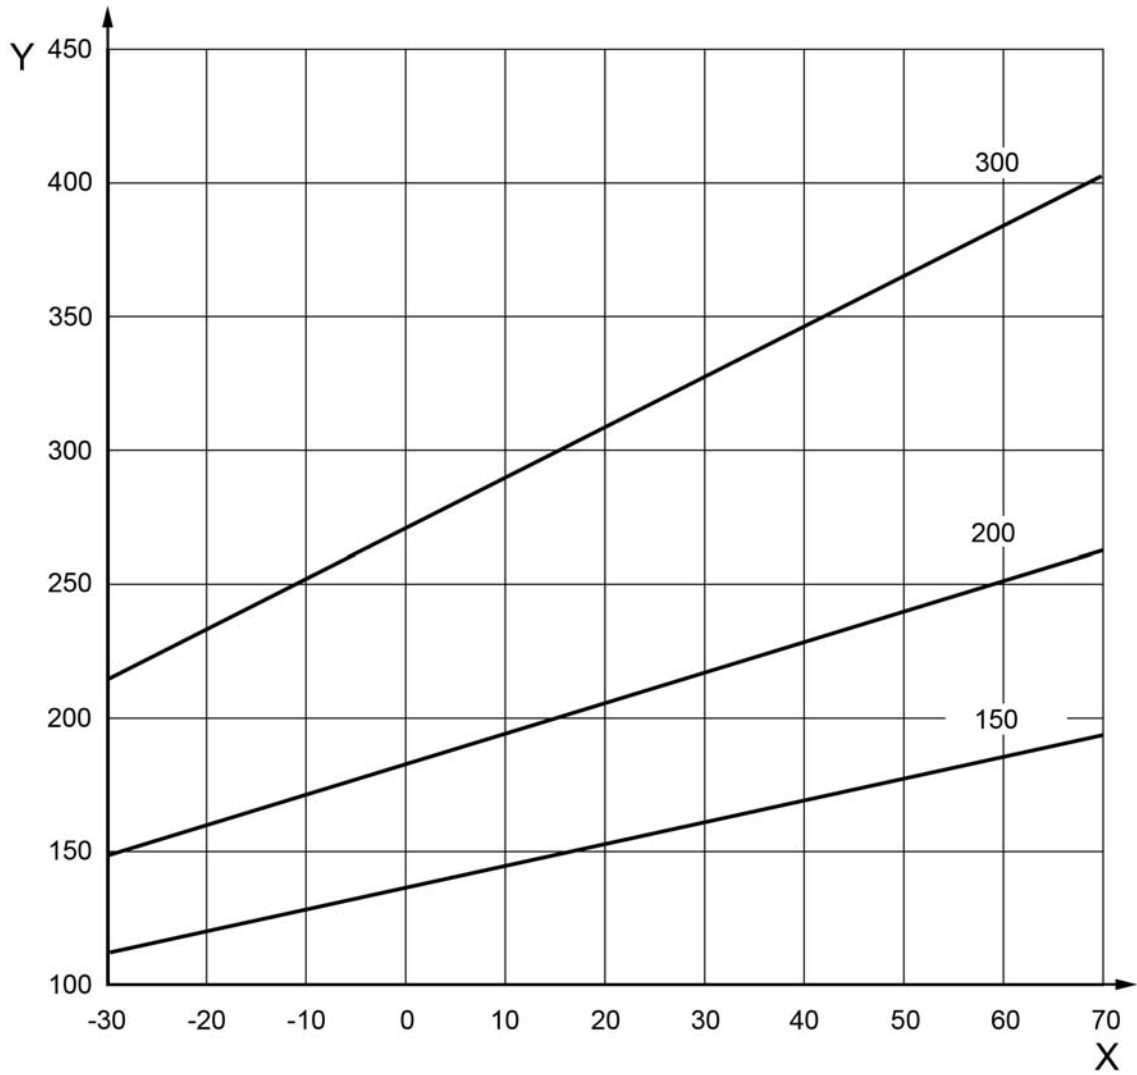
6.3 Extinguishant quantity

The quantity of extinguishant shall be the minimum required to achieve the design concentration within the hazard volume at the minimum expected temperature, determined using Table 3 and the method according to ISO 14250-1:—⁵⁾, 7.6.

The design concentrations shall be those specified for relevant hazards in Tables 4 and 5, including a 1,3 safety factor on the extinguishing concentration.

Consideration should be given to increasing this for particular hazards, while seeking advice from the relevant authority.

5) To be published. (Revision of ISO 14520-1:2000)

**Key**

X temperature, °C
Y pressure, bar

Figure 1 — Temperature/pressure graph for IG-55 pressurized to 150 bar, 200 bar and 300 bar at 15 °C

BSI — British Standards Institution

BSI is the independent national body responsible for preparing British Standards. It presents the UK view on standards in Europe and at the international level. It is incorporated by Royal Charter.

Revisions

British Standards are updated by amendment or revision. Users of British Standards should make sure that they possess the latest amendments or editions.

It is the constant aim of BSI to improve the quality of our products and services. We would be grateful if anyone finding an inaccuracy or ambiguity while using this British Standard would inform the Secretary of the technical committee responsible, the identity of which can be found on the inside front cover.
Tel: +44 (0)20 8996 9000. Fax: +44 (0)20 8996 7400.

BSI offers members an individual updating service called PLUS which ensures that subscribers automatically receive the latest editions of standards.

Buying standards

Orders for all BSI, international and foreign standards publications should be addressed to Customer Services. Tel: +44 (0)20 8996 9001.
Fax: +44 (0)20 8996 7001. Email: orders@bsi-global.com. Standards are also available from the BSI website at <http://www.bsi-global.com>.

In response to orders for international standards, it is BSI policy to supply the BSI implementation of those that have been published as British Standards, unless otherwise requested.

Information on standards

BSI provides a wide range of information on national, European and international standards through its Library and its Technical Help to Exporters Service. Various BSI electronic information services are also available which give details on all its products and services. Contact the Information Centre.
Tel: +44 (0)20 8996 7111. Fax: +44 (0)20 8996 7048. Email: info@bsi-global.com.

Subscribing members of BSI are kept up to date with standards developments and receive substantial discounts on the purchase price of standards. For details of these and other benefits contact Membership Administration.
Tel: +44 (0)20 8996 7002. Fax: +44 (0)20 8996 7001.
Email: membership@bsi-global.com.

Information regarding online access to British Standards via British Standards Online can be found at <http://www.bsi-global.com/bsonline>.

Further information about BSI is available on the BSI website at <http://www.bsi-global.com>.

Copyright

Copyright subsists in all BSI publications. BSI also holds the copyright, in the UK, of the publications of the international standardization bodies. Except as permitted under the Copyright, Designs and Patents Act 1988 no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means – electronic, photocopying, recording or otherwise – without prior written permission from BSI.

This does not preclude the free use, in the course of implementing the standard, of necessary details such as symbols, and size, type or grade designations. If these details are to be used for any other purpose than implementation then the prior written permission of BSI must be obtained.

Details and advice can be obtained from the Copyright & Licensing Manager.
Tel: +44 (0)20 8996 7070. Fax: +44 (0)20 8996 7553.
Email: copyright@bsi-global.com.