

BS ISO 22158:2011



BSI Standards Publication

Input/output protocols and electronic interfaces for water meters — Requirements

bsi.

...making excellence a habit.™

National foreword

This British Standard is the UK implementation of ISO 22158:2011.

The UK participation in its preparation was entrusted to Technical Committee CPI/30/7, Volume flow-rate methods.

A list of organizations represented on this committee can be obtained on request to its secretary.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

© BSI 2011

ISBN 978 0 580 56128 3

ICS 91.140.60

Compliance with a British Standard cannot confer immunity from legal obligations.

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 31 May 2011.

Amendments issued since publication

Date	Text affected
------	---------------

**Input/output protocols and electronic
interfaces for water meters —
Requirements**

*Protocoles d'entrée/sortie et interfaces électroniques pour compteurs
d'eau — Exigences*





COPYRIGHT PROTECTED DOCUMENT

© ISO 2011

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
Case postale 56 • CH-1211 Geneva 20
Tel. + 41 22 749 01 11
Fax + 41 22 749 09 47
E-mail copyright@iso.org
Web www.iso.org

Published in Switzerland

Contents

Page

Foreword	iv
Introduction.....	v
1 Scope	1
2 Normative references	1
3 Terms and definitions	2
4 Pulse output water meters —type A.....	3
4.1 General	3
4.2 Pulse output modes	3
4.3 Pulse waveform definitions	3
4.4 Pulse data set types	3
4.5 Signal output types	8
4.6 Pulse configuration	8
5 Non-addressable water meters —type B	8
5.1 General	8
5.2 Non-addressable output modes	8
5.3 Non-addressable data set types	9
5.4 Non-addressable V-frame data protocol	10
5.5 Non-addressable two-wire asynchronous mode for reading via an inductive pad and probe.....	12
5.6 Non-addressable three-wire asynchronous mode for direct connection to the transponder/bus node.....	13
5.7 Non-addressable two-wire synchronous mode for reading via an inductive pad and probe	14
5.8 Non-addressable three-wire synchronous mode intended for direct connection to the transponder/bus node.....	15
5.9 Non-addressable two-wire bidirectional asynchronous mode for reading via optocouplers and probe	15
5.10 Compatibility statement.....	17
6 Addressable water meters —type C	17
6.1 General	17
6.2 Output mode 1, based on M-bus technology	17
6.3 Output mode 2, based on Dialog technology	29
6.4 Output mode 3, based on NABS technology.....	39
Annex A (informative) Designation of registration authority	51
Bibliography.....	52

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 2.

The main task of technical committees is to prepare International Standards. Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

ISO 22158 was prepared by Technical Committee ISO/TC 30, *Measurement of fluid flow in closed conduits*, Subcommittee SC 7, *Volume methods including water meters*.

Introduction

The need to be able to communicate with metered systems has become apparent. This International Standard seeks to address the issues associated with water meters, but can be used in conjunction with other metered systems such as gas and electricity supply that utilize common interfaces and protocols.

During recent years, an increasing number of electronic devices have been introduced into water meters, e.g.:

- pulse output systems;
- absolute encoded systems;
- bidirectional addressable bus systems.

Currently, there is no clear definition of either hardware interfaces or the protocols of such systems and this International Standard attempts to solve the problems arising from this.

Existing technology for water meter communications can be split into three distinct groups, which are defined as follows:

- pulse output water meters —referred to in this International Standard as type A;
- non-addressable water meters —referred to in this International Standard as type B;
- addressable water meters —referred to in this International Standard as type C.

This International Standard describes the general requirements of the protocols and electronic interfaces for water meters. It is intended to provide the necessary guidance for designers of meter registers and reading equipment.

The provisions have been determined by analysing applications currently in use and by consultation within the water industry. However, the list of applications is not exhaustive.

Input/output protocols and electronic interfaces for water meters — Requirements

1 Scope

This International Standard specifies the minimum communication requirements for water meters which have the capability to exchange or provide data by means of an electronic interface.

This International Standard only specifies the interface conditions present at the electrical and electronic connections of water meters and does not prescribe any specific equipment such as transponders and inductive pads, which might be connected to the water meter for automatic meter reading or remote meter reading purposes.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 1155, *Information processing — Use of longitudinal parity to detect errors in information messages*

IEC 60870-5-1, *Telecontrol equipment and systems — Part 5: Transmission protocols — Section One: Transmission frame formats*

IEC 60870-5-2, *Telecontrol equipment and systems — Part 5: Transmission protocols — Section 2: Link transmission procedures*

IEC 60947-5-6, *Low-voltage switchgear and controlgear — Part 5-6: Control circuit devices and switching elements — DC interface for proximity sensors and switching amplifiers (NAMUR)*

EN 13757 (all parts), *Communication systems for meters and remote reading of meters*

JIS X 5001:1982, *Character structure on the transmission circuits and horizontal parity method*

NABS¹⁾, *Communication system by addressable 8-bit electronic water meters — Specifications, ver. 1.0*, 2008. Available [2011-04-27] from: <http://www.keikoren.or.jp/eng/pub.html>

M-bus²⁾, *The M-bus: A documentation Rev. 4.8*, 1997. Available [2011-04-27] at <http://www.m-bus.com>

1) Published by the Japan Water Meter Manufacturers' Association.

2) Published by the M-bus User Group.

3 Terms and definitions

For the purposes of this document, the terms and definitions given in EN 13757 (all parts) and the following apply.

3.1 interface

⟨water meters⟩ point or means of interaction between two systems

3.2 pulse

⟨water meters⟩ electronic output (generated or passive) from the interface, with pulses at increments equal to a specific defined volume

3.3 non-addressable interface device

interface device that cannot be addressed individually in a reading bus

3.4 addressable interface device

interface device that can be addressed individually in a reading bus

3.5 automatic meter reading AMR

meter reading normally involving a central computer

3.6 remote meter reading RMR

meter reading remote from the meter, not necessarily involving a central computer

3.7 switching current

current that can be carried by the switch during switching

3.8 switch closure

device providing a digital pulse (reed switch, transistor, etc.)

3.9 omnidirectional pulse data set

pulse data set where the pulses do not signify flow direction

3.10 unidirectional pulse data set

pulse data set where the pulses signify flow in one direction only

3.11 bidirectional pulse data set

pulse data set where the pulses signify flow direction

3.12 passive output

⟨water meters⟩ non-powered switching device

3.13 active output

⟨water meters⟩ powered switching device (internal or external to interface)

3.14

tamper detection

⟨water meters⟩ facility to detect attempts to corrupt the metering equipment or the data stored in it

3.15

output mode

⟨water meters⟩ electronic characteristics of a pulse

3.16

data set type

electronic characteristics of a group of pulses providing flow information

3.17

V-frame

data sets including variable length fields

4 Pulse output water meters —type A

NOTE The primary function of this output type is to provide real-time metering pulses that represent a specific unit of water passing through the meter.

4.1 General

Compatibility is defined by output modes, data set types and signal output types designated as follows.

Pulse output modes	1, 2, 3, 4, 5, 6, 7, 8
Data set types	O, U, B1, B2, N1, N2
Signal output types	N, P, T

NOTE Compatible products may be marked, e.g. " A1O" , " A2O" , A3U" , " A4UN" , " A5B2P" , " A7N2" .

Requirements for pulse output modes, pulse waveform definitions, pulse data set types and signal output types are given in 4.2 to 4.5.

4.2 Pulse output modes

Pulse output modes shall meet the requirements set out in Table 1.

4.3 Pulse waveform definitions







Pulse waveform definitions for pulse output modes A1 to A8 shall meet the requirements set out in Figures 1 to 5.

NOTE In Figures 1 to 5, the timings are illustrative.

4.4 Pulse data set types

Pulse data set types shall conform to the requirements set out in Table 2.








Table 1 — Pulse output modes for pulse output water meters (type A)


Parameter	Type							
	A1	A2	A3	A4	A5	A6	A7	A8
Character	Passive		Active		Active		Active	
Pulse (see 4.3)	 Volt-free	 Active high			or			Active current loop (see 5.2)
Engineering	Passive switch closure signal usage	power usage	Pulse self-powered	Transistor switch self-powered		Transistor switch externally-powered sensor usage	Current pulse externally-powered	
Supply voltage range	—	—	—	—	2 V to 5 V DC	5 V to 15 V DC	IEC 60947-5-6 (8,2 V DC nom. at 1 kΩ source Z)	
Switching current and voltage	3 μA to 20 mA at up to 30 V DC	3 μA to 500 mA at up to 100 V DC	—	≤20 mA ^a at 20 V DC max.	≤10 mA ^a at 20 V DC max.	≤20 mA ^a at 20 V DC max.	—	—
Off-state impedance	>10 MΩ	>10 MΩ	—	—	>10 MΩ	—	—	—
On-state impedance	<200 Ω	<150 mΩ	—	—	<500 Ω	—	—	—
Current consumption	—	—	—	—	<20 mA	—	IEC 60947-5-6 (>2,1 mA)	—
Typical data set type (see 4.4) ^b	Omnidirectional		Unidirectional		Omni-, uni- or bidirectional		Omni- or bidirectional	
Typical product type ^b	Micro- or reed-switch or solid state		Generator or piezo sensor	Piezo or magnetic sensor	Piezo, magnetic or optical sensor		Micro- or reed-switch magnetic or optical sensor	

^a In the case of signal output type T, this voltage is replaced by "power supply voltage".

^b Other types may also apply.

Table 2 — Pulse data set types for pulse output water meters


Data-set type	O	U	B1	B2	B3	N1	N2
Format	Omnidirectional	Unidirectional	Bidirectional	Bidirectional	Bidirectional	Omnidirectional	Bidirectional
Pulse(s)							
Definition	Indistinguishable direction	Specific direction	Both unidirections	Omnidirection plus direction signal	Quadrature	IEC 60947-5-6	IEC 60947-5-6 plus "transparent" modifiers

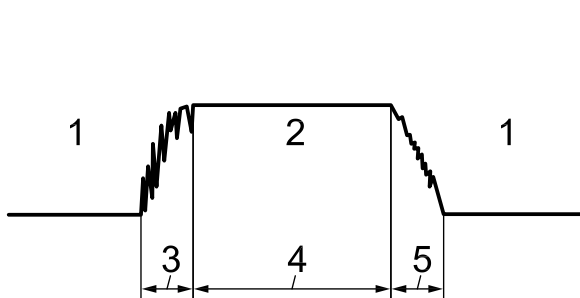

Key

- 1 switch open
- 2 switch closed
- 3 5 ms max. leading noise
- 4 25 ms min. width
- 5 5 ms max. trailing noise

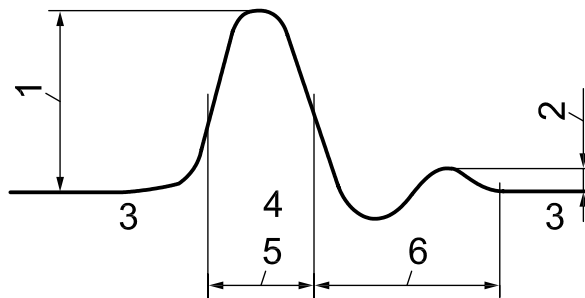
Figure 1 —Types A1 and A2



Key

- 1 3 V min. primary pulse
- 2 1 V min. secondary pulse(s)
- 3 off
- 4 on
- 5 1 ms min. width
- 6 200 ms max. ringing

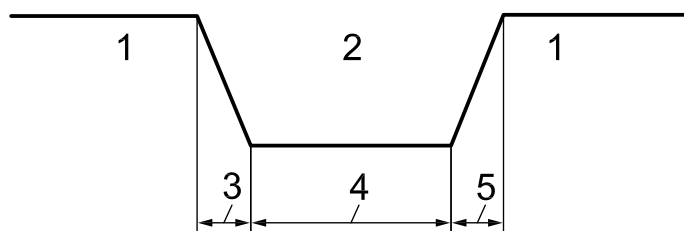Figure 2 —Type A3



Key

- 1 off
- 2 on
- 3 100 μ max. leading transition
- 4 2 ms min. width
- 5 10 ms max. trailing transition

Figure 3 —Types A4, A5 and A6

4.5 Signal output types

With the exception of data sets N1 and N2, the output signal shall be referenced to either supply rail.

The type of output shall be indicated by a suffix, as follows.

N	signal referenced to 0 volts
P	signal referenced to positive supply volts
T	totem-pole, push-pull output signal
W	floating output without polarity, not referenced signal

The suffix is used in conjunction with the data set type, e.g. ON, UP, B1T.

4.6 Pulse configuration

The signal “ set” outputs shall be inherently without reference to measurement values.

EXAMPLE Devices can have more than one “ set” of outputs and thus be marked with each compatible output type, which might or might not be different. For example, “ A1O+ A1O” indicates a single passive volt-free output device providing two signal “ sets” meeting the requirements of this International Standard. “ A6B-1A6B2” indicates an active externally powered output device providing two different bidirectional signal “ sets” meeting the requirements of this International Standard.

Where a pulse output is polarity conscious, the “ most negative” terminal should be so marked, or if it is a wire then a brown core should be used.

Tamper detection or tamper checking facilities can also be provided as a secondary function(s), using one of: cable loop-back, cable impedance-change or magnetic interference signal. These extra connections may optionally utilize the common line, but it is essential that any such use does not compromise the primary pulse function(s).

NOTE Due to the multiplicity of the conceivable pulse, power and tamper connections, it is not practical to allocate all possible core colours to functions.

5 Non-addressable water meters —type B

NOTE The primary function of this output type is to provide a data stream that identifies and reports the registered units of water passed through the meter when exclusively coupled to a reading device.

5.1 General

Compatibility is defined by output modes and data set types (using a common data protocol) designated as follows.

Output modes	1, 2, 3
Data set types	A, S1, S2

Compatible products may be compliance marked, e.g. “ B1S1” , “ B2A” , “ B3A” .

5.2 Non-addressable output modes

Output modes for non-addressable water meters shall meet the requirements set out in Table 3.

Table 3 —Output modes for non-addressable water meters (type B)

Parameter	Type		
	B1	B2	B3
Engineering	Two-wire encoded register	Three-wire encoded register	Two-wire encoded register
Signal	Unidirectional ASCII data frame protocol		Bidirectional ISO data frame protocol
Data set type (see 5.3)	Asynchronous or synchronous		Asynchronous
Supply voltage (if externally powered)	7 to 17 Vp-p AC	2,9 V to 6 V DC (asynchronous) 5 V to 12 V AC (synchronous)	—
AC supply frequency (if externally powered)	10 kHz to 30 kHz		—
Two-wire modulation depth	>10 % inductively	—	Optically isolated — not applicable
Three-wire output low voltage	—	<0,9 V with regard to “COMMON” pseudo-open collector/ open drain external pull-up resistor required	—
Current consumption	<3 mA (asynchronous) <15 mA (synchronous)		—

5.3 Non-addressable data set types

Data set types for non-addressable water meters shall meet the requirements set out in Table 4.

Table 4 —Data set types for non-addressable water meters (type B)

Parameter	Data set type		
	A	S1	S2
Communications	Asynchronous	Externally clocked synchronous	
Data rate	$\geq(300 \pm 2,25)$ bit/s	1 clock per bit, from 0 bit/s to 2 000 bit/s	1 clock per bit or 16 clocks per bit at 1 200 bit/s
Character format	1 start, 7 data (LSB first), even parity, 1 stop		
Two-wire data sense	logic 0 = carrier collapsed logic 1 = NO action	logic 0 = impulse burst logic 1 = NO action	logic 0 = biphasic change logic 1 = NO biphasic change
Three-wire data polarity	logic 0 = output LOW		logic 1 = output HIGH
Inter-character gap	≤ 6 bit times	—	—
Data frames	≥ 4 identical frames	as clocked, each frame “real-time”	
Inter-frame gap	<2 s	<200 ms	8 “stop” bits
Clock “low” definition	—	250 μ s min., 1 000 μ s max., stability ± 25 %	
Clock “high” definition	—	>1 000 μ s	
Power down conditions	>500 ms	>200 ms	

5.4 Non-addressable V-frame data protocol

5.4.1 General

The non-addressable V-frame data protocol is of variable length and has a format as follows:

V S-field [; R-field] [; A-field] [; B-field] [; C-field] [; J-field] <CR>

where

V is the frame start synchronization character (always upper case V);

; is an inter-field separator;

[] is an optional field;

<CR> is the frame (& final field) terminator.

V, S-field and <CR> are required in the format.

Applicable fields can have sub-fields, typically as follows:

; RC n [, u [, f [, t]]]

where

R is the field start synchronization character (upper case);

C is the data type (upper case);

n is the actual meter reading;

, is a sub-field separator.

RC n is mandatory, while [, u [, f [, t]]] is optional.

The first field shall be the S-field and optional fields are not sequence dependent.

Fields and sub-fields other than those specified may be included for manufacturer's own purposes, but might not be understood by compliant reading equipment.

5.4.2 Non-addressable V-frame data protocol field definitions

The V-frame data protocol field definitions are set out in Table 5.

Table 5 —Non-addressable V-frame data protocol field definitions

Field	Description	Format
S-field = Serial ID (mandatory)	(manufacturer's code/ID)	f S m s m = manufacturer code, 3 alpha characters ... see www.flag-association.com s = id, ≤16 alpha-numeric characters, 0 to 9, a-z
R-field = Reading (optional)	(quantity or flow-rate)	f ; RC n [,u [,f [,t]]] ...data type C = current or: ; RS n [,u [,f [,t]]] ...data type S = stored or: ; RH n [,u [,f [,t]]] ...data type H = highest flow or: ; RL n [,u [,f [,t]]] ...data type L = lowest flow n = actual meter reading, ≤ 16 numeric characters 0 to 9, one decimal point is permitted, ? is an error indicator u = units of registration ...see 5.4.3, Table 6 f = units factor multiplier/divisor in powers of 10 from -9 to + 9 t = units of time (for flow-rates) ...see 5.4.3, Table 7
A-field = Diagnostics (optional)	(manufacturer-specific)	; A a a = ≤16 ASCII characters
B-field = Billing ID (optional)	(account reference)	; B a a = ≤16 ASCII characters
C-field = CheckSum (optional)	(block check characters)	; C a a = ≤4 ASCII characters in accordance with ISO 1155
J-field = Free Text (optional)	(user-specific)	; J a a = ≤300 ASCII characters
Unless stated above, valid ASCII characters are Hex 20 through Hex 7E, excepting the field separator “;” Hex 3B &CR>. The message length has no maximum value, but shall include the “ V” and<CR>”, in not more than 63 fields.		

5.4.3 Non-addressable V-frame data protocol table allocations

For manufacturer codes, see the FLAG website (www.flag-association.com). Numerical codes for units of registration and time are given in Tables 6 and 7 respectively.

Table 6 —Codes for units of registration

Code	Units of registration
1	cubic metres
2	litres
3	US gallons
4	Imperial gallons
5	cubic feet
6	acre feet
7	hectare metres

Table 7 —Codes for units of time

Code	Units of time
1	second
2	minute
3	hour
4	day
5	year

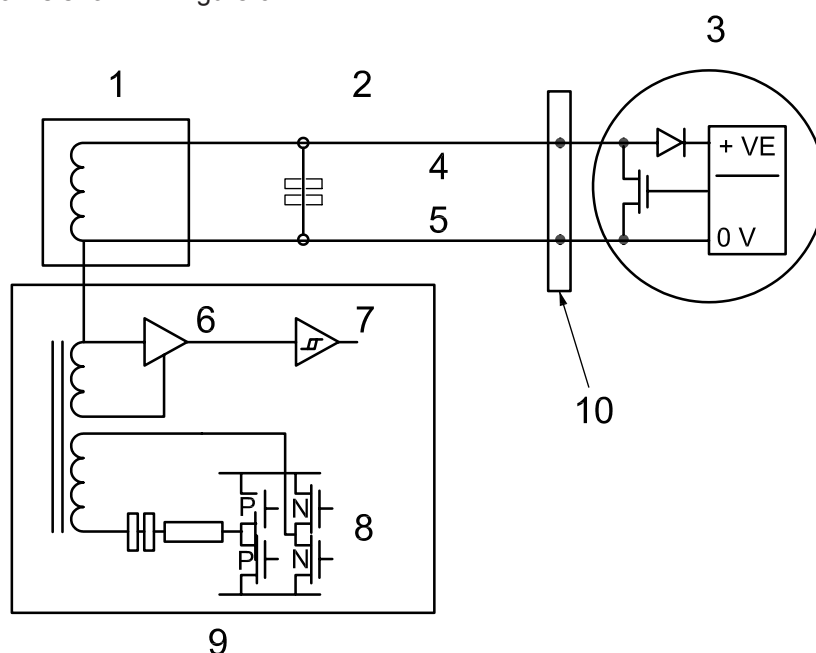
5.5 Non-addressable two-wire asynchronous mode for reading via an inductive pad and probe

This is a two-wire interface whereby an AC voltage (or rectified AC) is applied to the register on the data line to provide an internal supply and a data carrier wave.

After this power-up event, the register is automatically read and data transmitted, at a pre-determined bit-rate as identical data frames, using amplitude modulation, by collapsing the carrier for a logic 0, and not for a logic 1.

If the register is still powered when these transmissions are complete, the register can enter a passive state that allows reception of a manufacturer-specific configuration command; therefore, to re-read the register, it is essential that it is powered down for a brief period and then re-powered, in accordance with 5.3.

A typical configuration is shown in Figure 6.



- Key**
- | | | | | | |
|---|-------------|----|--|-----|-------------------------------|
| 1 | reading pad | 6 | low-pass filter | N | negative |
| 2 | cable | 7 | digital data | P | positive |
| 3 | register | 8 | AC drive | +VE | positive potential difference |
| 4 | data line | 9 | reading probe (shown for clarity) | | |
| 5 | common line | 10 | point of definition of this International Standard | | |

Figure 6 —Typical configuration for non-addressable two-wire asynchronous mode for reading via an inductive pad and probe

5.6 Non-addressable three-wire asynchronous mode for direct connection to the transponder/bus node

This is a three-wire interface whereby a DC voltage is applied to the register on the power line to provide an internal supply.

After this power-up event, the register is automatically read and data transmitted, at a predetermined bit-rate as identical data frames, directly on the data line, which is effectively an “open-drain” output, so a pull-up resistor is required external to the register.

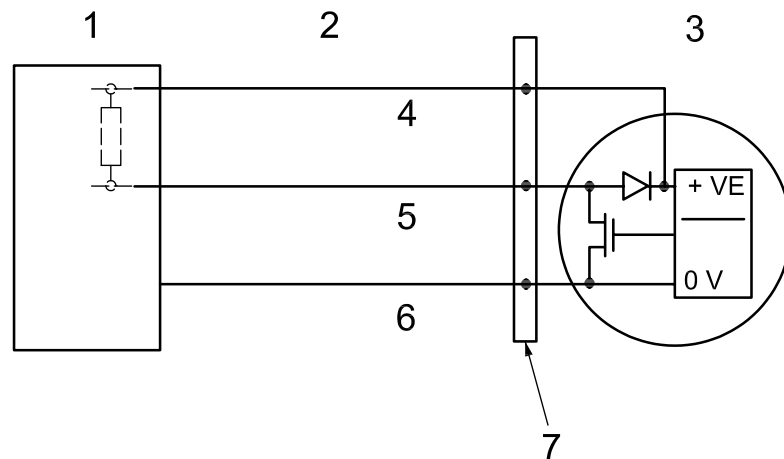
The data consists of a low to indicate a logic “0” or a high to indicate a logic “1” .

If the register is still powered when these transmissions are complete, the register can enter a passive state that allows reception of a manufacturer-specific configuration command; therefore, to re-read the register, it is essential that it is powered down for a brief period and then re-powered, in accordance with 5.3.

Compliant registers might also conform to the two-wire asynchronous mode.

With some engineering implementations for both two- and three-wire use, the use of an internal diode on the data line would cause a power-up event. To avoid this, the pull-up resistor should be gated with the power by the transponder.

A typical configuration is shown in Figure 7.



Key

- 1 transponder with pull-up resistor
- 2 cable
- 3 register
- 4 power line
- 5 data line
- 6 common line
- 7 point of definition of this International Standard
- +VE positive potential difference

Figure 7 — Typical configuration for non-addressable three-wire asynchronous mode for direct connection to the transponder/bus node

5.7 Non-addressable two-wire synchronous mode for reading via an inductive pad and probe

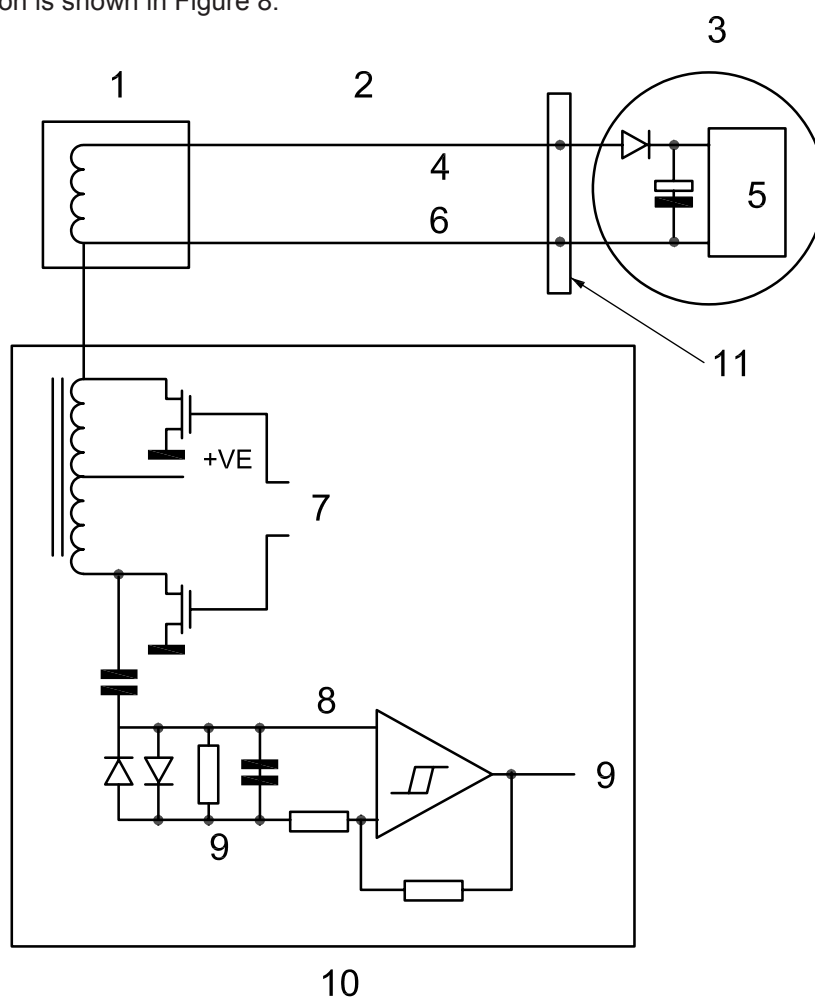
This is a two-wire interface whereby an AC voltage is applied to the register, amplitude shift key modulated 100 %, which acts as the register power source and data clock signal.

After this power-up event, the register is automatically read and data transmitted one bit at a time, synchronized to a brief cessation of the data clock signal.

The data output during this cessation consists of a burst of impulses to indicate a logic “ 0 ” or the absence of a burst to indicate a logic “ 1 ” .

Between each data frame the register is automatically re-read.

A typical configuration is shown in Figure 8.



Key

1	reading pad	7	AC power drive
2	cable	8	comparator
3	register	9	digital data
4	clock/data line	10	reading probe (shown for clarity)
5	load	11	point of definition of this International Standard
6	common line	+VE	positive potential difference

Figure 8 — Typical configuration for non-addressable two-wire synchronous mode for reading via an inductive pad and probe

5.8 Non-addressable three-wire synchronous mode intended for direct connection to the transponder/bus node

This is a three-wire interface whereby an AC signal is applied to the register, which acts as the register power source and data clock signal.

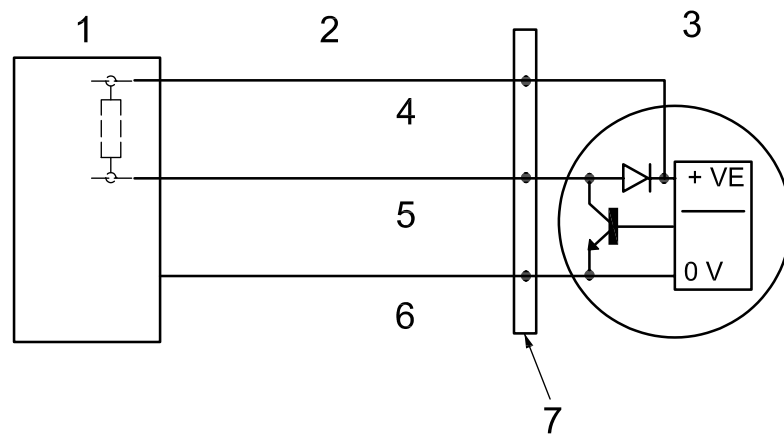
After this power-up event, the register is automatically read and data transmitted one bit at a time, synchronized to the falling edge of the data clock signal, directly on the data line, which is an “ open-collector” output, so a pull-up resistor is required external to the register.

The data consists of a low to indicate a logic “ 0” or a high to indicate a logic “ 1” .

Between each data frame the register is automatically re-read.

Compliant registers can also comply with the two-wire synchronous mode.

A typical configuration is shown in Figure 9.



Key

- 1 transponder with pull-up resistor
- 2 cable
- 3 register
- 4 clock/power line
- 5 data line
- 6 common line
- 7 point of definition of this International Standard
- +VE positive potential difference

Figure 9 — Typical configuration for non-addressable three-wire synchronous mode intended for direct connection to the transponder/bus node

5.9 Non-addressable two-wire bidirectional asynchronous mode for reading via optocouplers and probe

Data communication shall start by the reading equipment requesting data from the register, which is sent via optocouplers.

The reading equipment transmits data by switching optocoupler 2 as follows:

logic 1 = 0,1 mA to 1,0 mA, node voltage $\leq 0,5$ V;

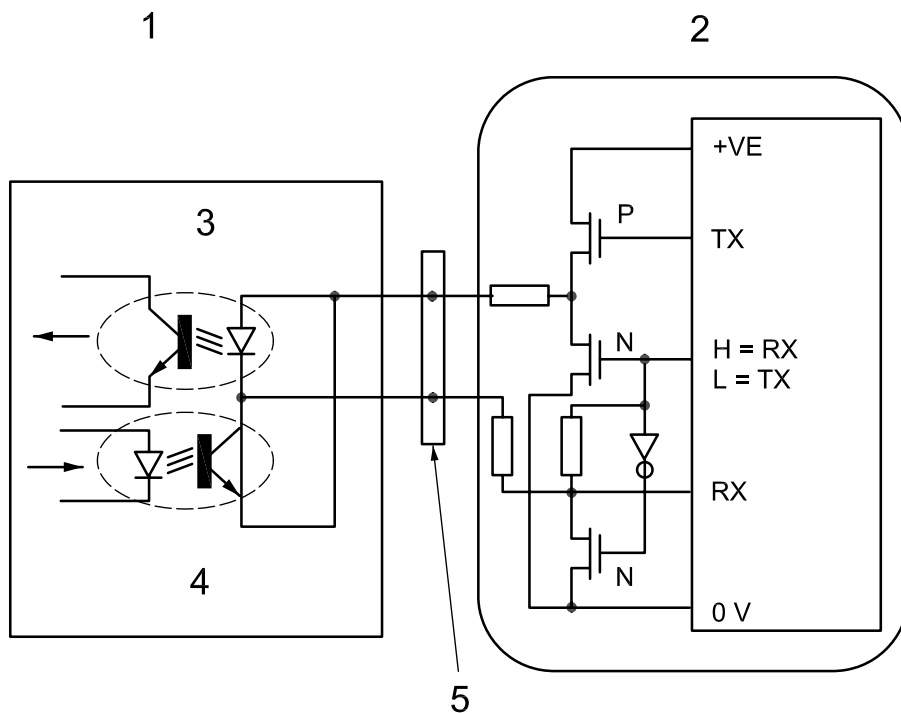
logic 0 ≤ 10 μ A.

The register transmits data by switching optocoupler 1 as follows:

logic 1 = 2,0 mA to 10 mA, node voltage $\leq 1,3$ V;

logic 0 ≤ 10 μ A.

A typical configuration is shown in Figure 10.



Key

- 1 reader optocouplers (shown for clarity)
- 2 register
- 3 optocoupler 1 for receiver, RX
- 4 optocoupler 2 for transmitter, TX
- 5 point of definition of this International Standard
- H high
- L low
- N negative
- P positive
- RX receiver
- TX transmitter
- +VE positive potential difference

Figure 10 — Typical configuration for non-addressable two-wire bidirectional asynchronous mode for reading via optocouplers and probe

5.10 Compatibility statement

Table 8 shows the possible relationships of existing engineering and new engineering compliant with this International Standard.

Table 8 —Options for compatibility of old and new engineering

Register	Compatibility	Reader
Existing	Yes	Existing
Existing	Yes ...if a new READER is engineered to accept new AND existing protocol fields	New
New	Yes ...if a new REGISTER is engineered to emit new AND existing protocol fields	Existing
New	Yes	New

For backwards compatibility in the register:

- a) the V-frame protocol could be embedded within uncommitted data areas of a pre-existing protocol;
- b) the V-frame protocol and a pre-existing protocol could be arranged sequentially or interspersed;
- c) pre-existing protocols could be embedded within the J-field of this V-frame protocol.

6 Addressable water meters —type C

NOTE The primary function of this output type is to provide a data stream that identifies and reports the registered units of water passed through the meter when commonly coupled to a reading bus.

6.1 General

Compatibility is defined by output modes designated 1, 2 or 3.

Compatible products may be compliance marked “ C1” , “ C2” or “ C3” .

6.2 Output mode 1, based on M-bus technology

6.2.1 Physical layer and interface to the physical medium

6.2.1.1 M-bus mode


6.2.1.1.1 General

General requirements for the M-bus mode are as set out in Table 9.

A typical configuration is shown in Figure 11.

Table 9 —General requirements for M-bus mode

Requirement	Characteristics	Reference	Clause
No. of connections	2 (no shielding necessary)	M-bus, v.4.8	4.1
Plug	not defined	M-bus, v.4.8	4.2
Connection polarity	free	M-bus, v.4.8	4.4
Polarity sensitivity	no damage in the case of polarity reversal	M-bus, v.4.8	4.4
Bus line earth connection	>1 MΩ at 500 V, bus may be electrically isolated from the meter by optocoupler	—	—

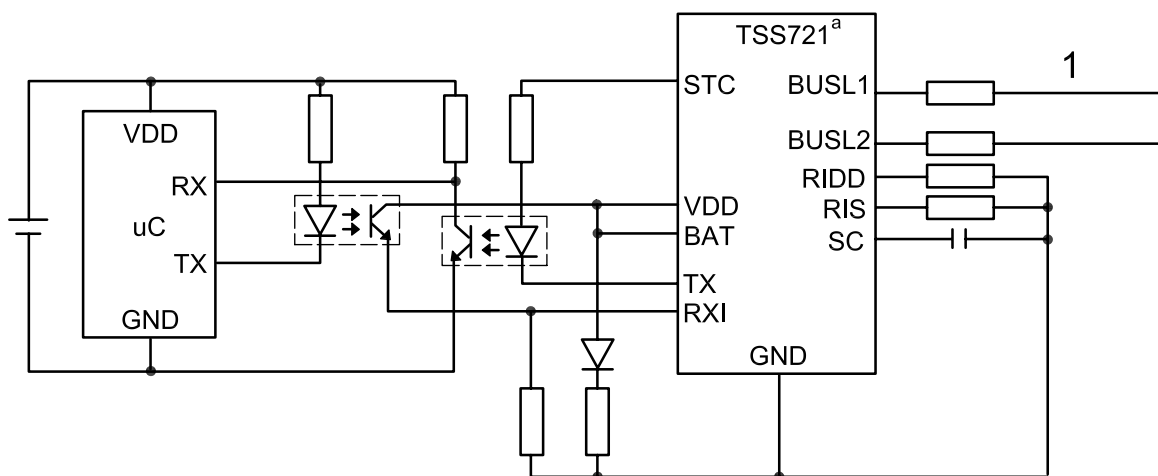

Key

1 M-bus

NOTE For further explanation of the labels, see M-bus, v.4.8, Clause 4.

^a TSS721 is the trade name of a product supplied by Texas Instruments. This information is given for the convenience of users of this document and does not constitute an endorsement by ISO of the product named.


Figure 11 —Typical configuration for M-bus mode

The power supply for the meter shall be

- remote from the bus; or
- remote from the bus with battery support; or
- supplied with a battery

in accordance with M-bus, v.4.8, 4.4.

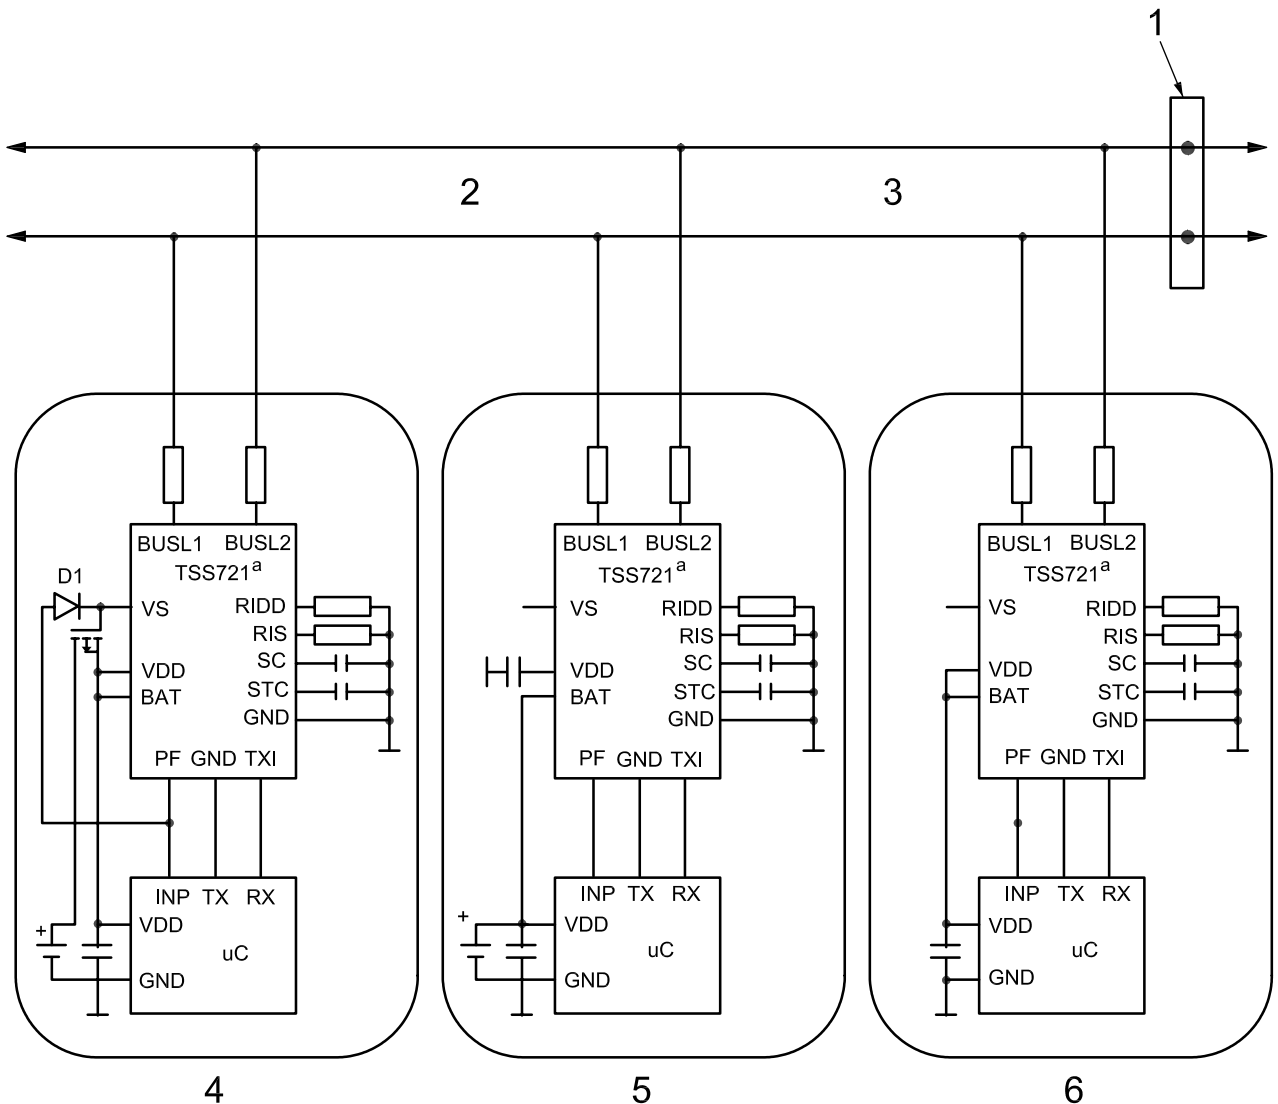The power supply shall typically be as shown in Figure 12.



Key

- 1 point of definition of this International Standard
- 2 meter
- 3 bus
- 4 remote supply/battery support
- 5 battery supply
- 6 remote supply

NOTE For further explanation of the labels, see M-bus, v.4.8, Clause 4.

^a TSS721 is the trade name of a product supplied by Texas Instruments. This information is given for the convenience of users of this document and does not constitute an endorsement by ISO of the product named.


Figure 12 —Example of a typical power supply

6.2.1.1.2 Electrical specifications for M-bus mode

Electrical requirements for the M-bus mode shall be as set out in Table 10 and Figure 13.

Table 10 —Electrical requirements for M-bus mode

Requirement	Characteristics	Reference	Clause
Absolute max. voltage, V	± 50 (no damage)	—	—
Mark state (= logic 1)			
Master to meter (slave), V	$(U_{\max} - 8,2) \dots U_{\max}$	M-bus, v.4.8	4.4
U_{\max} nominal, V	36		
U_{\max} range, V	21 to 42		
Meter to master, mA	$0 \dots I_{\text{mark}}$	M-bus, v.4.8	4.4
I_{mark} , mA	1,5		
tolerance			
$ \Delta I_{\text{mark}} $, %/V	<0,2	—	—
$ \Delta I_{\text{mark}} $, $\mu\text{A}/10 \text{ s}$	≤ 10		
$ \Delta I_{\text{mark}} $, % over time and temperature	≤ 10		
Space state (= logic 0)			
Master to meter, V	bus voltage $<(U_{\max} - 5,7)$	M-bus, v.4.8	4.4
Meter to master, mA	I_{space}	M-bus, v.4.8	4.4
I_{space} range, mA	$(11 + I_{\text{mark}}) \dots (20 + I_{\text{mark}})$		
Max. capacitance, nF	0,5		
Startup time after power loss of $\geq 0,1 \text{ s}$	recovery within $\leq 3 \text{ s}$	—	—

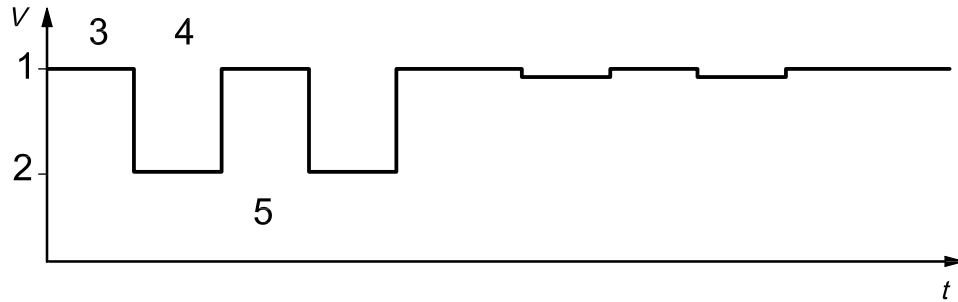


Key

- 1 $V_{\text{mark}} = 36 \text{ V}$
- 2 $V_{\text{space}} = 24 \text{ V}$
- 3 mark (" 1")
- 4 space (" 0")
- 5 master transmits to slave

t time
 V voltage

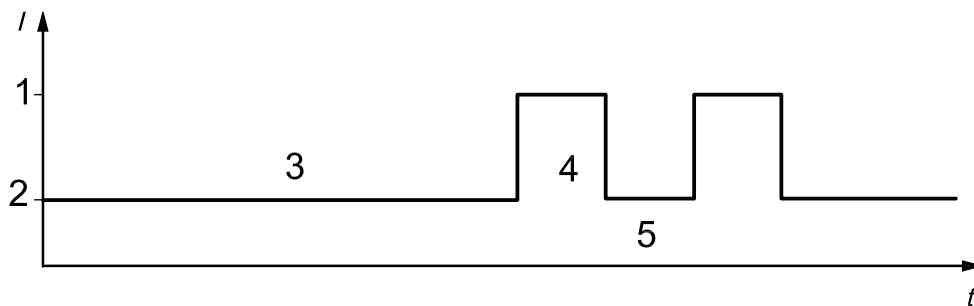a) Bus voltage at repeater



Key

- 1 $I_{\text{space}} = I_{\text{mark}} + (11 \text{ to } 20) \text{ mA}$
- 2 $I_{\text{mark}} < 1,5 \text{ mA}$
- 3 Mark (" 1")
- 4 Space (" 0")
- 5 Slave transmits to master

I current
 t time

b) Current consumption of a slave

Figure 13 —Electrical requirements for M-bus mode

6.2.1.2 Electrical requirements for Mini-bus mode

Electrical requirements for the Mini-bus mode shall be as set out in Table 11.

Table 11 —Electrical requirements for Mini-bus mode

Requirement	Characteristics	Reference	Clause
Absolute max. voltage, V	±50 (no damage)	—	—
Mark state (= logic 1)			
Master to meter, V	$(U_{\max} - 8,2) \dots U_{\max}$ (not negative)	M-bus, v.4.8	4.4
U_{\max} nominal, V	12		
U_{\max} range, V	5 to 15		
Meter to master, mA	$0 \dots I_{\text{mark}}$	M-bus, v.4.8	4.4
I_{mark} , mA	1,5		
tolerance			
$ \Delta I_{\text{mark}} $, %/V	<0,2	—	—
$ \Delta I_{\text{mark}} $, $\mu\text{A}/10 \text{ s}$	≤ 10		
$ \Delta I_{\text{mark}} $, % over time and temperature	≤ 10		
Space state (= logic 0)			
Master to meter, V	bus voltage $<(U_{\max} - 4,0)$	M-bus, v.4.8	4.4
Meter to master, mA	I_{space}	M-bus, v.4.8	4.4
I_{space} range, mA	$(3 + I_{\text{mark}}) \dots (6 + I_{\text{mark}})$		
max. capacitance, nF	0,5		
Startup time after power loss of $\geq 0,1 \text{ s}$	recovery within $\leq 3 \text{ s}$	—	—

6.2.2 Data link layer

Recommendations for the data link layer of output mode 1 are set out in Tables 12 to 18. The data in these tables are examples only.

Table 12 —First set of recommendations for the data link layer of output mode 1

Recommendation	Characteristics	Reference	Clause
Protocol basis		IEC 60870-5-1	
Type of transmission	asynchronous serial bit transmission, half-duplex	M-bus, v.4.8	5.1
Access technique	time division multiplexing	M-bus, v.4.8	2.2.1
Transmission speed	(300 ± 2,25) bit/s mandatory (2 400 ± 18) bit/s, (9 600 ± 72) bit/s optional (rates of 600 bit/s, 1 200 bit/s, 4 800 bit/s are not recommended, and may not be supported)	M-bus, v.4.8	6.4.1
Byte format (= IEC 60870-5-1)	1 start bit space 8 data bits LSB first 1 parity bit even parity 1 stop bit mark	IEC 60870-5-1 M-bus, v.4.8	5.1
— pauses within the telegram	none allowed (between start and stop bit)	IEC 60870-5-1	
— pauses after reception of valid telegram	> (330 bit periods + 50 ms)	M-bus, v.4.8	5.1
Telegrams			
— format class	FT1.2	IEC 60870-5-1	
— data integrity class	12	IEC 60870-5-2	
— Hamming distance	4	IEC 60870-5-1	
— CheckSum	arithmetical sum without carry digits	IEC 60870-5-1	
— Frame formats (ref./2/chapter 5.2)	single character (1 byte) short frame (5 bytes) control frame (9 bytes) long frame (max. 261 bytes)	IEC 60870-5-1	

Table 13 —Second set of recommendations for the data link layer of output mode 1

Single character	Short frame	Control frame	Long frame
E5h	Start 10h	Start 68h	Start 68h
	C Field	L Field = 03h	L Field
	A Field	L Field = 03h	L Field
	CheckSum	Start 68h	Start 68h
	Stop 16h	C Field	C Field
		A Field	A Field
		CI Field	CI Field
		CheckSum	User Data
		Stop 16h	(0-252 Byte)
			CheckSum
			Stop 16h

Table 14 —Third set of recommendations for the data link layer of output mode 1

Recommendation	Characteristics	Reference	Clause
Link services	— Send_Data/Confirm procedure: SND/CON — Request_Data/Respond procedure: REQ/RSP	IEC 60870-5-2 M-bus, v.4.8	5.4
Addressing	— primary addressing Address: 0 unconfigured meters (at manufacturing) 1 ... 250 distinct meter address 251 ... 255 reserved for special purposes — secondary addressing (preferred for meters in M-bus)	IEC 60870-5-1 M-bus, v.4.8 M-bus, v.4.8	5.2 7.3
Signal quality	— P1 for sending — PA for receiving	ISO/IEC 7480:1991 ^[1]	
Minimal meter communication			
	— SND_NKE/E5h (Initialize communication unit, i.e. meter/confirm)	M-bus, v.4.8	5.4

Table 15 —Fourth set of recommendations for the data link layer of output mode 1

Hex	Field	Meaning	Meter' s answer	Reference	Clause
10h	start	start character short frame		M-bus, v.4.8	5.2
40h	C	initialize communication	E5h	M-bus, v.4.8	5.3
00h	A	address (e.g. 00h)		M-bus, v.4.8	5.3
50h	CS	CheckSum		M-bus, v.4.8	5.3
16h	stop	end character		M-bus, v.4.8	5.2

Table 16 —Fifth set of recommendations for the data link layer of output mode 1






Recommendation	Reference	Clause
REQ_UD2/RSP_UD (Request User Data2/Respond User Data)	M-bus, v.4.8	5.4

Table 17 —Sixth set of recommendations for the data link layer of output mode 1

Hex	Field	Meaning	Meter' s answer	Clause
10h	start	start character short frame		/1/5.2
7Bh	C	REQ_UD2 (7Bh /5Bh alternating)	RSP_UD (see below)	/1/5.3
FEh	A	address for secondary addressing		/1/5.3
79h	CS	Checksum		/1/5.3
16h	stop	end character		/1/5.2

Table 18 —Seventh set of recommendations for the data link layer of output mode 1

Hex	bytes	Field	Meaning	Reference	Clause
68h	1	start	start character long frame	M-bus, v.4.8	5.2
1Bh	1	L	Length	M-bus, v.4.8	5.2
1Bh	1	L	Length	M-bus, v.4.8	5.2
68h	1	start	start character	M-bus, v.4.8	5.2
08h	1	C	C field for RSP_UD	M-bus, v.4.8	5.3
00h	1	A	primary address (e.g. 00h)	M-bus, v.4.8	5.3
72h	1	CI	CI field for variable data structure	M-bus, v.4.8	6.1
78h	4	identification	meter identification number	M-bus, v.4.8	6.3.1
56h			(e.g. 12345678)		
34h		8-digit BCD	(can be set by manufacturer or utility)		
12h					
18h	2	man. code	manufacturer code	M-bus, v.4.8	6.3.1
4Eh		2 bytes	(see below)		
01h	1	generation	type/software version	M-bus, v.4.8	6.3.1
07h	1	medium	medium to be measured (water: 07h, hot water: 06h)	M-bus, v.4.8	8.4.1
00h	1	access	access counter	M-bus, v.4.8	6.3.1
00h	1	status	error status information	M-bus, v.4.8	6.6
00h	2	signature	Reserved for future	M-bus, v.4.8	6.3.1
00h			signature and data encryption		
0Ch	1	DIF	data following in 8-digit BCD format	M-bus, v.4.8	6.3.2
78h	1	VIF	data following is: meter number	M-bus, v.4.8	8.4.3
78h	4			M-bus, v.4.8	8.4.2
56h		data	meter number		
34h		8-digit BCD	(e.g. 12345678)		
12h					
0Bh	1	DIF	3	M-bus, v.4.8	6.3.2
15h/16h/17h	1	VIF		M-bus, v.4.8	8.4.3
23h				M-bus, v.4.8	8.4.2
01h		data	meter index		
00h		6-digit BCD	(e.g. 000123)		
xxh	1	CS	Checksum	M-bus, v.4.8	5.3
16h	1	Stop	stop character	M-bus, v.4.8	5.2

	these bytes are constant
	(variable) data blocks
	fixed data header; all following data with LSB first
	total number of these bytes: length field L (e.g. 27 dec = 1 Bh)
	these fields (8 bytes) are used as secondary address

6.2.3 Network layer

Requirements for the network layer of output mode 1 shall be as set out in Table 19.

Table 19 —Requirements for the network layer of output mode 1

Requirement	Characteristics	Reference	Clause
Secondary addressing procedure		M-bus, v.4.8	7.1
Selection of the meter	long frame master to meter with — C-field 53h — A-field 253dec = FDh — CI-field 52h/56h — 4 bytes meter identification — 2 bytes manufacturer identification — 1 byte meter generation identification — 1 byte medium identification — response meter to master: \$E5		
Request of meter data	— REQ_UD2 with A-field 253dec to meter — RSP_UD from addressed meter		
Addressing range	based on meter- manufacturer- generation- and medium-identification	M-bus, v.4.8	6.7.3

6.2.4 Application layer

Requirements for the application layer of output mode 1 shall be as set out in Table 20.

Table 20 —Requirements for the application layer of output mode 1

Requirement	Characteristics	Reference	Clause
Structure of data records	— variable data structure	M-bus, v.4.8	6.3
	— fixed data structure (restricted to 2 indices + physical units only, no longer recommended)	M-bus, v.4.8	6.2
Data records on (e.g. in RSP_UD)	<ul style="list-style-type: none"> — meter identification number — manufacturer identification — meter generation/version — medium to be measured (e.g. water/ hot water) — meter status information — signature (for data encryption of meter data) — meter index + physical units 		
Additional meter data coding	— additional meter data optional		
— types of values	<ul style="list-style-type: none"> — instantaneous value — minimum value — maximum value — value during error state 		
— coding of data records	<ul style="list-style-type: none"> — 8, 16, 24, 32, 48, 64 bit signed binary integer — 2 bit pos. or neg. floating point number — 2, 4, 6, 8, 10 digit unsigned BCD — variable length ASCII-string — compound type (e.g. for date, time) 	M-bus, v.4.8 M-bus, v.4.8	8.2 var. 8.3 fixed
Coding of errors in the application layer	Reported by <ul style="list-style-type: none"> — 2 bit, coded in status field — 1 byte within respond procedure — 1 byte characterizing data record errors 	M-bus, v.4.8	6.6

6.2.5 Availability of documentation

M-bus is an open definition within the public domain and is therefore not proprietary information.

Supplementary information is available on the M-bus User Group website <http://www.m-bus.com>, which shows official documentation and gives:

- recommendations;
- examples;
- explanations on how to apply and use;
- documentation updates;
- user support (e.g. FAQs).

6.2.6 Additional information

6.2.6.1 Reliability of the interface to the physical medium

Tests on meter hardware with M-bus interfaces [with TSS721³⁾] have been performed as described in Table 21.

Table 21 —Tests on M-bus interface meter hardware

Test	Standards	Remarks
Climatic environments	IEC 60068-2-30 ^[2]	
EMC Surges/lightning	IEC 60801 ^[3]	necessary for declaration of CE conformity test report MBPROT1.doc (available at M-bus website)
Electrical safety		necessary for declaration of CE conformity

6.2.6.2 Testing M-bus protocol compatibility

To ensure the largest degree of interoperability and functional compatibility of meter products of different meter manufacturers on a common M-bus system at the customer site, testing facilities for compliance tests on specifications of the interface to the physical medium and protocol and procedure requirements of the physical, link and application layers have been set up.

6.3 Output mode 2, based on Dialog technology

6.3.1 Physical layer and interface to the physical medium

6.3.1.1 General


General requirements for output mode 2 shall be as set out in Table 22.

Table 22 —General requirements for output mode 2

Requirement	Characteristics
N° of connections	2 (no shielding necessary)
Plug	Not defined
Connection polarity	Free
Polarity sensitivity	No damage in the case of polarity reversal
Bus line earth connection	> 1 MΩ at 500 V; bus may be electrically isolated from meter by optocoupler
Power supply for the slave unit	Battery supplied

3) TSS721 is the trade name of a product supplied by Texas Instruments. This information is given for the convenience of users of this document and does not constitute an endorsement by ISO of the product named.

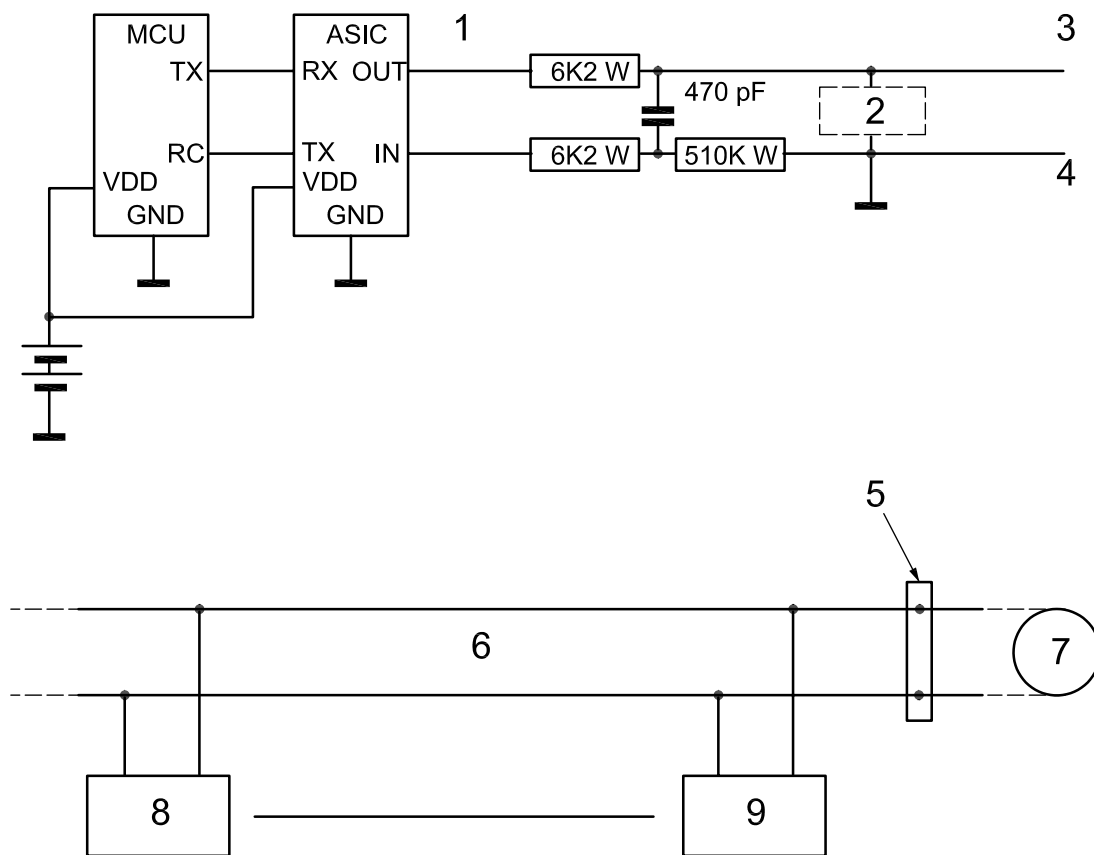A typical configuration is shown in Figure 14.



Key

- 1 tristate
- 2 optional lightning protection
- 3 green
- 4 red
- 5 point of definition of this International Standard
- 6 bus
- 7 optional read coil
- 8 slave No. 1
- 9 slave No. 127
- ASIC application specific integrated circuit
- MCU multipoint control unit

Figure 14 —Typical configuration for output mode 2


NOTE It is essential that each slave is programmed with a net address before being connected to the net.

6.3.1.2 Electrical specifications


Electrical requirements for output mode 2 shall be as set out in Table 23 and Figure 15.

Table 23 —Electrical requirements for output mode 2


Requirement	Characteristics
Absolute maximum voltage	
DC	−0,5 V to +4 V
AC (60 kHz to 200 kHz)	−25 V to +25 V
Mark state (= logic 1)	No signal
Space state (= logic 0)	Frequency
master to meter	65 kHz to 85 kHz, 2,5 V to 20 V p/p (at slave input)
meter to master	125 kHz, 30 mV to 3,5 V p/p (at master input)
Maximum meter input capacitance	200 pF
Maximum line capacitance	30 nF (including slave capacitance)
Lightning protection	Optional

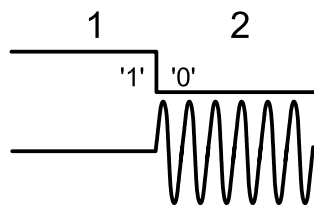

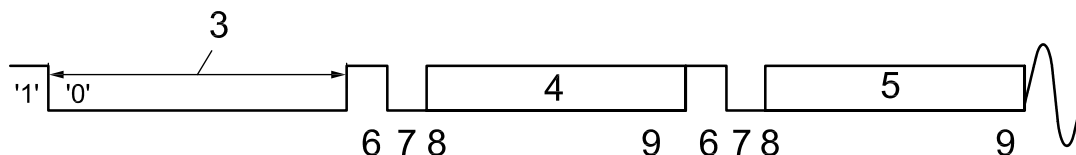
a) Mark and space view



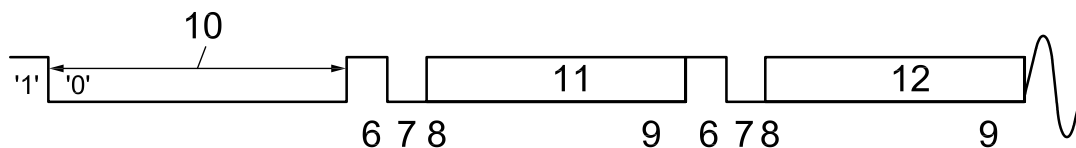b) Master transmission to slave



c) Slave transmission to master



d) Time frame response

Key

1	mark	7	start bit	13	transmit frame
2	space	8	LS bit 0	14	$t < 100$ ms
3	break 30 ms	9	MS bit 7	15	receive frame
4	byte 1	10	byte 1 (00hex)	16	$t > 50$ ms
5	byte 1	11	byte 2	17	transmit frame
6	stop bit	12	byte 3		

Figure 15 —Electrical requirements for output mode 2

6.3.2 Data link layer

6.3.2.1 General

General requirements for the data link layer of output mode 2 shall be as set out in Table 24.

Table 24 —General requirements for the data link layer of output mode 2

Protocol basis	Dialog technology
Type of transmission	Asynchronous serial bit transmission, half-duplex
Access technique	Random by net address from 1 to 7 Fh (1 to 127), address " 0" : access for all units
Transmission speed	(1 200 ± 9) bit/s, (600 ± 4,5) bit/s, (300 ± 2,25) bit/s
Byte format	1 start bit 8 data bits LSB first No parity 1 stop bit
Pause within the telegram	None allowed
Link services	R_COM: Read command procedure to unit W_COM: Write command procedure to unit S_ANS: Short answer procedure from unit R_A_COM: Read All DATA command F_ANS: Full answer procedure from unit
Frame formats	R_COM (header + 6 bytes + 1 byte CheckSum) W_COM (header + 6 bytes + 1 byte CheckSum) S_ANS (7 bytes + 1 byte CheckSum) F_ANS (12 bytes + 1 byte CheckSum)
CheckSum	Generated by Exclusive-OR of all valid bytes from a seed of 00h
Signal quality	9xh – Read command Axh – Write command 40h – Write net address
Pause after reception of valid telegram	> 50 ms

6.3.2.2 R_COM: Read command procedure to unit
W_COM: Write command procedure to unit

The Read and Write command procedures to unit shall be as given in Table 25.

Table 25 —Read and Write command procedures to unit

Byte	Hex/binary	Field	Meaning/Read_Answer or Write DATA bytes
Break		HEADER	Low pulse 30 ms long for waking up unit from power down (for all bit rates)
1	20h	Bit rate	Identify the bit rate of the communication
2	B0XXXXXXX	Net address	Network address from 1 to 7Fh (1 to 127)
3	90h	Read command	Read from unit ID, 3 least significant bytes —6 digits BCD or alpha-numeric binary format ^a
	91h	Read command	Read from unit ID, 3 most significant bytes —6 digits BCD or alpha-numeric binary format ^a
	92h	Read command	Read from unit QUANTITY, 3 bytes —6 digits BCD format
	93h	Read command	Read from unit FACTOR (DATA byte 1) FACTOR number in hexadecimal (DATA byte 2)
	94h	Read command	Read from unit STATUS/tamper (DATA byte 2)
	95h	Read command	Read from unit ASIC Frequency, 1 byte Binary format (DATA byte 1, only for factory test)
	96h	Read command	Read from unit METER Type, 1 byte (DATA byte 1)
	97h	Read command	Read from unit VERSION, 1 byte BCD format (DATA byte 1)
	A0h	Write command	Write to unit New ID, 3 least significant bytes – 6 digits BCD format (DATA bytes 1 to 3) ^a
	A1vh	Write command	Write to unit New ID, 3 most significant bytes – 6 digits BCD format (DATA bytes 1 to 3) ^a
	A2h	Write command	Write to unit New QUANTITY, 3 bytes – 6 digits BCD format (DATA bytes 1 to 3)
	A3vh	Write command	Write to unit FACTOR prescaler code, 1 byte (DATA byte 1)
	A4h	Write command	Clear (reset) STATUS/tamper (DATA bytes not carry)
	A6h	Write command	Write to unit new METER Type, 1 byte BCD format (DATA byte 1)
40vh	Write command	Write to units new net address, 1 byte Binary format (DATA byte 1) ^b	
4-6	XXh	DATA	Write: DATA to unit, 3 bytes, from least to most significant Read: DATA bytes not carry
7	XXh	CHECKSUM	Generated by exclusive-OR of all valid bytes from a seed of 00h

^a See 6.3.2.9 Alpha-numeric slave format.
^b See 6.3.2.6 W_COM.

6.3.2.3 S_ANS: Short answer procedure from unit

The short answer procedure from the unit shall be as set out in Table 26.

Table 26 —Short answer procedure from unit

Byte	Hex/binary	Field	Meaning
1	00h	HEADER	
2	20h	Bit rate	Echo byte from Master
3	B0XXXXXXXX	Net Address	Echo byte from Master
4	XXh	Command	Echo byte from Master
5-7	XXh	DATA	Read command: DATA from unit Write command: Repeat DATA from Master 3 bytes, from least to most significant, BCD format
8	XXh	CHECKSUM	Generated by Exclusive-OR of all valid bytes from a seed of 00h

Example: Quantity = “ 123456”

byte 5 = 56 BCD

byte 6 = 34 BCD

byte 7 = 12 BCD

6.3.2.4 Factor (prescaler code)

Factors shall be in accordance with Table 27.

Table 27 —Output mode 2 data link layer factors

Factor (division ratio)	Bit 7	Bit 6	Bit 5	Bit 4	Bit 3	Bit 2	Bit 1	Bit 0
100	×	×	×	×	×	0	0	0
200	×	×	×	×	×	0	0	1
20	×	×	×	×	×	0	1	0
40	×	×	×	×	×	0	1	1
50	×	×	×	×	×	1	0	0
10	×	×	×	×	×	1	0	1
1	×	×	×	×	×	1	1	0
2	×	×	×	×	×	1	1	1

6.3.2.5 Meter type

Meter types shall be in accordance with Table 28.

Table 28 —Output mode 2 data link layer meter types

Meter type	Bit 7	Bit 6	Bit 5	Bit 4	Bit 3	Bit 2	Bit 1	Bit 0
Water	×	×	×	×	×	×	0	0
Electric	×	×	×	×	×	×	0	1
Gas	×	×	×	×	×	×	1	0
Other	×	×	×	×	×	×	1	1

6.3.2.6 W_COM: Write command procedure to unit

The Write command procedure to the unit shall be as set out in Table 29.

(Write net address to the unit before connecting it to the net.)

Table 29 —Output mode 2 data link layer Write command procedure

Byte	Hex/binary	Field	Meaning
Break		HEADER	Low pulse 30 ms long for waking up unit from power down (for all bit rates)
1	20h	Bit rate	Identify the bit rate of the communication
2	B0XXXXXXXX	Net Address	Network address from 1 to 7 Fh (1 to 127)
3	40h	Write Command	Write to new network address of the unit
4	B0XXXXXXXX	New Net Address	New network address from 1 to 7 Fh (1 to 127)
5	00h	DATA	Shall always be 00h
6	00h	DATA	Shall always be 00h
7	XXh	CHECKSUM	Generated by Exclusive-OR of all valid bytes from a seed of 00h

6.3.2.7 R_A_COM: Read all DATA command (9Eh)

The Read all DATA command shall be as set out in Table 30.

Table 30 —Output mode 2 data link layer Read all DATA command procedure

Byte	Hex/binary	Field	Meaning
Break		HEADER	Low pulse 30 ms long for waking up unit from power down (for all bit rates)
1	20h	Bit rate	Echo byte from Master
2	B0XXXXXXXX	Net Address	Network address from 1 to 7 Fh (1 to 127)
3	9Eh	Read Command	Read from unit ALL data, 12 bytes BCD/Binary format
4	00h	DATA	Memory begin address
5	0Ch	DATA	Number of bytes is 12
6	00h	DATA	
7	XXh	CHECKSUM	Generated by Exclusive-OR of all valid bytes from a seed of 00h

6.3.2.8 F_ANS: Full answer procedure from unit

The full answer procedure from the unit shall be as set out in Table 31.

Table 31 —Output mode 2 data link layer full answer procedure

Byte	Hex/binary	Field	Meaning
1–3	XXh	QUANTITY	3 bytes —6 digits, from least to most significant BCD format
4–6	XXh	Identification Code (ID)	ID low, 3 bytes —6 digits, from least to most significant BCD format
7–9	XXh	Identification Code (ID)	ID high, 3 bytes —6 digits, from least to most significant BCD format
10	BXXXXXXXXS	STATUS	If S = 0, OK; if S = 1, tamper, 1 byte
11	BXXXXXFFF	FACTOR	Prescaler code, 1 byte
12	BXXXXXMM	METER Type	1 byte
13	XXh	CHECKSUM	Generated by Exclusive-OR of all valid bytes from a seed of 00h

6.3.2.9 Alphanumeric slave format

6.3.2.9.1 General

By using the existing BCD code in the 6 byte of the ID number (ID low + ID high), and following a coding table, it is possible to obtain a code for alphanumeric characters.

6.3.2.9.2 Converting from alphanumeric to serial number

6.3.2.9.2.1 The first six characters (the least significant) are coded according to the representative serial number in the code table.

If there are less than six characters, the remaining spaces are zeros.

6.3.2.9.2.2 The seventh character is coded according to the binary value of the representative serial number in the code table. The less significant bit in the less significant character is encoded according to the following rule:

- in order to represent (ZERO), leave the value of the serial number as it is;
- in order to represent (ONE), add 50.

6.3.2.9.3 Converting from serial number (in BCD) to alphanumeric

6.3.2.9.3.1 The first six characters are decoded as follows:

- if the value is less than or equal to 49, the numerical value is the representative serial number in the code table;
- if the value is greater than 49, subtract 50. The obtained numerical value is the representative serial number in the code table.

6.3.2.9.3.2 The seventh digit is decoded according to the following rule:

- if the LSD character is greater than 49, the corresponding bit value is 1 (ONE);
- if the character is greater than 49, the corresponding bit value is 0 (ZERO), and so forth, until the sixth character.

The LSD character corresponds with the LSB bit.


Table 32 —Code table

Serial number	Character	Serial number	Character
0	SPACE	25	V
1	.	26	W
2	,	27	X
3	;	28	Y
4	A	29	Z
5	B	30	(
6	C	31	:
7	D	32	#
8	E	33	=
9	F	34	0
10	G	35	1
11	H	36	2
12	I	37	3
13	J	38	4
14	K	39	5
15	L	40	6
16	M	41	7
17	N	42	8
18	O	43	9
19	P	44	—
20	Q	45	/
21	R	46	*
22	S	47)
23	T	48	+
24	U	49	^

EXAMPLE

- 1) **05 35 36 50 00 00** will correspond in alphanumeric to **AB12**.
- 2) Slave will correspond to: **12 04 15 68 60 50**.

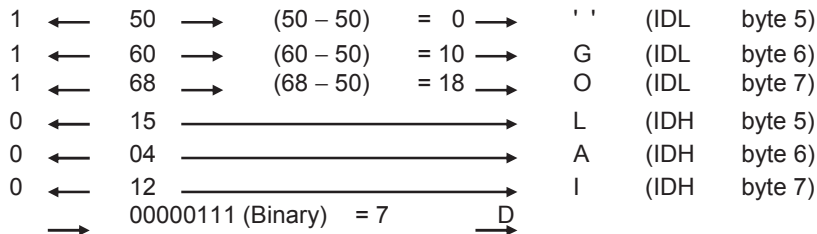Starting from the right:



6.3.3 Documentation

Dialog is an open definition within the public domain and is therefore not proprietary information.

Supplementary information is available on the website <http://www.arad.co.il>, which shows official documentation and gives:

- recommendations;
- examples;
- explanations on how to apply and use;
- documentation updates;
- user support (e.g. FAQs).

6.4 Output mode 3, based on NABS technology

6.4.1 Physical layer and interface to the physical medium


6.4.1.1 General

General requirements for output mode 3 shall be as set out in Table 33.

Table 33 —General requirements for output mode “ 3”

Requirement	Characteristics	Reference	Clause
No. of connections	2 (no shielding necessary)	NABS, v.1.0	1.1, 4
Plug	not defined		
Connection polarity	polarity reverses on transmission and reception	NABS, v.1.0	1.1
Polarity sensitivity	no damage in the case of polarity reversal		
Bus line earth connection	> 1 MΩ at 500 V, bus may be electrically isolated from meter by optocoupler		
Power supply for the meter	battery supplied		

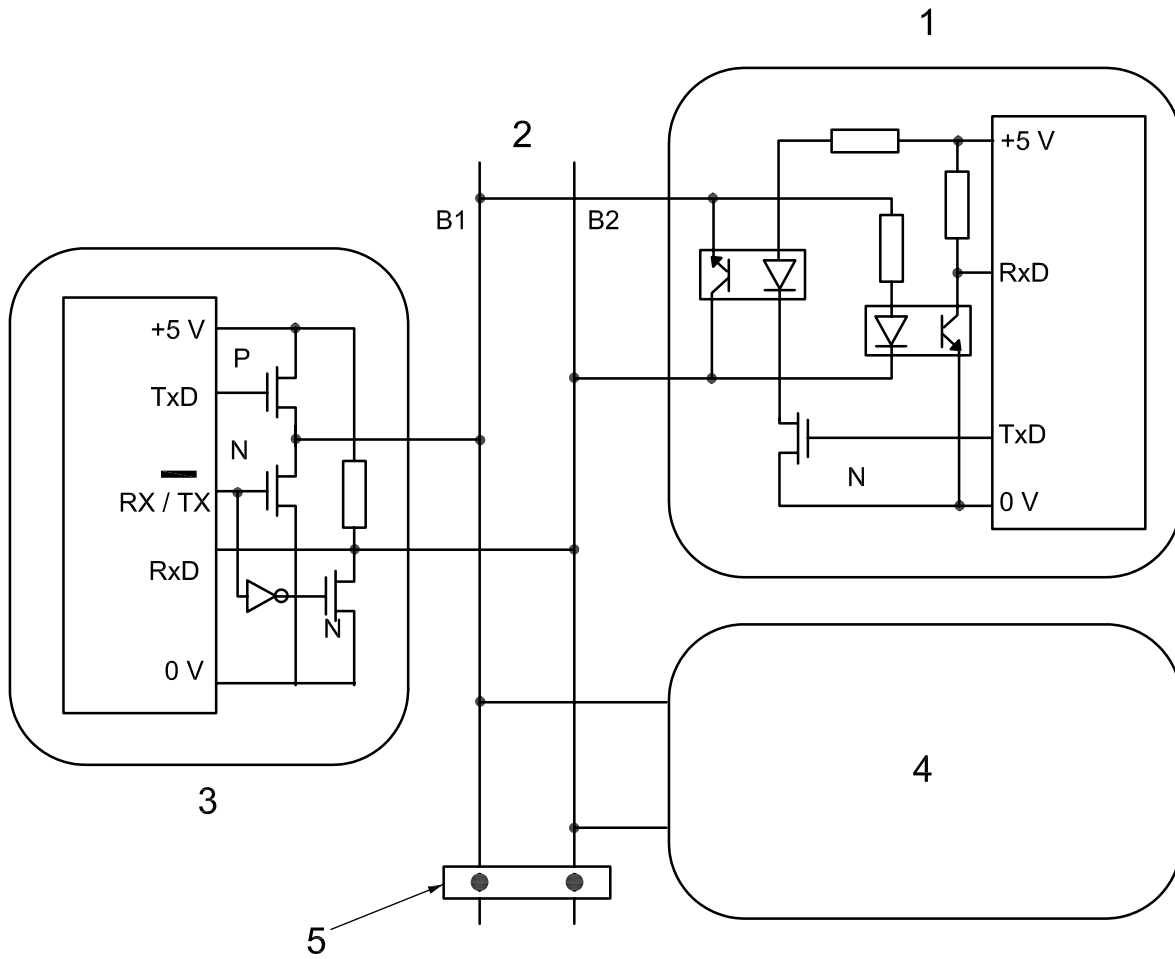A typical configuration is shown in Figure 16.



Key

- 1 slave
- 2 bus
- 3 master
- 4 slave
- 5 point of definition of this International Standard


Figure 16 — Typical configuration for output mode 3

6.4.1.2 Electrical specifications

Electrical requirements for output mode 3 shall be as set out in Table 34 and Figure 17.

Table 34 —Electrical requirements for output mode 3

Direction	$V_s = B_1 - B_2 ^a, V$	Reference	Clause
Mark state (= logic 1)			
Master to meter, V	$4,5 \leq V_s \leq 5,5$	NABS, v.1.0	5.1.1
Meter to master, V	$V_s \leq 1,0$	NABS, v.1.0	5.1.2
Space state (= logic 0)			
Master to meter, V	$V_s \leq 0,5$	NABS, v.1.0	5.1.1
Meter to master, V	$V_s \geq 4,0$	NABS, v.1.0	5.1.2
^a Where B_1 is the voltage at B1 and B_2 is the voltage at B2 (see Figure 16).			

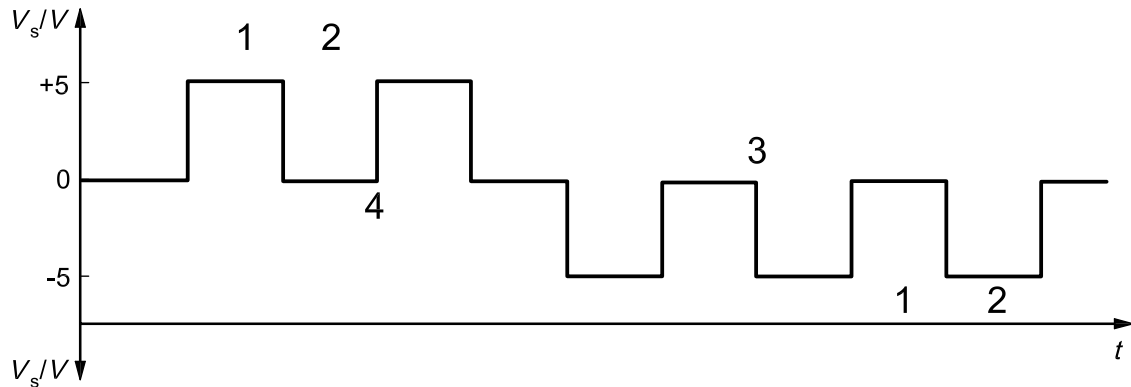

Key


- 1 mark
- 2 space
- 3 meter to master
- 4 master to meter

t time

$V_s = |B_1 - B_2|$, where B_1 is the voltage at B1 and B_2 is the voltage at B2 (see Figure 16)

Figure 17 —Electrical requirements for output mode 3

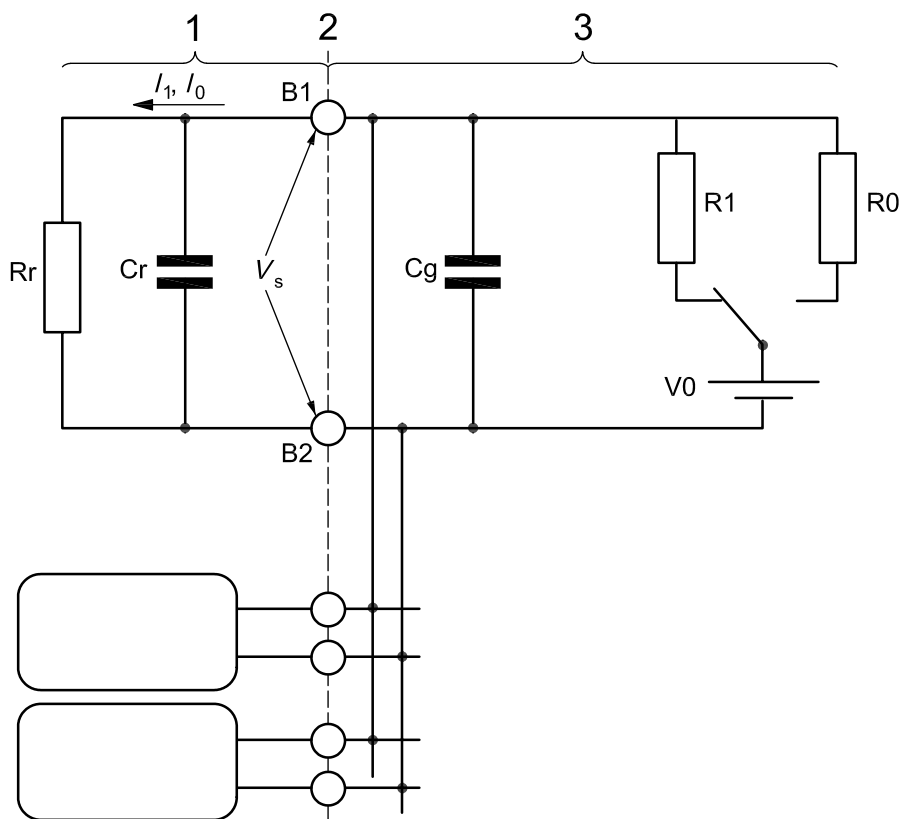6.4.1.3 Equivalent interface circuit between master and meter —when meter receives (communication is made through optocouplers in the meter). See Figure 18.




Key

- 1 receiver (meter)
- 2 interchange point
- 3 transmitter (master)

- B1 point
- B2 point
- Cg transmitter capacitance
- Cr receiver capacitance $C < 0,01 \mu\text{F}$
- I_1 current at “ mark” =(logic 1) $< 1 \text{ mA}$ at $V_s = 5 \text{ V}$
- I_0 current at “ space” =(logic 0)
- R0 internal resistance of signal source at “ space” (logic 0)
- R1 internal resistance of signal source at “ mark” (logic 1)
- Rr internal resistance of receiver
- V0 transmitting voltage
- V_s $|B_1 - B_2|$, where B_1 is the voltage at B1 and B_2 is the voltage at B2

Figure 18 —Output mode 3 equivalent interface circuit (receiving meter)

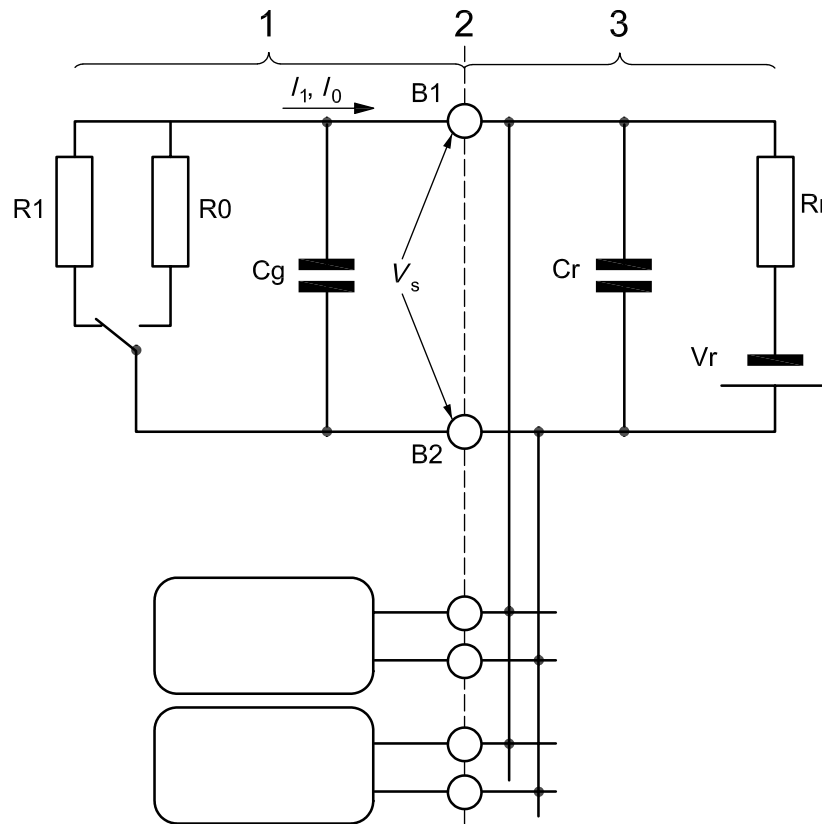6.4.1.4 Equivalent interface circuit between master and meter – when meter transmits (communication is made through optocouplers in the meter). See Figure 19.



Key

- 1 transmitter (meter)
- 2 interchange point
- 3 receiver (master)

B1 point

B2 point

Cg transmitter capacitance $C < 0,01 \mu\text{F}$

Cr receiver capacitance

I_1 current at “ mark” =(logic 1)

I_0 current at “ space” =(logic 0), $I_0 < 0,10 \mu\text{A}$

R0 internal resistance of signal source at “ space” (logic 0)

R1 internal resistance of signal source at “ mark” (logic 1)

Rr internal resistance of receiver $\geq 1 \text{ K}\Omega$

Vr receiver voltage

V_s $|B_1 - B_2|$, where B_1 is the voltage at B1 and B_2 is the voltage at B2

Figure 19 —Output mode 3 equivalent interface circuit (transmitting meter)


6.4.2 Data link layer

6.4.2.1 General

General requirements for the data link layer of output mode 3 shall be as set out in Table 35 and Figure 20.

Table 35 —General requirements for the data link layer of output mode 3

Requirement	Characteristics	Reference	Clause
Type of transmission	Asynchronous serial bit transmission, half-duplex	NABS, v.1.0	1.1
Access technique	Time division multiplexing	NABS, v.1.0	1.1
Transmission speed, bit/s	300 ± 2,25	NABS, v.1.0	1.1
Character format	1 start bit : space 7 data bits : LSB first 1 parity bit : even parity 1 stop bit : mark	NABS, v.1.0	1.2
Frame format	Mark: 150 ms to 250 ms STX : 02h Data : variable length ASCII ETX : 03h BCC : block check character Space : 100 ms to 110 ms	NABS, v.1.0 JIS X 5001:1982 JIS X 5001:1982 NABS, v.1.0	1.1 4.1 5.1 1.1

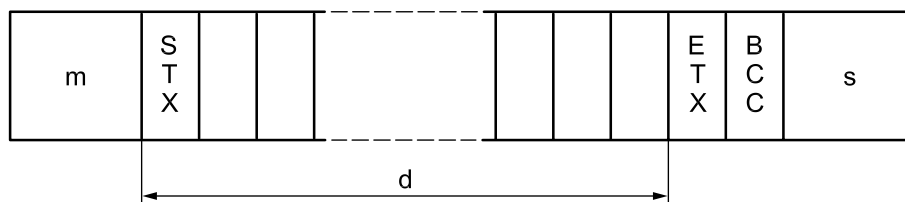

Key

- d data
- m mark
- s space

Figure 20 —Data link layer of output mode 3

6.4.2.2 Specific requirements

Specific requirements for the data link layer of output mode 3 shall be as set out in Table 36 and Figure 21.

Table 36 — Specific requirements for the data link layer of output mode “ 3”

Requirement	Characteristics	Reference	Clause
Frame type usage or meaning	Addressing frame/addressing and request for data Answer frame/response to addressing frame A data frame/termination of communication B data frame/request for re-send R type frame/request for data S type frame/setting of data D type frame/response to R/S frame	NABS, v.1.0	2.2.1
Data structure of addressing frame	Utility code : “ W2” Meter address : 14-digit BCD (= meter ID)	NABS, v.1.0	2.2.2
Data structure of answer frame	Utility code : “ W2” Meter address : 14-digit BCD Frame type : “ D” Data item : “ 01” Data : 19-digit BCD (value with alarm message) Decimal point : 1-digit BCD Current date/time : 8-digit BCD	NABS, v.1.0	2.2.2
Data structure of A frame	“ A”	NABS, v.1.0	2.2.2
Data structure of B frame	“ B”	NABS, v.1.0	2.2.2
Data structure of R frame	Utility code : “ W2” Meter address : 14-digit BCD Frame type : “ R” Data item : 2-digit BCD Current date/time : 8-digit BCD	NABS, v.1.0	2.2.3
Data structure of S frame	Utility code : “ W2” Meter address : 14-digit BCD Frame type : “ S” Data item : 2-digit BCD Data : variable length ASCII Current date/time : 8-digit BCD	NABS, v.1.0	2.2.3
Data structure of D frame	Utility code : “ W2” Meter address : 14-digit BCD Frame type : “ D” Data item : 2-digit BCD Data : variable length ASCII Decimal point : 1-digit BCD Current date/time : 8-digit BCD	NABS, v.1.0	2.2.3

S T X	W2	Meter address (14 digit BCD)	E T X	B C C
-------------	----	------------------------------	-------------	-------------

a) Addressing frame (master to meter)/Addressing and request for data

S T X	W2	Meter address	D	Data item '01'	Value with alarm message	d.p. 1 BCD	Current date/time	E T X	B C C
-------------	----	---------------	---	----------------	--------------------------	------------	-------------------	-------------	-------------

b) Answer frame (meter to master)/Response to addressing frame

S T X	A	E T X	B C C
-------------	---	-------------	-------------

c) Type A data frame (master to meter)/Termination of communication

S T X	B	E T X	B C C
-------------	---	-------------	-------------

d) Type B data frame/Request to re-send

S T X	W2	Meter address	R	Data item 2 BCD	Current date/time	E T X	B C C
-------------	----	---------------	---	-----------------	-------------------	-------------	-------------

e) Type R data frame (master to meter)/Request for data

S T X	W2	Meter address	S	Data item 2 BCD	Set data (variable length)	Current date/time	E T X	B C C
-------------	----	---------------	---	-----------------	----------------------------	-------------------	-------------	-------------

f) Type S data frame (master to meter)/Setting of data


S T X	W2	Meter address	D	Data item 2 BCD	Response data (variable)	d.p. 1 BCD	Current date/time	E T X	B C C
-------------	----	---------------	---	-----------------	--------------------------	------------	-------------------	-------------	-------------

g) Type D frame (meter to master)/Response to type R/S frame

Figure 21 —Representation of requirements in Table 36

6.4.2.3 Communication procedure

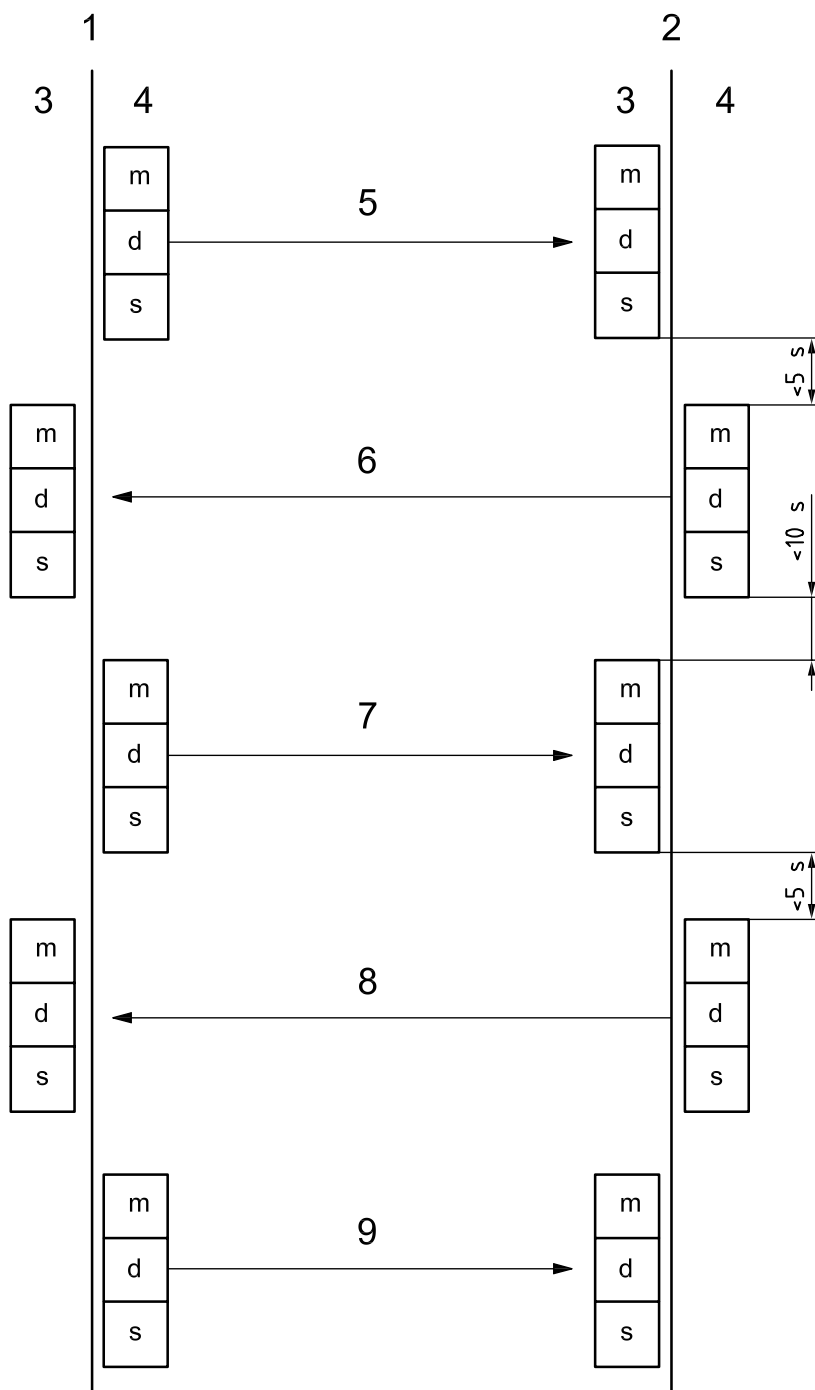The communication procedure for output mode 3 shall be as set out in Figure 22.



Key


1	master	5	addressing frame	9	A type data frame
2	meter	6	answer frame	d	STX + data + ETX + BCC
3	receive	7	S or R type frame	m	mark
4	transmit	8	D type frame	s	space

NOTE 1 In this communication, these frames can be used repeatedly.


NOTE 2 The purpose of a B type data frame is a request to re-send in case of communication error only.

Figure 22 —Communication procedure

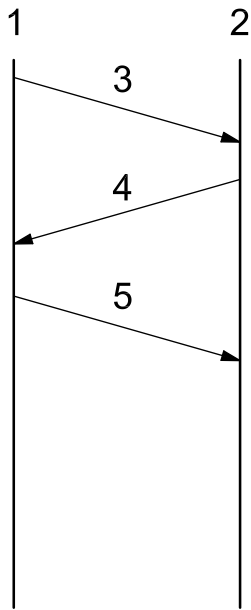
6.4.2.4 Communication examples



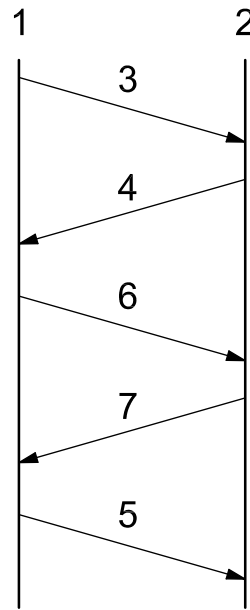
a) Minimal communications



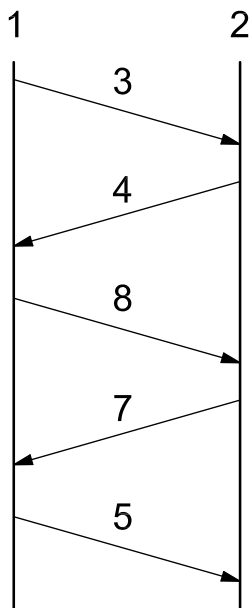b) Request for data



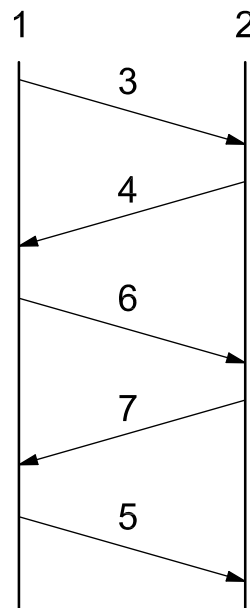c) Pre-setting



d) Request for pre-set data

Key

- 1 master
- 2 meter
- 3 addressing
- 4 answer
- 5 A data
- 6 R type
- 7 D type
- 8 S type

Figure 23 —Communication examples

6.4.3 Application link layer

Requirements for the application link layer of output mode 3 shall be as set out in Table 37.

Table 37 —Requirements for the application link layer of output mode 3

Data items	No.	Frame type						Reference	Clause
		R request meter reading	D reply	S pre-set condition pre-setting	D reply	R request condition reading	D reply		
1 Date/time to store values	00			0	0	0	0	NABS, v.1.0	2.2.3
	01	0	0						
2 Current values	04	0	0					NABS, v.1.0	2.2.4
3 Current values w/alarm message	05	0	0					NABS, v.1.0	2.2.5
4 Current flow rate	06	0	0					NABS, v.1.0	2.2.6
5 load survey	10			0	0	0	0	NABS, v.1.0	2.2.7
	11	0	0						
	12	0	0						
6 Meter ID	21			0	0	0	0	NABS, v.1.0	2.2.8
7 Manufacturer code	23					0	0	NABS, v.1.0	2.2.9
8 Date and time	29	0	0	0	0			NABS, v.1.0	2.2.10
9 Alarm message	30	0	0					NABS, v.1.0	2.2.11
	31			0	0				
10 Leakage detection 1	32	0	0					NABS, v.1.0	2.2.12
	33			0	0	0	0		
11 Leakage detection 2	34	0	0					NABS, v.1.0	2.2.13
	35			0	0	0	0		
12 Excessive flow rate detection	36	0	0					NABS, v.1.0	2.2.14
	37			0	0	0	0		
13 No usage detection 1	38	0	0					NABS, v.1.0	2.2.15
	39			0	0	0	0		
14 Reverse flow detection	40	0	0					NABS, v.1.0	2.2.16
	41			0	0	0	0		
	42	0	0						
15 No usage detection 2	38	0	0					NABS, v.1.0	2.2.17
	44			0	0	0	0		
16 Excessive flow volume detection	46	0	0					NABS, v.1.0	2.2.18
	47			0	0	0	0		

6.4.4 Availability of documentation

NABS, v.1.0 is an open definition within the public domain and is therefore not proprietary information.

Further information is available from the Japan Measuring Instruments Federation (email: jmif@keikoren.or.jp).

Annex A (informative)

Designation of registration authority

Attention is also drawn to the establishment of a registration authority, see www.flag-association.com, where the registration of manufacturer codes, as referred to in this International Standard, Table 5 and 5.4.3, is administered.

Bibliography

- [1] ISO/IEC 7480:1991, *Information technology — Telecommunications and information exchange between systems — Start-stop transmission signal quality at DTE/DCE interfaces*
- [2] IEC 60068-2-30, *Environmental testing — Part 2-30: Tests — Test Db: Damp heat, cyclic (12 h + 12 h cycle)*
- [3] IEC 60801 (all parts)⁴⁾, *Electromagnetic compatibility for electrical and electronic equipment*
- [4] IEC 60870-5-4:1993, *Telecontrol equipment and systems — Part 5: Transmission protocols — Section 4: Definition and coding of application information*

4) Superseded by IEC 61000-4 (all parts).

British Standards Institution (BSI)

BSI is the national body responsible for preparing British Standards and other standards-related publications, information and services.

BSI is incorporated by Royal Charter. British Standards and other standardization products are published by BSI Standards Limited.

About us

We bring together business, industry, government, consumers, innovators and others to shape their combined experience and expertise into standards-based solutions.

The knowledge embodied in our standards has been carefully assembled in a dependable format and refined through our open consultation process. Organizations of all sizes and across all sectors choose standards to help them achieve their goals.

Information on standards

We can provide you with the knowledge that your organization needs to succeed. Find out more about British Standards by visiting our website at bsigroup.com/standards or contacting our Customer Services team or Knowledge Centre.

Buying standards

You can buy and download PDF versions of BSI publications, including British and adopted European and international standards, through our website at bsigroup.com/shop, where hard copies can also be purchased.

If you need international and foreign standards from other Standards Development Organizations, hard copies can be ordered from our Customer Services team.

Subscriptions

Our range of subscription services are designed to make using standards easier for you. For further information on our subscription products go to bsigroup.com/subscriptions.

With **British Standards Online (BSOL)** you'll have instant access to over 55,000 British and adopted European and international standards from your desktop. It's available 24/7 and is refreshed daily so you'll always be up to date.

You can keep in touch with standards developments and receive substantial discounts on the purchase price of standards, both in single copy and subscription format, by becoming a **BSI Subscribing Member**.

PLUS is an updating service exclusive to BSI Subscribing Members. You will automatically receive the latest hard copy of your standards when they're revised or replaced.

To find out more about becoming a BSI Subscribing Member and the benefits of membership, please visit bsigroup.com/shop.

With a **Multi-User Network Licence (MUNL)** you are able to host standards publications on your intranet. Licences can cover as few or as many users as you wish. With updates supplied as soon as they're available, you can be sure your documentation is current. For further information, email bsmusales@bsigroup.com.

BSI Group Headquarters

389 Chiswick High Road London W4 4AL UK

Revisions

Our British Standards and other publications are updated by amendment or revision.

We continually improve the quality of our products and services to benefit your business. If you find an inaccuracy or ambiguity within a British Standard or other BSI publication please inform the Knowledge Centre.

Copyright

All the data, software and documentation set out in all British Standards and other BSI publications are the property of and copyrighted by BSI, or some person or entity that owns copyright in the information used (such as the international standardization bodies) and has formally licensed such information to BSI for commercial publication and use. Except as permitted under the Copyright, Designs and Patents Act 1988 no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means – electronic, photocopying, recording or otherwise – without prior written permission from BSI. Details and advice can be obtained from the Copyright & Licensing Department.

Useful Contacts:

Customer Services

Tel: +44 845 086 9001

Email (orders): orders@bsigroup.com

Email (enquiries): cservices@bsigroup.com

Subscriptions

Tel: +44 845 086 9001

Email: subscriptions@bsigroup.com

Knowledge Centre

Tel: +44 20 8996 7004

Email: knowledgecentre@bsigroup.com

Copyright & Licensing

Tel: +44 20 8996 7070

Email: copyright@bsigroup.com



...making excellence a habit.™