



# Structural use of timber —

## Part 7: Recommendations for the calculation basis for span tables —

### Section 7.2 Joists for flat roofs

UDC [624.011.1 + 674.038.5 + 691.1.11]:[692.526:694.5]:001.4

# Committees responsible for this British Standard

The preparation of this British Standard was entrusted by the Civil Engineering and Building Structures Standards Committee (CSB/-) to Technical Committee CSB/32 upon which the following bodies were represented:

British Woodworking Federation  
 Building Employers' Confederation  
 Chartered Institute of Building  
 Department of the Environment (Building Research Establishment, Princes Risborough Laboratory)  
 Department of the Environment for Northern Ireland  
 Department of the Environment (Housing and Construction Industries)  
 Department of the Environment (Property Services Agency)  
 Health and Safety Executive  
 Incorporated Association of Architects and Surveyors  
 Institute of Clerks of Works of Great Britain Inc.  
 Institute of Wood Science  
 Institution of Civil Engineers  
 Institution of Structural Engineers  
 International Truss Plate Association  
 National House-building Council  
 Royal Institute of British Architects  
 Royal Institution of Chartered Surveyors  
 Timber Research and Development Association  
 Timber Trade Federation  
 Coopted members

This British Standard, having been prepared under the direction of the Civil Engineering and Building Structures Standards Committee, was published under the authority of the Board of BSI and comes into effect on 30 June 1989

© BSI 01-2000

The following BSI references relate to the work on this standard:  
 Committee reference CSB/32  
 Draft for comment 86/10303 DC

ISBN 0 580 16587 6

## Amendments issued since publication

Amd. No.	Date of issue	Comments

# Contents

	Page
Committees responsible	Inside front cover
Foreword	ii
1 Scope	1
2 Definitions	1
3 Symbols	1
4 Design considerations	2
5 Permissible spans	3
6 Bearing length	8
7 Information to be given in span tables	8
Appendix A Sample calculations for a flat roof joist	9
Appendix B Specimen span tables for flat roof joists	10
Figure 1 — Bearing length, permissible effective and permissible clear span	8
Table 1 — Permissible clear spans for roof joists without access, imposed load 0.75 kN/m <sup>2</sup> : SC3, regularized sizes	11
Table 2 — Permissible clear spans for roof joists without access, imposed load 0.75 kN/m <sup>2</sup> : redwood/whitewood, SS grade, basic sizes	12
Table 3 — Permissible clear spans for roof joists without access, imposed load 0.75 kN/m <sup>2</sup> : spruce-pine-fir, joist and plank no. 2 grade, CLS sizes	13
Publications referred to	Inside back cover

# Foreword

This Section of Part 7 of BS 5268 has been prepared under the direction of the Civil Engineering and Building Structures Standards Committee.

The general principles for the design of structural timber components are given in BS 5268-2 and using these principles it is possible for span tables to be prepared for a wide range of components.

Experience has shown that different interpretations of these principles has led to inconsistencies in span tables prepared by different compilers. It is the purpose of BS 5268-7 to eliminate these differences by recommending the design equations and the loading to be used in the preparation of span tables. Part 7 is intended to ensure that different organizations produce span tables on a consistent basis in the future, and is not necessarily intended for use by designers for individual designs carried out in their day-to-day work, where simplified equations may produce adequate designs. Section 7.2 deals with joists for flat roofs. Other sections of BS 5268-7 published or in preparation are as follows.

- *Section 7.1: Domestic floor joists;*
- *Section 7.3: Ceiling joists;*
- *Section 7.4: Ceiling binders;*
- *Section 7.5: Rafters;*
- *Section 7.6: Purlins supporting rafters;*
- *Section 7.7: Purlins supporting sheeting or decking.*

BS 5268-2 gives grade stresses for very many combinations of species and grade and it is considered impractical to publish in a British Standard span tables for all possible combinations of species, grades and sizes. BS 5268-7 is therefore restricted to the basis of the calculations.

The solution of the design equations for many combinations of geometry and material is most conveniently undertaken by computer. A program written by the Timber Research and Development Association (TRADA) was used to prepare Appendix A and Appendix B. For users wishing to prepare their own span tables or computer programs Appendix A gives a sample calculation. Appendix B gives span tables for three typical combinations of species and grade. Although the presentation of span tables is not covered in BS 5268-7, it is recommended that tables for predetermined flat roof joist centres and loading follow this format.

A British Standard does not purport to include all the necessary provisions of a contract. Users of British Standards are responsible for their correct application.

**Compliance with a British Standard does not of itself confer immunity from legal obligations.**

## Summary of pages

This document comprises a front cover, an inside front cover, pages i and ii, pages 1 to 14, an inside back cover and a back cover.

This standard has been updated (see copyright date) and may have had amendments incorporated. This will be indicated in the amendment table on the inside front cover.

## 1 Scope

This Section of BS 5268 recommends a calculation basis for the permissible clear span for joists for flat roofs and roofs with a slope of up to  $10^\circ$ . The recommendations apply to joists at a maximum spacing of 610 mm centre-to-centre, this being the maximum spacing for which the "load-sharing" assumption may be adopted as described in BS 5268-2. The method of calculation makes no allowance for any contribution of the roof decking to the load resistance of the joists although it is assumed that the decking should be capable of providing lateral load distribution. It does not cover the design of joists taking account of a structural contribution by sheet material supporting the roofing where such action can be provided by adequate design of its attachments as in a stressed skin panel roof.

The uniform and concentrated loads recommended in BS 6399-1 and BS 6399-3 are considered.

This Section of BS 5268 is applicable to the species and grades of timber given in BS 5268-2.

NOTE The titles of the publications referred to in this standard are listed on the inside back cover.

## 2 Definitions

For the purposes of this Section of BS 5268, the definitions given in BS 6100-4.2 to BS 6100-4.4, BS 6100-2.1 and BS 5268-2 apply, together with the following.

### 2.1

#### grade stress

stress that can safely be permanently sustained by material of a specific section size and of a particular strength class or species and grade

### 2.2

#### load-sharing system

assembly of pieces or members that are constrained to act together to support a common load

### 2.3

#### permissible stress

stress that can safely be sustained by a structural material under a particular condition

NOTE For the purposes of this Section of BS 5268 it is the product of the grade stress and the appropriate modification factors for section size, service and loading.

### 2.4

#### strength class

classification of timber based on particular values of grade stress

### 2.5

#### bearing length

length at each end of the joist in contact with the support

### 2.6

#### notional bearing length

bearing length required for the calculation of permissible clear spans

### 2.7

#### effective span

span from centre-to-centre of the minimum bearing lengths at each end

### 2.8

#### permissible effective span

lowest value of effective span found from the calculations for bending strength, shear strength and deflection

### 2.9

#### permissible clear span

permissible unsupported span of a joist, measured between the faces of the supports at its two ends

NOTE Permissible clear span is equal to permissible effective span less the notional bearing length.

### 2.10

#### point load

concentrated load referred to in BS 6399-1, that is regarded as acting at a point for calculation purposes

## 3 Symbols

For the purposes of this Section of BS 5268, the following symbols apply.

NOTE The symbols used are in accordance with ISO 3898, published by the International Organization for Standardization, supplemented by the recommendations of CIB-W18-1 "Symbols for use in structural timber design", published by the International Council for Building Research Studies and Documentation, which takes particular account of timber properties.

The symbols used are:

$a$	Distance (notional bearing length)
$b$	Breadth of joist
$E$	Modulus of elasticity
$F$	Total load per metre length
$F_d$	Dead load per square metre applied by mass of ceiling and roofing materials (excluding joist self weight)
$F_j$	Self weight of joist per metre length
$F_p$	Point load
$G$	Shear modulus
$h$	Depth of joist

$l$	Second moment of area
$K$	Modification factor (always with a subscript)
$L$	Effective span
$L_{adm}$	Permissible effective span
$L_{cl}$	Permissible clear span
$M$	Bending moment
$s$	Spacing of joists, centre-to-centre
$w$	Deflection
$Z$	Section modulus
$\rho$	Density
$\sigma$	Stress
$\tau$	Shear stress

The following subscripts are used:

a) **Type of force, stress, etc.**

c	Compression
m	Bending

b) **Significance**

adm	Permissible
cl	Clear
g	Grade
max	Maximum

c) **Geometry**

tra or $\perp$	Perpendicular (to the grain)
----------------	------------------------------

It is recommended that where more than one subscript is used, the categories should be separated by commas.

Subscripts may be omitted when the context in which the symbols are used is unambiguous except in the case of modification factor  $K$ .

## 4 Design considerations

### 4.1 General

The design calculations recommended by this Section of BS 5268 are based on engineers' bending theory and are consistent with the recommendations of BS 5268-2. The design method ensures that the permissible bending and shear stresses, as given in BS 5268-2, are not exceeded and that the deflection due to bending and shear does not exceed the recommended limit of 0.003 times the span.

NOTE A sample calculation is given in Appendix A and Table 1 to Table 3 in Appendix B contain specimen span tables.

### 4.2 Qualifying assumptions

The calculations given in this Section of BS 5268 apply to systems of at least four roof joists, at a maximum spacing of 610 mm centre-to-centre, and having roofing adequate to provide lateral load distribution. Because load sharing takes place the load sharing modification factor  $K_8$  and the mean modulus of elasticity should be used.

Lateral support should be provided in accordance with 14.8 of BS 5268-2:1988.

The bearing length required at each end of the joist, calculated in accordance with 5.5, may not be sufficient for practical construction purposes.

### 4.3 Loading

The design calculations provide for flat roof loads which consist of the following.

a) *Imposed load*<sup>1)</sup>

1) with access: 1.5 kN/m<sup>2</sup> uniformly distributed, or a concentrated load of 1.8 kN, whichever governs the design;

2) without access: 0.75 kN/m<sup>2</sup> uniformly distributed, or a concentrated load of 0.9 kN, whichever governs the design.

The concentrated load, in accordance with BS 6399-1, is taken as a point load for calculation purposes.

The point load is assumed to act in the position which produces maximum stress or deflection.

The imposed distributed load should be considered as a medium term load for both roofs with access and those without access. The imposed point load should be considered as a short term load, as given in Table 8 of BS 5268-3:1985.

b) *Dead load*. Dead load per square metre  $F_d$  (in kN/m<sup>2</sup>) to provide for the mass of ceiling and roofing materials, insulation, etc. Weights of materials are given in BS 648.

c) *Self weight*. Self weight per metre length  $F_j$  (in kN/m) to provide for the mass of the joists. The timber densities (in kg/m<sup>3</sup>) given in Table 9 and 92 of BS 5268-2:1988 should be used.

### 4.4 Design loads

For roofs with or without access three loading conditions should be considered.

a) A uniform imposed load condition, the loading consisting of uniformly distributed imposed load, dead load and member self weight. This loading should be considered as medium term.

<sup>1)</sup> The numerical values are examples of imposed loads, including snow load, specified in BS 6399-1. For other snow loads reference should be made to BS 6399-3.

b) A point imposed load condition, the loading consisting of a point imposed load plus uniformly distributed dead load and member self weight. This loading should be considered as short term.

c) A long term load condition, the loading consisting of uniformly distributed dead load and member self weight with no imposed load. This loading should be considered as long term.

With access

For the uniform imposed load condition  $F$  (in kN/m) is given by the equation

$$F = (1.5 + F_d) \left( \frac{s}{1000} \right) + F_j \quad (1)$$

For the point imposed load condition

$$F_p = 1.8 \text{ kN}$$

acting together with uniform dead load and self weight (in kN/m)

$$F_d \left( \frac{s}{1000} \right) + F_j \quad (2)$$

For the long term load condition, i.e. dead load and self weight alone,  $F$  (in kN/m) is given by the equation

$$F = F_d \left( \frac{s}{1000} \right) + F_j \quad (3)$$

Without access

For the uniform imposed load condition  $F$  (in kN/m) is given by the equation

$$F = (0.75 + F_d) \left( \frac{s}{1000} \right) + F_j \quad (4)$$

For the point imposed load condition

$$F_p = 0.9 \text{ kN}$$

acting together with uniform dead load and self weight (in kN/m)

$$F_d \left( \frac{s}{1000} \right) + F_j \quad (5)$$

For the long term load condition, i.e. dead load and self weight alone,  $F$  (in kN/m) is given by the equation

$$F = F_d \left( \frac{s}{1000} \right) + F_j \quad (6)$$

In equations (1) to (6)

$s$  is the joist spacing (in mm);

$F_d$  is the dead load (in kN/m<sup>2</sup>);

$F_j$  is the self weight of joist (in kN/m).

The value of  $F_j$  (in kN/m) may be found from the equation

$$F_j = 9.80665 \times 10^{-9} \times \rho b h \quad (7)$$

where

$\rho$  is the timber density (in kg/m<sup>3</sup>);

$b$  is the joist breadth (in mm);

$h$  is the joist depth (in mm).

For the calculation of spans under loading incorporating a point load, the combined effect of uniform and point loads may be obtained using the equivalent uniformly distributed load  $F$ .  $F$  (in kN/m) is given by the following equations.

In bending strength calculations

$$F = \frac{1000 \times 2F_p}{L} + F_d \left( \frac{s}{1000} \right) + F_j \quad (8)$$

In shear strength calculations

$$F = \frac{1000 \times 2F_p}{L} + F_d \left( \frac{s}{1000} \right) + F_j \quad (9)$$

In deflection calculations:

For bending deflection

$$F = \frac{1000 \times 1.6F_p}{L} + F_d \left( \frac{s}{1000} \right) + F_j \quad (10)$$

For shear deflection

$$F = \frac{1000 \times 2F_p}{L} + F_d \left( \frac{s}{1000} \right) + F_j \quad (11)$$

In equations (8) to (11)

$F_p = 1.8$  kN with access or 0.9 kN without access;

$L$  is the span (in mm).

## 5 Permissible spans

### 5.1 General

The permissible effective span of a timber joist subjected to the applied loads given in 4.3 should be the shortest effective span resulting from calculations for bending strength, shear strength and deflection, as given in 5.2, 5.3 and 5.4.

The permissible clear span should be calculated as the permissible effective span less the notional bearing length, calculated in accordance with 5.5.



## 5.2 Limitation of bending stress

From BS 5268-2, the permissible bending stress  $\sigma_{m,adm}$  (in N/mm<sup>2</sup>) is given by the equation

$$\sigma_{m,adm} = \sigma_{m,g} K_3 K_7 K_8 \quad (12)$$

where

- $\sigma_{m,g}$  is the grade bending stress (in N/mm<sup>2</sup>) (see BS 5268-2);
- $K_3$  is the load duration modification factor, 1.0 for long term, 1.25 for medium term or 1.5 for short term (see Table 17 of BS 5268-2:1988);
- $K_7$  is the section depth modification factor (see 14.6 of BS 5268-2:1988);
- $K_8$  is the load sharing modification factor 1.1 [see clause 13 item a) of BS 5268-2:1988].

Expanding the equation

$$\sigma_{m,adm} = \frac{M}{Z} \quad (13)$$

leads to the following equations.

With access

Uniform imposed load condition

$$\begin{aligned} &\sigma_{m,g} \times 1.25 \times K_7 \times 1.1 \\ &= \left\{ (1.5 + F_d) \left( \frac{s}{1000} \right) + F_j \right\} \frac{L^2}{8} \frac{6}{bh^2} \end{aligned} \quad (14)$$

Point imposed load condition

$$\begin{aligned} &\sigma_{m,g} \times 1.5 \times K_7 \times 1.1 \\ &= \left\{ \frac{3600}{L} + F_d \left( \frac{s}{1000} \right) + F_j \right\} \frac{L^2}{8} \frac{6}{bh^2} \end{aligned} \quad (15)$$

Long term load condition, i.e. dead load and self weight alone

$$\begin{aligned} &\sigma_{m,g} \times 1.0 \times K_7 \times 1.1 \\ &= \left\{ F_d \left( \frac{s}{1000} \right) + F_j \right\} \frac{L^2}{8} \frac{6}{bh^2} \end{aligned} \quad (16)$$

Without access

Uniform imposed load condition

$$\begin{aligned} &\sigma_{m,g} \times 1.25 \times K_7 \times 1.1 \\ &= \left\{ (0.75 + F_d) \left( \frac{s}{1000} \right) + F_j \right\} \frac{L^2}{8} \frac{6}{bh^2} \end{aligned} \quad (17)$$

Point imposed load condition

$$\begin{aligned} &\sigma_{m,g} \times 1.5 \times K_7 \times 1.1 \\ &= \left\{ \frac{1800}{L} + F_d \left( \frac{s}{1000} \right) + F_j \right\} \frac{L^2}{8} \frac{6}{bh^2} \end{aligned} \quad (18)$$

Long term load condition, i.e. dead load and self weight alone

$$\begin{aligned} &\sigma_{m,g} \times 1.0 \times K_7 \times 1.1 \\ &= \left\{ F_d \left( \frac{s}{1000} \right) + F_j \right\} \frac{L^2}{8} \frac{6}{bh^2} \end{aligned} \quad (19)$$

NOTE These equations lead to the following polynomials in  $L$ .  
With access

Uniform imposed load condition

$$\begin{aligned} &\frac{3}{4bh^2} \left\{ (1.5 + F_d) \left( \frac{s}{1000} \right) + F_j \right\} L^2 - \\ &- \sigma_{m,g} \times 1.25 \times K_7 \times 1.1 = 0 \end{aligned} \quad (20)$$

Point imposed load condition

$$\begin{aligned} &\frac{3}{4bh^2} \left\{ F_d \left( \frac{s}{1000} \right) + F_j \right\} L^2 + \\ &+ \frac{2700}{bh^2} L - \sigma_{m,g} \times 1.5 \times K_7 \times 1.1 = 0 \end{aligned} \quad (21)$$

Long term load condition, i.e. dead load and self weight alone

$$\begin{aligned} &\frac{3}{4bh^2} \left\{ F_d \left( \frac{s}{1000} \right) + F_j \right\} L^2 - \\ &- \sigma_{m,g} \times 1.0 \times K_7 \times 1.1 = 0 \end{aligned} \quad (22)$$

Without access

Uniform imposed load condition

$$\begin{aligned} &\frac{3}{4bh^2} \left\{ (0.75 + F_d) \left( \frac{s}{1000} \right) + F_j \right\} L^2 - \\ &- \sigma_{m,g} \times 1.25 \times K_7 \times 1.1 = 0 \end{aligned} \quad (23)$$

Point imposed load condition

$$\begin{aligned} &\frac{3}{4bh^2} \left\{ F_d \left( \frac{s}{1000} \right) + F_j \right\} L^2 + \\ &+ \frac{1350}{bh^2} L - \sigma_{m,g} \times 1.5 \times K_7 \times 1.1 = 0 \end{aligned} \quad (24)$$

Long term load condition, i.e. dead load and self weight alone

$$\begin{aligned} &\frac{3}{4bh^2} \left\{ F_d \left( \frac{s}{1000} \right) + F_j \right\} L^2 - \\ &- \sigma_{m,g} \times 1.0 \times K_7 \times 1.1 = 0 \end{aligned} \quad (25)$$

## 5.3 Limitation of shear stress

From BS 5268-2, the permissible shear stress  $\tau_{adm}$  (in N/mm<sup>2</sup>) is given by the equation

$$\tau_{adm} = \tau_g K_3 K_8 \quad (26)$$

where

- $\tau_g$  is the grade shear stress (in N/mm<sup>2</sup>) (see BS 5268-2);
- $K_3$  is the load duration modification factor, 1.0 for long term, 1.25 for medium term or 1.5 for short term (see Table 17 of BS 5268-2:1988);
- $K_8$  is the load sharing modification factor, 1.1 [see clause 13 item a) of BS 5268-2:1988].

Expanding the equation

$$\tau_{adm} = \frac{3}{2} \frac{FL}{2bh} \quad (27)$$

leads to the following equations.

With access

Uniform imposed load condition

$$\begin{aligned} & \tau_g \times 1.25 \times 1.1 \\ &= \frac{3}{2} \left\{ (1.5 + F_d) \left( \frac{s}{1000} \right) + F_j \right\} \frac{L}{2bh} \end{aligned} \quad (28)$$

Point imposed load condition

$$\begin{aligned} & \tau_g \times 1.5 \times 1.1 \\ &= \frac{3}{2} \left\{ \frac{3600}{L} + F_d \left( \frac{s}{1000} \right) + F_j \right\} \frac{L}{2bh} \end{aligned} \quad (29)$$

Long term load condition, i.e. dead load and self weight alone

$$\begin{aligned} & \tau_g \times 1.0 \times 1.1 \\ &= \frac{3}{2} \left\{ F_d \left( \frac{s}{1000} \right) + F_j \right\} \frac{L}{2bh} \end{aligned} \quad (30)$$

Without access

Uniform imposed load condition

$$\begin{aligned} & \tau_g \times 1.25 \times 1.1 \\ &= \frac{3}{2} \left\{ (0.75 + F_d) \left( \frac{s}{1000} \right) + F_j \right\} \frac{L}{2bh} \end{aligned} \quad (31)$$

Point imposed load condition

$$\begin{aligned} & \tau_g \times 1.5 \times 1.1 \\ &= \frac{3}{2} \left\{ \frac{1800}{L} + F_d \left( \frac{s}{1000} \right) + F_j \right\} \frac{L}{2bh} \end{aligned} \quad (32)$$

Long term load condition, i.e. dead load and self weight alone

$$\begin{aligned} & \tau_g \times 1.0 \times 1.1 \\ &= \frac{3}{2} \left\{ F_d \left( \frac{s}{1000} \right) + F_j \right\} \frac{L}{2bh} \end{aligned} \quad (33)$$

NOTE These equations lead to the following polynomials in  $L$ .  
With access

Uniform imposed load condition

$$\begin{aligned} & \frac{3}{4bh} \left\{ (1.5 + F_d) \left( \frac{s}{1000} \right) + F_j \right\} L - \\ & - \tau_g \times 1.25 \times 1.1 = 0 \end{aligned} \quad (34)$$

Point imposed load condition

$$\begin{aligned} & \frac{3}{4bh} \left\{ F_d \left( \frac{s}{1000} \right) + F_j \right\} L + \\ & + \frac{2700}{bh} - \tau_g \times 1.5 \times 1.1 = 0 \end{aligned} \quad (35)$$

Long term load condition, i.e. dead load and self weight alone

$$\begin{aligned} & \frac{3}{4bh} \left\{ F_d \left( \frac{s}{1000} \right) + F_j \right\} L - \\ & - \tau_g \times 1.0 \times 1.1 = 0 \end{aligned} \quad (36)$$

Without access

Uniform imposed load condition

$$\begin{aligned} & \frac{3}{4bh} \left\{ (0.75 + F_d) \left( \frac{s}{1000} \right) + F_j \right\} L \\ & - \tau_g \times 1.25 \times 1.1 = 0 \end{aligned} \quad (37)$$

Point imposed load condition

$$\begin{aligned} & \frac{3}{4bh} \left\{ F_d \left( \frac{s}{1000} \right) + F_j \right\} L + \\ & + \frac{1350}{bh} - \tau_g \times 1.5 \times 1.1 = 0 \end{aligned} \quad (38)$$

Long term load condition, i.e. dead load and self weight alone

$$\begin{aligned} & \frac{3}{4bh} \left\{ F_d \left( \frac{s}{1000} \right) + F_j \right\} L - \\ & - \tau_g \times 1.0 \times 1.1 = 0 \end{aligned} \quad (39)$$

#### 5.4 Limitation of deflection

From 14.7 of BS 5268-2:1988, the recommended deflection limitation  $w_{max}$  (in mm) for general application is given by the equation

$$w_{max} = 0.003 L \quad (40)$$

The design equation limiting deflection<sup>2)</sup> is:

Uniform imposed load condition

$$w_{max} = \frac{5}{384} \frac{FL^4}{EI} + \frac{3}{20} \frac{FL^2}{Gbh} \quad (41)$$

Point imposed load condition

$$\begin{aligned} w_{max} &= \frac{5}{384} \frac{FL^4}{EI} + \frac{3}{20} \frac{FL^2}{Gbh} + \frac{1}{48} \frac{F_p L^3}{EI} + \\ & + \frac{3}{10} \frac{F_p L}{Gbh} \end{aligned} \quad (42)$$

where  $E$  is the mean modulus of elasticity.

Taking  $G$  as  $\frac{E}{16}$  (see clause 11 of BS 5268-2:1988):

Uniform imposed load condition

$$w_{max} = \frac{5}{384} \frac{FL^4}{EI} + \frac{12}{5} \frac{FL^2}{Ebh} \quad (43)$$

<sup>2)</sup> In addition to the deflection due to bending the shear deflection may be significant and has been taken into account.

Point imposed load condition

$$w_{\max} = \frac{5}{384} \frac{FL^4}{EI} + \frac{12}{5} \frac{FL^2}{Ebh} + \frac{1}{48} \frac{F_p L^3}{EI} + \frac{24}{5} \frac{F_p L}{Ebh} \quad (44)$$

or, inserting the expressions for equivalent uniformly distributed load,

$$w_{\max} = \left\{ \frac{1000 \times 1.6F_p}{L} + F_d \left( \frac{s}{1000} \right) + F_j \right\} \times \frac{5}{384} \frac{L^4}{EI} + \left\{ \frac{1000 \times 2F_p}{L} + F_d \left( \frac{s}{1000} \right) + F_j \right\} \times \frac{12}{5} \frac{L^2}{Ebh} \quad (45)$$

With a deflection limitation of  $0.003 L$

With access

Uniform imposed load condition

$$0.003 L = \left\{ (1.5 + F_d) \left( \frac{s}{1000} \right) + F_j \right\} \times \left( \frac{5}{384} \frac{L^4}{E} \frac{12}{bh^3} + \frac{12}{5} \frac{L^2}{Ebh} \right) \quad (46)$$

Point imposed load condition

$$0.003 L = \left\{ \frac{2880}{L} + F_d \left( \frac{s}{1000} \right) + F_j \right\} \times \frac{5}{384} \frac{L^4}{E} \frac{12}{bh^3} + \left\{ \frac{3600}{L} + F_d \left( \frac{s}{1000} \right) + F_j \right\} \times \frac{12}{5} \frac{L^2}{Ebh} \quad (47)$$

Without access

Uniform imposed load condition

$$0.003 L = \left\{ (0.75 + F_d) \left( \frac{s}{1000} \right) + F_j \right\} \times \left( \frac{5}{384} \frac{L^4}{E} \frac{12}{bh^3} + \frac{12}{5} \frac{L^2}{Ebh} \right) \quad (48)$$

Point imposed load condition

$$0.003 L = \left\{ \frac{1440}{L} + F_d \left( \frac{s}{1000} \right) + F_j \right\} \times \frac{5}{384} \frac{L^4}{E} \frac{12}{bh^3} + \left\{ \frac{1800}{L} + F_d \left( \frac{s}{1000} \right) + F_j \right\} \times \frac{12}{5} \frac{L^2}{Ebh} \quad (49)$$

NOTE These equations lead to the following polynomials in  $L$ .  
With access

Uniform imposed load condition

$$\frac{5}{32Ebh^3} \left\{ (1.5 + F_d) \left( \frac{s}{1000} \right) + F_j \right\} L^3 + \frac{12}{5Ebh} \left\{ (1.5 + F_d) \left( \frac{s}{1000} \right) + F_j \right\} L - 0.003 = 0 \quad (50)$$

Point imposed load condition

$$\frac{5}{32Ebh^3} \left\{ F_d \left( \frac{s}{1000} \right) + F_j \right\} L^3 + \frac{450}{Ebh^3} L^2 + \frac{12}{5Ebh} \left\{ F_d \left( \frac{s}{1000} \right) + F_j \right\} L + \frac{8640}{Ebh} - 0.003 = 0 \quad (51)$$

Without access

Uniform imposed load condition

$$\frac{5}{32Ebh^3} \left\{ (0.75 + F_d) \left( \frac{s}{1000} \right) + F_j \right\} L^3 + \frac{12}{5Ebh} \left\{ (0.75 + F_d) \left( \frac{s}{1000} \right) + F_j \right\} L - 0.003 = 0 \quad (52)$$

Point imposed load condition

$$\frac{5}{32Ebh^3} \left\{ F_d \left( \frac{s}{1000} \right) + F_j \right\} L^3 + \frac{225}{Ebh^3} L^2 + \frac{12}{5Ebh} \left\{ F_d \left( \frac{s}{1000} \right) + F_j \right\} L + \frac{4320}{Ebh} - 0.003 = 0 \quad (53)$$

## 5.5 Permissible clear spans

The calculation of clear span requires the deduction of a notional bearing length from an effective span.

The calculation of the notional bearing length to be deducted from the permissible effective span to produce the clear span is made after finding  $L_{adm}$ , the smallest of the effective spans for a given cross section, as limited by:

- bending stress under uniform imposed load;
- bending stress under point imposed load;
- bending stress under long term load alone;
- shear stress under uniform imposed load;
- shear stress under point imposed load;

- f) shear stress under long term load alone;  
g) deflection under uniform imposed load;  
h) deflection under point imposed load.

From BS 5268-2, the permissible compression perpendicular to the grain stress,  $\sigma_{c,\perp,adm}$  (in N/mm<sup>2</sup>) is given by the equation

$$\sigma_{c,\perp,adm} = \sigma_{c,\perp,g} K_3 K_8 \quad (54)$$

where

$\sigma_{c,\perp,g}$  is the grade compression perpendicular to the grain stress (in N/mm<sup>2</sup>) (see BS 5268-2)<sup>a</sup>;

$K_3$  is the load duration modification factor, 1.0 for long term, 1.25 for medium term or 1.5 for short term (see Table 17 of BS 5268-2:1988);

$K_8$  is the load sharing modification factor, 1.1 [see clause 13 item a) of BS 5268-2:1988].

<sup>a</sup> BS 5268-2 provides two values for the grade compression perpendicular to the grain stress. When the specification specifically prohibits wane at bearing areas, the higher value may be used, otherwise the lower value applies. (See footnotes to Table 9, Table 10, Table 11, Table 12 and Table 13 in BS 5268-2:1988). The span table should indicate whether wane is permitted.

The notional bearing length  $a$  (in mm) required at each end should be found from the equation

$$\sigma_{c,\perp,adm} ba = \text{support reaction} \quad (55)$$

where  $b$  is the breadth of the joist (in mm).

Inserting appropriate expressions for the support reaction, equation (54) gives the following equations.

With access

Uniform imposed load condition

$$\sigma_{c,\perp,g} \times 1.25 \times 1.1 \times ba = \left\{ (1.5 + F_d) \left( \frac{s}{1000} \right) + F_j \right\} \frac{L_{adm}}{2} \quad (56)$$

Point imposed load condition with bending stress or deflection governing

$$\sigma_{c,\perp,g} \times 1.5 \times 1.1 \times ba = \left\{ \frac{1800}{L_{adm}} + F_d \left( \frac{s}{1000} \right) + F_j \right\} \frac{L_{adm}}{2} \quad (57)$$

Point imposed load condition with shear stress governing

$$\sigma_{c,\perp,g} \times 1.5 \times 1.1 \times ba = \left\{ \frac{3600}{L_{adm}} + F_d \left( \frac{s}{1000} \right) + F_j \right\} \frac{L_{adm}}{2} \quad (58)$$

Long term load condition, i.e. dead load and self weight alone

$$\sigma_{c,\perp,g} \times 1.0 \times 1.1 \times ba = \left\{ F_d \left( \frac{s}{1000} \right) + F_j \right\} \frac{L_{adm}}{2} \quad (59)$$

Without access

Uniform imposed load condition

$$\sigma_{c,\perp,g} \times 1.25 \times 1.1 \times ba = \left\{ (0.75 + F_d) \left( \frac{s}{1000} \right) + F_j \right\} \frac{L_{adm}}{2} \quad (60)$$

Point imposed load condition with bending stress or deflection governing

$$\sigma_{c,\perp,g} \times 1.5 \times 1.1 \times ba = \left\{ \frac{900}{L_{adm}} + F_d \left( \frac{s}{1000} \right) + F_j \right\} \frac{L_{adm}}{2} \quad (61)$$

Point imposed load condition with shear stress governing

$$\sigma_{c,\perp,g} \times 1.5 \times 1.1 \times ba = \left\{ \frac{1800}{L_{adm}} + F_d \left( \frac{s}{1000} \right) + F_j \right\} \frac{L_{adm}}{2} \quad (62)$$

Long term load condition, i.e. dead load and self weight alone

$$\sigma_{c,\perp,g} \times 1.0 \times 1.1 \times ba = \left\{ F_d \left( \frac{s}{1000} \right) + F_j \right\} \frac{L_{adm}}{2} \quad (63)$$

In equations (56) to (63)

$a$  is the notional bearing length (in mm);

$b$  is the breadth of the joist (in mm);

$L_{adm}$  is the permissible effective span (in mm).

The equation corresponding to the loading condition governing the permissible effective span should be solved for  $a$ , and half the value of  $a$  should be deducted from each end of the span (total deduction  $a$ , see Figure 1) to give the permissible clear span.  $L_{cl}$  (in mm) is given by the equation

$$L_{cl} = L_{adm} - a \quad (64)$$

## 6 Bearing length

Although correct for the calculation of clear span the procedure given in 5.5 for the calculation of notional bearing length may not ensure that the permissible compression perpendicular to the grain stress is not exceeded for all loading cases.

The design of some members may be governed by a loading case which does not represent the greatest total load of all loading cases. For example, the governing design case may include a concentrated load, but another less critical loading case may consist of a greater total load uniformly distributed along the span.

## 7 Information to be given in span tables

There are many possible formats for span tables. A typical format suitable for flat roof joists at predetermined centres and for quoted loading is given in Appendix B.

This Section of BS 5268 does not recommend formats for different components but whatever format is used the following information should be given in the heading or in the main body or in the footnotes of the span tables, or in an introduction to the tables:

- a) the loading;
- b) details of the arrangement of the members;
- c) the member sizes and their maximum permissible deviations and/or the standards that define these quantities;
- d) the species, stress grade or strength class and/or the standards that define these properties;
- e) a statement specifying any requirements additional to those given in the stress grading rules, e.g. whether wane is prohibited at bearings;
- f) a statement that the spans have been calculated in accordance with the recommendations of BS 5268-2 and BS 5268-7.2;
- g) a statement specifying any structural requirements that may be necessary to comply with the qualifying assumptions made in 4.2, e.g. lateral support requirements, accommodation of lateral thrust at supports;
- h) the permissible clear spans.

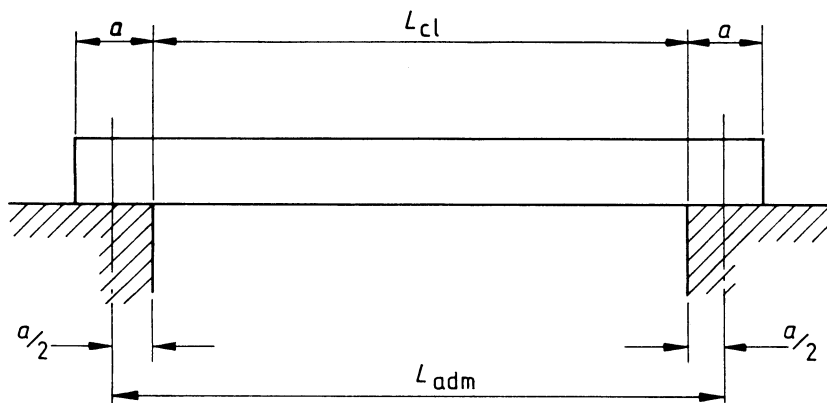


Figure 1 — Bearing length, permissible effective and permissible clear span

## Appendix A Sample calculations for a flat roof joist

The object is to find the permissible clear span, given the following data as applicable to a particular design case.

<b>Timber</b>	Strength class SC3		(See Table 3 to Table 6 of BS 5268-2:1988)
<b>Dimensions</b>	Joist breadth, $b$	= 50 mm	
	Joist depth, $h$	= 195 mm	
	Joist spacing, $s$	= 600 mm	
<b>Loading</b> (without access)	Dead load $F_d$	= 0.50 kN/m <sup>2</sup>	[see 4.3 b)]
	Imposed load	= 0.75 kN/m <sup>2</sup> or = 0.9 kN	[see 4.3 a)]

The following data are given in BS 5268-2:1988.

<b>Grade stresses and density</b>		<b>BS 5268-2:1988 reference</b>
Grade bending stress, $\sigma_{m,g}$	= 5.3 N/mm <sup>2</sup>	Table 9
Grade shear stress, $\tau_g$	= 0.67 N/mm <sup>2</sup>	Table 9
Grade mean modulus of elasticity, $E$	= 8 800 N/mm <sup>2</sup>	Table 9
Grade compression perpendicular to the grain stress (with wane permitted), $\sigma_{c,\perp,g}$	= 1.7 N/mm <sup>2</sup>	Table 9
Density, $\rho$	= 540 kg/m <sup>3</sup>	Table 9
<b>Modification factors</b>		
Uniform load, load duration, $K_3$	= 1.00 long term	Table 17
Uniform load, load duration, $K_3$	= 1.25 medium term	Table 17
Point load, load duration, $K_3$	= 1.5 short term	Table 17
Depth, $K_7$	= $(300/h)^{0.11}$	<b>14.6</b>
Load sharing, $K_8$	= 1.1	<b>13</b>
<b>Permissible stresses and recommended deflection limitation</b>		<b>BS 5268-7.2 reference</b>
Permissible bending stress, $\sigma_{m,adm}$ (in N/mm <sup>2</sup> )	$\sigma_{m,g} K_3 K_7 K_8$ = 7.641 N/mm <sup>2</sup> for uniform load (medium term) or = 9.175 N/mm <sup>2</sup> for point load or = 6.113 N/mm <sup>2</sup> for uniform load (long term)	<b>5.2</b>
Permissible shear stress, $\tau_{adm}$ (in N/mm <sup>2</sup> )	= $\tau_g K_3 K_8$ = 0.921 N/mm <sup>2</sup> for uniform load (medium term) or = 1.1055 N/mm <sup>2</sup> for point load or = 0.737 N/mm <sup>2</sup> for uniform load (long term)	<b>5.3</b>
Recommended deflection limitation, $w_{max}$ (in mm)	= 0.003 $L$	<b>5.4</b>

## BS 5268-7.2 reference

Permissible compression  
perpendicular to the grain  
stress,  $\sigma_{c,\perp,adm}$  (in N/mm<sup>2</sup>)

$$= \sigma_{c,\perp,g} K_3 K_8 \quad \mathbf{5.5}$$

$$= 2.3375 \text{ N/mm}^2 \text{ for uniform load}$$

(medium term)

$$\text{or} = 2.805 \text{ N/mm}^2 \text{ for point load}$$

$$\text{or} = 1.87 \text{ N/mm}^2 \text{ for uniform load}$$

(long term)

Application of the design equations from 5.2 to 5.4 leads to the following solutions for effective span,  $L$ ;

- |   |   |
|---|---|
| a) limitation of bending stress, uniform imposed load | $L = 4\,916 \text{ mm}$ [equation (20) or (23)];  |
| b) limitation of bending stress, point imposed load   | $L = 5\,964 \text{ mm}$ [equation (21) or (24)];  |
| c) limitation of bending stress, long term load alone | $L = 6\,638 \text{ mm}$ [equation (22) or (25)];  |
| d) limitation of shear stress, uniform imposed load   | $L = 1\,4940 \text{ mm}$ [equation (34) or (37)]; |
| e) limitation of shear stress, point imposed load     | $L = 35\,752 \text{ mm}$ [equation (35) or (38)]; |
| f) limitation of shear stress, long term load alone   | $L = 47\,517 \text{ mm}$ [equation (36) or (39)]; |
| g) limitation of deflection, uniform imposed load     | $L = 4\,230 \text{ mm}$ [equation (50) or (52)];  |
| h) limitation of deflection, point imposed load       | $L = 4\,484 \text{ mm}$ [equation (51) or (53)];  |

The permissible effective span  $L_{adm}$  is therefore

$$L_{adm} = 4\,230 \text{ mm}$$

The appropriate equation is selected from 5.5 to calculate the notional bearing length,  $a$ , as 15 mm.

The permissible clear span  $L_{cl}$  for the joists is then

$$L_{cl} = L_{adm} - a$$

$$L_{cl} = 4\,215 \text{ mm}$$

## Appendix B Specimen span tables for flat roof joists

There are many possible formats for span tables and Table 1, Table 2 and Table 3 are typical examples. Whatever format is used, the information listed in clause 7 should be given.

Table 1, Table 2 and Table 3 apply only to flat roofs where no access is provided to the roof (other than that necessary for cleaning and repair). The tables should not be used for the design of flat roofs with permanent access. Load span tables covering both types of loadings and covering a wider range of timber sizes are available from a number of trade organizations.

**Table 1 — Permissible clear spans for roof joists without access, imposed load 0.75 kN/m<sup>2</sup>: SC3<sup>a</sup>, regularised sizes<sup>b</sup>**

Size of joist	Dead load per square metre (in kN/m <sup>2</sup> ) supported by joist, excluding the self weight of the joist								
	Not more than 0.50 (51 kg/m <sup>2</sup> )			More than 0.50 but not more than 0.75 (76.5 kg/m <sup>2</sup> )			More than 0.75 but not more than 1.00 (102 kg/m <sup>2</sup> )		
	Centre-to-centre spacing of joists (in mm)								
	400	450	600	400	450	600	400	450	600
Permissible clear span									
mm	m	m	m	m	m	m	m	m	m
38 × 72	1.145	1.136	1.109	1.109	1.096	1.063	1.077	1.063	1.024
	1.738	1.719	1.666	1.666	1.642	1.578	1.605	1.578	1.507
	2.368	2.336	2.250	2.250	2.212	2.113	2.155	2.113	2.005
	3.020	2.974	2.851	2.851	2.797	2.659	2.717	2.659	2.511
	3.631	3.571	3.368	3.412	3.342	3.166	3.239	3.166	2.980
	4.303	4.226	3.855	4.025	3.939	3.629	3.810	3.719	3.446
	4.943	4.762	4.340	4.641	4.491	4.087	4.383	4.274	3.881
44 × 72	1.231	1.221	1.191	1.191	1.177	1.139	1.155	1.139	1.096
	1.861	1.840	1.781	1.781	1.755	1.685	1.714	1.685	1.607
	2.527	2.492	2.399	2.399	2.357	2.249	2.295	2.249	2.133
	3.214	3.164	3.031	3.031	2.973	2.824	2.886	2.824	2.665
	3.856	3.791	3.535	3.620	3.545	3.329	3.435	3.356	3.157
	4.559	4.436	4.044	4.262	4.170	3.810	4.033	3.936	3.620
	5.175	4.988	4.551	4.888	4.708	4.289	4.632	4.480	4.076
47 × 72	1.272	1.260	1.229	1.229	1.214	1.175	1.192	1.175	1.130
	1.919	1.896	1.835	1.835	1.808	1.735	1.765	1.735	1.654
	2.602	2.565	2.468	2.468	2.425	2.313	2.360	2.313	2.192
	3.304	3.252	3.115	3.115	3.055	2.900	2.964	2.900	2.736
	3.960	3.892	3.612	3.716	3.639	3.402	3.525	3.444	3.232
	4.677	4.530	4.132	4.372	4.277	3.893	4.136	4.037	3.700
	5.282	5.093	4.649	4.991	4.808	4.383	4.747	4.577	4.166
50 × 72	1.310	1.299	1.266	1.266	1.250	1.209	1.227	1.209	1.162
	1.974	1.950	1.887	1.887	1.858	1.782	1.814	1.782	1.699
	2.672	2.635	2.534	2.534	2.489	2.373	2.422	2.373	2.249
	3.390	3.336	3.194	3.194	3.132	2.973	3.039	2.973	2.804
	4.059	3.989	3.685	3.807	3.729	3.472	3.611	3.528	3.300
	4.789	4.618	4.215	4.476	4.360	3.973	4.234	4.132	3.777
	5.383	5.192	4.742	5.088	4.904	4.472	4.847	4.669	4.252
63 × 147	3.722	3.662	3.444	3.503	3.434	3.246	3.330	3.256	3.069
	4.439	4.345	3.969	4.161	4.074	3.744	3.945	3.853	3.561
	5.141	4.961	4.537	4.864	4.689	4.282	4.612	4.468	4.074
	5.771	5.572	5.101	5.464	5.270	4.816	5.212	5.024	4.585
75 × 195	5.415	5.229	4.791	5.129	4.949	4.526	4.894	4.719	4.310
	6.074	5.869	5.383	5.758	5.558	5.088	5.497	5.303	4.847

NOTE 1 The tables are computed on the basis that the specification does not exclude wane at bearings.

NOTE 2 The spans have been calculated in accordance with the recommendations of BS 5268-2 and BS 5268-7.2. Lateral support should be provided in accordance with 14.8 of BS 5268-2:1988.

NOTE 3 The material should be stress graded in accordance with BS 4978.

NOTE 4 The sizes and their maximum permissible deviations should be in accordance with BS 4471.

<sup>a</sup> For species/grade combinations in this strength class, see Table 3 to Table 7 of BS 5268-2:1988.

<sup>b</sup> Regularized sizes are given in BS 4471.



**Table 2 — Permissible clear spans for roof joists without access, imposed load 0.75 kN/m<sup>2</sup>: redwood/whitewood, SS grade, basic sizes<sup>a</sup>**

Size of joist	Dead load per square metre (in kN/m <sup>2</sup> ) supported by joist, excluding the self weight of the joist								
	Not more than 0.50 (51 kg/m <sup>2</sup> )			More than 0.50 but not more than 0.75 (76.5 kg/m <sup>2</sup> )			More than 0.75 but not more than 1.00 (102 kg/m <sup>2</sup> )		
	Centre-to-centre spacing of joists (in mm)								
	400	450	600	400	450	600	400	450	600
Permissible clear span									
mm	m	m	m	m	m	m	m	m	m
38 × 75	1.325	1.313	1.279	1.279	1.264	1.221	1.239	1.221	1.173
	1.971	1.947	1.883	1.883	1.854	1.778	1.810	1.778	1.694
	2.651	2.613	2.512	2.512	2.468	2.352	2.401	2.352	2.228
	3.352	3.298	3.157	3.157	3.095	2.936	3.002	2.936	2.768
	4.065	3.994	3.684	3.808	3.728	3.468	3.609	3.524	3.294
	4.783	4.611	4.201	4.463	4.348	3.957	4.218	4.115	3.758
	5.368	5.172	4.716	5.067	4.880	4.443	4.823	4.642	4.222
44 × 75	1.422	1.409	1.371	1.371	1.354	1.307	1.327	1.307	1.254
	2.107	2.081	2.010	2.010	1.979	1.895	1.930	1.895	1.804
	2.826	2.784	2.674	2.674	2.626	2.500	2.553	2.500	2.366
	3.563	3.505	3.322	3.352	3.285	3.114	3.185	3.114	2.934
	4.310	4.234	3.865	4.035	3.949	3.641	3.822	3.731	3.460
	5.012	4.831	4.406	4.720	4.558	4.152	4.460	4.337	3.947
	5.618	5.417	4.945	5.308	5.114	4.662	5.055	4.868	4.432
47 × 75	1.468	1.453	1.414	1.414	1.396	1.347	1.368	1.347	1.292
	2.170	2.143	2.069	2.069	2.036	1.950	1.986	1.950	1.855
	2.907	2.864	2.750	2.750	2.699	2.569	2.624	2.569	2.431
	3.661	3.601	3.394	3.442	3.373	3.197	3.270	3.197	3.011
	4.424	4.330	3.949	4.140	4.051	3.721	3.920	3.827	3.536
	5.116	4.932	4.501	4.833	4.656	4.243	4.571	4.431	4.034
	5.734	5.529	5.050	5.419	5.222	4.763	5.162	4.972	4.529
50 × 75	1.511	1.496	1.455	1.455	1.436	1.385	1.407	1.385	1.328
	2.231	2.203	2.126	2.126	2.092	2.002	2.040	2.002	1.904
	2.984	2.940	2.821	2.821	2.769	2.635	2.691	2.635	2.492
	3.754	3.692	3.463	3.528	3.457	3.263	3.351	3.276	3.085
	4.531	4.416	4.029	4.240	4.149	3.797	4.014	3.919	3.610
	5.215	5.028	4.591	4.928	4.748	4.329	4.677	4.520	4.117
	5.843	5.636	5.151	5.525	5.325	4.859	5.264	5.071	4.622
63 × 150	4.114	4.044	3.731	3.862	3.783	3.518	3.665	3.581	3.346
	4.919	4.745	4.338	4.624	4.484	4.093	4.377	4.272	3.894
	5.594	5.399	4.940	5.293	5.105	4.663	5.047	4.865	4.439
	6.262	6.046	5.538	5.930	5.721	5.231	5.658	5.455	4.981
75 × 200	5.890	5.689	5.215	5.580	5.385	4.928	5.326	5.137	4.694
	6.588	6.367	5.843	6.247	6.032	5.525	5.966	5.757	5.264

NOTE 1 The tables are computed on the basis that the specification does not exclude wane at bearings.  
NOTE 2 The spans have been calculated in accordance with the recommendations of BS 5268-2 and BS 5268-7.2. Lateral support should be provided in accordance with 14.8 of BS 5268-2:1988.  
NOTE 3 The material should be stress graded in accordance with BS 4978.  
NOTE 4 The sizes and their maximum permissible deviations should be in accordance with BS 4471.  
<sup>a</sup> Basic sizes are given in BS 4471.

**Table 3 — Permissible clear spans for roof joists without access, imposed load 0.75 kN/m<sup>2</sup>: spruce-pine-fir, joist and plank no. 2 grade, CLS sizes<sup>a</sup>**

Size of joist	Dead load per square metre (in kN/m <sup>2</sup> ) supported by joist, excluding the self weight of the joist								
	Not more than 0.50 (51 kg/m <sup>2</sup> )			More than 0.50 but not more than 0.75 (76.5 kg/m <sup>2</sup> )			More than 0.75 but not more than 1.00 (102 kg/m <sup>2</sup> )		
	Centre-to-centre spacing of joists (in mm)								
	400	450	600	400	450	600	400	450	600
	Permissible clear span								
mm	m	m	m	m	m	m	m	m	m
38 × 114	2.190	2.162	2.085	2.085	2.051	1.962	1.999	1.962	1.864
140	2.872	2.829	2.714	2.714	2.664	2.533	2.588	2.533	2.394
184	4.064	3.991	3.678	3.804	3.723	3.460	3.602	3.517	3.284
235	5.336	5.139	4.680	5.033	4.844	4.405	4.788	4.605	4.183
285	6.438	6.203	5.655	6.077	5.851	5.326	5.783	5.566	5.060

NOTE 1 The tables are computed on the basis that the specification does not exclude wane at bearings.  
NOTE 2 The spans have been calculated in accordance with the recommendations of BS 5268-2 and BS 5268-7.2. Lateral support should be provided in accordance with 14.8 of BS 5268-2:1988.  
NOTE 3 The material should be stress graded in accordance with NLGA rules.  
NOTE 4 The sizes and their maximum permissible deviations should be in accordance with Appendix A of BS 4471:1987.  
<sup>a</sup> CLS sizes are given in Appendix A of BS 4471:1987.



## Publications referred to

- BS 648, *Schedule of weights of building materials*.
- BS 4471, *Specification for sizes of sawn and processed softwood*.
- BS 4471-1, *Sizes of sawn and planed timber*.
- BS 4978, *Specification for timber grades for structural use*.
- BS 5268, *Structural use of timber*.
- BS 5268-2, *Code of practice for permissible stress design, materials and workmanship*.
- BS 5268-3, *Code of practice for trussed rafter roofs*.
- BS 5268-7.1, *Domestic floor joists<sup>3)</sup>*.
- BS 5268-7.3, *Ceiling joists<sup>3)</sup>*.
- BS 5268-7.4, *Ceiling binders<sup>3)</sup>*.
- BS 5268-7.5, *Rafters<sup>3)</sup>*.
- BS 5268-7.6, *Purlins supporting rafters<sup>3)</sup>*.
- BS 5268-7.7, *Purlins supporting sheeting or decking<sup>3)</sup>*.
- BS 6100, *Glossary of building and civil engineering terms*.
- BS 6100-2.1, *Structural design and elements*.
- BS 6100-4.1, *Characteristics and properties of timber and wood based panel products*.
- BS 6100-4.2, *Sizes and quantities of solid timber*.
- BS 6100-4.3, *Wood based panel products*.
- BS 6100-4.4, *Carpentry and joinery*.
- BS 6399, *Loading for buildings*.
- BS 6399-1, *Code of practice for dead and imposed loads*.
- BS 6399-3, *Code of practice for imposed roof loads*.
- ISO 3898, *Bases for design of structures — Notations — General symbols*.
- CIB-W18-1, *Symbols for use in structural timber design*. International Council for Building Research Studies and Documentation, Post Box 20704, 3001 JA Rotterdam, The Netherlands.
- NLGA 1979, *The national grading rules for dimension lumber*. National Lumber Grades Authority, 1450-1055 West Hastings Street, Vancouver, British Columbia, Canada V6E 2G8.

---

<sup>3)</sup> Referred to in the foreword only.

---

---

## BSI — British Standards Institution

BSI is the independent national body responsible for preparing British Standards. It presents the UK view on standards in Europe and at the international level. It is incorporated by Royal Charter.

### Revisions

British Standards are updated by amendment or revision. Users of British Standards should make sure that they possess the latest amendments or editions.

It is the constant aim of BSI to improve the quality of our products and services. We would be grateful if anyone finding an inaccuracy or ambiguity while using this British Standard would inform the Secretary of the technical committee responsible, the identity of which can be found on the inside front cover. Tel: 020 8996 9000. Fax: 020 8996 7400.

BSI offers members an individual updating service called PLUS which ensures that subscribers automatically receive the latest editions of standards.

### Buying standards

Orders for all BSI, international and foreign standards publications should be addressed to Customer Services. Tel: 020 8996 9001. Fax: 020 8996 7001.

In response to orders for international standards, it is BSI policy to supply the BSI implementation of those that have been published as British Standards, unless otherwise requested.

### Information on standards

BSI provides a wide range of information on national, European and international standards through its Library and its Technical Help to Exporters Service. Various BSI electronic information services are also available which give details on all its products and services. Contact the Information Centre. Tel: 020 8996 7111. Fax: 020 8996 7048.

Subscribing members of BSI are kept up to date with standards developments and receive substantial discounts on the purchase price of standards. For details of these and other benefits contact Membership Administration. Tel: 020 8996 7002. Fax: 020 8996 7001.

### Copyright

Copyright subsists in all BSI publications. BSI also holds the copyright, in the UK, of the publications of the international standardization bodies. Except as permitted under the Copyright, Designs and Patents Act 1988 no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means – electronic, photocopying, recording or otherwise – without prior written permission from BSI.

This does not preclude the free use, in the course of implementing the standard, of necessary details such as symbols, and size, type or grade designations. If these details are to be used for any other purpose than implementation then the prior written permission of BSI must be obtained.

If permission is granted, the terms may include royalty payments or a licensing agreement. Details and advice can be obtained from the Copyright Manager. Tel: 020 8996 7070.