



Specification for

Unplasticized PVC pipe and fittings for gravity sewers

UDC 628.24:621.643:678.743.22

Cooperating organizations

The Plastics Standards Committee, under whose direction this British Standard was prepared, consists of representatives from the following Government departments and scientific and industrial organizations:

British Plastics Federation*	Electrical Research Association
British Resin Manufacturers' Association	Engineering Equipment Users' Association*
Chemical Industries Association Limited*	Institution of Production Engineers
Department of the Environment — Building Research Establishment	Ministry of Defence*
Department of Industry — Chemicals and Textiles	Plastics and Rubber Institute
Department of Industry — National Physical Laboratory	Post Office
Electrical and Electronic Insulation Association	Royal Institute of British Architects*
Electrical Installation Equipment Manufacturers' Association	Rubber and Plastics Research Association of Great Britain
	Society of Chemical Industry
	Society of Motor Manufacturers and Traders Limited*

The organizations marked with an asterisk in the above list, together with the following, were directly represented on the committee entrusted with the preparation of this British Standard:

Agrément Board	Institution of Civil Engineers
British Chemical and Dyestuff Traders' Association Limited	Institution of Municipal Engineers
British Gas Corporation	Institution of Public Health Engineers
British Rubber Manufacturers' Association	Institution of Water Engineers and Scientists
British Valve Manufacturers' Association	Lloyd's Register of Shipping
Copper Tube Fittings Manufacturers' Association	Ministry of Agriculture, Fisheries and Food
Department of the Environment — Property Services Agency	National Association of Plumbing, Heating and Mechanical Services Contractors
Electricity Supply Industry in England and Wales	National Water Council
Environmental Health Officers' Association	Pitch Fibre Pipe Association of Great Britain
Greater London Council	Royal Society of Health
Institute of Plumbing	Society of Builders' Merchants
	Water Companies Association
	Water Research centre

This British Standard, having been prepared under the direction of the Plastics Standards Committee, was published under the authority of the Executive Board on 31 August 1977

© BSI 02-1999

The following BSI references relate to the work on this standard:

Committee reference PLC/9
Draft for comment 74/54532

ISBN 0 580 09604 1

Amendments issued since publication

Amd. No.	Date of issue	Comments
3631	September 1981	
4436	December 1983	Indicated by a sideline in the margin

Contents

	Page
Cooperating organizations	Inside front cover
Foreword	ii
<hr/>	
1 Scope	1
2 References	1
3 Material	1
4 Colour	1
5 Dimensions and construction	1
6 Fittings	2
7 Marking	3
8 Testing	3
9 Sealing components	4
<hr/>	
Appendix A Heat reversion test for pipe	9
Appendix B Stress relief test for injection mouldings	9
Appendix C Stress rupture test for pipe	10
Appendix D Drop test for fabricated fittings	10
Appendix E Negative pressure test for ring seal joints	10
Appendix F Hydrostatic pressure test for solvent cement joints	11
Appendix G Test for impact resistance at 20 °C	11
Appendix H Explanation of symbols used in tables and figures	12
<hr/>	
Figure 1 — Effective length of pipe	5
Figure 2 — Socket dimensions	6
Figure 2a — Positions for measurement of snap cap wall thicknesses	5
Figure 3 — Schematic illustrations of typical fittings (including saddles)	7
Figure 4 — Spigot length of fitting	8
Figure 5 — Essential features of apparatus for diameter distortion test with negative pressure	11
Figure 6 — Suitable type of impact testing machine	14
Figure 7 — Chart for true impact rate (TIR) for test at 20 °C	15
<hr/>	
Table 1 — Dimensions of pipe and fittings	1
Table 2 — Dimensions of spigot ends and sockets with sealing rings	2
Table 3 — Dimensions of solvent cement sockets	2
Table 4 — Minimum radius (<i>R</i>) for long bends made from extruded pipe	2
Table 5 — Type tests	3
Table 6 — Test parameters for impact resistance requirements	3
Table 7 — Test parameters for stress rupture requirement for pipe	4
Table 8 — Quality control tests	5
Table 9 — Number of equally spaced lines to be drawn on test specimens	12
Publications referred to	Inside back cover
<hr/>	

Foreword

This British Standard has been prepared under the authority of the Plastics Standards Committee. Requirements are specified for unplasticized PVC pipe and fittings for underground sewers of either the combined or separate pipe systems intended for the disposal of surface water, domestic effluent and such effluent as is permitted by the statutory drainage authorities to be discharged into public sewers by the Public Health Act 1936, and of surface water and sewage as is permitted and defined by the Sewerage (Scotland) Act 1968. This standard covers pipe and fittings with nominal diameters in the range 200 mm to 630 mm inclusive. For sizes below 200 mm, see BS 4660.

Outside diameters included in this standard are in accordance with Table 2 of BS 3867:1969 and are in technical agreement with ISO 161-1. In the preparation of this standard attention has been given to the work of ISO/TC 138, Plastics pipes and fittings for the transport of fluids. In particular, the symbols used in tables and figures (see Appendix H) are in accordance with the ISO standards prepared by this committee.

The preliminary document of similar scope under international study includes pipe with four different values of the standard dimension ratio (SDR), which is the ratio of the outside diameter of the pipe to its minimum wall thickness. In this standard only pipe with an SDR of 41 is specified; the thinner walled pipe of SDR 65 and SDR 51 is intended for specialized application, e.g. the relining of existing sewers whilst the thicker walled pipe of SDR 34 is intended for the particularly onerous duty found in some countries.

Pipe and fittings complying with the requirements of this standard and made in accordance with good commercial practice are clean, smooth and reasonably free from grooving and other defects likely to impair their performance. Furthermore, the ends of pipes and fittings made in accordance with good commercial practice are cleanly cut and square with the axis of the component and the pipes are reasonably straight.

Certification. It is strongly recommended that in view of the nature of this specification manufacturers and purchasers should make use of the certification facilities described on the inside back cover of this standard.

A British Standard does not purport to include all the necessary provisions of a contract. Users of British Standards are responsible for their correct application.

Compliance with a British Standard does not of itself confer immunity from legal obligations.

Summary of pages

This document comprises a front cover, an inside front cover, pages i and ii, pages 1 to 16, an inside back cover and a back cover.

This standard has been updated (see copyright date) and may have had amendments incorporated. This will be indicated in the amendment table on the inside front cover.

1 Scope

This British Standard specifies requirements for unplasticized PVC pipe, fittings and accessories suitable for the construction of drains including foul and surface water sewers. The standard covers pipe and fittings with nominal diameters in the range 200 mm to 630 mm together with necessary joints and accessories. If it is proposed to use these pipes and fittings with untreated trade waste or with discharges at elevated temperatures, reference should be made to CP 312-1 and/or to the manufacturer concerning the suitability of the material for the intended service.

2 References

The titles of the standards publications referred to in this standard are listed on the inside back cover.

3 Material

3.1 Except as provided for in clause 9, the material from which the pipe and fittings are produced shall consist substantially of polyvinyl chloride. Only those additives may be used that are needed for the manufacture of the polymer and for its subsequent conversion into sound, durable extrusions or mouldings of good surface finish and mechanical strength, together with such pigments as are necessary to meet the requirements of clause 4.

3.2 The use of the manufacturer's own clean rework material, complying with the requirements of this standard, is permissible. No other rework material shall be used.

4 Colour

Pipe and fittings made from unplasticized PVC shall be golden brown approximating to colour 414 of BS 381C:1980 or colour 06 D 45 of BS 4901:1976. The colour known as RAL 8023 is also acceptable. The requirements of this clause need not apply to snap caps (see clause 9) which may be supplied alternatively in black or grey as agreed between the purchaser and the supplier.

5 Dimensions and construction

5.1 Pipe

5.1.1 Pipe dimensions shall be in accordance with Table 1.

5.1.2 Pipe shall normally be delivered in effective lengths (see Figure 1) of 3 m, 6 m and 9 m. Other lengths may be supplied as agreed between the purchaser and the vendor.

5.1.3 The basic dimensions of integral sockets with sealing rings shall be in accordance with Table 2 and Figure 2.

5.1.4 The basic dimensions of integral solvent cement sockets shall be in accordance with Table 3 and Figure 2.

Table 1 — Dimensions of pipe and fittings

All dimensions are in millimetres

Nominal size ^a	Mean outside diameter ^b of pipe and spigots		Extreme individual outside diameter of pipes and spigots		Wall thickness "e" of pipes and of bodies and spigots of fittings ^c
	Min.	Max.	Min.	Max.	Min.
200	200.0	200.6	196.3	204.3	4.9
250	250.0	250.7	245.4	255.4	6.1
315	315.0	315.9	309.2	321.8	7.7
(355)	355.0	356.0	348.4	362.6	8.7
400	400.0	401.0	392.5	408.5	9.8
(450)	450.0	451.0	441.5	459.5	11.0
500	500.0	501.0	490.5	510.5	12.2
(560)	560.0	561.0	549.3	571.7	13.7
630	630.0	631.0	617.9	643.1	15.4

^a Non-preferred sizes are indicated in parentheses
^b Mean outside diameter is defined as the arithmetic mean of any two diameters at right angles to each other.
^c These values of wall thickness are for a standard dimension ratio (SDR) of 41 (see foreword).

5.2 Fittings

5.2.1 Injection moulded fittings

5.2.1.1 Fittings having sockets with sealing rings shall conform to the relevant dimensions given in Table 1 and Table 2 and Figure 2, except that fittings or those parts of fittings not intended to come into contact with the fluid being transported are not required to comply with the wall thicknesses given in Table 2. Typical fittings are schematically illustrated in Figure 3.

The positions for measuring the wall thickness dimensions of a typical snap cap shall be as illustrated in Figure 2a.

5.2.1.2 Fittings having solvent cement sockets shall be in accordance with Table 1 and Table 3 and Figure 2. Typical fittings are schematically illustrated in Figure 3.

5.2.2 *Fabricated fittings manufactured from pipe complying with this standard.* Sockets and spigot ends shall meet the requirements laid down for injection moulded fittings. In the case of long bends, fabricated by drawing pipe, minimum radii shall be in accordance with Table 4 (see also Figure 3). The wall thickness of such bends may be reduced to the values given for e_2 in Table 2.

Table 2 — Dimensions of spigot ends and sockets with sealing rings (see Figure 2)

All dimensions are in millimetres

Nominal size (outside diameter d_e) (see note 1)	Socket							Spigot end
	d_1 min.	A min.	B min.	C max.	e min.	e_2 min.	e_3 min.	(see Figure 4) min. E
200	200.7	50	12	40	4.9	4.4	3.7	99
250	250.8	55	18	70	6.1	5.5	4.6	134
315	316.0	62	20	70	7.7	6.9	5.8	144
(355)	356.1	66	22	70	8.7	7.8	6.5	149
400	401.1	70	24	70	9.8	8.8	7.3	155
(455)	451.1	75	26	75	11.0	9.9	8.2	166
500	501.1	80	28	80	12.2	11.0	9.1	178
(560)	561.1	86	31	86	13.7	12.3	10.3	192
630	631.1	93	34	93	15.4	13.9	11.5	209

NOTE 1 Non-preferred sizes are indicated in parentheses.

NOTE 2 d_1 maximum depends on the shape, the dimensions and the hardness of the rubber rings, which are designed and fixed by the manufacturer.NOTE 3 For constructions in which the rubber ring is firmly fixed in the groove of the socket the requirement for a minimum value for dimension B shall not apply.**Table 3 — Dimensions of solvent cement sockets** (see Figure 2)

All dimensions are in millimetres

Nominal size (outside diameter d_e)	d_2 min.	d_2 max.	A_1 min.	e min.	e_2 min.	Spigot end (see Figure 4) E min.
200	200.1	200.6	76	4.9	4.4	99
250	250.1	250.7	94	6.1	5.5	134
315	315.3	315.9	116	7.7	6.9	134

NOTE It is possible for the solvent weld technique to be used on larger diameters of pipes and fittings but it is essential that the manufacturer's special jointing instructions are strictly adhered to during construction.

5.3 Chamfer. Spigot ends of pipes and fittings shall be chamfered.

6 Fittings

6.1 Range of fittings. Fittings covered by this standard include bends, sockets, reducers and branches. They shall comply with the relevant requirements given in clause 5 and Table 1, Table 2, Table 3 and Table 4. Examples of fittings are illustrated in Figure 3. Other fittings complying with the relevant requirements of this standard are permitted, whether they are illustrated or not.

Table 4 — Minimum radius (R) for long bends made from extruded pipe

All dimensions are in millimetres

Nominal size (see note)	Minimum radius (R) (measured to the centre line)
200	905
250	1 130
315	1 425
(355)	1 605
400	1 805
(450)	2 030
500	2 255
(560)	2 525
630	2 840

NOTE Non-preferred sizes are indicated in parentheses.

6.2 Swept fittings. Fittings such as bends, branches or saddles for angles greater than 45° may be swept and in this case shall have a throat radius of not less than 60 mm (see Figure 4).

6.3 Unequal fittings and adaptors

6.3.1 Where a fitting or adaptor provides for a transition between pipes and/or fittings of two nominal sizes of this standard, the wall thickness of each part of the fitting or adaptor shall comply with the requirements for the nominal size for that part.

6.3.2 Where a fitting or adaptor provides a transition between pipes and/or fittings complying with the requirements of this standard and pipes and/or fittings complying with the requirements of BS 4660, the wall thickness of each part of the fitting or adaptor shall comply with the requirements of the relevant standard.

6.3.3 The minimum wall thickness of the transition shall be $0.9 \times e$ of the larger diameter end of the fitting or adaptor.

7 Marking

Each length of pipe and every fitting shall be clearly and durably marked to show the manufacturer's identification, the number of this British Standard (i.e., BS 5481), the nominal size and the reference SDR 41¹⁾.

8 Testing

8.1 Type tests

8.1.1 General. Type tests are intended to prove the suitability and performance of a new composition, a new compounding or processing technique or a new design or size of pipe, joint or fittings. Such tests are required when a change is made in polymer composition or method of manufacture and in any case on a continuing basis to such a schedule as will ensure that each size and design of pipe, fittings and joint assembly is tested at least once in every five year period. A summary of the type tests is given in Table 5.

8.1.2 Vicat softening point

8.1.2.1 Pipe. When two random samples, taken from pipe, are tested by method 120B of BS 2782, the deformation temperature of each sample shall not be lower than 79 °C.

8.1.2.2 Moulded fittings. When two random samples, taken from moulded fittings of a given formulation, are tested by method 120B of BS 2782, the deformation temperature of each sample shall not be lower than 75 °C.

Table 5 — Type tests (clause references)

Requirement	Pipe	Moulded fittings	Fabricated fittings	Ring seal joints
Vicat softening point	8.1.2.1	8.1.2.2	—	—
Impact	8.1.3	—	—	—
Reversion	8.1.4	—	—	—
Stress relief	—	8.1.5	—	—
Stress rupture	8.1.5	—	—	—
Drop resistance	—	—	8.1.7	—
Negative pressure	—	—	—	8.1.8

8.1.3 Impact resistance requirement at 20 °C for pipe. When tested by the method described in Appendix G, samples of each combination of pipe size and material formulation shall have a true impact rate (TIR) below 10 % at a confidence level of 90 %. The test conditions shall be in accordance with Table 6.

Table 6 — Test parameters for impact resistance requirements

Nominal size	Mass of falling weight	Fall height
mm	kg	mm
200	4.0	2 000 ± 10
250	5.75	2 000 ± 10
315	7.5	2 000 ± 10
>315	7.5	2 000 ± 10

8.1.4 Reversion requirement for pipe. When three samples from each combination of pipe size and material formulation are tested by the method described in Appendix A, at no point around a specimen shall the length change by more than 5 %. After testing, the specimens shall show no faults, e.g. cracks, cavities or blisters.

¹⁾ See foreword for explanation of SDR.

8.1.5 Stress relief requirement for injection moulded fittings. When tested at 150 °C as described in Appendix B, a sample of each combination of fitting and material formulation shall not show excessive blisters, excessive delaminations, cracking or weld splitting. Weld lines may become more pronounced, e.g. through localized sinking, during the test but this in itself shall not constitute a failure. For fittings moulded by conventional techniques special care shall be taken in examining the area around the point of injection where no cracks or delaminations shall penetrate to a depth greater than 50 % of the wall thickness at that point.

For fittings moulded by end-gating techniques, e.g. ring or diaphragm moulds, cracks or delaminations in the wall of the fittings adjacent to the injection area shall not penetrate to a depth equivalent to more than 25 % of the socket depth.

The assessment of the depth of penetration shall be carried out by sectioning the specimen at the point of injection and measuring the depth to which these defects penetrate the thickness of the fitting.

8.1.6 Stress rupture requirement for pipe. When subjected to an internal hydrostatic pressure calculated from the hoop stress given in Table 7, using the equation given in Appendix C, samples of pipe shall sustain the appropriate pressure for the appropriate time, given in Table 7, without failure. Three specimens of pipe of each combination of pipe size and material formulation shall be tested at 20 °C and a further three specimens at 60 °C.

Because of the practical difficulties in achieving the exact stress in the pipe in the test at a temperature of 60 °C, it is permissible for the stress to differ from that specified by ± 1 %. The corresponding minimum time to failure for the actual test stress shall be obtained from the regression curve corresponding to the equation:

$$\log(\text{stress}) = 1.2304 - 0.0768 \log(\text{time}).$$

Table 7 — Test parameters for stress rupture requirement for pipe

Test temperature	Minimum time to failure	Hoop stress,	
		MN/m ²	bar ^a
°C	h		
20 ± 1	1	42	420
60 ± 2	1 000	10 ± 0.1	100 ± 1

^a 1 bar = 10⁵ N/m² = 100 kPa.

8.1.7 Drop requirements for fabricated fittings. When tested by the method described in Appendix D, fittings shall neither break nor crack. Three fittings of each type and size shall be tested.

8.1.8 Negative pressure requirement for ring seal joints only. When tested by the method described in Appendix E, a joint, whilst deformed, shall withstand a pressure of 25 ± 3 kN/m² below atmospheric pressure for 1 h without leakage. This test shall be applied to one joint for each size of pipe.

8.2 Quality control tests

8.2.1 General. Quality control tests shall be carried out during manufacture to prove the quality of a production run of pipe or fitting as appropriate. A summary of the quality control tests is given in Table 8.

8.2.2 Impact resistance requirement at 20 °C for pipe. A programme of testing shall demonstrate that the pipe continues to comply with the requirements of 8.1.3.

8.2.3 Reversion requirement for pipe. At least one sample shall be taken from each machine during every 8 h production run. When tested by the method described in Appendix A, at no point around a specimen shall the length change by more than 5 %; after test, specimens shall show no faults, e.g. cracks, cavities or blisters.

8.2.4 Stress relief requirement for injection moulded fittings. At least one sample fitting shall be taken at random from each machine during every 8 h production run and each sample shall comply with the requirements of 8.1.5.

8.2.5 Hydrostatic pressure requirement for solvent cement joint assemblies. Three samples of solvent cement joint assemblies shall be taken from each machine at least once in every 8 h production run. When tested by the method described in Appendix F, each sample shall withstand a pressure of 70 kN/m² for 60 s without failure.

8.2.6 Stress rupture requirement for pipe. At least one sample shall be taken from each machine at least once during each 8 h production run. Each specimen shall comply with the requirements of 8.1.6 for the test at 20 °C.



9 Sealing components



9.1 Elastomeric sealing rings Sealing rings supplied with pipe or fittings shall comply with the requirements of BS 2494.

9.2 Other components Components, e.g. snap caps used to retain the sealing rings, may be manufactured from materials other than unplasticized PVC, e.g. polyethylene or polypropylene. These components shall comply with the requirements applicable to fittings and assemblies i.e. 8.1.3, 8.1.5, 8.1.8, and 8.2.4. For polyethylene components the stress relief test shall be carried out in accordance with Appendix B except that the temperature of test shall be 110 ± 2 °C.

Table 8 — Quality control tests (clause references)

Requirement	Pipe	Moulded fittings	Solvent cement joints	Ring seal joints	Fabricated fittings
Dimensions	clause 5	clause 5	clause 5	clause 5	clause 5
Impact resistance	8.2.2	—	—	—	—
Reversion	8.2.3	—	—	—	—
Stress relief	—	8.2.4	—	—	—
Hydrostatic	—	—	8.2.5	—	—
Stress rupture at 20 °C	8.2.6	—	—	—	—

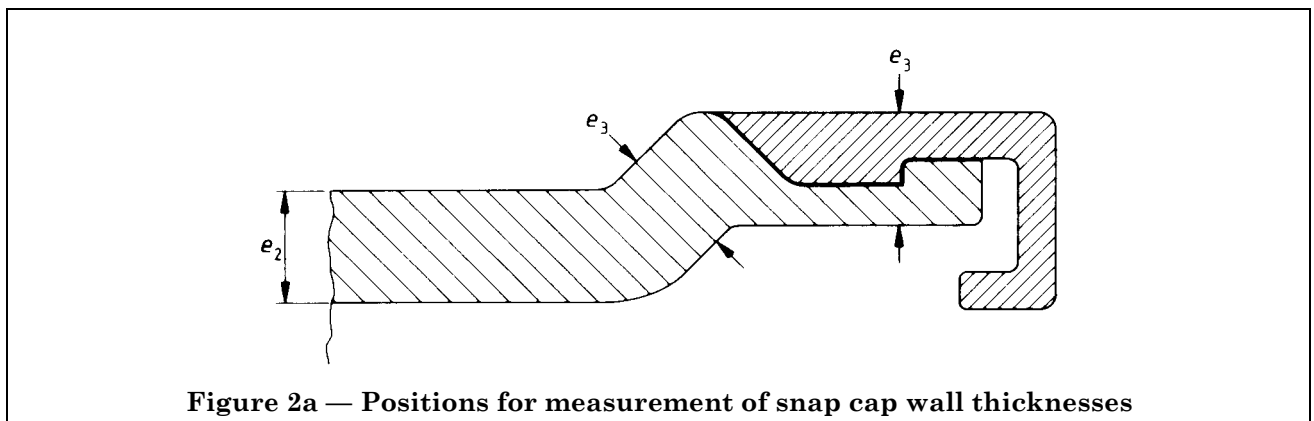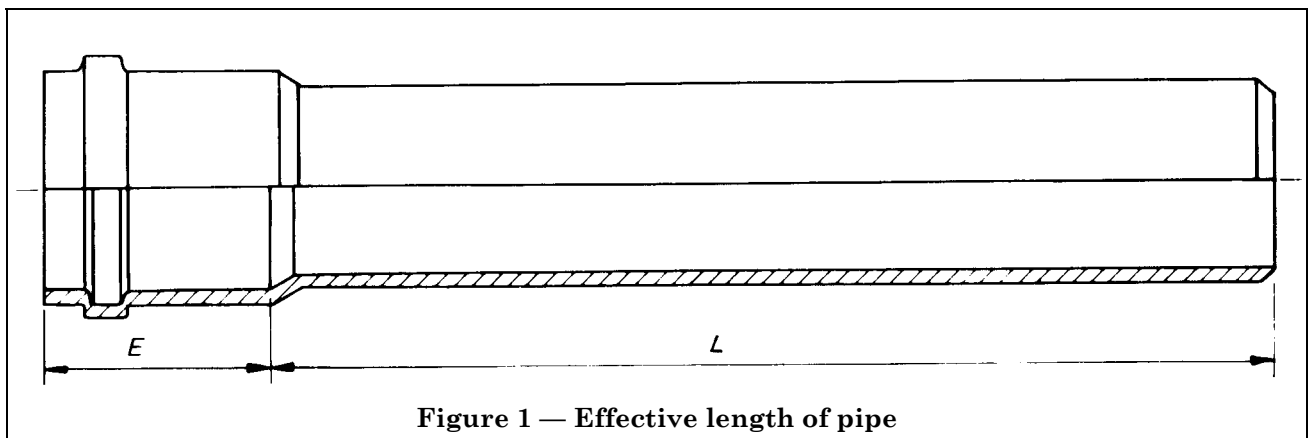

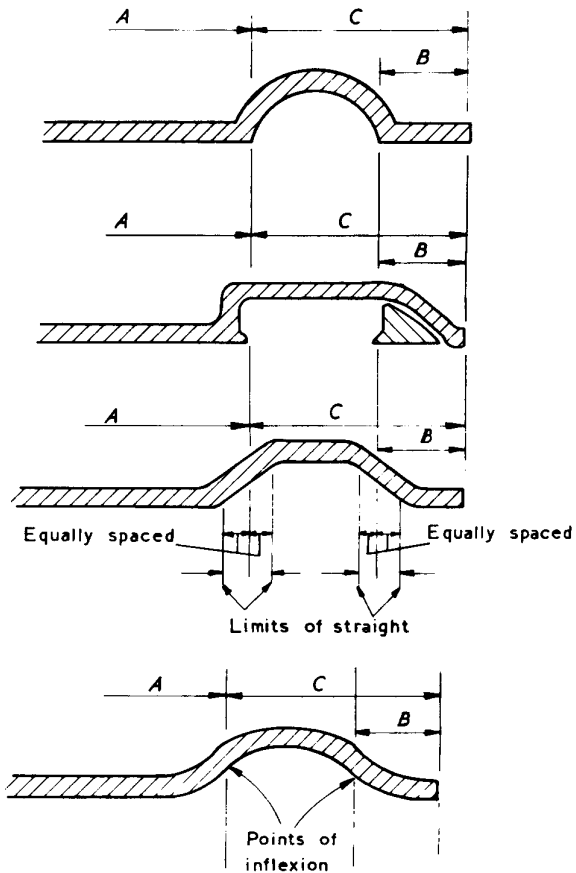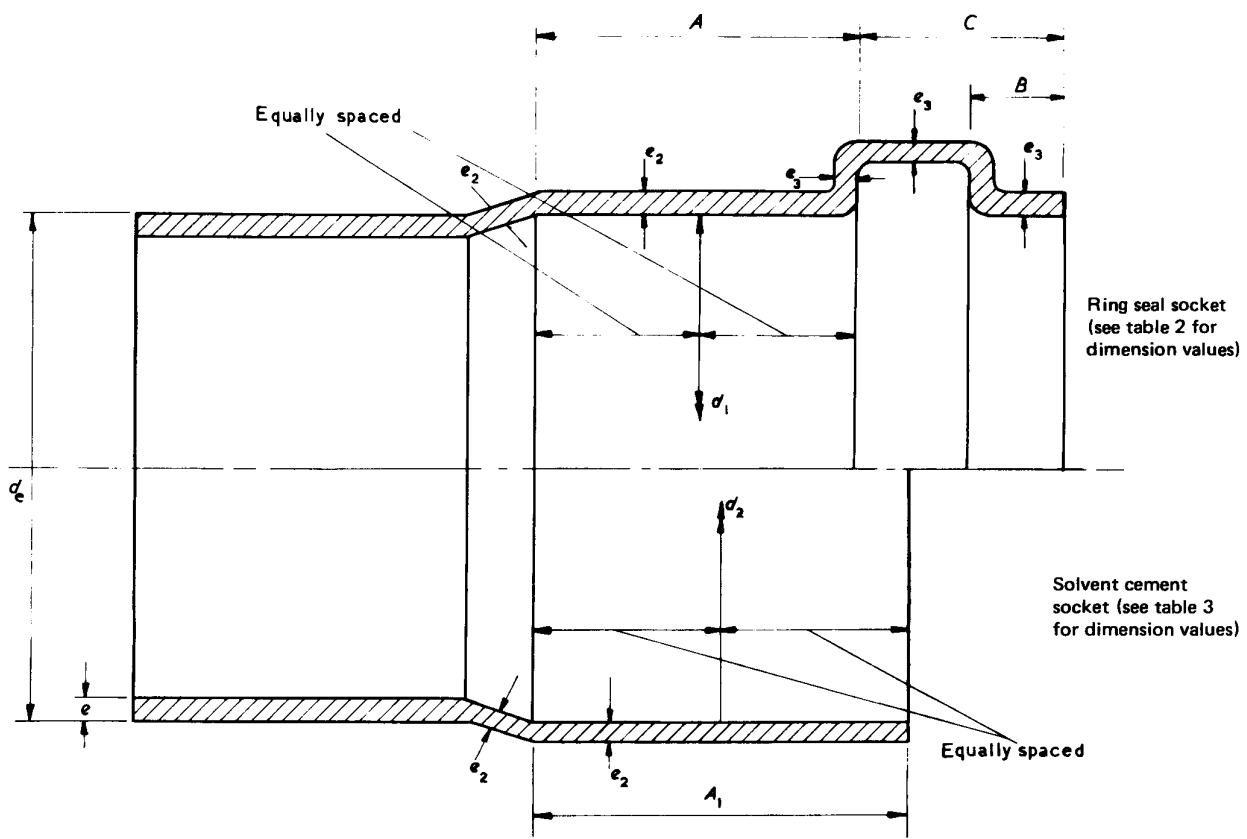


A selection of typical groove designs is illustrated for the purpose of defining dimensions A , B and C . Other groove designs are possible and may be deemed to comply with the requirements of this standard provided dimensions A , B and C , when measured in accordance with the principles shown, are in accordance with table 2. The values of e , e_2 and e_3 are given in table 2.

Some designs of sockets incorporate longer ring seals than those normally used with the groove designs shown. Further, some special seals incorporate integral sealing membranes. In the case of these longer or special seals the dimension C does not apply, provided that initial sealing action is achieved upon insertion of the pipe or spigot to a depth not greater than the maximum value of C (see table 2). Thereafter the pipe or spigot shall be capable of further insertion to a depth at least equivalent to the minimum value of A (see table 2).

If a ring seal is retained by means of a snap cap there are no requirements to be complied with in respect of dimension B and dimension e_3 where there is no overlap of the snap cap with the body of the socket.

Figure 2 — Socket dimensions

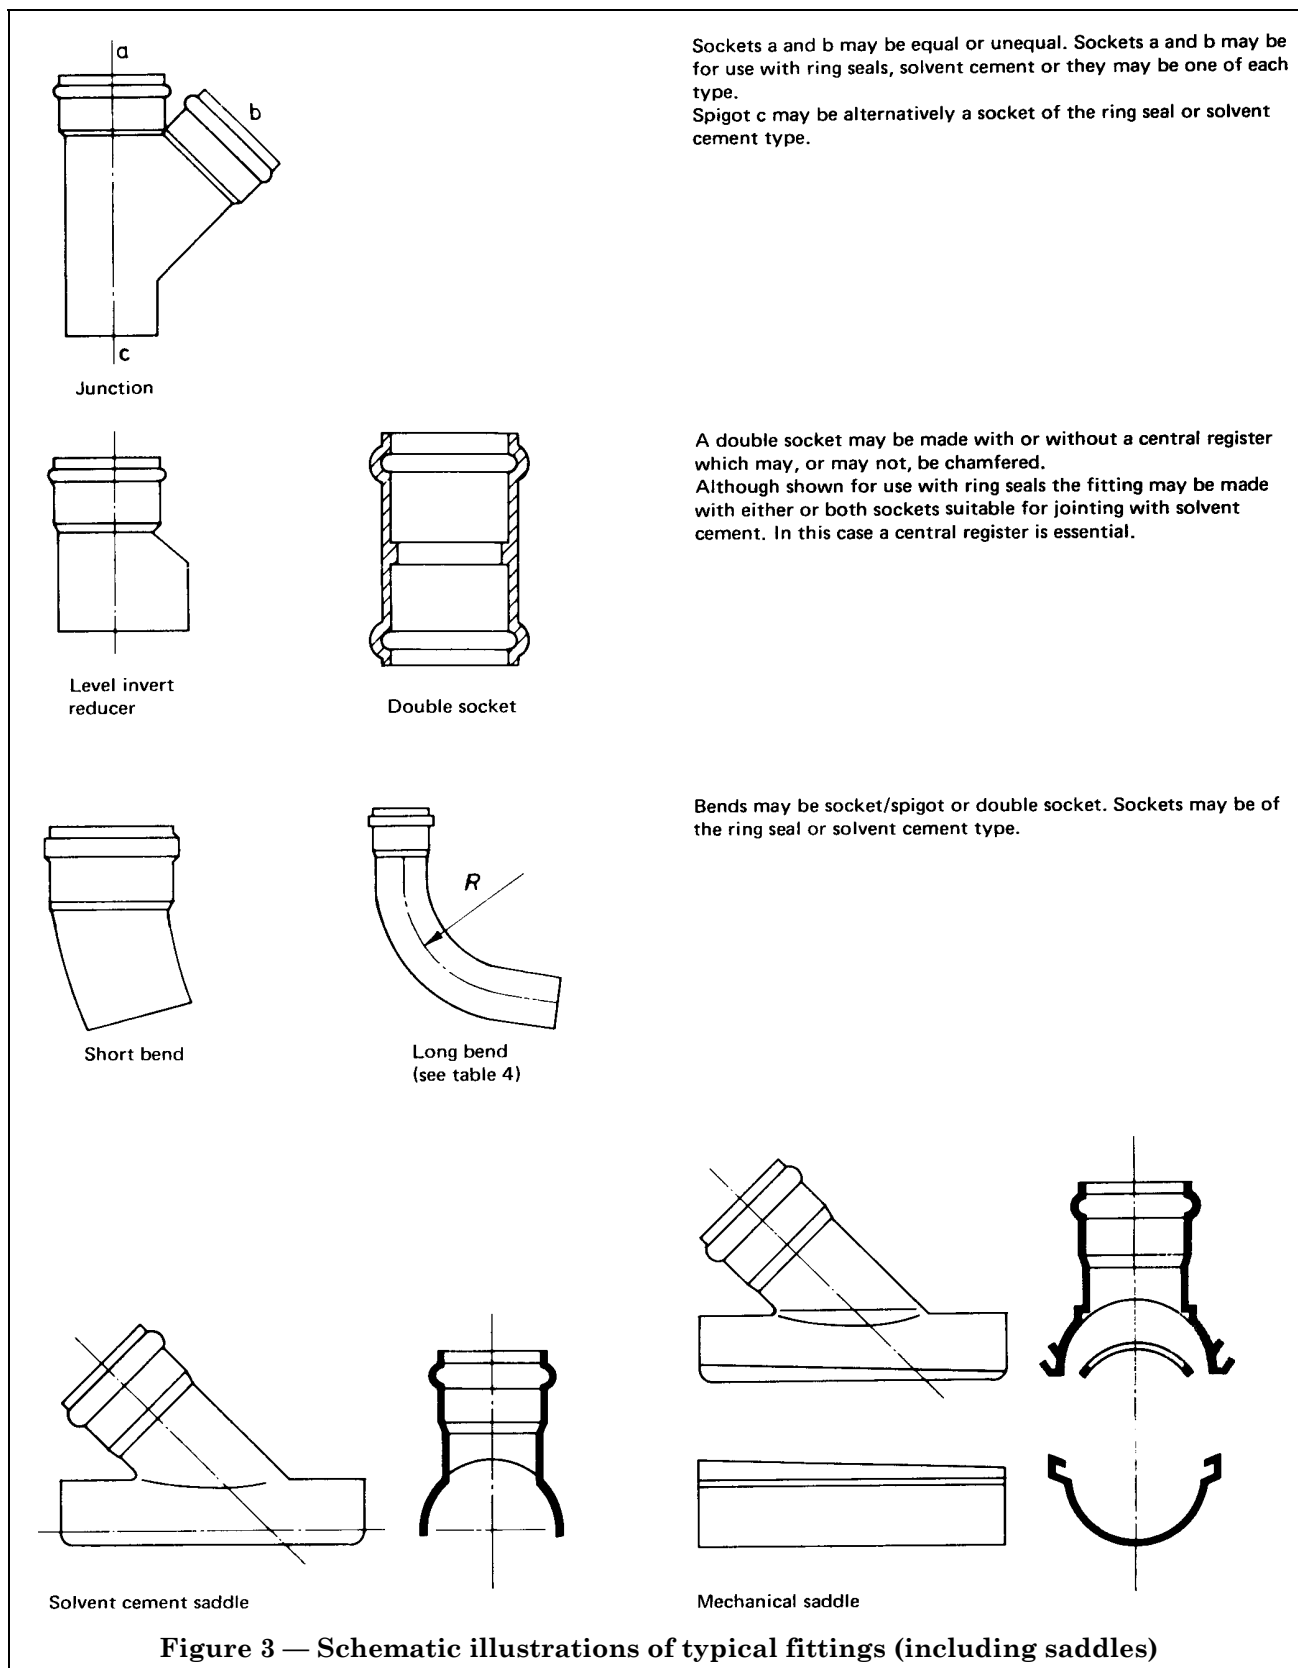

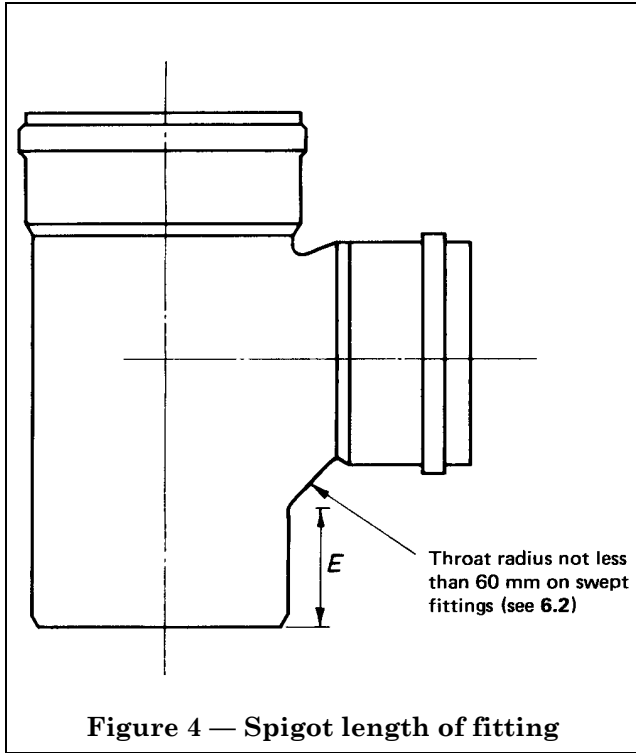


Figure 4 — Spigot length of fitting

Appendix A Heat reversion test for pipe

A.1 Apparatus. The apparatus shall consist of a thermostatically controlled bath which maintains the temperature of the heat transfer medium at 150 ± 2 °C. The heat transfer medium may be polyethylene glycol or a mineral oil free from aromatic hydrocarbons.

A.2 Form of test specimen. The test specimen shall consist of a length of pipe approximately 300 mm long. Two circumferential marks shall be scribed on the test specimen 100 mm apart in such a way that one of these marks is approximately 15 mm from one end of the specimen.

A.3 Procedure. Suspend the test specimen in the heat transfer medium by the end furthest from the scribed marks in such a way that both scribed marks are completely immersed. Take care that the specimen does not contact the sides or bottom of the bath.

Immerse the test specimen in the bath for a time determined as follows:

- a) for pipe of nominal size 200, 250 and 315: 15 min,
- b) for pipe of nominal size 355, 400, 450, 500 and 560: 30 min,
- c) for pipe of nominal size 630: 60 min.

After the specified immersion period, remove the specimen from the bath, lay it on its side and allow to cool to room temperature. Measure the distance between the two scribed marks along the surface of the pipe and calculate the percentage change in length. Inspect the specimen for any faults, e.g. cracks, cavities or blisters.

As an alternative, it is permissible to use an air circulating oven in which the test specimen shall be supported in such a way as to leave it free of external stresses. Increase the three immersion times given for the oil bath method detailed above to 30 min, 60 min, and 120 min, respectively. In this case, measure the immersion times from the time the oven regains a temperature of 150 ± 2 °C. Upon removal from the oven, allow the specimens to cool naturally to room temperature and determine the change in length.

Appendix B Stress relief test for injection mouldings

B.1 General. This test may be carried out either in an air oven or alternatively in a bath of polyethylene glycol, glycerol or a mineral oil free from aromatic hydrocarbons.

B.2 Oven method

B.2.1 Apparatus. An electrically heated air oven with circulating fan, the whole interior of which is maintained, by thermostatic means, at a temperature of 150 ± 2 °C.

B.2.2 Procedure. Place the specimen in the oven standing on one socket mouth. The specimen may be supported if necessary by a simple jig that has been preheated in the oven.

Measure the time from the moment at which the oven regains the temperature of 150 ± 2 °C.

After one hour remove the specimen from the oven and allow it to cool naturally in air before examination.

B.3 Immersion method

B.3.1 Apparatus. A thermostatically-controlled bath in which the heat transfer medium is polyethylene glycol, glycerol or mineral oil free from aromatic hydrocarbons. The bath is stirred continuously and maintained, by thermostatic means, at a temperature of 150 ± 2 °C.

B.3.2 Procedure. Place the specimen in the bath standing on one socket mouth. Measure the time from the moment at which the bath regains a temperature of 150 °C. After 30 min, remove the specimen and allow it to cool naturally in air before examination.

B.4 Examination of specimens. Examine carefully each specimen after test for excessive blisters, delamination, cracking or signs of weld line splitting. Take special care in examining the areas around the point of injection.

Assess the depth of penetration of any defects by sectioning the specimen at the point of injection and measuring the depth to which the defects penetrate the thickness of the fitting.

Appendix C Stress rupture test for pipe

C.1 Form of test specimen. Each piece of pipe shall have a free length between end fittings of 750 ± 10 mm.

C.2 Apparatus. The apparatus consists of a thermostatically controlled bath maintained at 20 ± 1 °C or at 60 ± 2 °C, as appropriate, and equipment that permits the application to the specimens of controlled internal hydrostatic pressure accurate to ± 2 %.

C.3 Procedure. Measure the minimum wall thickness and the mean outside diameter of each specimen and calculate the internal pressure to be applied from the formula;

$$P = \frac{2 \delta t}{D - t}$$

where

- P is the pressure to be applied (in bar)
- δ is the hoop stress (in bar)
- t is the minimum wall thickness (in mm)
- D is the mean outside diameter (in mm)

Connect the specimen to the apparatus and apply the calculated internal hydrostatic pressure at a rate of increase so that it is reached within 30 s to 40 s of first applying pressure. Maintain the pressure with an accuracy of ± 2 % throughout the test for the time and at the appropriate temperature given in Table 7.

Appendix D Drop test for fabricated fittings

Drop the fitting freely, in random positions, from a height of 1 ± 0.05 m on to a flat concrete floor within 10 s of having been conditioned for 30 min at a temperature of 0 ± 1 °C. Examine the fittings for breaks or cracks.

Appendix E Negative pressure test for ring seal joints

E.1 Apparatus. The apparatus shall be as illustrated in Figure 5 and shall be capable of permitting the application of a constant force and a constant hydrostatic test pressure for a period of at least 1 h.


Figure 5 shows the apparatus with the pipe in the horizontal position but a disposition with the pipe in the vertical position is permissible. If the pipe is horizontal it is necessary to ensure that the annular space between the pipe and the socket is continuously flooded with water, e.g. by use of a suitable flange.

The distortion load shall be applied to a rocker on the top of a beam which is free to move in the vertical plane through the axis of the pipe. The effective beam length shall be equal to the nominal diameter of the pipe under test. The pipe assembly under test shall be placed so that the face of the socket housing the joint under test is 10 mm from the end of the load-bearing beam.

E.2 Procedure. Measure accurately the maximum socket inside diameter at the mouth of the joint and the minimum spigot outside diameter of the pipe. Take the difference of the two measurements. Carefully dry the interior of the test specimen before assembly. Apply a distorting load to the pipe so that the vertical movement of the load distribution plate is equal to the difference of the two measurements taken. Reduce the air pressure in the assembly to 25 ± 3 kN/m² below ambient pressure, and, if necessary, readjust the position of the load-bearing plate so that the distortion of the pipe is maintained at the level defined before the pressure was reduced. Maintain these conditions for one hour, during which time the annular space between pipe and socket mouth shall be kept filled with water.

At the end of this period examine the assembly for evidence of leakage by either of the following methods.

- a) Remove the assembly from the apparatus, dry the exterior thoroughly and then examine the interior for evidence of water penetration.
- b) After shutting off the source of negative pressure, maintain a static negative pressure (of 25 ± 3 kN/m²) for a further 10 min and, by means of a pressure gauge, determine if any leakage into the assembly occurs.

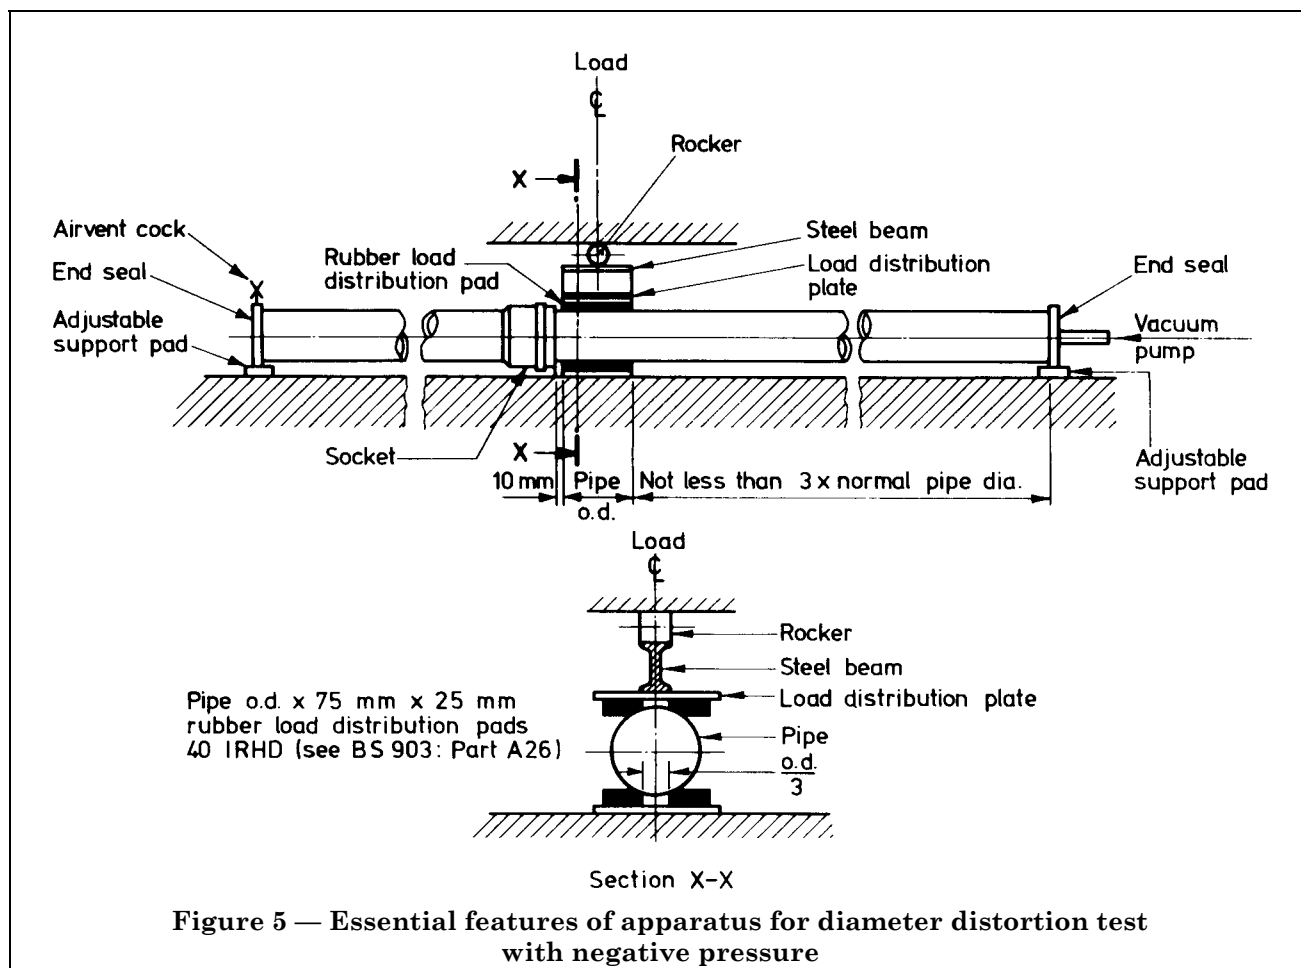

Appendix F Hydrostatic pressure test for solvent cement joints

F.1 Apparatus. The apparatus shall consist of end sealing devices of size and method appropriate to the pipe system under test. The sealing devices shall be restrained to prevent their movement when pressure is applied. They shall not exert axial force on the system, prior to application of the test pressure.

One end of the sealing device shall be connected to the source of hydrostatic pressure. A bleed valve shall be provided to enable all air to escape when hydrostatic pressure is applied.

F.2 Procedure. Apply a pressure of 70 kN/m^2 and maintain it for 60 s. Examine the assembly for failure.

Appendix G Test for impact resistance at 20°C

G.1 Form of test specimen. Each test specimen shall be a length of pipe having undamaged ends, cut square to the longitudinal axis. Specimens shall be $200 \pm 5 \text{ mm}$ long. A straight line shall be drawn along the entire length of each specimen, randomly positioned on the pipe's circumference. Further lines to bring the total number to that given in Table 9, shall be drawn, parallel to the first line, and equally spaced around the circumference.

Table 9 — Number of equally spaced lines to be drawn on test specimens

Nominal size mm	Number of lines
200	12
250	12
315	16
355	16
400	24
455	24
500	24
560	24
630	24

G.2 Apparatus. A falling weight machine (a suitable form of which is shown in Figure 6) shall be used and shall consist essentially of the following.

G.2.1 A main frame which can be rigidly fixed in a true vertical position.

G.2.2 Guide rails carried from the inside of the main frame, on side bearings which can be adjusted to keep them parallel and vertical.

G.2.3 A weighted striker which can fall freely within the guide rails and which is equipped with a hardened hemispherical striking surface 25 mm in diameter. The striking surface shall be free from flats and other imperfections. The combined mass of striker and weight shall be capable of adjustment to meet the requirements of 8.1.3.

G.2.4 A specimen support comprising a 120° vee block, at least 200 mm in length, so positioned below the guide rails that the tip of the striker is not more than 2.5 mm from the axis of vee block.

G.2.5 A release mechanism such that the striker can fall through a height of $2\,000 \pm 10$ mm on to the top surface of the pipe specimen.

G.2.6 Means for maintaining a constant height of fall, by vertical movement of either the vee block, the release mechanism or the main frame, in order to accommodate different diameters of pipe.

G.3 Procedure. Prior to testing, condition the specimens at 20 ± 1 °C for at least 30 min. Testing should be carried out within 1 min of removal from the conditioning environment.

Set the impact testing machine to give a height of drop of $2\,000 \pm 10$ mm. Determine the weight to be used according to the pipe diameter (see Table 6).

Place the first test specimen in the machine with one of the marked lines uppermost. Allow the weighted striker to fall freely on to the test specimen. If the specimen does not fail, as defined by cracking right through its wall thickness, rotate it until the next line becomes uppermost and in this position strike it again. Repeat this process so long as the specimen does not fail and until each line has been struck once. Test further specimens in the same manner. When any specimen fails simply remove it from the machine, record the number of blows and recommence the test using a further specimen.

There is no set number of specimens or strikes laid down. It is simply required that a definite result be obtained. Generally this will be achieved by testing four or five specimens but, on occasion, it will be necessary to proceed further.

G.4 Determination of result. Reference to Figure 7 enables the number of strikes to be read off against the number of broken test pieces. If the true impact rate falls within region C (TIR above 10 %) the result is a failure. If the true impact rate falls within region A (TIR below 10 %) the result is a pass.

In the event of the result falling in region B testing should be continued until a positive result is obtained. Alternatively it will become clear that a result in region A is most unlikely and in this case the pipes shall be deemed to fail the test.

Appendix H Explanation of symbols used in tables and figures

A is the socket length of a ring seal socket, i.e. the dimension from back of ring seal zone to commencement of socket root (see Figure 2).

*A*₁ is the socket length of a solvent cement socket, i.e. the dimension from socket mouth to commencement of socket root (see Figure 2).

B is the dimension from socket mouth to commencement of ring seal zone (see Figure 2).

C is the dimension from socket mouth to back of ring seal zone (see Figure 2).

*d*_e is the nominal outside diameter and nominal size and also the minimum permitted value for mean outside diameter (see Table 2 and Figure 2).

*d*₁ is the internal diameter at a distance $\frac{A}{2}$ behind the back of the ring seal zone (see Figure 2).

*d*₂ is the internal diameter at a distance $\frac{A_1}{2}$ behind the socket mouth of a solvent cement socket (see Figure 2).

-
- E is the spigot length of fitting (see Figure 1 and Figure 4).
- e is the wall thickness of pipe and body of fitting. Minimum values are given in Table 2.
- e_2 is the wall thickness of parts of a socket as indicated in Figure 2. Minimum values are expressed in terms of e .
- e_3 is the wall thickness of parts of a socket as indicated in Figure 2. Minimum values are expressed in terms of e .
- L is the effective length of pipe (see Figure 1).
- R is the centre line radius of long bends (see Figure 3).


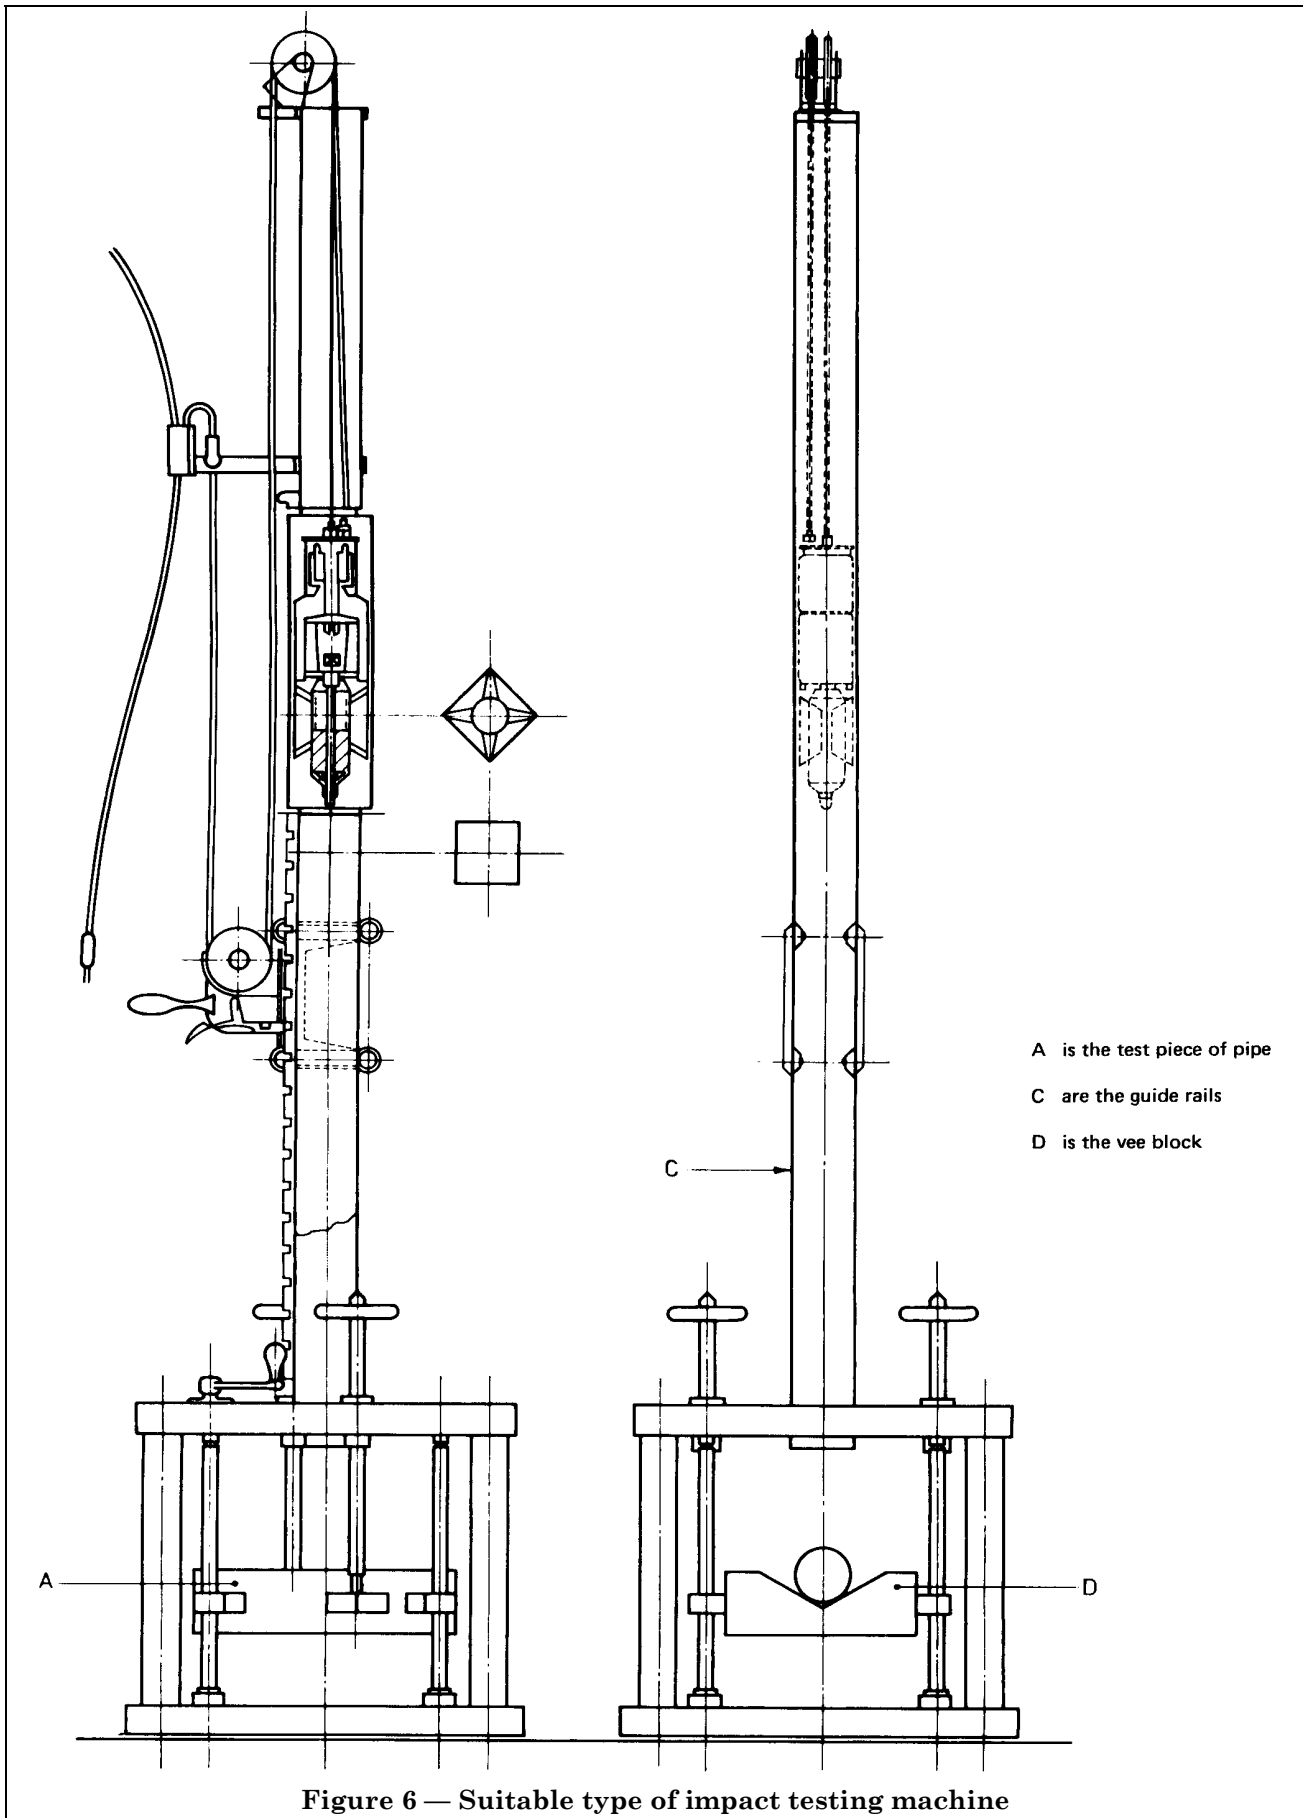


Figure 6 — Suitable type of impact testing machine

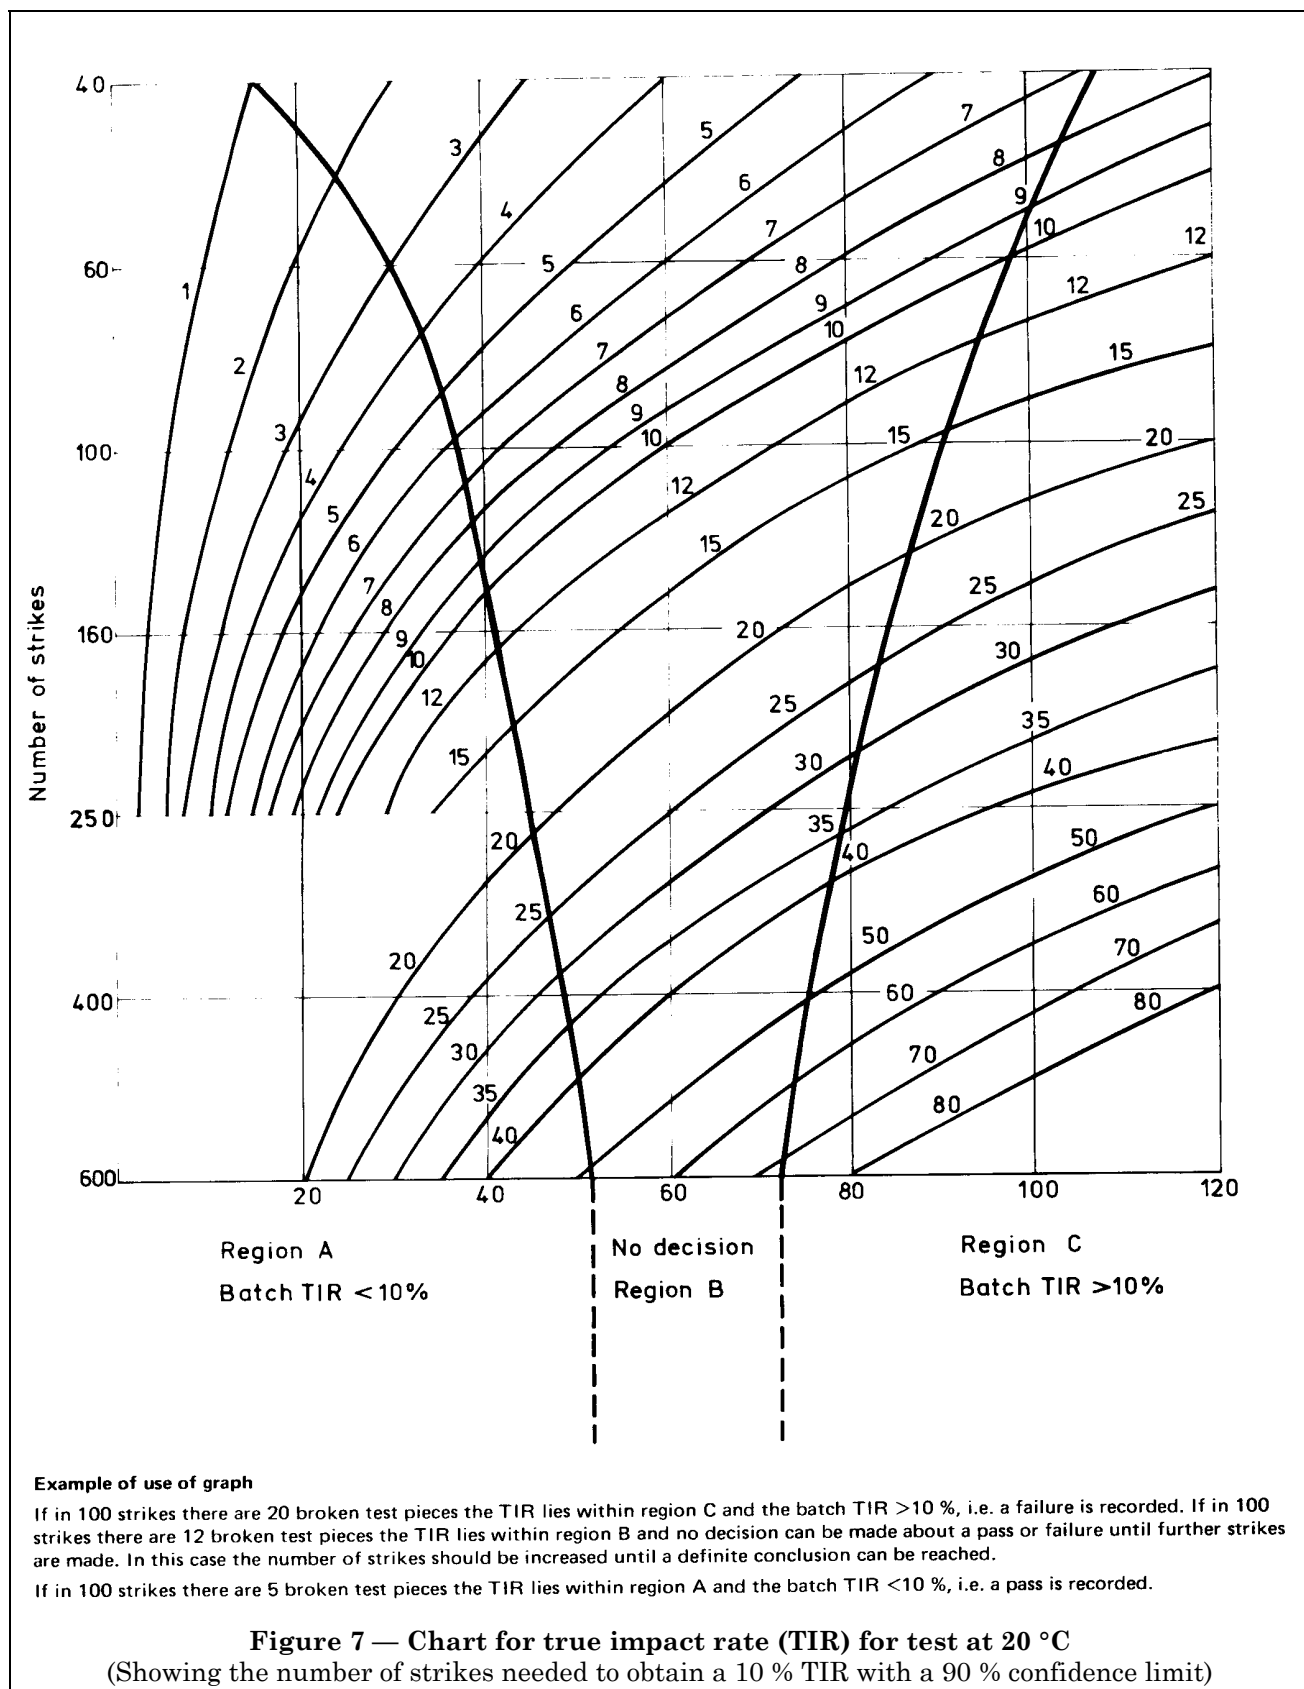

Publications referred to

BS 381C, *Colours for specific purposes.*

BS 903, *Methods of testing vulcanized rubber.*

BS 903-A26, *Determination of hardness.*

BS 2494, *Materials for elastomeric joint rings for pipework and pipelines.*

BS 2782, *Methods of testing plastics.*

BS 3867, *Outside diameters and pressure ratings of pipe of plastics materials.*

BS 4660, *Unplasticized PVC underground drain pipe and fittings.*

BS 4901, *Specification for plastics colours for building purposes.*

CP 312, *Plastics pipework (thermoplastics materials).*

CP 312-1, *General principles and choice of material.*

ISO 161/1, *Thermoplastics pipes for the transport of fluids — Nominal outside diameters and nominal pressures.*

ISO 161/1-1, *Metric series.*

BSI — British Standards Institution

BSI is the independent national body responsible for preparing British Standards. It presents the UK view on standards in Europe and at the international level. It is incorporated by Royal Charter.

Revisions

British Standards are updated by amendment or revision. Users of British Standards should make sure that they possess the latest amendments or editions.

It is the constant aim of BSI to improve the quality of our products and services. We would be grateful if anyone finding an inaccuracy or ambiguity while using this British Standard would inform the Secretary of the technical committee responsible, the identity of which can be found on the inside front cover. Tel: 020 8996 9000. Fax: 020 8996 7400.

BSI offers members an individual updating service called PLUS which ensures that subscribers automatically receive the latest editions of standards.

Buying standards

Orders for all BSI, international and foreign standards publications should be addressed to Customer Services. Tel: 020 8996 9001. Fax: 020 8996 7001.

In response to orders for international standards, it is BSI policy to supply the BSI implementation of those that have been published as British Standards, unless otherwise requested.

Information on standards

BSI provides a wide range of information on national, European and international standards through its Library and its Technical Help to Exporters Service. Various BSI electronic information services are also available which give details on all its products and services. Contact the Information Centre. Tel: 020 8996 7111. Fax: 020 8996 7048.

Subscribing members of BSI are kept up to date with standards developments and receive substantial discounts on the purchase price of standards. For details of these and other benefits contact Membership Administration. Tel: 020 8996 7002. Fax: 020 8996 7001.

Copyright

Copyright subsists in all BSI publications. BSI also holds the copyright, in the UK, of the publications of the international standardization bodies. Except as permitted under the Copyright, Designs and Patents Act 1988 no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means – electronic, photocopying, recording or otherwise – without prior written permission from BSI.

This does not preclude the free use, in the course of implementing the standard, of necessary details such as symbols, and size, type or grade designations. If these details are to be used for any other purpose than implementation then the prior written permission of BSI must be obtained.

If permission is granted, the terms may include royalty payments or a licensing agreement. Details and advice can be obtained from the Copyright Manager. Tel: 020 8996 7070.