

# INTERNATIONAL STANDARD

# ISO 6445

Second edition  
2005-10-15

---

---

## Doors — Behaviour between two different climates — Test method

*Portes — Comportement entre deux climats différents — Méthode  
d'essai*



Reference number  
ISO 6445:2005(E)

© ISO 2005

**PDF disclaimer**

This PDF file may contain embedded typefaces. In accordance with Adobe's licensing policy, this file may be printed or viewed but shall not be edited unless the typefaces which are embedded are licensed to and installed on the computer performing the editing. In downloading this file, parties accept therein the responsibility of not infringing Adobe's licensing policy. The ISO Central Secretariat accepts no liability in this area.

Adobe is a trademark of Adobe Systems Incorporated.

Details of the software products used to create this PDF file can be found in the General Info relative to the file; the PDF-creation parameters were optimized for printing. Every care has been taken to ensure that the file is suitable for use by ISO member bodies. In the unlikely event that a problem relating to it is found, please inform the Central Secretariat at the address given below.

© ISO 2005

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office  
Case postale 56 • CH-1211 Geneva 20  
Tel. + 41 22 749 01 11  
Fax + 41 22 749 09 47  
E-mail [copyright@iso.org](mailto:copyright@iso.org)  
Web [www.iso.org](http://www.iso.org)

Published in Switzerland

## Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 2.

The main task of technical committees is to prepare International Standards. Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

ISO 6445 was prepared by Technical Committee CEN/TC 33, *Doors, windows, shutters, building hardware and curtain walling* (as EN 1121:2000) and was adopted, under a special “fast-track procedure”, by Technical Committee ISO/TC 162, *Doors and windows* in parallel with its approval by the ISO member bodies.

This second edition cancels and replaces the first edition (ISO 6445:1989) which has been technically revised.

Throughout the text of this document, read “... this European Standard ...” to mean “... this International Standard ...”.

## **Foreword**

This European Standard has been prepared by Technical Committee CEN/TC 33 "Doors, windows, shutters, building hardware and curtain walling", the secretariat of which is held by AFNOR.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by December 2000, and conflicting national standards shall be withdrawn at the latest by December 2000.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and the United Kingdom.

This European Standard supersedes EN 79:1985.

This draft is one of a series of standards for doors.

This standard includes six informative annexes describing the test procedures.

## 1 Scope

This European Standard defines the test method to be used for determining the behaviour of door leaves and doorsets between two different climates.

## 2 Normative references

This European Standard incorporates by dated or undated reference, provisions from other publications. These normative references are cited at the appropriate places in the text and the publications are listed hereafter. For dated references, subsequent amendments to or revisions of any of these publications apply to this European Standard only when incorporated in it by amendment or revision. For undated references the latest edition of the publication referred to applies.

EN 952	Door leaves - General and local flatness - Measurement method
EN 12046-2	Operating forces – Test method – Part 2: Doors
EN 1026	Windows and doors – Air permeability – Test method
prEN 12519:1996	Doors and windows - Terminology

## 3 Definitions

For the purposes of this standard the definitions given in prEN 12519:1996 apply, together with the following:

### 3.1


#### Face 1, face 2

the orientation of face 1 and face 2 of the door with regard to the climates is defined in 6.1

3.2

**Bow**

Maximum deviation of the long edge of a door leaf measured in accordance with EN 952. According to its orientation, it can be positive or negative, see figure 1

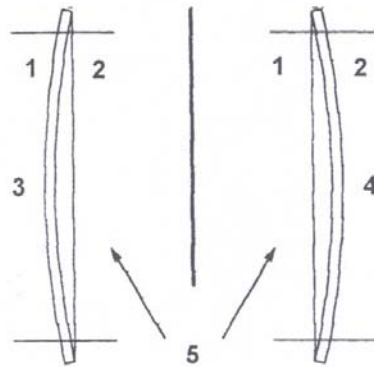

- |   |              |   |                                 |
|---|--------------|---|---------------------------------|
| 1 | Face 1       | 4 | Positive bow                    |
| 2 | Face 2       | 5 | Datum line as defined in EN 952 |
| 3 | Negative bow |   |                                 |

**Figure 1 - Definition of positive and negative bow**

4 **Principle**

The test is carried out by subjecting the doors to two different climates on either side for a period of time, and measuring the resulting bow of the longitudinal lock side edge at stages of the test. If required, the operating forces and the air permeability of the doors in their deformed state are also determined.

5 **Apparatus**

5.1 **Basic equipment**

The test facility shall consist as minimum of :

- a climate chamber or enclosure in which the required climatic conditions on the cold side can be maintained and adjusted within the stipulated tolerances ;
- an opposite climate chamber or enclosure in which the required climatic conditions on the warm side can be maintained and adjusted within the stipulated tolerances ;
- a frame for supporting the doors, which is sufficiently rigid that it will not be significantly deformed by any force that may be transmitted from the door leaf to the door frame ;
- a device for measuring bow ;
- a device for determining the operating forces in accordance with EN 12046-2 during exposure to the climatic stress.

## 5.2 Supplementary equipment

- a bank of filament infrared lamps (see informative Annex A) for heating face 2 of the door. The power of the apparatus shall be such that the surface temperature  $\theta_3$  shall be reached within 2 hours and maintained afterwards within a range of  $\pm 5$  °C.

The filament infrared lamps shall be positioned in such a way that the emitted radiation energy is distributed as evenly as possible over the door leaf. (See Annex A).

- Reference surfaces, having an absorption coefficient  $a_s$  in the visible field (0,4  $\mu\text{m}$  to 0,7  $\mu\text{m}$ ) of at least 0,90 and a thermal resistance of between 0,1  $\text{Km}^2/\text{W}$  and 0,2  $\text{Km}^2/\text{W}$ , each consisting of an aluminium sheet with matt black finish, mounted on polystyrene thermally insulating material (extruded;  $\lambda$  0,03  $\text{W}/\text{mK}$ ) having a thermal resistance between 0,6  $\text{Km}^2/\text{W}$  and 0,7  $\text{Km}^2/\text{W}$ , and incorporating a temperature sensor;

NOTE 5 mm thickness of polystyrene is usually adequate.

- a device for measuring the surface temperatures of the door leaf;

- a device, installed in the climatic chamber, for determining the air permeability of the door between the test chambers in accordance with EN 1026;

or

- a device for deforming the door leaf mechanically, when determination of the air permeability of the doorset is carried out outside the climatic test chambers.

NOTE Annex B gives an example of such a device.

## 6 Preparation

### 6.1 Orientation of the doors

The orientation of the faces of the door shall be defined by the manufacturer prior to its installation in the test chamber. (See also tables 1 and 2).

Closing side = face 1, if the door normally opens outwards, or

Closing side = face 2, if the door normally opens inwards.

If this information is missing, the door shall be tested in the orientation least favourable for the classification.

NOTE Which orientation is least favourable for the classification depends on the test required. One orientation may be worse for operating forces and the other for air permeability. It may therefore be necessary to test the door in both orientations.

### 6.2 Mounting

If possible, the door and its frame shall be mounted in the test facility in accordance with the manufacturer's normal fixing instructions. However, the door frame shall be fixed in such a way that its bow does not exceed 1,0 mm under test.

## 6.3 The door's closing condition

### 6.3.1 During exposure to the climates

The door shall be latched and unlocked, unless this is inconsistent with the hardware of the door set.

### 6.3.2 When determining bow

The bow shall be determined with the door unlatched.

NOTE This means that the door is slightly open and that the door leaf is under the minimum stress.

If the bow of the door leaf is measured in a different state, this shall be recorded and the reasons given.

### 6.3.3 When determining air permeability

If the air permeability of the door is to be measured, this shall be done with the door closed and locked.

## 7 Measurement methods and accuracy

### 7.1 Bow

The bow of the door leaf shall be measured in accordance with the procedure specified in 4.2 of EN 952. The deviation shall be measured and recorded to an accuracy of 0,1 mm.

### 7.2 Operating forces

The operating forces shall be determined in accordance with EN 12046-2 when specified in the test procedure. Each determination of operating forces shall be completed before the loss of bow has exceeded 10 % of the bow measured previously.

### 7.3 Air permeability

If required, air permeability shall be measured in accordance with EN 1026 when specified in the test procedure. Alternatively, the air permeability may be determined away from the climatic test facility provided that the door is maintained in its deformed condition within 10 % (e.g. as shown in Annex B). For this the door leaf is deformed mechanically in such manner as to reproduce the bow caused by the climatic stress.

NOTE 1 It is recommended that all air permeability checks are carried out in the climate chambers without moving the frame of the test specimen.

If during the determination of the air permeability the bow of the door leaf has changed by more than 10 %, the bow shall be reset by changing the pressure applied to the jack, and the



measurement of air permeability repeated. This shall be carried out either in the climate chambers or outside. If the measurement of air permeability is carried out outside the climate chambers, the loss of bow of the leaf shall not exceed 10 % of the bow measured previously. If necessary, the closing edge of the leaf shall be deformed mechanically with an appropriate device so as to reproduce the bow measured previously.

NOTE 2 Annexe B shows an example of such a device.

**8 Test conditions**

**Table 1 - Test climate a to d**

Test climates	Required climates			
	Side 1		Side 2	
	Air temperature ( $\theta_1$ ) °C	Relative humidity ( $\varphi_1$ ) %	Air temperature ( $\theta_2$ ) °C	Relative humidity ( $\varphi_2$ ) %
a	23 ± 2	30 ± 5	18 ± 2	50 ± 5
b	23 ± 2	30 ± 5	13 ± 2	65 ± 5
c	23 ± 2	30 ± 5	3 ± 2	85 ± 5
d	23 ± 2	30 ± 5	-15 ± 2	No requirements

$\theta_1$  air temperature on side 1  
 $\theta_2$  air temperature on side 2  
 $\varphi_1$  relative humidity on side 1  
 $\varphi_2$  relative humidity on side 2.

The mean values of temperature and relative humidity shall be kept as close as practicable to the nominal values. The stated tolerances are maximum allowable deviations.

**Table 2 - Test climate e**

Test climates	Required climates			
	Side 1		Side 2	
e	Air temperature ( $\theta_1$ ) °C	Relative humidity ( $\varphi_1$ ) %	Air temperature ( $\theta_2$ ) °C	Relative humidity ( $\varphi_2$ ) %
	20 min.  30 max.	No requirements	Reference temperature  $\theta_3 = \theta_1 + (55 \pm 5)$	No requirements

$\theta_1$  air temperature on side 1

$\theta_3$  reference temperature for heating up the door surface by radiation  
The reference temperature is the average temperature of at least three reference surfaces as described in 5.2, placed on the surface of the door leaf or on the test frame

$\varphi_1$  relative humidity on side 1.

$\varphi_2$  relative humidity on side 2.

The mean values of temperature and relative humidity shall be kept as close as practicable to the nominal values. The stated tolerances are maximum allowable deviations.

**8.1 Verification of the test temperatures**

Air temperatures shall be measured to an accuracy of  $\pm 0,5$  °C, within planes parallel to each face of the door leaf, at a distance of  $(100 \pm 50)$  mm. They shall be measured at 3 points, at least, located in the centre of the door leaf and symmetrically to the vertical axis of the door leaf, within 100 mm of the top and the bottom of the leaf. If more points are measured, they shall be arranged symmetrically to the vertical and horizontal axes of the door leaf. The average of the results from all the measuring points on each face shall be taken as the temperature of the climate applied on that face.

NOTE This procedure does not apply to the measurement of the surface temperature when heating is achieved by radiation (face 2 in climate “e”). In this case, the procedure for measuring the surface temperature is specified in table 2.

## 8.2 Air velocity

Air velocities shall be sufficient to ensure that the maximum difference in air temperature registered within the plane of measurement in front of each side of the door leaf does not exceed 2 °C.

NOTE Air velocities  $\geq 0,3$  m/s are usually adequate.

## 8.3 Surface temperature and radiation properties of the test chamber walls

The difference between the air temperature and the temperature of those surfaces of the test chamber visible from the test specimen shall not exceed 3 °C when testing to climates a, b, c or d. Those surfaces shall have an emission coefficient  $\varepsilon$  in range  $\lambda \geq 0,7$   $\mu\text{m}$  of at least 0,85.

NOTE This can normally be achieved by painting with a paint that contains no metallic pigments.

## 9 Procedure

The measurement methods shall comply with clause 7.

### 9.1 Test sequence with set of climates a, b, or c

#### 9.1.1 testing doors with no special requirements

- measurement of initial bow ;
- determination of operating forces ;
- exposure of the doorset to the set of climates specified in table 1;
- measurement of final bow ;
- determination of operating forces ;
- calculation of the difference between final and initial bow.

The exposure to the specified set of climates shall not be less than 7 days and not more than 28 days. In between those two durations, the exposure shall be terminated if during 3 successive days, the increase in deformation is less than 0,1 mm per day.

NOTE See sequence of test procedures illustrated in Annex C.

#### 9.1.2 Testing doors with requirements for air permeability

- measurement of initial bow ;
- determination of operating forces ;

- exposure of the doorset to the set of climates specified in table 1 or table 2;
- measurement of final bow ;
- determination of operating forces ;
- measurement of air permeability ;
- calculation of the difference between final and initial bow.

The exposure to the specified set of climates shall not be less than 7 days and not more than 28 days. In between those two durations, the exposure shall be terminated if during three successive days, the increase in deformation is less than 0,1 mm per day.

NOTE See sequence of test procedures illustrated in Annex D.

## 9.2 Supplementary test to climate d or e

### 9.2.1 Sequence

- preliminary testing to climate a or b or c;
- conditioning of the doorset in a climate of  $(20 \pm 2)$  °C and  $(65 \pm 5)$  % RH for at least 7 days ;
- measurement of bow ;
- exposure to climate d specified in table 1 or climate e specified in table 2;
- measurement of bow ;
- determination of operating forces ;
- calculation of the difference between the bow before and after exposure to climate d or climate e.

### 9.2.2 Duration of exposure

#### 9.2.2.1 Climate d

The exposure shall not exceed 7 days. It can be terminated sooner if, during 3 successive days, the increase in deformation is less than 0,1 mm per day.

NOTE See sequence of test procedures illustrated in Annex E.

#### 9.2.2.2 Climate e

The exposure is maintained for  $(24 \pm 0,5)$  hours.

The measurement of bow and the determination of operating forces are carried out while the heating is on.

Page 10  
EN 1121:2000

NOTE See sequence of test procedures illustrated in Annex E.

### 9.3 Deviation from the test procedure

Any deviation from the test procedure shall be described and reasons given.

NOTE See Annex F.


## 10 Test report

The test report shall contain as minimum the following information :

- name of the test institution;
- all necessary references to identify the door ;
- all relevant details concerning the dimensions of the door , its materials, design, construction and manufacture and its surface finish and fittings. Also its method of delivery to the test laboratory ;
- drawings of details of the door to scale of 1:2 or larger ;
- brief description of the test methods ;
- storage and conditioning prior to test, and mounting of the door ready for test ;
- test climates used ;
- results and their accuracy ;
- any particularities (e.g. deviation from the normal test procedure, with reasons) ;
- reference to this European Standard.

**Annex A (informative)****Description and arrangement of infrared lamps**

Type of lamp	Filigran infrared lamp
Input energy	250 W
Angle of radiation	80 °
Position	in grid pattern
Distance between the lamps	(500 ± 20) mm (see figure A.1)

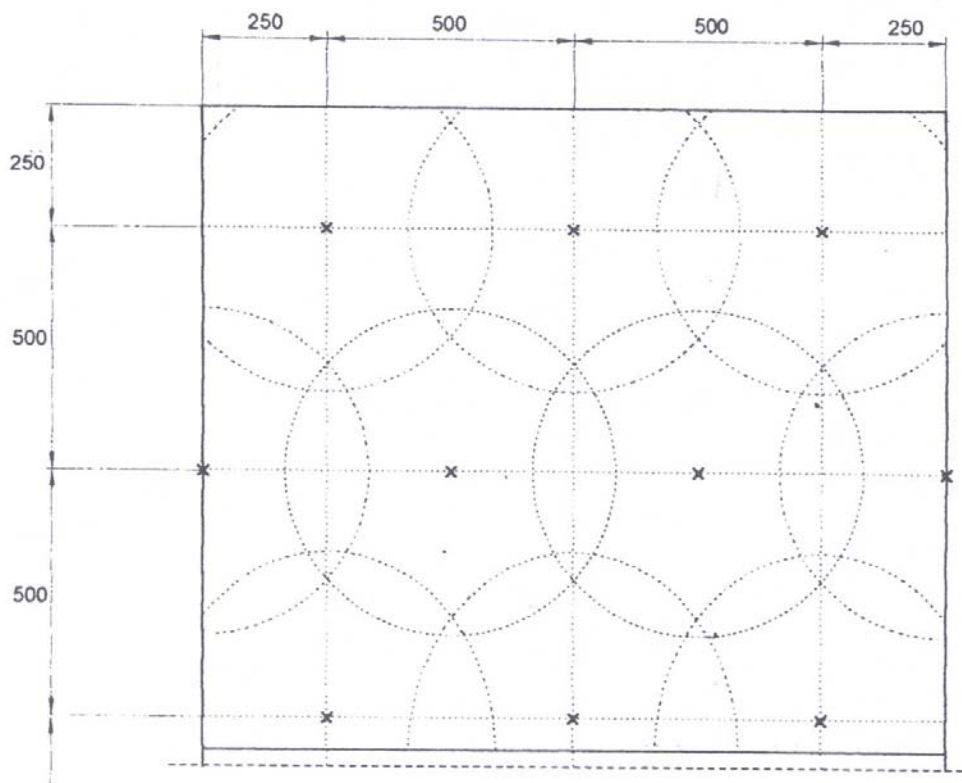

x Position of the infrared lamp  
 ---- Cone of radiation

**Figure A.1 - Description and arrangement of infrared lamps**

By changing the distance of the infrared lamps to the specimen surface the temperature on the reference plates can be adjusted.

## Annex B (informative)


### Procedure for measuring air permeability outside the climate chambers

#### B.1 Description of the test

In order to determine the air permeability of doors with bowed leaves away from the climatic test facility, the bow at the lock side is reproduced mechanically. The air permeability is then measured in accordance with EN 1026 using conventional test apparatus.

#### B.2 Test procedure

- mount the door in the conventional test apparatus ;
- deform the lock side edge of the door leaf mechanically, by means of a pneumatic or hydraulic jack, until the bow achieved during the climatic test is reproduced (see figure B.1) ;
- maintain the pressure applied to the jack at a constant level ;
- close and lock the door ;
- measure the air permeability in accordance with EN 1026;
- open the door and check the bow.

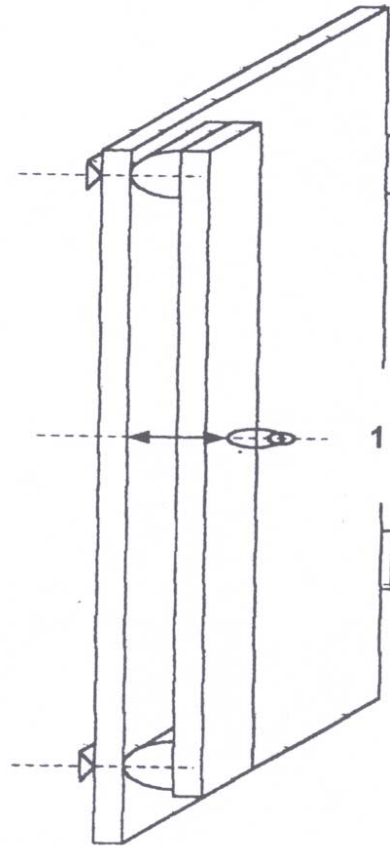


1 Pneumatic or hydraulic jack

**Figure B.1 - Device for mechanical deformation of the door leaf**



**Annex C (informative)**

**Test procedure for doors without special requirements**

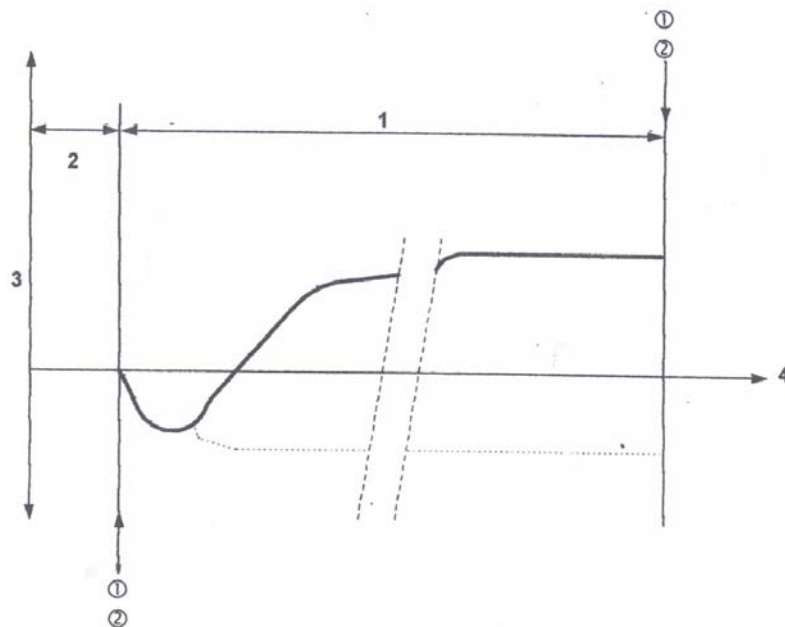


\_\_\_\_\_ door leaves with hygroscopic material  
 - - - - - door leaves without hygroscopic material  
 (1) determination of bow  
 (2) determination of operating forces

- 1 Exposure to differential test climate a, b or c maintained for 7 to 28 days
- 2 Conditioning
- 3 Deviation
- 4 Time

**Figure C.1 - Test procedure for doors without special requirements**

Annex D (informative)

Test procedure for doors with requirements for air permeability

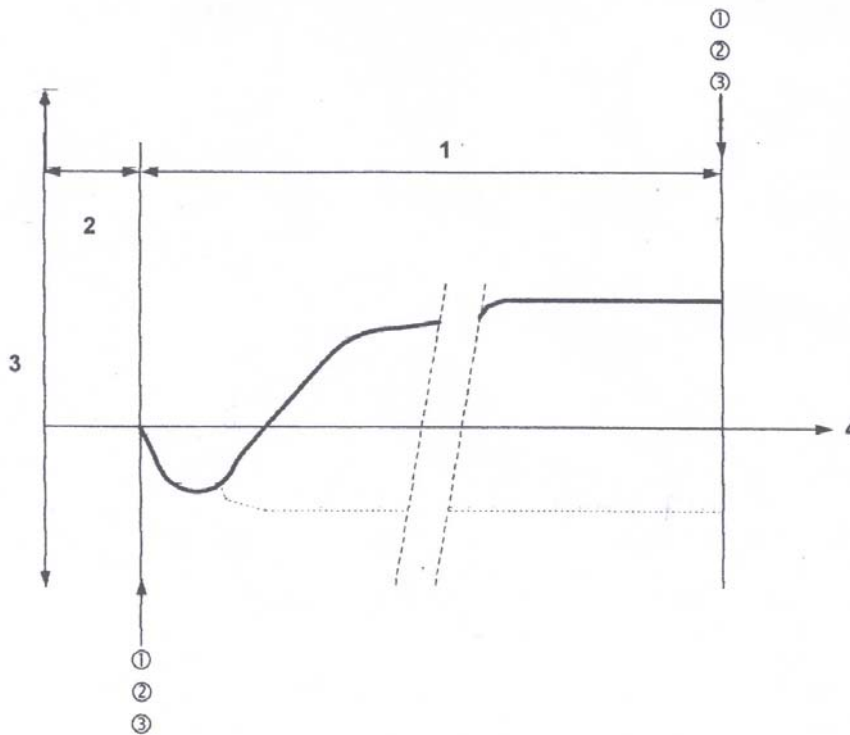


\_\_\_\_\_ door leaves with hygroscopic material  
 - - - - - door leaves without hygroscopic material  
 (1) determination of bow  
 (2) determination of operating forces  
 (3) determination of air permeability

- 1 Exposure to differential test climate a, b or c maintained for 7 to 28 days
- 2 Conditioning
- 3 Deviation
- 4 Time

Figure D.1 - Test procedure for doors with requirements for air permeability

**Annex E (informative)**

**Supplementary tests to climate d or e**

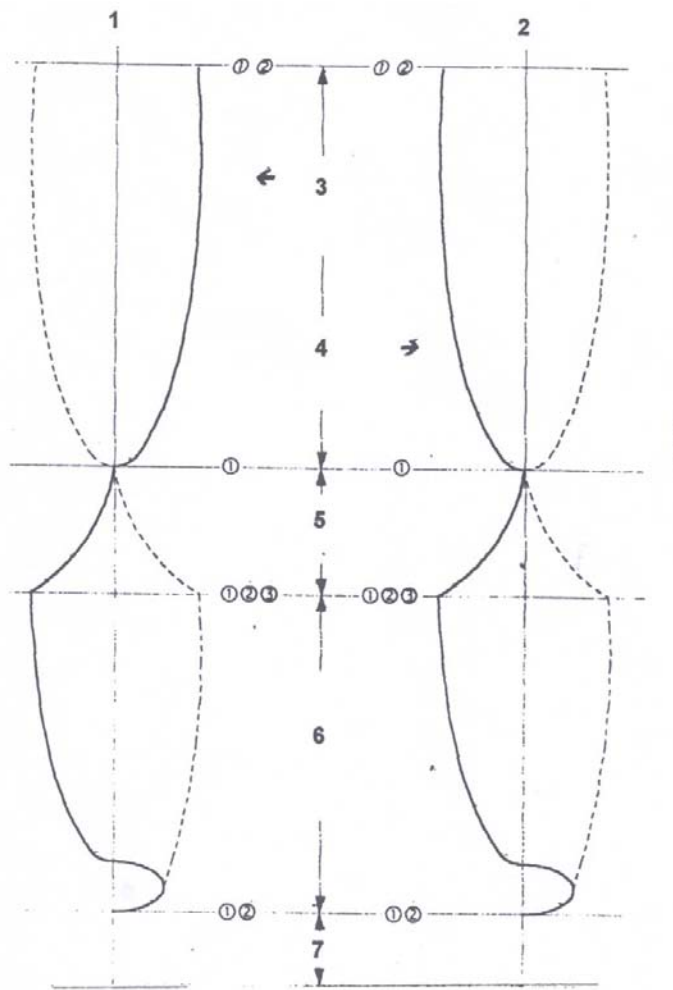

- \_\_\_\_\_ door leaves with hygroscopic material
- door leaves without hygroscopic material
- (1) determination of bow
- (2) determination of operating forces
- (3) determination of air permeability if required

- 1 climate d
- 2 climate e
- 3 Exposure to frost (7 days)
- 4 Heat by radiation (24 hours)
- 5 conditioning at least 7 days
- 6 Exposure to differential test climate a, b or c ; maintained for 7 to 28 days
- 7 conditioning

**Figure E.1 - Supplementary tests to climate d or e**

**Annex F (informative)****Simplified method for testing several different door leaves in one frame of a particular design**

If several door leaves are to be tested for use in identical frames, then the critical level of bow of the door leaf with regard to the maximum permissible air permeability may be determined in advance. For this purpose one of the door leaves shall be deformed mechanically. By progressive deformation of the edge of the door leaf, it is possible to determine the maximum bow at which the air permeability does not exceed the permissible values. Any door which does not exceed this maximum bow during the climatic test then meets the appropriate classification.

.....

---

---

**ICS 91.060.50**

Price based on 16 pages