# INTERNATIONAL STANDARD

ISO 10437

Second edition 2003-07-01

# Petroleum, petrochemical and natural gas industries — Steam turbines — Special-purpose applications

Industries du pétrole, de la pétrochimie et du gaz naturel — Turbines à vapeur — Usage spécial



Reference number ISO 10437:2003(E)

#### PDF disclaimer

This PDF file may contain embedded typefaces. In accordance with Adobe's licensing policy, this file may be printed or viewed but shall not be edited unless the typefaces which are embedded are licensed to and installed on the computer performing the editing. In downloading this file, parties accept therein the responsibility of not infringing Adobe's licensing policy. The ISO Central Secretariat accepts no liability in this area.

Adobe is a trademark of Adobe Systems Incorporated.

Details of the software products used to create this PDF file can be found in the General Info relative to the file; the PDF-creation parameters were optimized for printing. Every care has been taken to ensure that the file is suitable for use by ISO member bodies. In the unlikely event that a problem relating to it is found, please inform the Central Secretariat at the address given below.

#### © ISO 2003

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office Case postale 56 • CH-1211 Geneva 20 Tel. + 41 22 749 01 11 Fax + 41 22 749 09 47 E-mail copyright@iso.org Web www.iso.org

Published in Switzerland

## **Contents**

Page

iii

Forewordvi		
Introductionvii		
1	Scope	1
2	Normative references	1
3	Terms and definitions	4
4	Dimensions	8
5	Statutory requirements	
6	Basic design	
6.1	General	8
6.2	Nameplates and rotation arrows	
7 7.1	Casings	
7.1 7.2	Pressure casings  Casing connections	
7.3	Internal stationary components	. 15
7.4	External forces and moments	
8	Rotating elements	. 15
8.1 8.2	General Shafts	. 15
8.3	Blading	
8.4	Speed-sensing element	
9	Rotor dynamics	
9.1	General	. 17
9.2	Lateral analysis	
9.3 9.4	Unbalanced rotor response verification test	
9.5	Torsional analysis	
9.6	Vibration and balancing	
10	Bearings, bearing housings, and seals	. 27
10.1	Radial bearings	. 27
10.2	Thrust bearings and collars	
10.3 10.4	Bearing housingGrounding	
10.4	Shaft seals	
11	Materials	30
11.1	General	
11.2	Castings	
11.3	Welding	. 32
12	Controls and instrumentation	
12.1 12.2	General  Turbine governing system	
12.2	Overspeed shutdown system	
12.3.1	General	. 36
12.3.2	Electronic overspeed detection system	
12.3.3 12.3.4	Electro-hydraulic solenoid valves	
12.3.4 12.4	Trip valves/combined trip and throttle valves Other alarms and shutdowns	

12.5	Instrument and control panels	
12.6	Indicating instrumentation	
12.6.1	Tachometers	
12.6.2 12.6.3	Temperature gauges	
12.6.3	Thermocouples and resistance temperature detectors	
12.6.4	Pressure gauges	
12.0.3		
13	Electrical systems	41
14	Piping and appurtenances	41
14.1	General	
14.2	Oil piping	42
14.3	Instrument piping	42
15	Accessories	12
15.1	Couplings and guards	
15.2	Gear units	
15.3	Mounting plates	
15.3.1	General	43
15.3.2	Baseplates	
15.3.3	Soleplates and subplates	
15.4	Relief valves	
15.5	Lubrication and control-oil system	
15.6	Gland vacuum systems	
15.7	Insulation and jacketing	
15.8	Turning gear	
15.9	Special tools	
16	Inspection, testing and preparation for shipment	
16.1	General	
16.2	Inspection	
16.2.1	General	
16.2.2	Materials inspection	
16.2.3 16.3	Mechanical inspection	
16.3 16.3.1	General	
16.3.1	Casing pressure hydro tests	
16.3.3	Mechanical running test	
16.3.4	Optional tests and inspections	
16.4	Preparation for shipment	
4-	·	
17 17.1	Vendor's information	
17.1 17.2	General	
17.2.1	General	
	Drawings	
	Technical data	
17.2.4	Curves	
17.3	Contract data	
17.3.1	General	
17.3.2	Drawings and technical data	58
	Parts lists and recommended spares	
17.3.4	Installation, operation, maintenance and technical manuals	58
Annex	A (informative) Typical data sheets	59
	•	
	B (informative) Steam turbine nomenclature	
Annex	C (normative) Procedures for determining residual unbalance	82
Annex	D (informative) Alarm and shutdown systems	88
Annex	E (normative) Coupling guards	90

Annex F (informative) Foundation drawings	92
Annex G (informative) Gland sealing and leak-off system	96
Annex H (informative) Typical inspection of components	98
Annex I (informative) Inspector's checklist	99
Annex J (informative) Vendor drawing and data requirements (VDDR)	101
Bibliography	113

#### **Foreword**

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 2.

The main task of technical committees is to prepare International Standards. Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

ISO 10437 was prepared by Technical Committee ISO/TC 67, *Materials, equipment and offshore structures* for petroleum, petrochemical and natural gas industries, Subcommittee SC 6, *Processing equipment and systems*.

This second edition cancels and replaces the first edition (ISO 10437:1993), which has been technically revised

#### Introduction

This International Standard is based on API Std 612, fourth edition, June 1995.

Users of this International Standard should be aware that further or differing requirements may be needed for individual applications. This International Standard is not intended to inhibit a vendor from offering, or the purchaser from accepting, alternative equipment or engineering solutions for the individual application. This may be particularly appropriate where there is innovative or developing technology. Where an alternative is offered, the vendor should identify any variations from this International Standard and provide details.

This International Standard requires the purchaser to specify certain details and features.

A bullet (•) at the beginning of a clause or subclause indicates that either a decision is required or further information is to be provided by the purchaser. This information or decision should be indicated on the data sheets; otherwise it should be stated in the quotation request (inquiry) or in the order.

In this International Standard, where practical, US Customary units have been included in brackets for information.

....----...

# Petroleum, petrochemical and natural gas industries — Steam turbines — Special-purpose applications

#### 1 Scope

This International Standard specifies requirements and gives recommendations for the design, materials, fabrication, inspection, testing and preparation for shipment of steam turbines for special-purpose applications. It also covers the related lube-oil systems, instrumentation, control systems and auxiliary equipment. It is not applicable to general-purpose steam turbines, which are covered in ISO 10436.

NOTE For the purpose of this provision, API Std 611 is equivalent to ISO 10436.

#### 2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 7-1, Pipe threads where pressure-tight joints are made on the threads — Part 1: Dimensions, tolerances and designation.

ISO 261, ISO general-purpose metric screw threads — General plan

ISO 262, ISO general-purpose metric screw threads — Selected sizes for screws, bolts and nuts

ISO 724, ISO general-purpose metric screw threads — Basic dimensions

ISO 965 (all parts), ISO general-purpose metric screw threads — Tolerances

ISO 1940-1, Mechanical vibration — Balance quality requirements of rigid rotors — Part 1: Determination of permissible residual unbalance

ISO 3744, Acoustics — Determination of sound power levels of noise sources using sound pressure — Engineering method in an essentially free field over a reflecting plane

ISO 7005-1, Metallic flanges — Part 1: Steel flanges

ISO 7005-2, Metallic flanges — Part 2: Cast iron flanges

ISO 8068, Petroleum products and lubricants — Petroleum lubricating oils for turbines (categories ISO-L-TSA and ISO-L-TGA) — Specifications

ISO 8501-1, Preparation of steel substrates before application of paints and related products — Visual assessment of surface cleanliness — Part 1: Rust grades and preparation grades of uncoated steel substrates and of steel substrates after overall removal of previous coatings

ISO 8821, Mechanical vibration — Balancing — Shaft and fitment key convention

ISO 10438 (all parts)<sup>1)</sup>, Petroleum and natural gas industries — Lubrication, shaft sealing and control oil systems for special-purpose applications.

ISO 10441, Petroleum and natural gas industries — Flexible couplings for mechanical power transmission — Special purpose applications

ISO 13691, Petroleum and natural gas industries — High-speed special-purpose gear units

ISO 15649, Petroleum and natural gas industries — Piping

IEC 60045-1, Steam turbines — Part 1: Specifications

IEC 60072, Dimensions and output series for rotating electrical machines

IEC 60079, Electrical apparatus for explosive atmospheres

IEC 60953, Rules for steam turbine thermal acceptance tests

EN 287, Approval testing of welders — Fusion welding<sup>2)</sup>

EN 288, Specification and approval of welding procedures for metallic materials

API RP 520 PT I, Sizing, selection, and installation of pressure-relieving systems in refineries, Part I — Sizing and selection.3)

API RP 520 PT II, Sizing, selection, and installation of pressure-relieving systems in refineries, Part II — Installation

API Std 526, Flanged steel pressure relief valves

API Std 613, Special-purpose gear units for petroleum, chemical and gas industry services

API Std 670, Machine protection systems

API Std 671, Special-purpose couplings for petroleum, chemical and gas industry services

API RP 686 (First edition, April 1996), Recommended Practices for machinery installation and installation design

ASME, Boiler and pressure vessel code, Section V — Nondestructive examination.<sup>4)</sup>

ASME, Boiler and pressure vessel code, Section VIII — Pressure vessels

ASME. Boiler and pressure vessel code. Section IX — Qualification standard for welding and brazing procedures, welders, brazers, and welding and brazing operators

ASME B1.1, Unified screw threads (UN and UNR Thread Form)

ASME B16.1, Cast iron pipe flanges and flanged fittings, Class 25, 125 and 250

2) Comité Européen de Normalisation, 36, rue de Stassart, B-1050 Brussels, Belgium.

4) ASME International, 3 Park Avenue, New York, NY 10016-5990, USA.

<sup>1)</sup> To be published.

<sup>3)</sup> American Petroleum Institute, Publications and Distribution Section, 1220 L Street Northwest, Washington DC 20005, USA.

ASME B16.5, Pipe flanges and flanged fittings, NPS 1/2 through NPS 24

ASME B16.11, Forged fittings, socket-welding and threaded

ASME B16.42, Ductile iron pipe flanges and flanged fittings, classes 150 and 300

ASME B16.47, Large diameter steel flanges NPS 26 through NPS 60

ASME B17.1, Keys and keyseats

ASME PTC 6, Performance test code 6 on steam turbines

ASME PTC 20.2, Overspeed trip systems for steam turbine-generator units

ASTM A 194, Standard specification for carbon and alloy steel nuts for bolts for high-pressure or high-temperature service, or both<sup>5)</sup>

ASTM A 247, Standard test method for evaluating the microstructure of graphite in iron castings

ASTM A 278, Standard specification for gray iron castings for pressure-containing parts for temperatures up to 650 °F (350 °C)

ASTM A 307, Standard specification for carbon steel bolts and studs, 60 000 psi tensile strength

ASTM A 395, Standard specification for ferritic ductile iron pressure-retaining castings for use at elevated temperatures

ASTM A 418, Standard test method for ultrasonic examination of turbine and generator steel rotor forgings

ASTM A 472, Standard test method for heat stability of steam turbine shafts and rotor forgings

ASTM A 536, Standard specification for ductile iron castings

AWS D1.1, Structural welding code — Steel<sup>6)</sup>

NEMA SM 23, Steam turbines for mechanical drive service.<sup>7)</sup>

NFPA 70, National electrical code.8)

NACE MR0175, Sulfide stress cracking resistant metallic materials for oilfield equipment.<sup>9)</sup>

SSPC-SP6/NACE No. 3, Commercial blast cleaning. 10)

<sup>5)</sup> American Society for Testing and Materials, 1916 Race Street, Philadelphia, PA 19103-1187.

<sup>6)</sup> American Welding Society, 550 NW Le Jeune Road, PO Box 351040, Miami, FL 33130, USA.

<sup>7)</sup> National Electrical Manufacturers Association, 1300 N 17th Street; Suite 1847, Rosslyn, VA 22209, USA.

<sup>8)</sup> National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02269, USA.

<sup>9)</sup> NACE International, 1440 South Creek Drive, Houston, TX 77084, USA.

<sup>10)</sup> SSPC: The Society for Protective Coatings, 40 24th Street 6th floor, Pittsburgh, PA 15222-4656, USA.

#### 3 Terms and definitions

For the purposes of this document, the following terms and definitions apply. (See Annex B for a guide to steam turbine nomenclature.)

#### 3.1

#### alarm point

preset value of a measured parameter at which an alarm is actuated to warn of a condition that requires corrective action

#### 3.2

#### anchor bolts

bolts used to attach the mounting plate to the support structure or foundation

#### 3.3

#### axially split

split with the principal joint parallel to the shaft centreline

#### 3.4

#### control mechanism

all of the equipment between the speed governor and the governor-controlled valve(s) (such as linkages, pilot valves, power servos, and so forth)

#### 3.5

#### critical speed

shaft rotational speed at which the rotor-bearing-support system is in a state of resonance

#### 3.6

#### design

equipment manufacturer's description of various parameters relevant to the equipment

NOTE This terminology is for use only by the equipment manufacturer and is not intended to appear in the purchaser's specifications.

#### 3.7

#### fail safe system

system which causes the equipment to revert to a permanently safe condition (shutdown and/or depressurized) in the event of a component failure or failure of the energy supply to the system

#### 3.8

#### field changeable

design feature that permits alteration of a function after the equipment has been installed

NOTE The alteration can be accomplished by the following:

- soldering jumper leads to terminal pins especially provided for this purpose; a)
- employing circuit-board-mounted switches or potentiometers; b)
- using a shorting or diode-pin-type matrix board; c)
- using prewired shorting plugs; d)
- e) using authorized controlled access.

#### 3.9

#### gauge board

bracket or plate used to support and display gauges, switches, and other instruments

NOTE A gauge board is open and not enclosed.

#### 3.10

#### general-purpose turbines

horizontal or vertical turbines used to drive equipment that is usually spared, is relatively small in size (power), or is in non-critical service

NOTE General-purpose steam turbines are intended for applications where the inlet gauge pressure does not exceed 4 800 kPa (48 bar) (700 psi) and the inlet temperature does not exceed 400 °C (750 °F), and where the speed does not exceed 6 000 r/min.

#### 3.11

#### governor-controlled valve

device that controls the flow of steam into or out of the turbine in response to the speed governor

#### 3.12

#### hold-down bolts

mounting bolts

bolts that hold the equipment to the mounting plate or plates

#### 3.13

#### hydrodynamic bearings

bearings that use the principles of hydrodynamic lubrication

NOTE The bearing surfaces are oriented so that relative motion forms an oil wedge, or wedges, to support the load without shaft-to-bearing contact.

#### 3.14

#### local

(device) mounted on or near the equipment or console

#### 3.15

#### maximum allowable speed

highest speed at which the manufacturer's design permits continuous operation

#### 3.16

#### maximum allowable temperature

maximum continuous temperature for which the manufacturer has designed the equipment (or any part to which the term is referred) when handling the specified fluid at any specified operating conditions

#### 3.17

#### maximum allowable working pressure

maximum continuous pressure for which the manufacturer has designed the equipment (or any part to which the term is referred) when handling the specified fluid at the maximum allowable temperature

#### 3.18

#### maximum continuous speed

highest speed at which the turbine, as built and tested, is capable of continuous operation, at any of the specified steam conditions

#### 3.19

#### maximum exhaust casing pressure

highest exhaust steam pressure that the purchaser requires the casing to contain, with steam supplied at maximum inlet conditions

NOTE The turbine casing is subjected to the maximum temperature and pressure under these conditions.

#### 3.20

#### maximum exhaust pressure

highest exhaust steam pressure at which the turbine is required to operate continuously

#### 3.21

#### maximum inlet pressure and temperature

highest inlet steam pressure and temperature conditions at which the turbine is required to operate continuously

#### 3.22

#### maximum sealing pressure

highest pressure the seals are required to seal during any specified static or operating conditions and during startup and shutdown

#### 3.23

#### minimum allowable speed

lowest speed at which the manufacturer's design permits continuous operation

#### 3.24

#### minimum exhaust pressure

lowest exhaust steam pressure at which the turbine is required to operate continuously

#### 3.25

#### minimum inlet pressure and temperature

lowest inlet steam pressure and temperature conditions at which the turbine is required to operate continuously

#### 3.26

#### normal operating point

point at which usual operation is expected and optimum efficiency is desired

NOTE This point is usually the point at which the vendor certifies that performance is within the tolerances stated in this International Standard.

#### 3.27

#### observed

test or inspection for which the purchaser requires notification of the timing and may wish to attend

This is not a hold point. The inspection or test is performed as scheduled, and if the purchaser or the purchaser's representative is not present, the vendor proceeds to the next step.

#### 3.28

final recipient of the equipment who may delegate another agent as the purchaser of the equipment

#### 3.29

#### panel

enclosure used to mount, display and protect gauges, switches and other instruments

#### 3.30

#### potential maximum power

approximate maximum power to which the turbine can be uprated at the specified normal speed and steam conditions when it is furnished with suitable (that is, larger or additional) nozzles and, possibly, with a larger governor-controlled valve or valves

#### 3.31

#### pressure casing

composite of all stationary pressure-containing parts of the unit, including all nozzles and other attached parts

#### 3.32

#### purchaser

agency that issues the order and specification to the vendor

NOTE The purchaser may be the owner of the plant in which the equipment is to be installed or the owner's appointed agent.

#### 3.33

#### radially split

split with the principal joint perpendicular to the shaft centreline

#### 3.34

#### rated power

greatest turbine power specified and its corresponding speed; it includes all the margin required by the specifications of the driven equipment

#### 3.35

#### rated speed

100 % speed

highest rotational speed required to meet any of the specified operating conditions

#### 3.36

#### relief valve set pressure

pressure at which a relief valve starts to lift

#### 3.37

#### remote

⟨device⟩ located away from the equipment or console, typically in a control room

#### 3.38

#### separation margin

margin between a critical speed and the nearest required operating speed

#### 3.39

#### shutdown set point

preset value of a measured parameter at which automatic or manual shutdown of the system or equipment is required

#### 3.40

#### slow roll

speed recommended by the vendor (typically 400 r/min to 500 r/min) for warm-up and initial check of equipment integrity prior to full operation

#### 3.41

#### special-purpose turbines

horizontal turbines used to drive equipment that are usually not spared and are used in uninterrupted continuous operation in critical service

NOTE This category is not limited by steam conditions, power or turbine speed.

#### 3.42

#### special tool

tool which is not a commercially available catalogue item

#### 3.43

#### standby service

normally idle, or idling, piece of equipment that is capable of immediate automatic or manual startup and continuous operation

Not for Resale

#### 3.44

#### steam rate

quantity of steam required by the turbine per unit of power output measured at the output shaft of the turbine

#### 3.45

#### turbine manufacturer

company that designs, manufactures, tests and provides service support for the turbine

#### 3.46

#### trip speed

rotational speed at which the independent overspeed shutdown system operates to shut down a turbine

#### 3.47

#### unit responsibility

responsibility for coordinating the technical aspects of the equipment and all auxiliary systems included in the scope of the order

The technical aspects to be considered include, but are not limited to, such factors as the power requirements, speed, rotation, general arrangement, couplings, dynamics, noise, lubricant selection, instrumentation, piping, testing of components, conformance to specifications and material test reports.

#### 3.48

#### vendor

supplier

agency that supplies the equipment in response to the order

The vendor may be the manufacturer of the equipment or the manufacturer's agent and is normally responsible for service support.

#### 3.49

#### witnessed

inspection or test that the purchaser attends

NOTE A hold is applied to the production schedule and the inspection or test is carried out with the purchaser or purchaser's representative in attendance

#### **Dimensions**

Drawings and maintenance dimensions shall be in SI units or United States Customary (USC) units. Use of an ISO datasheet indicates that SI units shall be used. Use of a USC datasheet indicates that USC units shall be used. Typical datasheets in both systems of units are given in Annex A.

#### Statutory requirements

The purchaser and vendor shall mutually determine the measures that must be taken to comply with any governmental codes, regulations, ordinances or rules that are applicable to the equipment.

#### Basic design

#### 6.1 General

The equipment (including auxiliaries) covered by this International Standard shall be designed and constructed for a minimum service life of 20 years and at least five years of uninterrupted operation.

NOTE It is recognized that achievement of this objective requires a joint effort of the purchaser, vendor and user.

- **6.1.2** The vendor shall assume unit responsibility for all equipment and all auxiliary systems included in the scope of the order.
- **6.1.3** The vendor who has unit responsibility shall assure that all subvendors comply with the requirements of this International Standard.
- 6.1.4 The purchaser shall specify the equipment's normal operating point and any other required operating points, including the inlet and exhaust steam conditions and any extraction or induction steam quantities and pressures. The purchaser shall also specify the maximum and minimum values of the inlet, exhaust and extraction/induction steam conditions.
- 6.1.5 The purchaser shall specify the purity of steam available.
  - NOTE IEC 60045-1 and NEMA SM 23 contain recommendations for steam purity levels.
  - **6.1.6** Turbines shall be capable of the following:
  - a) operation at normal power and speed with normal steam conditions, with the steam rate certified by the manufacturer at these conditions;
  - b) delivering rated power at its corresponding speed with coincident minimum inlet and maximum exhaust conditions specified.
    - NOTE To prevent oversizing or to obtain higher operating efficiency or both, it may be desirable to limit maximum turbine capability by specifying normal power or a selected percentage of rated power instead of rated power at the conditions specified.
  - c) continuous operation at maximum continuous speed and at any other speed within the range specified, with a maximum continuous speed of at least 105 % of rated speed;
  - d) continuous operation at rated power and speed with maximum inlet steam conditions and maximum or minimum exhaust steam conditions;
  - e) continuous operation at the lowest speed at which maximum torque is required with minimum inlet and maximum exhaust conditions, with the purchaser specifying both the speed and torque values required;
  - f) continuous operation at specified conditions for extraction and/or induction:
  - g) operation with variations from rated steam conditions and steam purity levels recommended in IEC 60045-1 or NEMA SM 23;
  - h) operation uncoupled with maximum inlet steam conditions.

Governing instability and high acceleration rates may occur and require action such as throttling of inlet pressure. Care should be taken when operating uncoupled or no load for generator sets. Consideration should be given to the high exhaust and extraction steam temperatures that would result during light or no-load operation.

**6.1.7** Equipment shall be designed to run to the trip speed without damage. The turbine trip speed shall be 110 % of maximum continuous speed, normally 116 % of rated speed.

This requirement should not be construed to allow continuous operation above maximum continuous speed.

**6.1.8** The turbine and accessories shall perform on the test stand and when installed on the permanent foundation within the specified acceptance criteria. After installation, the performance of the combined units shall be the joint responsibility of the purchaser and the vendor who has unit responsibility.

- **6.1.9** Many factors may adversely affect site performance. These factors include such items as piping loads, alignment at operating conditions, supporting structure, handling during shipment, and handling and assembly at the site. To minimize the influence of these factors, the vendor shall review and comment on the purchaser's piping and foundation drawings.
- If specified, the vendor's representative shall witness one or more of the following:
  - a check of the piping alignment performed by unfastening the major flanged connections of the equipment;
  - b) the initial shaft alignment check;
  - c) shaft alignment at operating temperature.
  - NOTE Further information on machinery installation and installation design is given in API RP 686.
  - **6.1.10** The arrangement of the equipment, including piping and auxiliaries, shall be developed jointly by the purchaser and the vendor. The arrangement shall provide adequate clearance areas and safe access for operation and maintenance.
  - **6.1.11** All equipment shall be designed to permit rapid and economical maintenance. Major parts, such as casing components and bearing housings, shall be designed and manufactured to ensure accurate alignment on reassembly. This may be accomplished by the use of shouldering, cylindrical dowels or keys.
  - **6.1.12** Oil reservoirs and housings that enclose moving lubricated parts (such as bearings, shaft seals), highly polished parts, instruments, and control elements, shall be designed to minimize contamination by moisture, dust and other foreign matter during periods of operation or idleness.
  - **6.1.13** Unless otherwise specified, cooling water systems shall be designed for the conditions specified in Table 1. Provision shall be made for complete venting and draining of the system.

Table 1 — Design criteria and specifications for cooling water systems

Criteria	SI units	US Customary units
Water velocity over heat exchanger surfaces	1,5 m/s to 2,5 m/s	5 ft/s to 8 ft/s
Maximum allowable working pressure, gauge	700 kPa	100 psi (7 bar)
Test pressure (1,5 MAWP), gauge	1 050 kPa	150 psi (10,5 bar)
Maximum pressure drop	100 kPa	15 psi (1 bar)
Maximum inlet temperature	32 °C	90 °F
Maximum outlet temperature	49 °C	120 °F
Maximum temperature rise	17 K	30 °R
Minimum temperature rise	11 K	20 °R
Fouling factor on water side	0,32 m <sup>2</sup> ·K/kW	0,002 hr-ft <sup>2</sup> -°F/Btu
Shell corrosion allowance	3 mm	1/8 in

NOTE The criterion for velocity over heat exchange surface is intended to minimize water side fouling; the criterion for minimum temperature rise is intended to minimize the use of cooling water.

- **6.1.14** The vendor shall notify the purchaser if the criteria for minimum temperature rise and velocity over heat exchange surfaces result in a conflicting design. If such a conflict exists, the purchaser shall approve the final selection.
- 6.1.15 Control of the sound pressure level (SPL) of all equipment furnished shall be a joint effort of the
  purchaser and the vendor. The equipment furnished by the vendor shall conform to the maximum allowable
  sound pressure level specified. In order to determine compliance, the vendor shall provide both maximum

sound pressure and sound power level data per octave band for the equipment. The vendor shall provide details of any special measures taken to achieve the stated levels.

- 6.1.16 Motors, electrical components, and electrical installations shall be suitable for the area classification (class, group, and division or zone) specified by the purchaser and shall meet the requirements of the applicable sections of IEC 60079 or NFPA 70, Articles 500, 501, 502, and 504, as well as any local codes specified (and, if requested by the vendor, furnished) by the purchaser.
- 6.1.17 The equipment, including all auxiliaries, shall be suitable for operation under the environmental
  conditions specified by the purchaser. These conditions shall include whether the installation is indoors
  (heated or unheated) or outdoors (with or without a roof), maximum and minimum temperatures, unusual
  humidity, and dusty or corrosive conditions.
- **6.1.18** The equipment, including all auxiliaries, shall be suitable for operation, using the utility conditions specified by the purchaser.
  - **6.1.19** Spare parts for the machine and all furnished auxiliaries shall meet all the criteria of this International Standard.

#### 6.2 Nameplates and rotation arrows

- **6.2.1** A nameplate shall be securely attached at a readily visible location on the equipment and on any other major piece of auxiliary equipment.
- **6.2.2** Rotation arrows shall be cast in, or attached to, each major item of rotating equipment at a readily visible location. Welding is not permitted. A rotation arrow shall be located on the thrust-bearing housing.
- **6.2.3** Nameplates and rotation arrows (if attached) shall be of austenitic stainless steel or of nickel-copper alloy. Attachment pins shall be of the same material.
- **6.2.4** Data shall be clearly stamped on the nameplate and shall include, but not be limited to, the following:
- a) purchaser's equipment item number (may be on a separate nameplate if there is insufficient space on the rating nameplate);
- b) vendor's name;
- c) serial number;
- d) size and type;
- e) rated power and speed;
- f) all lateral critical speeds less than trip speed;
- g) the next lateral critical speed greater than trip speed;
- h) maximum continuous speed;
- i) trip speed (see 3.46);
- j) normal and maximum inlet steam temperature and pressure;
- k) normal and maximum exhaust steam pressure;
- I) number of teeth in the multi-toothed surface provided for speed sensing (see 8.4).

- **6.2.5** Any critical speeds determined from mechanical running tests shall be stamped on the nameplate followed by the word "Test". Critical speeds, predicted by calculation, up to and including the first critical speed above trip speed, and not identifiable by test, shall be stamped on the nameplate followed by the abbreviation "Calc".
- 6.2.6 The purchaser shall specify the units to be shown on the nameplate.

#### 7 Casings

#### 7.1 Pressure casings

- **7.1.1** All pressure parts shall be suitable for operation at the most severe conditions of coincident pressure and temperature expected with the specified steam conditions.
- **7.1.2** The tensile stress used in the design of the pressure casing for any material shall not exceed 0,25 times the minimum ultimate tensile strength for that material at the maximum specified operating temperature, and, for castings, multiplied by the appropriate casting factor as shown in Table 2. The manufacturer shall state the source of the material properties, such as ASTM, as well as the casting factors applied in his/her proposal.
- NOTE For bolting, the allowable tensile stress is used to determine the total bolting area based on pressure load or gasket preload. It is recognized that to provide the initial load required to obtain a reliable bolted joint, the bolting will be tightened to produce a tensile stress higher than the design tensile stress. Values in the range of 0,7 times yield are common.

Type of NDE	Casting factor
Visual, magnetic particle and/or liquid penetrant	0,8
Spot radiography	0,9
Ultrasonic	0,9
Full radiography	1,0

Table 2 — Casting factors

**7.1.3** The maximum allowable working pressure(s) of the casing shall be at least equal to the specified relief valve set point(s). For condensing turbines, the exhaust casing shall be designed for both full vacuum and for a maximum allowable working gauge pressure of at least 70 kPa (0,7 bar) (10 psi).

Normally, a full-capacity safety relief valve is required in the exhaust piping between each exhaust connection and exhaust block valve to prevent overpressure and possible rupture of the turbine casing.

- **7.1.4** The vendor shall define the physical limits and the maximum allowable working pressure of the turbine casing and of each part of turbine casings designed for more than one maximum allowable pressure level (split-pressure-level casings).
- **7.1.5** The turbine casing shall be axially split. Turbine casings may also be split radially between high-pressure and low-pressure sections.
- **7.1.6** The main joint of axially and radially split casings shall use a metal-to-metal joint that is tightly maintained by bolting. The joint shall be sealed with a compound that is compatible with the fluids to be handled. Gaskets (including string type) shall not be used.
- **7.1.7** Each axially split casing shall be sufficiently rigid to allow removal and replacement of its upper half without disturbing rotor-to-casing running clearances.

---,,-,----,,-,-,-,-,-

- **7.1.8** Casings and supports shall be designed to have sufficient strength and rigidity to limit any change in the relative position of the shaft ends caused by the worst combination of allowable pressure, torque, and piping forces and moments, to  $50 \mu m (0,002 in)$  (see 7.4).
- NOTE This clause does not apply to thermal growth.
- **7.1.9** Supports, and the design of jackscrews and their attachments, shall be rigid enough to permit the machine to be moved by the use of its lateral and axial jackscrews without damage.
- **7.1.10** Jackscrews, guide rods, cylindrical casing-alignment dowels and/or other appropriate devices shall be provided to facilitate disassembly and reassembly. Guide rods shall be of sufficient length to prevent damage to the internals or casing studs by the casing during disassembly and reassembly. Lifting lugs or eyebolts shall be provided for lifting only the top half of the casing.
- **7.1.11** When jackscrews are used as a means of parting contacting faces, one of the faces shall be relieved (counter bored or recessed) to prevent a leaking joint or an improper fit caused by marring of the face.
- **7.1.12** The steam chest and casing shall be provided with connections to ensure complete drainage. Drain connections shall be DN25 (NPS 1) minimum size.
- **7.1.13** The use of threaded holes in pressure parts shall be minimized. To prevent leakage in pressure sections of casings, metal equal in thickness to at least half the nominal bolt diameter, in addition to any allowance for corrosion, shall be left around and below the bottom of drilled and threaded holes. The depth of the threaded holes shall be at least 1,5 times the stud diameter. Through bolting is preferred in areas of the casing where the temperature may exceed 410 °C (775 °F).
- **7.1.14** Studded connections shall be furnished with studs installed. The first 1,5 threads at both ends of each stud shall be removed.
- **7.1.15** Bolting shall be furnished as follows.
- a) The details of threading shall conform to ISO 261, ISO 262, ISO 724 and ISO 965, or ASME B1.1.
- b) Studs or through bolts shall be supplied on the main joint of axially split casings and end covers of radially split casing joint(s).
- c) Studs or through bolts shall be used instead of cap screws on all other joints, except where hexagonal head cap screws are essential for assembly purposes and have been approved by the purchaser.
- d) The manufacturer's marking, in accordance with the appropriate standard (e.g. ASTM), shall be located on all fasteners 6 mm (1/4 in) and larger (excluding washers and headless set screws). For studs, the marking shall be located on the nut end of the exposed stud.
- e) Adequate clearance shall be provided at all bolting locations to permit the use of socket or box wrenches.
- f) If specified, the main casing joint studs and nuts shall be designed for the use of hydraulic bolt tensioning. Procedures and any special tooling required shall be provided by the vendor.
  - g) Internal socket-type, slotted-nut or spanner-type bolting shall not be used on the exterior of the turbine case unless specifically approved by the purchaser.
  - **7.1.16** Mounting surfaces shall meet the following criteria.
  - a) The surface finish shall be 6 μm (250 μin) arithmetic average roughness, Ra, or better.
  - b) The mounting surfaces in one plane shall be machined such that no point on any surface deviates from the common plane by more than 50 µm (0,002 in).
  - c) The different mounting planes shall be parallel to each other within 1 in 1 000, in any direction.
  - d) The upper surfaces shall be machined or spot-faced (to a diameter three times that of the hole), parallel to the mounting surface.

- **7.1.17** Hold-down bolt holes shall be drilled perpendicular to the mounting surface or surfaces and shall be 15 mm (0,6 in) larger in diameter than the hold-down bolt.
- **7.1.18** The equipment feet shall be provided with vertical jackscrews and shall be drilled with pilot holes that are accessible for use in final doweling.

#### 7.2 Casing connections

- 7.2.1 The purchaser shall specify the orientation of the main inlet and outlet steam connections. All connections shall be suitable for the maximum allowable working pressure(s) of the casing. Flanged connections shall be integral with the casing or, for casings of weldable material, may be formed by a socket-welded or butt-welded pipe nipple or transition piece, and shall terminate with a weld-neck or socket-weld flange.
  - **7.2.2** Connections welded to the casing shall meet the material requirements of the casing, including impact values, rather than the requirements of the connected piping (see 11.3.4). All welding of connections shall be completed before the casing is hydrostatically tested (see 16.3.2).
  - **7.2.3** Casing openings for piping connections shall be at least DN 20 (NPS 3/4) and shall be flanged or machined and studded. For casings of non-weldable materials, and where flanged or machined and studded openings are impractical, threaded openings in DN 20 (NPS 3/4) to DN 40 (NPS 1½) are permissible. Connections to these threaded openings shall be installed as follows.
  - a) Pipe nipples shall be provided with a weld-neck or socket-weld flange.
  - b) The nipple and flange materials shall meet the requirements of 7.2.2.
  - c) Threaded openings and bosses for tapered pipe threads shall conform to ASME B16.5.
  - d) Pipe threads shall be tapered threads conforming to ISO 7-1.
    - NOTE For the purpose of this provision, ASME B1.20.1 is equivalent to ISO 7-1.
  - e) A process-compatible thread lubricant of proper temperature specification shall be used on all threaded connections. Thread tape shall not be used.
  - **7.2.4** Pipe nipples screwed or welded to the casing should not be more than 150 mm (6 in) long and shall be a minimum of Schedule 160 seamless for sizes DN 25 (NPS 1) and smaller, and a minimum of Schedule 80 for DN 40 (NPS 1½). Bracing or reinforcement is required when nipples longer than 150 mm (6 in) are necessary.
  - **7.2.5** Sizes DN 32, DN 65, DN 90, DN 125, DN 175 and DN 225 (NPS 1 1/4, 2 1/2, 3 1/2, 5, 7, and 9) shall not be used.
  - **7.2.6** For non-weldable casing materials, threaded openings not required to be connected to piping shall be plugged with solid, round-head steel plugs in accordance with ASME B16.11, unless otherwise specified. Plugs that may later require removal shall be of a corrosion-resistant material. Plastic plugs are not permitted.
  - **7.2.7** Flanges shall conform to the following.
  - a) Cast iron flanges shall be flat faced and conform to the dimensional requirements of ISO 7005-2 or ASME B16.1 or ASME 16.42. Class 125 flanges shall have a minimum thickness equal to Class 250 for sizes DN 200 (8 NPS) and smaller. Gray cast iron shall not be used.
  - b) Steel flanges shall conform to dimensional requirements of ISO 7005-1 or ASME B16.5 or B16.47.
  - c) Flat face flanges with full raised face thickness are acceptable on casings of all materials. Flanges in all materials that are thicker or have a larger outside diameter than required by ISO or ANSI are acceptable. Non-standard (oversized) flanges shall be completely dimensioned on the arrangement drawing.

- d) Machined and studded connections and flanges not in accordance with ISO 7005-1, ISO 7005-2, ASME B16.1, ASME B16.5, ASME B16.42 or ASME B16.47 require purchaser's approval. Unless otherwise specified, the vendor shall supply mating flanges, studs nuts and gaskets for these non-standard connections.
- e) The concentricity of the bolt circle and the bore of all casing flanges shall be such that the area of the machined gasket-seating surface is adequate to accommodate a complete standard gasket without protrusion of the gasket into the fluid flow.
- f) Flanges shall be full faced or spot faced on the back and shall be designed for through bolting.
- g) Vertical nozzles shall have flanges parallel with the horizontal plane within 0,5°. Horizontal nozzles shall have flanges parallel with the vertical plane within 0,5°. Studs or bolt holes shall straddle centrelines parallel to the main axes of the equipment.
- **7.2.8** Machined and studded connections shall conform to the facing and drilling requirements of ISO 7005-1 or ISO 7005-2, or ASME B16.1, ASME B16.5, ASME B16.42 or ASME B16.47.
- **7.2.9** All of the purchasers' connections shall be accessible for disassembly without requiring the steam turbine, any major part or attached auxiliary piping to be moved.

#### 7.3 Internal stationary components

- **7.3.1** All control stage nozzle rings shall be replaceable. Nozzle rings welded to the outer casing are acceptable only when approved in advance by the purchaser.
- **7.3.2** All other stationary blading shall be mounted in replaceable diaphragms or blade carriers. Nozzles or blades welded to the diaphragm are preferred (see 11.3.1).
- 7.3.3 Any internal fasteners shall be positively retained to prevent them from entering the steam path.
- **7.3.4** The design shall ensure that water cannot be trapped in the wet region of a condensing turbine. The design of water drain holes in the wet region of a condensing turbine shall avoid the holes becoming blocked by corrosion or debris. In the case of drain holes in the diaphragms of an impulse type turbine, this shall be achieved by lining the drain holes with corrosion resistant material.

#### 7.4 External forces and moments

Turbines shall be designed to withstand external forces and moments at least equal to the values calculated in accordance with NEMA SM 23.

#### 8 Rotating elements

#### 8.1 General

**8.1.1** Rotors shall be capable of safe operation at maximum overshoot speed of 121 % of maximum continuous speed at any specified operating temperature. Following such an excursion, the rotor shall be capable of operation without immediate maintenance intervention.

NOTE Rubbing of seals and minor localized yielding of rotor components can occur and vibration levels can increase after such an event.

- **8.1.2** The purchaser's approval is required for built-up rotors (disks shrunk on the shaft) when blade tip velocities exceed 250 m/s (825 ft/s) at maximum continuous speed or when stage inlet steam temperatures exceed 440 °C (825 °F).
- **8.1.3** Each rotor shall be permanently marked with a unique identification number. This number shall be on the shaft end, in an area that is not prone to damage.

• **8.1.4** If specified, provisions shall be made for field balancing without disassembly of the turbine. The vendor shall describe these provisions and the method of use in the proposal.

#### 8.2 Shafts

- 8.2.1 Shafts shall be accurately finished throughout their entire length. The surface of the shaft at shrink fit areas and bearing areas shall be finished to a roughness not exceeding  $0.8 \mu m$  (32  $\mu$ in) Ra.
- **8.2.2** The rotor shaft sensing areas to be observed by radial vibration probes shall be concentric with the bearing journals. All sensing areas (both radial vibration and axial position) shall be free from stencil and scribe marks or any other surface discontinuity, such as an oil hole or a keyway, for a minimum of one probetip diameter on each side of the probe. These areas shall not be metallized, sleeved or plated. The surface shall be finished to a roughness not exceeding  $0.8 \, \mu m$  (32  $\mu$ in) Ra. These areas shall be properly demagnetized to the levels specified in API Std 670 or otherwise treated so that the combined total electrical and mechanical runout does not exceed the following.
- a) For areas to be observed by radial-vibration probes, 25 % of the allowed peak-to-peak vibration amplitude or 6,3 µm (0,25 mil), whichever is greater.
- b) For areas to be observed by axial-position probes, 12,7 µm (0,5 mil).
- **8.2.3** All shaft keyways shall have fillet radii conforming to ASME B17.1.
- **8.2.4** Shafts shall be capable of transmitting torque at least equal to the torque determined by potential maximum power. The coupling shaft end design shall conform to the requirements of ISO 10441 or API Std 671.
- **8.2.5** To prevent the buildup of harmful potential voltage, magnetic flux density of any part of the rotating element shall not exceed 0,000 3 T (3 G).

#### 8.3 Blading

**8.3.1** For each blade row, the vendor shall verify by Campbell diagrams or their equivalent (corrected to actual operating temperatures and speeds), for both nozzle passing frequency and twice nozzle passing frequency, that excitation does not occur within the specified operating speed range for all multiples up to 15 times running speed. The following modes shall be verified:

	in-priase langerillar,
—	out-of-phase tangential;
—	axial;
	torsional;
	any other high-response modes

in phase tengential

If this is not feasible, blade-stress levels developed in any specified driven-equipment operation shall be low enough to ensure trouble-free operation if resonant vibration occurs within the operating range. This shall be verified by Goodman diagrams or their equivalent. Copies of Campbell or Goodman diagrams or both shall be provided to the purchaser. Blades shall be designed to withstand operation at resonant frequencies during normal warm-up.

NOTE Excitation sources include — but are not limited to — fundamental and first harmonic passing frequencies of rotating blades and stationary vanes upstream and downstream of each blade row, steam passage splitters, irregularities in vane pitch at horizontal casing flanges, the first four turbine speed harmonics, casing openings (exhaust or extraction), partial arc diaphragms or nozzle plates, internal struts and structural members in the inlet and exhaust casing or horizontal joints, and meshing frequencies in gear units.

**8.3.2** All blades shall be mechanically suitable for operation (including transient conditions) over the specified speed range. The vendor shall assume that torque varies as speed squared, unless otherwise notified by the purchaser.

#### 8.4 Speed-sensing element

A dedicated multi-toothed surface for speed sensing shall be provided integral with, or positively attached and locked to, the turbine shaft. This surface may be shared by other speed sensors but shall not be used as a gear for driving other mechanical components. The axial width of the multi-toothed surface (the width of the surface being viewed by radial probes) shall be a minimum of one and one-half times the diameter of the probe tip.

#### 9 Rotor dynamics

#### 9.1 General

- **9.1.1** In the design of rotor-bearing systems, consideration shall be given to all potential sources of periodic forcing phenomena (excitations), which shall include, but are not limited to, the following:
- a) unbalance in the rotor system;
- b) oil-film instabilities (whirl);
- c) internal rubs;
- d) blade and nozzle passing frequencies;
- e) gear-tooth meshing and side bands;
- f) coupling misalignment;
- g) loose rotor-system components;
- h) hysteretic and friction whirl;
- i) boundary-layer flow separation;
- j) acoustic and aerodynamic cross-coupling forces;
- k) asynchronous whirl;
- I) electrical line frequency.
- NOTE 1 The frequency of a potential source of excitation can be less than, equal to, or greater than the rotational speed of the rotor.
- NOTE 2 When the frequency of a periodic forcing phenomenon (excitation) applied to a rotor-bearing support system coincides with a natural frequency of that system, the system is in a state of resonance. A rotor-bearing-support-system in resonance can have the magnitude of its normal vibration amplified. The magnitude of amplification and, in the case of critical speeds, the rate of change of the phase-angle with respect to speed, are related to the amount of damping in the system.
- NOTE 3 Publication 684 contains additional information on rotor dynamics not covered in this International Standard.
- **9.1.2** For the purposes of this International Standard, critical speeds and other resonant conditions of concern are those with an amplification factor greater than 2,5.
- **9.1.3** Resonances of structural support systems that are within the vendor's scope of supply and that affect the rotor vibration amplitude shall not occur within the specified operating speed range or the specified separation margins (see 9.2.9). The effective stiffness of the structural support shall be considered in the analysis of the dynamics of the rotor bearing support system [see 9.2.4 d)].
- NOTE Resonances of structural support systems can adversely affect the rotor vibration amplitude.

9.1.4 The vendor who is specified to have unit responsibility for the complete drive train shall communicate the existence of any undesirable running speeds in the range from zero to trip speed. This shall be illustrated by the use of Campbell (forced frequency) diagrams for individual machines or, if specified, for the complete train, or for both. These diagrams shall be submitted to the purchaser for review and included in the instruction manual.

NOTE Examples of undesirable speeds are those associated with the rotor lateral criticals of concern, system torsionals and blading modes.


#### 9.2 Lateral analysis

- **9.2.1** Critical speeds and their associated amplification factors shall be determined by means of a damped unbalanced rotor response analysis.
- **9.2.2** The location of all critical speeds below the trip speed shall be confirmed on the test stand during the mechanical running test by unbalancing the rotor if necessary. The accuracy of the numerical model shall be demonstrated (see 9.3).
- **9.2.3** Before carrying out the damped unbalanced response analysis, the vendor shall conduct an undamped analysis to identify the undamped critical speeds and determine the mode shapes located in the range from 0 % to 125 % of trip speed. Unless otherwise specified, the results of the undamped analysis shall be provided to the purchaser. The presentation of the results shall include:
- a) mode shape plots (relative amplitude vs. axial position on rotor), and
- b) critical speed-support stiffness map (frequency versus support stiffness) with the calculated support stiffness; horizontal,  $K_{XX}$ , and vertical,  $K_{YY}$ , (see Figure 1) superimposed on the map.

For machinery with widely varying bearing loads and/or load direction, the vendor may propose to substitute mode shape plots listing the undamped critical speed for each of the identified modes in lieu of the undamped critical speed map.

- **9.2.4** The damped unbalanced response analysis shall include, but shall not be limited to, the following:
- a) rotor masses, including the mass moment of coupling halves, stiffness, and damping effects (e.g. accumulated fit tolerances, fluid stiffening, dampening);
- b) bearing lubricant-film stiffness and damping values, including changes due to speed, load, preload, range
  of oil temperatures, maximum-to-minimum clearances resulting from accumulated assembly tolerances,
  and the effect of asymmetrical loading caused by partial arc admission, side streams, eccentric
  clearances, etc.;
- c) the pad pivot stiffness (for tilting pad bearings);
- d) support <sup>11</sup>) stiffness, mass, and damping characteristics, including effects of frequency dependent variation and for which
  - 1) the vendor shall state the support stiffness values used in the analysis and the basis for these values (e.g. modal tests of similar rotor support systems, or calculated support stiffness values),
  - 2) for machines whose bearing support stiffness values are less than or equal to 3,5 times the bearing oil-film stiffness values, support stiffness values derived from modal testing or calculated frequency dependent support stiffness and damping values (impedances) shall be used, and
  - 3) the value used for support stiffness should, in most cases, not exceed  $0.875 \times 10^6 \, \text{N/mm}$  (5  $\times$  10<sup>6</sup> lbf/in);

<sup>11)</sup> The term "support" includes the foundation or support structure, the base, the machine frame, and the bearing housing as appropriate.

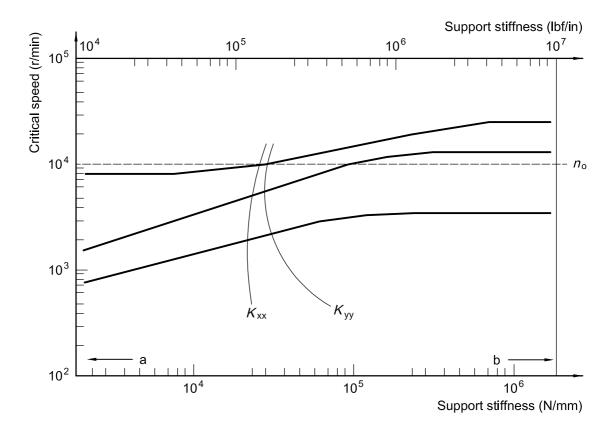

#### Key

- a low amplification factors
- b high amplification factors
- $K_{\mathsf{XX}}$  calculated support stiffness, horizontal
- $K_{vv}$  calculated support stiffness, vertical
- $n_0$  operating speed

Figure 1 — Undamped critical speed map

- e) rotational speed, including the various starting-speed detents, operating speed and load ranges (including agreed upon test conditions if different from those specified), trip speed, and coast-down conditions;
- f) the influence, over the operating range, of values for hydrodynamic stiffness and damping generated by the casing end seals;
- g) location and orientation of the radial vibration probes which shall be the same in the analysis as in the machine.
- 9.2.5 If specified, the effects of other equipment in the train shall be included in the damped unbalanced response analysis (i.e. a train lateral analysis shall be performed). In particular, this analysis should be considered for machinery trains with rigid couplings.
  - **9.2.6** A separate damped unbalanced response analysis shall be conducted for each critical speed within the speed range of 0 % to 125 % of trip speed. Unbalance shall analytically be placed at the locations that have been determined, by the undamped analysis, to most adversely affect the particular mode. For the translatory (symmetric) modes, the unbalance shall be based upon the sum of the journal static loads and shall be applied at the location of maximum displacement. For conical (asymmetric) modes, the unbalance shall be added at the location of maximum displacement nearest to each journal bearing. These unbalance masses shall be  $180^{\circ}$  out of phase and of magnitude based on the static load on the adjacent bearing. Figure 2 shows the typical mode shapes and indicates the locations and definitions of U for each of the shapes. The magnitude of the unbalance mass shall be four times the value of U as calculated by Equation (1).

In SI units:

$$U = \frac{6350 \times m}{n} \tag{1}$$


In US Customary units:

$$U = \frac{4 \times m}{n}$$

where

- is the input unbalance to be used in the rotor dynamic response analysis, expressed in grammillimetres (ounce-inches);
- is the mass, as follows, expressed in kilograms (pounds):
  - the rotor mass, for symmetric modes [see Figure 2 a) and c)];
  - that portion of the rotor mass supported by the adjacent bearing, for asymmetric modes [see Figure 2 b) and d)];
  - the overhung mass, i.e. the mass of the rotor outboard of the bearing, for overhung cantilevered modes [see Figure 2 e)];
  - the overhung mass, i.e. the mass of the rotor outboard of the bearing, or the mass load on the adjacent bearing, whichever is greater, for overhung rigid modes [see Figure 2 f)];
- is the operating speed nearest the critical speed of concern, expressed in revolutions per minute. n
- As a minimum, the unbalanced response analysis shall produce the following: 9.2.7
- identification of the frequency of each critical speed in the range from 0 % to 125 % of the trip speed;
- frequency, phase, and response amplitude data (Bode plots) at the vibration probe locations through the range of each critical speed resulting from the unbalance specified in 9.2.6;
- the plot of the deflected rotor shape for each critical speed resulting from the unbalances specified in 9.2.6, showing the major-axis amplitude at each coupling plane of flexure, the centrelines of each bearing. the locations of each radial probe, and at each seal area throughout the machine as appropriate, while, in addition, the minimum design diametral running clearance of the seals shall be indicated;
- additional Bode plots that compare absolute shaft motion with shaft motion relative to the bearing housing for machines where the support stiffness is less than 3,5 times the oil film thickness.
- Additional analyses shall be made for use with the verification test specified in 9.3. The location and magnitude of the unbalance shall be determined by the vendor and approved by the purchaser. Any test stand parameters which influence the results of the analysis shall be included.


Not for Resale



SI units:  $U = 6 350 (m_1 + m_2) / n$ 

USC units:  $U = 4 (m_1 + m_2) / n$ 


# ) Translatory first rigid



SI units:  $U = 6 350 (m_1 + m_2) / n$ 


USC units:  $U = 4 (m_1 + m_2) / n$ 

#### c) First bending



SI units:  $U = 6 350 m_3 / n$ USC units:  $U = 4 m_3 / n$ 

#### e) Overhung, cantilevered




SI units:  $U_1 = 6 350 m_1 / n$ 

 $U_2 = 6 350 \ m_2 \ / \ n$ 

USC units:  $U_1 = 4 m_1 / n$ 

 $U_2 = 4 m_2 / n$ 

#### b) Conical, rocking second rigid




SI units:  $U_1 = 6 350 m_1 / n$ 

 $U_2 = 6 350 m_2 / n$ 

USC units:  $U_1 = 4 m_1 / n$ 

 $U_2 = 4 m_2 / n$ 

## d) Second bending



SI units:  $U_1 = 6 350 \ m / n$ USC units:  $U_1 = 4 \ m / n$ 

(where m is the larger of  $m_1$  or  $m_4$ )

#### f) Overhung, rigid

#### Key

 $U \quad \hbox{ unbalance mass, expressed in gram-millimetres (ounce-inches)} \\$ 

m see 9.2.6

n operating speed nearest speed of concern, expressed in revolutions per minute

The position of the arrows labelled U indicates the location of the applied unbalances.

Figure 2 — Typical mode shapes

- **9.2.9** The damped unbalanced response analysis shall indicate that the machine meets the following separation margins (see Figure 3).
- a) If the amplification factor at a particular critical speed is less than 2,5, the response is considered critically damped and no separation margin is required.
- b) If the amplification factor at a particular critical speed is 2,5 or greater, and that critical speed is below the minimum speed, the separation margin  $(M_s)$ , as a percentage of the minimum speed, shall not be less than the value from Equation (2) or the value of 16, whichever is less.

$$M_{s} = 17 \times \left[1 - \frac{1}{F_{a} - 1,5}\right]$$
 (2)

where

 $M_{\rm S}$  is the separation margin;

 $F_a$  is the amplification factor.

c) If the amplification factor at a particular critical speed is 2,5 or greater, and that critical speed is above the maximum continuous speed, the separation margin, as a percentage of the maximum continuous speed, shall not be less than the value from Equation (3) or the value of 26, whichever is less.

$$M_{s} = 10 + 17 \times \left[ 1 - \frac{1}{F_{a} - 1.5} \right]$$
 (3)

where

 $M_{\rm S}$  is the separation margin;

 $F_a$  is the amplification factor.

**9.2.10** The calculated unbalanced peak-to-peak amplitudes (see 9.2.7) shall be multiplied using the factor calculated using Equation (4).

$$F_{\mathbf{c}} = \frac{A_1}{A_{\mathbf{d}\mathbf{x}}} \tag{4}$$

where

 $F_{\rm c}$  is the correction factor;

 $A_1$  is the amplitude limit, calculated using Equation (5), in  $\mu$ m (mil);

 $A_{4x}$  is the calculated peak-to-peak amplitude at the probe location in accordance with 9.2.7.b in  $\mu$ m (mil) peak to peak.

In SI units:


$$A_1 = 25,4 \times \sqrt{\frac{12 \quad 000}{n}} \tag{5}$$

In USC units:

$$A_1 = \sqrt{\frac{12 \quad 000}{n}}$$

where

*n* is the operating speed nearest the critical speed of concern, in revolutions per minute.

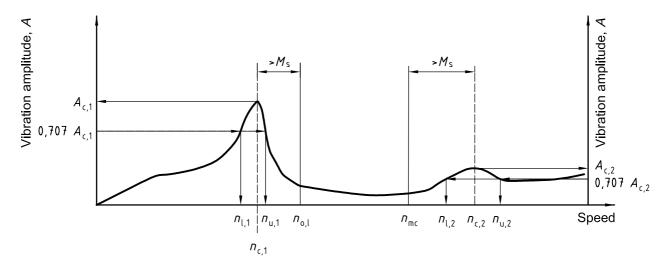

#### Key

$n_{C,n}$	critical speed n	$n_{mc}$	maximum continuous speed, 105 % rated speed
$n_{l,n}$	lower speed at 0,707 of amplitude at critical speed n	$A_{\mathtt{C},n}$	amplitude at critical speed n
$n_{u,n}$	upper speed at 0,707 of amplitude at critical speed $n$	$M_{\sf S}$	separation margin, function of $F_{a}$
$n_{O,I}$	minimum operating speed	$F_{a}$	amplification factor = $n_{C,n} / (n_{U,n} - n_{I,n})$

NOTE1 Operating speed range is from  $n_{o,l}$  to  $n_{mc}$ 

NOTE2 The shape of the curve is for illustration only and does not necessarily represent any actual rotor response plot; multiple critical speeds can be present below and above operating speed range.

#### Figure 3 — Rotor response plot

**9.2.11** The calculated major-axis, peak-to-peak, unbalanced rotor response amplitudes, corrected in accordance with 9.2.10, at any speed from zero to trip speed, shall not exceed 75 % of the minimum design diametral running clearances throughout the machine.

NOTE Running clearances can be different from the assembled clearances with the machine shut down.

#### 9.3 Unbalanced rotor response verification test

- **9.3.1** An unbalanced rotor response test shall be performed as part of the mechanical running test (see 16.3.3), and the results shall be used to verify the analytical model. The actual response of the rotor on the test stand to the same arrangement of unbalance as was used in the analysis specified in 9.2.8 shall be the criterion for determining the validity of the damped unbalanced response analysis. To accomplish this, the procedure given in a) to f), shall be performed.
- a) During the mechanical running test (see 16.3.3), record the amplitudes and phase angle of the shaft vibration, from zero to trip speed. Preset the gain of any analog recording instruments used before the test so that the highest response peak is within 60 % to 100 % of the recorder's full scale on the test-unit coast-down (deceleration).

NOTE This set of readings is normally taken during coast-down, with convenient increments of speed such as 50 r/min. Since the rotor is fully balanced at this point, any vibration amplitude and phase detected is usually the result of residual unbalance and mechanical and electrical runout.

- b) Establish the location of all critical speeds below the trip speed.
- c) Add the unbalance agreed upon in accordance with 9.2.8 and which was used in the analysis performed in 9.2.8 to the rotor in the location used in the analysis. The unbalance shall not exceed eight times the value of U calculated in accordance with 9.2.6, Equation (1).

- d) Bring the machine up to the operating speed nearest to the critical speed in question and record the indicated vibration amplitudes and phase using the same procedure used for a) above.
- e) Vectorially subtract the corresponding indicated vibration data taken in accordance with a) from the results of this test.
- f) Compare the results of the mechanical run, including the unbalance response verification test, with those from the analytical model specified in 9.2.8.
- **9.3.2** The vendor shall correct the model if it fails to meet either of the criteria contained in a) and b) below.
- a) The actual critical speeds determined on test shall not deviate from the corresponding critical speeds predicted by analysis by more than 5 %. Where the analysis predicts more than one critical speed in a particular mode (due, for example, to the bearing characteristics being significantly different horizontally and vertically or between the two ends of the machine), the test value shall not be lower than 5 % below the lowest predicted value nor higher than 5 % above the highest predicted value.
  - It is possible, particularly on electric motors, that the vertical and horizontal stiffnesses are significantly different and the analysis predicts two differing critical speeds. Should the operating speed fall between these critical speeds, these two critical speeds should be treated separately, as if they resulted from separate modes.
- b) The actual major axis amplitude of peak responses from test, including those critically damped, shall not exceed the predicted values. The predicted peak response amplitude range shall be determined from the computer model based on the four radial probe locations.
- **9.3.3** If the support stiffness is less than two times the bearing oil film stiffness, the absolute vibration of the bearing housing shall be measured and vectorially added to the relative shaft vibration, in both the balanced [9.3.1 a)] and in the unbalanced [9.3.1 d)] condition, before proceeding with the step specified in 9.3.1 e). In such a case, the measured response shall be compared with the predicted absolute shaft movement.
- **9.3.4** Unless otherwise specified, the verification test of the rotor unbalance shall be performed only on the first rotor tested, if multiple identical rotors are purchased.
- **9.3.5** The vibration amplitudes and phase from each pair of x-y vibration probes shall be vectorially summed at each vibration response peak after correcting the model, if required, to determine the maximum amplitude of vibration. The major axis amplitudes of each response peak shall not exceed the limits specified in 9.2.11.

#### 9.4 Additional testing

- **9.4.1** Additional testing is required (see 9.4.2) if, from the corrected damped unbalance response analysis (9.2, 9.3.2), either of the following conditions exist:
- a) any critical response fails to meet the separation margin requirements of 9.2.9;
- b) the clearance requirements of 9.2.11 have not been met.
- **9.4.2** Unbalance masses shall be placed as described in 9.2.6; this may require disassembly of the machine. Unbalance magnitudes shall be achieved by adjusting the indicated unbalance that exists in the rotor from the initial run to raise the displacement of the rotor at the probe locations to the vibration limit defined by 9.2.10, Equation (5) at the maximum continuous speed; however, the unbalance used shall be no less than two or greater than eight times the unbalance limit specified in 9.2.6, Equation (1). The measurements from this test, taken in accordance with 9.3.1 a) and 9.3.1 b) shall meet the following criteria:
- a) at no speed outside the operating speed range, including the separation margins, shall the shaft deflections exceed 90 % of the minimum design running clearances;

- b) at no speed within the operating speed range, including the separation margins, shall the shaft deflections exceed 55 % of the minimum design running clearances or 150 % of the allowable vibration limit at the probes (see 9.2.10).
- **9.4.3** The internal deflection limits specified in 9.4.2 a) and 9.4.2 b) shall be based on the calculated displacement ratios between the probe locations and the areas of concern identified in 9.2.11, based on a corrected model if required. Actual internal displacements for these tests shall be calculated by multiplying these ratios by the peak readings from the probes. Acceptance shall be based on these calculated displacements or inspection of the seals if the machine is opened. Damage to any portion of the machine as a result of this testing shall constitute failure of the test. Minor internal seal rubs that do not cause clearance changes outside the vendor's new-part tolerance do not constitute damage.

#### 9.5 Torsional analysis

- 9.5.1 For units including gears or generators, or for units comprising three or more coupled machines, or if
  specified, the vendor having unit responsibility shall ensure that a torsional vibration analysis of the complete
  coupled train is performed and shall be responsible for directing any modifications necessary to meet the
  requirements of 9.5.2 to 9.5.6.
  - **9.5.2** Excitation of torsional natural frequencies could come from many sources which might or might not be a function of running speed and should be considered in the analysis. These sources to be considered shall include at least the following:
  - a) gear problems such as unbalance, pitchline runout, and cumulative pitch error;
  - b) cyclic process impulses;
  - c) torsional transients such as start-up of synchronous electric motors and generator phase-to-phase or phase-to-ground faults;
  - d) torsional excitation resulting from electric motors and rotary type positive displacement machines;
  - e) control loop resonances from hydraulic, electronic governors, and variable frequency drives;
  - f) one or two times line frequency;
  - g) running speed or speeds;
  - h) harmonic frequencies from variable frequency drivers when motor drivers are part of the drive train.
  - **9.5.3** The torsional natural frequencies of the complete train shall be at least 10 % above or 10 % below any possible excitation frequency within the specified operating speed range, from minimum governor speed to maximum continuous speed.
  - **9.5.4** Torsional natural frequencies at two or more times running speeds shall be avoided or, in systems in which corresponding excitation frequencies occur, shall be shown to have no adverse effect.
  - **9.5.5** When torsional resonances are calculated to fall within the margin specified in 9.5.3 (and the purchaser and vendor have agreed that all efforts to remove the critical from within the limiting frequency range have been exhausted), a stress analysis shall be performed to demonstrate that the resonances have no adverse effect on the complete train. The assumptions made in this analysis regarding the magnitude of excitation and the degree of damping shall be clearly stated. The acceptance criteria for this analysis shall be mutually agreed upon by the purchaser and vendor.
  - **9.5.6** In addition to the torsional analysis required in 9.5.2 and 9.5.5, the vendor shall perform a transient torsional vibration analysis when synchronous motor or generator drives are part of the train. The acceptance criteria for this analysis shall be mutually agreed upon by the purchaser and vendor.

#### Vibration and balancing

- Major parts of the rotating element, such as the shaft, balancing drum, and discs, shall be individually dynamically balanced before assembly to ISO 1940 Grade G1 or better. When a bare shaft with a single keyway is dynamically balanced, the keyway shall be filled with a fully crowned half key in accordance with ISO 8821. Keyways 180° apart, but not in the same transverse plane, shall be filled. The initial balance correction to the bare shaft shall be recorded. The components to be mounted on the shaft (balance drum, disc. etc.) shall be balanced in accordance with the "half-key-convention" as described in ISO 8821.
  - The rotating element shall be multiplane dynamically balanced during assembly. This shall be accomplished after the addition of no more than two major components, except on integral disc rotating elements. Balancing correction shall only be applied to the elements added. Minor correction of other components may be required during the final trim balancing of the completely assembled element. In the sequential balancing process, any half-keys used in the balancing of the bare shaft (see 9.6.1) shall continue to be used until they are replaced with the final key and mating element. On rotors with single keyways, the keyway shall be filled with a fully crowned half-key. The mass of all half-keys used during final balancing of the assembled element shall be recorded on the residual unbalance work sheet (see Annex C). The maximum allowable residual unbalance per plane (journal) shall be calculated as follows:

In SI units:

$$U_{\text{max}} = \frac{6350 \times m}{n} \tag{6}$$

In USC units:

$$U_{\text{max}} = \frac{4 \times m}{n}$$

where

is the residual unbalance in gram-millimetres (ounce-inches);

is the journal static mass, in kilograms (pounds); m

is the maximum continuous speed, in revolutions per minute.

- If specified, completely assembled rotating elements shall be subject to high-speed (at rated speed) balancing in lieu of a sequential low speed balancing (see 9.6.2). When the vendor's standard balancing method is by high-speed balancing in lieu of a sequential low-speed balancing and high-speed balancing is not specified, it may be used with the purchaser's approval. The high-speed balance shall be in accordance with 9.6.4.
  - When the complete rotating element has been specified to be high-speed balanced (9.6.3), the rotor shall be supported in bearings of the same type and with similar dynamic characteristics as those in which it will be supported in service. The final check balance shall be performed at maximum continuous speed. Before making any corrections (unless it is necessary to improve the initial balance in order to be able to run the rotor at high speed), the rotor shall be run in the balancing machine at trip speed for at least 5 min to allow seating of any shrunk-on components.
  - Unless otherwise specified, the vibration acceptance criteria for high-speed balancing, with maximum pedestal stiffness at all speeds, as measured on the bearing cap, shall be as follows:
  - for speeds above 3 000 r/min, it shall not exceed the "greater" of 7 400/n mm/s (291/n in/s) or 1 mm/s (0,039 in/s), where n is the speed, in revolutions per minute;
  - for speeds at or less than 3 000 r/min, it shall not exceed 2,5 mm/s (0,098 in/s).

- 9.6.6 A rotor that is to be high-speed balanced shall, if specified, first receive a sequential low-speed balance as specified in 9.6.2.
- 9.6.7 For a rotor that has been low-speed balanced (see 9.6.2), and if specified for rotors that are high—speed balanced (see 9.6.3), a low-speed residual unbalance check shall be performed in a low-speed balance machine in accordance with Annex C and recorded on the residual unbalance work sheet.

NOTE This procedure provides a reference of residual unbalance and phase for future use in a low-speed balance machine.

**9.6.8** During the shop test of the machine, assembled with the balanced rotor, operating at its maximum continuous speed or at any other speed within the specified operating speed range, the peak-to-peak amplitude of unfiltered vibration in any plane, measured on the shaft adjacent and relative to each radial bearing, shall not exceed the following value or 25 µm (1,0 mil), whichever is less.

In SI units:

$$A = 25.4 \times \sqrt{\frac{12\,000}{n}} \tag{7}$$

In USC units:

$$A = \sqrt{\frac{12\ 000}{n}}$$

where

- A is the amplitude of unfiltered vibration, measured in  $\mu$ m (mil) peak to peak;
- *n* is the maximum continuous speed, measured in revolutions per minute.

At any speed greater than the maximum continuous speed, up to and including the trip speed of the driver, the vibration shall not exceed 150 % of the maximum value recorded at the maximum continuous speed.

IMPORTANT — Do not confuse these limits with the limits specified in 9.3 for shop verification of unbalanced response.

- **9.6.9** Electrical and mechanical runout shall be determined by rotating the rotor throughout the full 360° supported in V-blocks at the journal centres while measuring runout with a noncontacting vibration probe and a dial indicator at the centreline of each probe location and one probe-tip diameter to either side.
- **9.6.10** Accurate records of electrical and mechanical runout, for the full 360° at each probe location, shall be included in the mechanical test report.

#### 10 Bearings, bearing housings, and seals

#### 10.1 Radial bearings

**10.1.1** Hydrodynamic radial bearings shall be provided. They shall be split for ease of assembly, precision bored, and sleeved or padded, with steel-backed, babbitted replaceable liners, pads or shells. These bearings shall be equipped with antirotation pins and shall be positively secured in the axial direction. The liners, pads or shells shall be in axially split housings and shall be replaceable without the removal of the top half of the casing of an axially split machine or the head of a radially split unit and without the removal of the coupling hub.

10.1.2 Radial bearing design shall be such that load transfer to the bearing housing by the bearing shall not cause damage to critical bearing housing surfaces which are not considered normal wearing surfaces subject to repair or replacement.

#### 10.2 Thrust bearings and collars

- 10.2.1 Thrust bearings shall be hydrodynamic and steel-backed, with babbitted multiple segments, designed for equal thrust capacity in both directions, and arranged for continuous pressurized lubrication to each side. Tilting pads shall be used on both sides and shall incorporate a self-levelling feature ensuring that each pad carries an equal share of the thrust load with minor variations in pad thickness.
- 10.2.2 Thrust bearings shall be sized for continuous operation under the most adverse specified operating conditions. Calculation of the thrust load shall include, but shall not be limited to, the following factors:
- fouling and variation in seal clearances up to twice the design internal clearances; a)
- step thrust from all diameter changes; b)
- stage reaction and stage differential pressure; c)
- variations in inlet, extraction, induction, and exhaust pressure; d)
- external loads from the driven equipment in accordance with 10.2.3 and 10.2.4.
- 10.2.3 External loads transmitted through flexible-element couplings shall be calculated on the basis of the maximum allowable deflection permitted by the coupling manufacturer.
- 10.2.4 If two or more rotor thrust forces are to be carried by one thrust bearing, the resultant of the forces shall be used, provided the directions of the forces make them numerically additive; otherwise, the largest of the forces shall be used.
- 10.2.5 Thrust bearings shall be selected at no more than 50 % of the bearing manufacturer's ultimate load rating. The ultimate load rating is the load that produces the minimum acceptable oil-film thickness without inducing failure during continuous service or the load that does not exceed the creep-initiation or yield strength of the babbitt at the maximum temperature location on the pad, whichever load is less. In sizing thrust bearings, consideration shall be given to, but shall not be limited to, the following for each specific application:
- the shaft speed; a)
- the temperature of the bearing babbitt; b)
- the deflection of the bearing pad;
- the minimum oil-film thickness; d)
- the feed rate, viscosity and supply temperature of the oil; e)
- the design configuration of the bearing;
- the babbitt alloy; q)
- the pad material;
- the turbulence of the oil film.

The basis for sizing of thrust bearings shall be made available for review by the purchaser.

10.2.6 Thrust bearings shall be arranged to allow axial positioning of each rotor relative to the casing and setting of the bearings' clearance.

- **10.2.7** Unless otherwise specified, integral thrust collars shall be furnished. They shall be provided with at least 3 mm (1/8 in) of additional stock on total thickness to enable refinishing if the collar is damaged. When replaceable collars are furnished, they shall be shrunk on, and positively locked to, the shaft to prevent fretting.
- **10.2.8** Both faces of thrust collars shall be finished to a surface roughness not exceeding 0,8  $\mu$ m (32  $\mu$ in) Ra. The axial total indicated runout of either face shall not exceed 13  $\mu$ m (0,000 5 in).

## 10.3 Bearing housing

- **10.3.1** Bearing housings for pressure-lubricated hydrodynamic bearings shall be arranged to minimize foaming. The drain system shall be adequate to maintain the oil and foam level below shaft end seals. The rise in oil temperature through the bearing and housings shall not exceed 30 °C (50 °F) under the most adverse specified operating conditions. The bearing outlet oil temperature shall not exceed 80 °C (180 °F). When the inlet oil temperature exceeds 50 °C (120 °F), special consideration shall be given to bearing design, oil flow, and allowable temperature rise. Oil outlets from flooded thrust bearings shall be tangential and in the upper half of the control ring or, if control rings are not used, in the thrust-bearing cartridge.
- **10.3.2** Bearing housings shall be equipped with replaceable labyrinth end seals and deflectors where the shaft passes through the housing; lip-type end seals shall not be used. The seals and deflectors shall be made of non-sparking materials. The design of the seals and deflectors shall effectively retain oil in the housing and prevent entry of foreign material into the housing.
- 10.3.3 Cantilevered shaft support structures bolted to steel casings shall be steel.
- 10.3.4 Cast iron bearing housings or bearing housing supports shall not be used.
- **10.3.5** Provision shall be made for mounting two non-contacting radial-vibration probes in each bearing housing, two axial-position probes at the thrust end of each machine, and a one-event-per-revolution probe in each machine. The probe installation shall be as specified in API Std 670.
- 10.3.6 When specified, provisions for mounting accelerometers on the bearing housings shall be made in accordance with API Std 670.

## 10.4 Grounding

Unless otherwise specified, condensing turbines shall be provided with at least two grounding brushes on the same end of the shaft. Unless otherwise specified, the arrangement of the brushes shall be designed to enable the brushes to be replaced with the turbine in operation. The brushes shall be a standard size and grade suitable for the service. The vendor shall include drawings with the proposal showing the number and location of the brushes.

#### 10.5 Shaft seals

- 10.5.1 Unless otherwise specified, casing end seals shall be replaceable labyrinth seals.
- 10.5.2 Interstage sealing shall be by replaceable labyrinths.
- **10.5.3** Labyrinth casing end seals operating at less than atmospheric pressure shall be designed for admission of dry steam to seal against air ingress. Piping with pressure gauges, regulators and other necessary valves shall be provided to interconnect the end labyrinth seals. The piping shall have one common connection to the purchaser's sealing steam supply. The admission and the pressure of the sealing steam shall be automatically controlled. The normal operating sealing steam supply should preferably come from a positive pressure section of the turbine.
- **10.5.4** Unless otherwise specified, a separate vacuum system shall be furnished to reduce external leakage from the end labyrinth seals and possible contamination of the bearing oil (15.6). Unless otherwise specified, the system shall be supplied loose for mounting and connection by others. Annex G shows a typical labyrinth end seal vacuum system.

10.5.5 All piping and components of the shaft seal and vacuum systems shall be sized for not less than 300 % of the calculated new clearance leakage.

#### 11 Materials

#### 11.1 General

- 11.1.1 Except as required or not permitted by this International Standard or by the purchaser, materials of construction shall be selected by the manufacturer for the specified operating and site environmental conditions (11.1.6).
- **11.1.2** The materials of construction of all major components shall be clearly stated in the vendor's proposal. Materials shall be identified by reference to applicable international standards, including the material grade. If no such designation is available, the vendor's material specification, giving physical properties, chemical composition and test requirements shall be included in the proposal.
- 11.1.3 The vendor shall specify the optional tests and inspection procedures that may be necessary to ensure that materials are satisfactory for the service. Such tests and inspections shall be listed in the proposal.

The purchaser may specify additional optional tests and inspections, especially for materials used for critical components or in critical services.

- 11.1.4 External parts that are subject to rotary or sliding motions (such as control linkage joints and adjusting mechanisms) shall be of corrosion-resistant materials suitable for the site environment.
- 11.1.5 Minor parts that are not identified (such as nuts, springs, washers, gaskets and keys) shall have corrosion resistance at least equal to that of parts identified in accordance with 11.1.2 in the same environment.
- 11.1.6 The purchaser shall specify any corrosive agents exceeding IEC 60045-1 or NEMA SM 23 steam quality requirements present in the steam and in the environment, including constituents that may cause stress corrosion cracking.

The vendor should recognize that some steam systems include contaminants such as sodium hydroxide, chlorides, sulfates, phosphates, copper and lead, and should consider these when selecting materials.

- 11.1.7 If austenitic stainless steel parts exposed to conditions that may promote intergranular corrosion are to be fabricated, hard faced, overlaid or repaired by welding, they shall be made of low-carbon or stabilized grades.
- NOTE Overlays or hard surfaces that contain more than 0,10 % carbon can sensitize both low-carbon and stabilized grades of austenitic stainless steel unless a buffer layer that is not sensitive to intergranular corrosion is applied.
- 11.1.8 Where mating parts such as studs and nuts of austenitic stainless steel or materials with similar galling tendencies are used, they shall be lubricated with an anti-seizure compound of the appropriate temperature specification and compatible with steam.
- Torque loading values differ considerably with and without an anti-seizure compound. NOTE
- 11.1.9 If the purchaser has specified the presence of hydrogen sulfide in any fluid, materials exposed to that fluid shall be selected in accordance with the requirements of NACE MR0175. Ferrous materials not covered by NACE MR0175 shall not have a yield strength exceeding 620 N/mm<sup>2</sup> (90 000 psi) or a hardness exceeding Rockwell C 22. Components that are fabricated by welding shall be postweld heat treated, if required, so that both the welds and the heat-affected zones meet the yield strength and hardness requirements.

In many applications, small amounts of wet H<sub>2</sub>S are sufficient to require materials resistant to sulfide stress corrosion cracking. When there are trace quantities of wet H<sub>2</sub>S known to be present or if there is any uncertainty about the amount of wet H<sub>2</sub>S that may be present, the purchaser should automatically note on the data sheets that materials resistant to sulfide stress corrosion cracking are required.

- NOTE It is the responsibility of the purchaser to determine the amount of wet H<sub>2</sub>S that may be present, considering normal operation, startup, shutdown, idle standby, upsets or unusual operating conditions such as catalyst regeneration.
- **11.1.10** Unless otherwise specified, the vendor shall list in the proposal all steam path components (valves, seats, blades, shrouds, closing pieces, pins, damping wires, wheels, bolting, and so forth) with a hardness of more than Rockwell C 22. The vendor shall also indicate the hardness range of each component.
- **11.1.11** Pressure-containing parts subject to steam conditions exceeding gauge pressures of 520 kPa (5,2 bar) (75 psi) or temperatures of 230 °C (450 °F) shall be steel. In the case of the exhaust casing of non-condensing turbines, this shall be based on the maximum specified exhaust pressure and the maximum no-load exhaust temperature. Alloy steels shall be used for maximum steam temperatures exceeding 410 °C (775 °F).
- **11.1.12** The material limits for pressure bolting based upon the actual bolting temperature shall be as specified in ISO 15649. Nuts shall conform to ASTM A 194, Grade 2H (or ASTM A 307, Grade B, case-hardened, where space is limited) or better material.
- NOTE For the purpose of this provision, ASME B31.3 is equivalent to ISO 15649.
- **11.1.13** Material for turbine wheels and shafts shall be forged steel. Unless otherwise approved, 11 % to 13 % chromium steel, titanium, or nickel-copper alloy (similar to ASTM B 127) shall be used for nozzles, closing pieces, rotating and stationary blading, shrouding and steam strainers.
- **11.1.14** Bearing surfaces (journals and thrust faces) shall be of a material containing less than 2,5 % Cr, to prevent the risk of wire wool type bearing failures.
- **11.1.15** Low-carbon steels can be notch-sensitive and susceptible to brittle fracture at ambient or lower temperatures. Therefore, only fully killed, normalized steels made to fine-grain practice shall be used. Steel made to a coarse grain size practice (such as ASTM A 515) shall not be used.
- The purchaser shall specify the minimum design metal temperature used to establish impact test and other material requirements.

## 11.2 Castings

- **11.2.1** Castings shall be sound and free from porosity, hot tears, shrink holes, blow holes, cracks, scale, blisters and similar injurious defects. Surfaces of castings shall be cleaned by sandblasting, shotblasting, chemical cleaning or any other standard method. Mold-parting fins and remains of gates and risers shall be chipped, filed or ground flush.
- **11.2.2** The use of chaplets in pressure castings shall be held to a minimum. Where chaplets are necessary, they shall be clean and corrosion-free (plating is permitted) and of a composition compatible with the casting.
- **11.2.3** If repairs to castings are necessary, pressure-containing ferrous castings shall not be repaired except as follows.
- a) Weldable grades of castings shall be repaired by welding, using a qualified welding procedure (including pre- or post-weld heat treatment or both, when necessary) as specified in Table 3. After major weld repairs, and before hydrostatic testing, the complete casting shall be given a postweld heat treatment to ensure stress relief and continuity of mechanical properties of both weld and parent metal and dimensional stability during subsequent machining.
- b) Cast iron may be repaired by plugging within the limits specified in ASTM A 278, ASTM A 395 or ASTM A 536. The holes drilled for plugs shall be carefully examined, using liquid penetrant, to ensure that all defective material has been removed.
- c) All repairs that are not covered by the material specifications shall be subject to the purchaser's approval. All major repairs, as defined by the material specifications, shall be recorded (on a drawing, if appropriate) and reported [see 16.2.1.1 g)] as part of the vendor's documentation (11.3.2).

- **11.2.4** Fully enclosed cored voids, which become fully enclosed by methods such as plugging, welding, or assembly, are prohibited.
- **11.2.5** Nodular iron castings shall be produced in accordance with an internationally recognized standard such as ASTM A 395. The production of the castings shall also conform to the conditions specified in a) to e), as follows.
- a) The keel or Y-block cast at the end of the pour shall be at least as thick as the thickest section of the main casting. This test block shall be tested for tensile strength and hardness and shall be microscopically examined. Classification of graphite nodules under microscopic examination shall be in accordance with ASTM A 247.
- b) If critical sections of a casting have different thicknesses, average size keel or Y blocks may be selected in accordance with ASTM A 395. Minimum quality levels should be agreed upon between the purchaser and the vendor. Critical sections are typically heavy sections, section changes and high-stress points. Normally, bosses and similar sections are not considered critical sections of a casting.
- c) A minimum of one set (three samples) of Charpy V-notch impact specimens at one-third the thickness of the test block shall be made from the material adjacent to the tensile specimen on each keel or Y-block. These specimens shall have a minimum impact value of 12 J (9 ft-lbf) and the mean of the three specimens shall not be less than 14 J (10 ft-lbf) at room temperature.
- d) Integrally cast test bosses, preferably at least 25 mm (1 in) in height and diameter, shall be provided at critical areas of the casting for subsequent removal for the purposes of hardness testing and microscopic examination. Critical areas are typically heavy sections, section changes, flanges and other high-stress points as agreed upon by the purchaser and the vendor. Classification of graphite nodules shall be in accordance with ASTM A 247.
- e) An "as-cast" sample from each ladle shall be chemically analysed.
- f) Brinell hardness tests shall be made on the actual casting at feasible critical sections such as section changes, flanges, and other accessible locations. Sufficient surface material shall be removed before hardness tests are made to eliminate any skin effect. Tests shall also be made at the extremities of the casting at locations that represent the sections poured first and last. These shall be made in addition to Brinell readings on the keel or Y-blocks in accordance with a) above.

## 11.3 Welding

**11.3.1** Welding and weld repairs shall be performed by operators, and in accordance with procedures, qualified to the requirements of Table 3. Alternative standards may be proposed by the vendor for the purchasers approval. The datasheets in Annex A may be used for this purpose.

Table 3 — Welding requirements

Requirement	Applicable code or standard
Welder/operator qualification	ASME IX or EN 287
Welding procedure qualification	Applicable material specification or, where weld procedures are not covered by the material specification, ASME IX or EN 288
Non-pressure-retaining structural welding such as baseplates or supports	AWS D1.1
Magnetic particle or liquid penetrant examination of the plate edges	ASME VIII, Division 1, UG-93(d)(3)
Post-weld heat-treatment	Applicable material specification or ASME VIII, Division 1, UW 40
Post-weld heat-treatment of casing fabrication welds	Applicable material specification or ASME VIII, Division I

- **11.3.2** The vendor shall be responsible for the review of all repairs and repair welds to ensure that they are properly heat treated and nondestructively examined for soundness and compliance with the applicable qualified procedures. Repair welds shall be nondestructively tested by the same method used to detect the original flaw. As a minimum, the inspection shall be by the magnetic particle method for magnetic material, and by the liquid penetrant method for non-magnetic materials, in accordance with 16.2.2. Unless otherwise specified, procedures for major repairs shall be subject to review by the purchaser before any repair is made [see 11.2.3 c)]
- **11.3.3** Pressure-containing casings made of wrought materials or combinations of wrought and cast materials shall conform to the conditions specified in a) to d), as follows.
- Plate edges shall be inspected by magnetic particle or liquid penetrant examination as specified in 11.3.1.
- b) Accessible surfaces of welds shall be inspected by magnetic particle or liquid penetrant examination after back chipping or gouging and again after post-weld heat treatment.
- If specified, the quality control of welds that are inaccessible on completion of the fabrication shall be agreed on by the purchaser and vendor prior to fabrication.
  - c) Pressure-containing welds, including welds of the casing to axial- and radial-joint flanges, shall be full-penetration welds.
  - d) Fabricated casings (regardless of thickness) shall be post-weld heat treated.
  - 11.3.4 Connections welded to pressure casings shall be installed as specified in a) to d), as follows.
  - a) In addition to the requirements of 11.3.1, the purchaser may specify that 100 % radiography, magnetic particle inspection or liquid penetrant inspection of welds is required.
  - b) Auxiliary piping welded to chromium-molybdenum alloy steel or 12 % chromium steel components shall be of the same material, except that chromium-molybdenum alloy steel pipe may be substituted for 12 % chromium steel pipe.
  - c) If heat treatment is required, piping welds shall be made before the component is heat treated.
  - d) All welds shall be heat treated as specified in Table 3.

## 12 Controls and instrumentation

## 12.1 General

The wiring and installation of instrumentation control and electrical systems shall conform to the purchaser's specifications and, unless otherwise specified, shall conform to the requirements of ISO 10438 and API Std 670.

NOTE For the purpose of this provision, API 614 is equivalent to ISO 10438.

## 12.2 Turbine governing system


**12.2.1** The governing system is the primary system necessary to match the turbine output to the application. The governing system includes the speed governor, control mechanism and governor-controlled valve(s). The turbine vendor shall have unit responsibility for the entire governing system. For generator drive applications, the requirements shall be as agreed by the purchaser and the turbine vendor.

NOTE The relationship between the various turbine speeds is illustrated in Figure 4.

12.2.2 Unless otherwise specified, the primary function of the governing system shall be to maintain the turbine speed at a set value by regulating the steam flow through the turbine.

NOTE Speed control may not be required when the turbine is to be used in tandem with a main driver and the main driver controls the speed of the complete train.

12.2.3 A dedicated digital microprocessor-based governor unit shall be furnished. This unit shall be separate and independent of any overall system such as a distributed control system (DCS) and shall be provided with electrical power by a purchaser-supplied uninterruptible power source.

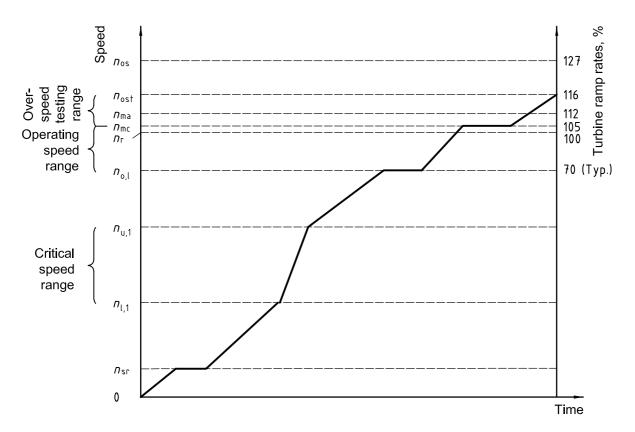

Key			
$n_{Sr}$	slow roll speed	$n_{\sf mc}$	maximum continuous speed
$n_{I,1}$	minimum critical speed	$n_{\sf ma}$	maximum allowable speed rise
$n_{u,1}$	maximum critical speed	$n_{\sf ost}$	overspeed trip speed = 116 % $n_{\rm r}$
$n_{O,I}$	minimum operating speed	$n_{OS}$	maximum temporary overshoot speed = 127 % $n_{\rm f}$

Figure 4 — Turbine ramp speeds

12.2.4 Unless otherwise specified, the governing system shall comply with the requirements of a) to c), as follows.

The speed regulation at rated speed and rated steam inlet and exhaust conditions shall not exceed 0,5 %. Speed regulation is defined as:

$$\frac{n_{P0}-n_{PR}}{n_{PR}}\times 100\%$$

rated operating speed

 $n_{\mathsf{r}}$ 

#### where

 $n_{P0}$  is the speed at zero power;

 $n_{PR}$  is the speed at rated power.

b) The steady state speed variation at rated speed, rated power and rated steam inlet and exhaust conditions, shall not exceed 0,25 %. Speed variation is defined as:

$$\frac{n_{i,\text{max}} - n_{i,\text{min}}}{2 \times n_{f}} \times 100 \%$$

#### where

 $n_{i,max}$  is the maximum instantaneous speed;

 $n_{i,min}$  is the minimum instantaneous speed;

 $n_{\rm r}$  is the rated speed;

- c) The maximum speed rise shall not exceed 7 % of the maximum continuous speed. The maximum speed rise is the maximum momentary increase in speed when the turbine is developing rated power at maximum continuous speed and rated steam inlet and exhaust conditions, and the load is suddenly and completely reduced to zero.
- **12.2.5** A multi-toothed surface for speed sensing shall be provided in accordance with 8.4. This surface may be shared by the speed governor, overspeed shutdown system, and tachometer.
- **12.2.6** The speed governing system shall include at least two speed sensors dedicated for speed control. The speed sensors are not to be shared with the overspeed shutdown system. The speed governor shall discriminate between the signals from the speed-sensing elements by high signal selection. The failure of any one speed-sensing element shall initiate an alarm only. The failure of all elements shall initiate a shutdown.
- **12.2.7** The design of the speed governor shall include but not be limited to the following:
- a) an assignable speed range corresponding to the normal range of operation (typically 70 % to 105 % of rated operating speed);
- b) speed setpoint adjustment;
- c) remote or process controlled speed setpoint adjustment;
- d) digital speed indication;
- e) individual outputs to each control mechanism actuator;
- f) adjustable speed ramp rate;
- g) slow roll control;
- h) critical speed band avoidance;
- i) manually activated override for testing the overspeed shutdown system;
- j) settings which are field changeable and protected through controlled access.

- **12.2.8** The speed of the turbine shall vary linearly with the setpoint signal. An increase in setpoint signal shall increase turbine speed.
- **12.2.9** The governing system shall provide for both slow roll (typically 400 r/min to 500 r/min) and startup using the governor-controlled valves.
- **12.2.10** Failure of the governing system shall initiate a turbine shutdown.
- **12.2.11** Activation of any shutdown device shall cause the governor-controlled valve(s) and the trip valve(s)/combined trip and throttle valve(s) to close and initiate a signal to close non-return valve(s).
- **12.2.12** The shutdown system shall prevent opening of the trip valve(s) if the governor-controlled valve(s) are not fully closed.
- 12.2.13 Additional modes of control, such as single controlled extraction/induction, shall be as specified by the purchaser.
  - **12.2.14** The level of redundancy and fault tolerance shall be as required to meet the five-year uninterrupted service expectation (see 6.1.1).

#### 12.3 Overspeed shutdown system

#### 12.3.1 General

- **12.3.1.1** A dedicated overspeed shutdown system capable of independently shutting down the turbine shall be provided. This system shall not be dependent on the governing system or any other system. The system shall prevent the turbine rotor speed from exceeding 127 % of the rated speed on an instantaneous, complete loss of coupled inertia and load while operating at the rated conditions. In the event of loss of load without loss of coupled inertia, and unless otherwise specified by the driven equipment vendor, the system shall prevent the speed from exceeding 120 % of rated speed. The turbine vendor shall have unit responsibility for the overspeed shutdown system.
- **12.3.1.2** The overspeed shutdown system shall include, but not be limited to, the following:
- a) electronic overspeed detection system (speed sensors and logic devices);
- b) electro-hydraulic solenoid valves;
- c) emergency trip valve(s)/combined trip and throttle valve(s).
- 12.3.1.3 If specified, a turbine with an exhaust pressure less than atmospheric pressure shall be provided
  with an exhaust vacuum breaker actuated by the shutdown system. Details of such a system shall be agreed
  by the purchaser and the turbine vendor.
  - NOTE Even when the emergency trip valve is closed, a turbine exhausting to sub-atmospheric pressure can leak enough steam to prevent the turbine and driven equipment from coming to a complete stop. A vacuum breaker admits air to the exhaust casing, increases exhaust pressure and reduces coast-down time. For turbines exhausting to a common condensing system, air admission may not be feasible and a more positive-emergency trip valve(s) or other provisions may be required.
  - **12.3.1.4** On controlled extraction turbines, the vendor shall supply a non-return valve, equipped with a spring-loaded hydraulic or pneumatic actuated cylinder to assist in closing the valve, on each extraction line. The hydraulic or pneumatic cylinder on these valves shall be actuated by the shutdown system. The manufacturer, model, quantity and location of the device(s) shall be agreed by the purchaser and the turbine vendor.

Non-return valve(s) should not be installed in a vertical line with downward flow.

- NOTE 1 Non-return valves are normally mounted directly to steam turbine extraction connections or as close as possible to the turbine to avoid trapping large volumes of steam, which can keep the turbine operating when extraction valves do not fully close.
- NOTE 2 Location of non-return valves in piping below the turbine requires that low-point drain provisions be furnished to eliminate water from the extraction line before startup and to eliminate the accumulation of water during operation with no extraction flow.
- NOTE 3 Location of hydraulically actuated non-return valves in piping below oil console level can result in drainage problems. Alternative actuation methods may be required.
- **12.3.1.5** On turbines with uncontrolled extractions, two non-return valves in series shall be provided on each extraction.

## 12.3.2 Electronic overspeed detection system

- **12.3.2.1** An overspeed detection system based on three independent measuring circuits and two-out-of-three voting logic in accordance with API Std 670 shall be supplied.
- **12.3.2.2** A multi-toothed surface for speed sensing shall be provided in accordance with 8.4. This surface may be shared by the speed governor, overspeed shutdown system and tachometer.

## 12.3.3 Electro-hydraulic solenoid valves

- **12.3.3.1** The turbine shall be provided with a minimum of two, separate electro-hydraulic solenoid-operated valves located in the shutdown system.
- **12.3.3.2** Solenoid valves shall be continuously rated with Class F insulation or better, in accordance with IEC 60072.
- **12.3.3.3** Unless otherwise specified, solenoid valves shall be de-energized to shutdown. The solenoid valves shall be in series, be close to the trip valve(s) or trip and throttle valve(s), and have no other device between them and the trip valve(s) or trip and throttle valve(s) except test isolation valves.

Test isolation valves, where used, should be locked in the open position for normal operation.

- **12.3.3.4** If energize to shutdown is specified, the solenoid valves shall be in parallel and the solenoids and relays shall have a detection system to alarm on failure of the coil.
- **12.3.3.5** The solenoid valves and any required interposing relays shall be capable of on-line testing without defeating trip protection.

Solenoids can draw significantly high currents. Interposing relays may be used when the current requirements of the solenoids exceed the current rating of the relay in the overspeed shutdown system.

**12.3.3.6** De-energizing of solenoid valves shall be initiated by the electronic overspeed detection system or the operation of other shutdown systems (see 12.4).

## 12.3.4 Trip valves/combined trip and throttle valves

- 12.3.4.1 A separate independent trip valve(s) or combined trip and throttle valve(s), as specified, shall be
  provided for each steam inlet. In the remainder of this clause, the term trip valve refers to both separate trip
  valves and combined trip and throttle valves.
  - NOTE Trip valve(s) operate in the shut (tripped) or fully open positions only. In addition to the functions provided by trip valve(s), combined trip and throttle valve(s) provide intermediate valve positioning for use during startup or during abnormal conditions.

12.3.4.2 If specified, duplicate trip valves shall be provided, arranged in parallel. Each trip valve shall be sized to pass the full steam flow.

In normal operation, one valve shall be closed. The purpose of the second valve is to enable the normally open valve to be completely tested with the turbine on line.

Failure of trip valves to close when required is a common cause of turbine failure. It is recommended that trip valves should be fully tested at regular intervals. Where the turbine cannot be conveniently taken out of service for this purpose consideration should be given to installing two trip valves.

Where duplicate trip valves are provided, the steam piping shall be designed to allow for the thermal expansion and entrapped energy effects resulting from steam flow through either or both valves.

The trip valve(s) shall be designed to be closed by the action of a spring. Unless otherwise specified, the valve(s) shall be held open by direct hydraulic means. Any shutdown signal shall cause the valve(s) to close.

NOTE The use of fully hydraulic operated trip valves allows higher spring closing forces and avoids friction associated with mechanical latches.

- The design of trip valve(s) shall include, but not be limited to, the following features: 12.3.4.4
- corrosion-resistant material on the stem and seating surfaces;
- prevention of steam contaminate deposits on the valve stem which inhibit closure; b)
- spring loading and steam flow and pressure to assist closure; C)
- above and below seat drain connections, as required by the body style and mounting position, and valve stem leak-off connections;
- reset and start-up capability with maximum differential pressure across the valve; e)
- partial stroking capability which does not interrupt operation of the turbine when redundant valves are not f) specified; the arrangement shall prevent full closure during an exercise test but shall permit the valve to fully close if a shutdown condition occurs;
- replacement of wearing parts with the valve in place;
- corrosion-resistant steam strainer;
- valve disk designed to prevent the rotation of the valve disk on seat; i)
- valve stem, stem bushing, main valve disk, and all sliding surfaces shall have hardened contact surfaces. j)

Consideration should be given to the use of a back-seated valve stem to minimize leakage and fouling.

- 12.3.4.5 The trip valve steam strainer shall be designed to prevent in-service failure. The strainer shall be removable without dismantling any of the inlet steam piping. The effective free area of the strainer shall be at least twice the cross-sectional area of the valve inlet connection. The steam strainer shall be capable of withstanding a pressure differential at least equal to 25 % of the inlet pressure.
- The trip valve shall not depend on steam flow assistance to meet the required closure time. The closure time of the valve shall be verified during the mechanical running test.
- The time from the overspeed condition to full closure of the trip valve shall not exceed the time calculated by the turbine vendor to meet the requirements of 12.3.1.1. The calculation methodology shall be in accordance with ASME PTC 20.2.

## 12.4 Other alarms and shutdowns

<b>12.4.1</b> An alarm/shutdown sy	stem shall be	provided in accordance	with ISO	10438.
------------------------------------	---------------	------------------------	----------	--------

NOTE For the purpose of this provision, API 614 is equivalent to ISO 10438.

- 12.4.2 The turbine vendor shall advise the purchaser of any alarms and/or shutdowns considered essential
- е

	to s		uard the turbine.
•			The purchaser shall specify the alarms and shutdowns required. As a minimum, to safeguard the these should include the following.
	a)	Ala	rms:
		_	overspeed shutdown system fault;
			failure of any one governor speed sensor;
			low lube oil pressure;
			high exhaust pressure;
			high radial vibration;
			axial displacement;
		_	high bearing temperature;
			low control oil pressure;
			low/high extraction pressure;
			low steam inlet temperature;
			high exhaust temperature (condensing turbines).
1	b)	Shu	utdowns:
1		_	overspeed (see 12.3);
1			failure of all governor speed sensors;
			very low lube oil pressure;
			very high radial vibration;
			high axial displacement;
			very high bearing temperature.

- 12.4.4 In addition to the shutdowns listed above, a manual trip shall be provided local to the turbine to allow an operator to trip the unit.
- 12.4.5 The purchaser shall specify the extent to which the alarm/shutdown system is to be supplied by the turbine vendor.
  - NOTE This can conveniently be achieved by the use of a responsibility matrix.

- 12.4.6 The vendor shall furnish with the proposal a complete description of the alarm and shutdown facilities to be provided.
- 12.4.7 Unless otherwise specified, the alarm/shutdown system shall comply with the requirements of ISO 10438 and a) to c) as follows.
- For the purpose of this provision, API 614 is equivalent to ISO 10438. NOTE 1
- NOTE 2 It is accepted that with some systems, particularly those based on conventional, direct-acting instruments, complete compliance with the requirements of a) to c) as follows may not be possible.
- Examples of alarm/shutdown system arrangements generally considered acceptable are given in Annex D. NOTE 3
- When any component of the alarm/shutdown system malfunctions, an alarm shall be initiated which shall be distinguishable from alarms associated with an equipment parameter reaching the alarm or shutdown point.
  - NOTE Redundant sensors could be required to accomplish this.
- b) When any malfunction of a component of the shutdown system results in the system being unable to recognize a shutdown condition, the turbine shall be caused to shutdown (a fail safe system).
- c) Following a malfunction of the alarm/shutdown system that results in the system being unable to recognize an alarm condition, all other alarms and all shutdowns shall remain functional.
- 12.4.8 If specified, the alarm/shutdown system shall incorporate an event recorder to record the order of occurrence of alarms and shutdowns.
  - NOTE The special-event recorder normally associated with a DCS may not have a sufficiently fast scanning rate.
  - **12.4.9** Where alarm or shutdown functions or both are initiated by locally mounted switches, such switches shall comply with a) to c) as follows.
- The purchaser shall specify whether switches shall be connected to open (de-energize) or close (energize) to initiate alarms.
- Temperatures shall be measured by thermocouples or resistance temperature detectors, as specified, b) which shall be connected to local panel-mounted instruments. Multipoint instruments may be used, except that alarms and shutdowns shall be connected to separate instruments and separate alarm or shutdown contacts (switches) shall be provided for each temperature monitored and each alarm and shutdown level shall be separately adjustable.
- Vibration, axial position and/or bearing temperature switches shall be provided by instruments complying with the requirements of API Std 670.

#### 12.5 Instrument and control panels

- 12.5.1 Unless otherwise specified, instrument and control panels shall conform to ISO 10438.
- NOTE For the purpose of this provision, API 614 is equivalent to ISO 10438.
- **12.5.2** Unless otherwise specified, panels shall be made of steel plate at least 3 mm thick, reinforced, self-supporting and closed on the top and sides. If specified, the backs of panels shall be closed to minimize electrical hazards, to prevent tampering or to allow purging for safety or corrosion prevention. All instruments shall be flush-mounted on the front of the panel and all fasteners shall be of corrosion-resisting materials.
- 12.5.3 Interconnecting piping, tubing or wiring for controls and instrumentation, furnished by the vendor, shall be disassembled only to the extent necessary for shipment.

## 12.6 Indicating instrumentation

#### 12.6.1 Tachometers

- **12.6.1.1** Unless otherwise specified, two electronic digital-speed indicators shall be furnished. The minimum tachometer range shall be from 0 % to 125 % of the maximum continuous speed. One indicator shall be locally mounted and the other shall be supplied to the purchaser for remote mounting.
- **12.6.1.2** The speed signals may be obtained from the speed sensors provided for turbine governing or from independent sensors (see 12.2.5 and 12.2.6).

## 12.6.2 Temperature gauges

- **12.6.2.1** Dial temperature gauges shall be heavy duty and corrosion resistant. They shall be at least 115 mm (4,5 in) in diameter and bimetallic or gas-filled and, unless otherwise agreed, shall have black printing on a white background.
- **12.6.2.2** Liquid-filled temperature gauges shall not be used.

#### 12.6.3 Thermowells

Thermowells shall be in accordance with ISO 10438.

NOTE For the purpose of this provision, API 614 is equivalent to ISO 10438.

#### 12.6.4 Thermocouples and resistance temperature detectors

Thermocouples and resistance temperature detectors shall be in accordance with ISO 10438.

NOTE For the purpose of this provision, API 614 is equivalent to ISO 10438.

## 12.6.5 Pressure gauges

Pressure gauges shall be in accordance with ISO 10438.

NOTE For the purpose of this provision, API 614 is equivalent to ISO 10438.

## 13 Electrical systems

Electrical systems shall conform to the purchaser's specifications and, unless otherwise specified, shall conform to the requirements of ISO 10438 and API Std 670.

NOTE For the purpose of this provision, API 614 is equivalent to ISO 10438.

## 14 Piping and appurtenances

## 14.1 General

- **14.1.1** Piping design, fabrication, examination and inspection shall be in accordance with the codes and standards specified and shall conform to the requirements of ISO 10438.
- NOTE For the purpose of this provision, API 614 is equivalent to ISO 10438.
- **14.1.2** Threaded connections shall not be seal-welded.

\_\_\_\_\_

If welding in a particular location is acceptable, the connection shall be welded and not threaded.

**14.1.3** Unless otherwise specified, pipe-flange gaskets shall be spiral-wound metal or metal-jacketed with non-hazardous filler for steam temperatures above 260 °C (500 °F) or steam gauge pressures above 2 800 kPa (28 bar) (400 psi). The manufacturer's standard gasket may be used below these limits.

## 14.2 Oil piping

Oil piping design, fabrication, examination and inspection shall be in accordance with ISO 10438.

NOTE For the purpose of this provision, API 614 is equivalent to ISO 10438.

## 14.3 Instrument piping

Instrument piping design, fabrication, examination and inspection shall be in accordance with ISO 10438.

NOTE For the purpose of this provision, API 614 is equivalent to ISO 10438.

#### 15 Accessories

## 15.1 Couplings and guards

- **15.1.1** When the turbine vendor supplies tandem drivers, the vendor shall furnish flexible coupling(s) and guard(s) between the units. Unless otherwise specified, all other couplings and guards shall be supplied by the vendor of the driven equipment.
- 15.1.2 Couplings shall conform to ISO 10441 or API Std 671. The make, type, and mounting arrangement of
  the couplings shall be as specified by the purchaser and agreed by the vendors of the driver and driven
  equipment.
  - **15.1.3** The coupling-to-shaft juncture shall be designed and manufactured to be capable of continuously transmitting torque at least equal to the coupling continuously rated torque.
  - **15.1.4** Where a coupling is to be mounted on the turbine shaft with a tapered fit, the correct machining of the taper shall be confirmed by the use of a matched plug and ring gauge, unless an alternative method of confirming the correct fit has been agreed.
  - **15.1.5** Information on shafts, keyway dimensions (if any) and shaft end movements due to end play and thermal effects shall be furnished to the supplier of the coupling.
  - **15.1.6** Coupling mass simulator(s) (or by agreement, moment simulators), in accordance with ISO 10441 or API Std 671, shall be provided to enable the turbine to be properly tested before shipment.
  - **15.1.7** Idling adapter(s) (solo plates), and bolting in accordance with ISO 10441 or API Std 671, shall be furnished, if required, to enable the turbine to be run uncoupled from the driven equipment without requiring removal of the half coupling. The idling adapter(s) shall be supplied to the purchaser as part of the special tools.
  - **15.1.8** Unless otherwise specified, the turbine coupling hub(s) shall be mounted by the turbine manufacturer.
  - 15.1.9 Coupling guards shall be designed and manufactured in accordance with Annex E.

#### 15.2 Gear units

Gear units shall conform to ISO 13691 or API Std 613.

## 15.3 Mounting plates

#### 15.3.1 General

- 15.3.1.1 The equipment shall be furnished with soleplates or a baseplate, as specified. *Mounting plate* refers to both baseplates and soleplates.
  - NOTE Typical mounting plate arrangements are shown in Annex F.
  - **15.3.1.2** Mounting plates shall be equipped with vertical levelling screws. Baseplate levelling jackscrews shall be located at each anchor bolt location.
  - **15.3.1.3** If an item of equipment supported has a mass in excess of 225 kg (500 lb), the mounting plates shall be furnished with horizontal jackscrews (axial and lateral) the same size as or larger than the equipment vertical jackscrews. The lugs holding these jackscrews shall be attached to the mounting plates in such a manner that they do not interfere with the installation or removal of the equipment jackscrews or shims. Precautions shall be taken to prevent vertical jackscrews in the equipment feet from marring the shimming surfaces. Alternative methods of lifting equipment for the removal or insertion of shims or for moving equipment horizontally, such as provision for the use of hydraulic jacks, may be proposed. Such arrangements should be proposed for equipment that is too heavy to be lifted or moved horizontally using jackscrews. Jackscrews shall be plated for rust resistance.
  - 15.3.1.4 Machinery supports shall be designed to limit the relative displacement of the shaft ends caused by the worst combination of pressure, torque, and allowable piping stress to  $50 \,\mu m$  (0,002 in). See 7.4 for allowable piping forces.
  - **15.3.1.5** When pedestals or similar structures are provided for centreline support, they shall be designed and fabricated to permit the machine to be moved using horizontal jackscrews.
  - **15.3.1.6** The upper and lower surfaces of mounting plates and any separate pedestals mounted thereon shall be machined parallel. The surface finish shall be 6  $\mu$ m (250  $\mu$ in) arithmetic average roughness (Ra).
  - **15.3.1.7** The vendor shall blast clean all grout contact surfaces on the mounting plates in accordance with ISO 8501 Grade Sa2 or SSPC-SP6/NACE No. 3, and shall coat those surfaces compatible with epoxy grout. Grouts other than epoxy could require alternative surface preparation. Full bond strength of epoxy is not generally necessary.
  - **15.3.1.8** Mounting plates shall conform to the following:
  - a) mounting plates shall not be drilled for equipment to be mounted by others;
  - b) mounting plates shall be supplied with levelling screws;
  - c) mounting plates which are in contact with the grout shall have 50 mm (2 in) minimum radiused outside corners (in the plan view);
  - d) all machinery mounting surfaces shall be treated with a rust preventative immediately after machining;
  - e) mounting plates shall extend at least 25 mm (1 in) beyond the outer three sides of equipment feet.
- 15.3.1.9 The purchaser shall specify who is to supply the anchor bolts.
  - **15.3.1.10** Hold-down bolts used to attach equipment to the mounting plates and vertical jackscrews shall be supplied by the equipment vendor.
  - **15.3.1.11** Unless otherwise specified, horizontal jackscrews and levelling screws shall be provided by the supplier of the mounting plate(s).

- **15.3.1.12** The supplier of the mounting plates shall furnish austenitic stainless steel shim packs not less than 3 mm (1/8 in) total thickness and not more than 13 mm (1/2 in) thick between the equipment feet and the mounting plates. All shim packs shall straddle hold-down bolts and vertical jackscrews and shall be at least 6 mm (1/4 in) larger on all sides than the equipment feet.
- **15.3.1.13** If levelling plates are specified, they shall be steel plates at least 19 mm (3/4 in) thick. They shall be circular in shape in the plan view.
  - **15.3.1.14** Equipment shall be designed for installation in accordance with API RP 686.

## 15.3.2 Baseplates

- 15.3.2.1 If a baseplate is specified, the purchaser shall indicate the major equipment to be mounted on it. A baseplate shall be a single fabricated steel unit, unless the purchaser and the vendor agree that it may be fabricated in multiple sections. Multiple-section baseplates shall have machined and doweled mating surfaces which shall be bolted together to ensure accurate field reassembly.
  - NOTE A baseplate with nominal length of more than 12 m (40 ft) or a nominal width of more than 4 m (12 ft) may have to be fabricated in multiple sections because of shipping restrictions.
- 15.3.2.2 If specified, the baseplate shall be suitable for column mounting that is of sufficient rigidity to be supported at specified points without continuous grouting under structural members. The design of column mounted baseplates shall be agreed upon by the purchaser and the vendor.
- 15.3.2.3 If specified, the baseplate shall be designed to facilitate the use of optical, laser-based or other instruments for accurate levelling in the field. The details of such features shall be agreed upon by the purchaser and the vendor. Where levelling pads or targets or both these are supplied, they shall be accessible with the baseplate or baseplates on the foundation and the equipment mounted. Removable protective covers shall be provided. For column-mounted baseplates, pads or targets shall be located close to support points. For non-column-mounted baseplates, a pad or target shall be located at each corner. When required, additional pads or targets shall be located at intermediate points.
  - **15.3.2.4** The baseplate shall be provided with lifting lugs for at least a four-point lift. Lifting the baseplate complete with all equipment mounted shall not permanently distort or otherwise damage the baseplate or the equipment mounted on it.
  - CAUTION For safety reasons, special care and attention shall to be given to the stability of the lifting system to prevent overturning of the equipment.
- 15.3.2.5 The bottom of the baseplate between structural members shall be open. When the baseplate is designed for grouting, it shall be provided with at least one grout hole having a clear area of at least 0,01 m<sup>2</sup> (20 in<sup>2</sup>) and no dimension less than 75 mm (3 in) in each bulkhead section. These holes shall be located to permit grouting under all load-carrying structural members. Where practical, the holes shall be accessible for grouting with equipment installed. The holes shall have 13 mm (1/2 in) raised-lip edges and, if located in an area where liquids could impinge on the exposed grout, metallic covers with a minimum thickness of 1 mm (16 gauge) shall be provided. Vent holes at least 13 mm (1/2 in) in size shall be provided at the highest point in each bulkhead section of the baseplate.
  - **15.3.2.6** The underside mounting surfaces of the baseplate shall be in one plane to permit use of a single-level foundation. When multi-section baseplates are provided, the mounting surfaces shall be in one plane after the baseplate sections are doweled and bolted together.
- 15.3.2.7 If specified, subplates shall be provided by the supplier of the baseplate.
  - **15.3.2.8** Unless otherwise specified, non-skid decking covering all walk and work areas shall be provided on top of the baseplate.
  - **15.3.2.9** After baseplate fabrication, the equipment mounting surfaces shall meet the following criteria:
  - a) the surface finish shall be 6 µm (250 µin) arithmetic average roughness, Ra, or better;

- b) mounting surfaces in one plane shall be machined such that no point on any surface deviates from the common plane by more than 50 μm (0,002 in);
- c) different mounting planes shall be parallel to each other within 1 in 1 000, in any direction.

## 15.3.3 Soleplates and subplates

If soleplates are furnished, they shall meet the requirements of a) to c), as follows, in addition to those of 15.3.1.

NOTE See Annex F for a typical sketch.

- Adequate working clearance shall be provided at the bolting locations on soleplates to allow the use of socket or box wrenches and to allow the equipment to be moved using the horizontal and vertical jackscrews.
- b) Soleplates shall be steel plates that are thick enough to transmit the expected loads from the equipment feet to the foundation, without distortion of the soleplate, but in no case shall the plates be less than 40 mm (1 1/2 in) thick.
- c) If specified, subplates shall be supplied and shall be steel, a minimum of 25 mm (1 in) thick, and have a
  mating surface finish of 3 μm to 6 μm (125 μin to 250 μin) Ra or better. Corners shall be rounded to a
  minimum 50 mm (2 in) radius in the plan view.

#### 15.4 Relief valves

- **15.4.1** The vendor shall furnish the relief valves that are to be installed on equipment or in piping within their scope of supply. Other relief valves shall be furnished by the purchaser. The vendor shall advise the purchaser of the flow rate, set pressure, and temperature for purchaser's use in relief valve sizing and selection. The vendor's quotation shall list all relief valves and shall clearly indicate those to be furnished by the vendor.
- **15.4.2** The sizing, selection and installation of relief valves shall meet the requirements of API RP 520, Parts I and II. Relief valves shall be in accordance with API Std 526. The vendor shall determine the size and set pressure of all relief valves within their scope of supply and recommend the size and setting of relief valves supplied by others required to protect the equipment. Relief valve sizes and set pressures shall take account of all possible modes of equipment failure.
- **15.4.3** Unless otherwise specified, relief valves shall have steel bodies.
- **15.4.4** If specified, thermal relief valves shall be provided for components that contain liquid and could be blocked in by isolation valves.

## 15.5 Lubrication and control-oil system

- **15.5.1** Unless otherwise specified, bearings and bearing housings shall be arranged for oil lubrication using a mineral oil in accordance with ISO 8068.
- **15.5.2** If specified, the turbine vendor shall furnish a pressurized oil system to supply oil at a suitable pressure or pressures, as applicable, to the following:
  - a) the bearings of the driver and of the driven equipment (including any gear);
  - b) any continuously lubricated couplings;
  - c) the control-oil system;
  - d) the shutdown system.

. . . . . . .

- **15.5.3** If the pressurized oil system is furnished by others, the turbine vendor shall
- define the steady and transient oil-flow and pressure requirements, the degree of filtration required, and the maximum heat load imposed and
- furnish piping to a single feed connection for each pressure level. One drain connection shall be provided for all oil to be returned to the reservoir.
- **15.5.4** Pressurized oil systems shall conform to ISO 10438.
- NOTE For the purpose of this provision, API 614 is equivalent to ISO 10438.
- 15.5.5 Where oil is supplied from a common system to two or more components of a machinery train (such as a compressor, a gear and a turbine), the vendor having unit responsibility shall ensure compatibility of type, grade, pressure and temperature of oil for all equipment served by the common system.
- NOTE The usual lubricant employed in a common oil system is a mineral oil that corresponds to ISO 3448 Grade 32. Compatibility of lube oil requirements needs to be agreed upon among the user and all vendors supplying equipment served by the common system. In some cases there can be significant differences in individual component needs. For example, a refrigeration compressor may need low-pour point oil, a gear may need high viscosity and a turbine may need a conventional mineral oil. In such cases it may be necessary to change the design of a component or to provide separate oil systems.
- 15.5.6 Any points that require grease lubrication during operation and which cannot be easily and safely accessed during operation shall be provided with austenitic stainless steel extension lines shielded from heat if necessary.

## 15.6 Gland vacuum systems

- 15.6.1 Unless otherwise specified, a gland vacuum system shall be furnished by the vendor (see typical system in Annex G). It shall include a gland condenser and steam ejector sized for three times the expected flow with "as new" shaft seal clearances. The condenser shall have a steel shell, brass or cupro-nickel tubes with a nominal wall thickness of not less than 1,25 mm (0,050 in) and a diameter of at least 15 mm (5/8 in), and fixed tube sheets with water on the tube side. U-tubes shall not be used. The water side (tube side) shall conform to the requirements of 6.1.13. The shell side shall be designed for both full vacuum and gauge pressure of 500 kPa (5 bar) (75 psi). The steam ejector shall have a steel body and a replaceable stainless steel steam nozzle.
- **15.6.2** If specified, a vacuum pump shall be provided in place of a steam ejector.

## 15.7 Insulation and jacketing

15.7.1 If specified or required by the vendor, turbines shall be insulated and jacketed. The insulation and jacketing shall extend over all parts of the turbine casing that can reach a normal operating temperature of 74 °C (165 °F) or higher.

If insulation is not supplied, the vendor should advise the purchaser of the expected surface temperature of the casing and any special requirements. This applies to the turbine casing and does not include any auxiliary steam piping or bolted-on trip or trip and throttle valves.

- NOTE A jacket is a metal lagging or cover over the unit. A blanket is a removable, reusable, fit insulation skin which is wired to the turbine casing.
- 15.7.2 The insulation shall maintain an external surface temperature of not more than 74 °C (165 °F) under normal operating conditions. Jackets and insulation shall be designed to minimize possible damage during removal and replacement.

## 15.8 Turning gear

- 15.8.1 A turning gear shall be provided if specified by the purchaser or required by the vendor.
  - NOTE The need for a turning gear is typically determined by the bearing span and the rotor's vulnerability to temporary bow during shutdown.
  - **15.8.2** Energizing power operated turning gear shall be possible only after lube-oil pressure has been established.
  - **15.8.3** The turning gear shall automatically disengage when the rotor accelerates during start-up.
  - **15.8.4** Engagement of the turning gear on shutdown before the rotor has come to a stop shall be positively prevented if this could damage the turning device or the steam turbine.
- **15.8.5** The type of turning device shall be specified. It may be driven by a steam turbine, electrical motor, hydraulic motor or pneumatic motor. Provision shall be made to permit manual operation of the turning gear.
  - **15.8.6** The turning-gear rotational speed and torque shall be agreed upon by the purchaser and the vendor. Consideration shall be given to duration of use, minimum speed required for the turbine and driven equipment, and the type of lube-oil supply.
- **15.8.7** If specified, a turning gear operating station with associated control features, as detailed by the purchaser, shall be provided.

## 15.9 Special tools

- **15.9.1** When special tools and fixtures are required to disassemble, assemble or maintain the turbine unit, they shall be included in the quotation and furnished as part of the initial supply of the machine. For multi-unit installations, the requirements for quantities of special tools and fixtures shall be agreed upon by the purchaser and the vendor. These or similar special tools shall be used during shop assembly and post-test disassembly of the equipment.
- **15.9.2** When special tools are provided, they shall be packaged in a separate, rugged metal box or boxes and shall be marked "special tools for (tag/item number)". Each tool shall be stamped or tagged to indicate its intended use.
- 15.9.3 When spreader beams or other special lifting devices are required for installation or maintenance, they shall be provided by the vendor, unless otherwise specified. The purchaser shall specify whether these devices shall be provided on loan or for permanent retention by the owner.

## 16 Inspection, testing and preparation for shipment

## 16.1 General

- **16.1.1** After advance notification to the vendor, the purchaser's representative shall have entry to all vendor and subvendor facilities where manufacturing, testing or inspection of the equipment is in progress.
- **16.1.2** The vendor shall notify subvendors of the purchaser's inspection and testing requirements.
- **16.1.3** The vendor shall provide sufficient advance notice to the purchaser before conducting any inspection or test that the purchaser has specified to be witnessed or observed. For mechanical running or performance tests, this requires written notification of a successful preliminary test.

The purchaser should expect to be in the factory longer for an observed test than for a witnessed test.

- **16.1.4** The purchaser shall specify the extent of his participation in the inspection and testing and the amount of advance notification he requires.
  - **16.1.5** If shop inspection and testing have been specified by the purchaser, the purchaser and the vendor shall meet to coordinate manufacturing hold points and inspectors' visits.
  - **16.1.6** Equipment, materials and utilities for the specified inspection and tests shall be provided by the vendor.
- 16.1.7 If specified, the purchaser's representative, the vendor's representative or both shall indicate compliance with this International Standard by initialling, dating and submitting a completed checklist to the purchaser before shipment. For a typical inspector's checklist, see Annex I.
  - **16.1.8** The purchaser's representative shall have access to the vendor's quality-control program for review.

## 16.2 Inspection

#### 16.2.1 General

- **16.2.1.1** The vendor shall keep the following data available for at least 20 years:
- a) necessary or specified certification of materials, such as mill test reports;
- b) specifications for all purchased items;
- c) fully identified records of all heat treatment whether performed in the normal course of manufacture or as part of a repair procedure;
- d) test data to verify that the requirements of the specification have been met;
- e) results of quality-control tests and inspections;
- f) final-assembly maintenance and running clearances;
- g) details of all major repairs [see 11.2.3 c) and 11.3.2].
- h) other data specified by the purchaser or required by applicable codes and regulations (see 17.3).
- NOTE 1 Test data applies to such tests as hydro and running, as well as NDE results.
- NOTE 2 A summary of typical component inspections is given in Annex H.
- **16.2.1.2** Pressure-containing parts shall not be painted until the specified pressure testing of the parts is completed.
- 16.2.1.3 In addition to the requirements of 11.3.1, the purchaser may specify the following:
  - a) parts that shall be subjected to surface and subsurface examination;
  - b) the type of examination required, such as magnetic particle, liquid penetrant, radiographic or ultrasonic examination.

## 16.2.2 Materials inspection

NDE shall be performed as required by the material specification. If additional radiographic, ultrasonic, magnetic particle or liquid penetrant examinations of the welds or materials are specified by the purchaser, the methods and acceptance criteria shall be in accordance with the standards shown in Table 4 or alternative standards specified by the purchaser or proposed by the vendor and agreed by the purchaser.

Radiography should normally be considered for steam gauge pressures exceeding 8 600 kPa (86 bar) (1 250 psi) or steam temperatures exceeding 510 °C (950 °F).

Table 4 — Materials inspection standards

Type of inspection	Methods	Acceptance criteria				
Type of inspection	Methods	For fabrications	For castings			
Radiography	Section V, Articles 2 and 22 of the ASME Code	Section VIII , Division 1, UW-51 (for 100 % radiography) and UW-52 (for spot radiography) of the ASME Code	Section VIII, Division 1, Appendix 7 of the ASME Code			
Ultrasonic inspection	Section V, Articles 5 and 23 of the ASME Code	Section VIII, Division 1, Appendix 12, of the ASME Code	Section VIII, Division 1, Appendix 7, of the ASME Code			
Magnetic particle inspection	Section V, Articles 7 and 25 of the ASME Code	Section VIII, Division 1, Appendix 6 of the ASME Code	Section VIII, Division 1, Appendix 7, of the ASME Code			
Liquid penetrant inspection	Section V, Articles 6 and 24 of the ASME Code	Section VIII, Division 1, Appendix 8 of the ASME Code	Section VIII, Division 1, Appendix 7, of the ASME Code			

Forgings used for turbine shafts, disks, and rotors with integrally forged disks shall be inspected by ultrasonic methods in accordance with ASTM A 418.

Unless otherwise specified, a heat stability check shall be performed on the turbine shaft or rotor forging in accordance with ASTM A 472.

## 16.2.3 Mechanical inspection

- **16.2.3.1** During assembly of the equipment, each component (including integrally cast-in passages) and all piping and appurtenances shall be inspected to ensure they have been cleaned and are free of foreign materials, corrosion products, and mill scale.
- **16.2.3.2** All oil system components furnished shall meet the cleanliness requirements of ISO 10438.
- NOTE For the purpose of this provision, API 614 is equivalent to ISO 10438.
- 16.2.3.3 If specified, the purchaser may inspect for cleanliness the equipment and all piping and appurtenances before installation of nozzle blocks and steam-chest covers, final assembly of piping, or closure of openings.
- 16.2.3.4 If specified, the hardness of parts, welds, and heat-affected zones shall be verified as being within
  the allowable values by testing. The method, extent, documentation, and witnessing of the testing shall be
  agreed by the purchaser and the vendor.

## 16.3 Testing

#### 16.3.1 General

- **16.3.1.1** Equipment shall be tested in accordance with 16.3.2 and 16.3.3. Other tests that may be specified by the purchaser are described in 16.3.4.
- **16.3.1.2** At least six weeks before the first scheduled mechanical running test, the vendor shall submit to the purchaser for his review and comment, detailed procedures for all running tests, and all specified optional tests (16.3.4), including acceptance criteria for all monitored parameters.

The vendor shall notify the purchaser not less than five working days before the date the equipment is ready for testing. If the testing is rescheduled, the vendor shall notify the purchaser not less than five working days before the new test date.

## 16.3.2 Casing pressure hydro tests

#### 16.3.2.1 General

- 16.3.2.1.1 The chloride content of liquids used to hydrotest austenitic stainless steel materials shall not exceed 50 mg/kg (wt ppm). To prevent deposition of chlorides as a result of evaporative drying, all residual liquid shall be removed from tested parts at the conclusion of the test.
- 16.3.2.1.2 The test liquid shall be at a higher temperature than the nil-ductility transition temperature of the material being tested (reference ASTM E 1003).
- The nil ductility temperature is the highest temperature at which a material experiences complete brittle fracture. without appreciable plastic deformation.
- **16.3.2.1.3** The vendor shall define test procedures for turbines with double shell construction.

## 16.3.2.2 Casing integrity test

- 16.3.2.2.1 All pressure-containing parts shall be hydro pressure tested to prove casing integrity with liquid at a gauge pressure of at least 1,5 times the maximum allowable working pressure but not less than 140 kPa (1,4 bar) (20 psi). See 3.17.
- 16.3.2.2.2 If the part tested is to operate at a temperature at which the strength of a material is below the strength of that material at the testing temperature, the hydro test pressure shall be multiplied by a factor obtained by dividing the allowable working stress for the material at the testing temperature by that at the rated operating temperature. The stress values used shall be determined in accordance with 7.1.2. The pressure thus obtained shall then be the minimum pressure at which the hydro test shall be performed. The data sheets shall list actual hydro test pressures.
- NOTE Applicability of this requirement to the material being tested should be verified before pressure test, as the properties of many grades of steel do not change appreciably at temperatures up to 200 °C (400 °F).
- 16.3.2.2.3 Tests shall be maintained for a sufficient period of time to permit complete examination of parts under pressure. The pressure casing integrity hydro test shall be considered satisfactory when neither leaks nor seepage through the casing is observed for a minimum of 30 min. Large, heavy castings may require a longer testing period to be agreed upon by the purchaser and the vendor. Seepage past internal test closures required for testing of segmented cases and operation of a test pump to maintain pressure are acceptable.
- NOTE The purpose of the pressure hydro test is to prove pressure casing integrity and not to prove joint sealing.
- **16.3.2.2.4** Use of a sealant compound or gasket on the casing joints is acceptable during the casing integrity hydro test.

## 16.3.2.3 Casing joint leakage test

A hydro test for casing joint leakage shall be performed. The hydro test pressure shall be 1,5 times the maximum allowable working pressure in that pressure zone. Temperature corrections as specified in 16.3.2.2.2 are not required for this test. This test should be performed after the casing hydro integrity test. Gaskets shall not be used at the casing joint for this test. Suitable joint compound may be used (see 7.1.6). The test shall be considered satisfactory when neither leaks nor seepage through the casing joint is observed for a minimum of 30 min. The casing joint leakage test may be combined with the casing hydro integrity test, provided casing joint gaskets are not used.

#### 16.3.3 Mechanical running test

- **16.3.3.1** The requirements of a) to j), as follows, shall be met before the mechanical running test is performed.
- a) The contract shaft seals and bearings shall be used in the machine for the mechanical running test. Bearing housing seals shall be checked and any leaks shall be corrected.
- b) All oil pressures, viscosities, and temperatures shall be within the range of operating values recommended in the vendor's operating instructions for the specific unit being tested. For pressure lubrication systems, oil flow rates for each bearing housing shall be measured.
- c) Test-stand oil filtration shall be 10 μm nominal or better. Oil system components downstream of the filters shall meet the cleanliness requirements of ISO 10438 before any test is started.
  - NOTE For the purpose of this provision, API 614 is equivalent to ISO 10438.
- d) All joints and connections shall be checked for tightness, and any leaks shall be corrected.
- e) All warning, protective and control devices used during the test shall be checked, and adjustments shall be made as required.
- f) The mechanical running test shall be performed with the contract half coupling and a coupling mass simulator, or moment simulator, in accordance with ISO 10441 or API Std 671, in place (15.1.7).
- g) All contract vibration probes, cables, oscillator-demodulators and accelerometers shall be in use during the test.
- h) Shop test facilities shall include instrumentation with the capability of continuously monitoring and plotting revolutions per minute, peak-to-peak displacement and phase angle (*x-y-y'*). Presentation of vibration displacement and phase marker shall also be by oscilloscope.
- i) The vibration characteristics determined by the use of instrumentation specified in g) and h) shall serve as the basis for acceptance or rejection of the machine.
- j) If external housing vibration test values are specified, vibration data (minimum and maximum values and phase angles) shall be measured vertically and horizontally transverse to each bearing centreline using shop instrumentation.
- **16.3.3.2** Unless otherwise specified, operation of the control systems shall be demonstrated and the mechanical running test of the steam turbine shall be conducted as specified in a) to f), as follows.

Test steam conditions should be as close to design as practical. Due to no-load operation for extended periods of time during the test, the inlet steam conditions may need to be reduced to prevent overheating of the unit and exceeding design clearances.

- a) Operate the equipment at speed increments of approximately 10 % from zero to the maximum continuous speed (avoiding any resonant speeds) and run at maximum continuous speed until bearings, lube-oil temperatures and shaft vibrations have stabilized.
- b) Increase the speed to trip speed and run the equipment for a minimum of 15 min.
- c) Check overspeed trip devices and adjust them until values within 1 % of the nominal trip setting are attained. Mechanical overspeed devices, when supplied, shall attain three consecutive non-trending trip values that meet this criterion.
- d) The speed governor and any other speed-regulating devices shall be tested for smooth performance over the operating speed ranges. Check no-load stability and response to the control signal.

- Record data for governors such that it includes at least the sensitivity and linearity of relationship between speed and control signal, and, for adjustable governors, the response speed range.
- Run the turbine continuously at the maximum continuous speed for at least 4 h.
- 16.3.3.3 During the mechanical running test, the requirements specified in a) to g), as follows, shall be met.
- The mechanical operation of all equipment being tested, including all casing joints and connections, and the operation of the test instrumentation shall be satisfactory. The measured unfiltered vibration shall not exceed the limits of 9.6.8 and shall be recorded throughout the operating speed range.
- b) While the equipment is operating at maximum continuous speed and at other speeds and/or load that may have been specified in the test agenda, vibration data shall be acquired to determine amplitudes at frequencies other than synchronous. As a minimum, this data shall cover a frequency range from 0,05 times to 8 times the maximum continuous speed. If the amplitude of any discrete, non-synchronous vibration exceeds 20 % of the allowable vibration as defined in 9.6.8, the purchaser and the vendor shall agree on requirements for any additional testing and on the equipment's acceptability.
- The mechanical running test shall verify that lateral critical speeds conform to the requirements of 9.2 and 9.3. Any non-critically-damped critical speed below the trip speed shall be determined during the mechanical running test.
- Shop verification of the unbalanced response analysis shall be performed in accordance with 9.3.
- Real-time vibration data, as agreed upon by the purchaser and vendor, shall be recorded and a copy e) provided to the purchaser.
  - Plots showing synchronous vibration amplitude and phase angle versus speed for deceleration shall be made before and after the 4 h run. Plots shall be made of both the filtered (one for each revolution) and unfiltered vibration levels. If specified, these data shall also be furnished in polar form. The speed range covered by these plots shall be from the specified trip speed to 400 r/min.
  - During the 4 h test, lube-oil inlet pressures and temperatures shall be varied through the range specified in the steam turbine operating manual.
  - 16.3.3.4 Unless otherwise specified, the requirements of a) to c), as follows shall be met after the mechanical running test is completed.
  - Hydrodynamic bearings shall be removed, inspected and reassembled after the mechanical running test is completed.
  - If replacement or modification of bearings or seals, or if dismantling of the case to replace or modify other parts, is required to correct mechanical deficiencies, the initial test shall not be acceptable. Final shop tests shall be run after these deficiencies are corrected.
  - When spare rotors are ordered to permit concurrent manufacture, each spare rotor shall also be given a mechanical running test in accordance with this International Standard.

## 16.3.4 Optional tests and inspections

#### 16.3.4.1 General

The purchaser shall specify in the inquiry or in the order whether any of the shop tests specified in 16.3.4.2 to 16.3.4.11 shall be performed.

#### 16.3.4.2 Performance test

• The machine shall be tested in accordance with IEC 60953 or ASME PTC 6. If this is not practicable, the vendor's proposal shall define the conditions under which the vendor proposes to conduct the test. Methodology and acceptance criteria shall be agreed upon by the purchaser and the vendor. Vibration levels shall be measured and recorded during this test, as specified in 16.3.3.1 and 16.3.3.2.

## 16.3.4.3 Complete unit test

 Components such as compressors, gears, drivers and auxiliaries, which make up a complete unit, shall be tested together. By agreement, this test may incorporate the mechanical running test.

## 16.3.4.4 Auxiliary equipment test

 Auxiliary equipment such as oil systems and control systems shall be tested in the vendor's shop. Details of auxiliary-equipment tests shall be developed jointly by the purchaser and the vendor.

## 16.3.4.5 Post-test internal inspection of casing

 The steam turbine shall be dismantled, inspected and reassembled after satisfactory completion of the mechanical running test.

The merits of post-test internal inspection of casing should be evaluated against the benefits of shipping a unit with proven mechanical assembly and casing joint integrity.

## 16.3.4.6 Overspeed shutdown systems test

• The response time of the overspeed shutdown systems shall be recorded to confirm compliance with the requirements of 12.3.1.1.

#### 16.3.4.7 Spare parts test

 Spare parts such as couplings, gears, diaphragms, bearings and seals shall be tested as specified by the purchaser.

See 16.3.3.4 c) for a mechanical test of the spare rotor.

#### 16.3.4.8 Inspection of hub/shaft fit for hydraulically mounted couplings

 After the running tests, the shrink fit of hydraulically mounted couplings shall be inspected by comparing hub/shaft match marks to ensure that the coupling hub has not moved on the shaft during the tests.

## 16.3.4.9 Trip valve test

 Complete valve assembly shall be tested by the vendor in its specified orientation and tripped closed from the full open position. Travel versus time shall be recorded. The trip time shall not exceed the required trip time (see 12.3.4.7).

## 16.3.4.10 Governor system response test

• If a load test is performed at a specific operating point, the response time of the turbine governing system shall be continuously recorded to confirm compliance with the requirements of 12.2.4.

## 16.3.4.11 Sound level test

The sound level test shall be performed in accordance with ISO 3744 or other agreed upon standard.

Sound pressure levels may be converted into sound power levels in accordance with ISO 10494.

## 16.4 Preparation for shipment

- 16.4.1 Equipment shall be prepared for the type of shipment specified, including blocking of the rotor when necessary. Blocked rotors shall be identified by means of corrosion-resistant tags attached with stainless steel wire. The preparation shall make the equipment suitable for six months of outdoor storage from the time of shipment, with no disassembly required before operation, except for inspection of bearings and seals. If storage for a longer period is contemplated, the purchaser shall consult with the vendor regarding the recommended procedures to be followed.
  - 16.4.2 The vendor shall provide the purchaser with the instructions necessary to preserve the integrity of the storage preparation after the equipment arrives at the job site and before startup, as described in Chapter 3 of API RP 686.
  - 16.4.3 The equipment shall be prepared for shipment after all testing and inspection have been completed and the equipment has been released by the purchaser. The preparation shall include that specified in a) to k), as follows.
  - Except for machined surfaces, all exterior surfaces that may corrode during shipment, storage, or in service, shall be given at least one coat of the manufacturer's standard paint. The paint shall not contain lead or chromates.
    - Austenitic stainless steels typically are not painted.
  - b) Exterior machined surfaces, except for corrosion-resistant material, shall be coated with a suitable rust preventative.
  - The interior of the equipment shall be clean; free from scale, welding spatter and foreign objects; and sprayed or flushed with rust preventative that can be removed with solvent. The rust preventative shall be applied through all openings while the rotor is rotated.
  - d) Internal surfaces of bearing housings and carbon steel oil systems' components shall be coated with an oil-soluble rust preventative that is compatible with the lubricating oil.
  - e) Flanged openings shall be provided with metal closures at least 5 mm (3/16 in) thick, with elastomer gaskets and at least four full-diameter bolts. For studded openings, all nuts needed for the intended service shall be used to secure closures. Each opening shall be car sealed (tagged) so that the protective cover cannot be removed without the seal being broken.
  - Threaded openings shall be provided with steel caps or round-head steel plugs. In no case shall nonmetallic (such as plastic) caps or plugs be used.
    - NOTE These are shipping plugs; permanent plugs are covered in 7.2.6.
  - Turbines supplied without self-supporting baseplates shall be bolted to a shipping skid formed of heavy timbers suitable for sling-lift or forklift truck handling. Larger turbines shall have supports as required by the type of transportation and handling.
  - Lifting points, lifting lugs, and the centre of gravity shall be clearly identified on the equipment package. The vendor shall provide the recommended lifting arrangement.
  - The equipment shall be identified with item and serial numbers. Material shipped separately shall be identified with securely affixed, corrosion-resistant metal tags indicating the item and serial number of the equipment for which it is intended. In addition, crated equipment shall be shipped with duplicate packing lists, one inside and the other on the outside of the shipping container.
- If a spare rotor is purchased, the rotor shall be prepared for unheated indoor storage for a period of at j) least 10 years. The rotor shall be crated for domestic or export shipment, as specified. Lead sheeting, at

least 3 mm (1/8 in) thick or a purchaser-approved equivalent shall be used between the rotor and the cradle at the support areas. The rotor shall not be supported at journals. Unless otherwise specified, the rotor shall be prepared for vertical storage. It shall be supported from its coupling end with a fixture designed to support 1,5 times the rotor's mass without damaging the shaft. Instructions on the use of the fixture shall be included in the installation, operation and maintenance manuals.

- k) Exposed shafts and shaft couplings shall be wrapped with waterproof, mouldable waxed cloth or vapourphase-inhibitor paper. The seams shall be sealed with oil-proof adhesive tape.
- **16.4.4** Auxiliary piping connections furnished on the purchased equipment shall be impression stamped, matchmarked (for ease of reassembly), and permanently tagged to agree with the vendor's connection table or general arrangement drawing. Service and connection designations shall be indicated.
- **16.4.5** Bearing assemblies shall be fully protected from the entry of moisture and dirt. If vapour-phase-inhibitor crystals in bags are installed in large cavities to absorb moisture, the bags must be attached in an accessible area for easy removal. Where applicable, bags shall be installed in wire cages attached to flanged covers, and bag locations shall be indicated by corrosion-resistant tags attached with stainless steel wire.
- **16.4.6** One copy of the manufacturer's installation instructions shall be packed and shipped with the turbine.
- **16.4.7** Connections on auxiliary piping, removed for shipment, shall be tagged and matchmarked for ease of reassembly.
- **16.4.8** The fit-up and assembly of machine-mounted piping shall be completed in the vendor's shop prior to shipment, to confirm fitup.

## 17 Vendor's information

## 17.1 General

- **17.1.1** The information to be furnished by the vendor is specified in 17.2 and 17.3. The vendor shall complete and forward a vendor drawing and data requirements form (see typical form in Annex J) or purchaser's equivalent to the address or addresses noted on the inquiry or order. This form shall detail the schedule for transmission of drawings, curves and data as agreed to at the time of the order, as well as the number and type of copies required by the purchaser.
- **17.1.2** The data shall be identified on transmittal (cover) letters and in title blocks or title pages with the following information:
- a) the purchaser's/user's corporate name;
- b) the job/project number;
- c) the equipment item number and service name;
- d) the inquiry or purchase order number;
- e) any other identification specified in the inquiry or purchase order;
- f) the vendor's identifying proposal number, shop order number, serial number or other reference required to completely identify return correspondence.
- **17.1.3** A coordination meeting shall be held, preferably at the vendor's plant, within four to six weeks after order commitment. Unless otherwise specified, the vendor shall prepare and distribute a proposed agenda prior to this meeting, which shall include, but not be limited to, review of the following items:
- a) the purchase order, scope of supply, unit responsibility, and subvendor items;

- the data sheets;
- applicable specifications and previously agreed-upon exceptions; c)
- schedules for transmittal of data, production and testing;
- the quality assurance program and procedures; e)
- inspection, expediting and testing; f)
- schematics and bills of material for auxiliary systems; g)
- the physical orientation of the equipment, piping and auxiliary systems;
- coupling selections; i)
- thrust and journal bearing sizing, estimated loading and specific configurations; j)
- the preliminary rotor dynamics analysis; k)
- I) equipment performance, alternate operating conditions, startup, shutdown and any operating limitations;
- m) instrumentation and controls.

## 17.2 Proposals

#### 17.2.1 General

The vendor shall forward the original proposal and the specified number of copies to the addressee specified in the inquiry documents. The proposal shall include, as a minimum, the data specified in 17.2.2 to 17.2.4, and a specific statement that the equipment and all its components and auxiliaries are in strict accordance with this International Standard. If the equipment or any of its components or auxiliaries is not in strict accordance, the vendor shall include a list that details and explains each deviation. The vendor shall provide sufficient detail to enable the purchaser to evaluate any proposed alternative designs. All correspondence shall be clearly identified in accordance with 17.1.2.

## 17.2.2 Drawings

The drawings indicated on the VDDR form shall be included in the proposal. As a minimum, the following data shall be included:

- preliminary general arrangement or outline drawing for each turbine or skid-mounted package, showing overall dimensions, maintenance clearance dimensions, overall masses, erection masses, and the largest maintenance mass for each item, as well as the direction of rotation and the size and location of major purchaser connections;
- cross-sectional drawings and/or literature showing the details of the proposed equipment;
- schematics of all auxiliary systems, including the steam, lube-oil, control, and alarm and shutdown c) systems;
- sketches that show methods of lifting the assembled machine or machines, packages, and major components and auxiliaries [this information may be included on the drawings specified in 17.2.2 a)].

#### 17.2.3 Technical data

The following data shall be included in the proposal:

the purchaser's data sheets, with complete vendor's information entered thereon;

- b) the predicted noise data (see 6.1.15);
- c) the VDDR form, indicating the schedule according to which the vendor agrees to transmit all the data specified as part of the purchase order;
- a list of spare parts recommended for start-up and normal maintenance purposes;
- e) a list of the special tools furnished for maintenance;
- f) a description of any special weather protection and winterization required for startup, operation and periods of idleness under the site conditions specified on the data sheets; this description shall show the protection to be furnished by the purchaser, as well as that included in the vendor's scope of supply;
- g) a complete tabulation of utility requirements, e.g. steam, water, electricity, air and lube oil (including the quantity and supply pressure of oil required and the heat load to be removed by the oil), and the nameplate power rating and operating power requirements of auxiliary drivers. (Approximate data shall be defined and clearly identified as such);
- h) a description of any optional or additional tests and inspection procedures for materials, in accordance with 16.3.4;
- i) a description of any special requirements specified in the purchaser's inquiry and in accordance with 11.1.2, 12.4, 14.2 and 15.4;
- j) a list of machines similar to the proposed machine(s) that have been installed and are operating under conditions analogous to those specified in the inquiry;
- k) any startup, shutdown or operating restrictions required to protect the integrity of the equipment;
- the expected output power at normal steam conditions and rated speed with governor control valves fully open;
- m) approximate potential maximum power output of the unit under normal steam conditions and at normal speed that could be obtained by field modification the required field modifications shall be described in general (for example, valve, nozzle, diaphragm, or blade changes with no changes to the rotor or casing):
- n) a list of all relief valves in accordance with 15.4, including size and set pressure relief valves furnished by the vendor shall also be specified, with valve manufacturer and model data provided;
- o) a list of any components that can be construed as being of alternate design, hence requiring purchaser's acceptance;
- p) the types of fasteners (e.g. SI or US Customary) used in equipment, including auxiliaries, in the vendor's scope of supply.

## 17.2.4 Curves

The vendor shall provide complete performance curves to encompass the map of operations, with any limitations indicated thereon. The curves shall include those indicated by the purchaser on the VDDR form.

## 17.3 Contract data

### 17.3.1 General

- 17.3.1.1 Contract data shall be furnished by the vendor in accordance with the agreed VDDR form.
- **17.3.1.2** Each drawing shall have a title block in the lower right-hand corner with the date of certification, identification data specified in 17.1.2, revision number and date and title. Similar information shall be provided on all other documents.

- 17.3.1.3 Review of vendor data by the purchaser, with or without comment, shall not relieve the vendor of the responsibility of supplying the equipment in accordance with the purchase order.
- 17.3.1.4 A complete list of vendor data shall be included with the first issue of the major drawings. This list shall contain titles, drawing numbers and a schedule for transmission of each item listed. This list shall crossreference data with the VDDR form in the purchase order.

## 17.3.2 Drawings and technical data

The drawings and data furnished by the vendor shall contain sufficient information so that, together with the manuals specified in 17.3.4, the purchaser can properly install, operate and maintain the equipment covered by the purchase order. All contract drawings and data shall be clearly legible (8 point minimum font size even if reduced from a larger size drawing), and shall cover the scope of the agreed VDDR form (see 17.1.1).

#### 17.3.3 Parts lists and recommended spares

- The vendor shall submit complete parts lists for all equipment and accessories supplied. These 17.3.3.1 lists shall include part names and manufacturers' unique part numbers. Each part shall be completely identified and shown on appropriate cross-sectional, assembly-type cutaway or exploded-view isometric drawings. Interchangeable parts shall be identified as such. Parts that have been modified from standard dimensions or finished to satisfy specific performance requirements shall be uniquely identified by part number. Standard purchased items shall be identified by the original manufacturer's name and part number.
- The vendor shall indicate all those parts that are recommended as start-up or maintenance spares, and the recommended stocking quantities of each. These should include spare parts recommendations of subsuppliers that were not available for inclusion in the vendor's original proposal. The vendor shall forward the lists to the purchaser promptly after receipt of the reviewed drawings and in time to permit order and delivery of the parts before field start-up.

## 17.3.4 Installation, operation, maintenance and technical manuals

#### 17.3.4.1 General

The vendor shall provide sufficient written instructions and all necessary drawings to enable the purchaser to install, operate and maintain all of the equipment covered by the purchase order. This information shall be compiled in a manual or manuals with a cover sheet showing the information listed in 17.1.2, an index sheet and a complete list of enclosed drawings by title and drawing number. The manual or manuals shall be prepared specifically for the equipment covered by the purchase order. "Typical" manuals are unacceptable.

## 17.3.4.2 Installation manual

All information required for the proper installation of the equipment shall be compiled in a manual that shall be issued no later than the time of issue of final certified drawings. For this reason, it may be separate from the operating and maintenance instructions. This manual shall contain information on alignment and grouting procedures, normal and maximum utility requirements, centres of mass, rigging provisions and procedures, and all installation data. All drawings and data specified in 17.2.2 and 17.2.3 that are pertinent to proper installation shall be included as part of this manual (see description of Item mm in Annex J).

## 17.3.4.3 Operating and maintenance manual

A manual containing all required operating and maintenance instructions shall be supplied not later than two weeks after all specified tests have been successfully completed. In addition to covering operation at all specified process conditions, this manual shall also contain separate sections covering operation under any specified extreme environmental conditions (also see description of Item nn in Annex J).

## 17.3.4.4 Technical data manual

If specified, the vendor shall provide the purchaser with a technical data manual within thirty days of completion of shop testing. (See description of line Item tt in Annex J for minimum requirements of this manual.)

# Annex A (informative)

## Typical data sheets

This annex contains typical data sheets for use by the purchaser and the vendor.

The sheets are presented in SI units (10 sheets) and USC units (10 sheets).

Unless indicated otherwise, all pressure units are gauge pressure.

									JOB NOITEM NO.							
									PURCHASE ORDER NO.							
								SPECIFICATION NO.								
	SPE	CIAL-PUR	POSE S	TEAM <sup>-</sup>	<b>TURBINE</b>	E		REVISION NO. DATE								
		D.	ATA SHE	ET				PAGE 1 OF 10 BY								
			SI UNITS	6							-		-			
1	APPLICABLE TO:	0	PROPOSAL	0	PURCHASE	: [	) A	S-BL	JILT							
2	FOR						_	UNI	т							
3	SITE							SEF	RIAL NUI	MBEF	₹					
4	SERVICE							NUI	MBER RI	EQUI	RED					
5	MANUFACTURER	}			MODEL	_				DRI	VEN EQU	JIPMENT	ITEM NO.			
6	DRIVEN EQUIPME	ENT TYPE:	Осо	MPRESS	DR C	GENER	ATOR		Оот	- HER						
7	NOTE: INFORMAT	TION TO BE C	OMPLETED	BY:	Орг	URCHASE	R		MANUF	ACT	URER	Ор	JRCHASER OR	MANU	JFACTURE	ER
8						PE	RFOR	MAN	ICE							
9	OPERATING POIN	NTS	SHA	FT		INLET			INDU	CTIO	N/EXTRA	CTION		EXH	HAUST	
10	☐ ☐ AS APPL	ICABLE	POWER	SPEED	FLOW	PRESS	TEN	MP	FLO	W	PRESS	TEMP	PRESS		TEMP	ENTHALPY
11			kW	r/min	kg/h	kPa	°C (	TT)	kg/l	า	kPa	°C (TT)	kPa		°C (TT)	kJ / kg
12	DATED															
13 14	RATED	4.4\														
15	NORMAL (3.26)(6. MINIMUM	1.4)														
16	IVIINIIVIOIVI															
17	STEAM RATE	: ka/k\N b (3 /	4).		NORMAL	+	RATE	:n		INID	UCTION		CONTROLLED		UNCON	TPOLLED
18	POTENTIAL N		,		NONWAL			.0			TRACTIO	_	CONTROLLED		UNCON	
19		WAXIIVIOW 1 O	WEI((0.00)			STE	AM CO	NDIT	TIONS	LXI	110-0110		CONTROLLED		2 0110011	TROLLED
20			O IN	LET		EXHAUST		Τ_	O EXT	DACT	TION .		XTRACTION		O EXTR	ACTION
21				LLI		LXIIAUUI		1	_	UCTI			NDUCTION		_	JCTION
22		MAXIMUM							1140	0011	1014		NDOOTION		IIVDC	0011014
23	FLOW	NORMAL														
24	kg/h	MINIMUM														
25	PRESSURE	MAXIMUM														
26	kPa	NORMAL														
27		MINIMUM														
28		MAXIMUM														
29	TEMPERATURE	NORMAL														
30	°C (TT)	MINIMUM														
31	C(11)	IVIIIVIIVIOIVI				CITE A	ND HT		Y DATA							
32	LOCATION:					SIILA	NAD O I		ELECT	DIC.	DBI	/ERS	HEATING INS	TDIIM	IENIT/ ALA	DM/
33	O INDOOR	O HEATED	. 0	UNDER	ROOF (	Оотро	OR		LLLOII	wo.	Ditit	LINO			OL SHU	
34	UNHEATED	O PARTIAL		O GRA		) MEZZAI			VOLTS					,011111	OL OH	3150VIII
35	O OTHER:								PHASE							
36	O WINTERIZAT	ION REQUIRE	:D O	TROPICA	ALIZATION I	REQ'D			HERTZ							
37	O LOW TEMPE		_		SIVE AGENT						BLE					
38	O ELECTRICAL							0	COOLI							
39	CLASS		DIVISIO								ERATUR	E:	°C MAX	MUM I	RETURN	°C
40	ZONE	GROUP		RATURE I	RATING:						RM.:		-	GN		
41	SITE DATA:		_								ETURN P				kPa	l
42	O ELEVATION		m $\bigcirc$ BA	ROM. PRE	SS		kPa		MAXIM	JM A	LLOWAB	LE PRES	SS. DROP:		kPa	ı
43	O WINTER TEM	IP.	°C	SUMME	R TEMP.		°C		WATER	SOL	JRCE					
44	O REL. HUMIDI	TY	%	DESIGN	WET BULB		°C		VELOC	ITY, r	m/s:	MIN		M	AX	
45	O UNUSUAL CO	ONDITIONS:		DUST	O FUMES	3			FOULIN	IG FA	ACTOR:				m <sup>2</sup> ·	K/kW
46	O OTHER						_	0	UTILITY	COI	NSUMPT	ION:				
47	UTILITY CONDITI	ONS:							COOLIN	NG W	ATER:		m³/h	INST.	AIR	m³/h
48	O AUXILIARY S	TEAM:	N	IAX	NORM	MIN			AUX. S	TM:	NORMA	L	kg/h	MAXIN	мим	kg/h
49	INITIAL PRES	SS.(kPa))	_				_		AUX. D	RIVE	RS: ELE	CTRIC	kW	STEA	М	kW
50	INITIAL TEMP	PERATURE, °	C (TT)				_		HEATE	R(S):			kW	OTHE	R:	
51	EXH. PRESS.	(kPa)	_				_									
52	INST. AIR (kP	a):	NORM	МІ	ΝΜ	AX	_									
53	INSTRUMEN	TAIR DEW PO	DINT:	°C												
54	REMARKS:															
55																

		JOB NOITEM NO					
	SPECIAL-PURPOSE STEAM TURBINE	REVISION NODATE					
	DATA SHEET	PAGE 2 OF 10 BY					
_	SI UNITS						
1	APPLICABLE SPECIFICATIONS:	NOISE SPECIFICATIONS:					
2	ISO 10437 (API 612), SPECIAL PURPOSE STEAM TURBINES	O APPLICABLE TO MACHINE:					
3	O OTHER	SEE SPECIFICATION:  APPLICABLE TO NEIGHBORHOOD:					
4 5	O VENDOR HAVING UNIT RESPONSIBILITY(3.47):	SEE SPECIFICATION:					
6	VENDOR HAVING UNIT RESPONSIBILITY (3.47).	ACOUSTICAL TREATMENT O YES O NO					
7	O GOVERNING SPECIFICATION, IF DIFFERENT:	TYPE					
8	O GOVERNME OF EON TOATION, IT BITTERENT.						
	CONSTRUC	TION FEATURES					
9	TURBINE TYPE OBACKPRESSURE O CONDENSING O INDUCTION						
10 11	SPEEDS:	TORSIONAL CRITICAL SPEEDS (9.5):					
12	MAXIMUM CONTINUOUS r/min TRIP r/min	` '					
12	MAXIMUM ALLOWABLE r/min	SECOND CRITICAL r/min					
14		THIRD CRITICAL r/min					
15	, , ,	FOURTH CRITICAL r/min					
16	SECOND CRITICAL r/min MODE	LATERAL ANALYSIS REPORT REQUIRED					
17	THIRD CRITICAL r/min MODE	O INDIVIDUAL BODY O TRAIN					
18	FOURTH CRITICAL r/min MODE	O UNDAMPED STIFFNESS MAP REQUIRED					
19	☐ VIBRATION µm (PEAK TO PEAK)	TRAIN TORSIONAL ANALYSIS REPORT REQUIRED					
20		TRAIN TORSIONAL PERFORMED BY					
21	CASINGS, NOZZLES & DIAPHRAGMS						
22	MAWP (3.17)(7.1.3)	HYDRO TEST PRESSURE (16.3.2.2)					
23	INLET SECTIONEXH. SECTION(kPa)	HP CASINGMID CASING(kPa)					
24	INDUCTION / EXTRACT. SECTION(kPa)	EXHAUSTCASING OTHER (kPa)					
25	OTHER(kPa)	○ WELDED NOZZLE RING (7.3.1) NOZZLE RING%ADM.					
26	☐ MAX OPERATING TEMP. (3.16)(3.21)	DIAPHRAGM BLADE ATTACH.: INTEGRALLY CAST					
27	INLET SECTION°C EXHAUST SECTION°C	☐ WELDED (7.3.2) ☐ OTHER					
28	INDUCTION / EXTRACTION SECTION °C	DIAPHRAGM AXIAL LOCATION:   INDIVIDUALLY   STACKED					
29							
30	C RELIEF VALVE SETTING: INLET(kPa)(kPa)						
31	EXTRACTION (kPa) OTHER (kPa)						
32	CASING CONNECTIONS	IO IO IO .					
33		FLANGED OMATING FLG. MAXIMUM MINIMUM					
34	CONNECTION SIZE FACING POSTION	OR & GASKET STEAM STEAM					
35 36		STUDDED BY VENDOR FLOW FLOW					
36	INUET.	(7.2.1)(7.2.3) (7.2.7.d) kg/h kg/h					
37 20	INLET EVALUET						
38 39	EXTRACTION EXTRACTION						
ა9 40	INDUCTION	<del>                                     </del>					
<del>4</del> 0 41		<del>                                     </del>					
42	AUX. SCRWD. PIPE CONN.: O TAPERED O STRAIGHT O MAIN CAS	I I I I I I I I I I I I I I I I I I I					
43	ALLOWABLE FORCES & MOMENTS	ROTATION:(VIEWED FROM INLET END)					
44		T./INDUCT. O CW O CCW					
45	FORCE MOMENT FORCE MOMENT FORCE	MOMENT					
46	N N·m N N·m N	N⋅m					
47	PARALLEL	VIEW STEAM					
48	TO SHAFT	$\longrightarrow$ $\lfloor \longrightarrow  vert$					
49	VERTICAL						
50	HORZ. 90°						
51							
<b>5</b> 2		i e e e e e e e e e e e e e e e e e e e					

_			-						
	SDECIAL DUDDOSE STE	AM TUDDINE		JOB NO. ITEM NO. DATE					
	SPECIAL-PURPOSE STE					10 BY			
	SI UNITS		PA	GE	OF	10 BY			
1	MATERIALS-CASINGS & APPURTENANCE	:S:							
2	HIGH PRESSURE CASING			DIAPI	HRAGM/BLADE C	ARRIERS			
3	MID PRESSURE CASING				HRAGM NOZZLES				
4	EXHAUST CASING								
5	STEAM CHEST								
6	☐ NOZZLE RING								
7	O STEAM CONTAMINANTS (11.1.6)								
8	O STEAM PATH COMPONENTS < HRC 2:	2 (11.1.9)							
9									
10	ROTATING ELEMENTS (8)								
11	SHAFT TYPE:								
12	INTEGRAL WHEELS BUILT-UP (8.	1.2) COMBINATION				ER @ COUPLING		mm	
13	DOUBLE EXTENDED			0	STRAIGHT O	TAPER		mm/m	
14	NUMBER OF STAGES BEA	RING SPAN	mm			SINGLE O DO			
15	SHAFT MATERIAL					OINTEGR			
	BLADES(BUCKETS): MAX TIP SPE					NG PROVISIONS			
17	FINAL STAGE BLADE LENGTH	mm MAX	mm		DESCRIPTION O	F FIELD BALANC	ING PROVISIONS	3:	
18 19	-		_	MARKS	<u>.</u>				
20			—   KE	IVIARK	o				
21									
22	STA	AGE STAGE	STA	GF	STAGE	STAGE	STAGE	STAGE	
23	WHEEL MATERIAL	0.7.02	<b>U.</b>		0.7.02	002	002	0.7.02	
24	☐ BLADE MATERIAL								
25	☐ BLADE ROOT TYPE								
26	CLOSURE PIECE TYPE								
27	☐ TIE WIRE MATERIAL								
28	SHROUD MATERIAL								
29	SHROUD ATTACH.								
30	PITCH DIAMETER, mm.								
31	BLADE HEIGHT, mm.								
	BLADE TYPE								
33									
34	<u> </u>							L	
35	SHAFT SEALS (10.5)		1						
36		INLET EXHAUST	CA	SING E	ND SEALS (10.5.	1)			
37	MAX. SEAL PRESSURE, kPa		<b>  </b>	T\/D=		NTU (40.5.4)	OTHER		
38	STEAM LEAKAGE, kg/h  AIR LEAKAGE, m³/h (std cond.)		<b> </b>	TYPE		NTH (10.5.1)	UTHEK		
39 40	SHAFT DIA. @ SEAL, mm		<del> </del>	IVIATE	RIAL:				
40	STATIONARY LABY. TYPE		<del> </del>						
41 42	ROTATING LABY. TYPE		<del> </del>	FPeT.	AGE SEALS (10.5	2).			
43	MATERIAL		<del> </del>  ''''		TYPE: O LAE	•			
44			<del>  </del>		O OTH				
45			<del> </del>		MATERIAL:	· · · · · · · · · · · · · · · · · · ·			
46			<del> </del>						
47			<del></del>	-					
48	REMARKS:								
49									
50									
E4	Ī								

_		T
		JOB NO. ITEM NO.
	SPECIAL-PURPOSE STEAM TURBINE	REVISION NO. DATE
	DATA SHEET	PAGE 4 OF 10 BY
	SI UNITS	
1	BEARINGS AND BEARING HOUSINGS	
2	RADIAL (10.1.1)(10.1.2) INLET EXHAUST	THRUST (10.2.1)(10.2.2)
3	☐ TYPE	ACTIVE INACTIVE
4	MANUFACTURER	□ TYPE
5	LENGTH (mm)	MANUFACTURER
6	SHAFT DIAMETER (mm)	UNIT LOADING MAX. (MPa)
7	UNIT LOAD (ACT/ALLOW), N	UNIT LOAD ULTIMATE (MPa)
8	BASE MATERIAL	NUMBER OF PADS
9	BABBIT THICKNESS (mm)	AREA (mm²)
10	□ NUMBER OF PADS	PIVOT: CENTER / OFFSET, %
11	LOAD: BETWEEN/ON PAD	PAD BASE MATERIAL
12	PIVOT: CENTER/OFFSET %	
13		LUBRICATION: O FLOODED O DIRECTED
14		THRUST COLLAR: O INTEGRAL O REPLACEABLE
	BEARING TEMPERATURE DEVICES:	VIBRATION DETECTORS:
15 16	O THERMOCOUPLES O TYPE	O TYPE
17	SELECTOR SWITCH & INDICATOR BY: PURCH	O MANUFACTURER
18	O RESISTANCE TEMPERATURE DETECTORS	O NUMBER AT EACH SHAFT BRG TOTAL NUMBER
19	O RESISTANCE MATERIAL Ohm	MONITOR CURRILED BY
20	O SELECTOR SWITCH & INDICATOR BY: DIRCH MEE	MONITOR SUPPLIED BY  C LOCATION ENCLOSURE  O MFR MODEL
21	O LOCATION-JOURNAL BEARING	R
22	TOTAL LOCATION	SCALE RANGE ALARM SET @ µm
23	COLE DANCE ALARM SET ® °C	SHUTDOWN: SET @ um O DELAY s
24	SCALE RAINGE ALARM SET @ C	SHOTDOWN. SET @µIII
25	O LOCATION-THRUST BEARING	TYPE MODEL
	ACTIVE SIDE	○ MFR ○ NUMBER REQUIRED
26 27	TOTAL LOCATION	
28	INACTIVE SIDE	MONITOR SUPPLIED BY ENCLOSURE
29	TOTAL LOCATION	O MED MODEL
30	SCALE DANCE ALARM SET @ °C	O MFR
31	SCALE RAINGE ALARM SET @ C	O SHUTDOWN SET @µm O DELAYs
	O MONITOR SUPPLIED BY:	PROVISION FOR ACCELEROMETER MOUNTED ON BRG HOUSINGS
32	O LOCATION ENCLOSURE	
33		
34	○ MFR	REMARKS:
35		
36		
37	-	
38		
39	LUBRICATION AND CONTROL OIL SYSTEM (15.5)	, , , , , , , , , , , , , , , , , , ,
40	REFRENCE SPECIFICATIONS:	OIL REQUIREMENTS: CTRL OIL LUBE OIL
41	FURNISHED BY O TURBINE MFR O OTHERS	NOMINAL FLOW, m³/h
42	SEPARATE FOR TURBINE ONLY	TRANSIENT FLOW, m³/h
43	COMMON W/ DRIVEN EQUIPMENT & INCL (15.5.2)(15.5.5):	PRESSURE, kPa
44		TEMPERATURE, °C
45	TURBINE MANUFACTURER TO SUPPLY:	TOT. HEAT REJ, MW
46	O CONTROL OIL ACCUMULATOR	OIL TYPE, Hydrocarbon/Synthetic
47	O STAINLESS STEEL OIL SUPPLY HEADING PIPING	U VISCOSITY, SSU @ 37.8°C
48	O OIL DRAIN HEADER PIPING	FILTRATION, μm
49	O STAINLESS STEEL O CARBON STEEL	
50	O SIGHT FLOW INDICATORS	
51	CONTROL OIL FILTERS O SINGLE O DUAL	
52	I	1

				JOB NO.			ITEM NO.			
	SPECIAL-PURPOSE STE	_		REVISION N	0		DATE			
	DATA SHEE	T		PAGE 5	5	OF 10	BY			
	SI UNITS									
1			ACC	ESSORIES						
2	COUPLINGS AND GUARDS (15.1.1)(15.1.2									
3	NOTE: SEE ROTATING ELEMENTS-SHAFT									
4	SEE ATTACHED ISO 10441 DATA SHE	ET								
5	COUPLING FURNISHED BY		_							
6	MANUFACTURER	TYF	'E			MODE	L			
7	COUPLING GUARD FURNISHED BY									
8	TYPE O FULLY ENCLOSED O SE	MI OPEN OTHER		1						
9	COUPLING DETAILS			D VENDO		NT 1141 F 001	IDI INO(45.4.0)			
10	☐ MAXIMUM OUTER DIAMETER ☐ HUB MASS		mm				JPLING(15.1.8)	(45.4.0)(45.4.7)		
11	SPACER LENGTH		kg				ADAPTER REQUIRED	(15.1.6)(15.1.7)		
12	SPACER MASS			LUBRICATIO GRE		_		NIE		
13 14	SPACER MASS		kg	QUANTI			kg OR n			
	; 			☐ QUANTI	IY PER	K HUB	kg OK II	11 /11		
	MOUNTING PLATES (15.3)			1						
	BASEPLATES FURNISHED BY:			SOLEPLATE		NISHED BY:				
17	O UNDER TURBINE ONLY O OTHER	·		THICKNESSmmm						
18	O OPEN O NON-SKID DECKING (15.			SUBPLATES REQUIRED (15.3.2.7)						
19	O LEVELING PADS (15.3.2.3) O SU		ALIGN	O HOLD-DOWN BOLTS FURNISHED BY O EPOXY PRIMER VENDOR (15.3.1.7)						
20	O SINGLE SECTION O MULTI-S			C EPOXY	PRIME	R VENDOR (1	5.3.1.7)			
21	O COLUMN MOUNTING (15.3.2.2) O SU		.2.7)				:D D) ( (45.0.4.0)			
22	O LEVELING(CHOCK) BLOCKS REQD	SUPPLIED BY:		O ANCHOR	K BOLI	S FURNISHE	D BY (15.3.1.9):			
	GEAR UNIT(15.2)									
	FURNISHED BY:	O REFERE	NCE ISO	13691	C	OTHER _				
	SEE DATA SHEETS									
26	CONTROL AND INSTRUMENTATION (12.0	)								
27	INSTRUMENTS AND CONTROL PANELS S	HALL BE		O ISO 1043	38, PAC	GES				
28	IN ACCORDANCE WITH THE FOLLOWING			O API 670,						
29	ATTACHED DATA SHEETS:			OPURCHA	ASER'S	DATA SHEE	TS			
30										
31	PROTECTIVE DEVICES									
32		EXHAUST RELIEF	EXTRAC	CT./INDUCT.	\	/ACUUM	NON-RETURN	THERMAL RELIEF		
33		VALVE	RELIE	EF VALVE	Е	BREAKER	VALVE(S)	VALVE(S)		
34		(7.1.3)(15.4.1)(15.4.2)	(7.1.3)(1	5.4.1)(15.4.2)	(	(12.3.1.3)	(12.3.1.4)	(15.4.4)		
35	MOUNTING LOCATION									
36	SET RELIEF PRESSURE, kPa				$/ \setminus$	><				
37	CAPACITY, kg/h STEAM					><<				
38	VALVE MANUFACTURER									
39	VALVE TYPE									
40	VALVE SIZE/RATING									
41	FLANGE FACING (FF, RF)									
42	FURNISHED BY									
43	QUANTITY		ļ					ļ		
44										
45	REMARKS:									
46										
47										
48										
49										
50	I									

							ITEM NO.	_				
	SPECIAL-PURPOSE STEAM	M TURE	BINE		REVISION NODATE							
	DATA SHEET				PAGE	6 OF 10	BY					
	SI UNITS											
1			0	DUPLICA	CATE TRIP / TRIP AND THROTTLE VALVES REQUIRED (12.3.4.2)							
2	LOCATION: O MAIN INLET O INDUC				STRAINER: OPENING SIZE (mm/MESH							
3	PROVIDED BY: O VENDOR OPURCH				MATERIAL							
4 5	☐ MANUFACTURER     MODEL       ☐ SIZE     RATING       FA	CINC			O TEMPORARY START-UP STRAINER (MESH							
6	SIZE RATING FA				OTEM M	AL ATERIAL	HADDNESS	HRC				
7	SIZE RATING FACING				SEAT M.		HARDNESS					
8						G MATERIAL		kg/h				
9	RESET: O MANUAL O HYDRAULIC					SUPPORT OF VALVE						
	TRIP: O LOCAL (MANUAL) O REMOT	L				VENDOR O						
11	EXERCISER: O LOCAL (MANUAL) O RE											
12	_											
13	GOVERNOR-CONTROLLED VALVE(S):	u.										
14	LOCATION	MAIN INI	_ET	INDI	JCTION	INDUCTION	INDUCTION	NOTES				
15						EXTRACTION	EXTRACTION					
16	TRIP POSTION (OPEN/CLOSED)											
17	NUMBER OF VALVES											
18	CONNECTION SIZE											
19	RATING											
20	FACING (RF, RTJ, OTHER)											
21	ACTION (CAM,BAR, OTHER)											
	STEM MATERIAL											
	STEM MATERIAL HARDNESS, HRC											
	SEAT MATERIAL											
	SEAT MATERIAL HARDNESS, HRC											
	PACKING MATERIAL											
27 28	PACKING LEAKOFF, kg/h											
29												
30												
31												
	TURNING GEAR (15.8)				MISCELLAN	EOUS						
33	O TURNING GEAR REQUIRED (15.8.1)				O START-I	UP ASSISTANCE		DAYS				
34	O FURNISHED BY				_	R'S REVIEW & COMME	ENTS ON PURCHASE	R'S				
35	O TYPE(15.8.5)	PEED		r/min	PIPING A	AND FOUNDATION DE	RAWINGS					
36	O ENGAGEMENT(15.8.2)(15.8.3)(15.8.4):	OTUAC	○ MAN	IUAL	O VENDO	R WITNESS INITIAL AL	LIGNMENT					
37	O MANUFACTURER	MODEL			TYPE	E STRAINER						
38	O MOUNTED BY				O WATER	WASHING CONNECT	IONS					
39	39 O DRIVER: REFERENCE SPECIFICATION					CONDUCTING BRUSH	HES					
40	40 DRIVEN BY: OELECTRIC MOTOR OSTEAM TURBINE					OWN ACTIVATES EXH	AUST VACUUM BREA	KER (12.3.1.3)				
41								_				
42	42 O OPERATOR STATION (15.8.7) O LOCAL O REMOTE											
43						OLS (15.9)						
44	44 O BLANKET O OTHER					NG RING AND PLUG	GAUGE					
45	OJACKETING				O HYDRAL	JLIC COUPLING MOU	NTING/REMOVAL KIT					
46	CARBON STEEL STAINLESS STE	EEL			OTHER							
47	O EXTENT					DER BEAM(S)						
48 49					ON PUF	LOAN RCHASE						

		JOB NO. ITEM NO.
	SPECIAL-PURPOSE STEAM TURBINE	
	DATA SHEET	REVISION NODATE
	SI UNITS	PAGE7
<del> </del>		
1	GOVERNOR (12.2)	
2	TYPE O DIGITAL PROCESSOR BASED	O MANUFACTURERMODEL
3	O OTHER	O SUPPLIED BY
4	○ SIMPLEX ○ MULTI-CPU	
5	STEAM TURBINE TYPE	
6	○ SINGLE VALVE SINGLE STAGE	O DOUBLE AUTOMATIC EXTRACTION
7	O SINGLE VALVE MULTISTAGE	O SINGLE AUTOMATIC EXTRACTION / INDUCTION
8	O MUTIVALVE MULTISTAGE	O DOUBLE AUTOMATIC EXTRACTION / INDUCTION
9	○ SINGLE AUTO EXTRACTION	O OTHER
10	DRIVEN EQUIPMENT TYPE	
11	O CENTRIFUGAL COMPRESSOR	O SYCHRONOUS GENERATOR
12	AXIAL COMPRESSOR	O INDUCTION GENERATOR
13	CENTRIFUGAL PUMP	O OTHER
		O OTHER
14	SERVICE REQUIREMENTS	
15	MECHANICAL DRIVE	GENERATOR DRIVE
16	O SPEED CONTROL BY:	O DROOP CONTROL
17	PROCESS VARIABLE O PRESSURE O FLOW	O FREQUENCY CONTROL
18	EXTRACTION O PRESSURE O FLOW	O LOAD CONTROL
19	INDUCTION O PRESSURE O FLOW	○ KW CONTROL
20	TURBINE INLET O PRESSURE O FLOW	O KW IMPORT / EXPORT CONTROL
21	TURBINE EXHAUST O PRESSURE O FLOW	O LOAD SHEDDING
22	OTHER	O AUTOMATIC SYNCHRONIZATION
23		O AUTOMATIC VOLTAGE REGULATION
24		O TURBINE INLET PRESSURE LIMITING
25		○ INLET PRESSURE LIMITER
26	INPUT/OUTPUT REQUIREMENTS	
27	DISCRETE INPUTS	DISCRETE OUTPUTS
28	O START OR RESET	O COMMON SHUTDOWN
29	O NORMAL STOP	O COMMON ALARM
30	© EMERGENCY TRIP	O OVERSPEED TRIPr/min
31	O RAISE SPEED	© REMOTE SPEED SETPOINT ENABLED
	O LOWER SPEED	O PRESSURE CONTROL ENABLED
	© ENABLE/DISABLE REMOTE SPEED SETPOINT	O FLOW CONTROL ENABLED
	O RAMP TO MINIMUM CONTINUOUS	© EXTRACTION CONTROL ENABLED
	O OVERSPEED TEST ENABLE	O INDUCTION CONTROL ENABLED
36		O SPEED PICKUP ALARM
37	© ENABLE EXTRACTION CONTROL	OTHER
38	REMOTE ALARM CLEAR/ACKNOWLEDGE	
39	© ENABLE AUTO SYNCHRONIZE	
40	1 £	ANALOG OUTPUTS (4 mA to 20 mA)
41	OTHER	_ ○ SPEED
42	ANALOG INPUTS (4 mA to 20 mA)	○ SPEED SETPOINT
43	REMOTE SET POINT	© REMOTE SPEED SETPOINT
44	O PROCESS PRESSURE	© EXTRACTION PRESSURE
45	EXTRACTION     PRESSURE    FLOW	© EXTRACTION PRESSURE SETPOINT
46	○ kW IND. LOAD ○ PRESSURE ○ FLOW	O ACTUATOR POSITION
47	kw import / export	O PROCESS PRESSURE
48	OTHER	○ kW
49		O kW IMPORT/EXPORT
50		
51		

		JOB NO. ITEM NO.
	SPECIAL-PURPOSE STEAM TURBINE	DEVICION NO.
	DATA SHEET	PAGE 8 OF 10 BY
	SI UNITS	
1	GOVERNOR INSTALLATION REQUIREMENTS	
2	LOCATION O LOCAL (AT TURBINE)	MOUNTING OFLUSH MOUNT IN PANEL OSURFACE MOUNT
3	REMOTE (CONTROL ROOM)	O VERTICAL RACK
4	O OTHER	POWER SOURCE SINGLE DUAL
5	O AREA CLASSIFICATION:	120 V (a.c.)
6	CLASS GROUP DIVISION	220 V (a.c.)
7	ZONEGROUPTEMP. RATING:	125 V (d.c.)
8	ENCLOSURE O IP65	24 V (d.c.)
9	O NEMA 4	
10	O NEMA 4X O OTHER	
11		
12	LOCAL GOVERNOR CONTROL PANEL ORQUIRED	O NOT REQUIRED
13 14	LOCATION O LOCAL (AT TURBINE) O REMOTE CONTROL ROOM	ENCLOSURE O IP65 O NEMA 4 O NEMA 4X
15	O OTHER	O OTHER
16	O OTHER	O AREA CLASSIFICATION:
17	OUTPUTS FROM PANEL TO GOVERNOR	CLASS GROUP DIVISION
18	O START	ZONE GROUP TEMP. RATING:
19	O TRIP	INPUTS TO PANEL FROM GOVERNOR
20	O RAISE	○ COMMON ALARM TRIP
21	OLOWER	○ TRIP LAMP
22	O OVERSPEED TEST	REMOTE SETPOINT ENABLED LAMP
23	O RAMP TO MINIMUM CONTINUOUS	SPEED SETPOINT METER
24	REMOTE SETPOINT ENABLE/DISABLE	OTHER
25	O RESET	
26	O OTHER	
27	MISCELLANEOUS GOVERNOR DETAILS	
28	GOVERNOR ACTION ON LOSS OF REMOTE SIGNAL:	O LOCKS ON LAST VALUE
29		GOES TO MINIMUM CONTINUOUS
30		O GOES TO MAXIMUM CONTINUOUS
31 32	EXTERNAL INTERFACE DEVICE TYPE: O PRINTER FOR	RMAT: O GRAPHIC DISPLAY
33	O CRT	O TABULAR DATA
34	O MODEM	O TRENDING (REAL TIME)
35		O HISTORICAL ARCHIVING
36	O DISTRIBUTIVE CONTROL SYSTEM MANUFACTURER	O MODEL_
37	DATA TRANSMISSION O DATA LINK	O PROTOCOL_
38	O DISCRETE I/O	
39	O NETWORK TYPE	
40		
41	GOVERNOR SPEED PICKUP SENSORS(12.2.6):	INICIALIATION, O DUAL O TRIBLE O MATERIALE
42	MANUFACTURER MODEL  NUMBER OF TEETH IN SPEED SENSING SURFACE	INSTALLATION: O DUAL O TRIPLE O INSTALLED SPARE
43 44	NOWIDER OF TEETH IN SPEED SENSING SURFACE	
45	ACTUATOR(S): SUPPLIED BY	O MANUFACTURER O MODEL
45	· ·	GLE COIL O MULTI COIL O OTHER
46		
47	TURBINE MOUNTED ACCESSORIES	
48	TACHOMETER O MANUFACTURER	O MODEL O NUMBER REQUIRED.
49	O LOCATION(S)	
50		
51		

_												
						JOB NO.		ITEM	NO			
	SPECIA		OSE STE		BINE	REVISION	_	DATE				
			TA SHEE	ı		PAGE _	9	OF <u>10</u> BY _				
1	OVERSPEED SH											
2	O FURNISHED		01EM (12.5)			O NUME	RER OF T	EETH IN SPEED SEN	ISING SURFACE			
3	O MANUFACTI			Омо	DEL	O SOLE			DE-ENERGIZE TO TRIP			
4	☐ ELECTRONI		Т		-	r/min	· I					
5	OVERSPEE	D SHUTDOWI	N REQUIREM	ENTS		О сонт	CONTACTS SHALL BE: NORMALLY OPEN					
6	O 2 OUT OF 3					0 1	NORMALLY CLOSED					
7	O OTHER					O VOLT	AGE LEVI	EL:				
8											_	
9												
10	GLAND SEALING	G AND VACU	`									
11	SYSTEM PER:	_		ANNEX G.2			_	CUUM SYSTEM FU				
12		OTHER	-						SKID MOUNTED			
	O AVAIL. HEAD				TEMPER		_	THER	255 255 255 255 255			
	O AVAILABLE					kPa °C	_	,	SEE SPECIFICATION	L-D-		
15 16	SEAL. STM.			_	FLOW	kg/h	O 5		STEAM PRESS	kPa	kg/h	
17	SEALING ST			_		kPa	O v		STEAM TEOW 2), SEE SPECIFICATION		Kg/i	
18	O FURNISHED		VALVE CETT	RECOURE		-	_	ONDENSATE RECEI		· ——		
19	☐ FLOW ADJU		ES, TYPE				_	OP SEAL HEIGHT	. —		m	
20	O FURNISHED		-,								_	
21					INSPECTIO	N AND TESTING	(16.2) (16	.3)				
22	GENERAL							MECHANICAL RU	NNING TEST (16.3.3)			
23	O SHOP INSPE	ECTION (16.1.	.4)						OBS	SVD W	/IT	
24	EXTENT:							O CONTRACT F	OTOR C		$\supset$	
25	O REFERENCE	E INSPECTIO	N CHECKLIST	Γ "Ι"				SPARE ROTO			_	
26								O TEST W/JOB			_	
27	INSPECTION AN							_	ECORD REQUIRED	_	_	
28	O FINAL ASSE			`	,			O TEST TAPE G	_		_	
29			PECTION & TE		1	1		O TEST W/JOB	LUBE OIL CONSOLE		_	
30	COMPONENT	MAG PART	DYE PEN	R.T.	U.T.	OBSVD	WIT	<u> </u>		, (	)	
31 32	TRIP & T & T VALVE	0	0	0			0	OPTIONAL TESTS	(16 3 4)			
33	STM CHEST	0	0	0	0	0	0		(10.01.)	OBSVD	WIT	
34	CASING	0	0	0	0	Ö	Ö	O PERFORMAN	CE (16.3.4.2)	0	0	
35	PIPING	0	0	0	0	0	$\circ$	O COMPLETE U	, ,	0	0	
36	ROTOR	0	0	0	0	0	$\circ$		, ,		$\circ$	
37						0	$\circ$	AUXILIARY EQUIF	MENT (16.3.4.4)			
38	O HEAT STABI	ILITY (16.2.2)				0	$\circ$	O TRIP/TRII	& THROTTLE VALVE	$\circ$	$\circ$	
39	O CLEANLINES	SS (16.2.3.3)				$\circ$	$\circ$	O GLAND S	EAL SYSTEM	$\circ$	$\circ$	
40	O HARDNESS	(16.2.3.4)				$\circ$	$\circ$	O GLAND V	ACUUM SYSTEM	$\circ$	0	
41	O HYDRO TES	STS (16.3.2)				$\circ$	$\circ$	O RELIEF V	ALVES	$\circ$	0	
42	O BLADE SHA	KER (STATIC	)			0	0	<u> </u>		0	0	
43	ROTOR BALANC	_	ANDARD (9.6.			0	0		RNAL INSP (16.3.4.5)	0	0	
44		_	H SPEED (9.6			0	0		SHAFT FIT (ISO 1044		0	
45					SPEED(9.6.6	· _	0	O TURNING GE		0	0	
46	C EIN				ALANCE CHE	,	0		SHUTDOWN SYSTEM	0	0	
47	O FINAL SURF		, ,			0	0	SOUND (16.3.	RESPONSE (16.3.4.10)	0	0	
48 49	<ul><li>CRATING IN</li><li>SPARE ROT</li></ul>		10.4.1)			0	0		4.11) S TESTS (16.3.4.7)	0	0	
49 50	CASING JOI		ST (16 3 2 2)			0	0	O SPARE PART	0 12010 (10.0.4.7)	0	0	
51	CASING JOI	IVI LEAN IEC	71 (10.0.2.0)			0	0	l		0	0	

		JOB	NO. ITEM NO.
	SPECIAL-PURPOSE STEAM TURBINE	REVI	ISION NODATE
	DATA SHEET	PAG	E 10 OF 10 BY
	SI UNITS		
1	MISCE	LLAN	IEOUS
2	PAINTING		WEIGHTS:
3	MANUFACTURER'S STANDARD		TURBINEkg
4	O OTHER		ROTORkg
5	0		TURBINE UPPER HALF CASING kg
6	UNIT NAMEPLATE UNITS O U.S. CUSTOMARY O SI		MAXIMUM FOR MAINTENANCE (IDENTIFY) kg
7	SHIPMENT (16.4.1)(16.4.3.j)		TRIP / TRIP & THROTTLE VALVEkg
8	O DOMESTIC O EXPORT		MISCELLANEOUSkg
9	<ul><li>EXPORT BOXING REQD.</li><li>OUTDOOR STORAGE OVER 6 MONTHS</li><li>WATERPROOF BOXING REQUIRED</li></ul>		TOTAL SHIPPING MASSkg
10	l _		
11	SPARE ROTOR ASSEMBLY PACKAGED FOR:     HORIZONTAL STORAGE     VERTICAL STORAGE		
12 13	SPACE REQUIREMENTS:		VENDOR DRAWING & DATA REQUIREMENTS (17)
14	COMPLETE UNIT: L mm W mm H		O ANNEX J
15		-	OTHER
16	OTHER: L mm W mm H	mm	
17	OTHER: L mm W mm H	mm	
	REMARKS AND ADDITIONAL REQUIREMENTS:		
18 19	REMARKS AND ADDITIONAL REQUIREMENTS:		
20			
21			
22			
23			
24			
25			
26			
27			
28			
29			
30			
31			
32			
33			
34			
35			
36			
37			
38			
39			
40			
41			
42			
43			
44			
45			
46			

_															
	ĺ							J	OB NO.			ITEM NO.			
								PURCHASE ORDER NO.							
								SPECIFICATION NO.							
	SPE	CIAL-PUR			URBINI	E		R	EVISION NO.			DATE			
			ATA SHE					P.	AGE 1	OF	10	BY			
		US CUS	<b>TOMARY</b>	UNITS											
1	APPLICABLE TO:	0	PROPOSAL	. 01	PURCHAS	E	O AS	S-BU	JILT						
2	FOR							UN	NIT						
3	SITE							SE	RIAL NUMBE	R					
4	SERVICE							NU	JMBER REQU	IRED					
5	MANUFACTURER	<u></u>			MODEL					IVEN EQUI	PMENT I	TEM NO.			
6	DRIVEN EQUIPME	ENT TYPE:	Осо	MPRESSO		GENERA			O OTHER						
7	NOTE: INFORMATION TO BE COMPLETED BY: O PURCHASER						R		MANUFACT	URER	D PL	JRCHASER OR M	MANUFACTUR	ER	
8							PERFO	DRM	IANCE						
9	OPERATING POIN	NTS	SHAI	FT		INLET			INDUCTIO	ON/EXTRA	CTION		EXHAUST		
10	AS APPLICAE	BLE	POWER	SPEED	FLOW	PRESS	TEM	ΛP	FLOW	PRESS	TEMP	PRESS	TEMP	ENTHALPY	
11			hp	r/min	lb/h	psig	°F (T	ΓT)	lb/h	psig	°F (TT)	psig/in HgA	°F (TT)	Btu/lb	
12	RATED														
13	NORMAL (3.26) (6	i.1.4)													
14	MINIMUM														
15															
16	STEAM RATE	, lb/hp-h (3.44)	):	NOR	MAL	RAT	ED		IND	UCTION	0	CONTROLLED	O UNC	ONTROLLED	
17	POTENTIAL N	MAXIMUM PO	WER (3.30)						EX	TRACTION	0	CONTROLLED	O UNC	ONTROLLED	
18						ST	ЕАМ С	ONI	DITIONS						
19			O INL	.ET		EXHAUST		T	O EXTRAC	TION	OE	XTRACTION	O EX	CTRACTION	
20													NDUCTION		
21		MAXIMUM													
22	FLOW	NORMAL													
23	lb/h	MINIMUM													
24		MAXIMUM													
25	PRESSURE	NORMAL													
26	psig	MINIMUM													
27		MAXIMUM													
28	TEMPERATURE	NORMAL													
29	°F (TT)	MINIMUM													
30					-	CITE	ANDI	ITII	ITY DATA						
31	LOCATION:					3111	AND		ELECTRIC:	DRIVI	EDS	HEATING INS	STRUMENT/ A	U ADM/	
32	O INDOOR	O HEATED	$\circ$	LINDED	ROOF C	) OUTDO	<b>1</b> P		LLLCTRIC.	DIVIVI	LING		CONTROL S		
33	O UNHEATED	O PARTIAL				MEZZAN			VOLTS				JOINTINOL O	HOLDOWN	
34	OTHER:	O 17411112	OIDEO O	OIVIDE	Ŭ	WILLES VI			PHASE					<del></del>	
35	O WINTERIZATI	ION REQUIRE	D O	TROPICA	ALIZATION	RFQ'D			HERTZ					<del></del>	
36	O LOW TEMPER		_		SIVE AGEN				KW AVAILAI	BI F				<del></del>	
37	O ELECTRICAL							0	COOLING W						
37	CLASS	GROUP	DIVISIO	N					INLET TEMP			°F MAXIMU	JM RETURN	°F	
38		GROUP		RATURE F	RATING:				PRESSURE			psig	DESIGN:	psig	
39	SITE DATA:								MINIMUM R					psig	
40	O ELEVATION		FT () BAI	ROM. PRE	SS	psia	/HgA					SURE DROP:		psi	
41	O WINTER TEM		-	SUMMER			°F		WATER SOL					r	
42	O REL. HUMIDI				WET BULE		°F		VELOCITY,		MIN		MAX		
43	O UNUSUAL CO				OFUMES		•		FOULING FA					n·ft².°R/Btu	
44	OOTHER		_						UTILITY CO		DN:		·		
45	UTILITY CONDITION	ONS:						$\bigcup$	COOLING W			GPM	INST. AIR	SCFM	
46	O AUXILIARY S		M	IAX	NORM	MIN			AUX. STM:				MAXIMUM	lb/h	
47	INITIAL PRES								AUX. DRIVE		TRIC		STEAM	hp	
48	"							HEATER(S):				OTHER:	<b>P</b>		
49		ESS. (psig/in l							(0)				-		
50	INSTRUMENT		NORM	MIN	I MA	λX									
51		ΓAIR DEW PO		°F											
52	REMARKS:														
52															
	1														

	ODEOLAL	DUDD	005.0	A BA TI	IDDINE		JOB NO.		-	TEM NO.		
	SPECIAL				IKRINE		REVISION N			DATE		
			TA SHE				PAGE :	2 (	OF <u>10</u> E			
-	1			Y UNITS								
1	APPLICABLE SPECI						NOISE SPEC					
2	ISO 10437 (API 612),	SPECIAL	. PURPOSE	STEAMIL	IRBINES		O APPLICA					
3	OTHER					<del></del>	SEE SPI			NOD:		
5	O VENDOR HAVIN	C LINIT D	FODONOIS	ULITV/2 47\.		<del></del>	SEE SPI		) NEIGHBORHC	JOD:		
6	VENDOR HAVIN	G UNIT K	ESPUNSIE	DILIT (3.47).					TMENT OY	res O no		
7	GOVERNING SP	ECIEICAT	TION IE DI	CEEDENT:			TYPE					
8	O GOVERNING SF	ECIFICAI	HON, IF DI	FFERENI.								
						ONOTOLIC	TION SEATIN	250				
9	TURBINE TYPE	DA OKDE	SECOLIDE	OONDE			TION FEATU					
10		BACKPR	RESSURE	O CONDE	NSING U	INDUCTIO						
11	SPEEDS:			, ,	TO:0	, .			ITICAL SPEEDS	3 (9.5):		
12	MAXIMUM CONT			r/min	TRIP	r/min			-			r/min
13	MAXIMUM ALLO			_			SECONI		-			r/min
14	LATERAL CRITIC		•	,, ,			THIRD C		-			r/min
15	FIRST CRITICAL		r/			MODE	_		AL			r/min
16	SECOND CRITIC					MODE			YSIS REPORT			
17	THIRD CRITICAL		r/			MODE			BODY O T			
18	FOURTH CRITIC	AL	r/	min	(55.11.7	MODE			FFNESS MAP F			
19	☐ VIBRATION			mil	(PEAK I	TO PEAK)				REPORT REQUI	RED	
20 21	CASINGS, NOZZ	I ES & DI	IVDHDVCI	18			□ TRAIN	ORSIO	NAL PERFORM	ED RA		
22			AFTIKAGI	10			LIVERO	TECT D	DESCUDE (16.3	2.2)		
23	MAWP (3.17) (7.1		noia F	VII SECTIO	N.I	noia			RESSURE (16.3	,		noia
24	INLET SECTION INDUCTION / EX					psig			psig NG p			psig
25	OTHER		BECTION	-		psig	_			sig OTHER NOZZLE RIN		
26	MAX OPERATING		(3.16)(3.21	١		psig			` ′	INTEGR		-
27	INLET SECTION				)N	°E	WELDER			OTHER		
28	INDUCTION / EX		-				WELDE!	J (1.5.2)				
29						' °F	DIAPHRAGM	ΙΔΧΙΔΙ Ι	OCATION:	INDIVIDUALI	ıy 🗆	STACKED
30	RELIEF VALVE S					psig	DIAI TII (AOI)		LOOATION.	IIVDIVIDOALI		OTAORED
31	EXTRACTION	LITINO.	psig	OTHER		psig psig						
	CASING CONNECTION	ONS										
33	CAGING COMILECTIO				0		FLANGE	.D	O MATING F	IG MAY	XIMUM	MINIMUM
34	CONNECTION		SIZE	FACING		STION	OR	.0	& GASKE		EAM	STEAM
35	CONNECTION		OIZL	TAOINO	10	31101	STUDDE	:D	BY VEND		OW	FLOW
36							(7.2.1) (7		(7.2.7.d		o/h	lb/h
37	INLET	_	+				( , ( /	,	(1.2.7.0	, 10		127.1
38	EXHAUST											
39	EXTRACTION											
40	INDUCTION											
41												
42	AUX. SCRWD. PIPE (	CONN.: (	O TAPERI	D OSTR	AIGHT O	MAIN CAS	SING JOINT S	TUDS / N	UTS DESIGNE	D FOR HYD. TE	NSIONIN	G (7.1.15.f)
43	ALLOWABLE FO									ROM INLET EN		
44		II	NLET	EXI	HAUST	EXTRAC	T. / INDUCT.	_	cw O ccw		-	
45		FORCE	MOMEN'	T FORCE	MOMENT	FORCE	MOMENT					
46		lb	ft-lb	lb	ft-lb	lb	ft-lb					7
47	PARALLEL		-	<u>'</u>			-	VIE	:W		STEAM	
48	TO SHAFT							_	$\longrightarrow$			>
49	VERTICAL									_		
50	HORZ. 90°											
I	I			•								
51												

+1012470101010101-

					IOB NO.	-			ITEM NO	). 			
	SPECIAL-PURPOSE		JRBINE		REVISION NO.         DATE           PAGE 3 OF 10 BY         BY								
	DATA S US CUSTOM			F	PAGE	3	OF	10	ВҮ				
	MATERIALS-CASINGS & APPURTE												
1	HIGH PRESSURE CASING	NANCES:		ſ		HRAGM/BL	4DE C	NADDIEDO					
3	MID PRESSURE CASING  —				_	HRAGM NO							
4	EXHAUST CASING												
5	STEAM CHEST				01111	ER							
6	NOZZLE RING												
7	STEAM CONTAMINANTS (11.1.6	3)											
8	STEAM PATH COMPONENTS <												
9		,			-								
10	ROTATING ELEMENTS (8)												
11	SHAFT TYPE:												
12	☐ INTEGRAL WHEELS ☐ BUILT	Γ-UP (8.1.2)	COMBINATION	[	SHAF	T ENDS: D	IAMET	TER @ CO	UPLING		in		
13	☐ DOUBLE EXTENDED				$\circ$	STRAIGH	т О	TAPER			in/ft		
14	☐ NUMBER OF STAGES	BEARING SF	PAN	in		KEYED							
	SHAFT MATERIAL									AL FLANGE			
	BLADES(BUCKETS): MAXI									REQUIRED (8.1.4			
17	☐ FINAL STAGE BLADE LENGTH		MAX	in		DESCRIP	TION C	OF FIELD E	BALANCI	NG PROVISION	S:		
18	REMARKS:												
19				F	REMARK	S:							
20													
21	ļ							T			T		
22 23	☐ WHEEL MATERIAL	STAGE	STAGE	SI	AGE	STAC	jΕ	STA	GE	STAGE	STAGE		
23	BLADE MATERIAL							1			1		
25	BLADE ROOT TYPE												
26	CLOSURE PIECE TYPE												
27	☐ TIE WIRE MATERIAL							<del> </del>					
28	SHROUD MATERIAL										1		
29	SHROUD ATTACH.												
30	☐ PITCH DIAMETER, in												
31	BLADE HEIGHT, in							1					
	BLADE TYPE												
33													
34													
35	SHAFT SEALS (10.5)										•		
36	, ,	INLET	EXHAU	ST C	CASING I	END SEALS	S (10.5	i.1)					
37	MAX. SEAL PRESSURE, psig						`	,					
38	STEAM LEAKAGE, lb/h				TYPE	: O L	ABYRI	INTH (10.5	.1) 🔘	OTHER			
39	☐ AIR LEAKAGE, SCFM				MATE	ERIAL:				_			
40	SHAFT DIAMETER @ SEAL, in					_							
41	STATIONARY LABY. TYPE					_							
42	ROTATING LABY. TYPE				NTERST	AGE SEAL	S (10.5	5.2):					
43	☐ MATERIAL					TYPE: (							
44						(	то С	HER					
45						MATERIA	L:						
46					-								
47													
48	REMARKS:												
49													
50													
51	1												

				IODNO ITEMNO					
-	SPECIAL-PURPOSE S	STEAM TURE	INF	JOB NO. ITEM NO. REVISION NO. DATE					
	DATA SH			PAGE 4 OF 10 BY					
	US CUSTOMAR			1 AGE GI					
1	BEARINGS AND BEARING HOUSINGS								
2	RADIAL (10.1.1)(10.1.2)	INLET	EXHAUST	THRUST (10.2.1)(10.2.2)					
3	TYPE			ACTIVE INACTIVE					
4	MANUFACTURER			☐ TYPE					
5	LENGTH (IN)			MANUFACTURER					
6	SHAFT DIAMETER (IN)			UNIT LOADING MAX. (psi)					
7	UNIT LOAD (ACT/ALLOW)(PSI)			UNIT LOAD ULTIMATE (psi)					
8	☐ BASE MATERIAL			NUMBER OF PADS					
9	BABBIT THICKNESS (IN)			AREA (IN²)					
10	NUMBER OF PADS			PIVOT: CENTER / OFFSET, %					
11	LOAD: BETWEEN/ON PAD			PAD BASE MATERIAL					
12	☐ PIVOT: CENTER/OFFSET %								
13				LUBRICATION: O FLOODED O DIRECTED					
14				THRUST COLLAR: O INTEGRAL O REPLACEABLE					
	BEARING TEMPERATURE DEVICES:			VIBRATION DETECTORS:					
16	O THERMOCOUPLES O TYPE			O TYPE					
17			PURCH	O MANUFACTURER					
	O RESISTANCE TEMPERATURE DET			O NUMBER AT EACH SHAFT BRGTOTAL NUMBER					
19	O RESISTANCE MATERIAL			MONITOR SUPPLIED BY					
20	_	FOR BY:	PURCHMFI	R O LOCATIONENCLOSURE					
	O LOCATION-JOURNAL BEARING			O MFR MODEL					
22 23				SCALE RANGE ALARM SET @ mil					
23		_		○ SHUTDOWN: □SET @mil ○ DELAYs  AXIAL POSITION DETECTORS:					
	SHUTDOWN SET @  O LOCATION-THRUST BEARING	F DELA	ss	TYPE MODEL					
26	ACTIVE SIDE			O MFR O NUMBER REQUIRED					
27	TOTAL LOCA	MOITA		MONITOR SUPPLIED BY					
28	INACTIVE SIDE		-	O LOCATION ENCLOSURE					
29	TOTAL LOCA	ATION		O MFR					
30	SCALE RANGE AL	_ARM SET @	°F	○ MFR         □ MODEL           □ SCALE RANGE         ALARM         □ SET @ mil					
31	SHUTDOWN SET @	°F DELA	Y s						
32	O MONITOR SUPPLIED BY:			PROVISION FOR ACCELEROMETER MOUNTED ON BRG HOUSINGS					
33	OLOCATION	ENCLOSURE		KEYPHASOR: O STEAM TURBINE O GEAR O DRIVEN EQUIP.					
34	O MFR.	MODEL		REMARKS:					
35		<del>-</del>							
36									
37									
38				3.5					
39	LUBRICATION AND CONTROL OIL SYS	STEM (15.5)							
40	REFRENCE SPECIFICATIONS:			OIL REQUIREMENTS: CTRL OIL LUBE OIL					
41	FURNISHED BY O TURBINE MFR	OTHERS		NOMINAL FLOW, U.S. gal/min					
42	SEPARATE FOR TURBINE ONL			TRANSIENT FLOW, U.S. gal/min					
43	COMMON W/ DRIVEN EQUIPM	IENT & INCL (15.5.2	2) (15.5.5):	PRESSURE, psig					
44				TEMPERATURE, °F					
45	TURBINE MANUFACTURER TO SUPPLY			TOT. HEAT REJ, Btu/h					
46	O CONTROL OIL ACCUMULATOR			OIL TYPE, Hydrocarbon/Synthetic					
47	O STAINLESS STEEL OIL SUPPLY	Y HEADING PIPING	3	☐ VISCOSITY, SSU @ 100°F					
48	O OIL DRAIN HEADER PIPING			FILTRATION, microns					
49	O STAINLESS STEEL O								
50	O SIGHT FLOW INDICATORS								
51	CONTROL OIL FILTERS O SING	ile O DUAL		<sup>□</sup>					
52									

_				Ī						
				JOB NO.		ITEM NO.				
	SPECIAL-PURPOSE STE	AM TURRINE		REVISION N	າ	DATE				
	DATA SHEE				5 OF 10	BY				
	US CUSTOMARY			FAGE .	OF 10					
1	I SO COOTOMAKT	ONTO	400	ESSORIES						
	COUPLINGS AND GUARDS (15.1.1)(15.1.2	1	ACC	ESSURIES						
2										
3	NOTE: SEE ROTATING ELEMENTS-SHAFT									
4	O SEE ATTACHED API 671 DATA SHEET									
5	COUPLING FURNISHED BY		_							
6	MANUFACTURER	TYF	'E		MODEL	-				
7	COUPLING GUARD FURNISHED BY									
8		SEMI OPEN C	OTHER	1						
9	COUPLING DETAILS									
10	MAXIMUM OUTER DIAMETER		in		R MOUNT HALF COU	` ,				
11	HUB WEIGHT		lb			ADAPTER REQUIRED	(15.1.6) (15.1.7)			
12	SPACER LENGTH		in		N REQUIREMENTS	_				
13	SPACER MASS		lb		ASE CONT.	OIL LUBE O NO	NE			
14				QUANTI	TY PER HUB	lb OR U	.S. gal/min			
15	MOUNTING PLATES (15.3)			-						
16	BASEPLATES FURNISHED BY:			SOLEPLATE	S FURNISHED BY:					
17	O UNDER TURBINE ONLY O OTHER	(15.3.2.1)		THICKNI	ESS	-	IN.			
18	O OPEN O NON-SKID DECKING (15.		M	O SUBPLA	TES REQUIRED (15.	3.2.7)	_			
19	O LEVELING PADS (15.3.2.3) O SUI				OWN BOLTS FURNIS					
20	O SINGLE SECTION O MULTI-S				PRIMER VENDOR (15					
21	O COLUMN MOUNTING (15.3.2.2) O SUI		27)	2. 0/11	2	,				
22		SUPPLIED BY:	.2.7 )	O ANCHOE	R BOLTS FURNISHE	) RV (15 3 1 9)·	<del></del>			
		0011 EIED D1.		O ANOHOI	( BOETO I OTTINOTIEE	<u> </u>				
	GEAR UNIT(15.2)	O			O					
	FURNISHED BY:	O REFERE	ENCE API	613	O OTHER					
25										
26	CONTROL AND INSTRUMENTATION (12.0	)								
27	INSTRUMENTS AND CONTROL PANELS S	HALL BE			APPENDIX B, PAGES					
28	IN ACCORDANCE WITH THE FOLLOWING			O API 670 APPENDIX D, PAGES						
29	ATTACHED DATA SHEETS:			O PURCHASER'S DATA SHEETS						
30										
31	PROTECTIVE DEVICES					<del></del>				
32		EXHAUST RELIEF	EXTRA	CT./INDUCT.	VACUUM	NON-RETURN	THERMAL RELIEF			
33		VALVE		EF VALVE	BREAKER	VALVE(S)	VALVE(S)			
34		(7.1.3)(15.4.1)(15.4.2)		5.4.1)(15.4.2)	(12.3.1.3)	(12.3.1.4)	(15.4.4)			
35	MOUNTING LOCATION	(,(,(,(,(,(,	()(1	,()	(3)	(======)	(1-2111)			
36	SET RELIEF PRESSURE, psig									
37	CAPACITY, Ib/h STEAM									
38	VALVE MANUFACTURER		<del>                                     </del>							
39	VALVE TYPE									
40	VALVE TIFE VALVE SIZE/RATING		1							
41	FLANGE FACING (FF, RF)		<del>                                     </del>							
	FURNISHED BY									
42			<del>                                     </del>							
43	QUANTITY									
44	DEMARKS.	l .	<u>I</u>			l	l			
45	REMARKS:									
46										
47										
48										
49										
50										

					JOB NO.		ITEM NO.				
	SPECIAL-PURPOSE STEAI	M TURE	BINE		REVISION NODATE						
	DATA SHEET				PAGE	6 OF 10	BY				
	US CUSTOMARY UN										
1	○ TRIP ○ TRIP & THROTTLE VALVES		C	DUPLICA	CATE TRIP / TRIP AND THROTTLE VALVES REQUIRED (12.3.4.2)						
2	LOCATION: O MAIN INLET O INDUC				STRAINER: OPENING SIZE (in/MESH						
3	PROVIDED BY: O VENDOR OPURCH				MATERIAL  TEMPORARY START-UP STRAINER (MES						
4	MANUFACTURER MODEL						AINER	(MESH)			
5 6	SIZE RATING FA				MATERI	AL ATERIAL	HADDNESS	HRC			
7	SIZE RATING FA				SEAT M		HARDNESS				
8				INDUCT		G MATERIAL		lb/h			
9	RESET: O MANUAL O HYDRAULIC		IIVEET	1110001.		SUPPORT OF VALVE					
	TRIP: O LOCAL (MANUAL) O REMO					VENDOR O					
11	EXERCISER: O LOCAL (MANUAL) O RE				· 5.		21101101110211				
12	_										
	GOVERNOR-CONTROLLED VALVE(S):										
14	LOCATION	MAIN IN	LET	IND	JCTION	INDUCTION	INDUCTION	NOTES			
15						EXTRACTION	EXTRACTION				
16	TRIP POSTION (OPEN/CLOSED)										
17	NUMBER OF VALVES										
18	CONNECTION SIZE										
19	RATING										
20	FACING (RF, RTJ, OTHER)										
21	ACTION (CAM,BAR, OTHER)										
22	STEM MATERIAL										
23	STEM MATERIAL HARDNESS, HRC										
	SEAT MATERIAL										
	SEAT MATERIAL HARDNESS, HRC										
	PACKING MATERIAL										
	PACKING LEAKOFF, lb/h										
28											
29											
30 31											
	TURNING GEAR (15.8)				MISCELLAN	FOUS					
	TURNING GEAR REQUIRED (15.8.1)					UP ASSISTANCE		DAYS			
34	O FURNISHED BY				_	R'S REVIEW & COMME	ENTS ON PURCHASE	<del></del>			
35		PEED		r/min		AND FOUNDATION DE					
36	O ENGAGEMENT(15.8.2)(15.8.3)(15.8.4):	AUTO	O MAI	NUAL	O VENDO	R WITNESS INITIAL AL	IGNMENT				
37	O MANUFACTURER	MODEL				E STRAINER					
38	O MOUNTED BY				O WATER	WASHING CONNECT	IONS				
39						CONDUCTING BRUSH					
40	DRIVEN BY: OELECTRIC MOTOR OSTEAM TURBINE					OWN ACTIVATES EXH	AUST VACUUM BREA	KER (12.3.1.3)			
41	11 (15.8.5) OHYD./PNEU. MOTOR OTHER:										
42	42 O OPERATOR STATION (15.8.7) O LOCAL O REMOTE										
43	43 INSULATION & JACKETING (15.7)					OLS (15.9)					
44						NG RING AND PLUG	GAUGE				
45	O JACKETING				O HYDRAI	JLIC COUPLING MOU	NTING/REMOVAL KIT				
46	○ CARBON STEEL ○ STAINLESS STE	EEL			OTHER						
47	O EXTENT					DER BEAM(S)					
48 49					ON PUF	LOAN RCHASE					

		1
		JOB NOITEM NO
	SPECIAL-PURPOSE STEAM TURBINE	REVISION NO. DATE
	DATA SHEET	PAGE 7 OF 10 BY
	US CUSTOMARY UNITS	
1	GOVERNOR (12.2)	
2	TYPE O DIGITAL PROCESSOR BASED	
3	OTHER	O SUPPLIED BY
4	O SIMPLEX O MULTI-CPU	
5	STEAM TURBINE TYPE	
6	O SINGLE VALVE SINGLE STAGE	O DOUBLE AUTOMATIC EXTRACTION
7	O SINGLE VALVE MULTISTAGE	SINGLE AUTOMATIC EXTRACTION / INDUCTION
8	MUTIVALVE MULTISTAGE	O DOUBLE AUTOMATIC EXTRACTION / INDUCTION
9	SINGLE AUTO EXTRACTION	O OTHER
	DRIVEN EQUIPMENT TYPE	9 OTTEN
10		O AVOLDONOLIO OFNEDATOR
11	CENTRIFUGAL COMPRESSOR	O SYCHRONOUS GENERATOR
12	AXIAL COMPRESSOR	O INDUCTION GENERATOR
13	CENTRIFUGAL PUMP	O OTHER
14	SERVICE REQUIREMENTS	
15	MECHANICAL DRIVE	GENERATOR DRIVE
16	O SPEED CONTROL BY:	O DROOP CONTROL
17	PROCESS VARIABLE O PRESSURE O FLOW	© FREQUENCY CONTROL
18	EXTRACTION O PRESSURE O FLOW	O LOAD CONTROL
19	INDUCTION O PRESSURE O FLOW	○ KW CONTROL
20	TURBINE INLET O PRESSURE O FLOW	○ KW IMPORT / EXPORT CONTROL
21	TURBINE EXHAUST O PRESSURE O FLOW	○ LOAD SHEDDING
22	OTHER	O AUTOMATIC SYNCHRONIZATION
23		O AUTOMATIC VOLTAGE REGULATION
24		O TURBINE INLET PRESSURE LIMITING
25		○ INLET PRESSURE LIMITER
26	INPUT/OUTPUT REQUIREMENTS	
27	DISCRETE INPUTS	DISCRETE OUTPUTS
28	O START OR RESET	O COMMON SHUTDOWN
29	O NORMAL STOP	O COMMON ALARM
30	© EMERGENCY TRIP	OVERSPEED TRIPr/min
31	O RAISE SPEED	REMOTE SPEED SETPOINT ENABLED
32	O LOWER SPEED	O PRESSURE CONTROL ENABLED
	© ENABLE/DISABLE REMOTE SPEED SETPOINT	FLOW CONTROL ENABLED     EYTRACTION CONTROL ENABLED
34	O RAMP TO MINIMUM CONTINUOUS OVERSPEED TEST ENABLE	EXTRACTION CONTROL ENABLED     INDUCTION CONTROL ENABLED
35		O INDUCTION CONTROL ENABLED O SPEED BICKLIP ALARM
36 37	ENABLE PRESSURE CONTROL     ENABLE EXTRACTION CONTROL	○ SPEED PICKUP ALARM ○ OTHER
38	REMOTE ALARM CLEAR/ACKNOWLEDGE	OTHER
	REMOTE ALARM CLEAR/ACKNOWLEDGE     ENABLE AUTO SYNCHRONIZE	
39 40	CASCADE RAISE/LOWER	ANALOG OUTPUTS (4 mA to 20 mA)
41	O OTHER	SPEED
41	ANALOG INPUTS (4 mA to 20 mA)	SPEED SETPOINT
43		REMOTE SPEED SETPOINT
44	O PROCESS PRESSURE	EXTRACTION PRESSURE
45	O EXTRACTION O PRESSURE O FLOW	EXTRACTION PRESSURE     EXTRACTION PRESSURE SETPOINT
46	O kW IND. LOAD O PRESSURE O FLOW	ACTUATOR POSITION
47	O kW IMPORT / EXPORT	O PROCESS PRESSURE
48	O OTHER	O kW
49		. ○ kW IMPORT/EXPORT
50		·
51		

		JOB NO.	ITEM NO.	
	SPECIAL-PURPOSE STEAM TURBINE	REVISION NO.	DATE	
	DATA SHEET	PAGE 8	OF 10 BY	
	US CUSTOMARY UNITS			
1	GOVERNOR INSTALLATION REQUIREMENTS			
2	LOCATION O LOCAL (AT TURBINE)	MOUNTING	O FLUSH MOUNT IN PANEL	O SURFACE MOUNT
3	REMOTE (CONTROL ROOM)		O VERTICAL RACK	
4	OTHER	POWER SOURCE	SINGLE DUAL	
5	O AREA CLASSIFICATION:	120 V (a.c.)	0 0	
6	CLASS GROUP DIVISION	220 V (a.c.)	0 0	
7	ZONEGROUPTEMP. RATING:	125 V (d.c.)	0 0	
8	ENCLOSURE O IP65	24 V (d.c.)	0 0	
9	O NEMA 4		_ 0 0	
10	O NEMA 4X		_ 0 0	
11	OTHER			
12	LOCAL GOVERNOR CONTROL PANEL O REQUIRED	O NOT REQUIRE	ED	
13	LOCATION O LOCAL (AT TURBINE)	<u>ENCLOSURE</u>	O IP65	
14	O REMOTE CONTROL ROOM		O NEMA 4 O NEMA	A 4X
15	O OTHER		O OTHER	
16			O AREA CLASIFICATION	
17	OUTPUTS FROM PANEL TO GOVERNOR		CLASSGROUP_	
18	O START		ZONEGROUP_	TEMP. RATING:
19	O TRIP		FROM GOVERNOR	
20	O RAISE	$\cup$	I ALARM TRIP	
21	OLOWER	○ TRIP LAM		
22	O OVERSPEED TEST	$\cup$	SETPOINT ENABLED LAMP	
23	O RAMP TO MINIMUM CONTINUOUS	_	ETPOINT METER	
24	© REMOTE SETPOINT ENABLE/DISABLE	O OTHER _		
25	RESET			
26	O OTHER			
27	MISCELLANEOUS GOVERNOR DETAILS			
28	GOVERNOR ACTION ON LOSS OF REMOTE SIGNAL:	_	(S ON LAST VALUE	
29		_	S TO MINIMUM CONTINUOUS	
30		○ GOES	S TO MAXIMUM CONTINUOUS	
31				
	_	_	PHIC DISPLAY	
33	○ CRT		ILAR DATA	
34	○ MODEM		IDING (REAL TIME)	
35	O BIOTRIBUTU /F COLUTE COLUTE COLUMN	∪ HISTO	ORICAL ARCHIVING	
36	O DISTRIBUTIVE CONTROL SYSTEM MANUFACTURER	<u> </u>	O MODEL	
37	DATA TRANSMISSION O DATA LINK	∪ F	PROTOCOL	
38	O DISCRETE I/O O NETWORK TYPE			
39	O NETWORK TYPE			
40 41	GOVERNOR SPEED PICKUP SENSORS(12.2.6):			
42	MANUFACTURER MODEL	INSTALLATION: (	O DUAL O TRIPLE O I	NSTALLED SPAPE
43	NUMBER OF TEETH IN SPEED SENSING SURFACE	OITILLATION.	- 56/1E - 11(III EE - 1	
44				
	ACTUATOR(S): SUPPLIED BY	O MANUFACTUE	RER O	MODEL
			TI COIL O OTHER	· · · <del></del>
46				
47	TURBINE MOUNTED ACCESSORIES			
47	TACHOMETER O MANUFACTURER	O MODEL_	O NUM	BER REQUIRED.
48	O LOCATION(S)			
49				
50				


						JOB NO.		ITEM NO.
	SPECIA	AL-PURP			BINE	REVISION	_	DATE
			TA SHEE			PAGE	9	OF 10 BY
_	OVERSPEED SH	US CUST		JNI15				
1	OVERSPEED SH		31 EWI(12.3)			O NILIMBI		EETH IN SPEED SENSING SURFACE
2	O MANUFACTI			OMODEL		O SOLEN		
4	ELECTRONI	-	-	○ MODEL	-	r/min	IOIDS SI	O ENERGIZE TO TRIP     O ENERGIZE TO TRIP
5		D SHUTDOWN		ENTS		CONTA	лсте ен	
6	O 2 OUT OF 3			21110		001417	1010 011	NORMALLY CLOSED
7	OTHER		(			O VOLTA	GE LEVE	
8								
9								
10	GLAND SEALING	G AND VACUL	JM SYSTEM(	15.6)				
11	SYSTEM PER:	O ANNEX		ANNEX G.2			O VA	ACUUM SYSTEM FURNISHED BY
12		OTHER					O SH	HIP LOOSE SKID MOUNTED
13	O AVAIL. HEAD	DER PRESSUI	RE	psig TEM	MPERATURE	°F	$\circ$	THER
14	O AVAILABLE	SEAL STEAM	SUPPLY PRE	SSURE	psig		O GI	LAND CONDENSOR, SEE SPECIFICATION
15	O AVAILABLE	SEAL STEAM	SUPPLY TEN	IPERATURE		°F	O s1	TEAM EJECTOR STEAM. PRESSUREpsig
16	SEALING ST	EAM PRESSU	JRE	psig	FLOW	lb/h		STM. FLOW LBS/HR.
17	SEALING ST	EAM. RELIEF	VALVE SET	PRESSURE		psig		ACUUM PUMP (15.6.2), SEE SPEC.
18	○ FURNISHED							ONDENSATE RECEIVER
19	☐ FLOW ADJU		S, TYPE				O LC	DOP SEAL HEIGHTft
20	O FURNISHED	BY					_	
21					INSPECTION	N AND TESTING (	16.2) (16	•
22								
23	O SHOP INSPE	ECTION (16.1.	4)					OBSVD WIT
24	EXTENT:	LINODEOTION						O CONTRACT ROTOR O O
25 26	REFERENCE	EINSPECTION	N CHECKLIST	"I"				SPARE ROTOR O  TEST W/JOB COUPLING
27	INSPECTION AN	D MATERIAL	TESTING					O TEST WISOB COOPEING O
28	O FINAL ASSE			ED (16.2.1.1.1	f)			O TEST TAPE GIVEN TO PURCH.
29		ATERIAL INSP		•	,			O POLAR PLOTS REQUIRED
30	COMPONENT	MAG PART		R.T.	U.T.	OBSVD	WIT	○ TEST W/JOB LUBE OIL CONSOLE ○
31	TRIP & T & T							
32	VALVE	0	0	0	0	0	$\circ$	OPTIONAL TESTS (16.3.4)
33	STM CHEST	0	0	0	0	0	$\circ$	OBSVD WIT
34	CASING	0	0	0	0	0	0	O PERFORMANCE (16.3.4.2)
35	PIPING	0	0	0	0	0	0	O COMPLETE UNIT (16.3.4.3)
36	ROTOR	0	0	0	0	0	0	0 0
37						0	0	AUXILIARY EQUIPMENT (16.3.4.4)
38	O HEAT STABI	, ,				0	0	O TRIP/TRIP & THROTTLE VALVE O O
39	CLEANLINES					0	0	O GLAND SEAL SYSTEM O O
40	<ul><li>HARDNESS</li><li>HYDRO TES</li></ul>	. ,				0	0	O GLAND VACUUM SYSTEM O O RELIEF VALVES O O
41	O BLADE SHA	, ,				0	0	O RELIEF VALVES O O
42 43	ROTOR BALANC		, NDARD (9.6.1	\(0 6 2\)		0	0	O CASING INTERNAL INSP (16.3.4.5)
44	ROTOR BALANC		H SPEED (9.6.			0	0	O COUPLING TO SHAFT FIT (ISO 10441)
45		_			SPEED(9.6.6	_	0	O TURNING GEAR O O
46		_			ALANCE CHE	, -	0	O OVERSPEED SHUTDOWN SYSTEM O
47	O FINAL SURF					0	Ö	○ GOVERNOR RESPONSE (16.3.4.10) ○
48	CRATING IN		, ,			Ō	0	O SOUND (16.3.4.11)
49	O SPARE ROT		,			0	$\circ$	O SPARE PARTS TESTS (16.3.4.7)
50	CASING JOI	NT LEAK TES	T (16.3.2.3)			0	$\circ$	0 0
l_,								

_			
		О.	ITEM NO.
	SPECIAL-PURPOSE STEAM TURBINE	ION NO.	DATE
	DATA SHEET	10 OF 10	BY
	US CUSTOMARY UNITS	10 OF 10	_ ы
H	MISCE	OUE	
1	PAINTING	EIGHTS:	
2		TURBINE	
3	MANUFACTURER'S STANDARD		lb
4	O OTHER	ROTOR	lb
5		TURBINE UPPER HALF C	
6	UNIT NAMEPLATE UNITS O U.S. CUSTOMARY O SI	MAXIMUM FOR MAINTEN	
7	SHIPMENT (16.4.1) (16.4.3.j)	TRIP / TRIP & THROTTLE	
8	O DOMESTIC O EXPORT	MISCELLANEOUS	lb
9	○ EXPORT BOXING REQD. ○ OUTDOOR STORAGE OVER 6 MONTHS	TOTAL SHIPPING MASS	lb
10	○ WATERPROOF BOXING REQUIRED		
11	SPARE ROTOR ASSEMBLY PACKAGED FOR:		
12	O HORIZONTAL STORAGE O VERTICAL STORAGE		
13	SPACE REQUIREMENTS:	ENDOR DRAWING & DATA	REQUIREMENTS (17)
14	COMPLETE UNIT: Lin Win H	ANNEX J	
15	CONTROL PANEL: Lin Win H	OTHER	
16	OTHER: L in W in H		
17	OTHER: L in W in H	·	
18	REMARKS AND ADDITIONAL REQUIREMENTS:	·	
19			
20			
21			
22			
23			
24			
25			
26			
27			
28			
29			
30			
31			
32			
33			
34			
35			
36			
37			
38			
39			
40			
41			
42			
43			
44 45			
45			
46			
47			
48			
49			

## **Annex B** (informative)


#### Steam turbine nomenclature

Figures B.1 and B.2 are included only to clarify the nomenclature for standard machine parts and are in no way intended to show preferred design solutions or establish any design requirements whatsoever. The machine parts depicted here might not all be present in each turbine or might have a different appearance, depending on the machine type selected by the vendor to suit the service specified by the purchaser. These figures have no influence on the compliance of a specific turbine design with this International Standard.

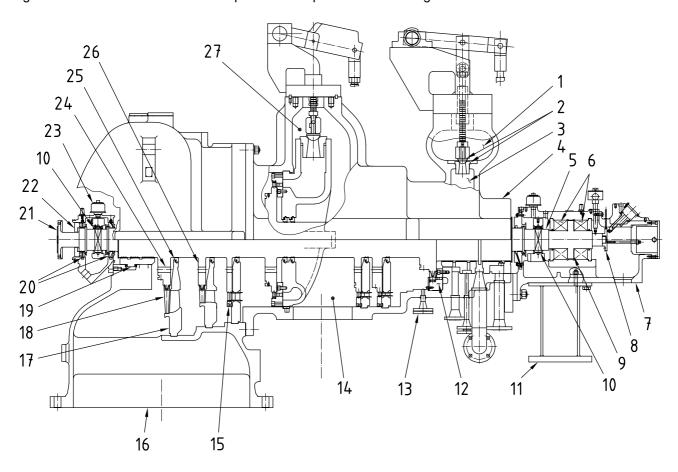

1	steam chest	10	journal bearing	19	shaft outer seals
2	inlet valves and seats	11	support	20	bearing housing end seals
3	nozzle chamber	12	control stage nozzle ring	21	rotor
4	casing	13	casing drain	22	bearing housing deflector
5	rotor shaft sensing area	14	controlled extraction/injection nozzle	23	breather/vent
6	thrust bearings	15	tip seal	24	steam balance hole
7	bearing housing	16	exhaust connection	25	interstage seals
8	multi-toothed speed sensing surface	17	diaphragm	26	wheel (disk)
9	thrust collar	18	rotor blades	27	LP section control valves

Figure B.1 — Typical impulse steam turbine nomenclature

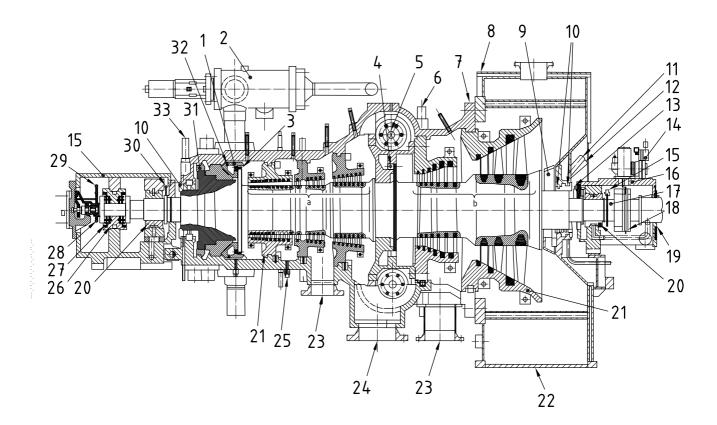

- <sup>a</sup> HP Reaction staging.
- b HR Reaction staging.

4	LID manufa alamant	40	and starm supply	22	blooding/inication name
ı	HP nozzle element	12	seal steam supply	23	bleeding/injection nozzle
2	inlet control valves	13	rotor ground	24	controlled extraction/injection nozzle
3	control stage impulse blading	14	turning gear	25	casing drain
4	LP nozzles inner casing	15	relative expansion pickup	26	thrust bearing
5	LP control valves	16	bearing housing	27	pads
6	balancing line	17	rotor	28	multi-toothed speed sensing surface
7	turbine casing	18	gear wheel	29	speed pickup
8	exhaust casing	19	bearing housing end seals	30	shaft vibration pickup
9	diffuser	20	journal bearing	31	balance piston
10	labyrinth seals	21	blade carrier	32	HP nozzles inner casing
11	waste steam nozzle	22	exhaust connection	33	balance line

Figure B.2 — Typical reaction steam turbine nomenclature

## Annex C

(normative)

## Procedures for determining residual unbalance

#### C.1 Scope

This annex specifies the procedure to be used to determine residual unbalance in machine rotors. Although some balancing machines may be set up to read out the exact amount of unbalance, the calibration can be in error. The only sure method of determining residual unbalance is to test the rotor with a known amount of unbalance.

#### C.2 Terms and definitions

For the purposes of this annex, the following terms and definitions apply.

#### C.2.1

#### residual unbalance

amount of unbalance remaining in a rotor after balancing

NOTE Unless otherwise specified, residual unbalance is expressed in g·mm (oz-in).

#### C.3 Maximum allowable residual unbalance

- The maximum allowable residual unbalance per plane shall be calculated in accordance with 9.6.2, using Equation (6).
- C.3.2 If the actual static load on each journal is not known, it shall be assumed that the total rotor mass is equally supported by the bearings.

**EXAMPLE** A two-bearing rotor with a mass of 2 700 kg (6 000 lb) would be assumed to impose a mass of 1 350 kg (3 000 lb) on each journal.

#### C.4 Residual unbalance check

#### C.4.1 General


- When the balancing machine readings indicate that the rotor has been balanced to within the specified tolerance, a residual unbalance check shall be performed before the rotor is removed from the balancing machine.
- To check the residual unbalance, a known trial mass is attached to the rotor sequentially in six equally spaced radial positions (or 12, if specified by the purchaser), each at the same radius. The check is run in each correction plane and the readings in each plane are plotted on a graph using the procedure specified in C.4.2.

#### C.4.2 Procedure

- **C.4.2.1** Select a trial mass and radius that is equivalent to between one and two times the maximum allowable residual unbalance [i.e., if  $U_{\text{max}}$  is 1 440 g·mm (2 oz-in), the trial mass should cause 1 440 g·mm to 2 880 g·mm (2 oz-in to 4 oz-in) of unbalance].
- **C.4.2.2** Starting at the last known heavy spot in each correction plane, mark off the specified number of radial positions (six or 12) in equal (60° or 30°) increments around the rotor. Add the trial mass to the last known heavy spot in one plane. If the rotor has been balanced very precisely and the final heavy spot cannot be determined, add the trial mass to any one of the marked radial positions.
- **C.4.2.3** To verify that an appropriate trial mass has been selected, operate the balancing machine and note the units of unbalance indicated on the meter. If the meter pegs, a smaller trial mass should be used. If little or no meter reading results, a larger trial mass should be used. Little or no meter reading generally indicates that the rotor was not balanced correctly, the balancing machine is not sensitive enough, or a balancing machine fault exists (i.e. a faulty pickup). Whatever the error, it shall be corrected before proceeding with the residual check.
- **C.4.2.4** Locate the mass at each of the equally spaced positions in turn, and record the amount of unbalance indicated on the meter for each position. Repeat the initial position as a check. All verification shall be performed using only one sensitivity range on the balance machine.
- **C.4.2.5** Plot the readings on the residual unbalance work sheet and calculate the amount of residual unbalance (see Figure C.1). The maximum meter reading occurs when the trial mass is added at the rotor's heavy spot; the minimum reading occurs when the trial mass is opposite the heavy spot. Thus, the plotted readings should form an approximate circle (see Figure C.2). An average of the maximum and minimum meter readings represents the effect of the trial mass. The distance of the circle's centre from the origin of the polar plot represents the residual unbalance in that plane.
- **C.4.2.6** Repeat the steps in accordance with C.4.2.1 to C.4.2.5 for each balance plane. If the specified maximum allowable residual unbalance has been exceeded in any balance plane, the rotor shall be balanced more precisely and checked again. If a correction is made to any balance plane, the residual unbalance check shall be repeated in all planes.
- **C.4.2.7** For stack component balanced rotors, a residual unbalance check shall be performed after the addition and balancing of the first rotor component, and at the completion of balancing of the entire rotor, as a minimum.
- NOTE This ensures that time is not wasted and rotor components are not subjected to unnecessary material removal in attempting to balance a multiple component rotor with a faulty balancing machine.

Equipment (rotor) No	).:		_	
Purchase order No.:			_	
Correction plane (inle	et, drive end, etc. — u	se sketch):		
Balancing speed:			_ r/min	
n = maximum allowal	ole rotor speed:		_ r/min	
m = mass of journal (	closest to this correcti	ion plane):		_ kg/lb
$U_{\text{max}}^{\dagger}$ = maximum allo	owable residual unbal	ance =		
6 350 m/n (4 n	n/n)			
6 350 ×	kg/ r/m	in; (4 min × lb/	r/min)	g·mm(oz-in)
Trial unbalance (2 ×				
R = radius (at which r	mass shall be placed)	:		
Trial unbalance mass			_	
		oz-in/ in)	g (07)	
	on: 1 ounce = 28,350		9 (0=)	
		9.4		
	Test data	T	Rotor sketch	1
	Position	Trial mass	Balancing machine	
	1	Angular location	Amplitude readout	-
	2	60°		-
	3	120°		-
	4	180°		
	5	240°		1
	6	300°		
	Repeat 1	0°		1
				-
Test Data — Graphi	-			
<b>Step 1:</b> Plot data or amplitudes fit conven		gure C.1 continued). So	cale the chart so the	largest and smallest
Step 2: With a comp	ass, draw the best fit	circle through the six po	oints and mark the cen	tre of this circle.
Step 3: Measure the scale chosen in Step	diameter of the circle 1 and record.		units	
Step 4: Record the tr	rial unbalance from ab	oove	g·mm (oz-	-in)
Step 5: Double the tr	rial unbalance in Step lual unbalance).		g·mm (oz-	-in)
	nswer in Step 5 by the		Scale fact	
A correlation has now	v been made betweer	the units on the polar	chart and the actual ba	alance.

Figure C.1 — Residual unbalance work sheet

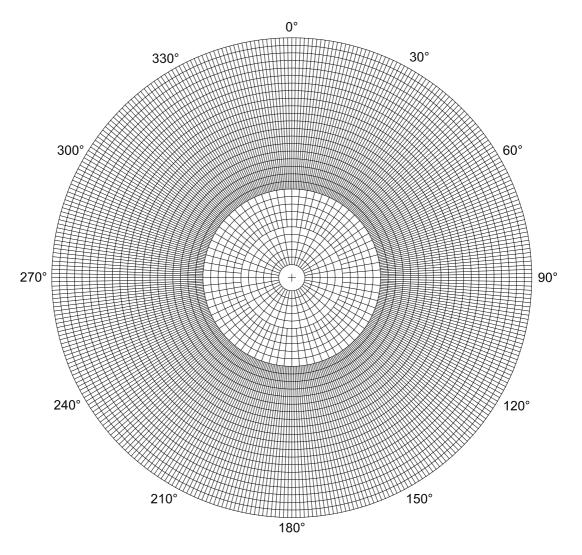

The circle drawn shall contain the origin of the polar chart. If it doesn't, the residual unbalance of the rotor exceeds the applied test unbalance.

NOTE Several possibilities for the drawn circle not including the origin of the polar chart are: operator error during balancing, a faulty balancing machine pickup or cable, or the balancing machine is not sensitive enough.

If the circle does contain the origin of the polar chart, the distance between origin of the chart and the centre of the circle is the actual residual unbalance present on the rotor correction plane. Measure the distance in units of scale chosen in Step 1 and multiply this number by the scale factor determined in Step 6. Distance in units of scale between origin and centre of the circle times scale factor equals actual residual unbalance.


Record actual residual unba	alance	(g·mm)(oz-in)
Record allowable residual u	nbalance (from Figure C.1)	(g·mm)(oz-in)
Correction plane	for rotor No	(has/has not) passed
Ву	Date	

Figure C.1 — Residual unbalance worksheet (continued)

Equipment (rotor) No	ı.:	C-101	<u> </u>		
Purchase order No.:			_		
Correction plane (inle	et, drive end, etc.—use	sketch):		Α	_
Balancing speed:		800	_ r/min		
n = maximum allowal	ole rotor speed:	10 000	_ r/min		
m = mass of journal (	closest to this correctio	n plane):		908	<del>kg</del> lb
$U_{\sf max}$ = maximum allo	owable residual unbalar	nce =			
6 350 m/n (4 m	/n)				
6350 ×	, <u>kg/r/min;</u> (4 ×	908 lb/10 000 r/min)	(	),36	<del>g·mm</del> (oz-in)
Trial unbalance (2 ×	$U_{\sf max})$	0,72	<del>g·mm</del> (c	z-in)	
R = radius (at which r	mass shall be placed):		mm (in)	·	
Trial unbalance mass	s = Trial unbalance/R		_		
g·mm/	mm 0,72 oz-in/ 6,8	<u></u>	_	0,10	g (oz)
Conversion Informati	on: 1 ounce = 28,350 g	rams			
	Test data		Rote	or sketch	
	103t data	Trial mass	1	ng machine	1
	Position	Angular location		ide readout	
	1	0°		14,0	1
	2	60°		12,0	
	3	120°		14,0	
	4	180°		23,5	
	5	240°		23,0	
	6	300°		15,5	
	Repeat 1	0°		13,5	
Test Data — Graphi	c Analysis				
-	the polar chart (Figure	C.2 continued). Scale	the chart	so the large	st and smallest
Step 2: With a comp					
	ass, draw the best fit ci	rcle through the six po	oints and	mark the cen	tre of this circle.
Step 3: Measure the scale chosen in Step	diameter of the circle in		oints and	mark the cen _ units	tre of this circle.
scale chosen in Step	diameter of the circle in	n units of			
scale chosen in Step <b>Step 4:</b> Record the tr	diameter of the circle in 1 and record.  Tial unbalance from about it is a second	n units of	35	_ units	n)

Figure C.2 — Sample calculations for residual unbalance

A correlation has now been made between the units on the polar chart and the actual balance.

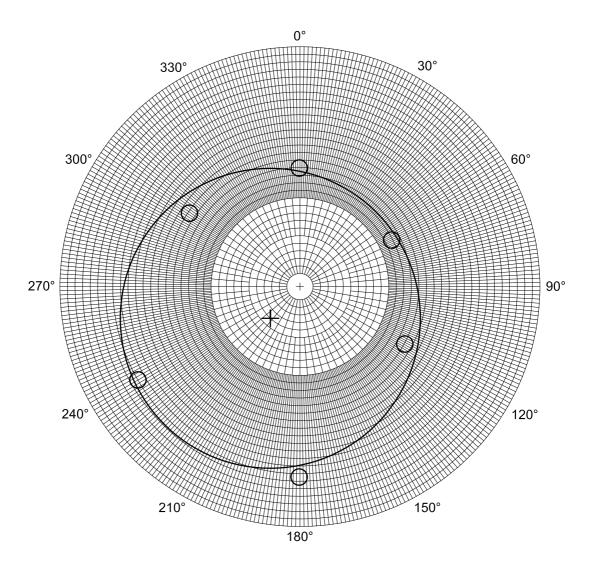

The circle you have drawn must contain the origin of the polar chart. If it doesn't, the residual unbalance of the rotor exceeds the applied test unbalance.

NOTE Several possibilities for the drawn circle not including the origin of the polar chart are: operator error during balancing, a faulty balancing machine pickup or cable, or the balancing machine is not sensitive enough.

If the circle does contain the origin of the polar chart, the distance between origin of the chart and the centre of your circle is the actual residual unbalance present on the rotor correction plane. Measure the distance in units of scale chosen in Step 1 and multiply this number by the scale factor determined in Step 6. Distance in units of scale between origin and centre of the circle times scale factor equals actual residual unbalance.

Record actual resid	lual unbalance	e <u> </u>	5 (0,041)	= 0,21	_ ( <del>g·mm</del> )(oz-in)
Record allowable re	esidual unbala	ınce (from Figur	re C.1)	0,36	( <del>g·mm</del> )(oz-in)
Correction plane	Α	for rotor No.		C-101	_ (has/ <del>has not</del> ) passed.
Ву	John Inspecto	r	Date		11-31-94

Figure C.2 — Sample calculations for residual unbalance (continued)

## Annex D

(informative)

## Alarm and shutdown systems

NOTE The requirements of 12.4.7 a) to 12.4.7 c), and 12.4.9 b) may be satisfied in many ways. For the guidance of the purchasers and vendors, three possible arrangements which satisfy these requirements are described below.

#### **D.1 Arrangement 1**

- Alarms and shutdowns are initiated by conventional, locally mounted, direct-acting switches.
- D.1.2 Alarms and shutdown switches are completely independent of each other.
- Each alarm and shutdown switch is furnished in a separate housing, located to facilitate inspection and maintenance. Switch settings are not adjustable from outside the housing.
- D.1.4 Alarm switches and, if specified, shutdown switches are connected through normally energized, fail-safe circuits. The shutdown circuit wiring is completely independent from the alarm circuit wiring and is run in a separate conduit or armoured cable.
- The necessary switches, links and other features are provided to enable the system to be tested. Warning devices are incorporated to indicate when any part of the system is disarmed.

#### D.2 Arrangement 2

- Shutdowns are initiated by local, direct-acting switches connected as described in Arrangement 1 D.2.1 (see D.1).
- D.2.2 Alarms operate through locally mounted transmitters (electronic or pneumatic) connected to either separate panel mounted switches or to a multi-point scanning type instrument.
- D.2.3 Where a multi-point scanning type instrument is used, the alarm setting for each parameter is separately and independently adjustable.
- D.2.4 As in Arrangement 1, the necessary switches, links, and other features, together with the associated warning devices, are provided to enable the system to be tested.

#### D.3 Arrangement 3

- For each parameter for which both an alarm and a shutdown is specified, three separate and independent electronic transmitters are provided.
- Each transmitter associated with each measured parameter is independently connected to a different one of three multi-point, electronic scanning type instruments. Connections are made through separate cables.
- D.3.3 Each multi-point instrument provides both an alarm and shutdown output, separately and independently adjustable for each transmitted output.

- **D.3.4** The shutdown and alarm function outputs from the three multi-point instruments are connected through a suitable voting logic system. The system is such that operation of any one alarm or shutdown function shall initiate an alarm; operation of two shutdown functions monitoring the same parameter shall initiate a separate alarm and cause the equipment to shut down. If specified, the voting logic system is duplicated or otherwise provided with suitable redundancy.
- **D.3.5** Alarm functions which are not associated with a shutdown function, are each provided with one single transmitter. These alarm transmitters may be connected to one of the three multi-point alarm/shutdown instruments or to a separate multi-point instrument.
- **D.3.6** Features that enable each transmitter to be tested are provided but disarming switches or links are not required.

NOTE Arrangement 3 has the following advantages:

- any shutdown or alarm function can be tested at any time with equipment in service and without the need to disarm any part of the system;
- failure of any one component shall initiate an alarm but shall not result in equipment shutdown;
- the use of modern digital instrument technology is facilitated.

# Annex E (normative)

### Coupling guards

#### **E.1 Introduction**

This annex covers the minimum requirements for guards to be used with special-purpose couplings. This information is added as a convenience to the owner or the contractor in specifying the total requirements for the driving and driven equipment system. Coupling guards are usually furnished by the machinery vendor rather than by the manufacturer of the coupling.

#### E.2 General requirements for all guards

- **E.2.1** The purchaser shall designate who is to coordinate and be responsible for the supply of all coupling guards in the equipment train.
- **E.2.2** The purchaser shall specify the types of guards that are required.
  - **E.2.3** Each coupling shall have a coupling guard that sufficiently encloses the coupling and shafts to prevent any personnel from accessing the danger zone during operation of the equipment train.
  - **E.2.4** The guard shall be readily removable for inspection and maintenance of the coupling without disturbance of the coupled machines.
  - **E.2.5** The guard shall be constructed to be rigid enough to withstand a 1 000 N (200 lbf) static load with a deflection of not more than 0,000 5 times the unsupported length of the guard.
  - **E.2.6** The guard shall comply with the requirements of any local code or regulation.
  - **E.2.7** If specified by the purchaser, the guard shall be oiltight.
  - **E.2.8** The guard shall contain anti-swirl baffles as required to minimize the effects of windage and oil swirl.
- **E.2.9** If specified, the guard shall be fabricated from spark-resistant materials. A description of the materials of construction shall be submitted to the purchaser for approval.
  - **E.2.10** Guards shall preferably be tubular in shape and shall be axially split with provision at each end for connection to the coupled equipment. If a slip joint is required at one end of the guard, the joint shall be provided with two O-rings. Alternatively, expansion may be accommodated by using a flexible diaphragm.
  - **E.2.11** The vendor shall include adapting flanges, if these are required to mate the guard to the associated components of the equipment train.
  - **E.2.12** A baffled vent connection DN 25 (NPS 1) minimum shall be provided. Unless otherwise specified, a threaded filter breather shall be supplied. The vent shall be flanged for connection to the bearing-oil vent system of the equipment train, in which case the filter breather is not required.
- **E.2.13** If specified, the guard shall be fitted with a connection for purging with dry air or an inert gas. This is necessary when unusually corrosive conditions exist.
- **E.2.14** If specified, the contract guard shall be used when the contact coupling is factory tested with the driver and driven equipment.

#### E.3 Guards for continuously lubricated couplings

- Each oil-spray nozzle shall be positively fastened to the guard in the proper orientation, and the mounting shall ensure that this orientation is easily re-established if removal of the nozzle is required for maintenance. Friction clamping of nozzles or tubing is unacceptable.
- E.3.2 Guards shall be designed to remain oiltight for at least five years of operation.
- E.3.3 A flanged oil-drain connection DN 25 (NPS 1) or larger in size shall be provided for each guard.
- If specified by the purchaser, a transparent window shall be provided to permit safe inspection of each oil spray while the coupling is in service.


#### E.4 Guards for flexible-disk couplings

- If specified, guards shall be designed to be essentially airtight at the radial and axial flanged joints and at the slip joint, if any. The design of the guards shall minimize the potential heating caused by windage.
  - A flanged oil-drain connection DN 25 (NPS 1) or larger in size shall be provided to handle any oil carry over from the coupled equipment into the guard.


## **Annex F** (informative)

## Foundation drawings

See Figures F.1 to F.4.



Top view of foundation at foundation bolt

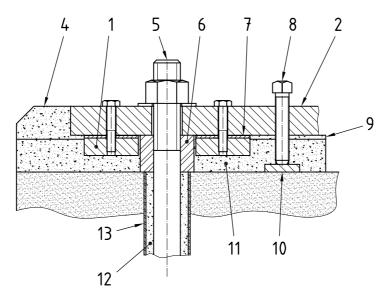


#### Cross-section of foundation at foundation bolt


#### Key

1 subplate 6 anchor bolt sleeve grout seal 11 epoxy grout 7 shims 2 soleplate 12 nonbonding fill capscrew 8 levelling jackscrew anchor bolt sleeve 3 13 grout level for shim access 4 final grout level after shimming is complete 9 5 anchor bolt levelling plate

Figure F.1 — Typical mounting plate arrangement — Soleplate with subplate

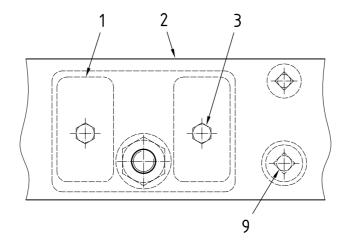

#### a) Top view of foundation at foundation bolt

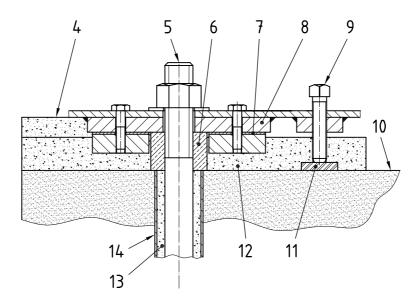


#### b) Cross-section of foundation at foundation bolt


- 1 subplate
- 2 baseplate beam
- 3 capscrew
- 4 optional full bed grout level after shimming is complete
- 5 anchor bolt

- 6 anchor bolt sleeve grout seal
- 7 shims
- 8 baseplate mounting pad
- 9 levelling jackscrew
- 10 grout level for shim access
- 11 levelling plate
- 12 epoxy grout
- 13 nonbonding fill
- 14 anchor bolt sleeve

Figure F.2 — Typical mounting plate arrangement — Baseplate with subplate

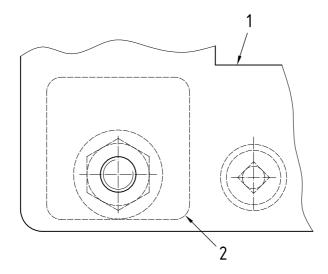


Top view of foundation at foundation bolt

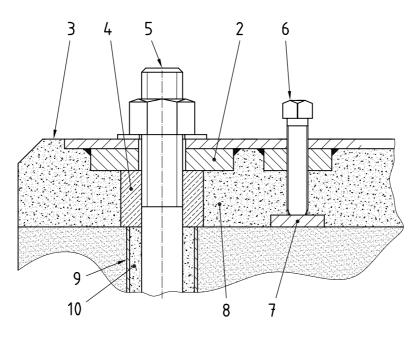


#### Cross-section of foundation at foundation bolt

- 1 baseplate beam
- baseplate mounting pad
- 3 grout level
- 4 anchor bolt sleeve grout seal
- 5 anchor bolt
- levelling jackscrew
- levelling plate
- 8 epoxy grout
- 9 anchor bolt sleeve
- 10 nonbonding fill

Figure F.3 — Typical mounting plate arrangement — Baseplate without subplates



#### Top view of foundation at foundation bolt

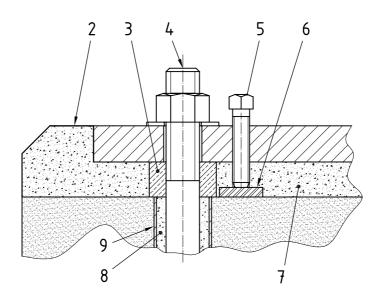

#### Cross-section of foundation at foundation bolt


1	soleplate	4	anchor bolt	7	epoxy grout
2	grout level	5	levelling jackscrew	8	nonbonding fill
3	anchor bolt sleeve grout seal	6	levelling plate	9	anchor bolt sleeve

Figure F.4 — Typical mounting plate arrangement — Soleplate without subplates

## **Annex G** (informative)

# Gland sealing and leak-off system


See Figures G.1 and G.2.

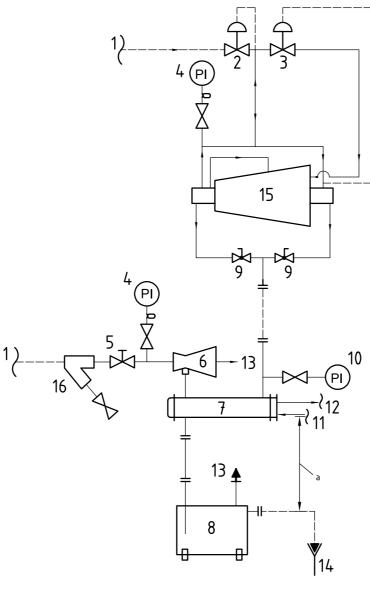

#### Key

gland condenser 1 dry steam supply 7 12 cooling water return 2 pressure reducing valve 8 condensate seal tank 13 vent 3 back-pressure regulator flow adjusting valve (only if specified) drain 4 pressure gauge 10 vacuum gauge turbine 5 flow-control valve cooling water supply steam strainer 6 air ejector (vacuum pump when specified) vendor supply purchaser supply  $\geqslant$  900 mm (3 ft).

Figure G.1 — Typical gland sealing and leak-off system for condensing turbines

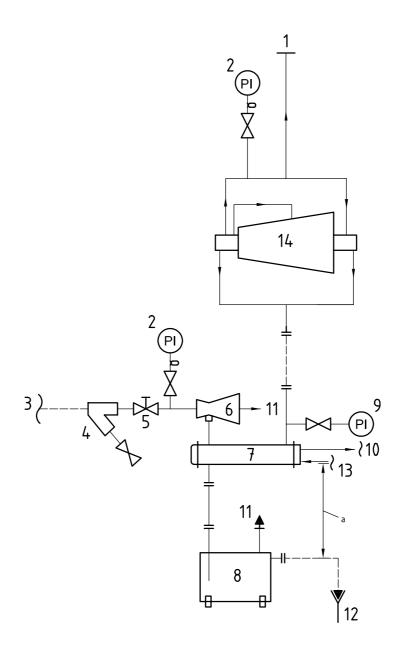

#### Key

1	low pressure steam header	6	air ejector (vacuum pump when specified)	11	vent
2	pressure gauge	7	gland condenser	12	drain
3	dry steam supply	8	condensate receiver	13	cooling water supply
4	steam strainer	9	vacuum gauge	14	turbine
5	flow-control valve	10	cooling water return		
а	≥ 900 mm (3 ft).				

Figure G.2 — Typical gland leak-off system for back-pressure turbines

vendor supply purchaser supply

# **Annex H**

(informative)

# **Typical inspection of components**

See Table H.1.

Table H.1 — Component inspection

Туре	Component	Mechanical property analysis	Chemical analysis	Ultrasonic test	Local X-ray test	Test for surface cracks
Forged or rolled components	Wheel discs Shaft Balance pistons	Yes <sup>a</sup>	Product check analysis or cast analysis <sup>a</sup>	Yes	NR	Yes
	Stationary blade Carriers Steel casing	Yes <sup>a</sup>		NR		Yes <sup>b</sup>
	Rotor blades Guide blades	Y	res <sup>a</sup> NR		NR	
Welded components	Wheel discs Stationary blade Carriers	Yes <sup>a</sup>	Yes	If specified <sup>c</sup>		Yes, in welded areas
	Steel casings	Yes <sup>a</sup>	Yes	Yes	Yes <sup>d</sup>	Yes
Castings	Steel casings	Yes	Product check analysis or cast analysis <sup>a</sup>	For gauge pressure > 6 200 kPa (62 bar) (900 psi) or temperature > 440 °C (825 °F)	For gauge pressure > 8 600 kPa (86 bar) (1 250 psi) or temperature > 510 °C (950 °F)	Yes (on machined surfaces)
	Guide blade carriers			Yes	If specified	
	Nodular cast iron casings					
	Lamellar cast iron casings			Footnote <sup>c</sup>		
	Rotor blades	Y	es <sup>a</sup>	If specified <sup>c</sup>	Random checks	Footnote c

Typical surface magnetic particle inspection.

С The details of testing shall be agreed between purchaser and vendor.

Where practical on larger components.

# Annex I (informative)

# Inspector's checklist

See Table I.1.

Table I.1 — Inspector's checklist

Item	Reference subclause	Reviewed	Observed	Witnessed	Inspected by	Status
General						
Vendor data records	16.2.1.1					
Final assembly maintenance and clearances	16.2.1.1f)					
Surface and subsurface inspection	16.2.1.3					
Material Inspection						
Material inspection certification/testing	16.2.2					
Mechanical Inspection	1	ı	ı	1	1	
Stud markings	7.1.15d)					
Socket clearances	7.1.15e)					
Equipment feet (vertical and horizontal) jackscrews	7.1.18 15.3.1.2					
Foot/baseplate shims	15.3.1.12					
Nozzle flange dimensions	7.2.7					
Casing openings — size/finish	7.2.3 7.2.7					
Rotor identification	8.1.3					
Number of teeth for governor and overspeed shutdown system wheel	8.4 12.2.5					
Shaft finishes	8.2.1					
Shaft electrical and mechanical runout	8.2.2 9.6.9					
Shaft magnetic flux density	8.2.5					
Coupling fit	8.2.4					
Rotor balance (balance machine residual)	9.6.2 9.6.5					
Rotation arrow/nameplate data and units	6.2.2 6.2.3					
Mounting surfaces coated	15.3.1.7					
Mounting surfaces primed	15.3.1.7					
Oil system cleanliness	16.2.3.2					
Equipment cleanliness	16.2.3.3					
Material hardness	16.2.3.4					

Table I.1 — Inspector's checklist (continued)

ltem	Reference subclause	Reviewed	Observed	Witnessed	Inspected by	Status
Mechanical running test						
Contract shaft seals and bearings	16.3.3.1a)					
Oil flows, pressure, and temperature as specified	16.3.3.1b)					
No leaks observed	16.3.3.1 d)					
Protective devices operational	16.3.3.1e)					
Control devices operational	16.3.3.1e)					
Control instrumentation used	16.3.3.1g)					
Control system functional at specified speeds	16.3.3.2					
Four-hour test complete	16.3.3.2f)					
Lateral critical speeds as predicted	16.3.3.3c)					
Recordings complete	16.3.3.3e)					
Bearing inspection after test satisfactory	16.3.3.4					
Spare rotor fit and run	16.3.3.4 c)					
Optional Tests						
Performance test	16.3.4.2					
Complete unit test	16.3.4.3					
Auxiliary equipment test	16.3.4.4					
Post-test casing internal inspection	16.3.4.5					
Overspeed shutdown systems test	16.3.4.6					
Spare parts test	16.3.4.7					
Turning gear test	15.8.3					
Preparation for shipment						
Preparation complete	16.4.1					
Paint	16.4.3a)					
Rust preventative (exterior and interior)	16.4.3b) 16.4.3c)					
Tagging complete	16.4.3i) 16.4.5					
Installation instructions shipped	16.4.6					
Special tools complete	15.9.2					
Spare parts complete	17.3.3.2					
Studs installed	7.1.14					

# Annex J (informative)

# Vendor drawing and data requirements (VDDR)

J.1 Example VDDR form

Special purpose steam turbine vendor drawing						Job No.		_ Item No					
and data requirement					Purchase Order No.		_ Date:						
						Requisition No		_ Date:					
						Inquiry No		_ Date:					
						Page	of		_By _				
For_						Revision							
						Unit							
Serv	ice					No. Required							
	Ę.												
	F	Prop	osal	<sup>a</sup> Bidder shall furnish	copies of data for a	all items indicated by a	n X.						
	∫ F	Rev	iew <sup>b</sup>	Vendor shall furnish co	pies and trans	sparencies of drawings	and data ind	icated.					_
	F	ina	Ic	Vendor shall furnish co Vendor shall furnish op			and data ind	icated.					_
			ſ	Distribution record	Final – Receive Final – Due fror	d from vendor ———							
						ned from vendor ——					_		
					Review – Recei	ved from vendor —				$\neg$			
			_		Review – Due f	rom vendor ———							
1 1	1	1							۲	*	1	1	1
					Descrip	tion			]				
			a)	Certified dimensional outline	drawing and list o	of connections							
			b)	Cross-sectional drawing and	bill of materials								
			c)	Rotor assembly drawings and									
			d)	Thrust-bearing assembly dra									
		-+	e)	Journal-bearing assembly dra	_	f materials			<u> </u>				
			f)	Seal assembly drawing and b								<u> </u>	
		-+	g)	Shaft coupling assembly draw					<u> </u>				
	_	_	h)	Gland sealing and leak-off so								-	
	_	_	i)	Gland sealing and leak-off ar			ons		1				
		-	j)	Gland sealing and leak-off co		is and data			-			<u> </u>	
	-	-	k)	Lube-oil schematics and bill o		of connections			+			<u> </u>	
	-	-	l) m)	Lube-oil system arrangement Lube-oil component drawings		or connections			-			<b>-</b>	-
	-	-	n)	Electrical and instrumentation		hills of materials			+				<del>                                     </del>
	-	-	0)	Electrical and instrumentation			nections		+				
	_	-	p)	Control- and governor-system		•	ii icoliono		+				
	-	_	q)	Overspeed shutdown system					†				
		-+	r)	Curves showing steam flow v	•				1				
			s)	Curve showing steam flow ve		· '			1				
			t)	Curves showing steam flow v									
			u)	Curve showing steam flow ve	rsus valve lift								
			v)	Curves showing extraction/in		nce (certified)							
			w)	Steam correction factors (cer	tified)								
			x)	Blading vibration analysis									
		_	y)	Lateral critical speed analysis					<u> </u>				
			z)	Torsional critical speed analy	sis							<u> </u>	
		_	aa)	Transient torsional analysis					<u> </u>				
	$\bot$	-	pp)	Anticipated thermal movemen	nts for major conr	nections			<del>                                     </del>				<u> </u>
+	+	4	cc)	Coupling alignment diagram					<del>                                     </del>			<u> </u>	<del>                                     </del>
	+		dd)	Welding procedures for fabric	ation and repair				-				<del>                                     </del>
	+	_	ee)	Hydro test logs (certified)					-				-
+	+	_	ff)	Mechanical running test logs					+				-
+	+		gg)	Nondestructive test procedur	es				+				-
	+	_	hh) ii)	Mill test reports					+			<u> </u>	-
	I		11 <i>)</i>	Rotor balancing logs					ь	l		Щ.	<u> </u>

Proposal drawings and data do not have to be certified or as-built.

b Purchaser to indicate in this column the time frame for submission of materials using the nomenclature given at the end of this form.

Bidder shall complete these two columns to reflect the actual distribution schedule and include this form with the proposal

Data re	equirement			Item No				
	- q			Date:				
				Date:				
				Date:				
_				B				
For								
						-		
Service_		No. Required				-		
		copies of data for all items indicated b						
F	Review <sup>b</sup> Vendor shall furnish co	ppies and transparencies of drawi	ings and data in	dicated.				
F	Final <sup>c</sup> Vendor shall furnish co Vendor shall furnish op	pies andtransparencies of drawi perating and maintenance manuals.	ings and data in	dicated.				
	Distribution record	Final – Received from vendor — Final – Due from vendor — Review – Returned from vendor – Review – Received from vendor –						
↓ ↓ ,		Review – Due from vendor		1	, ,		ļ	ļ
		Description						
	jj) Rotor combined mechanical	and electrical runout.						
	kk) As-built data sheets.							
	II) As-built dimensions and data	а.						
	mm) Installation operation.							
	nn) Operating and maintenance	manuals.						
	oo) List of spare parts.					_	-	-
	pp) Progress reports and deliver	y schedule.			-			₩
	qq) Drawing list.				-	_	-	-
	rr) Shipping list. ss) List of special tools furnished	d for maintanance			-			+
	tt) Technical data manual.	d for maintenance.				-	-	-
	uu) Preservation, packaging and	I shinning procedures						+
	vv) Rigging and lifting instruction							+
	ww) Vibration-probe sensing area							1
	xx) Material Safety Data Sheets							_
a Pror	posal drawings and data do not have t			<u> </u>				
form.	chaser to indicate in this column the		_					f this
NOTE 1 drawings	The vendor ( shall) ( s is required in either case.)	shall not) proceed with mar	nufacturer upo	on receipt of the	e ord	er. (I	Revie	€W O
NOTE 2	Send all drawings and data to	:						
	All drawings and data must sation and unit. In addition to the allation must be forwarded with the							
NOTE 4 Nomencl		on the distribution schedule sha	all be received	d before final pa	ymer	nt is r	nade	<del>)</del> .
S	Number of weeks prior to ship	ment						
F	Number of weeks after firm or							
D	Number of weeks after receipt							
	Vendor refere							
Signature	e:	Signature acknowledges receipt of all ins	tructions)					

#### J.2 Description

A description of the components (see example VDDR form list in J.1) should be provided as follows.

- a) Certified dimensional outline drawing and list of connections, including the following:
  - 1) size, rating, and location of all customer connections;
  - approximate overall handling masses; 2)
  - 3) overall dimensions, maintenance clearances, and dismantling clearances;
  - shaft centreline height, denoting nominal shim dimension;
  - dimensions of baseplates (if furnished), complete with diameter, number and locations of bolt holes, thickness of the metal through which bolts must pass, and recommended clearance; centres of gravity; details for foundation design;
  - direction of rotation.
- Cross-sectional drawings and bill of materials, including the following:
  - 1) journal-bearing clearances and tolerances;
  - axial rotor float;
  - shaft end and internal labyrinth seal clearances and tolerances;
  - axial position of wheels(s), blades relative to inlet nozzles or vanes of diaphragms, and tolerance allowed;
  - radial clearances at blade tips.
- Rotor assembly drawing and bills of materials, including the following:
  - axial position from the active thrust-collar face to 1)
    - i) each wheel, inlet side (built-up rotors only),
    - each radial probe, ii)
    - iii) each journal-bearing centreline,
    - iv) phase-angle notch, and
    - coupling face or end of shaft;
  - thrust-collar assembly details, including
    - i) collar-shaft, with tolerance,
    - ii) concentricity (or axial runout) tolerance,
    - iii) required torque for locknut,
    - surface finish requirements for collar faces, and
    - preheat method and temperature requirements for shrunk-on collar installation;
  - dimensioned shaft ends for coupling mountings.

- d) Thrust-bearing assembly drawing and bill of materials.
- e) Journal-bearing assembly drawings and bills of materials.
- f) Seal assembly drawing and bills of materials.
- g) Shaft-coupling assembly drawings and bills of materials, including the following:
  - 1) hydraulic mounting procedure;
  - 2) shaft end gap and tolerance;
  - 3) coupling guards;
  - 4) thermal growth from a baseline of 15 °C (60 °F);
  - make, size, and serial number of coupling;
  - 6) axial natural frequency over allowable spacer stretch (disc-type couplings);
  - 7) balance tolerance;
  - 8) coupling "pull-up" mounting dimension;
  - 9) idling adapter details.
- Gland sealing and leak-off schematic and bill of materials, including the following:
  - 1) steady-rate and transient steam and air flows and pressures and temperatures;
  - 2) control-valve settings;
  - 3) utility requirements, including electrical, water, steam and air;
  - 4) pipe and valve sizes;
  - 5) instrumentation, safety devices and control schemes;
  - bill of materials.
- i) Gland sealing and leak-off arrangement drawing and list of connections, including size, rating and location of all customer connections.
- j) Gland sealing and leak-off component, and sectional drawings and data, including the following:
  - 1) gland-condenser outline drawing, bill of materials, and loop seal requirements;
  - 2) complete data sheets for condenser;
  - 3) air or water ejector drawing and performance curves;
  - 4) control valves and instrumentation;
  - 5) vacuum pump schematic, performance curves, cross-section, outline drawing and utility requirements (if pump is furnished).

- Lube-oil schematics and bills of materials, including the following:
  - steady-state and transient oil flows and pressures at each use point;
  - 2) control, alarm and trip settings (pressures and recommended temperatures);
  - 3) supply temperature and heat loads at each use point at maximum load;
  - 4) utility requirements, including electricity, water and air;
  - 5) pipe and valve size;
  - instrumentation, safety devices and control schemes; 6)
  - 7) relief valve set-points;
  - size and location of all restriction orifices (to be shown on schematic).
- Lube-oil system assembly and arrangement drawings, including size, rating and location of all customer connections.
- Lube-oil component drawings and data including the following:
  - pumps and drivers
    - certified dimensional outline drawing, i)
    - ii) cross-section and bill of materials,
    - iii) mechanical seal drawing and bill of materials,
    - performance curves for centrifugal pumps,
    - instruction and operating manuals, and v)
    - vi) completed data sheets for pumps and drivers;
  - coolers, filters, and reservoir
    - outline drawings, i)
    - maximum, minimum and normal liquid levels in reservoir, and
    - complete data form for coolers;
  - instrumentation
    - i) controllers,
    - ii) switches,
    - iii) control valves,
    - iv) gauges;
  - priced spare parts list(s) and recommendations.

- Electrical and instrumentation schematics and bills of materials, including the following:
  - 1) vibration alarm and shutdown setpoints;
  - 2) bearing temperature alarm and shutdown setpoints;
  - 3) axial shaft position alarm and shutdown setpoints.
- o) Electrical and instrumentation arrangement drawings and lists of connections.
- Control and governor system description and schematic, including the following:
  - 1) valve-lift sequence on multi-valve turbines and final settings;
  - 2) control-lever and actuator setting;
  - 3) control-system drawings, including I/O definition;
  - 4) control setting instructions;
  - 5) control-oil, bill of materials, and steady-state and transient flows and pressures at each use point;
  - 6) size and location of all restriction orifices (to be shown on schematic);
  - 7) governor bill of materials;
  - 8) control panel and operator interface devices;
  - 9) control logic diagram to describe system functionality, facilitate implementation of the control system and develop operator training.
- q) Overspeed shutdown system description, including schematic.
- r) Curves showing steam flow versus horsepower at normal and rated speeds with normal steam conditions.
- s) Curve showing steam flow versus first-stage pressure for multi-stage machines or versus nozzle-bowl pressure for single-stage machines at normal and rated speed with normal steam.
- t) Curves showing steam flow versus speed and efficiency at normal steam conditions.
- u) Curve showing steam flow versus valve lift.
- v) Curves showing extraction/induction performance.
- w) Steam-rate correction factors for the curves listed in r) to v) with off-design steam, as follows:
  - 1) inlet pressure to maximum and minimum values listed on the data sheets in increments agreed upon at the time of the order;
  - 2) inlet temperature to maximum and minimum values listed on the data sheets in increments agreed upon at the time of the order;
  - 3) speed from 80 % to 105 % in 5 % increments;
  - 4) exhaust pressure to maximum and minimum values listed on the data sheets in increments agreed upon at the time of the order.

- Blading vibration analysis data, including the following:
  - tabulation of all potential excitation sources, such as vanes, blades, nozzles and critical speeds;
  - Campbell diagram for each stage; 2)
  - Goodman diagram for each stage.
- Lateral critical speed analysis report, including, but not limited to, the following:
  - complete description of the method used;
  - graphic display of critical speeds versus operating needs; 2)
  - 3) graphic display of bearing and support stiffness and its effect on critical speeds;
  - graphic display of rotor response to unbalance (including damping);
  - 5) journal static loads;
  - 6) stiffness and damping coefficients;
  - tilting-pad bearing geometry and configuration, including
    - pad angle (arc) and number of pads, i)
    - pivot offset, ii)
    - pad clearance (with journal radius, pad bore radius, and bearing-set bore radius), and
    - iv) preload.
- Torsional critical speed analysis report, including but not limited to the following:
  - 1) complete description of the method used;
  - 2) graphic display of the mass elastic system;
  - tabulation identifying the mass moment and torsional stiffness of each component identified in the mass elastic system;
  - graphic display of exciting forces versus speed and frequency;
  - graphic display of torsional critical speeds and deflections (mode-shape diagram);
  - effects of alternative coupling on analysis.
- aa) Transient torsional analysis for all units using synchronous starter/helper motors (mandatory) or driving synchronous generators (optional).
- bb) Anticipated thermal movements referenced to a defined point for major connections referenced to a defined point.
- cc) Coupling alignment diagram, including recommended coupling limits during operation. Note all shaft-end position changes and support growth from a referenced ambient temperature of 15 °C (59 °F) or another temperature specified by the purchaser. Include the recommended alignment method and cold setting targets.
- dd) Welding procedures for fabrication and repair.

- ee) Certified hydro test logs.
- ff) Mechanical running test logs, including but not limited to the following:
  - 1) oil flows, pressures and temperatures;
  - 2) vibration, including an x-y plot of amplitude and phase angle versus revolutions per minute during start-up and coast-down;
  - 3) bearing metal temperatures;
  - 4) observed critical speeds (for flexible rotors);
  - 5) if specified, tape recordings of real-time vibration data;
  - 6) control data (16.3.3.2e).
- gg) Non-destructive test procedures and acceptance criteria as itemized on the purchase order data sheets or the vendor drawing and data requirements form.
- hh) Certified mill test reports of items as agreed upon in the pre-commitment or pre-inspection meetings.
- ii) Rotor balance logs, including a residual unbalance report in accordance with Annex C.
- jj) Rotor combined mechanical and electrical.
- kk) As-built data sheets.
- II) As-built dimensions (including nominal dimensions with design tolerances) and data for the following listed parts:
  - 1) shaft or sleeve diameters at
    - i) thrust collar (for separate collars),
    - ii) each seal component,
    - iii) each wheel (for stacked rotors) or bladed disk,
    - iv) each interstage labyrinth, and
    - v) each journal bearing;
  - 2) each wheel or disk bore (for stacked rotors) and outside diameter;
  - each labyrinth or seal-ring bore;
  - 4) thrust-collar bore (for separate collars);
  - each journal-bearing inside diameter;
  - 6) thrust-bearing concentricity (axial runout);
  - 7) thrust-bearing, journal-bearing, and seal clearances;
  - 8) metallurgy and heat treatment for
    - i) shaft,

		ii)	wheels or bladed disks,					
		iii)	thrust collar, and					
		iv)	blades, vanes, and nozzles.					
mm	) Ins	tallat	ion manual describing the following (see 17.3.4.2):					
	1)	stor	age procedures;					
	2)	foundation plan;						
	3)	grou	uting details;					
	4)	setting equipment, rigging procedures, component masses and lifting diagrams;						
	5)	coupling alignment diagram (as specified in cc);						
	6)	piping recommendations, including allowable flange loads;						
	7)	composite outline drawings for the driver/driven-equipment train, including anchor-bolt locations;						
	8)	dismantling clearances.						
nn)	Оре	perating and maintenance manuals describing the following (see 17.3.4.3):						
	1)	start-up;						
	2)	normal shutdown;						
	3)	eme	ergency shutdown;					
	4)	ope	rating limits or other operating restrictions and list of undesirable speeds;					
	5)	lube-oil recommendations and specifications;						
	6)	6) routine operational procedures, including recommended inspection schedules and procedur						
	7)	inst	ructions for					
		i)	disassembly and reassembly of rotor in casing,					
		ii)	rotor unstacking and restacking procedures,					
		iii)	disassembly and reassembly of journal bearings (for tilting-pad bearings, the instructions shall include "go/no-go" dimensions with tolerances for three-step plug gauges),					
		iv)	disassembly and reassembly of thrust bearing,					
		v)	disassembly and reassembly of seals (including maximum and minimum clearances),					
		vi)	disassembly and reassembly of thrust collar,					
		vii)	wheel re-blading procedures, and					
		viii)	boring procedures and torque values.					

- i) curves showing steam flow versus normal and rated power at rated speed, including extraction/induction curves when applicable,
- ii) curve showing steam flow versus first stage pressure,
- iii) curves showing steam flow versus speed and efficiency,
- iv) curve showing steam flow versus valve lift,
- v) curves showing extraction/induction,
- vi) steam condition correction factors (prefer monograph),
- vii) speed versus torque,
- viii) exhaust steam temperature versus power, and
- ix) first stage pressure versus thrust.
- vibration analysis data, as specified in x) to aa);
- 10) as-built data, including
  - i) as-built data sheets,
  - ii) as-built dimensions or data, including assembly clearances,
  - iii) hydro test logs, as specified in ee),
  - iv) mechanical running test logs, as specified in ff),
  - v) rotor balancing logs, as specified in ii),
  - vi) rotor mechanical and electrical runout at each journal, as specified in jj),
  - vii) physical and chemical mill certificates, as specified in hh), and
  - viii) test logs of all specified optional tests;
- 11) drawings and data, including
  - i) certified dimensional outline drawing and list of connections,
  - ii) cross-sectional drawing and bill of materials,
  - iii) rotor assembly drawings and bills of materials,
  - iv) thrust-bearing assembly drawing and bill of materials,
  - v) journal-bearing assembly drawings and bills of materials,
  - vi) seal-component drawing and bill of materials,
  - vii) lube-oil schematics and bills of materials,
  - viii) lube-oil assembly drawing and list of connections,

- lube-oil component drawings and data,
- X) electrical and instrumentation assembly drawings and bills of material,
- electrical and instrumentation assembly drawings and list of connections,
- xii) governor and control- and trip-system drawings and data,
- xiii) trip/combined trip and throttle-valve construction drawings.
- oo) Spare parts list with stocking level recommendations, in accordance with 17.3.3.2.
- pp) Progress reports and delivery schedule, including vendor buyouts and milestones.
- qq) Drawing list, including latest revision numbers and dates.
- Shipping list, including all major components that will ship separately. rr)
- List of special tools furnished for maintenance. ss)
- Technical data manual, including the following:
  - 1) as-built purchaser data sheets, as specified in kk);
  - 2) certified performance curves, as specified in r) to w);
  - drawings, in accordance with 17.3.2; 3)
  - as-built assembly clearances; 4)
  - 5) spare parts list, in accordance with 17.3.3.2;
  - utility data;
  - 7) vibration data, as specified in x);
  - 8) reports, as specified in y) to aa), cc), ii) and ss);
  - data sheets (e.g. Annex A).
- uu) Preservation, packaging, and shipping procedures.
- Recommended equipment rigging and lifting instructions [see 16.4.3 h)].
- ww) Vibration-probe sensing area/shaft drawing that accurately locates sensing areas on the shaft axis which are not to be metallized, sleeved, or plated.
- xx) Material safety data sheets (e.g. OSHA Form 174).

### **Bibliography**

- [1] ISO 3448, Industrial liquid lubricants ISO viscosity classification
- [2] ISO 10436, Petroleum and natural gas industries General-purpose steam turbines for refinery service
- [3] ISO 10494, Gas turbines and gas turbine sets Measurement of emitted airborne noise Engineering/survey method
- [4] API Std 611, General-purpose steam turbines for petroleum, chemical, and gas industry services
- [5] API Std 614, Lubrication, shaft-sealing, and control-oil systems and auxiliaries for petroleum, chemical and gas industry services
- [6] API Publication 684, Tutorial on the API standard paragraphs covering rotor dynamics and balancing: An introduction to lateral critical and train torsional analysis and rotor balancing
- [7] ASME B1.20.1, General Purpose (Inch) Pipe Threads
- [8] ASME B31.3, Process piping
- [9] ASTM A 515, Standard specification for pressure vessel plates, carbon steel, for intermediate- and higher-temperature service
- [10] ASTM B 127, Specification for nickel-copper alloy (UNS N04400) plate, sheet, and strip
- [11] ASTM E 1003, Standard test method for hydrostatic leak testing
- [12] OSHA Form 174, Material Safety Data Sheet (MSDS)<sup>12)</sup>

<sup>12)</sup> U.S. Department of Labor, Occupational Safety & Health Administration, 200 Constitution Avenue, Washington, DC 20210, USA.

ICS 27.040; 75.180.20

Price based on 113 pages